


SEE ARCHITECTURAL.

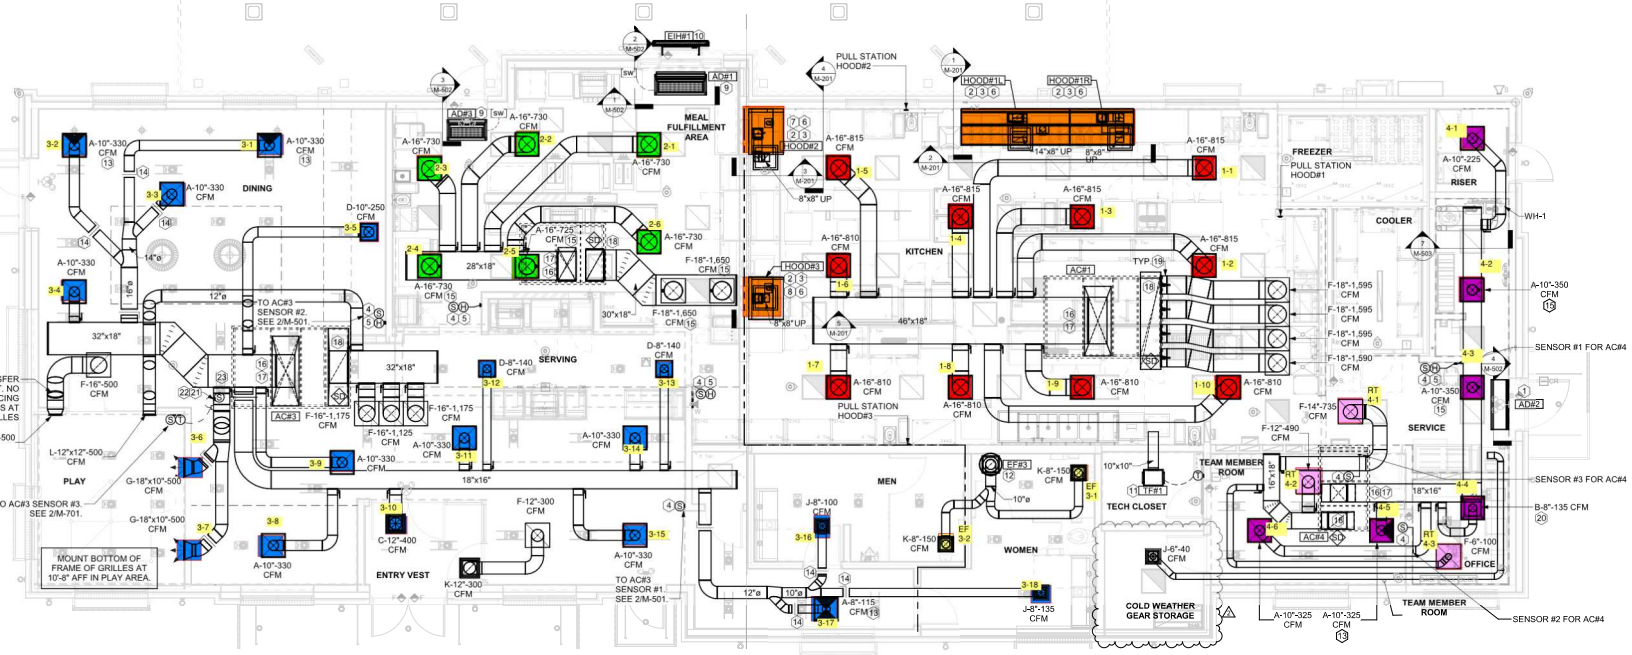

**AIR BALANCE SCHED**

Mark	SUPPLY AIR	RETURN AIR	OUTSIDE AIR
#1	8,125 CFM	6,375 CFM	1,750 CFM
#2	4,375 CFM	3,300 CFM	1,075 CFM
#3	5,250 CFM	3,975 CFM	1,275 CFM