


DRAWING NOTES

- EXISTING DUCTWORK TO REMAIN (TYPICAL).
- EXISTING VAV BOX TO REMAIN (TYPICAL).
- EXISTING HOT WATER PIPING TO REMAIN (TYPICAL).
- EXISTING THERMOSTAT TO REMAIN (TYPICAL).
- EXISTING PERIMETER FINITUBE TO REMAIN (TYPICAL).
- EXISTING EXHAUST SYSTEM TO REMAIN (TYPICAL).
- EXISTING RETURN AIR DUCT STUB FOR PLENUM RETURN AIR TO REMAIN.
- PROVIDE TRANSFER AIR DUCT.
- RELOCATED EXISTING VAV THERMOSTAT.
- RELOCATED EXISTING FINITUBE THERMOSTAT.
- EXISTING SLOT DIFFUSER AND ASSOCIATED DUCTWORK TO REMAIN.
- PROVIDE NEW VAV BOX THERMOSTAT WITH FINITUBE CONTROL INTERLOCK WITH VAV BOX.

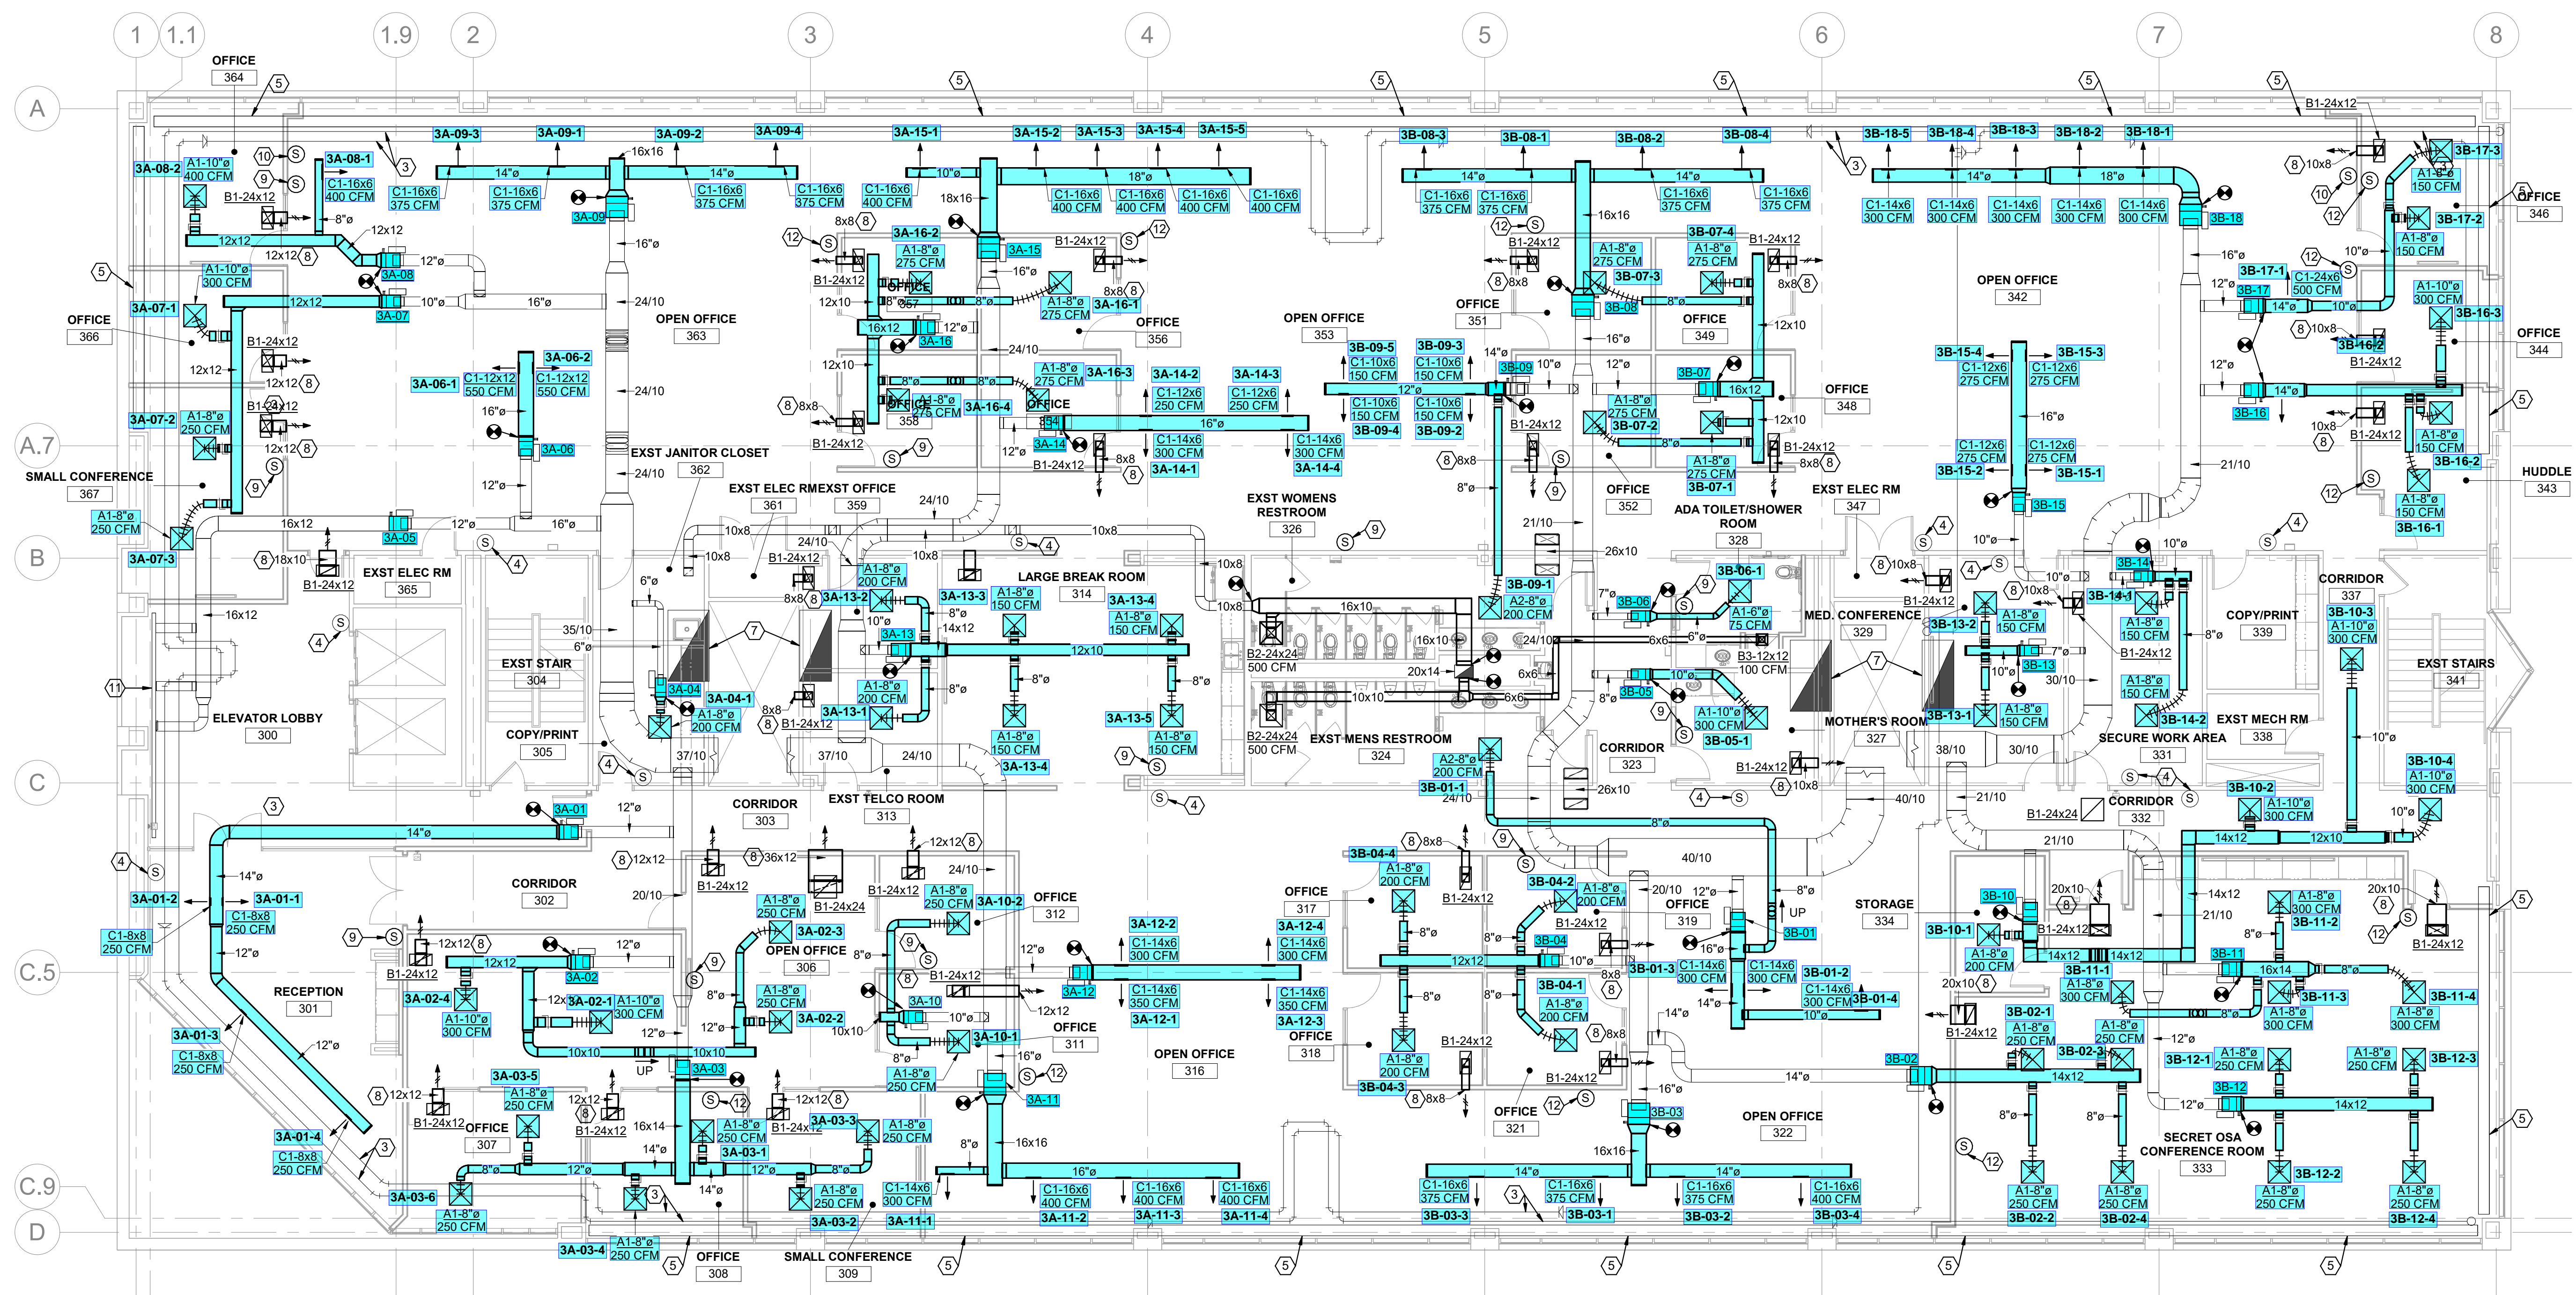

1 HVAC FLOOR PLAN - NEW WORK
1/8" = 1'-0"

Miamisburg Office Renovation

Sierra Nevada Corporation

9555 Springboro Pike
Miamisburg, Ohio
45342

ISSUANCES

No.	Description	Date
FOR BID/PERMIT		10/21/2024

Drawn By

KDB

Checked By

DST

Client No.

818

Project No.

7479

JEFFREY WETZEL
PE-76872
EXPIRATION DATE
12/31/2025

HVAC FLOOR PLAN -
NEW WORK