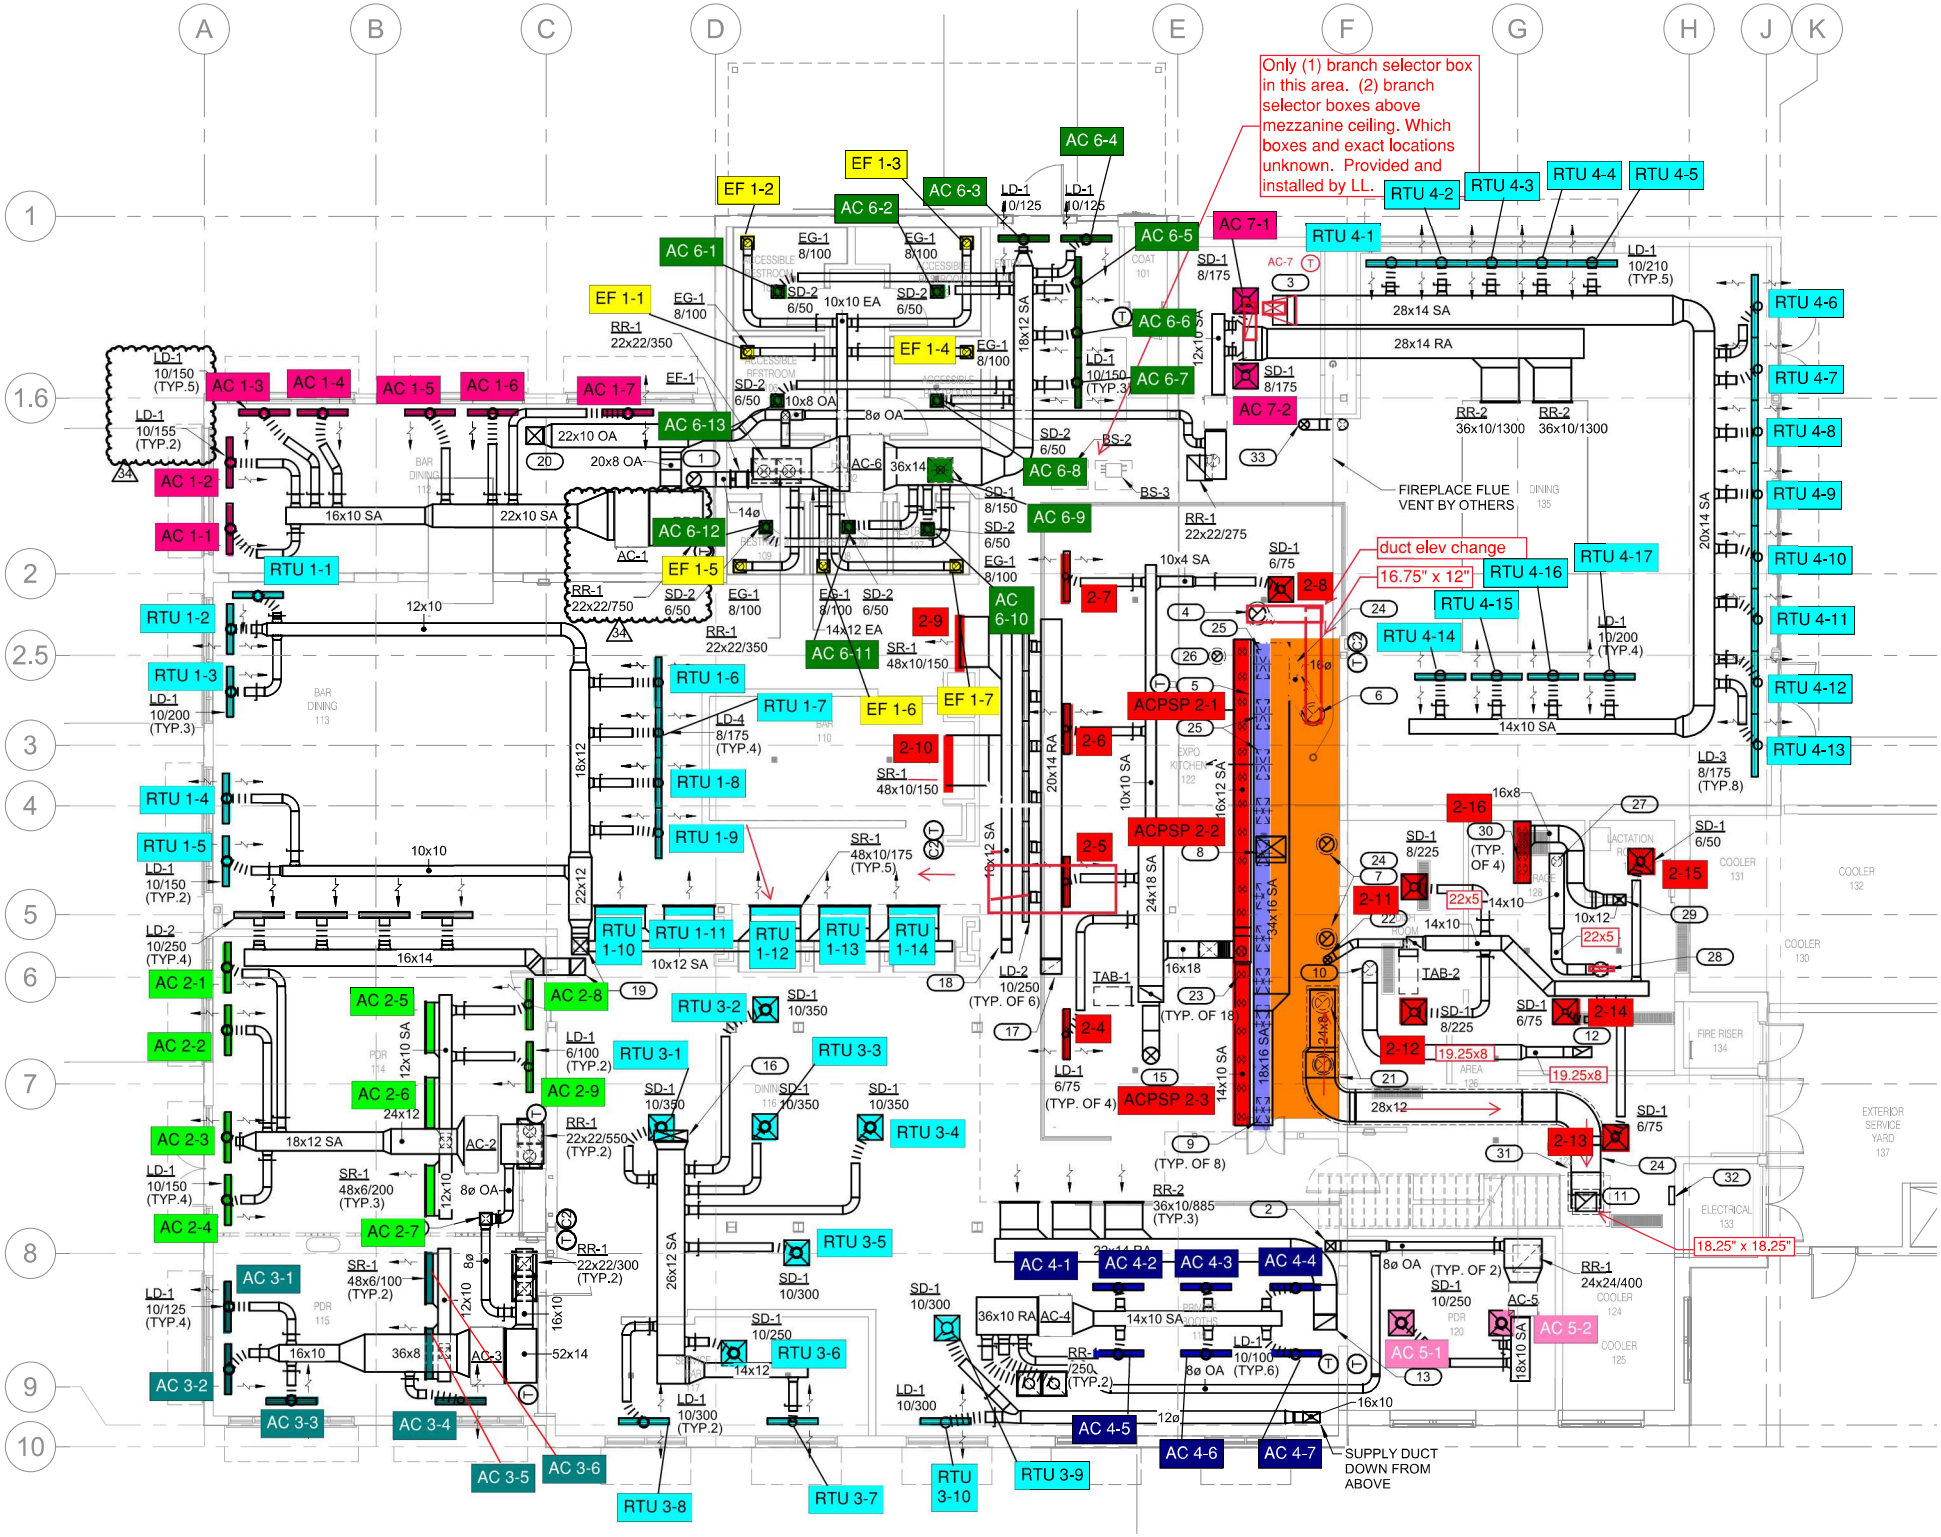
Only (1) branch selector box in this area. (2) branch selector boxes above mezzanine ceiling. Which boxes and exact locations unknown. Provided and installed by LL.
duct elev change
16.75" x 12"
18.25" x 18.25"
FIREPLACE FLUE VENT BY OTHERS
SUPPLY DUCT DOWN FROM ABOVE
AC 1-1
AC 1-2
AC 1-3
AC 1-4
AC 1-5
AC 1-6
AC 1-7
AC 2-1
AC 2-2
AC 2-3
AC 2-4
AC 2-5
AC 2-6
AC 2-7
AC 2-8
AC 2-9
AC 3-1
AC 3-2
AC 3-3
AC 3-4
AC 3-5
AC 3-6
AC 4-1
AC 4-2
AC 4-3
AC 4-4
AC 4-5
AC 4-6
AC 4-7
AC 5-1
AC 5-2
AC 6-1
AC 6-2
AC 6-3
AC 6-4
AC 6-5
AC 6-6
AC 6-7
AC 6-8
AC 6-9
AC 6-10
AC 6-11
AC 6-12
AC 6-13
AC 7-1
AC 7-2
EF 1-1
EF 1-2
EF 1-3
EF 1-4
EF 1-5
EF 1-6
EF 1-7
RTU 1-1
RTU 1-2
RTU 1-3
RTU 1-4
RTU 1-5
RTU 1-6
RTU 1-7
RTU 1-8
RTU 1-9
RTU 1-10
RTU 1-11
RTU 1-12
RTU 1-13
RTU 1-14
RTU 3-1
RTU 3-2
RTU 3-3
RTU 3-4
RTU 3-5
RTU 3-6
RTU 3-7
RTU 3-8
RTU 3-9
RTU 3-10
RTU 4-1
RTU 4-2
RTU 4-3
RTU 4-4
RTU 4-5
RTU 4-6
RTU 4-7
RTU 4-8
RTU 4-9
RTU 4-10
RTU 4-11
RTU 4-12
RTU 4-13
RTU 4-14
RTU 4-15
RTU 4-16
RTU 4-17
ACPSP 2-1
ACPSP 2-2
ACPSP 2-3
2-2
2-3
2-4
2-5
2-6
2-7
2-8
2-9
2-10
2-11
2-12
2-13
2-14
2-15
2-16
A
B
C
D
E
F
G
H
J
K
1
1.6
2
2.5
3
4
5
6
7
8
9
10