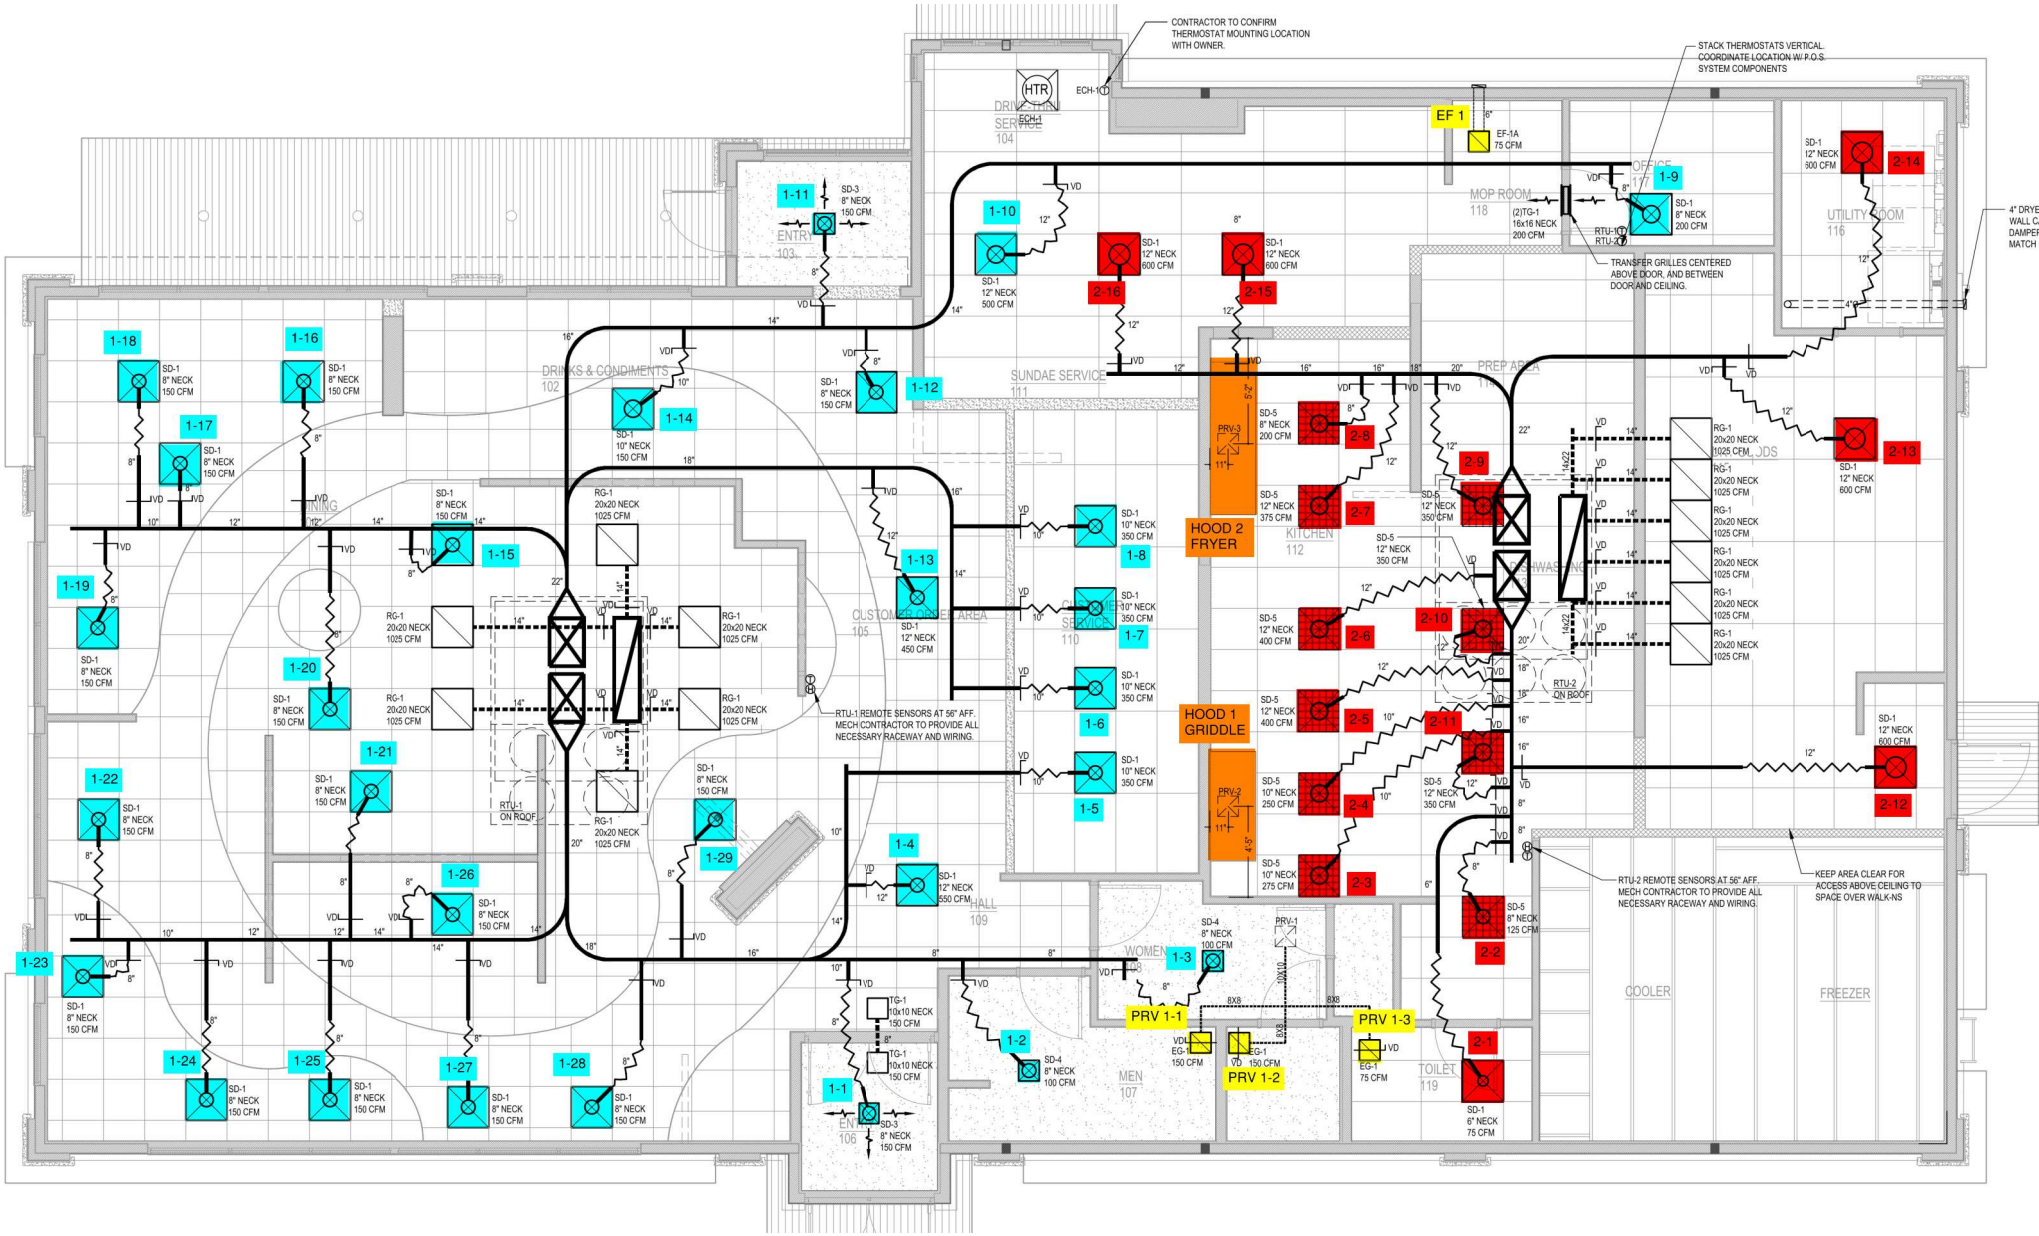
CONTRACTOR TO CONFIRM THERMOSTAT MOUNTING LOCATION WITH OWNER.
STACK THERMOSTATS VERTICAL. COORDINATE LOCATION W/ P.O.S. SYSTEM COMPONENTS
TRANSFER GRILLES CENTERED ABOVE DOOR, AND BETWEEN DOOR AND CEILING.
RTU-1 REMOTE SENSORS AT 56" AFF. MECH CONTRACTOR TO PROVIDE ALL NECESSARY RACEWAY AND WIRING.
RTU-2 REMOTE SENSORS AT 56" AFF. MECH CONTRACTOR TO PROVIDE ALL NECESSARY RACEWAY AND WIRING.
KEEP AREA CLEAR FOR ACCESS ABOVE CEILING TO SPACE OVER WALK-INS
HTR
ECH-1
DRIVE THRU SERVICE 104
ENTRY 103
DRINKS & CONDIMENTS 102
DINING
CUSTOMER DINE AREA 105
SUNDAE SERVICE 111
CUSTOMER SERVICE 110
HALL 109
WOMEN 108
MEN 107
ENTRY 106
KITCHEN 112
PREP AREA
DISHWASHER
HOOD 2 FRYER
HOOD 1 GRIDDLE
MOP ROOM 118
OFFICE 117
UTILITY ROOM 116
TOILET 119
COOLER
FREEZER
EF 1
EF-1A 75 CFM
(2)TG-1 16x16 NECK 200 CFM
RTU-1
RTU-2
RTU-1 ON ROOF
RTU-2 ON ROOF
PRV 1-1
PRV 1-2
PRV 1-3
PRV-1
PRV-2
PRV-3
EG-1 150 CFM
EG-1 75 CFM
TG-1 10x10 NECK 150 CFM
SD-1 8" NECK 150 CFM
SD-1 8" NECK 125 CFM
SD-1 6" NECK 75 CFM
SD-1 8" NECK 200 CFM
SD-1 12" NECK 500 CFM
SD-1 12" NECK 600 CFM
SD-1 12" NECK 450 CFM
SD-1 12" NECK 550 CFM
SD-1 10" NECK 150 CFM
SD-1 10" NECK 350 CFM
SD-3 8" NECK 150 CFM
SD-4 8" NECK 100 CFM
SD-5 8" NECK 200 CFM
SD-5 12" NECK 375 CFM
SD-5 12" NECK 350 CFM
SD-5 12" NECK 400 CFM
SD-5 10" NECK 250 CFM
SD-5 10" NECK 275 CFM
RG-1 20x20 NECK 1025 CFM
1-1
1-2
1-3
1-4
1-5
1-6
1-7
1-8
1-9
1-10
1-11
1-12
1-13
1-14
1-15
1-16
1-17
1-18
1-19
1-20
1-21
1-22
1-23
1-24
1-25
1-26
1-27
1-28
1-29
2-1
2-2
2-3
2-4
2-5
2-6
2-7
2-8
2-9
2-10
2-11
2-12
2-13
2-14
2-15
2-16