


GRILLE SCHEDULE							
MARK	SERVICE	QUANTITY	TYPE	DAMPER	CONSTRUCTION MATERIAL	FINISH COLOR	REMARKS
A	SUPPLY AIR	1	GRILLE	-	ALUMINUM	03	TRUS
B	RETURN AIR	1	GRILLE	-	ALUMINUM	03	TRUS
C	RETURN AIR	1	GRILLE	-	ALUMINUM	03	TRUS

GENERAL NOTES: (A)


1. DIFFUSER FINISHING STYLE SHALL BE CONFIRMED WITH ARCHITECTURAL DRAWING, REFLECTED CEILING PLAN
2. COORDINATE DIFFUSER DISCHARGE PATTERN WITH DRAWINGS
3. OBTAIN SIZES FOR 14-IN STEEL CEILING
4. PROVIDE SQUARE/RECTANGLE TO ROUND TRANSITIONS AS NEEDED
5. COORDINATE ALL FINISHES WITH FINISHERS
6. SUPPLY GRILLES ARE TO BE 4-WAY DISCHARGE DIFFUSERS UNLESS SHOWN OTHERWISE ON DRAWINGS
7. MANUFACTURER TO FURNISH AIR SCOP OR EXTRACTOR WITH PULL ROD ACCESSORY; MECHANICAL CONTRACTOR TO INSTALL

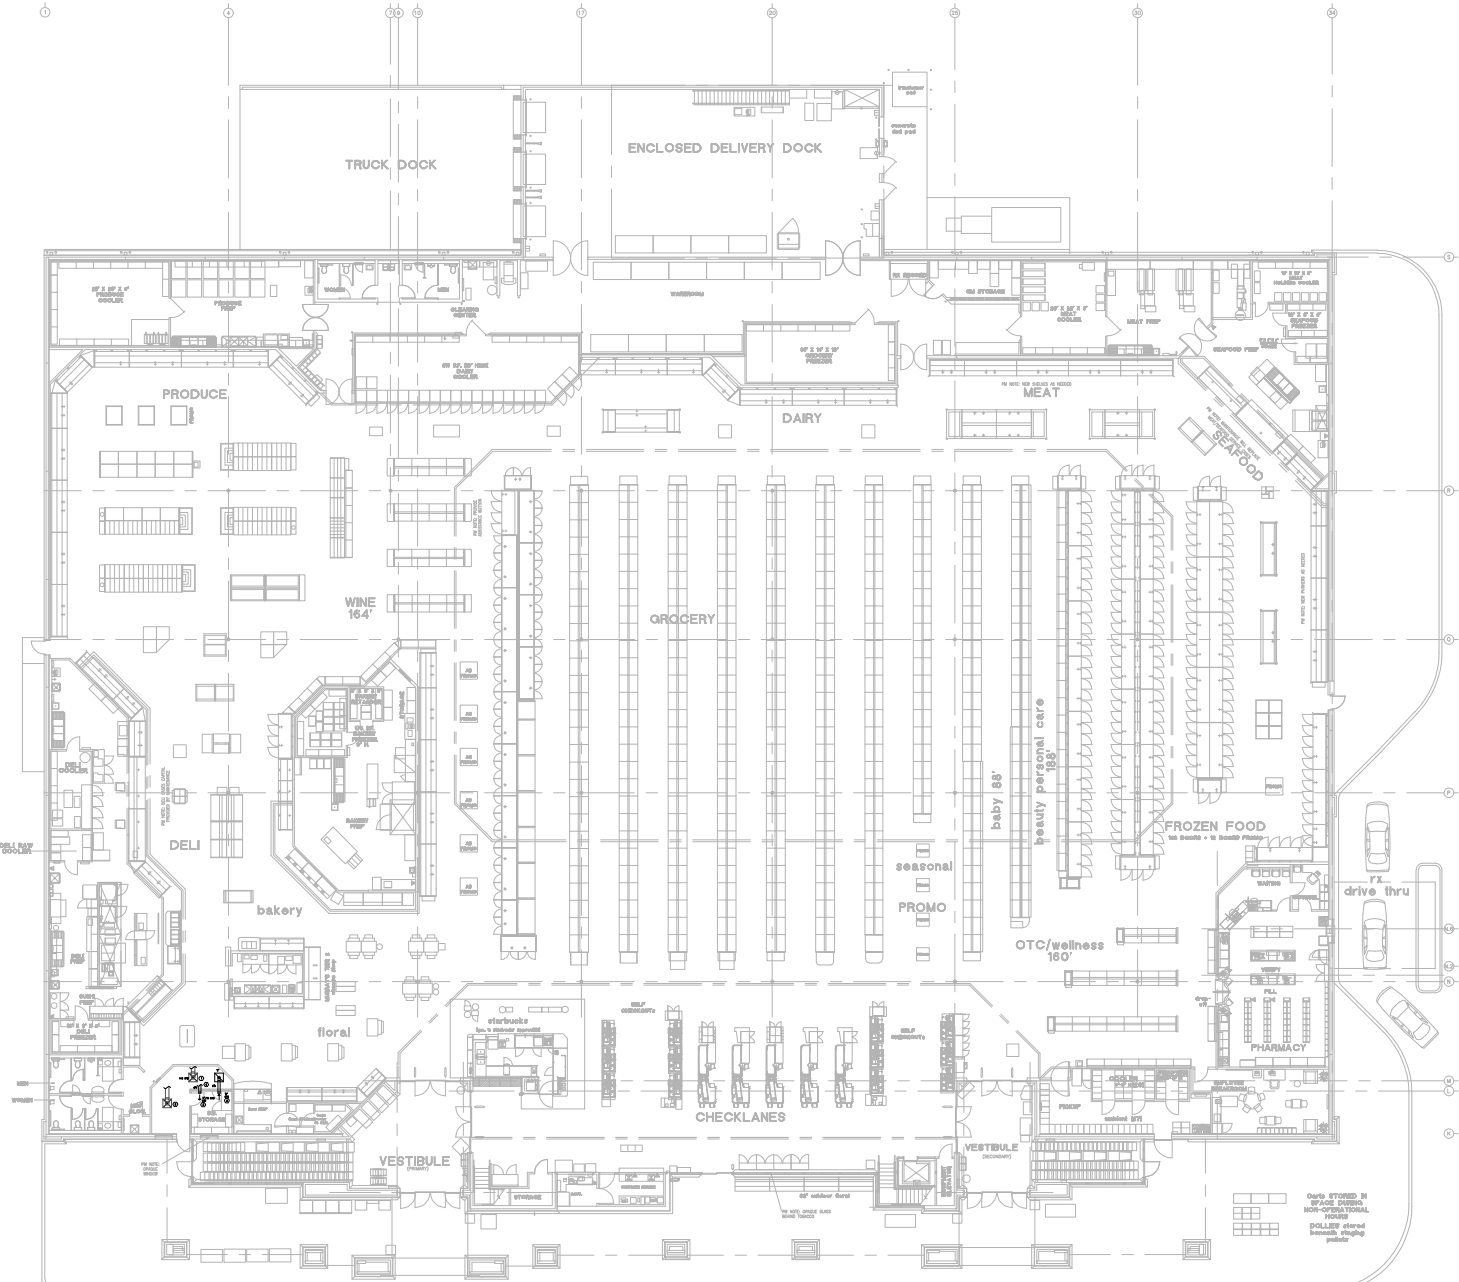

SYMBOL LEGEND	
SYMBOL	DESCRIPTION (DISCHARGE STATUS NOT SHOWN ON PLANS)
GENERAL	
⊙	EXISTING TRUS
⊙	NOTE SPECIFIC TO DETAIL TAG
⊙	REVISION TAG
⊙	NEW EQUIPMENT
OUTDOOR	
⊙	SUPPLY AIR OUTDOOR
⊙	RETURN AIR AND OUTSIDE AIR OUTDOOR
⊙	EXHAUST AIR OUTDOOR
FLEXIBLE OUTDOOR	
⊙	SUPPLY AIR OUTDOOR THROUGH HORIZONTAL PARTITION
⊙	RETURN AIR AND OUTSIDE AIR OUTDOOR THROUGH HORIZONTAL PARTITION
⊙	EXHAUST AIR OUTDOOR THROUGH HORIZONTAL PARTITION
FIRE DAMPER (VERTICAL)	
⊙	FIRE DAMPER (HORIZONTAL)
⊙	SMoke DAMPER (VERTICAL)
⊙	SMoke DAMPER (HORIZONTAL)
⊙	COMBINATION FIRE & SMoke DAMPER (VERTICAL)
⊙	COMBINATION FIRE & SMoke DAMPER (HORIZONTAL)
⊙	SMoke ALARMING DAMPER (SEE DAMPER SCHEDULE)
⊙	RETURNS DAMPER (SEE DAMPER SCHEDULE)
NEW GRILLE	
⊙	SUPPLY AIR GRILLE WITH FOUR-WAY THROW
⊙	SUPPLY AIR GRILLE WITH THREE-WAY THROW
⊙	SUPPLY AIR GRILLE WITH TWO-WAY THROW
⊙	SUPPLY AIR GRILLE WITH ONE-WAY CORNER THROW
⊙	SUPPLY AIR GRILLE WITH ONE-WAY THROW
⊙	RETURN AIR GRILLE
⊙	RETURN AIR GRILLE WITH SOUND ROOF
⊙	CONNECT AIR GRILLE
⊙	SUPPLY AIR RECYCLING GRILLE
⊙	RETURN AIR RECYCLING GRILLE
⊙	RETURN AIR OUTSIDE AIR SIDE CEILING

- GENERAL HVAC NOTES**
1. THESE DRAWINGS ARE BASED ON GENERAL STORE FINISHING. CONTRACTOR TO FIELD VERIFY FINISHING CONDITIONS PRIOR TO BEGINNING WORK. IF ANY EQUIPMENT OR ROOFING IS DISCLOSED, IT IS THE HVAC CONTRACTOR'S RESPONSIBILITY TO COORDINATE WITH THE GENERAL CONTRACTOR FOR THE REPAIR OF ANY ROOFING ITEMS AFTER THE COMPLETION OF HVAC WORK.
  2. ALL EQUIPMENT SHALL BE CONSIDERED EXISTING UNLESS OTHERWISE NOTED. EXISTING EQUIPMENT NOT SHOWN SHALL REMAIN UNCHANGED.
  3. DAMAGED DEVICES: IT IS THE CONTRACTOR'S RESPONSIBILITY TO IDENTIFY AND REPAIR ANY DAMAGED DIFFUSERS. SEE BIDDING LOGS AND TRACKER FOR QUANTITY OF DAMAGED DIFFUSERS TO BE REPLACED. CONTRACTORS COORDINATE WITH KROGER PROJECT MANAGER FOR REPLACEMENT OF DAMAGED DIFFUSERS.
  4. EXISTING DIFFUSERS TO REMAIN: IT IS THE CONTRACTOR'S RESPONSIBILITY TO CLEAN ALL EXISTING DIFFUSERS AND RETURN GRILLES THAT ARE NOT REPLACED.
  5. OUTDOOR AIR DIFFUSERS SHALL BE TAKEN DOWN AND PROPERLY DISPOSED OF.

- HVAC KEYED NOTES**
1. RELOCATE EXISTING CEILING DIFFUSER AND REBALANCE AS SHOWN. RECONNECT TO EXISTING SUPPLY DUCT AS REQUIRED. VERIFY EXACT LOCATION OF DIFFUSER IN FIELD.
  2. EXISTING DIFFUSER TO REMAIN.
  3. NEW DIFFUSER AT THIS LOCATION. COORDINATE FINAL DIFFUSER SIGHTING RECORD WITH INSURER P.A.
  4. CONNECT NEW 4" DUCT TO NEAREST EXISTING SUPPLY TRUNK DUCT.



2 FLEXIBLE DUCT TAP - CONICAL  
SCALE = NONE

1 HVAC FLOOR PLAN  
SCALE: 3/32" = 1'-0"



12/13/21  
PERMIT / BID ISSUE SET



Heights Venture ARCHITECTURE + DESIGN

KROGER FOOD STORE # 540  
MINOR W.I.W & ARTISAN DECOR REMODEL

3305 N. DALLAS PARKWAY  
PLANO, TX 75093

HVAC FLOOR PLAN

M1.1