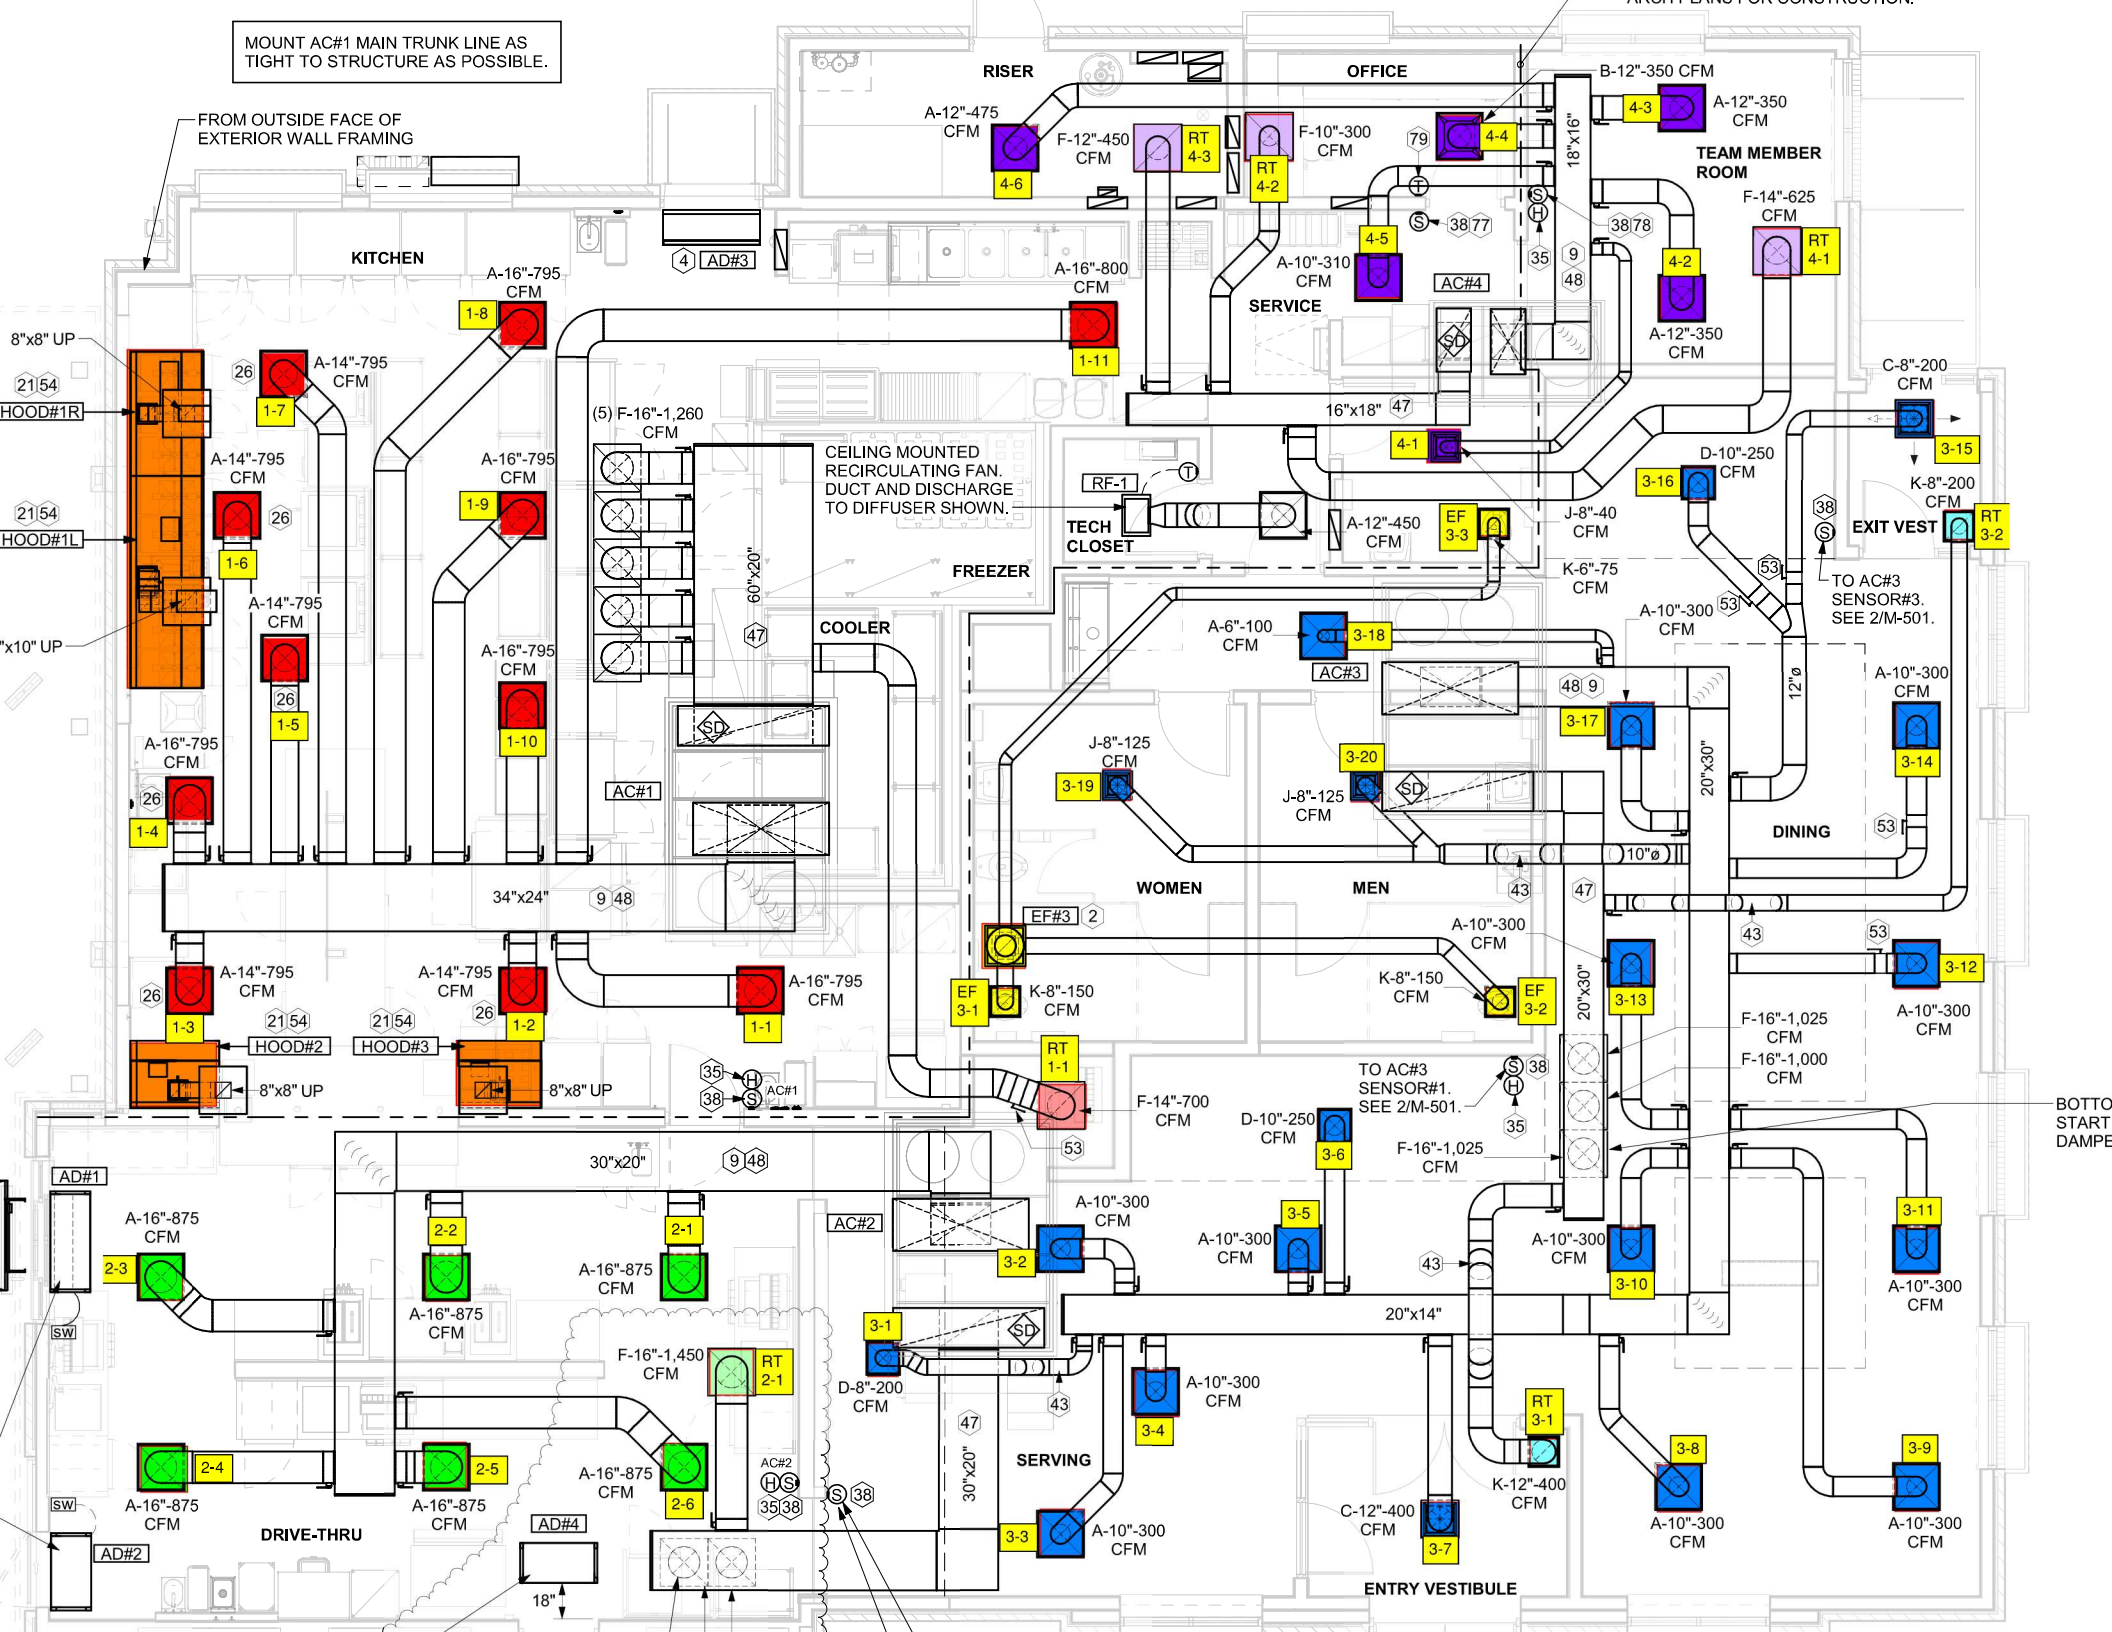
MOUNT AC#1 MAIN TRUNK LINE AS TIGHT TO STRUCTURE AS POSSIBLE.
FROM OUTSIDE FACE OF EXTERIOR WALL FRAMING
RISER
OFFICE
TEAM MEMBER ROOM
KITCHEN
SERVICE
TECH CLOSET
FREEZER
COOLER
WOMEN
MEN
DINING
EXIT VEST
DRIVE-THRU
SERVING
ENTRY VESTIBULE
CEILING MOUNTED RECIRCULATING FAN. DUCT AND DISCHARGE TO DIFFUSER SHOWN.
TO AC#3 SENSOR#3. SEE 2/M-501.
TO AC#3 SENSOR#1. SEE 2/M-501.
HOOD#1R
HOOD#1L
HOOD#2
HOOD#3
8"x8" UP
AC#1
AC#2
AC#3
AC#4
AD#1
AD#2
AD#3
AD#4
EF#3
RF-1
A-12"-475 CFM
F-12"-450 CFM
F-10"-300 CFM
B-12"-350 CFM
A-12"-350 CFM
F-14"-625 CFM
A-10"-310 CFM
A-16"-800 CFM
A-16"-795 CFM
A-14"-795 CFM
(5) F-16"-1,260 CFM
A-12"-450 CFM
J-8"-40 CFM
K-6"-75 CFM
C-8"-200 CFM
K-8"-200 CFM
D-10"-250 CFM
A-10"-300 CFM
A-6"-100 CFM
J-8"-125 CFM
K-8"-150 CFM
F-14"-700 CFM
F-16"-1,025 CFM
F-16"-1,000 CFM
A-16"-875 CFM
F-16"-1,450 CFM
D-8"-200 CFM
C-12"-400 CFM
K-12"-400 CFM
34"x24"
30"x20"
20"x14"
16"x18"
18"x16"
60"x20"
20"x30"
12"ø
10"ø
18"
SW
SD