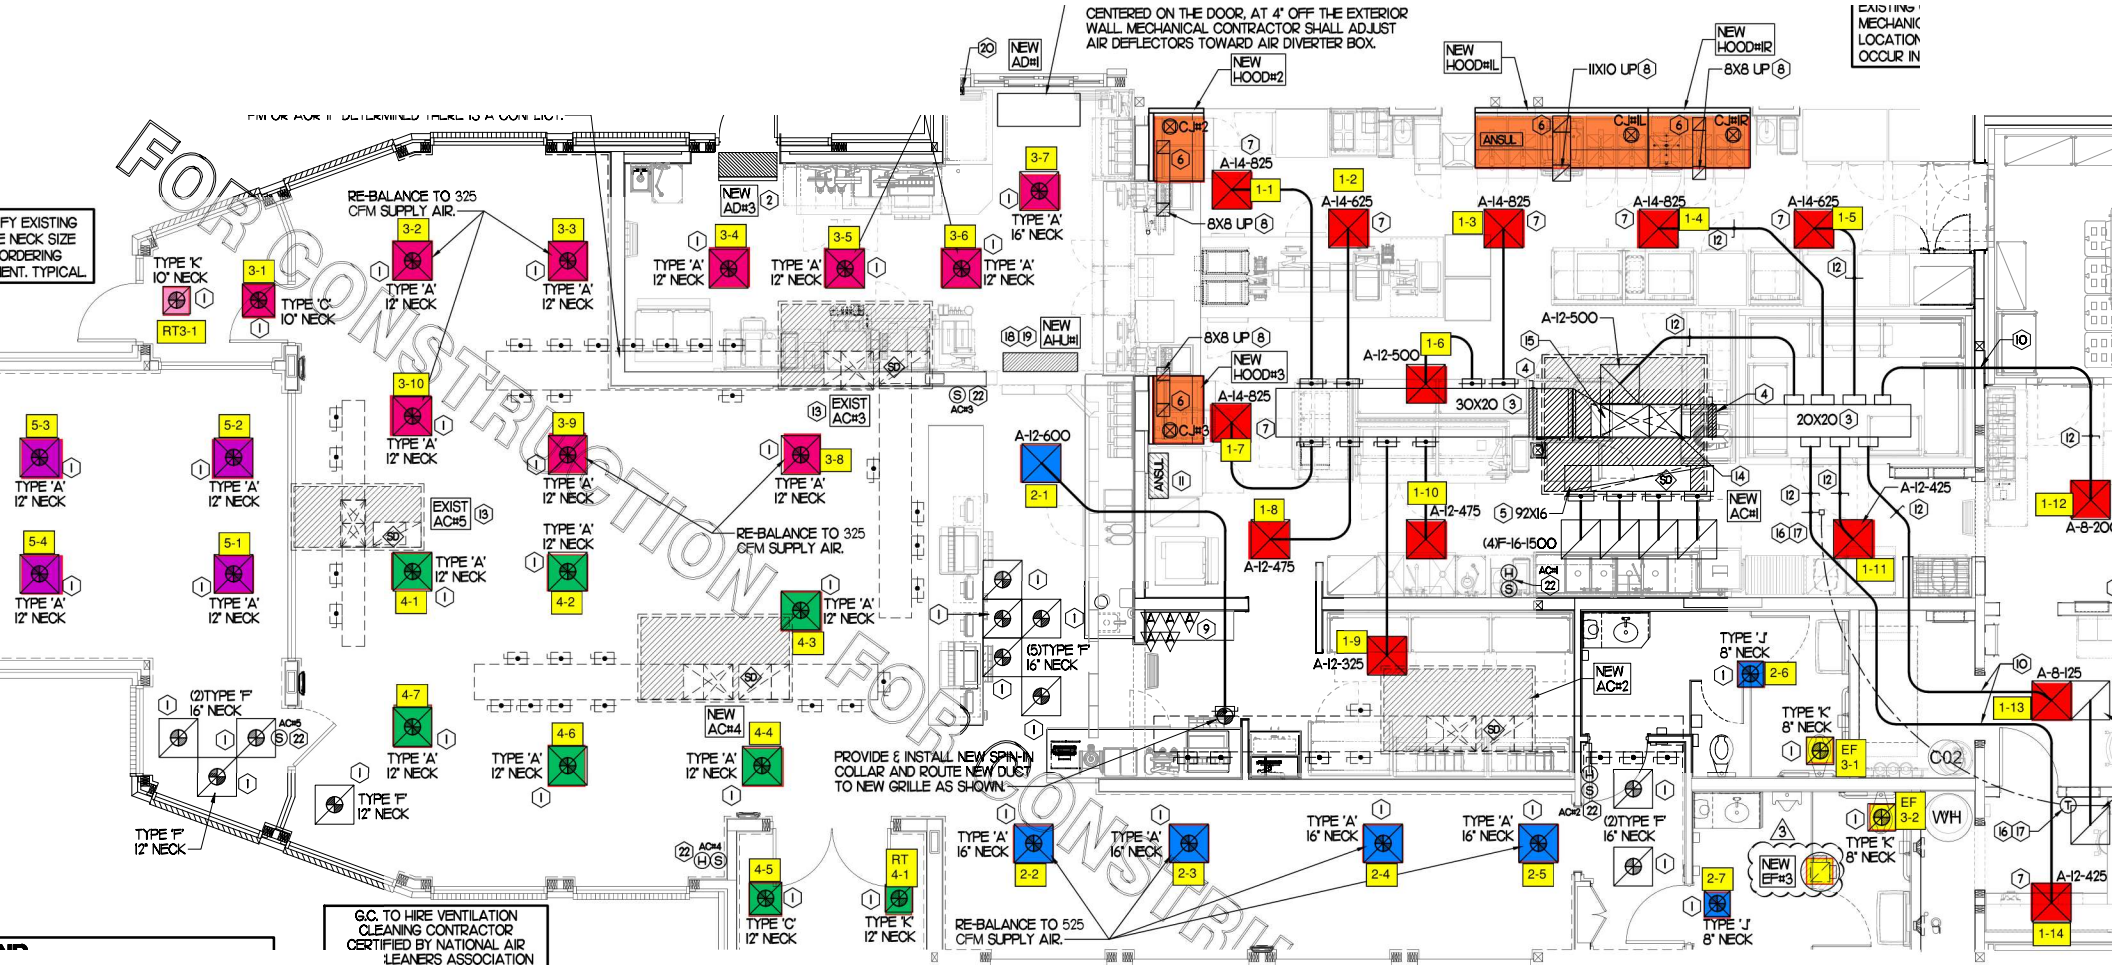
CENTERED ON THE DOOR, AT 4" OFF THE EXTERIOR WALL. MECHANICAL CONTRACTOR SHALL ADJUST AIR DEFLECTORS TOWARD AIR DIVERTER BOX.
NEW AD#1
NEW HOOD#2
NEW HOOD#1L
NEW HOOD#1R
11X10 UP
8X8 UP
NEW AD#3
NEW AH-U#1
NEW HOOD#3
EXIST AC#3
EXIST AC#5
NEW AC#1
NEW AC#2
NEW AC#4
NEW EF#3
RE-BALANCE TO 325 CFM SUPPLY AIR.
RE-BALANCE TO 525 CFM SUPPLY AIR.
PROVIDE & INSTALL NEW SPIN-IN COLLAR AND ROUTE NEW DUCT TO NEW GRILLE AS SHOWN.
G.C. TO HIRE VENTILATION CLEANING CONTRACTOR CERTIFIED BY NATIONAL AIR CLEANERS ASSOCIATION
FOR CONSTRUCTION
FOR CONSTRUCTION
A-14-825
A-14-625
A-12-500
A-12-600
A-12-475
A-12-325
A-12-425
A-8-125
A-8-200
30X20
20X20
92X16
(4)F-16-1500
TYPE 'A' 12" NECK
TYPE 'A' 16" NECK
TYPE 'C' 10" NECK
TYPE 'C' 12" NECK
TYPE 'K' 10" NECK
TYPE 'K' 12" NECK
TYPE 'K' 8" NECK
TYPE 'F' 12" NECK
TYPE 'J' 8" NECK
(2)TYPE 'F' 16" NECK
(5)TYPE 'F' 16" NECK
EF 3-1
EF 3-2
C02
WH