

INS THROUGH ROOF.
 INSTALL THE REFRIGERANT LINE
 INSER. IF REFRIGERANT PIPING TO
 ILESS STEEL SHROUD AS SHOWN


ION INSTRUCTIONS AND AS

IN THE ARCHITECTURAL AND
 JRNISHED BY CHIPOTLE ON

DETAIL 1/M700. TYPICAL.
 R WITH REMOTE KEY OPERATED
 NIT 60" AFF. TYPICAL.
 DETAIL 6/M700. SEE ELECTRICAL
 WARNING STICKERS ON FACE OF
 JGH WHICH THE REME HALO

ATION AND OUTSIDE AIR
 MBUSTION AIR INTAKE AND
 ORE INFORMATION ON WATER

POSITE SIDE OF ROOM AT
 JM.

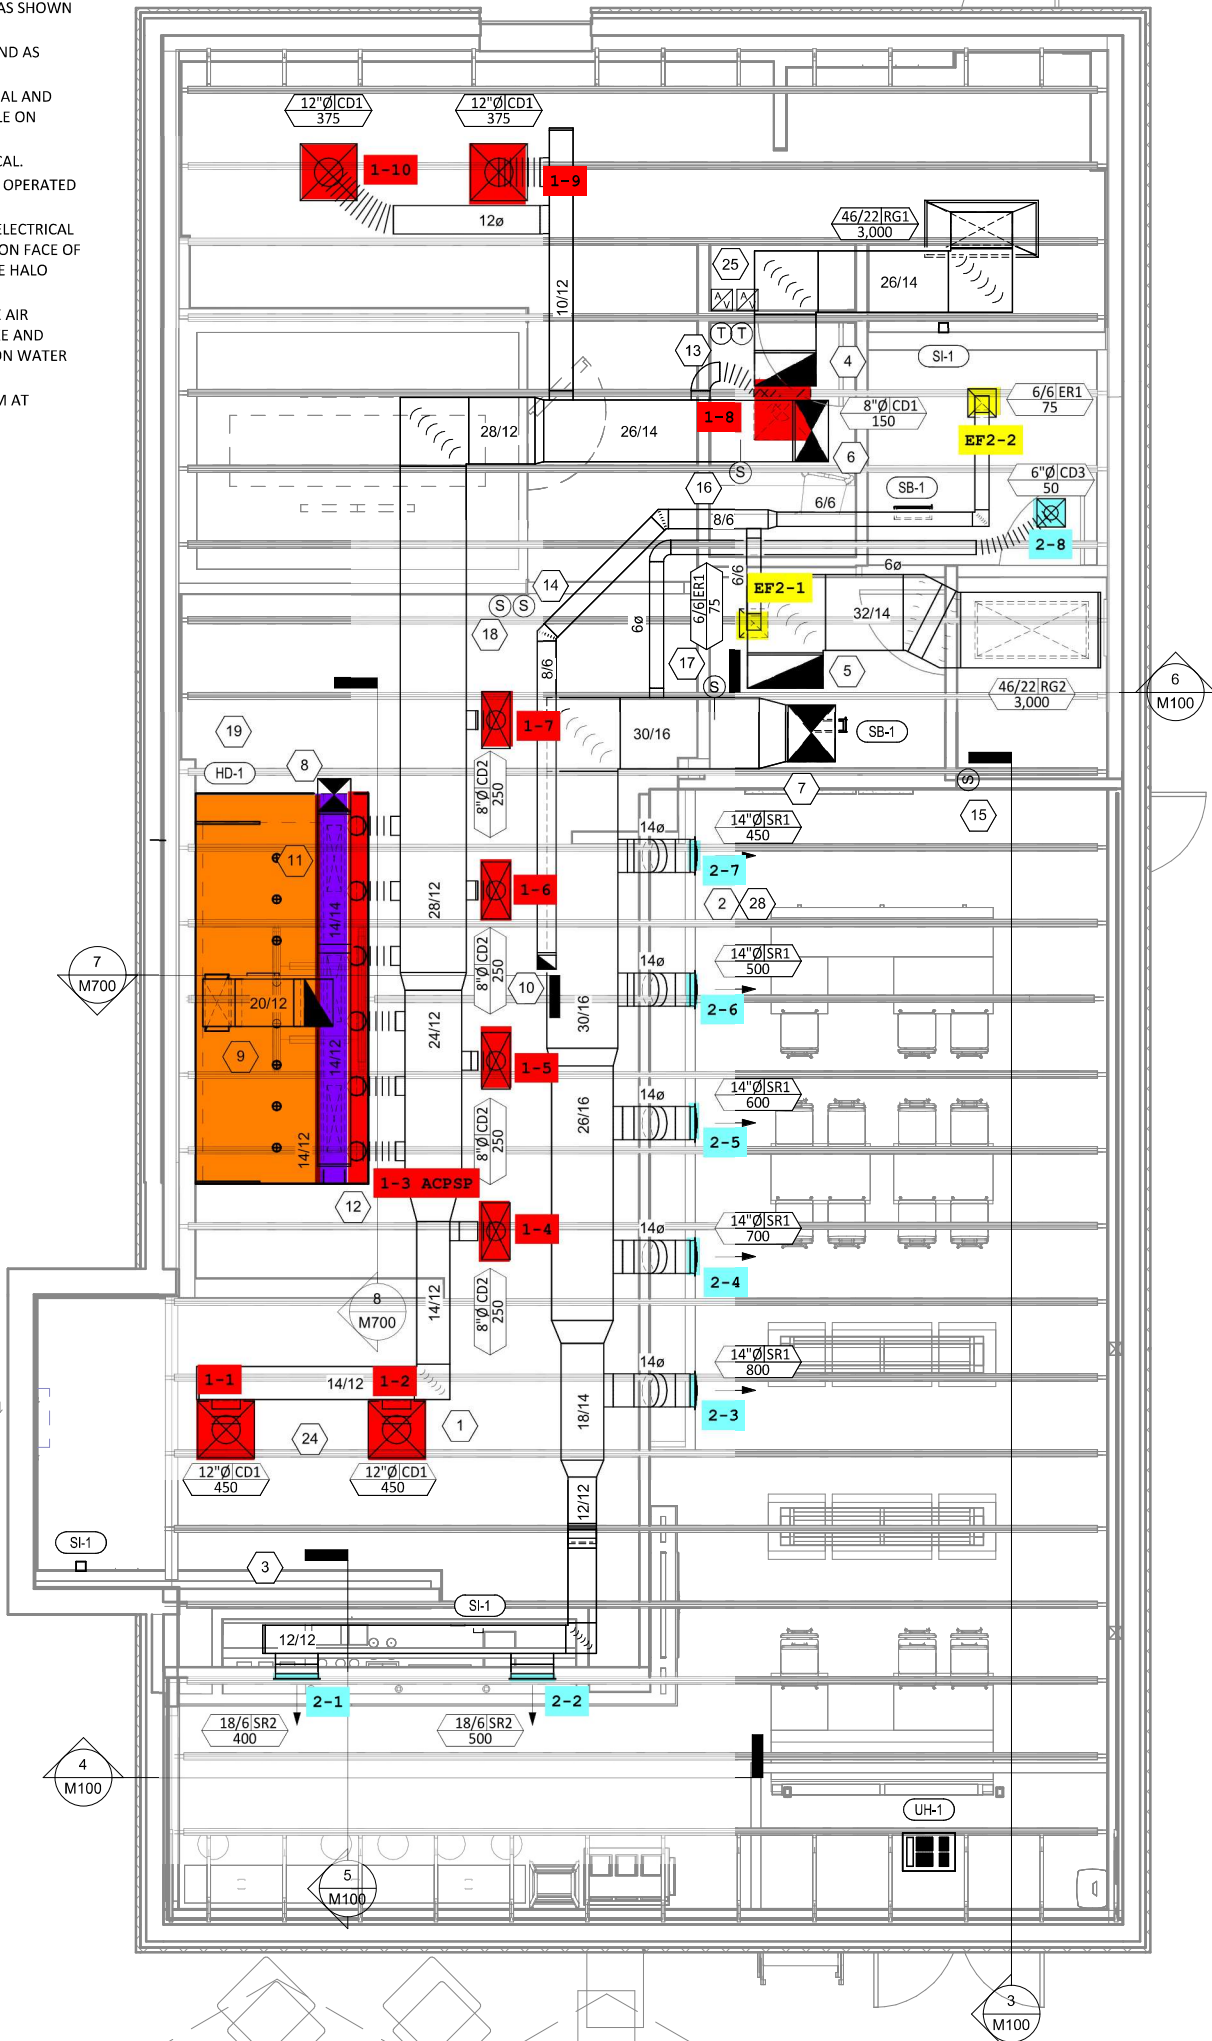

INTAKE

CC
TH
AN
CH
EX
CH



Issu
03
06

Rev

Dra
CJK

Proj
24

Con

H