



10-09-23 PERRY'S - RICHMOND, VA (CX, TAB)

CheckList Information

Name : E-PANEL IDENTIFICATION AND LABELS **Status :** Not Completed
Assigned Organization : National TAB **Asset :**
Requesting Organization : National TAB

CheckList Item Details

--


PANEL LOCATION, TAGS, AND RATING

LOCATION OF PANEL TAG: MAIN BUILDING DISCONNECT	Pass
Comment	EDC (Electrical Distribution)
LOCATION OF PANEL TAG: HDP	Pass
Comment	EDC (Electrical Distribution)
LOCATION OF PANEL TAG: LDP	Pass
Comment	EDC (Electrical Distribution)
PANEL MFG/JOB NO.	
PANEL AMP RATING	
PANEL VOLTAGE & PHASE	
PANEL LABEL/LINE CARD	
LOCATION OF PANEL TAG: B1	Pass
Comment	Coat Room
PANEL MFG/JOB NO.	EATON / VLPRY00007-007



B1_PANEL_LABEL.jpg

PANEL AMP RATING	250 AMPS
PANEL VOLTAGE & PHASE	208Y/120V 3PHASE - 4 WIRE
PANEL LABEL/LINE CARD	

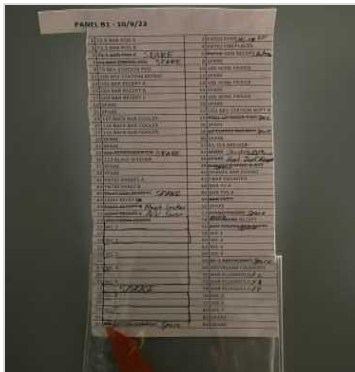


B1_PANEL_CARD.jpg

LOCATION OF PANEL TAG: L1	Pass
Comment	Main Kitchen
PANEL MFG/JOB NO.	EATON / VLPRY00007-006



L1_PANEL_LABEL.jpg

PANEL AMP RATING	225 AMPS
PANEL VOLTAGE & PHASE	208Y/120V 3PHASE - 4 WIRE
PANEL LABEL/LINE CARD	

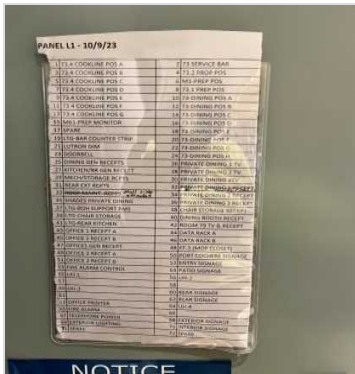

L1_PANEL_CARD.jpg

LOCATION OF PANEL TAG: K2	Pass
Comment	Main Kitchen next to L1
PANEL MFG/JOB NO.	EATON / VLPRY00007-004



K2_PANEL_LABEL.jpg


PANEL AMP RATING

250 AMPS

PANEL VOLTAGE & PHASE

208Y/120V 3PHASE - 4 WIRE

PANEL LABEL/LINE CARD

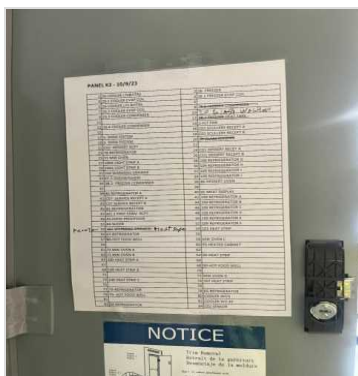

K2_PANEL_CARD.jpg

LOCATION OF PANEL TAG: K1

Pass

Comment

Prep

PANEL MFG/JOB NO.

EATON / VLPRY00007-005



K1_PANEL_LABEL.jpg


PANEL AMP RATING

250 AMPS

PANEL VOLTAGE & PHASE

208Y/120V 3PHASE - 4 WIRE

PANEL LABEL/LINE CARD

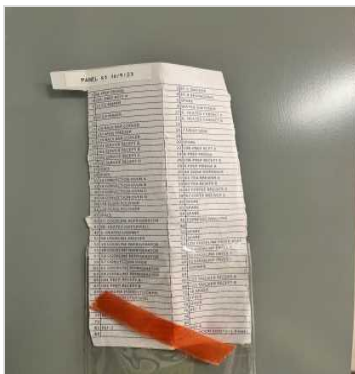

K1_PANEL_CARD.jpg

LOCATION OF PANEL TAG: H1

Pass

Comment

Prep Next to K1

PANEL MFG/JOB NO.

EATON / VLPRY00007-002



H1_PANEL_LABEL.jpg


PANEL AMP RATING

400 AMPS

PANEL VOLTAGE & PHASE

480Y/277V 3PHASE - 4 WIRE

PANEL LABEL/LINE CARD

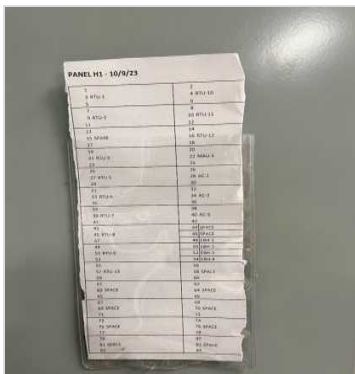

H1_PANEL_CARD.jpg

Notes/Comments :