




Culvers  
Rockford, MI



Thermostats



RTU-1  
Dining

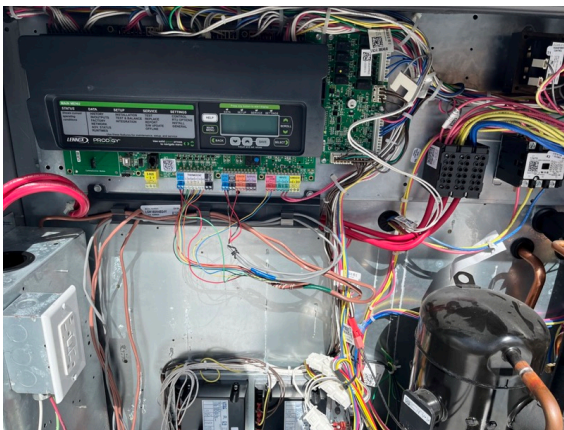


RTU-1  
Control wiring



RTU-1  
OA damper position marked



RTU-2  
Kitchen

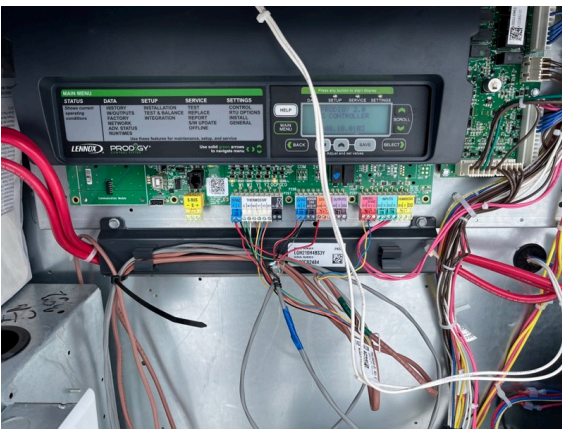

RTU-2  
Control wiring




RTU-2  
OA damper position marked



RTU-2  
Cookline diffusers perforated.



PRV-1  
Restrooms

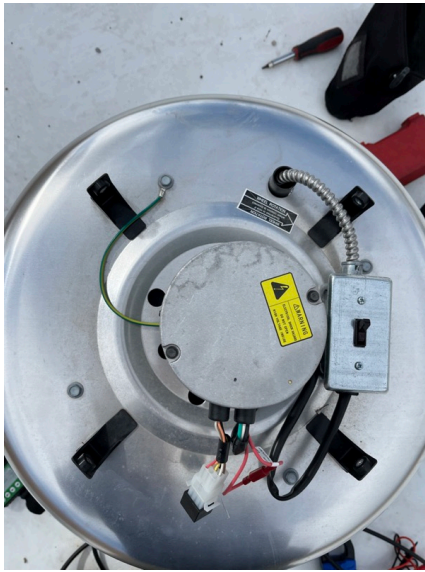

PRV-1  
Disconnect installed



PRV-1  
Setpoint marked



PRV-1  
Backdraft damper installed.



HMI



Accurex Panel



HD-1  
Griddle



PRV-2  
HD-1 Griddle



PRV-2  
Disconnect installed.



PRV-2



PRV-2  
Grease duct



HD-2  
Fryer



PRV-3  
HD-2 Fryer



PRV-3  
Disconnect installed.



PRV-3



PRV-3  
Grease duct



HD-3  
PRV-4



PRV-4  
Dish hood




PRV-4  
Disconnect



PRV-4  
Backdraft damper installed.



EF-1A  
Mop fan

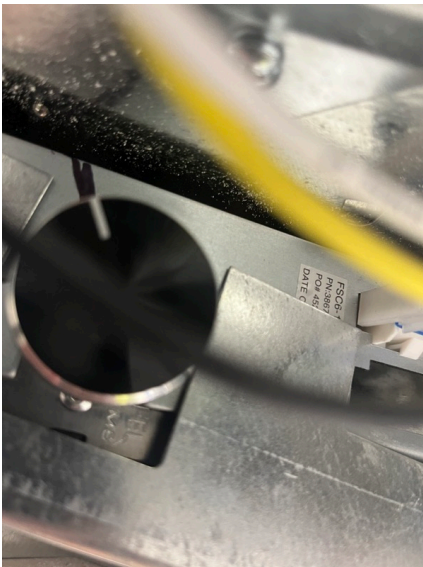

EF-1A  
Setpoint marked