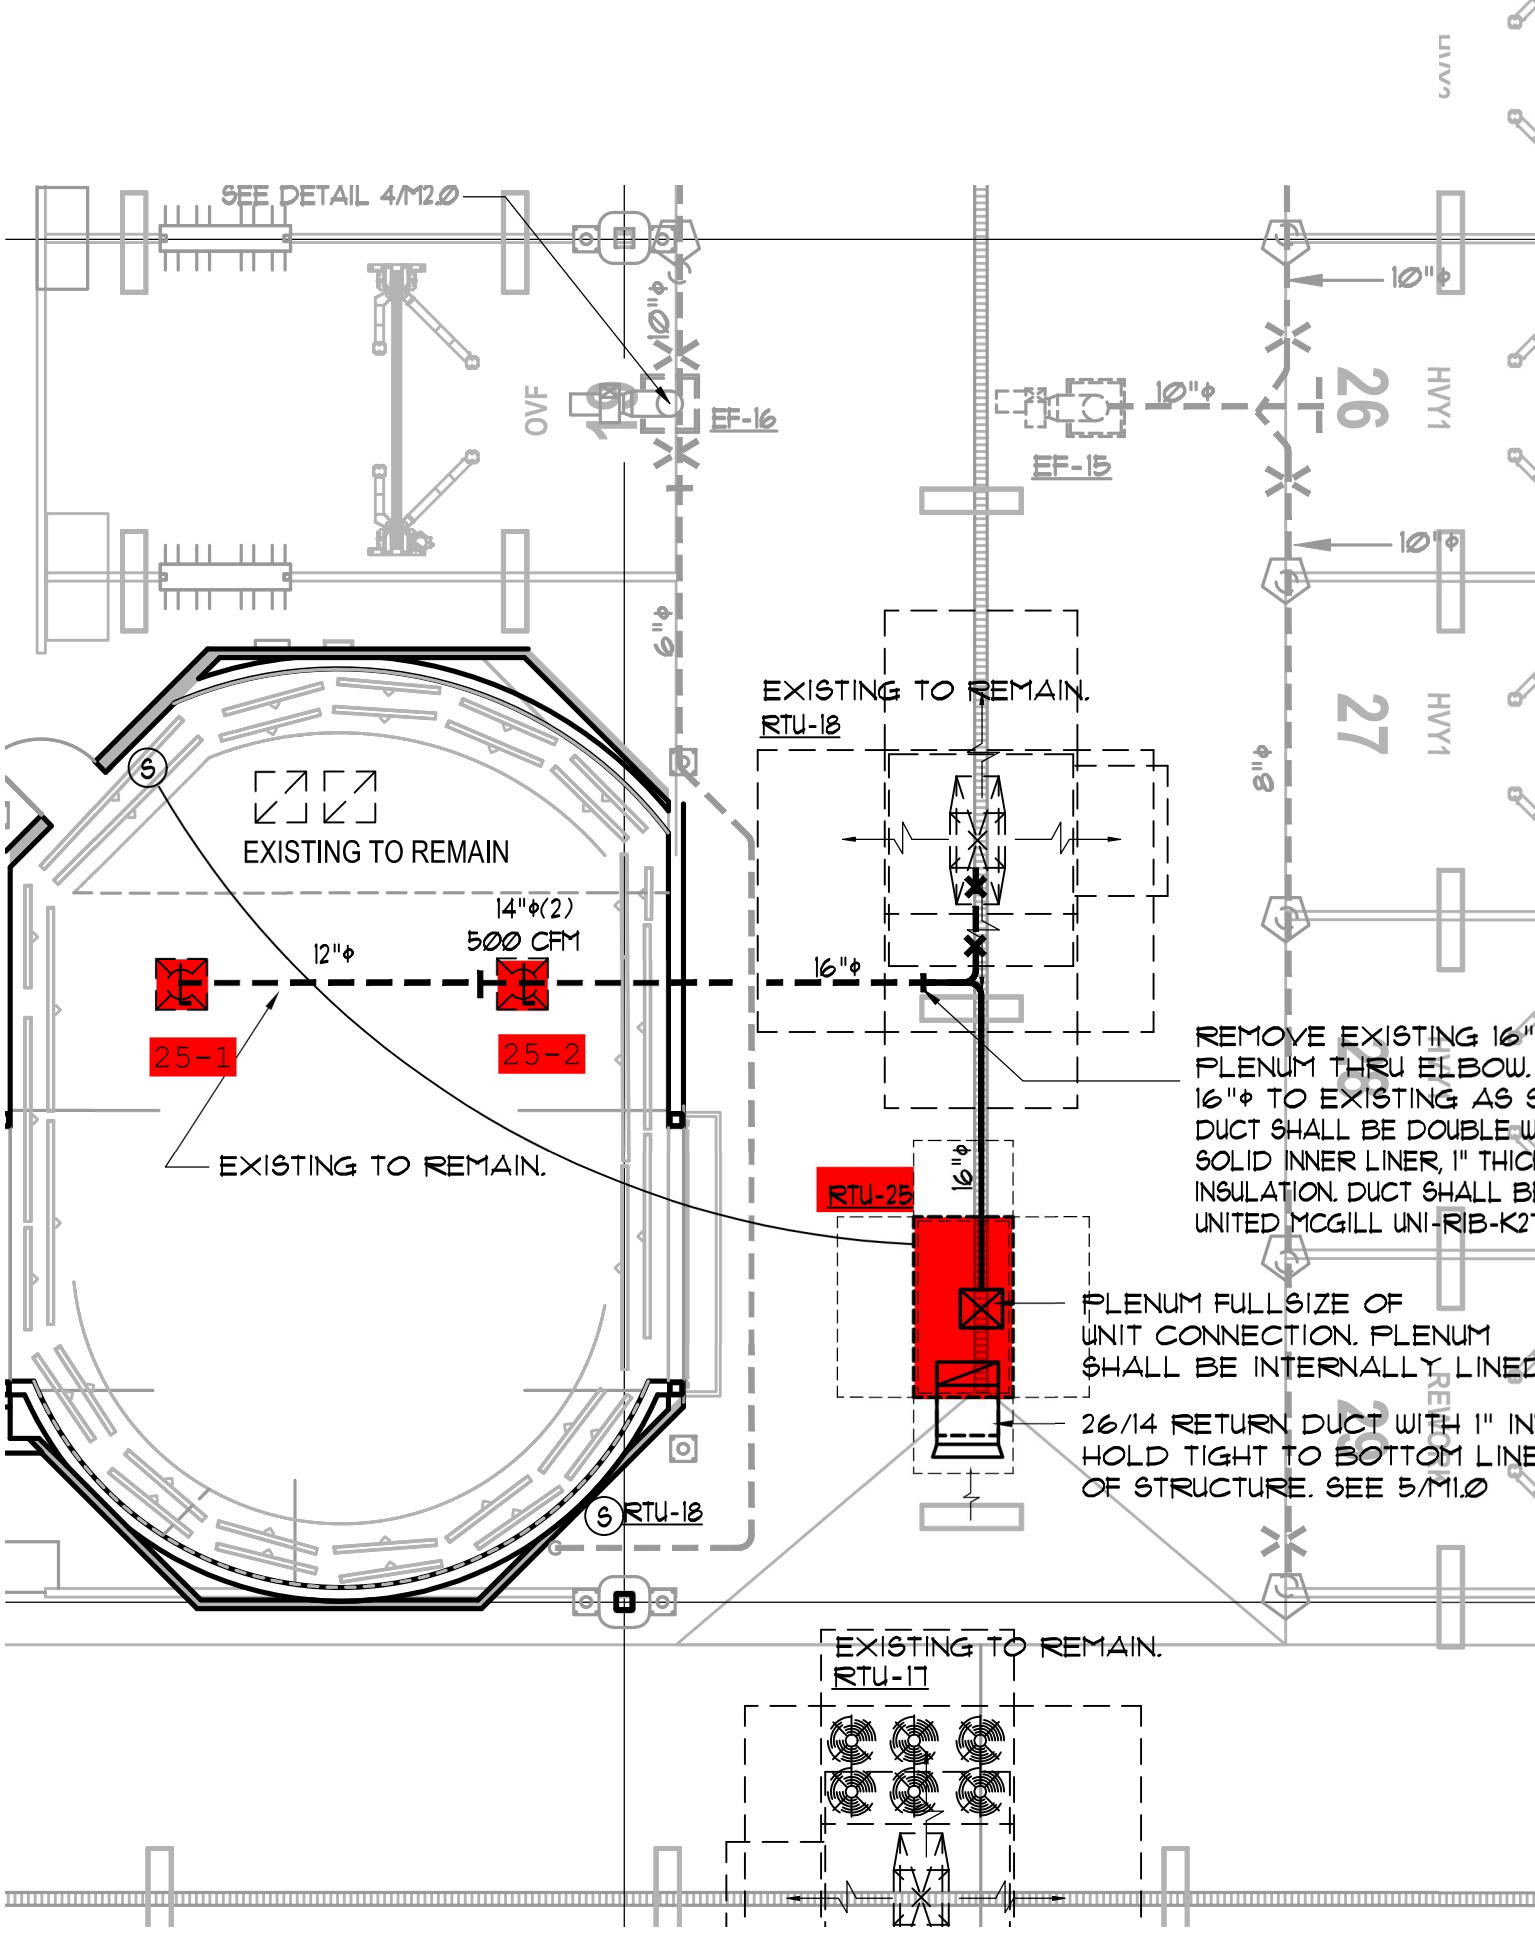
SEE DETAIL 4/M12.0
OVF
EF-16
EF-15
10"ϕ
10"ϕ
10"ϕ
6"ϕ
8"ϕ
HVY1
26
27
EXISTING TO REMAIN.
RTU-18
EXISTING TO REMAIN
14"ϕ(2)
500 CFM
12"ϕ
16"ϕ
25-1
25-2
EXISTING TO REMAIN.
RTU-25
16"ϕ
REMOVE EXISTING 16"
PLENUM THRU ELBOW.
16"ϕ TO EXISTING AS
DUCT SHALL BE DOUBLE W
SOLID INNER LINER, 1" THIC
INSULATION. DUCT SHALL BE
UNITED MCGILL UNI-RIB-K2
PLENUM FULLSIZE OF
UNIT CONNECTION. PLENUM
SHALL BE INTERNALLY LINED
26/14 RETURN DUCT WITH 1" IN
HOLD TIGHT TO BOTTOM LINE
OF STRUCTURE. SEE 5/M1.0
RTU-18
EXISTING TO REMAIN.
RTU-17