


SENSOR WITH CORRESPONDING UNIT.  
FOR MODULE FURNISHED BY TEMS FOR  
AFF DIRECTLY TO WALL (NO JUNCTION  
WITH EQUIPMENT. PROVIDE WIRING AS  
SENSOR WITH CORRESPONDING UNIT.

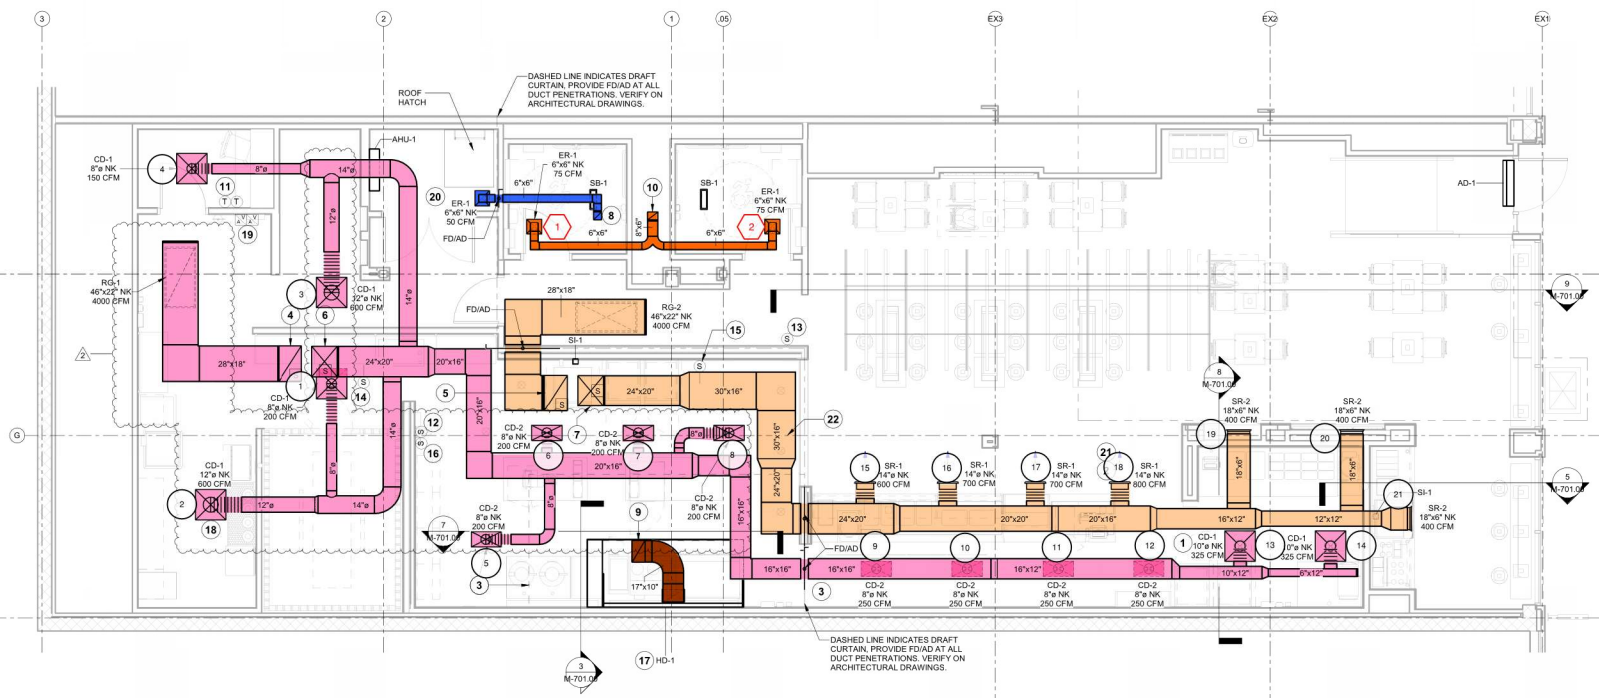

HVAC FLOOR PLAN  
1/4" = 1'-0"