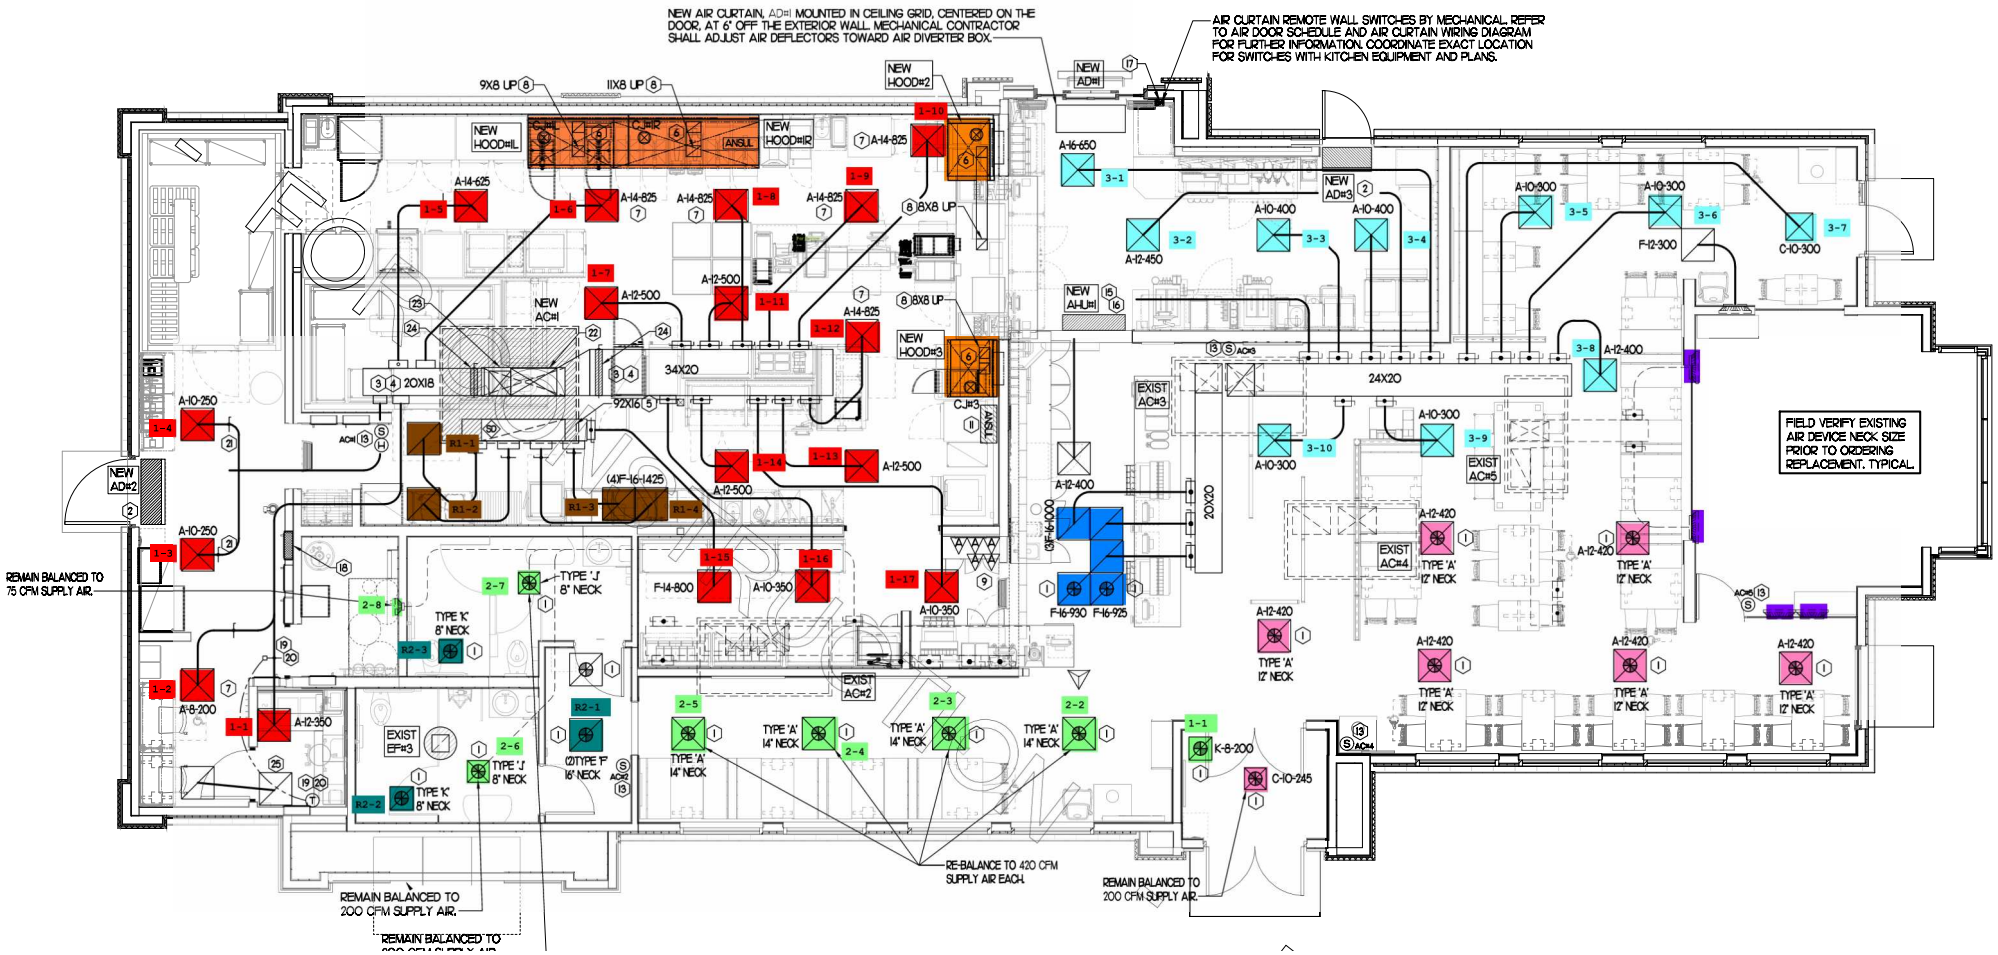
NEW AIR CURTAIN, AD#1 MOUNTED IN CEILING GRID, CENTERED ON THE DOOR, AT 6' OFF THE EXTERIOR WALL. MECHANICAL CONTRACTOR SHALL ADJUST AIR DEFLECTORS TOWARD AIR DIVERTER BOX.
AIR CURTAIN REMOTE WALL SWITCHES BY MECHANICAL. REFER TO AIR DOOR SCHEDULE AND AIR CURTAIN WIRING DIAGRAM FOR FURTHER INFORMATION. COORDINATE EXACT LOCATION FOR SWITCHES WITH KITCHEN EQUIPMENT AND PLANS.
FIELD VERIFY EXISTING AIR DEVICE NECK SIZE PRIOR TO ORDERING REPLACEMENT. TYPICAL.
REMAIN BALANCED TO 75 CFM SUPPLY AIR.
REMAIN BALANCED TO 200 CFM SUPPLY AIR.
RE-BALANCE TO 420 CFM SUPPLY AIR EACH.
REMAIN BALANCED TO 200 CFM SUPPLY AIR.
NEW HOOD#1L
NEW HOOD#1R
NEW HOOD#2
NEW HOOD#3
NEW AC#1
NEW AD#1
NEW AD#2
NEW AD#3
NEW AHU#1
EXIST AC#2
EXIST AC#3
EXIST AC#4
EXIST AC#5
EXIST EF#3
9X8 UP
11X8 UP
8X8 UP
20X18
34X20
92X16
24X20
20X20
TYPE 'A' 14" NECK
TYPE 'A' 12" NECK
TYPE 'J' 8" NECK
TYPE 'K' 8" NECK
(2)TYPE 'F' 16" NECK