

MECHANICAL SCOPE OF WORK

BUILDOUT OF SHELL SPACE FOR NEW SURGICAL SUITES.

APPLICABLE CODES AND STANDARDS

ALL MECHANICAL EQUIPMENT, MATERIALS, INSTALLATION, TESTING, CLEANING, SUPPORTS, AND WORKMANSHIP SHALL BE IN STRICT ACCORDANCE WITH THE BELOW LISTED APPLICABLE CODES INCLUDE BUT ARE NOT LIMITED TO:

CODE INFORMATION

2018 INTERNATIONAL BUILDING CODE (W/ HARRIS COUNTY AMENDMENTS)
2015 INTERNATIONAL MECHANICAL CODE (W/ HARRIS COUNTY AMENDMENTS)
2018 INTERNATIONAL FIRE CODE (W/ HARRIS COUNTY AMENDMENTS)
2015 INTERNATIONAL ENERGY CONSERVATION CODE (W/ HARRIS COUNTY AMENDMENTS)

2020 NFPA 70, NATIONAL ELECTRIC CODE
2015 NFPA 99, HEALTHCARE FACILITIES CODE
2013 NFPA 110, STANDARD FOR EMERGENCY AND STANDBY POWER SYSTEMS

TEXAS ADMINISTRATIVE CODE TITLE 25 CHAPTER 133 HOSPITAL LICENSING

MECHANICAL SHEET LIST	
SHEET NUMBER	SHEET NAME
M001	MECHANICAL LEGENDS AND NOTES
M002	MECHANICAL NOTES
M101	MECHANICAL FIRST FLOOR DEMO PLAN
M102	MECHANICAL SECOND FLOOR DEMO PLAN
M103	MECHANICAL ROOF DEMOLITION PLAN
M201	MECHANICAL FIRST FLOOR PLAN
M202	MECHANICAL SECOND FLOOR PLAN - OVERALL
M203	MECHANICAL SECOND FLOOR PLAN - ENLARGED PLAN EAST
M204	MECHANICAL SECOND FLOOR PLAN - ENLARGED PLAN WEST
M205	MECHANICAL SECOND FLOOR CEILING COORDINATION PLAN
M206	MECHANICAL ROOF PLAN
M301	MECHANICAL PRESSURIZATION DIAGRAM
M510	MECHANICAL DETAILS
M511	MECHANICAL DETAILS
M601	MECHANICAL SCHEDULES
M602	MECHANICAL SCHEDULES

MECHANICAL ABBREVIATIONS

A	AMPS
AFF	ABOVE FINISHED FLOOR
AHU	AIR HANDLING UNIT
APD	AIR PRESSURE DROP
BTU	BRITISH THERMAL UNIT
BHP	BRAKE HORSEPOWER
BMS	BUILDING MANAGEMENT SYSTEM
CD	CONDENSATE DRAIN
CFM	CUBIC FEET PER MINUTE
CH	CHILLER
CHP	CHILLED WATER PUMP
CHWR	CHILLED WATER RETURN
CHWS	CHILLED WATER SUPPLY
CO	CLEAN OUT
COND	CONDENSATE DRAIN
CP	CONDENSATE PUMP
CRAC	COMPUTER ROOM AIR CONDITIONING UNIT
CT	COOLING TOWER
CU	CONDENSING UNIT
CWR	CONDENSER WATER RETURN
CWS	CONDENSER WATER SUPPLY
DB	DRY BULB TEMPERATURE, °F
DN	DOWN
DOAS	DEDICATED OUTDOOR AIR SYSTEM
DX	DIRECT EXPANSION
EA	EXHAUST AIR
EAD	EXHAUST AIR DUCT
EAT	ENTERING AIR TEMPERATURE
EF	EXHAUST FAN
ERV	ENERGY RECOVERY VENTILATOR
ESP	EXTERNAL STATIC PRESSURE
ET	EXPANSION TANK
ETR	EXISTING TO REMAIN
EUH	ELECTRIC UNIT HEATER
EWT	ENTER WATER TEMPERATURE, °F
FA	FREE AREA
FCU	FAN COIL UNIT
FD	FIRE DAMPER
FLA	FULL LOAD AMPS
FS	FEET PER MINUTE
FPS	FEET PER SECOND
FPTU	FAN POWERED TERMINAL UNIT
FSD	FIRE SMOKE DAMPER
GUH	GAS UNIT HEATER
GPM	GALLONS PER MINUTE
HHWR	HEATING HOT WATER RETURN
HHWS	HEATING HOT WATER SUPPLY
HP	HORSEPOWER
HX	HEAT EXCHANGER
HZ	HERTZ
IN, WG	INCHES OF WATER COLUMN
KW	KILOWATT
LAT	LEAVING AIR TEMPERATURE, °F
LP	LIQUID PROPANE
LV	LOUVER
LWT	LEAVING WATER TEMPERATURE, °F
MAU	MAKE-UP AIR
MBH	THOUSAND BTU PER HOUR
MOC	MAXIMUM OVERCURRENT PROTECTION
N.C.	NORMALLY CLOSED
N.I.C.	NOT IN CONTRACT
N.O.	NORMALLY OPEN
NG	NATURAL GAS
NTS	NOT TO SCALE
OA	OUTSIDE AIR
OAD	OUTSIDE AIR DUCT
OED	OPEN END DUCT
OAHU	OUTSIDE AIR HANDLING UNIT
PSI	POUNDS PER SQUARE INCH
PSIA	POUNDS PER SQUARE INCH ABSOLUTE
PSIG	POUNDS PER SQUARE INCH GAUGE
PTAC	PACKAGED TERMINAL AIR CONDITIONER
RA	RETURN AIR
RAD	RETURN AIR DUCT
RCP	REFLECTED CEILING PLAN
RG	RETURN GRILLE
RH	RELATIVE HUMIDITY
RL	REFRIGERANT LIQUID
RPM	REVOLUTIONS PER MINUTE
RR	RETURN REGISTER
RS	REFRIGERANT SUCTION
RTU	ROOF TOP UNIT
RX	REMOVE EXISTING
SA	SUPPLY AIR
SAD	SUPPLY AIR DUCT
SD	SUPPLY DIFFUSER
SR	SUPPLY REGISTER
TYP	TYPICAL
UV	UNIT VENTILATOR
V	VOLTS
VAV	VARIABLE AIR VOLUME
VFD	VARIABLE-FREQUENCY DRIVE
VRV	VARIABLE REFRIGERANT VOLUME
W	WITH
WB	WET BULB TEMPERATURE, °F
WPD	WATER PRESSURE DROP
°F	DEGREES FAHRENHEIT
φ	PHASE

MECHANICAL LEGEND

	MECHANICAL EQUIPMENT
	PLENUM SLOT DIFFUSER
	SUPPLY AIR DEVICE
	RETURN AIR DEVICE
	EXHAUST AIR DEVICE
	CONCIAL TAP WITH DAMPER
	MOTORIZED DAMPER
	MANUAL BALANCING DAMPER
	RIGID DUCTWORK
	FLEX DUCT
	ZONE THERMOSTAT @ 48° A.F.F.
	ZONE TEMPERATURE SENSOR
	DIFFUSER TAG / AIR FLOW
	EQUIPMENT TAG
	KEY NOTE TAG
	POINT OF CONNECTION
	POINT OF DEMOLITION

MECHANICAL GENERAL NOTES

- DRAWINGS ARE DIAGRAMMATIC. CONFIRM DIMENSIONS AND LOCATIONS IN THE FIELD.
- RUNOUTS TO INDIVIDUAL AIR DEVICES ARE SAME SIZE AS AIR DEVICE NECK UNLESS OTHERWISE NOTED.
- DUCT SIZES SHOWN ARE FREE AREA.
- SEE ARCHITECTURAL REFLECTED CEILING PLANS FOR TYPE OF CEILING AND LOCATION OF CEILING DEVICES.
- SEE ARCH ELEVATIONS FOR LOCATION OF WALL MTD DEVICES.
- PLENUMS ARE CROWDED AND NOT ALL OBSTACLES ARE INDICATED. ALLOW FOR ADDITIONAL DUCT OR PIPE OFFSETS OR TRANSITIONS NOT INDICATED ON DRAWINGS.
- SEAL ALL PENETRATIONS OF FLOORS, RATED WALLS, EXTERIOR WALLS.
- CONTRACTOR SHALL SUBMIT DRAWINGS FOR ALL PERMITS IN A TIMELY MANNER AND PAY ALL PERMIT FEES.
- PROVIDE ANY REQUIRED TEMPORARY UTILITIES.
- THE LISTING OF PRODUCT MANUFACTURERS, MATERIALS, AND METHODS ARE THE BASIS OF DESIGN AND ARE INTENDED TO ESTABLISH A STANDARD OF QUALITY. THE ENGINEER SHALL BE THE SOLE JUDGE OF QUALITY AND EQUIVALENCE OF EQUIPMENT, MATERIALS, AND METHODS. WHERE SUBSTITUTED OR ALTERNATIVE EQUIPMENT IS PROPOSED ON THE PROJECT BEFORE BIDDING, IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO VERIFY THAT THE EQUIPMENT WILL FIT THE SPACE AVAILABLE, INCLUDING ALL REQUIRED CODE AND MAINTENANCE CLEARANCES, AND TO COORDINATE ALL EQUIPMENT REQUIREMENTS WITH OTHER CONTRACTORS.
- PROVIDE BID BREAKDOWN TO ALLOW FOR SELECTION OF EQUIPMENT FROM MULTIPLE MANUFACTURERS, MANUFACTURER'S REPRESENTATIVES AND/OR DISTRIBUTORS. BEING LISTED AS THE ONLY ACCEPTABLE MANUFACTURER FOR ONE LINE OF EQUIPMENT DOES NOT AUTOMATICALLY EXTEND TO ALL EQUIPMENT. BREAK BIDS ALONG RESPECTIVE SPECIFICATION SECTIONS.
- INSTALL ALL EQUIPMENT TO PROVIDE CLEARANCE AROUND ALL HVAC EQUIPMENT CONFORMING TO MANUFACTURER'S MINIMUM RECOMMENDED SPACE FOR MAINTENANCE AND/OR AIR FLOW AND SUFFICIENT TO ALLOW INSPECTION, SERVICE, REPAIR, OR REPLACEMENT WITHOUT REMOVING ELEMENTS OF PERMANENT CONSTRUCTION OR DISABLING THE FUNCTION OF FIRE RESISTANCE RATED ASSEMBLIES.
- DO NOT RUN DUCT OR PIPE ABOVE ELECTRICAL PANELS.
- ALL WORK IN OR ABOVE OCCUPIED AREAS SHALL BE AT OWNER'S CONVENIENCE AND MAY BE DURING EVENINGS OR WEEKENDS. SCHEDULE ALL SERVICE INTERRUPTIONS IN ADVANCE WITH OWNER.
- ONLY OWNER'S REPRESENTATIVE MAY SHUT OFF EQUIPMENT OR DISCONNECT UTILITIES.
- BEFORE SUBMITTING A BID, IT WILL BE NECESSARY FOR EACH CONTRACTOR WHOSE WORK IS INVOLVED TO VISIT THE SITE AND ASCERTAIN FOR HIMSELF THE CONDITIONS TO BE MET IN INSTALLING THE WORK AND MAKE PROVISIONS FOR THE CONDITIONS IN HIS FINAL PRICE. FAILURE OF THE CONTRACTOR TO COMPLY WITH THIS REQUIREMENT SHALL NOT BE CONSIDERED JUSTIFICATION FOR THE OMISSION OR FAULTY INSTALLATION OF ANY WORK COVERED BY THE CONTRACT DOCUMENTS. THE BID SHALL INCLUDE ALL THE WORK REQUIRED OR NECESSARY TO COMPLY WITH THE WORK SHOWN ON THE DRAWINGS AND IDENTIFIED IN THE SPECIFICATIONS. NO EXTRAS WILL BE ALLOWED FOR CONDITIONS THAT COULD BE READILY OBSERVED.
- REMOVE ALL UNUSED EXISTING DUCTWORK. CAP EXISTING TAPS OF DUCT MAINS WITH SHEET METAL CAPS AND SEAL AIRTIGHT.
- REMOVE ALL EXISTING DEVICES AND EQUIPMENT THAT ARE NOT TO BE REUSED.
- CONTRACTOR SHALL PROPERLY SEAL AND CAP ALL UNUSED DUCT TAPS AND NEW DUCTWORK. CONTRACTOR SHALL REPLACE ALL DAMAGED EXISTING FLEX DUCT AS REQUIRED.
- CONTRACTOR SHALL COORDINATE ALL WORK WITH THE BUILDING ENGINEER.
- ALL OTHER AREAS OF THE FLOOR NOT WITHIN THE SCOPE OF WORK SHALL REMAIN UNCHANGED.
- REPAIR ALL EXISTING DUCTWORK LEAKS AND DAMAGED INSULATION AS REQUIRED.
- EXISTING DUCTWORK WAS TAKEN FROM AS-BUILT DRAWINGS AND FIELD INVESTIGATION. CONTRACTOR SHALL FIELD VERIFY EXACT DUCTWORK CONDITIONS.
- BUILDING IS A STEEL STRUCTURE WITH THE 2-HOUR RATING AT THE CONCRETE SLAB. CEILING IS NOT PART OF THE RATED ASSEMBLY. CEILING RADIATION FIRE DAMPERS ARE NOT REQUIRED.
- AIR IS RETURNED TO THE RTU VIA DUCTED RETURN AND RETURN AIR TRANSFER DUCTS. CONTRACTOR SHALL VERIFY THAT SUFFICIENT RETURN AIR OPENINGS ARE PROVIDED.
- COORDINATE FINAL LOCATIONS AND LABELING REQUIREMENT OF THERMOSTATS WITH ARCHITECT AND BUILDING ENGINEER.
- LOCATE VOLUME DAMPERS ABOVE ACCESSIBLE CEILING. EVEN IN AREAS OF ACCESSIBLE CEILINGS, POSITION DAMPER HANDLE/OPERATOR ON BOTTOM SIDE OF DUCT OR ON CLEAR SIDE OF DUCT FOR EASE OF ADJUSTMENT.
- CONTRACTOR SHALL MAINTAIN MANUFACTURER CLEARANCES FOR ALL MECHANICAL EQUIPMENT AND ENSURE ALL SERVICEABLE COMPONENTS ARE READILY ACCESSIBLE, EVEN IN LAY-IN CEILING AREAS.
- CONTRACTOR SHALL COORDINATE WITH OTHER TRADES TO ENSURE THAT ALL NEW PLASTIC PIPING IN RETURN AIR PLENUMS AND EXPOSED AREAS ARE INSULATED (MORGAN PLENUMWRAP+ OR EQUAL) TO MEET CODE FLAME AND SMOKE REQUIREMENTS.
- NOTE TO PLAN CHECKER: BUILDING IS EXISTING AND RENOVATED SPACE IS CONDITIONED. BUILDING ENVELOPE CALCULATIONS ARE NOT REQUIRED.



21750 HARDY OAK BLVD. -----STE 102

SAN ANTONIO -----TX, 78258

P: 210.964.0132 -----M: 512.773.3070



7/25/2022



Texas Registered Engineering Firm F-10573

**LEGENT NORTH HOUSTON
SURGICAL HOSPITAL**
 24429 TOMBALL PKWY, SUITE 100
 TOMBALL, TX 77375

Drawn BAR

Checked SSM

Date 06/30/22

PROJECT No.

Revisions

06/30/22 ISSUE FOR CONSTRUCTION

SHEET TITLE
**MECHANICAL
 LEGENDS AND
 NOTES**

SHEET NO.

M001

HVAC DESIGN CRITERIA:

OUTDOOR DESIGN CONDITIONS (TOMBALL, TEXAS) PER 2015 IECC TABLE C302.2:

- 96°F DB, 80.5°F WB SUMMER; 28°F DB WINTER
- 7357 DEGREE DAYS COOLING; 1371 DEGREE DAYS HEATING
- CLIMATE ZONE 2A

HUMIDITY CONTROL: HUMIDIFICATION REQUIRED

75°F COOLING (MINIMUM ALLOWED BY 2015 IECC, SECTION C302.1)

72°F HEATING (MAXIMUM ALLOWED BY 2015 IECC, SECTION C302.1)

TEMPERATURE, HUMIDITY, AIR CHANGES, AND PRESSURIZATION PER FIGURE 25 TAC 133.169(C) BELOW:

Area Designation	Air movement relationship to adjacent areas ¹⁶	Minimum air changes of outdoor air per hour ¹	Minimum total air changes per hour ¹	All air exhausted directly to outdoors ²	Recirculated by means of room units ³	Relative humidity (%)	Design temperature ⁴ (degrees F)
SURGERY AND CRITICAL CARE							
Operating/Surgical, cytotoxic rooms ^{9,16}	Out	4	20	---	No	30-60	68-73 ¹⁷
Airborne infection isolation surgical rooms	In	4	15	Yes	No	30-60	68-73
Isolation anteroom (surgery)	In/Out ²⁰	---	10	Yes	No	---	---
Delivery room ⁹	Out	3	15	---	No	30-60	68-73
Recovery room ⁹	---	2	6	---	No	30-60	70-75
Critical and intensive care	---	2	6	---	No	30-60	70-75
Treatment room ¹⁰	---	---	6	---	---	---	75
Trauma room ¹⁰	Out	3	15	---	No	30-60	70-75
Anesthesia gas storage	In	---	8	Yes	---	---	---
Endoscopy	Out	2	6	---	No	30-60	68-73
Bronchoscopy	In	2	12	Yes	No	30-60	68-73
Intermediate care	---	2	6 ¹⁸	---	No	30-60	70-75
Newborn intensive care	---	2	6	---	No	30-60	72-78
Emergency suite waiting	In	2	12	Yes ¹⁹	---	---	70-75
Triage	In	2	12	Yes ¹⁹	---	---	70-75
Radiology waiting	In	2	12	Yes ¹⁹	---	---	70-75
Procedure room	Out	4	20	---	No	30-60	70-75
Laser eye room	Out	4	20	---	No	30-60	70-75
X-ray (Surgical/Critical care, catheterization)	Out	3	15	---	No	30-60	70-75
NURSING							
Patient room	---	2	6 ¹⁸	---	---	---	70-75
Toilet room	In	---	10	Yes	---	---	70-75
Newborn nursery suite	---	2	6	---	No	30-60	72-78
Protective environment room ¹¹	In/Out	2	12	---	No	---	70-75
Protective environment anteroom ¹¹	In/In ²¹	---	10	---	No	---	---
Airborne infection isolation room ¹²	In	2	12	Yes	No	---	70-75
Isolation alcove or anteroom ¹²	In/Out ²⁰	---	10	Yes	No	---	---
Labor, delivery, recovery (LDR)	---	2	6 ¹⁸	---	---	---	70-75
Labor, delivery, recovery, postpartum(LDRP)	---	2	6 ¹⁸	---	---	---	70-75
Patient corridor	---	---	2	---	---	---	---
ANCHILARY							
Radiology ¹³	---	---	6	---	---	---	75
X-ray (diagnostic and treatment)	---	---	6	---	---	---	75
Darkroom	In	---	10	Yes	No	---	---
Fluoroscopy	In	2	6	---	---	---	75
Laboratory General ¹³	---	2	6	---	---	---	75
Bacteriology	In	2	6	Yes	No	---	75
Biochemistry ¹³	In	2	6	Yes	No	---	75
Cytology	In	2	6	Yes	No	---	75
Glass washing	In	---	10	Yes	---	---	75
Histology	In	2	6	Yes	No	---	75
Microbiology ¹³	In	2	6	Yes	No	---	75
Nuclear medicine	In	2	6	Yes	No	---	75
Pathology	In	2	6	Yes	No	---	75
Serology	In	2	6	Yes	No	---	75
Sterilizing	In	---	10	Yes	No	---	75
Media transfer	Out	2	4	---	---	---	---
Anatomy room	In	---	12	Yes	No	---	---
Near/Integrated body-holding room	In	---	10	Yes	---	---	70
Pharmacy	Out	---	4	---	---	---	75
Preparation/anteroom	Out	2	6	---	---	---	75
Examination room	---	---	6	---	---	---	75
Medication room	Out	---	4	---	---	---	75
Treatment room	---	---	6	---	---	---	75
Physical therapy and hydrotherapy	In	---	6	---	---	---	75
Soiled workroom or holding	In	---	10	Yes	No	---	---
Clean workroom or holding	Out	---	4	---	---	---	---
STERILIZING AND SUPPLY							
EO sterilizer room ¹⁵	In	---	10	Yes	No	30-60	75
Sterilizer equipment room ²	In	---	10	Yes	No	---	---
Central medical and surgical supply	---	---	---	---	---	---	---
Soiled or decontamination room	In	---	6	Yes	No	---	68-73
Clean workroom	Out	---	4	---	No	30-60	75
Sterile storage	Out	---	4	---	---	70 Max	---
Equipment storage	---	---	2	---	---	---	---
SERVICE							
Food preparation center ¹⁴	---	---	10	---	No	---	---
Ware washing	In	---	10	Yes	No	---	---
Dietary day storage	In	---	2	---	---	---	---
Laundry, general	---	---	10	Yes	---	---	---
Soiled linen (sorting and storage)	In	---	10	Yes	No	---	---
Clean linen storage	Out	---	2	---	---	---	---
Soiled linen and trash chute room	In	---	10	Yes	No	---	---
Bedpan room	In	---	10	Yes	---	---	---
Bathroom	In	---	10	Yes	---	---	75
Janitor's closet	In	---	10	Yes	No	---	---
ADMINISTRATIVE AND SUPPORT SERVICE							
Administrative and support service	---	---	2	---	---	30 Min	68-73

OUTSIDE AIR REQUIREMENTS PER ASHRAE 62.1-2013

OFFICE SPACES: 5 CFM PER PERSON, 0.06 CFM PER SQ. FT.
CORRIDORS: 0.06 CFM PER SQ. FT.
STORAGE: 0.06 CFM PER SQ. FT.

ENERGY CODE PER 2015 IECC CHAPTER 4 (NOT ASHRAE 90.1) - MANDATORY.
HOUSTON IS ZONE 2A WARM-HUMID

SECTION C403 BUILDING MECHANICAL SYSTEMS

C403.2.1 Calculation of heating and cooling loads.
Engineer has performed HVAC load calculations using Trace 700

C403.2.2 Equipment sizing.
The output capacity of heating and cooling equipment shall be not greater than the loads calculated in accordance with Section C403.2.1. A single piece of equipment providing both heating and cooling shall satisfy this provision for one function with the capacity for the other function as small as possible, within available equipment options.

Exceptions:

- Required standby equipment and systems provided with controls and devices that allow such systems or equipment to operate automatically only when the primary equipment is not operating.
- Multiple units of the same equipment type with combined capacities exceeding the design load and provided with controls that have the capability to sequence the operation of each unit based on load.

C403.2.3 HVAC equipment performance requirements.
Equipment shall meet the minimum efficiency requirements of Tables C403.2.3.

C403.2.4 HVAC system controls.
Each heating and cooling system shall be provided with thermostatic controls.

C403.2.4.1 Thermostatic controls.
The supply of heating and cooling energy to each zone shall be controlled by individual thermostatic controls capable of responding to temperature within the zone. Where humidification or dehumidification or both is provided, at least one humidity control device shall be provided for each humidity control system.

C403.2.4.1.1 Heat pump supplementary heat.
Heat pumps having supplementary electric resistance heat shall have controls that, except during defrost, prevent supplementary heat operation where the heat pump can provide the heating load.

C403.2.4.1.2 Deadband.
Where used to control both heating and cooling, zone thermostatic controls shall provide a temperature range or deadband of at least 5°F within which the supply of heating and cooling energy to the zone is capable of being shut off or reduced to a minimum.

Exceptions:

- Thermostats requiring manual changeover between heating and cooling modes.
- Occupancies or applications requiring precision in indoor temperature control as approved by the code official.

C403.2.4.1.3 Set point overlap restriction.
Where a zone has a separate heating and a separate cooling thermostat control located within the zone, a limit switch, mechanical stop, or direct digital control systems with software programming shall be provided with the capability to prevent the heating set point from exceeding the cooling set point and to maintain a deadband in accordance with Section C403.2.4.1.2.

C403.2.4.2 Thermostatic setback capabilities.
Thermostatic setback controls shall have the capability to set back or temporarily operate the system to maintain zone temperatures down to 55°F or up to 85°F.

C403.2.4.3 Shutoff dampers.
Outdoor air intake and exhaust openings and stairway and shaft vents shall be provided with Class I motorized dampers. The dampers shall have an air leakage rate not greater than 4 cfm/ft² of damper surface area at 1.0 inch water gauge and shall be labeled by an approved agency when tested in accordance with AMCA 500D for such purpose.

Outdoor air intake and exhaust dampers shall be installed with automatic controls configured to close when the systems or spaces served are not in use or during unoccupied period warm-up and setback operation, unless the systems served require outdoor or exhaust air in accordance with the International Mechanical Code or the dampers are opened to provide intentional economizer cooling.

Stairway and shaft vent dampers shall be installed with automatic controls configured to open upon the activation of any fire alarm initiating device of the building's fire alarm system or the interruption of power to the damper.

Exception: Gravity (nonmotorized) dampers shall be permitted to be used as follows:

- In buildings less than three stories in height above grade plane.
- In buildings of any height located in Climate Zones 1, 2 or 3.
- Where the design exhaust capacity is not greater than 300 cfm.

Gravity (nonmotorized) dampers shall have an air leakage rate not greater than 20 cfm/ft² where not less than 24 inches in either dimension and 40 cfm/ft² where less than 24 inches in either dimension. The rate of air leakage shall be determined at 1.0 inch water gauge when tested in accordance with AMCA 500D for such purpose. The dampers shall be labeled by an approved agency.

C403.2.4.4 Zone isolation.
HVAC systems serving zones that are over 25,000 square feet in floor area or that span more than one floor and are designed to operate or be occupied nonsimultaneously shall be divided into isolation areas. Each isolation area shall be equipped with isolation devices and controls configured to automatically shut off the supply of conditioned air and outdoor air to and exhaust air from the isolation area. Each isolation area shall be controlled independently by a device meeting the requirements of Section C403.2.4.2.2. Central systems and plants shall be provided with controls and devices that allow system and equipment operation for any length of time while serving only the smallest isolation area served by the system or plant.

Exceptions:

- Exhaust air and outdoor air connections to isolation areas where the fan system to which they connect is not greater than 5,000 cfm.
- Exhaust airflows from a single isolation area of less than 10 percent of the design airflow of the exhaust system to which it connects.
- Isolation areas intended to operate continuously or intended to be inoperative only when all other isolation areas in a zone are inoperative.

C403.2.4.7 Economizer fault detection and diagnostics (FDD).
Air-cooled unitary direct-expansion units listed in Tables C403.2.3(1) through C403.2.3(3) and variable refrigerant flow (VRF) units that are equipped with an economizer in accordance with Section C403.3 shall include a fault detection and diagnostics (FDD) system complying with the following:

- The following temperature sensors shall be permanently installed to monitor system operation:
 - 1.1. Outside air.
 - 1.2. Supply air.
 - 1.3. Return air.
- Temperature sensors shall have an accuracy of ±2°F over the range of 40°F to 80°F.
- Refrigerant pressure sensors, where used, shall have an accuracy of ±3 percent of full scale.
- The unit controller shall be capable of providing system status by indicating the following:
 - 1.1. Free cooling available.
 - 1.2. Economizer enabled.
 - 1.3. Compressor enabled.
 - 1.4. Heating enabled.
 - 1.5. Mixed air low limit cycle active.
 - 1.6. The current value of each sensor.

The unit controller shall be capable of manually initiating each operating mode so that the operation of compressors, economizers, fans and the heating system can be independently tested and verified.

- The unit shall be capable of reporting faults to a fault management application accessible by day-to-day operating or service personnel, or annunciator locally on zone thermostats.
- The FDD system shall be capable of detecting the following faults:
 - 1.1. Air temperature sensor failure/fault.
 - 1.2. Not economizing when the unit should be economizing.
 - 1.3. Economizing when the unit should not be economizing.
 - 1.4. Damper not modulating.
 - 1.5. Excess outdoor air.

C403.2.6 Ventilation.
Ventilation, either natural or mechanical, shall be provided in accordance with Chapter 4 of the International Mechanical Code. Where mechanical ventilation is provided, the system shall provide the capability to reduce the outdoor air supply to the minimum required by Chapter 4 of the International Mechanical Code.

shall include a bypass or controls which permit operation of the economizer as required by Section C403.3.

C403.2.9 Duct and plenum insulation and sealing.
Supply and return air ducts and plenums shall be insulated with a minimum of R-6 insulation where located in unconditioned spaces and where located outside the building with a minimum of R-8 insulation in Climate Zones 1 through 4 and a minimum of R-12 insulation in Climate Zones 5 through 8. Where located within a building envelope assembly, the duct or plenum shall be separated from the building exterior or unconditioned or exempt spaces by a minimum of R-6 insulation in Climate Zones 1 through 4 and a minimum of R-12 insulation in Climate Zones 5 through 8.

Exceptions:

- Where located within equipment.
- Where the design temperature difference between the interior and exterior of the duct or plenum is not greater than 15°F.
- Ducts, air handlers and filter boxes shall be securely fastened and sealed with welds, gaskets, mastics (adhesives), mastic-plus-embedded fabric systems or tapes.

C403.2.9.1 Duct construction.
Ductwork shall be constructed and erected in accordance with the International Mechanical Code.

C403.2.9.1.1 Low-pressure duct systems.
Longitudinal and transverse joints, seams and connections of supply and return ducts operating at a static pressure less than or equal to 2 inches w.g. shall be securely fastened and sealed with welds, gaskets, mastics (adhesives), mastic-plus-embedded fabric systems or tapes installed in accordance with the manufacturer's installation instructions. Pressure classifications specific to the duct system shall be clearly indicated on the construction documents in accordance with the International Mechanical Code.

Exception: Locking-type longitudinal joints and seams, other than the snap-lock and button-lock types, need not be sealed as specified in this section

C403.2.9.1.2 Medium-pressure duct systems.
Ducts and plenums designed to operate at a static pressure greater than 2 inches w.g. but less than 3 inches w.g. shall be insulated and sealed in accordance with Section C403.2.9. Pressure classifications specific to the duct system shall be clearly indicated on the construction documents in accordance with the International Mechanical Code.

C403.2.9.1.3 Air System Design and Control
Each HVAC system having a total fan system motor nameplate horsepower (hp) exceeding 5 hp (3.7 kw) shall comply with the provisions of Sections C403.2.12.1 through C403.2.12.3

C403.2.12.1 Allowable fan motor horsepower.
Each HVAC system at fan system design conditions shall not exceed the allowable fan system motor nameplate hp (option 1) or fan system bhp (option 2) as shown in table C403.2.12.1(1). This includes supply fans, exhaust fans, return/relief fans, and fan-powered terminal units associated with systems providing heating or cooling capability. Single-zone variable air volume systems shall comply with the constant volume fan power limitation **Exceptions:**

- Hospital, vivarium and laboratory systems that utilize flow control devices on exhaust or return to maintain space pressure relationships necessary for occupant health and safety or environmental control shall be permitted to use variable volume fan power limitation.
- Individual exhaust fans with motor nameplate horsepower of 1 hp (0.746 kW) or less are exempt from the allowable fan horsepower requirement.

C403.2.12.2 Motor nameplate horsepower.
For each fan, the fan brake horsepower shall be indicated on the construction documents and the selected motor shall be not larger than the first available motor size greater than the following:

- For fans less than 6 bhp (4413 W), 1.5 times the fan brake horsepower.
- For fans 6 bhp (4413 W) and larger, 1.3 times the fan brake horsepower.
- Systems complying with Section C403.2.12.1 fan system motor nameplate hp (Option 1).

C403.2.12.3 Fan Efficiency
Fans shall have a fan efficiency grade (FEG) of not less than 67 when determined in accordance with AMCA 205 by an approved, independent testing laboratory and labeled by the manufacturer. The total efficiency of the fan at the design point of operation shall be within 15 percentage points of the maximum total efficiency of the fan.

Exception: The following fans are not required to have a fan efficiency grade:

- Fans of 5 hp (3.7 kW) or less as follows:
 1. Single fan with a motor nameplate horsepower of 5 hp or less, unless Exception 1.2 applies.
 2. Multiple fans in series or parallel that have a combined motor nameplate horsepower of 5 hp or less and are operated as the functional equivalent of a single fan.
- Fans that are part of equipment covered under section C403.2.3.
- Fans included in an equipment package certified by an approved agency for air or energy performance.
- Powered wall/roof ventilators.
- Fans outside the scope of AMCA 205.
- Fans that are intended to operate only during emergency conditions.

403.2.10 Piping insulation.
Piping serving as part of a heating or cooling system shall be thermally insulated in accordance with Table C403.2.10.

Exceptions:

- Factory-installed piping within HVAC equipment tested and rated in accordance with a test procedure referenced by this code.
- Factory-installed piping within room fan-coils and unit ventilators tested and rated according to AHRI 440 (except that the sampling and variation provisions of Section 6.5 shall not apply) and AHRI 840, respectively.
- Piping that conveys fluids that have a design operating temperature range between 60°F and 105°F.
- Piping that conveys fluids that have not been heated or cooled through the use of fossil fuels or electric power.
- Strainers, control valves, and balancing valves associated with piping 1 inch or less in diameter.
- Direct buried piping that conveys fluids at or below 60°F.

C403.2.10.1 Protection of piping insulation.
Piping insulation exposed to the weather shall be protected from damage, including that due to sunlight, moisture, equipment maintenance and wind, and shall provide shielding from solar radiation that can cause degradation of the material. Adhesive tape shall not be permitted.

C403.2.11 Mechanical systems commissioning and completion requirements.
Mechanical systems shall be commissioned and completed in accordance with Section C408.2.

C403.2.11 Integrated economizer control.
Economizer systems shall be integrated with the mechanical cooling system and be capable of providing partial cooling even when additional mechanical cooling is required to provide the remainder of the cooling load. Controls shall not be capable of creating a false load in the mechanical cooling systems by limiting or disabling the economizer or any other means, such as hot gas bypass, except at the lowest stage of mechanical cooling.

Units that include an air economizer shall comply with the following:

- Unit controls shall have the mechanical cooling capacity control interlocked with the air economizer controls such that the outdoor air damper is at the 100-percent open position when mechanical cooling is on and the outdoor air damper does not begin to close to prevent coil freezing due to minimum compressor run time until the leaving air temperature is less than 45°F.
- Direct expansion (DX) units that control 75,000 Btu/h or greater of rated capacity of the capacity of the mechanical cooling directly based on occupied space temperature shall have not fewer than two stages of mechanical cooling capacity control.
- Other DX units, including those that control space temperature by modulating the airflow to the space, shall be in accordance with Table C403.3.1.

C403.3.2 Economizer heating system impact.
HVAC system design and economizer controls shall be such that economizer operation does not increase building heating energy use during normal operation.

Exception: Economizers on variable air volume (VAV) systems that cause zone level heating to increase due to a reduction in supply air temperature.

C403.3.3 Air economizers.
Air economizers shall comply with Sections C403.3.3.1 through C403.3.3.5.

C403.3.3.1 Design capacity.
Air economizer systems shall be capable of modulating outdoor air and return air dampers to provide up to 100 percent of the design supply air quantity as outdoor air for cooling.

C403.3.3.2 Control signal.
Economizer dampers shall be capable of being sequenced with the mechanical cooling equipment and shall not be controlled by only mixed-air temperature.

Exception: The use of mixed-air temperature limit control shall be permitted for systems controlled from space temperature (such as single-zone systems).

C403.3.3.3 High-limit shutoff.
Air economizers shall be capable of automatically reducing outdoor air intake to the design minimum outdoor air quantity when outdoor air intake will no longer reduce cooling energy usage. High-limit shutoff control types for specific climates shall be chosen from Table C403.3.3.3. High-limit shutoff control settings for these control types shall be those specified in Table C403.3.3.3.

C403.3.3.4 Relief of excess outdoor air.
Systems shall be capable of relieving excess outdoor air during air economizer operation to prevent overpressurizing the building. The relief air outlet shall be located to avoid recirculation into the building.

C403.3.3.5 Economizer dampers.
Return, exhaust/relief and outdoor air dampers used in economizers shall comply with Section C403.2.4.3.

C403.3.4 Water-side economizers.
Water-side economizers shall comply with Sections C403.3.4.1 and C403.3.4.2.

C403.3.4.1 Design capacity.
Water economizer systems shall be capable of cooling supply air by indirect evaporation and providing up to 100 percent of the expected system cooling load at outdoor air temperatures of not greater than 50°F dry bulb/45°F wet bulb.

Exceptions:


- Systems primarily serving computer rooms in which 100 percent of the expected system cooling load at 40°F dry bulb/35°F wet bulb is met with evaporative water economizers.
- Systems primarily serving computer rooms with dry cooler water economizers which satisfy 100 percent of the expected system cooling load at 35°F dry bulb.
- Systems where dehumidification requirements cannot be met using outdoor air temperatures of 50°F dry bulb/45°F wet bulb and where 100 percent of the expected system cooling load at 45°F dry bulb/40°F wet bulb is met with evaporative water economizers.

C403.3.4.2 Maximum pressure drop.
Precooling coils and water-to-water heat exchangers used as part of a water economizer system shall either have a water-side pressure drop of less than 15 feet of water or a secondary loop shall be created so that the coil or heat exchanger pressure drop is not seen by the circulating pumps when the system is in the normal cooling (noneconomizer) mode.

SECTION C408 SYSTEM COMMISSIONING

C408.1 General.
This section covers the commissioning of the building mechanical systems in Section C403 and electrical power and lighting systems in Section C40

KEYED NOTES	
1	EXISTING DIFFUSER TO BE RELOCATED. RE: M201 FOR NEW LOCATION.
2	EXISTING RETURN GRILLE TO BE RELOCATED. RE: M201 FOR NEW LOCATION.
3	DEMO EXISTING RETURN DUCT TO POINT INDICATED.

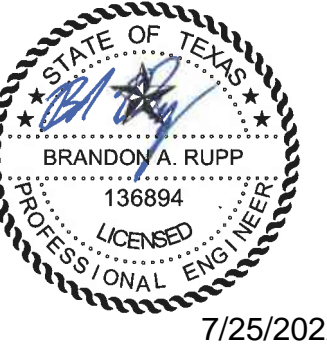


**LEGENT NORTH HOUSTON
 SURGICAL HOSPITAL**
 24429 TOMBALL PKWY, SUITE 100
 TOMBALL, TX 77375


Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
	06/30/22 ISSUE FOR CONSTRUCTION

SHEET TITLE
**MECHANICAL
 FIRST FLOOR
 DEMO PLAN**

SHEET NO.
M101

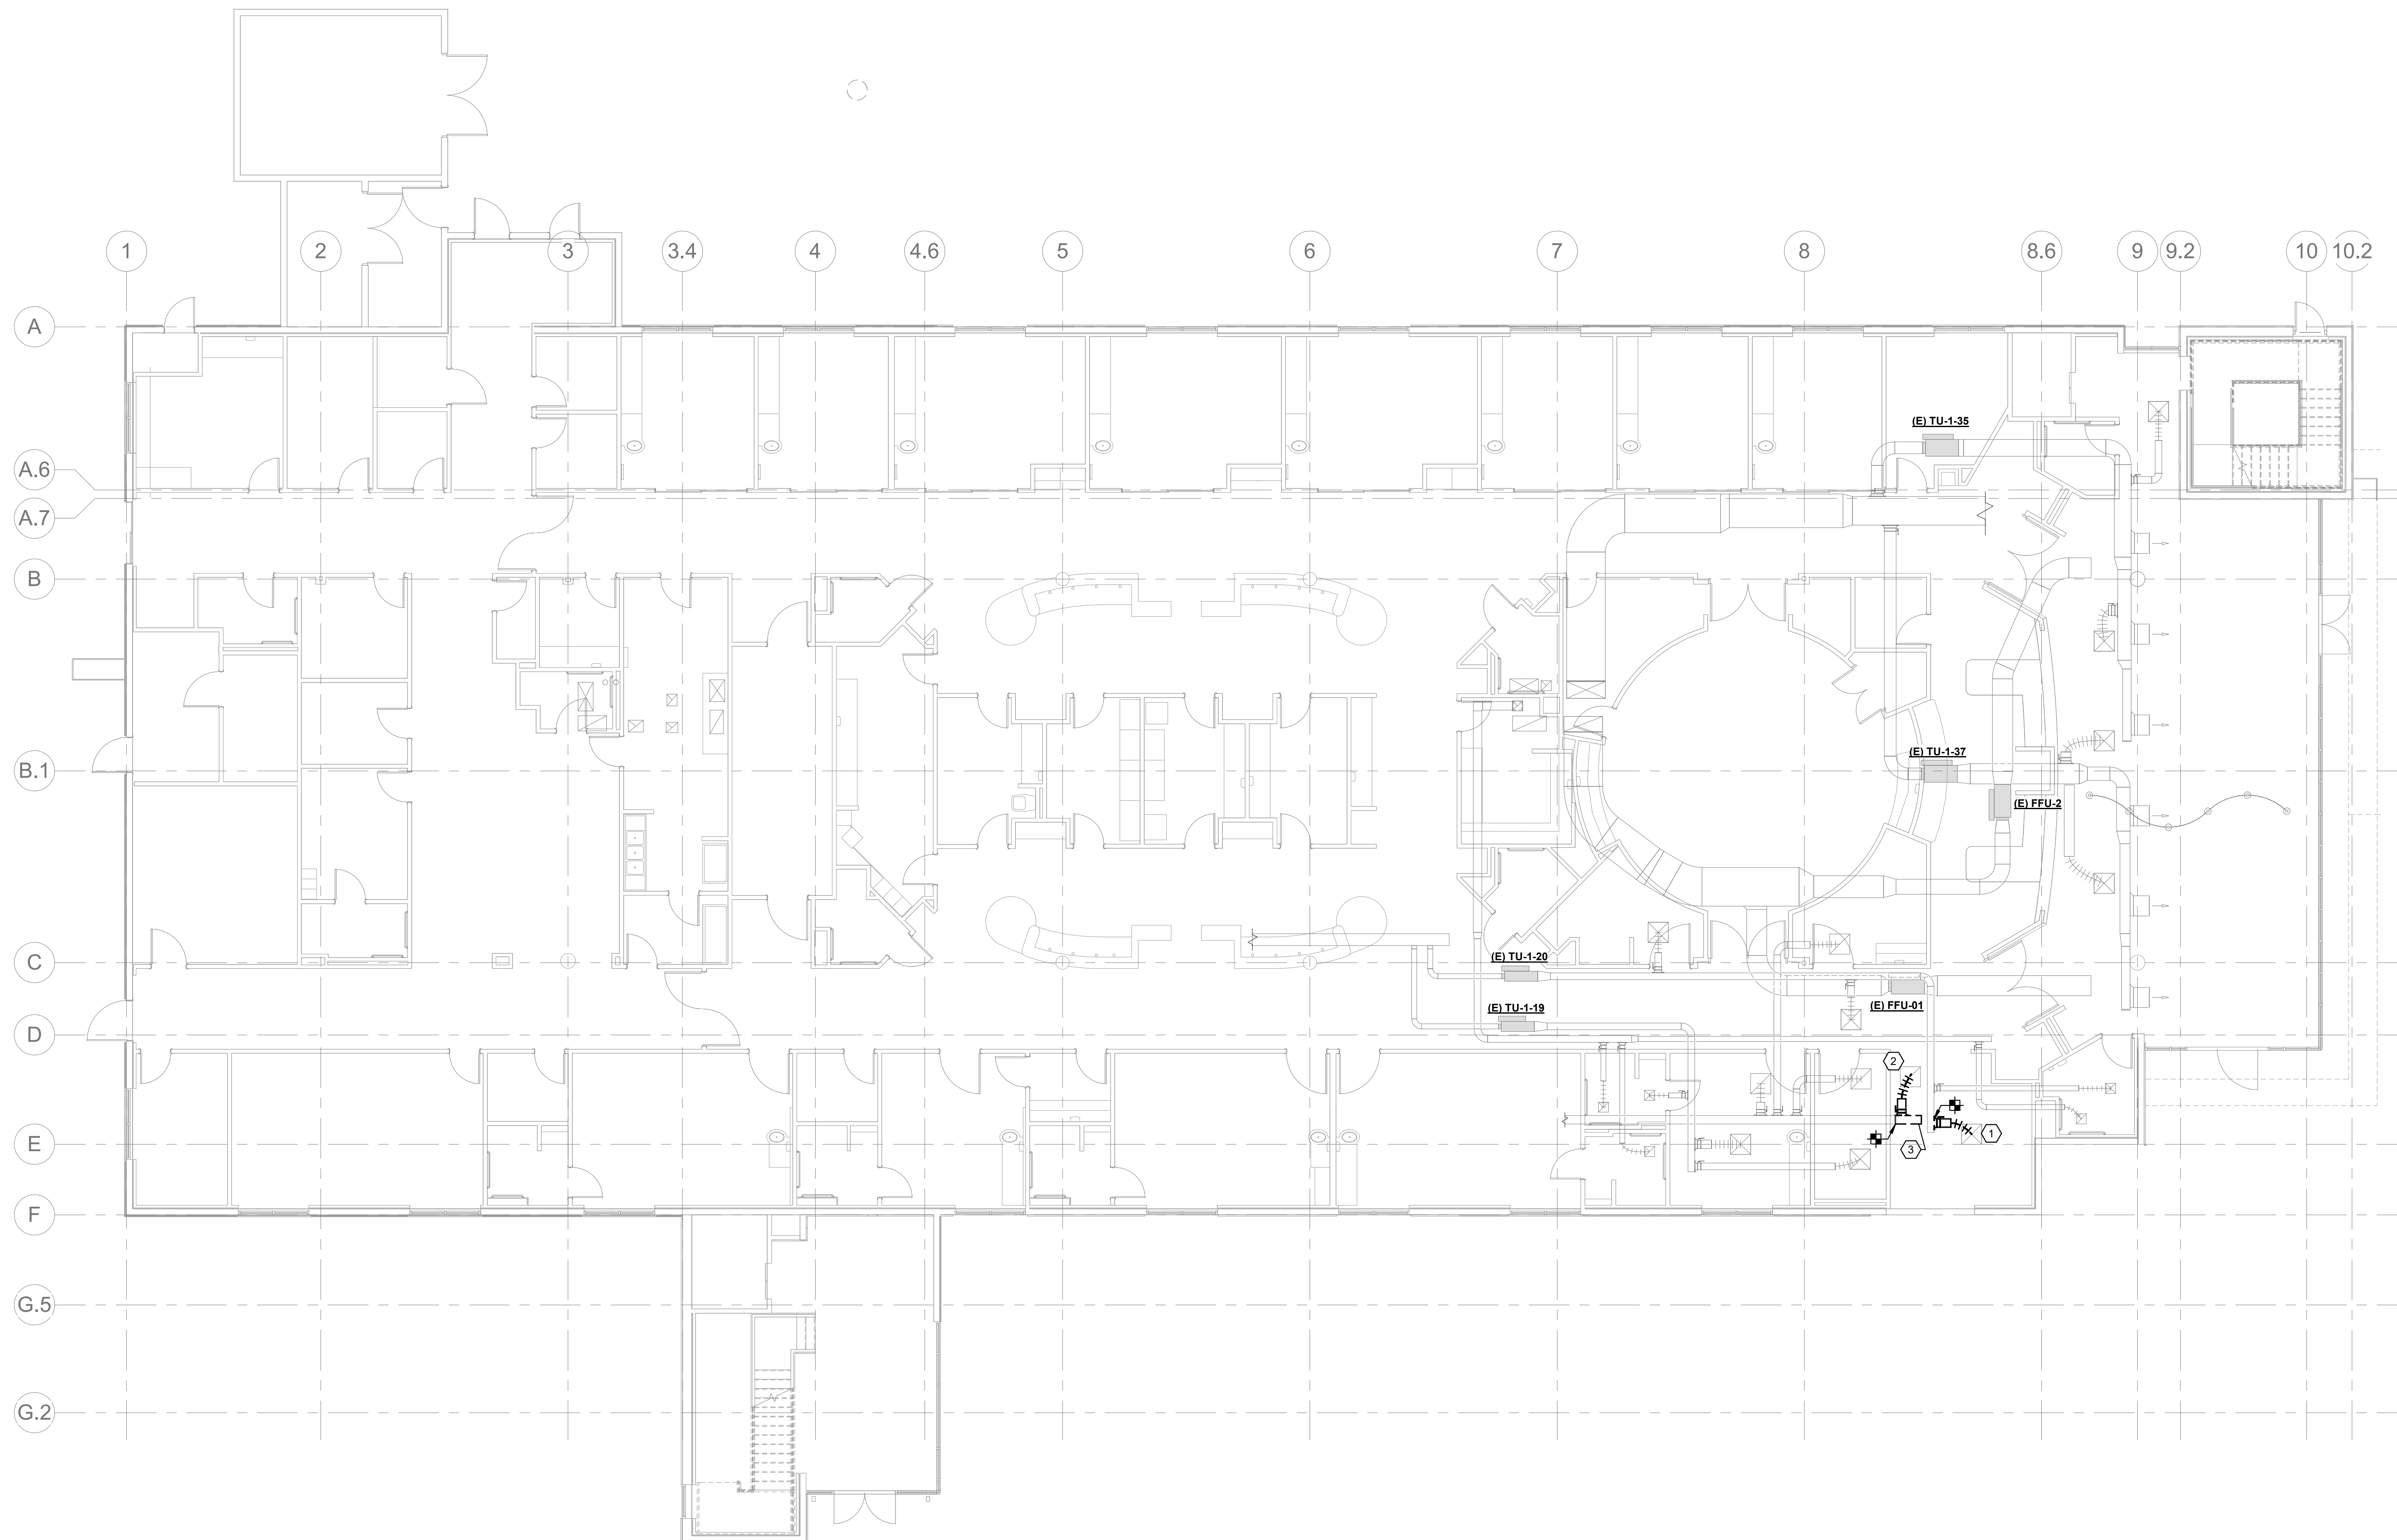

1 MECHANICAL FIRST FLOOR DEMO PLAN
 1/8" = 1'-0"

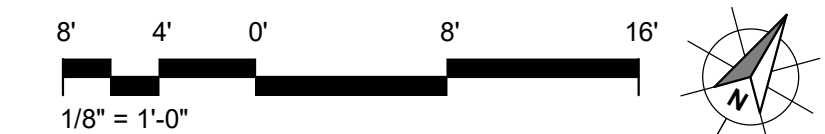

KEYED NOTES	
1	DEMO EXISTING SUPPLY DUCT UP TO ASSOCIATED UNIT ON ROOF.
2	DEMO EXISTING RETURN AIR DUCT UP TO ASSOCIATED UNIT ON ROOF.
3	DEMO EXISTING EXHAUST DUCTWORK AND ASSOCIATED EXHAUST FAN ON ROOF.
4	DEMO EXISTING SIDE WALL GRILLE AND ASSOCIATED DUCTWORK.
5	DEMO EXISTING SIDE WALL SUPPLY DIFFUSER.
6	DEMO EXISTING RETURN AIR TRANSFER DUCT.
7	DEMO EXISTING VAV AND ASSOCIATED CONTROLS.
8	DEMO DUCT PENETRATION INTO 2 HOUR FIRE AND SMOKE BARRIER IN PREPARATION FOR INSTALLATION OF NEW FIRE SMOKE DAMPER.
9	DEMO EXISTING RETURN AIR GRILLE.
10	DEMO CHILLED WATER SUPPLY/RETURN PIPING TO MAIN AS INDICATED.
11	DEMO EXISTING SUPPLY DIFFUSER AND ASSOCIATED DUCTWORK.
12	DEMO EXISTING EXHAUST GRILLE AND ASSOCIATED DUCTWORK.
13	DEMO EXISTING SUPPLY DUCTWORK AS SHOWN. EXISTING DUCTWORK AND ASSOCIATED DUCT MOUNTED AIR DEVICES SHALL REMAIN FOR FUTURE CONNECTION. SEE MECHANICAL PLAN FOR FUTHER INSTRUCTION.



21750 HARDY OAK BLVD. STE 102
 SAN ANTONIO TX, 78258
 P: 210.964.0132 M: 512.773.3070




ENGINEERS
 PLANNERS
 SCIENTISTS
 CONSTRUCTION MANAGERS
KCI
 TECHNOLOGIES
 13750 SAN PEDRO AVE. #640
 SAN ANTONIO, TX 78232
 PHONE: 210-544-5751
 FAX: 713-237-9801
 Texas Registered Engineering Firm F-10573

**LEGENT NORTH HOUSTON
 SURGICAL HOSPITAL**
 24429 TOMBALL PKWY, SUITE 100
 TOMBALL, TX 77375


Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
	06/30/22 ISSUE FOR CONSTRUCTION

SHEET TITLE
**MECHANICAL
 SECOND FLOOR
 DEMO PLAN**

SHEET NO.
M102

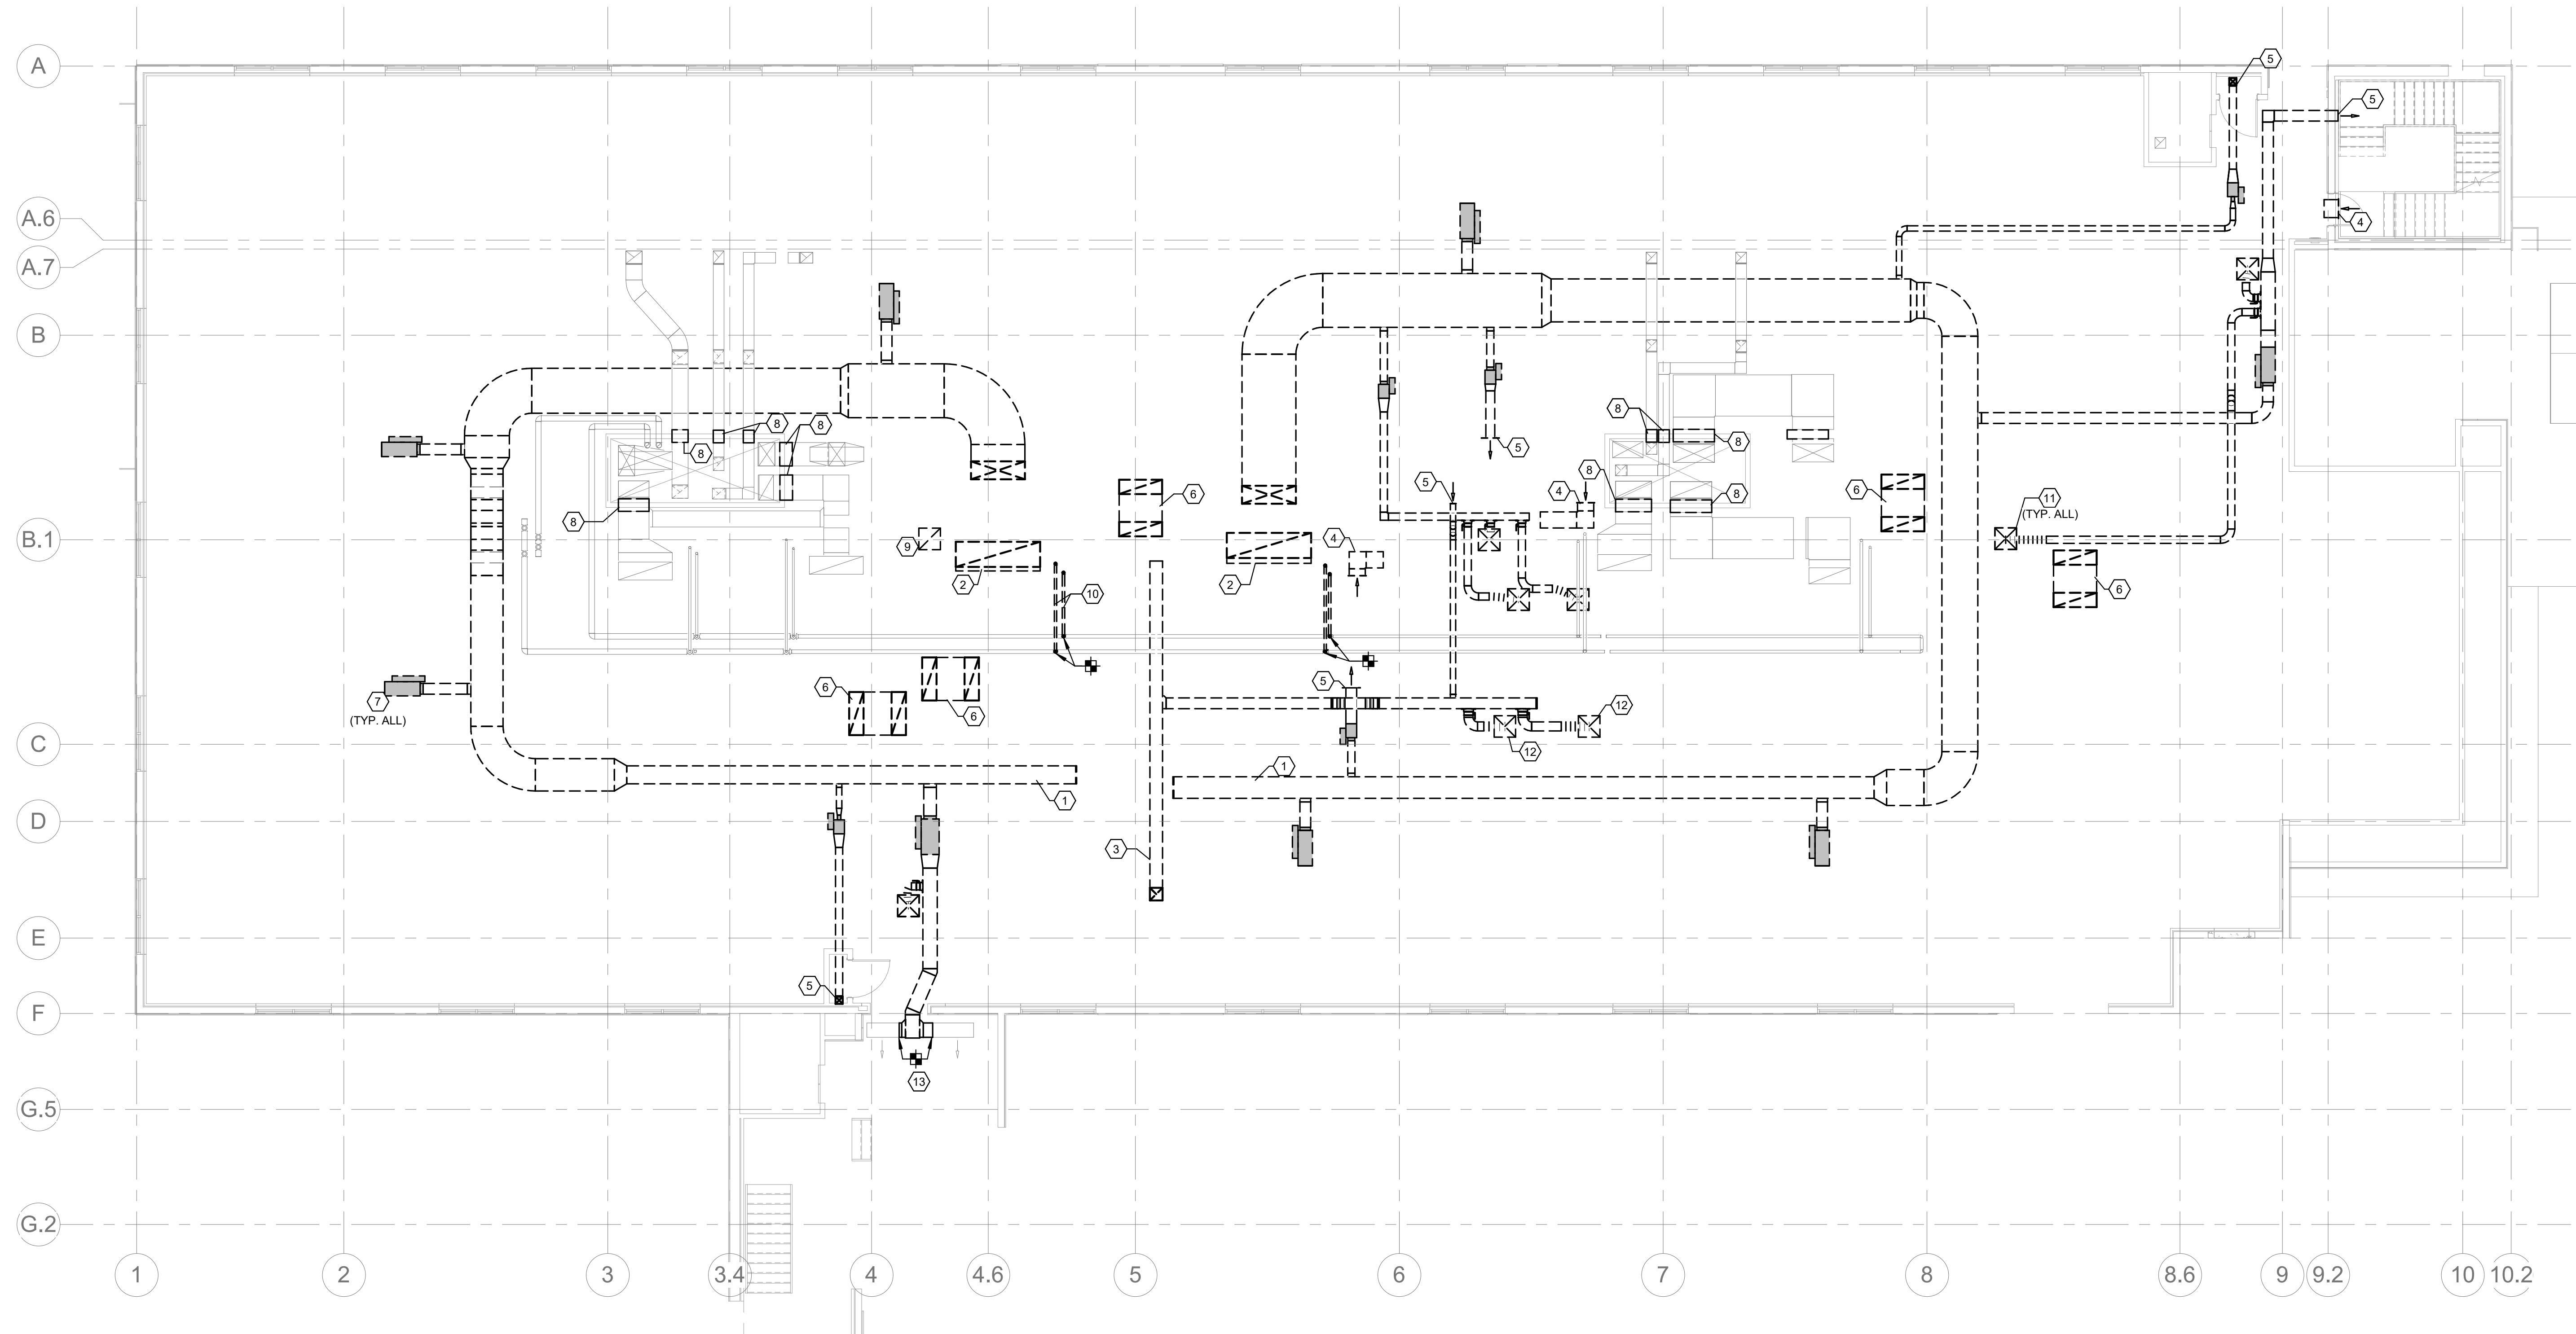

1 MECHANICAL SECOND FLOOR DEMOLITION PLAN
 1/8" = 1'-0"

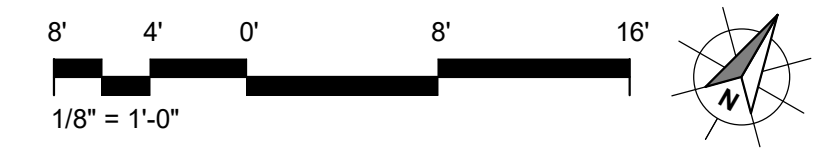

© 2022 XA COLLECTIVE, LLC. Unauthorized reproduction is prohibited.


KEYED NOTES	
1	DEMO EXISTING CHILLED WATER RTU AND ASSOCIATED CHILLED WATER PIPING, CONDENSATE PIPING, DUCTWORK, CONTROLS, ETC.
2	DEMO EXISTING EXHAUST FAN.
3	REMOVE ASSOCIATED ROOF CURB AND PATCH AND SEAL ROOF WATER TIGHT.




Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
06/30/22	ISSUE FOR CONSTRUCTION

SHEET TITLE
**MECHANICAL
 ROOF DEMOLITION
 PLAN**

SHEET NO.
M103

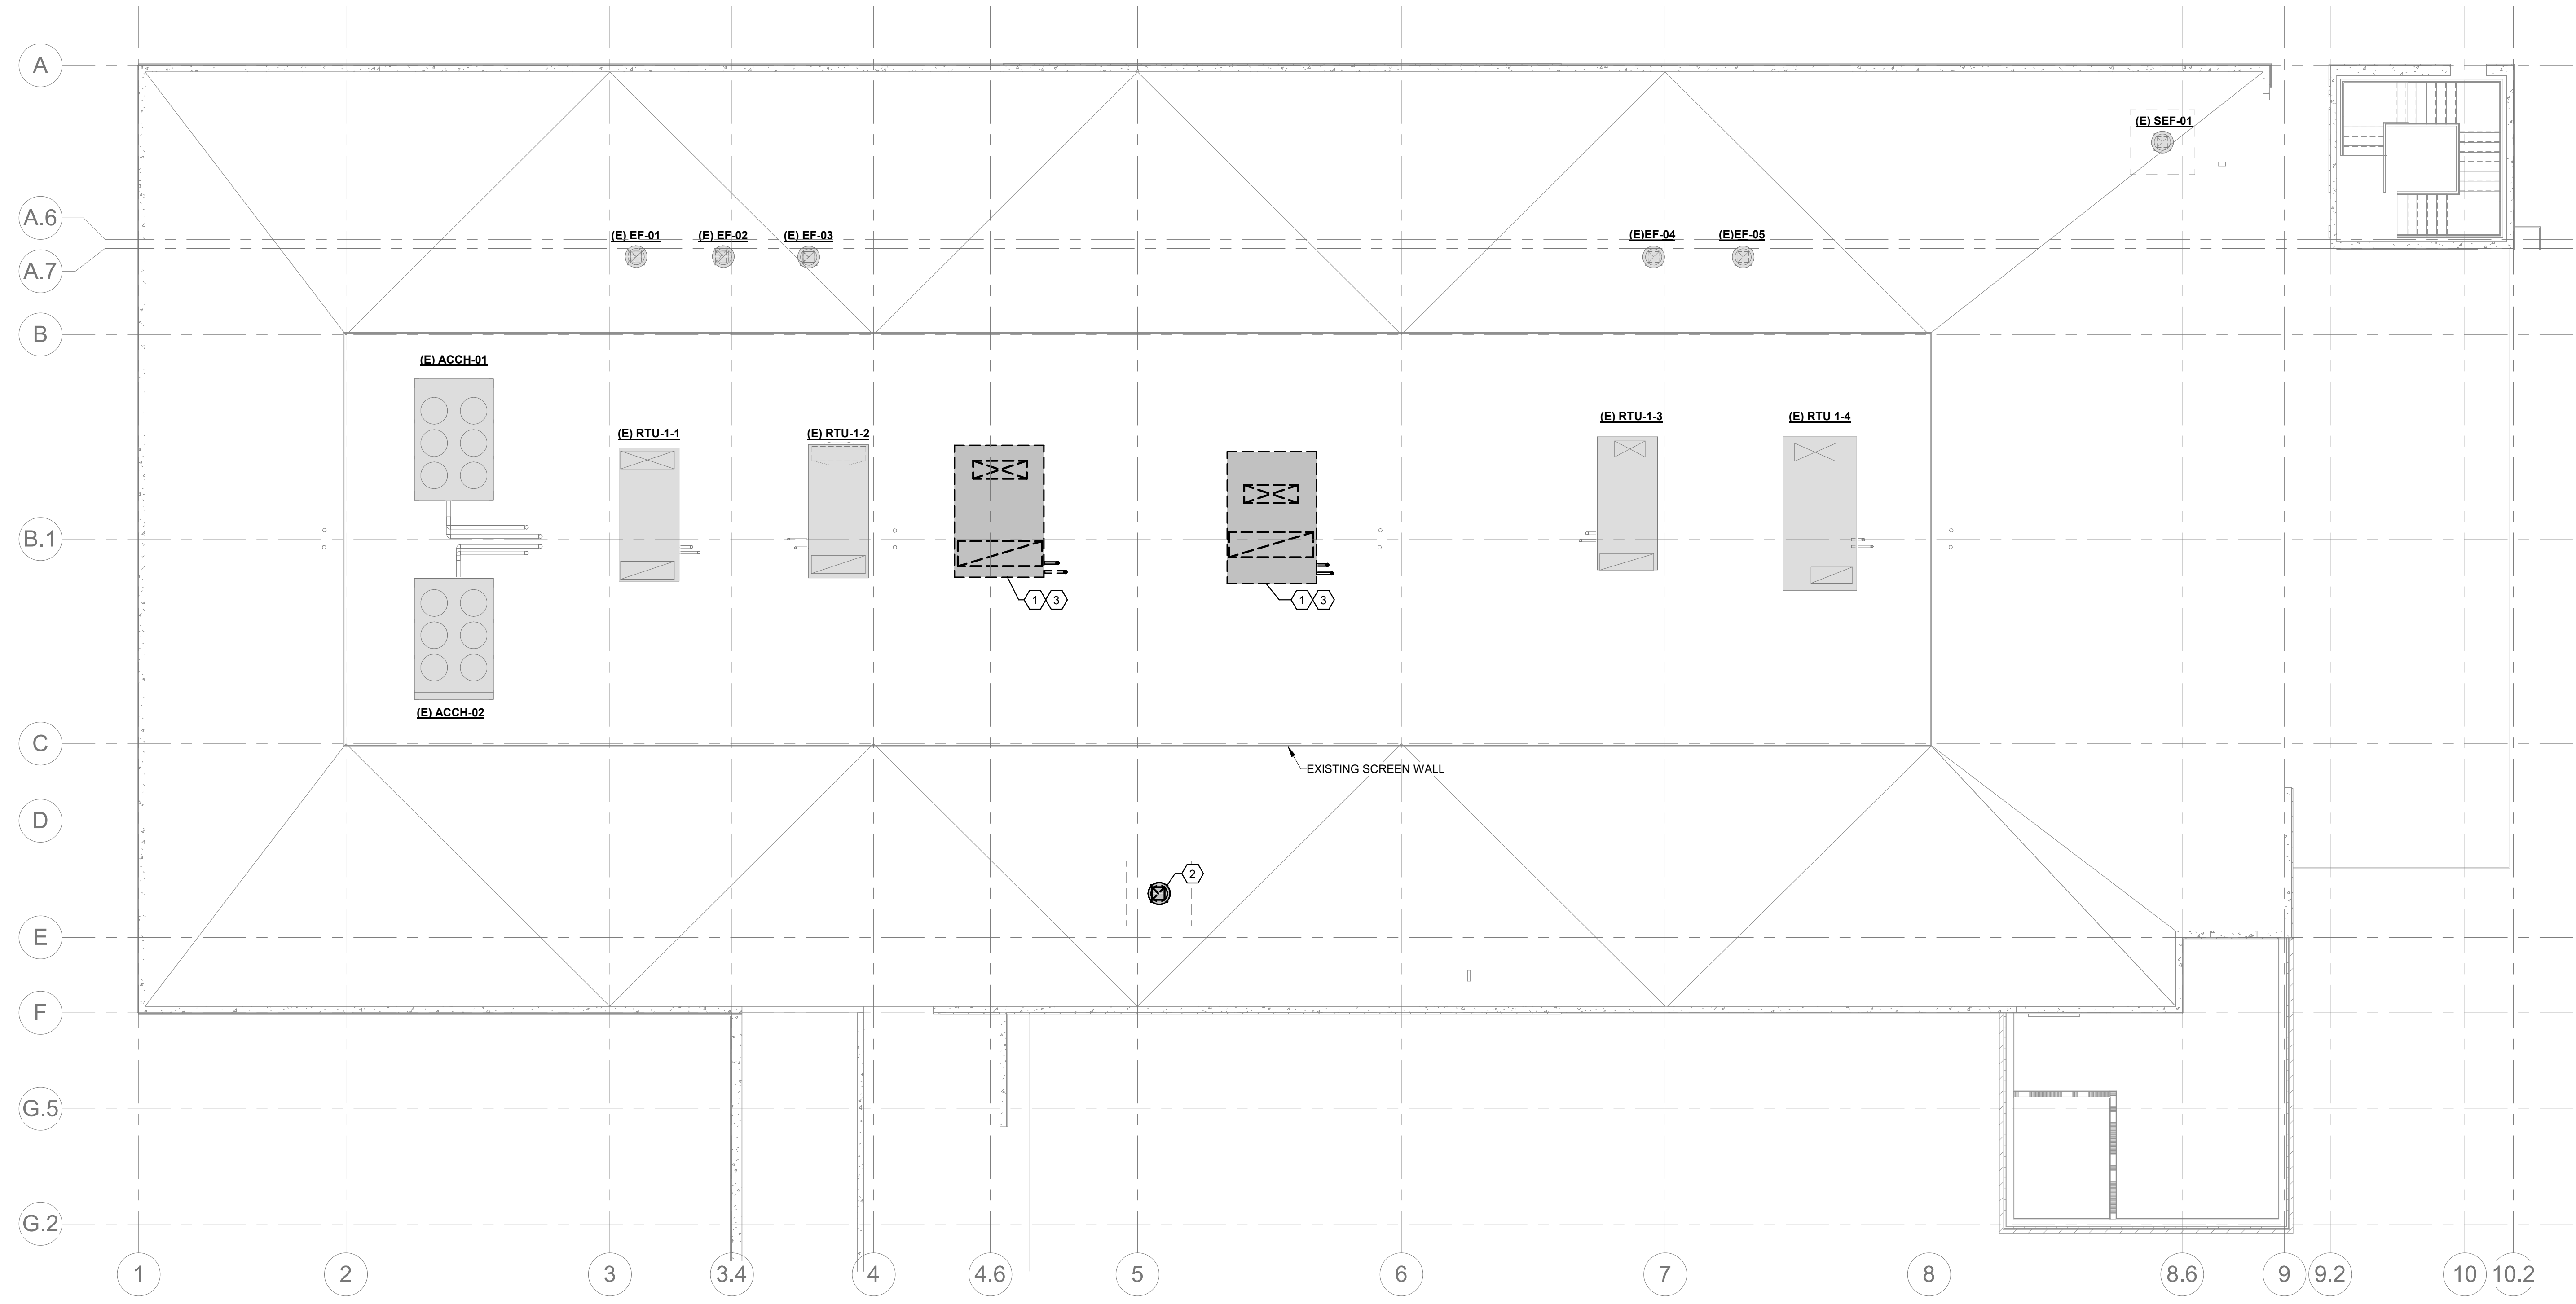

1 MECHANICAL ROOF DEMOLITION PLAN
 1/8" = 1'-0"

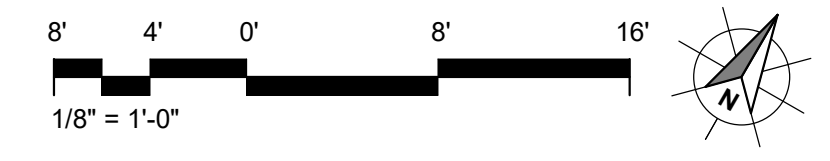

© 2022 XA COLLECTIVE, LLC. Unauthorized reproduction is prohibited.




**LEGENT NORTH HOUSTON
 SURGICAL HOSPITAL**
 24429 TOMBALL PKWY, SUITE 100
 TOMBALL, TX 77375

Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
06/30/22	ISSUE FOR CONSTRUCTION


SHEET TITLE
**MECHANICAL
 FIRST FLOOR PLAN**

SHEET NO.
M201

- KEYED NOTES**
- EXISTING SUPPLY DIFFUSER SHALL BE RELOCATED AS SHOWN. REBALANCE TO CFM INDICATED. PROVIDE NEW SPIN-IN AND FLEX DUCT. CAP AND SEAL UNUSED DUCT OPENING AIR TIGHT. REUSE EXISTING DUCT OPENINGS WHERE AVAILABLE. SEE SCHEDULE AND DETAIL.
 - EXISTING RETURN GRILLE SHALL BE RELOCATED AS SHOWN. REBALANCE TO CFM INDICATED. PROVIDE NEW SPIN-IN AND FLEX DUCT. CAP AND SEAL UNUSED DUCT OPENING AIR TIGHT. REUSE EXISTING DUCT OPENINGS WHERE AVAILABLE. SEE SCHEDULE AND DETAIL.
 - NEW SUPPLY AIR DIFFUSER SHALL BE LOCATED AS SHOWN. BALANCE TO CFM INDICATED. PROVIDE NEW SPIN-INS, SPIRAL DUCTWORK, AND FLEX DUCT. SEE SCHEDULE AND DETAILS.
 - RELOCATE EXISTING THERMOSTAT TO LOCATION INDICATED AND TIE INTO DESIGNATED EQUIPMENT CONTROLS.
 - REBALANCE EXISTING SUPPLY DIFFUSER TO CFM INDICATED.
 - REBALANCE EXISTING TERMINAL UNIT TO CFM OF ALL CONNECTED AIR DEVICES.
 - NEW RETURN GRILLE SHALL BE LOCATED AS SHOWN. BALANCE TO INDICATED CFM. SEE SCHEDULE.
 - REBALANCE EXISTING RETURN AIR GRILLE TO CFM INDICATED.

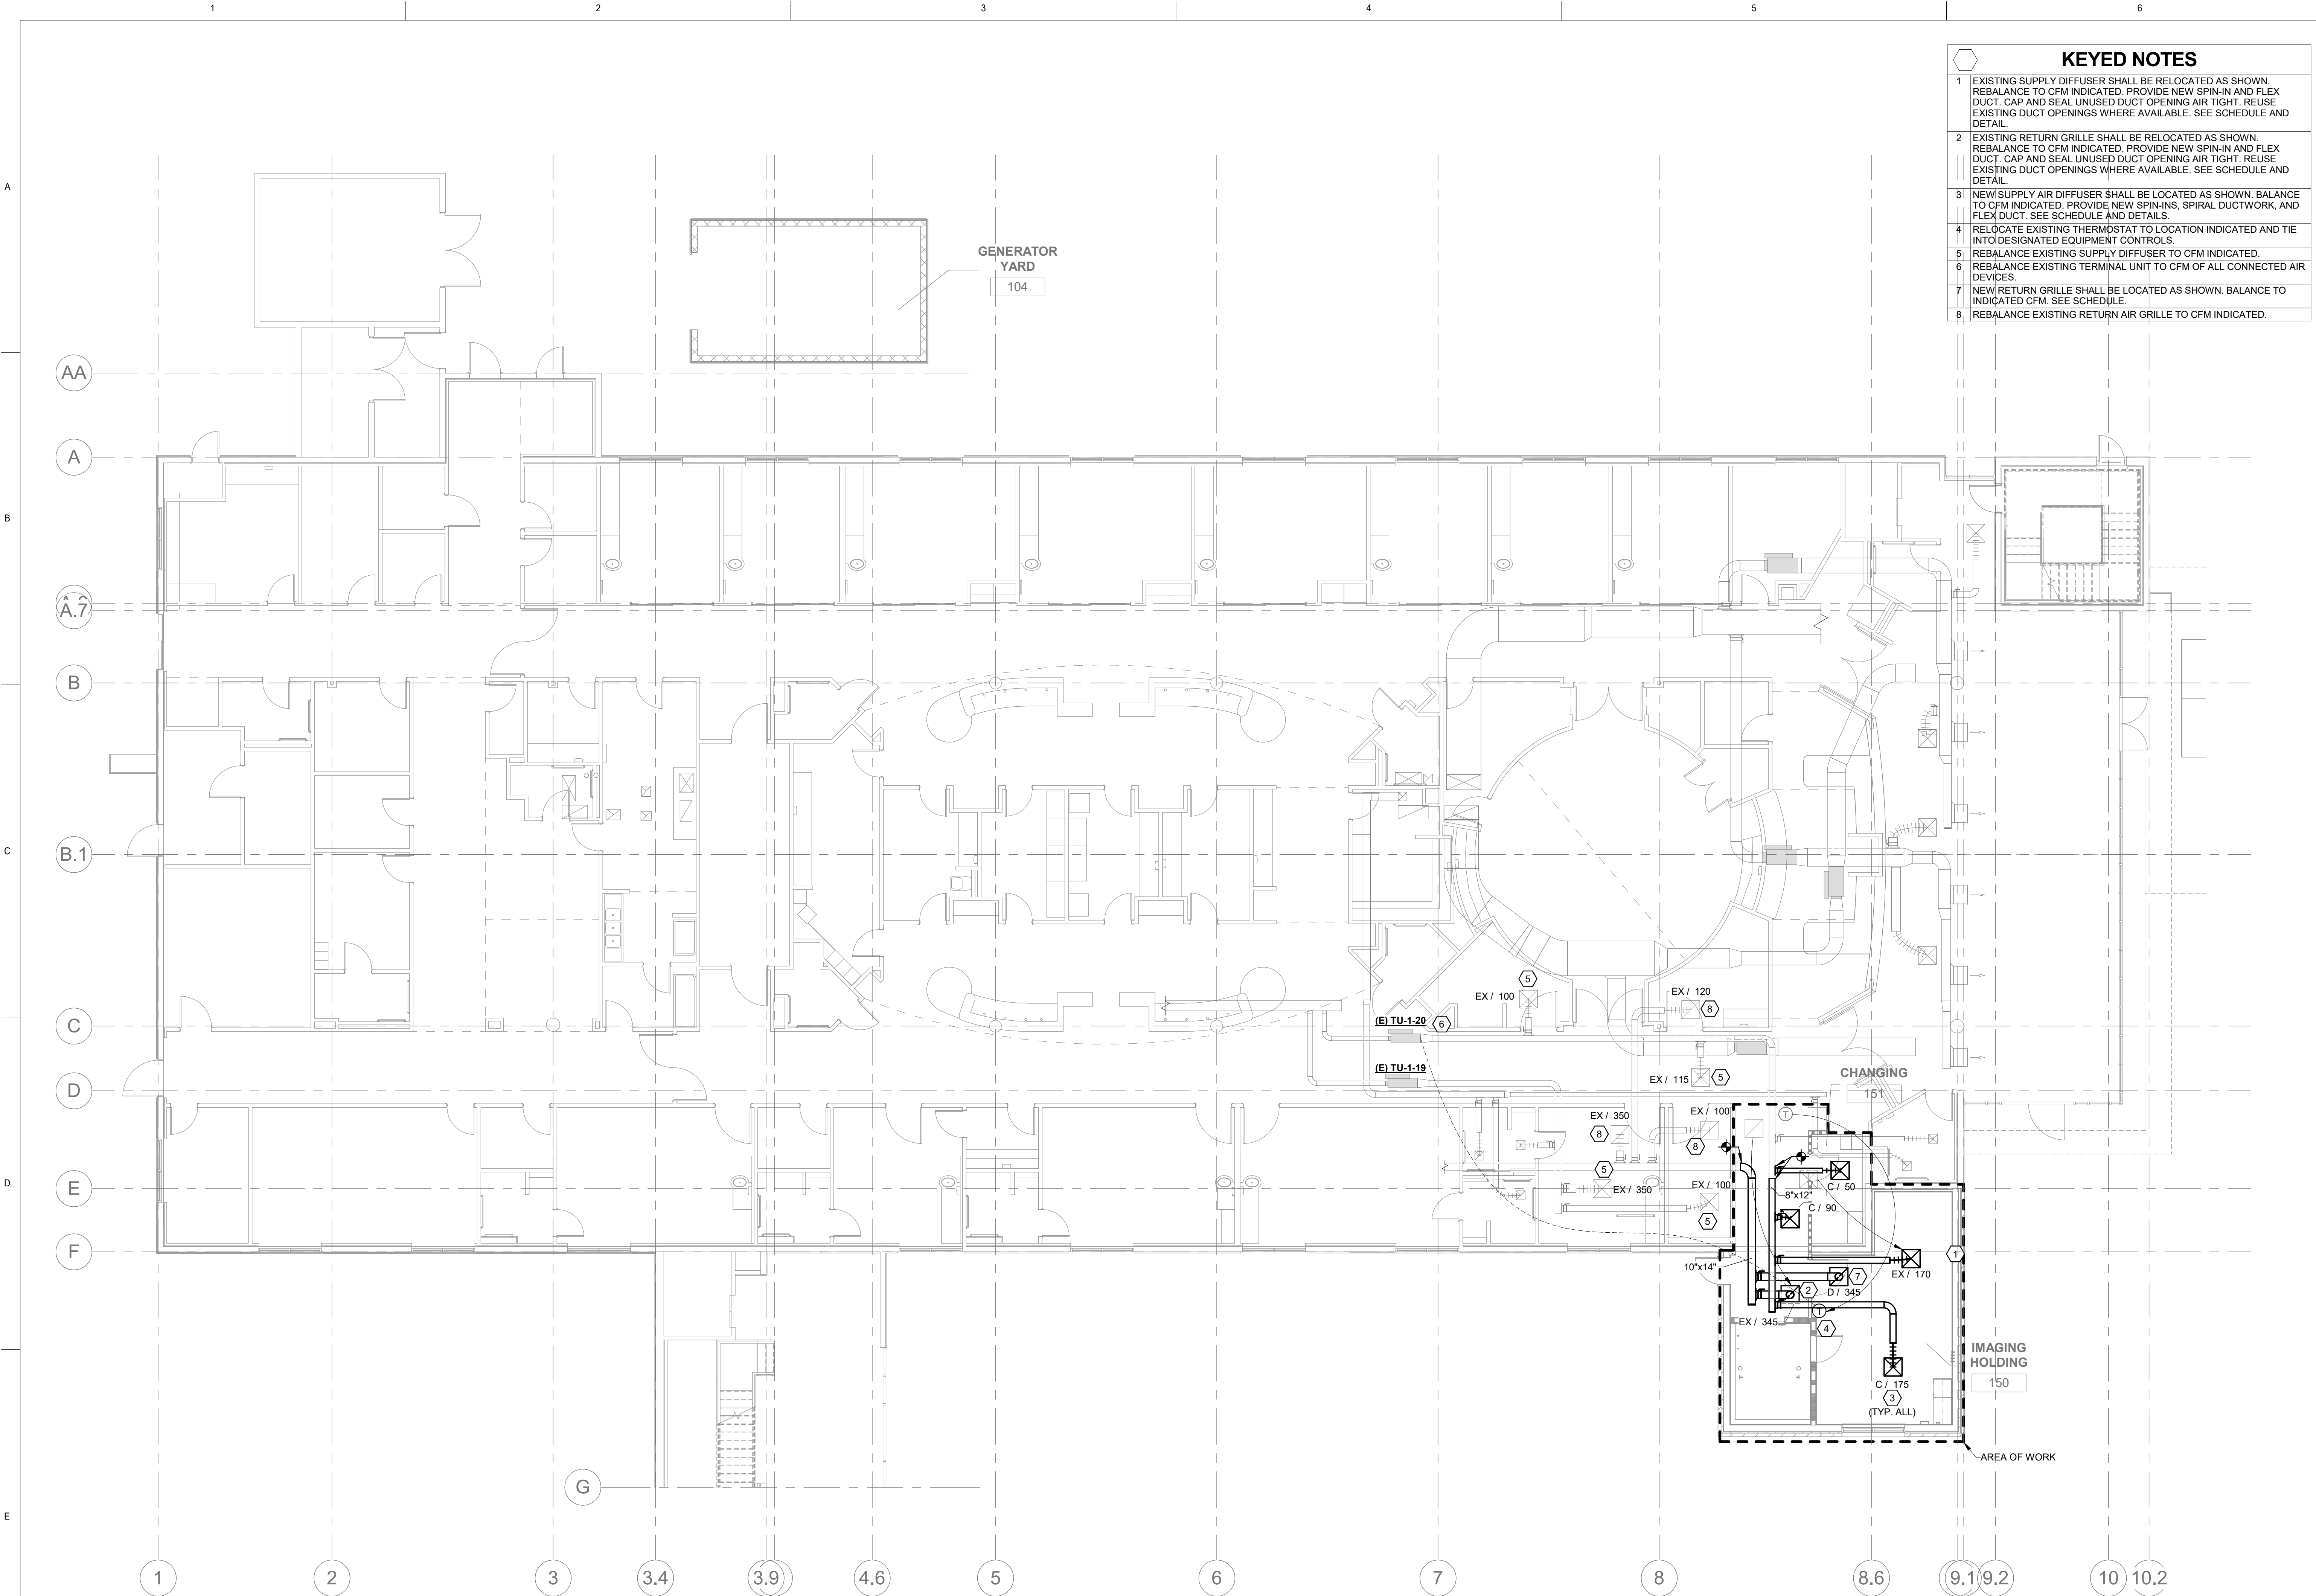

1 MECHANICAL FIRST FLOOR PLAN
 1/8" = 1'-0"

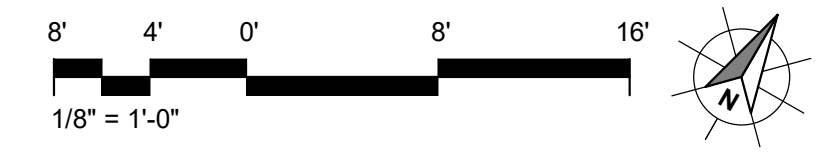

© 2022 XA COLLECTIVE, LLC. Unauthorized reproduction is prohibited.




**LEGENT NORTH HOUSTON
 SURGICAL HOSPITAL**
 24429 TOMBALL PKWY, SUITE 100
 TOMBALL, TX 77375


Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
06/30/22	ISSUE FOR CONSTRUCTION
1 07/25/22	PR 3


SHEET TITLE
**MECHANICAL
 SECOND FLOOR
 PLAN - OVERALL**

SHEET NO.
M202

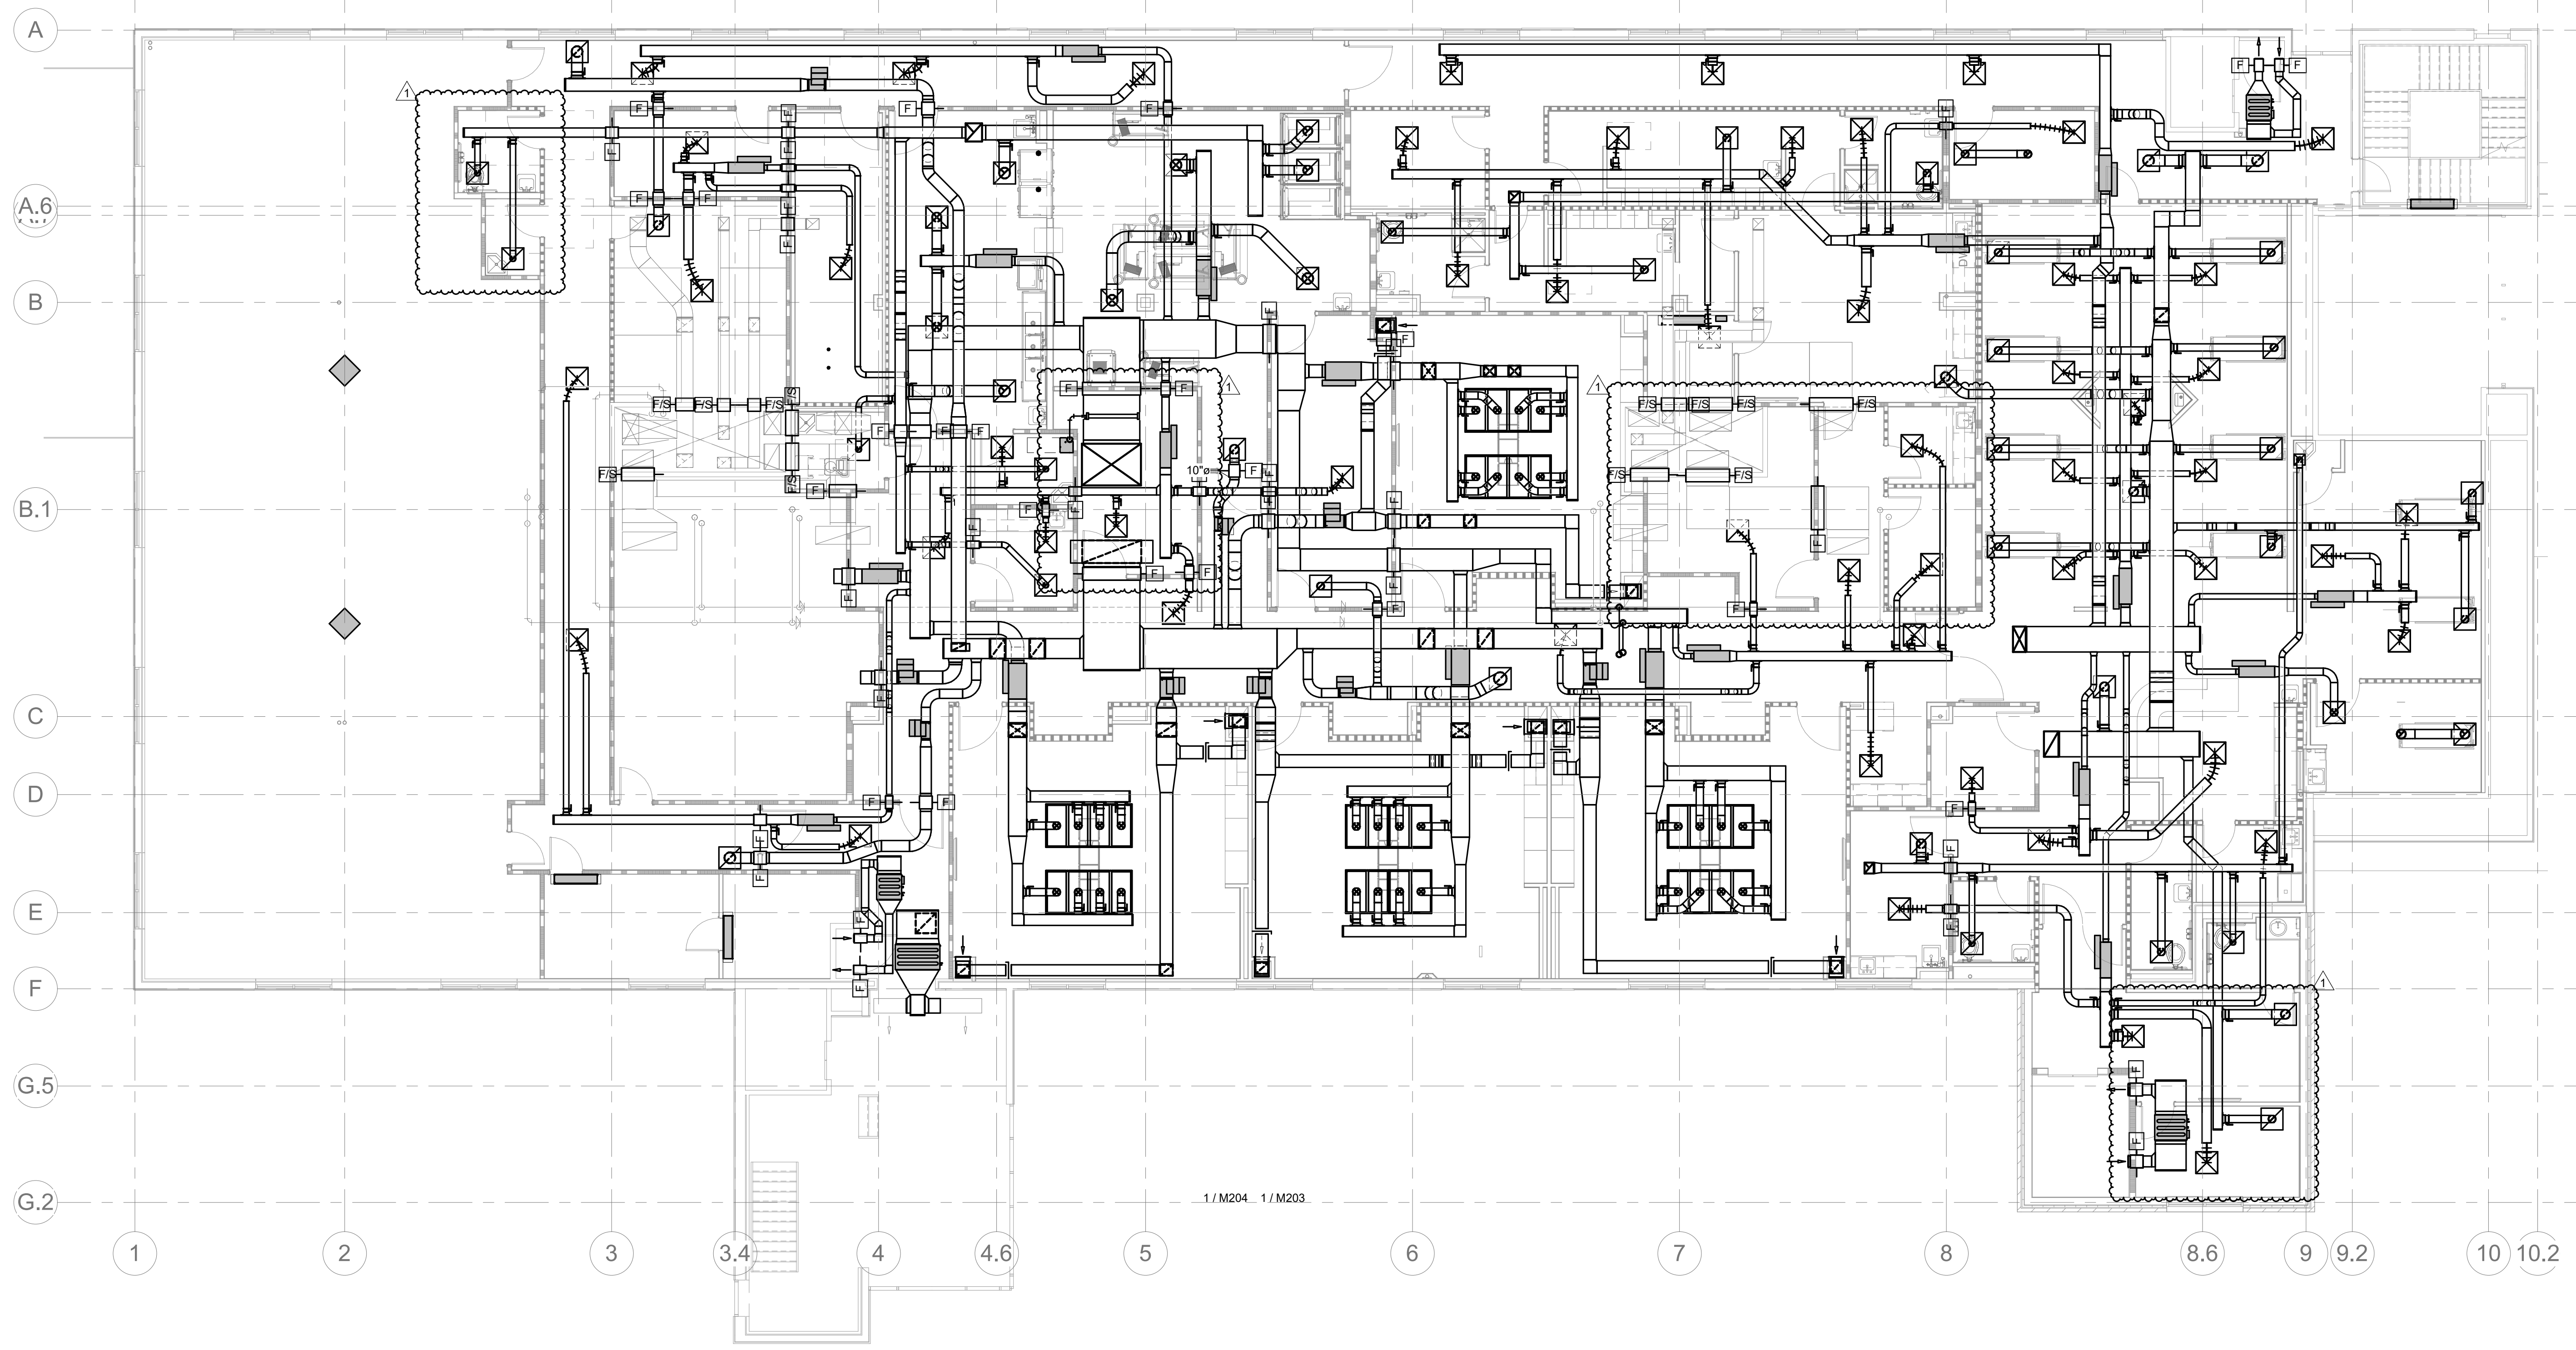

1 MECHANICAL SECOND FLOOR PLAN - OVERALL
 1/8" = 1'-0"

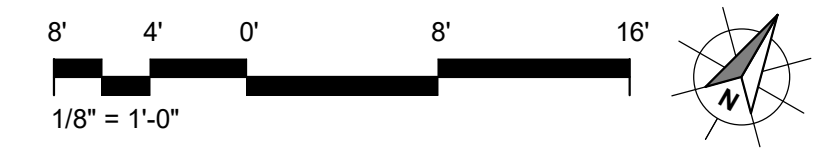

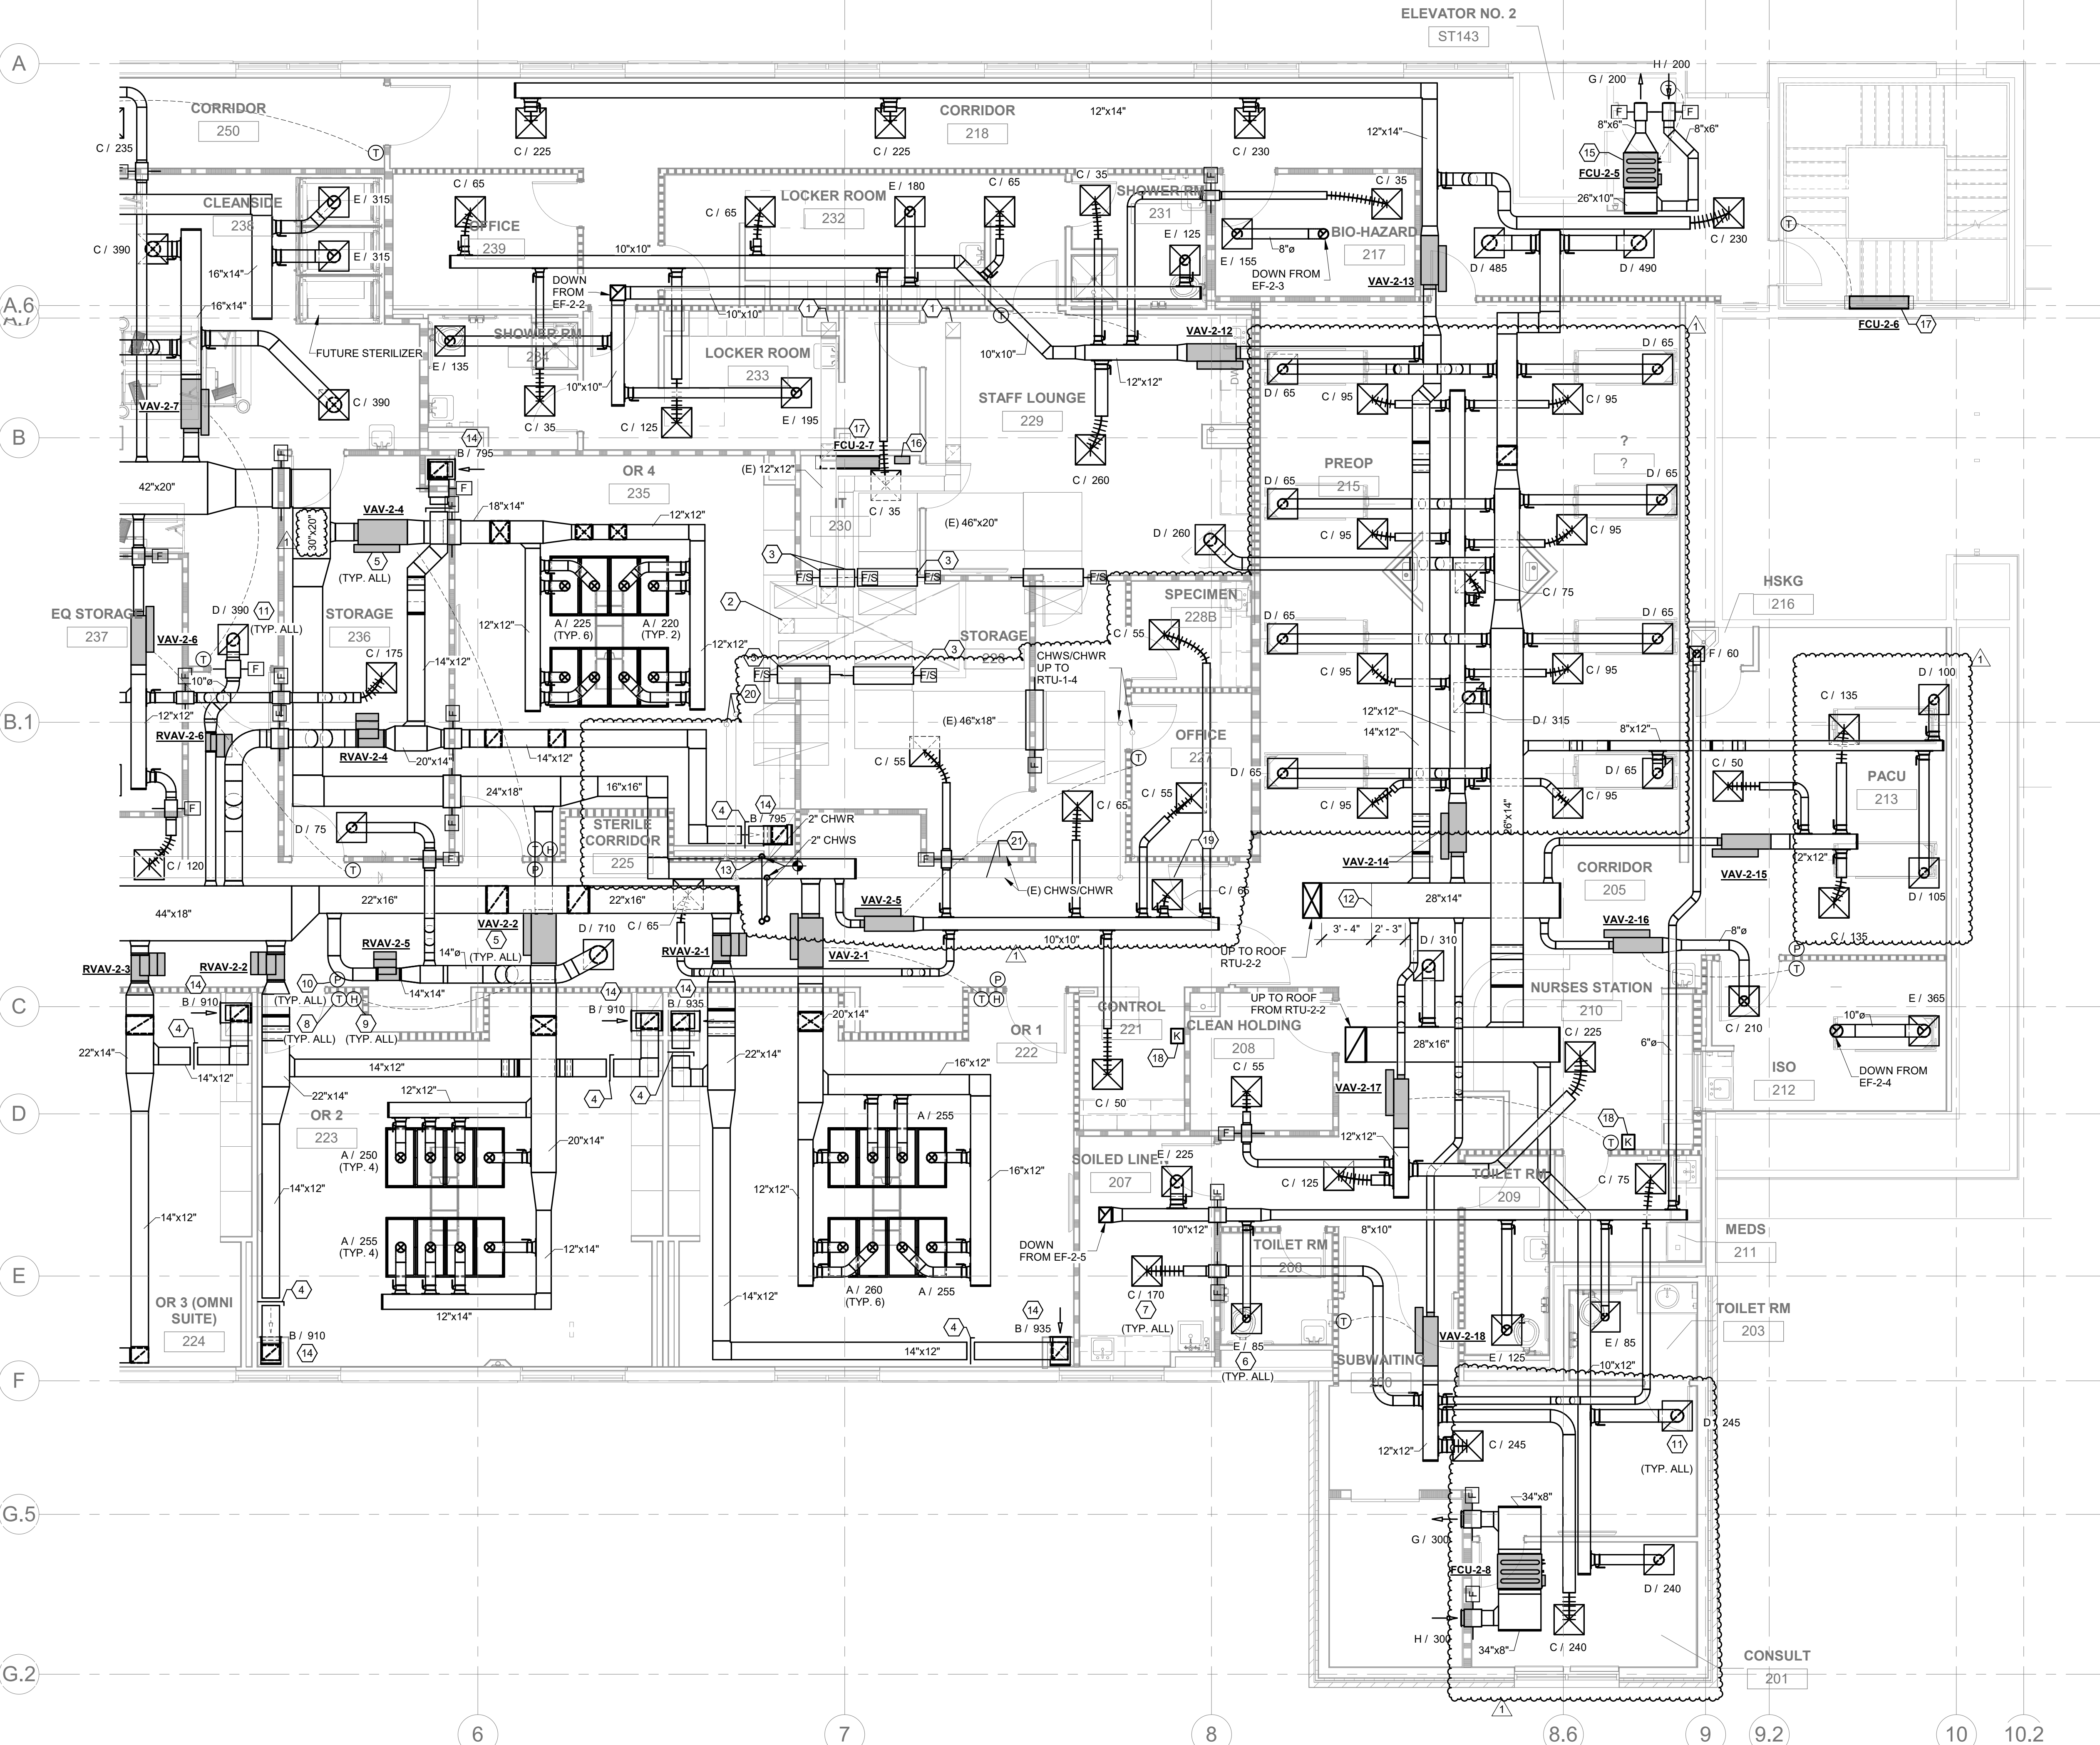

- ### KEYED NOTES
- EXHAUST DUCT DOWN FROM EXISTING EXHAUST FAN SERVING LEVEL
 - EXISTING EXHAUST DUCT DOWN IN CHASE TO SERVE FIRST FLOOR TO REMAIN.
 - PROVIDE NEW 1-1/2 HOUR FIRE/SMOKE DAMPER IN EXISTING DUCT AT EXISTING 2 HOUR FIRE AND SMOKE BARRIER. PROVIDE DAMPER WITH REMOTE TESTING CAPABILITY.
 - INSTALL REMOTE CABLE OPERATED BALANCING DAMPER SIMILAR TO ROTOTWIST MODEL RT-200 IN EXHAUST/RETURN DUCT AND BALANCE TO CFM INDICATED. ROUTE ADJUSTMENT CABLE TO ROTOTWIST ROUND MINIATURE CEILING CUP MODEL RT-CCM IN CEILING ADJACENT TO DAMPER.
 - NEW VAV BOX SHALL BE LOCATED AS SHOWN. BALANCE TO CFM INDICATED. MAINTAIN MANUFACTURER'S RECOMMENDED CLEARANCES AND ENSURE BOX IS READILY ACCESSIBLE FROM LAY-IN CEILING OR ACCESS PANEL. BALANCE TO CFM INDICATED ON DRAWINGS. SEE DETAILS AND SCHEDULE.
 - NEW EXHAUST GRILLE SHALL BE LOCATED AS SHOWN. BALANCE TO INDICATED CFM. SEE SCHEDULE.
 - NEW SUPPLY AIR DIFFUSER SHALL BE LOCATED AS SHOWN. BALANCE TO CFM INDICATED. PROVIDE NEW SPIN-INS, SPIRAL DUCTWORK, AND SHALL BE SET TO 0.1 IN WG (ADJUSTABLE). THE CONTROL SYSTEM SHALL ANNUNCIATE AN ALARM AT THE NURSE STATION IF THE DOOR IS HELD OPEN FOR LONGER THAN 30 SECONDS (ADJUSTABLE) OR IF THE DOOR IS CLOSED AND ROOM DIFFERENTIAL PRESSURE DROPS BELOW SETPOINT FOR 30 SECONDS (ADJUSTABLE).
 - NEW HUMIDITY SENSOR. PROVIDE NEW CONTROL WIRING AS REQUIRED.
 - CONTRACTOR SHALL PROVIDE ANTEC PMT (OR APPROVED EQUAL) AT NOTED LOCATION. PROVIDE ALL REQUIRED WIRING AND ACCESSORIES. CONNECT BACK TO BAS. ROOM DIFFERENTIAL PRESSURE SET POINT SHALL BE SET TO 0.1 IN WG (ADJUSTABLE). THE CONTROL SYSTEM SHALL ANNUNCIATE AN ALARM AT THE NURSE STATION IF THE DOOR IS HELD OPEN FOR LONGER THAN 30 SECONDS (ADJUSTABLE) OR IF THE DOOR IS CLOSED AND ROOM DIFFERENTIAL PRESSURE DROPS BELOW SETPOINT FOR 30 SECONDS (ADJUSTABLE).
 - NEW RETURN GRILLE SHALL BE LOCATED AS SHOWN. BALANCE TO INDICATED CFM. SEE SCHEDULE.
 - AHU PRESSURE SENSOR SHALL BE PLACED IN APPROXIMATE LOCATION SHOWN. NOTED DIMENSIONS ARE THE MINIMUM SEPARATION DISTANCE REQUIRED BEFORE TRANSITIONS AND FITTINGS. PROVIDE ALL REQUIRED ACCESSORIES FOR COMPLETE OPERATION. CONNECT BACK TO AHU AND BAS. PRIMARY SENSOR SHALL BE USED TO CONTROL VFD ON FAN. SEE SEQUENCE OF OPERATIONS IN SPECIFICATIONS FOR FURTHER DETAILS.
 - PROVIDE BTU/H METER READOUT IN APPROXIMATE LOCATION. COORDINATE WITH ARCHITECT AND OWNER FOR EXACT LOCATION.
 - MOUNT LOW EXHAUST GRILLE AT 10" AFF. BALANCE TO CFM INDICATED.
 - NEW HORIZONTAL DX FAN COIL UNIT SHALL BE SUPPORTED FROM STRUCTURE IN APPROXIMATE LOCATION SHOWN. ROUTE UNIT'S REFRIGERANT PIPING TO ASSOCIATED CONDENSING UNIT. FIELD VERIFY EXACT LOCATION BEFORE INSTALLATION. PROVIDE S/R DUCTWORK AS SHOWN. PROVIDE UNIT WITH FACTORY PROVIDED FILTER RACK. ROUTE UNIT'S 3/4" PRIMARY CONDENSATE LINE TO LAY TAIL PIECE (NOT SHOWN). PROVIDE UNIT WITH FACTORY (OR EQUAL) 7 DAY PROGRAMMABLE THERMOSTAT AND LOCATE AS SHOWN. PROVIDE HIGH LEVEL SWITCH IN PRIMARY DRAIN PAN. PROVIDE ALL REQUIRED ACCESSORIES AND TRANSITIONS. MAINTAIN MANUFACTURER'S RECOMMENDED CLEARANCES. SEE SCHEDULE AND DETAILS.
 - NEW DDC CENTRAL CONTROLLER SHALL BE LOCATED IN AREA SHOWN. CONTROLLER SHALL COMMAND ALL MECHANICAL EQUIPMENT AND THEIR ASSOCIATED TERMINALS. COORDINATE FINAL LOCATION WITH ARCHITECT AND OWNER. PROVIDE NEW CONTROL WIRING AS REQUIRED. SEE SPECS.
 - NEW WALL MOUNTED DX MINI SPLIT SYSTEM SHALL BE LOCATED AS SHOWN. FIELD VERIFY EXACT LOCATION BEFORE INSTALLATION. PROVIDE CONCEALED CONDENSATE PUMP. ROUTE 3/4" CONDENSATE TO LAY TAIL PIECE / FUNNEL DRAIN AS INDICATED. ROUTE UNIT'S REFRIGERANT PIPING TO ASSOCIATED CONDENSING UNIT.
 - NEW MANUAL SHUTDOWN SWITCHES SHALL BE LOCATED IN APPROXIMATE AREA PER NFPA 90A. ONE MANUAL SHUTDOWN SWITCH SHALL COMMAND RTU-2-1 AND EF-2-1. ANOTHER MANUAL SHUTDOWN SWITCH SHALL CONTROL RTU-2-2, EF-2-2,3,4,5. MANUAL SHUTDOWN SWITCHES SHALL BE 48" A.F.P. COORDINATE FINAL LOCATION WITH ARCHITECT AND OWNER. SEE SPECS. PROVIDE ALL REQUIRED ACCESSORIES, CONTROLS, AND WIRING.
 - EXISTING MOTORIZED PRESSURE INDEPENDENT BYPASS VALVE AND VENTURI FLOW METER TO REMAIN.
 - CHWS/CHWR UP TO RTU-1-3.
 - EXISTING CHILLED WATER SUPPLY/RETURN LOCATED ABOVE CEILING. CONTRACTOR TO FIELD VERIFY EXACT LOCATION OF EXISTING AND RE-ROUTE AS REQUIRED TO MAINTAIN EQUIPMENT CLEARANCES AND CEILING HEIGHTS.



21750 HARDY OAK BLVD. STE 102
SAN ANTONIO TX, 78258
P: 210.964.0132 M: 512.773.3070



ENGINEERS
PLANNERS
SCIENTISTS
CONSTRUCTION MANAGERS
KCI
TECHNOLOGIES
13750 SAN PEDRO AVE. #640
SAN ANTONIO, TX 78232
PHONE: 210-544-5751
FAX: 713-237-98011
Texas Registered Engineering Firm F-10573

**LEGENT NORTH HOUSTON
SURGICAL HOSPITAL**
24429 TOMBALL PKWY, SUITE 100
TOMBALL, TX 77375


Drawn BAR
Checked SSM
Date 06/30/22
PROJECT No.
Revisions
06/30/22 ISSUE FOR CONSTRUCTION
1 07/25/22 PR 3

SHEET TITLE
**MECHANICAL
SECOND FLOOR
PLAN - ENLARGED
PLAN EAST**

SHEET NO.
M203

1 MECHANICAL SECOND FLOOR PLAN - PLAN EAST
3/16" = 1'-0"

© 2022 XA COLLECTIVE, LLC. Unauthorized reproduction is prohibited.

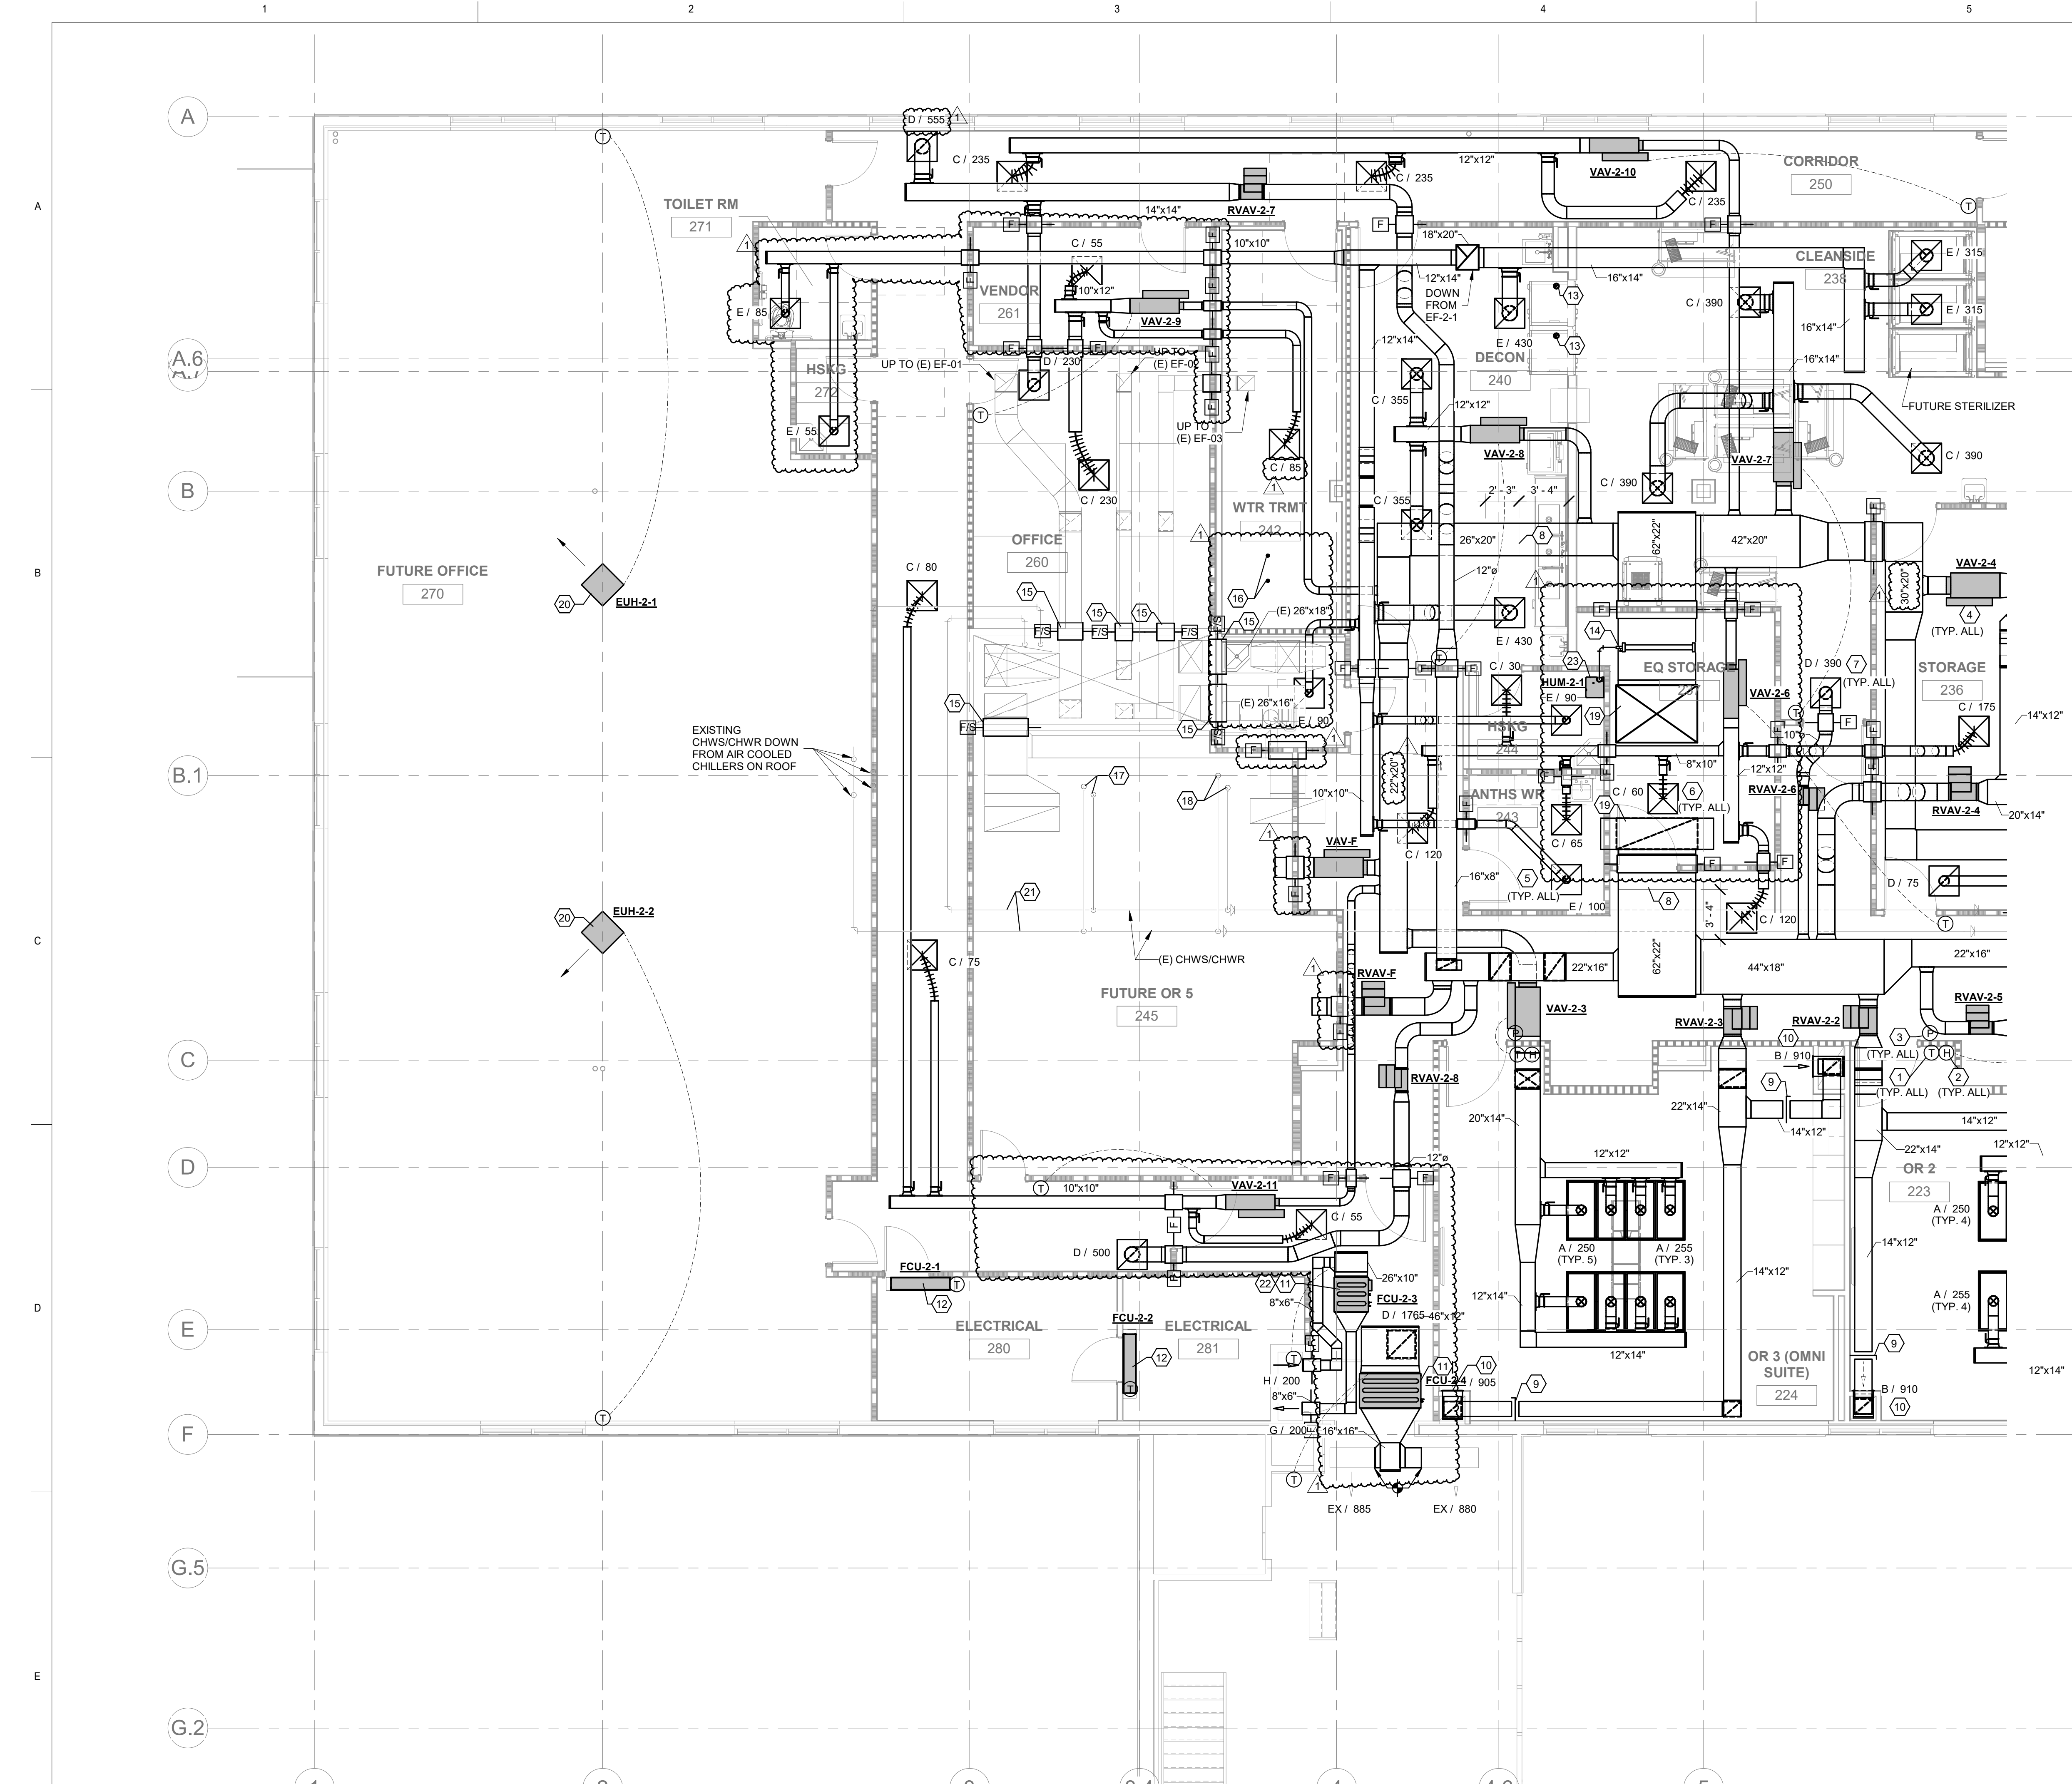

- ### KEYED NOTES
- NEW DDC ZONE THERMOSTAT/CONTROL. PROVIDE NEW CONTROL WIRING AS REQUIRED.
 - NEW HUMIDITY SENSOR. PROVIDE NEW CONTROL WIRING AS REQUIRED.
 - CONTRACTOR SHALL PROVIDE ANTEC PMT (OR APPROVED EQUAL) AT NOTED LOCATION. PROVIDE ALL REQUIRED WIRING AND ACCESSORIES. CONNECT BACK TO BAS. ROOM DIFFERENTIAL PRESSURE SET POINT SHALL BE SET TO 0.1 IN WG (ADJUSTABLE). THE CONTROL SYSTEM SHALL ANNUNCIATE AN ALARM AT THE NURSE STATION IF THE DOOR IS HELD OPEN FOR LONGER THAN 30 SECONDS (ADJUSTABLE) OR IF THE DOOR IS CLOSED AND ROOM DIFFERENTIAL PRESSURE DROPS BELOW SETPOINT FOR 30 SECONDS (ADJUSTABLE).
 - NEW VAV BOX SHALL BE LOCATED AS SHOWN. BALANCE TO CFM INDICATED. MAINTAIN MANUFACTURER'S RECOMMENDED CLEARANCES AND ENSURE BOX IS READILY ACCESSIBLE FROM LAY-IN CEILING OR ACCESS PANEL. BALANCE TO CFM INDICATED ON DRAWINGS. SEE DETAILS AND SCHEDULE.
 - NEW EXHAUST GRILLE SHALL BE LOCATED AS SHOWN. BALANCE TO INDICATED CFM. SEE SCHEDULE.
 - NEW SUPPLY AIR DIFFUSER SHALL BE LOCATED AS SHOWN. BALANCE TO CFM INDICATED. PROVIDE NEW SPINNS, SPIRAL DUCTWORK, AND FLEX DUCT. SEE SCHEDULE AND DETAILS.
 - NEW RETURN GRILLE SHALL BE LOCATED AS SHOWN. BALANCE TO INDICATED CFM. SEE SCHEDULE.
 - AHU PRESSURE SENSOR SHALL BE PLACED IN APPROXIMATE LOCATION SHOWN. NOTED DIMENSIONS ARE THE MINIMUM SEPARATION DISTANCE REQUIRED BEFORE TRANSITIONS AND FITTINGS. PROVIDE ALL REQUIRED ACCESSORIES FOR COMPLETE OPERATION. CONNECT BACK TO AHU AND BAS. PRIMARY SENSOR SHALL BE USED TO CONTROL VFD ON FAN. SEE SEQUENCE OF OPERATIONS IN SPECIFICATIONS FOR FURTHER DETAILS.
 - INSTALL REMOTE CABLE OPERATED BALANCING DAMPER SIMILAR TO ROTOTWIST MODEL RT-200 IN EXHAUST/RETURN DUCT AND BALANCE TO CFM INDICATED. ROUTE ADJUSTMENT CABLE TO ROTOTWIST ROUND MINIATURE CEILING CUP MODEL RT-CCM IN CEILING ADJACENT TO DAMPER.
 - MOUNT LOW EXHAUST GRILLE AT 10" AFF. BALANCE TO CFM INDICATED.
 - NEW HORIZONTAL DX FAN COIL UNIT SHALL BE SUPPORTED FROM STRUCTURE IN APPROXIMATE LOCATION SHOWN. ROUTE UNITS' REFRIGERANT PIPING TO ASSOCIATED CONDENSING UNIT. FIELD VERIFY EXACT LOCATION BEFORE INSTALLATION. PROVIDE S/R DUCTWORK AS SHOWN. PROVIDE UNIT WITH FACTORY PROVIDED FILTER RACK. ROUTE UNITS' 3/4" PRIMARY CONDENSATE LINE TO LAV TAIL PIECE (NOT SHOWN). PROVIDE UNIT WITH FACTORY (OR EQUAL) 7 DAY PROGRAMMABLE THERMOSTAT AND LOCATE AS SHOWN. PROVIDE HIGH LEVEL SWITCH IN PRIMARY DRAIN PAN. PROVIDE ALL REQUIRED ACCESSORIES AND TRANSITIONS. MAINTAIN MANUFACTURER'S RECOMMENDED CLEARANCES. SEE SCHEDULE AND DETAILS.
 - NEW WALL MOUNTED DX MINI SPLIT SYSTEM SHALL BE LOCATED AS SHOWN. FIELD VERIFY EXACT LOCATION BEFORE INSTALLATION. PROVIDE CONDENSATE PUMP. ROUTE 3/4" CONDENSATE TO LAV TAIL PIECE / FUNNEL DRAIN AS INDICATED. ROUTE UNITS' REFRIGERANT PIPING TO ASSOCIATED CONDENSING UNIT.
 - ROUTE 5" DIAMETER STAINLESS STEEL EXHAUST DUCT FROM STERILIZER UP THRU ROOF. COORDINATE EXACT LOCATION WITH ARCHITECT.
 - STEAM DISTRIBUTOR SHALL BE PLACED IN APPROXIMATE LOCATION SHOWN. NOTED DIMENSIONS ARE THE MINIMUM SEPARATION DISTANCE REQUIRED BEFORE TRANSITIONS, FITTINGS, AND ACCESSORIES. PROVIDE ALL REQUIRED ACCESSORIES FOR COMPLETE OPERATION. CONNECT BACK TO HUMIDIFIER. ROUTE CONDENSATE TO LOCATION SHOWN. AIR PROVING SWITCH AND HIGH LIMIT SENSOR (NOT SHOWN) SHALL ALSO BE PLACED IN RESPECTIVE SUPPLY DUCT. FOLLOW MANUFACTURER RECOMMENDED LOCATIONS FOR INSTALLATION.
 - PROVIDE NEW 1-1/2 HOUR FIRE/SMOKE DAMPER IN EXISTING DUCT AT EXISTING 2 HOUR FIRE AND SMOKE BARRIER. PROVIDE DAMPER WITH REMOTE TESTING CAPABILITY.
 - ROUTE INTAKE EXHAUST DUCT UP THRU ROOF FROM VACUUM PUMP SIZED PER MANUFACTURER'S RECOMMENDATIONS. TERMINATE DUCT PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.
 - CHWS/CHWR UP TO RTU-1-1.
 - CHWS/CHWR UP TO RTU-1-2.
 - SUPPLY/RETURN DUCT DOWN FROM RTU-2-1.
 - NEW ELECTRIC UNIT HEATER SUPPORTED FROM STRUCTURE ABOVE. PROVIDE REMOTE THERMOSTAT.
 - EXISTING CHILLED WATER SUPPLY/RETURN LOCATED ABOVE CEILING. CONTRACTOR TO FIELD VERIFY EXACT LOCATION OF EXISTING AND RE-ROUTE AS REQUIRED TO MAINTAIN EQUIPMENT CLEARANCES AND CEILING HEIGHTS.
 - UNIT SHALL BE MOUNTED TIGHT TO STRUCTURE. MAINTAIN MANUFACTURER RECOMMENDED CLEARANCES.
 - CONTRACTOR SHALL PROVIDE WALL HUNG HUMIDIFIER AS SHOWN. COORDINATE FINAL LOCATION WITH ARCHITECT. MAINTAIN MANUFACTURER'S RECOMMENDED CLEARANCES. ROUTE STEAM SUPPLY/RETURN PIPING FROM HUMIDIFIER TO ASSOCIATED MANIFOLD IN SUPPLY DUCT. PROVIDE ALL REQUIRED PIPE FITTINGS, TRANSITIONS, AND ACCESSORIES. ROUTE DRAIN WITH AIR GAP FROM HUMIDIFIER TO FLOOR DRAIN IN ROOM.



**LEGENT NORTH HOUSTON
SURGICAL HOSPITAL**
24429 TOMBALL PKWY, SUITE 100
TOMBALL, TX 77375

Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
06/30/22	ISSUE FOR CONSTRUCTION
1 07/25/22	PR 3

SHEET TITLE
**MECHANICAL
SECOND FLOOR
PLAN - ENLARGED
PLAN WEST**

SHEET NO.
M204

1 MECHANICAL SECOND FLOOR PLAN - PLAN WEST
3/16" = 1'-0"

© 2022 XA COLLECTIVE, LLC. Unauthorized reproduction is prohibited.



**LEGENT NORTH HOUSTON
 SURGICAL HOSPITAL**


24429 TOMBALL PKWY, SUITE 100
 TOMBALL, TX 77375

Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
06/30/22	ISSUE FOR CONSTRUCTION


SHEET TITLE
**MECHANICAL
 SECOND FLOOR
 CEILING
 COORDINATION
 PLAN**

SHEET NO.

M205

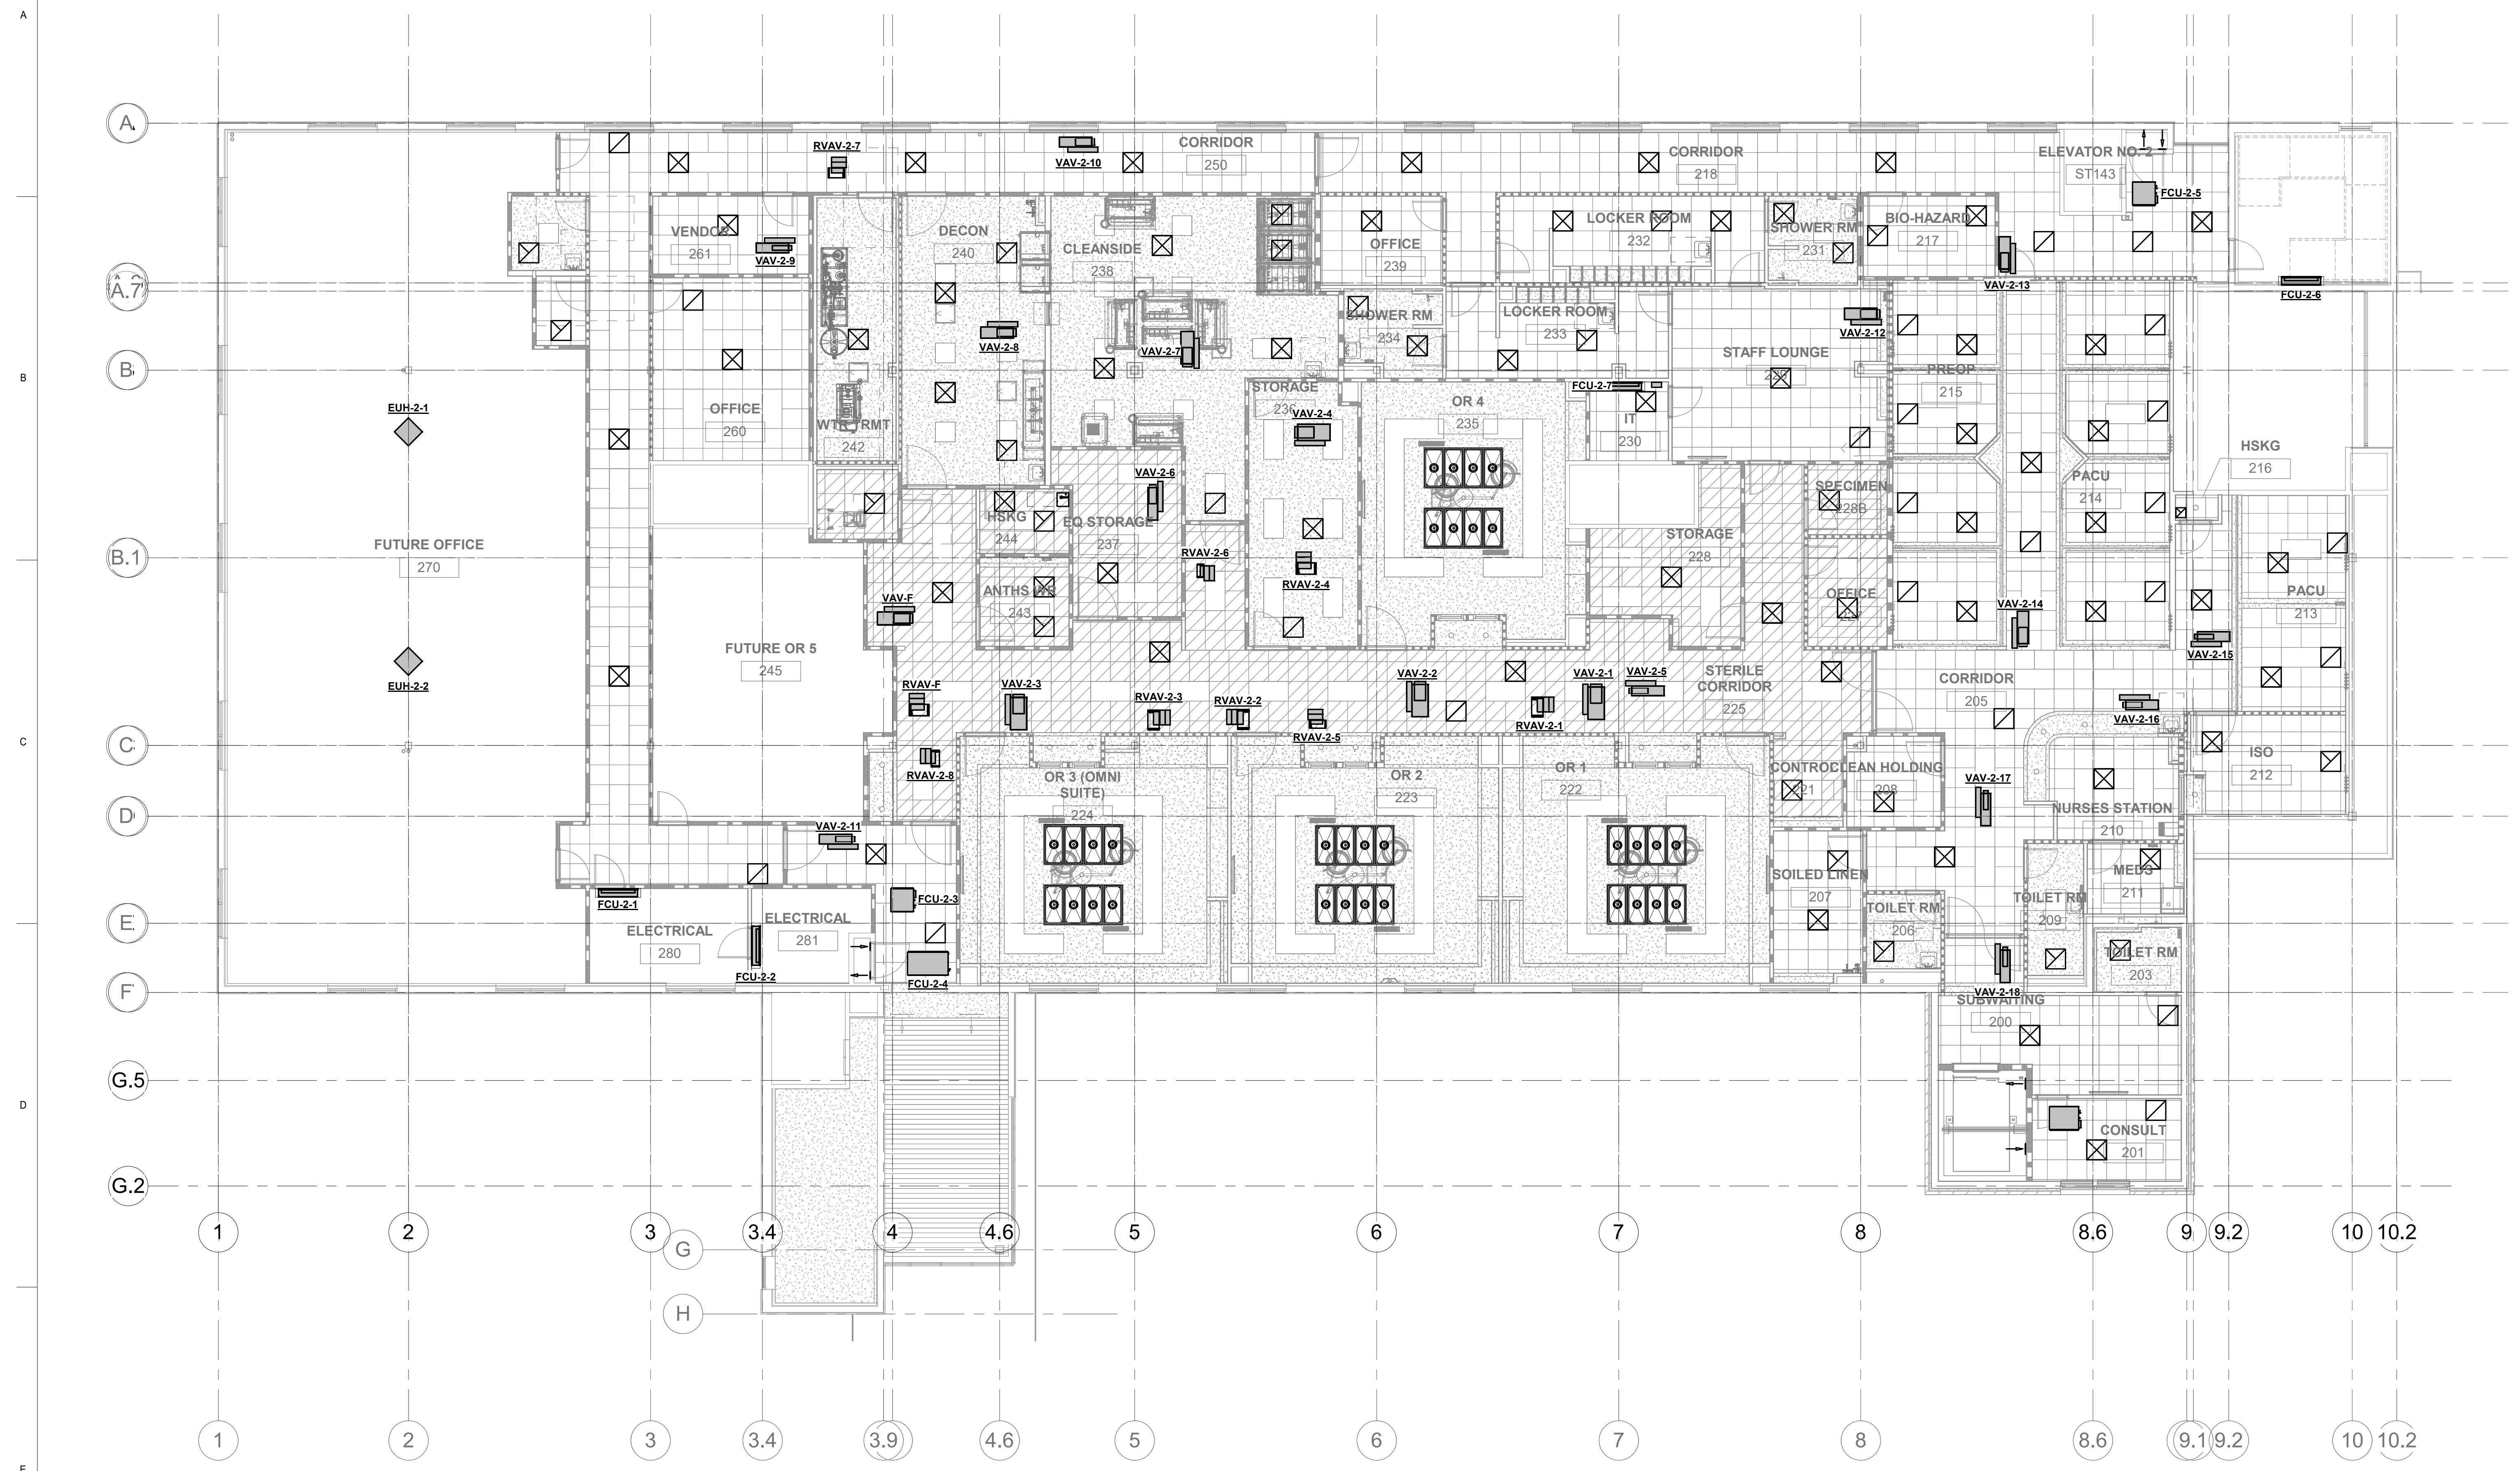

1 MECHANICAL SECOND FLOOR CEILING PLAN
 1/8" = 1'-0"

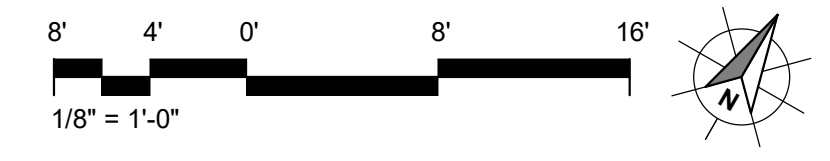

© 2022 XA COLLECTIVE, LLC. Unauthorized reproduction is prohibited.



**LEGENT NORTH HOUSTON
 SURGICAL HOSPITAL**
 24429 TOMBALL PKWY, SUITE 100
 TOMBALL, TX 77375

Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
06/30/22	ISSUE FOR CONSTRUCTION

SHEET TITLE
**MECHANICAL
 ROOF PLAN**

SHEET NO.
M206

KEYED NOTES


- EXISTING EXHAUST FAN SERVING LEVEL 1 TO REMAIN.
- ROOF MOUNTED EXHAUST FAN SERVING ISOLATION ROOM WITH HIGH VELOCITY DISCHARGE WITH NO RAIN CAP OR OTHER DEVICE TO IMPEDE THE VERTICAL MOMENTUM. THE TOP OF DISCHARGE SHALL BE AT LEAST 10 FEET ABOVE THE ROOF. EXHAUST DISCHARGE SHALL BE LOCATED NOT LESS THAN 25 FEET HORIZONTALLY FROM OUTSIDE AIR INTAKES. PROVIDE AT LEAST 5 DUCT DIAMETERS OF STRAIGHT DUCT PRIOR TO FAN INLET.
- NEW ROOF MOUNTED EXHAUST FAN. CONTRACTOR SHALL SEAL WATER TIGHT ROOF PENETRATION. FAN SHALL BE 10 FEET FROM ALL ROOF EDGES. CONTRACTOR SHALL PROVIDE ROOF CURB AND ALL OTHER TRANSITIONS, FITTINGS, AND ACCESSORIES. SEE SCHEDULE.

KEYED NOTES


- NEW ROOFTOP UNIT. COORDINATE FINAL LOCATION WITH STRUCTURAL. UNIT'S OUTSIDE AIR INTAKE SHALL BE MINIMUM OF 25 FEET FROM ALL EXHAUST AND PLUMBING VENTS. UNIT SHALL BE A MINIMUM OF 10 FEET FROM ALL ROOF EDGES. ROUTE NEW CONDENSATE LINE FROM UNIT AS SHOWN. CONTRACTOR SHALL PROVIDE ALL REQUIRED TRANSITIONS, FITTINGS, AND ACCESSORIES FOR FULL OPERATION. SEE SCHEDULE.
- CONDENSING UNIT (CU) SHALL BE INSTALLED ON ROOF IN APPROXIMATE AREA. EQUIPMENT SHALL BE AT LEAST 10 FEET FROM ROOF EDGE. COORDINATE WORK WITH STRUCTURAL DRAWINGS, ARCHITECTURAL DRAWINGS, ROOFING AND ELECTRICAL CONTRACTOR. MAINTAIN MANUFACTURER'S RECOMMENDED CLEARANCES. ROUTE UNITS REFRIGERATION AND ELECTRICAL LINES THROUGH ROOF PENETRATION. PROVIDE NEW ROOF EQUIPMENT SLEEPER (THYBARTEMS-1 OR EQUAL) AND CAP (ROOFSCREEN DRYCAP). SEE SCHEDULE AND DETAIL.

KEYED NOTES

- STERILIZER EXHAUST UP FROM BELOW. TERMINATE PER STERILIZER MANUFACTURER'S RECOMMENDATIONS.
- PROVIDE WITH BIO-HAZARD IDENTIFICATION STICKER. SEE SPECIFICATIONS.
- INTAKE/EXHAUST DUCTS FROM VACUUM PUMP BELOW. TERMINATE DUCT PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- PROVIDE BLANK OFFS IN RTU AS REQUIRED TO MAKE DUCT CONNECTIONS.

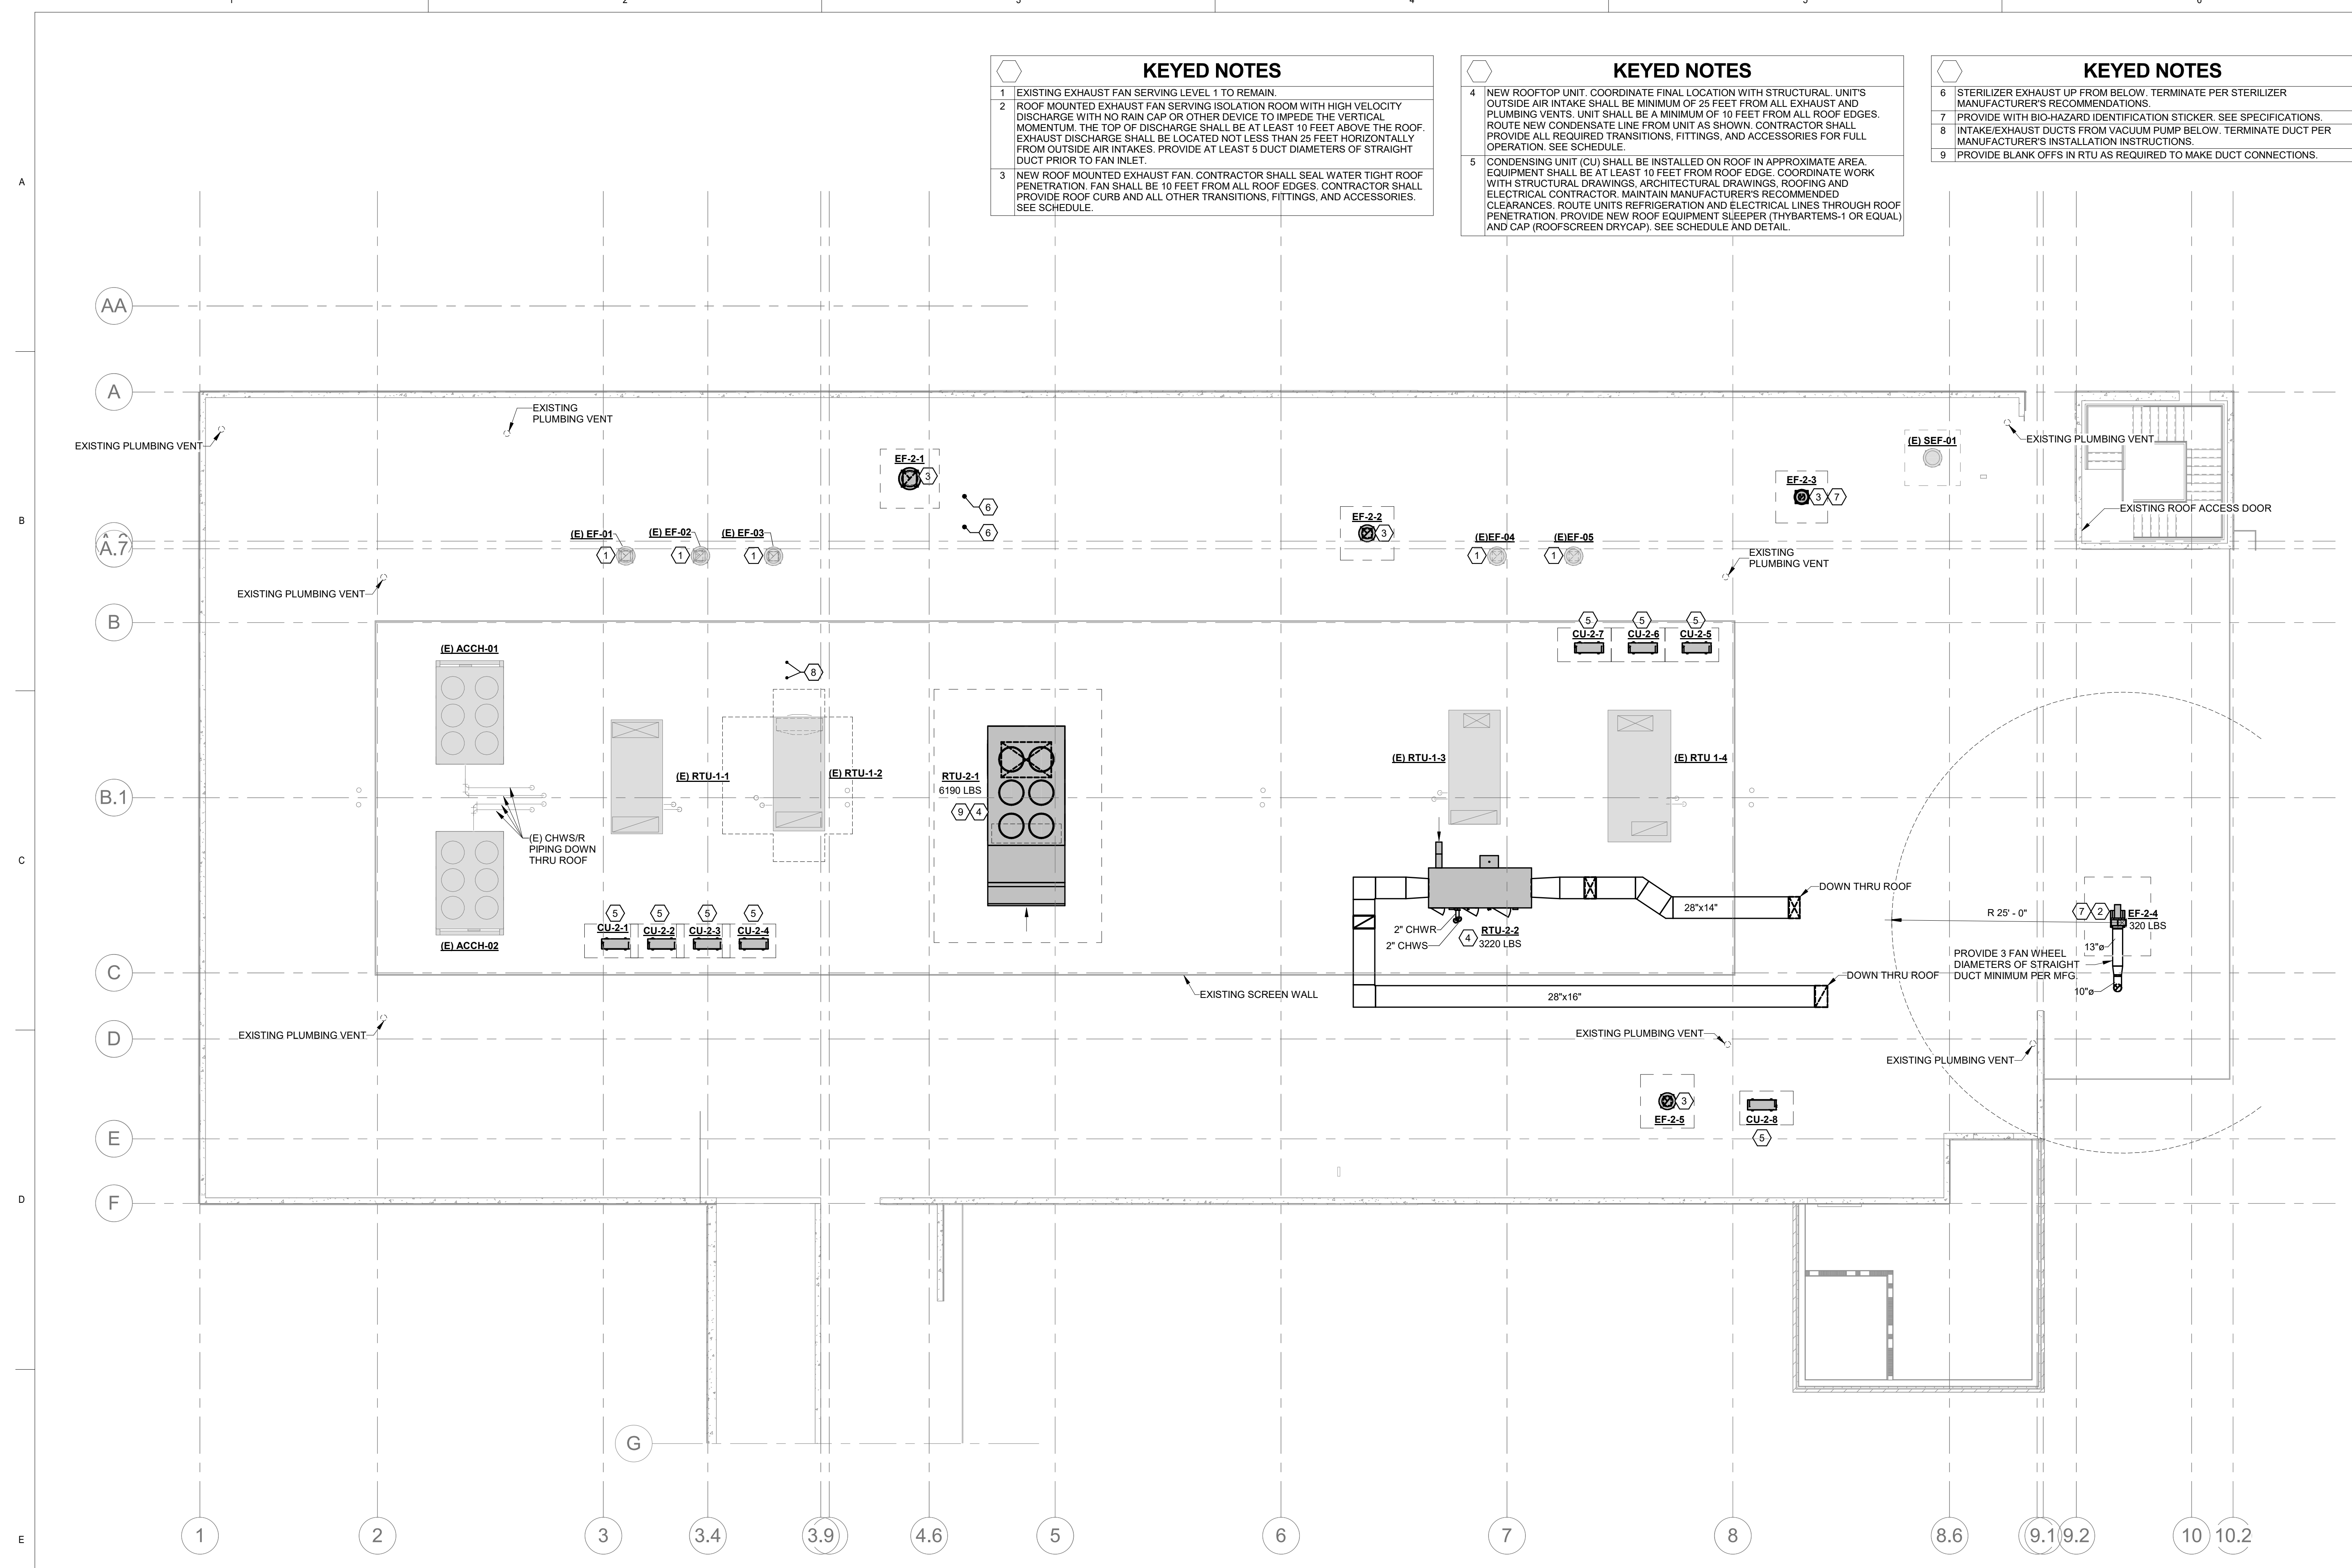

1 MECHANICAL ROOF PLAN
 1/8" = 1'-0"

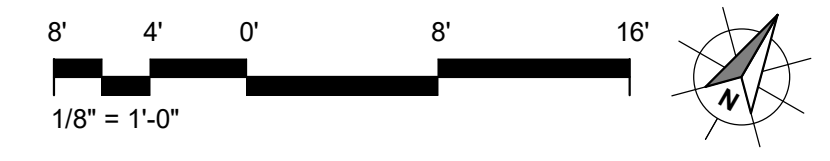

© 2022 XA COLLECTIVE, LLC. Unauthorized reproduction is prohibited.




**LEGENT NORTH HOUSTON
 SURGICAL HOSPITAL**
 24429 TOMBALL PKWY, SUITE 100
 TOMBALL, TX 77375

Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
06/30/22	ISSUE FOR CONSTRUCTION
1 07/25/22	PR 3

SHEET TITLE
MECHANICAL PRESSURIZATION DIAGRAM


SHEET NO.
M301

= ALL AIR EXHAUSTED DIRECTLY TO OUTDOORS

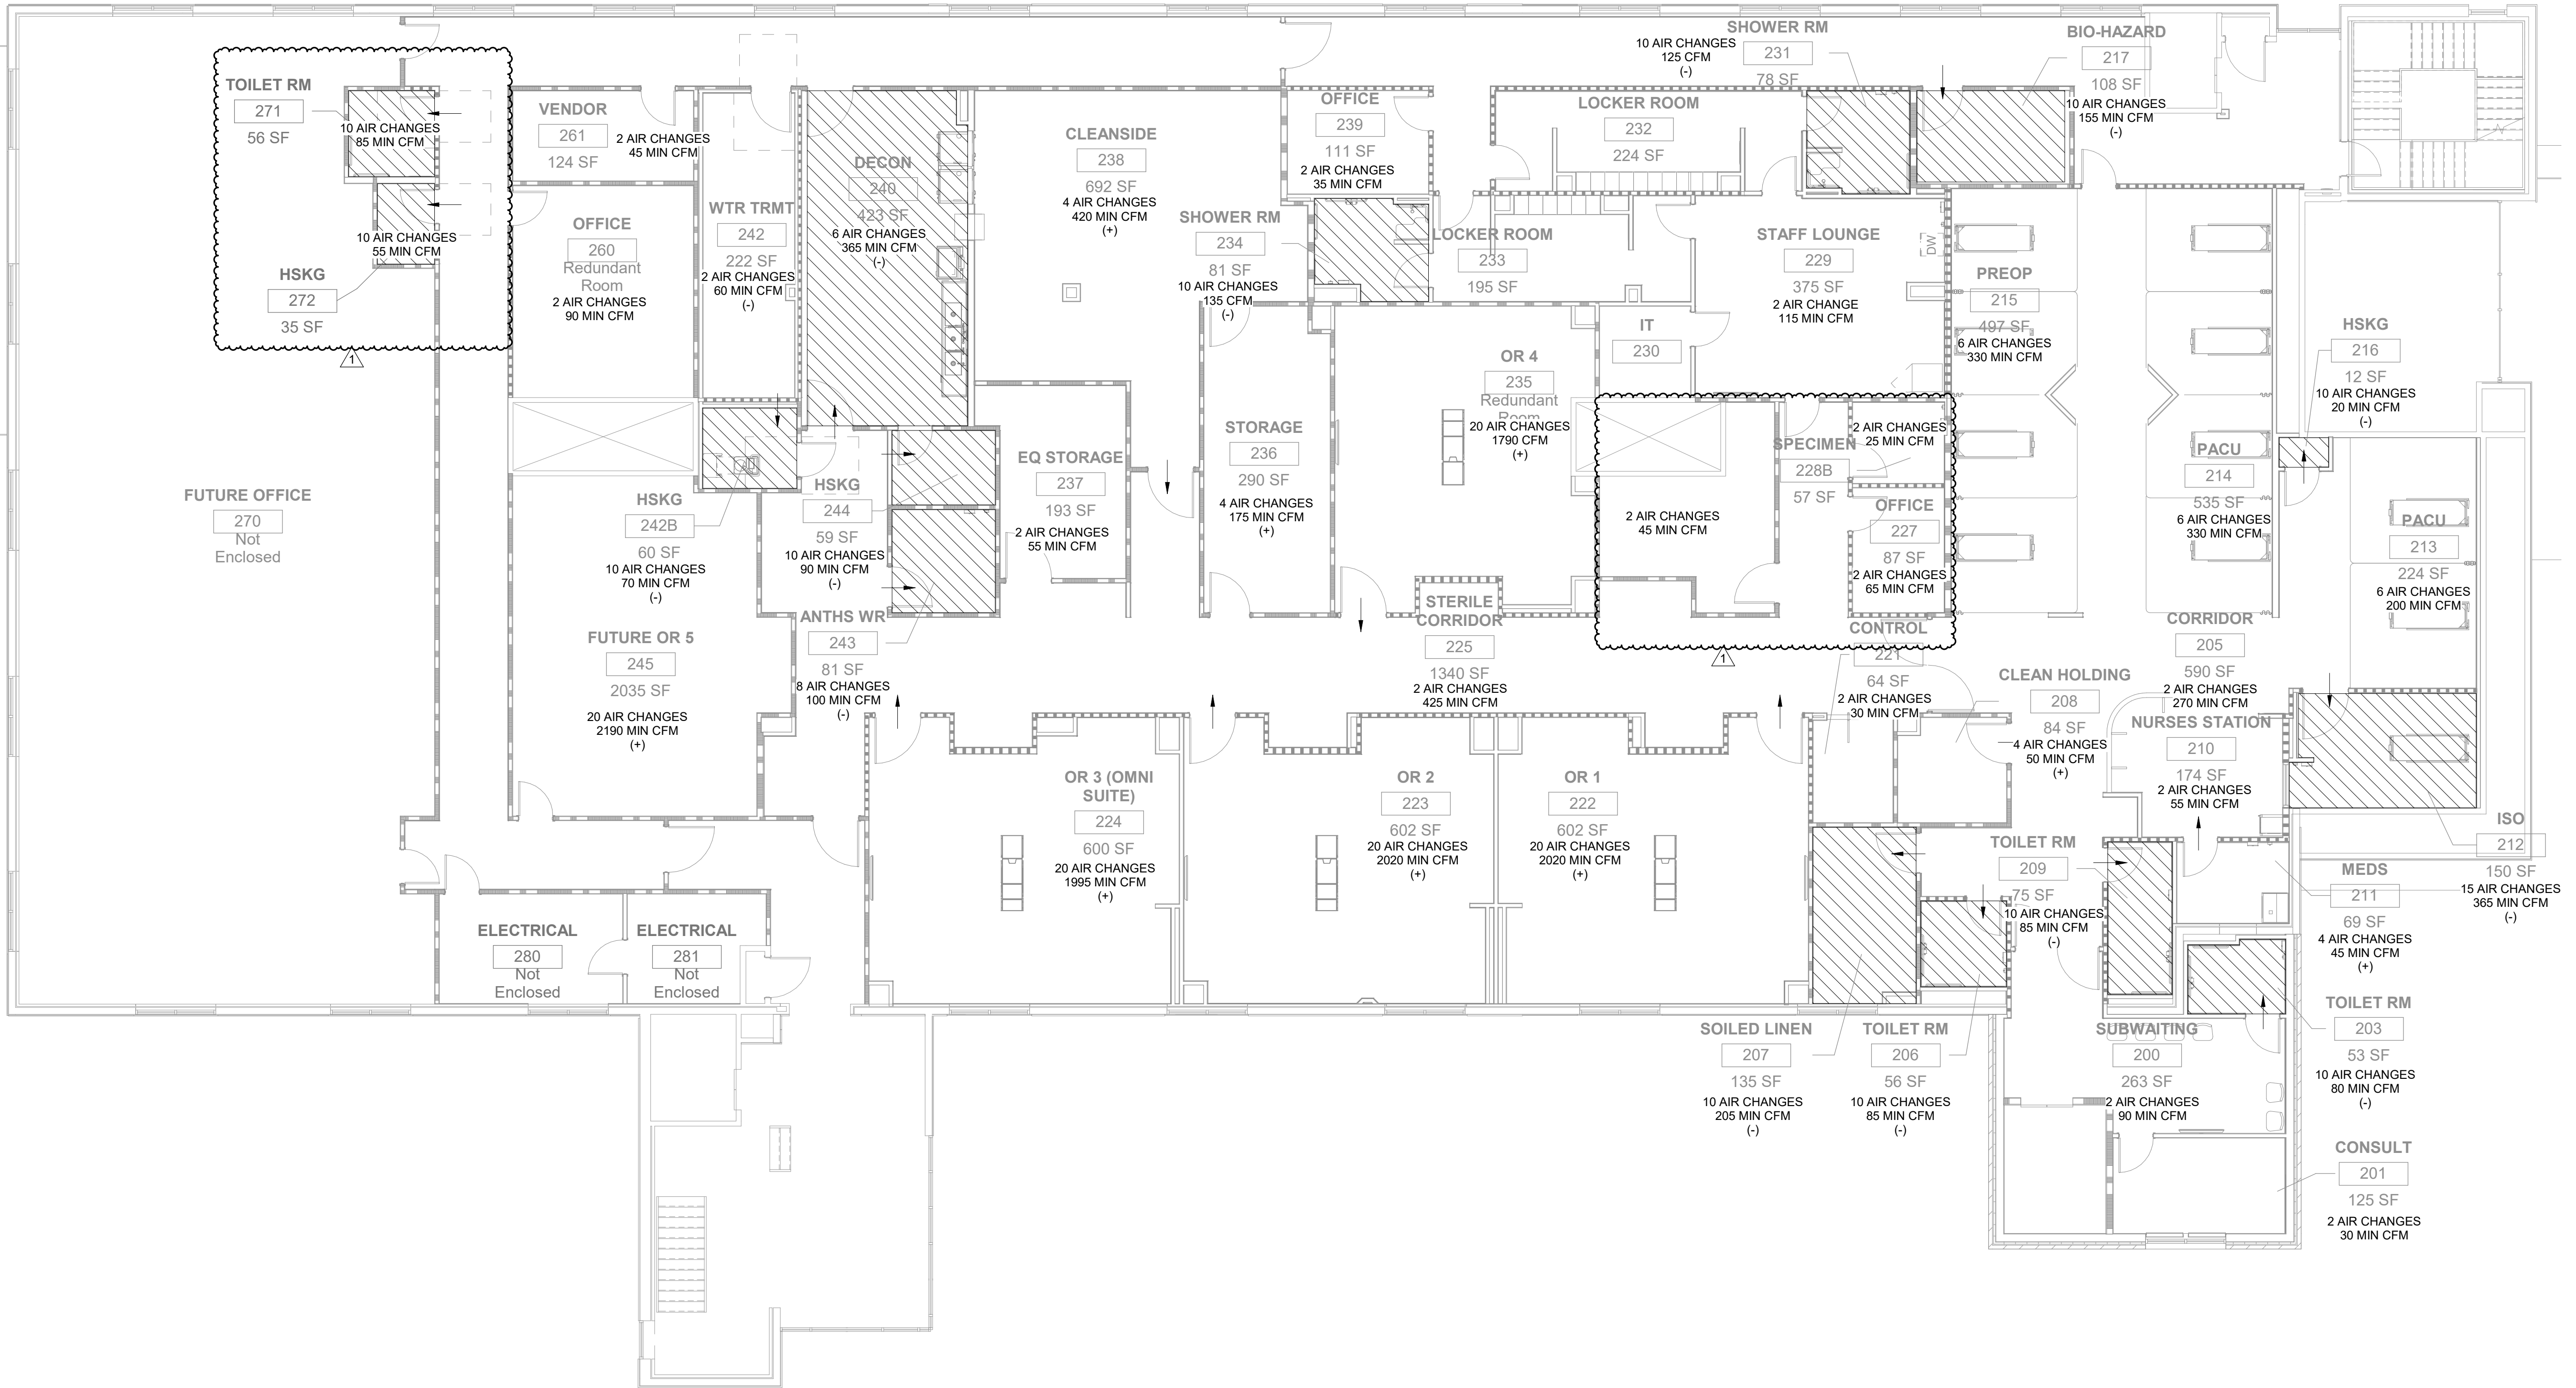


1 MECHANICAL PRESSURIZATION DIAGRAM
 1/8" = 1'-0"

© 2022 XA COLLECTIVE, LLC. Unauthorized reproduction is prohibited.

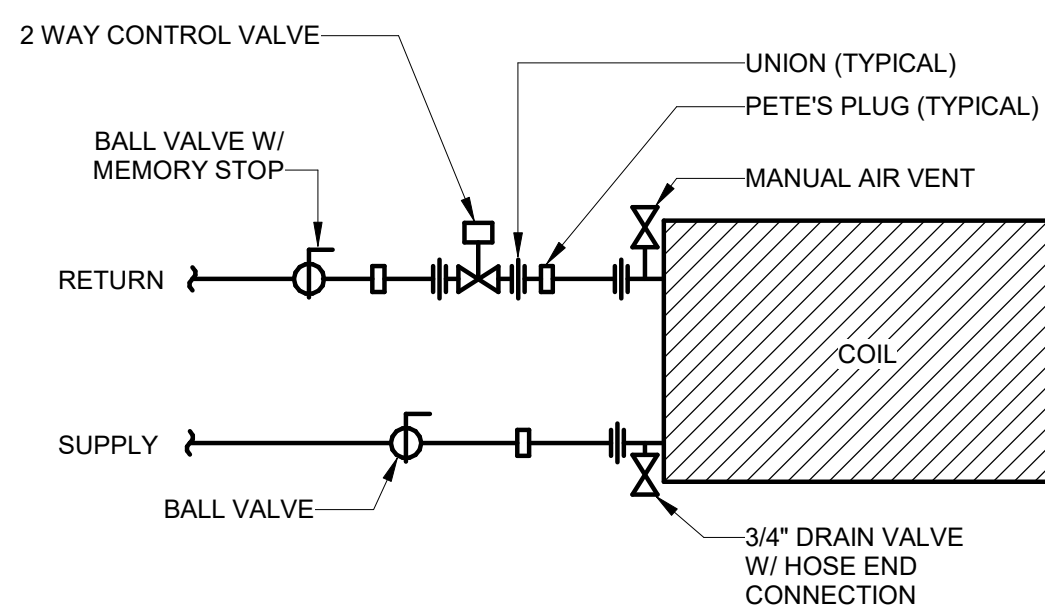


- NOTES:
1. PIPE WATER FLOW COUNTER TO AIR FLOW
 2. PROVIDE DIELECTRIC UNIONS WHERE MATERIALS DIFFER
 3. PROVIDE CONCENTRIC REDUCERS WHERE REQUIRED

8 2-WAY VALVE CONNECTION
NOT TO SCALE

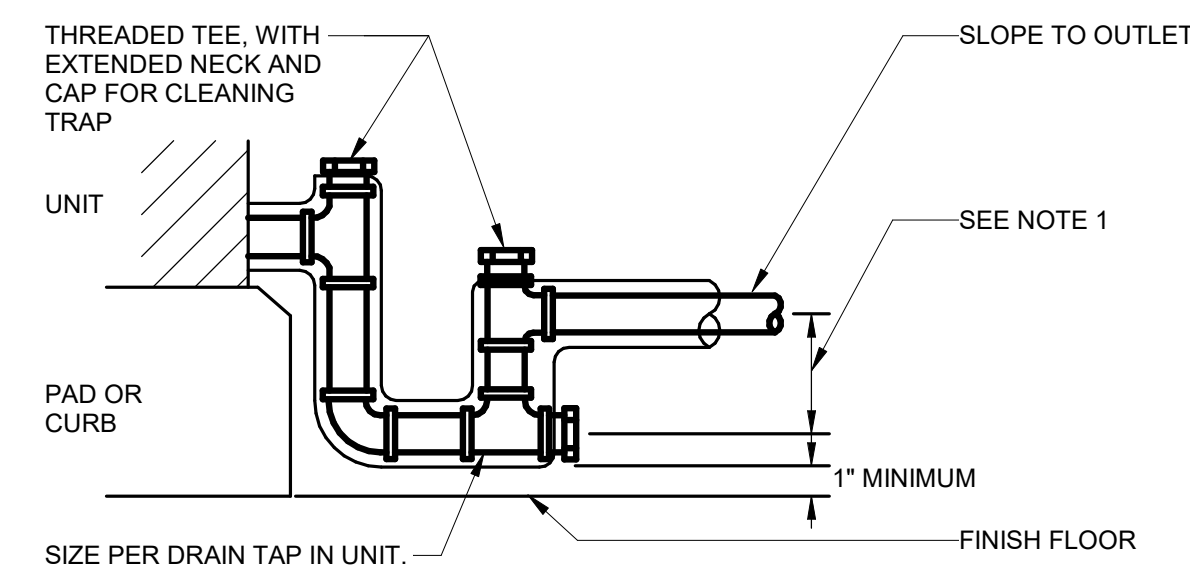


- NOTE:
1. DRAW THRU UNITS: TRAP DEPTH = GREATER OF 2" OR 1/2" PLUS AHU TOTAL PRESSURE IN INCHES - WG PRESSURE IN INCHES - WG
 2. PAD OR CURB HEIGHT DETERMINED BY SPACE REQD TO INSTALL TRAP

9 CONDENSATE DRAIN TRAP FOR RTUs
NOT TO SCALE

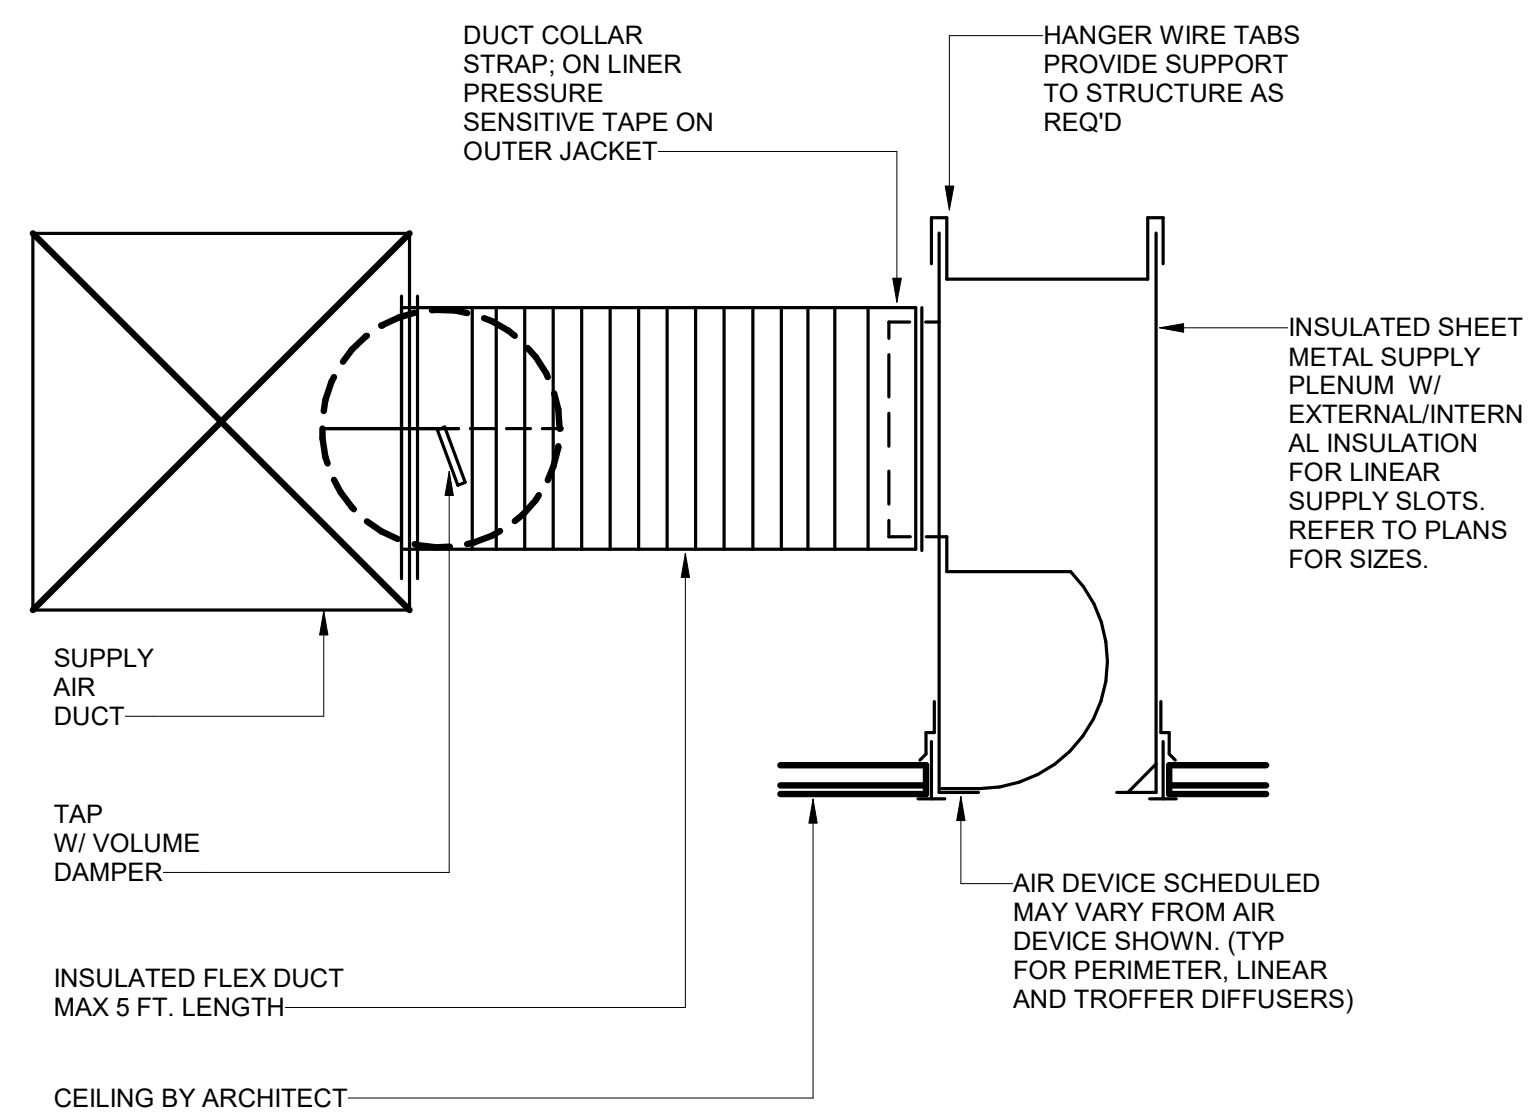


NOTE: SUPPORT FLEX DUCT FROM STRUCTURE SO THAT IT DOES NOT KINK, SAG OR REST ON LIGHT FIXTURES, CEILING SUPPORT TEES OR TILE.


10 SLOT DIFFUSER
NOT TO SCALE

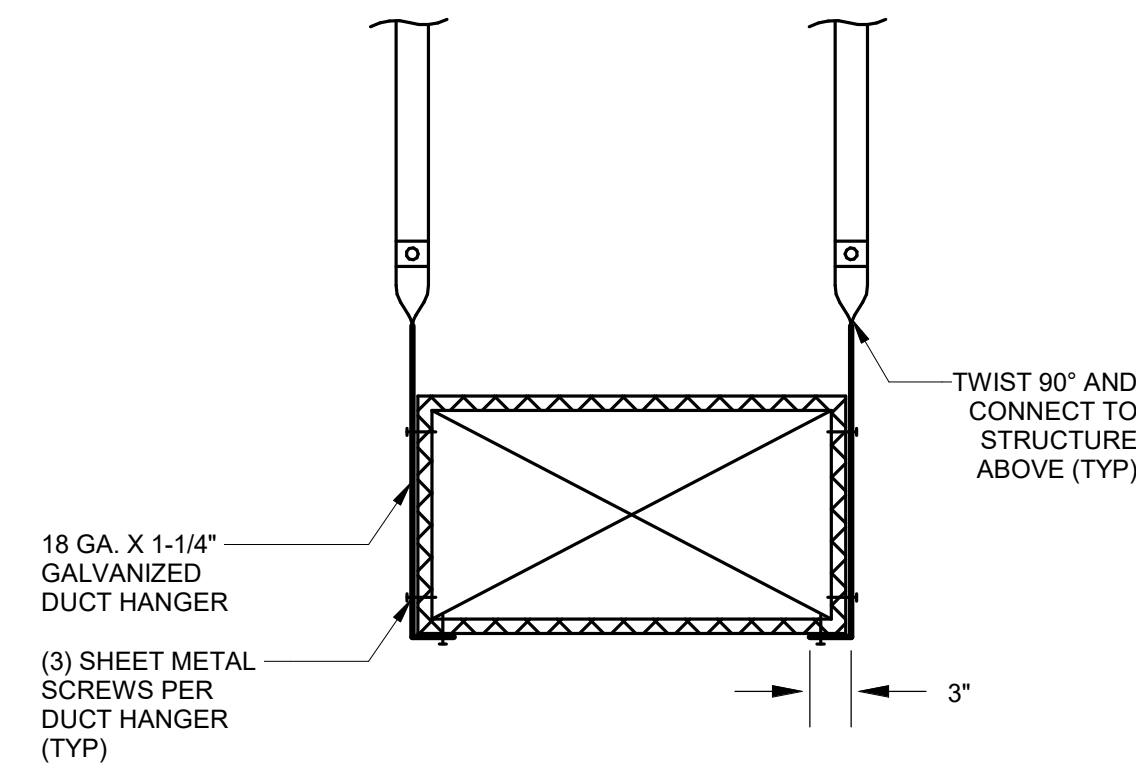


4 DUCT HANGER
NOT TO SCALE

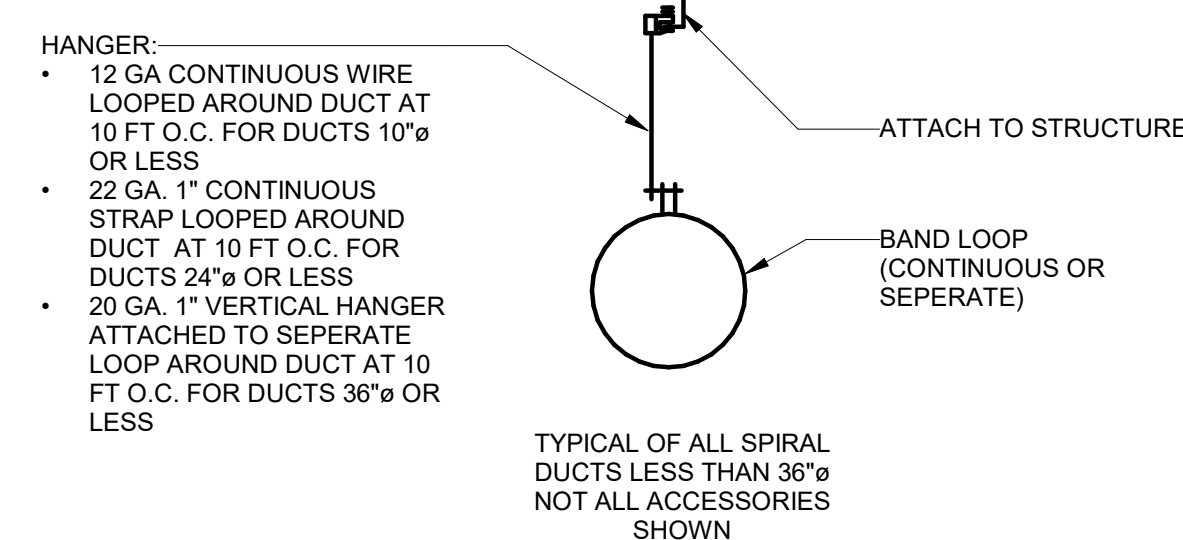


5 SPIRAL DUCT HANGER
NOT TO SCALE

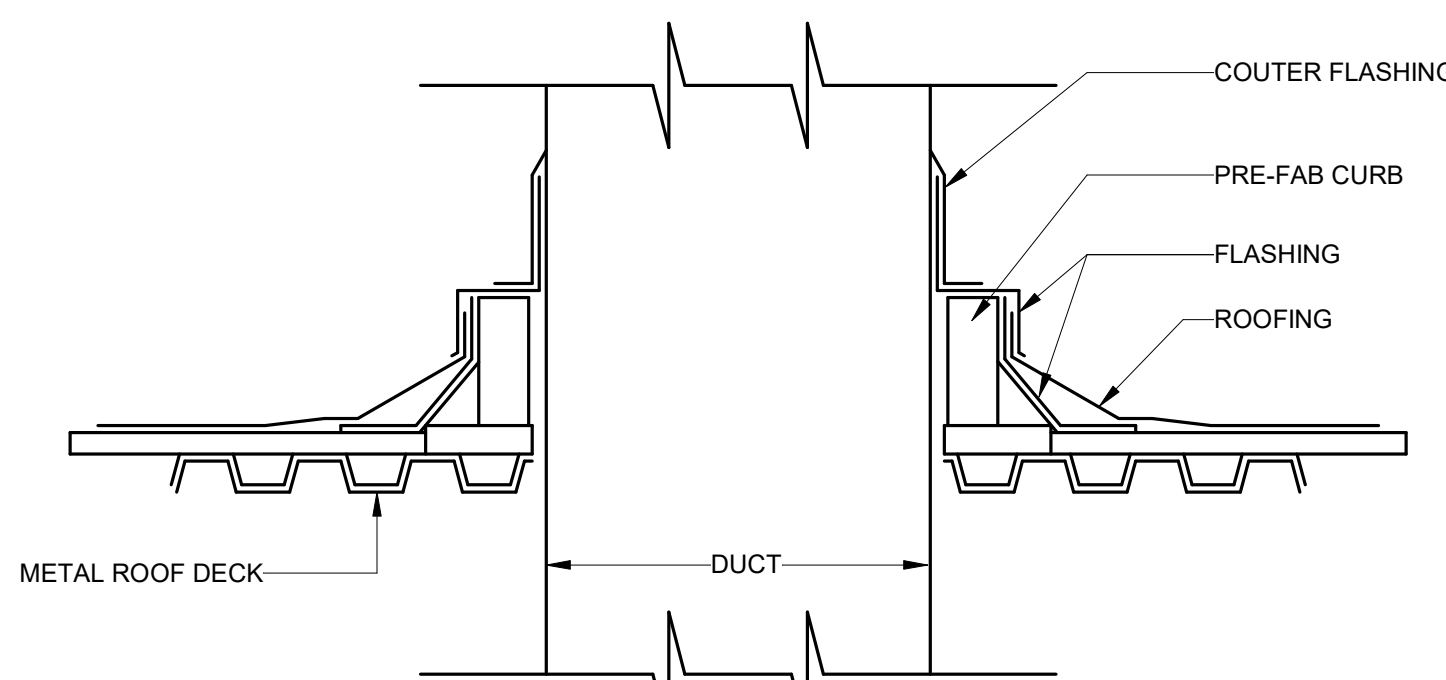

6 DUCT THROUGH ROOF PENETRATION
NOT TO SCALE

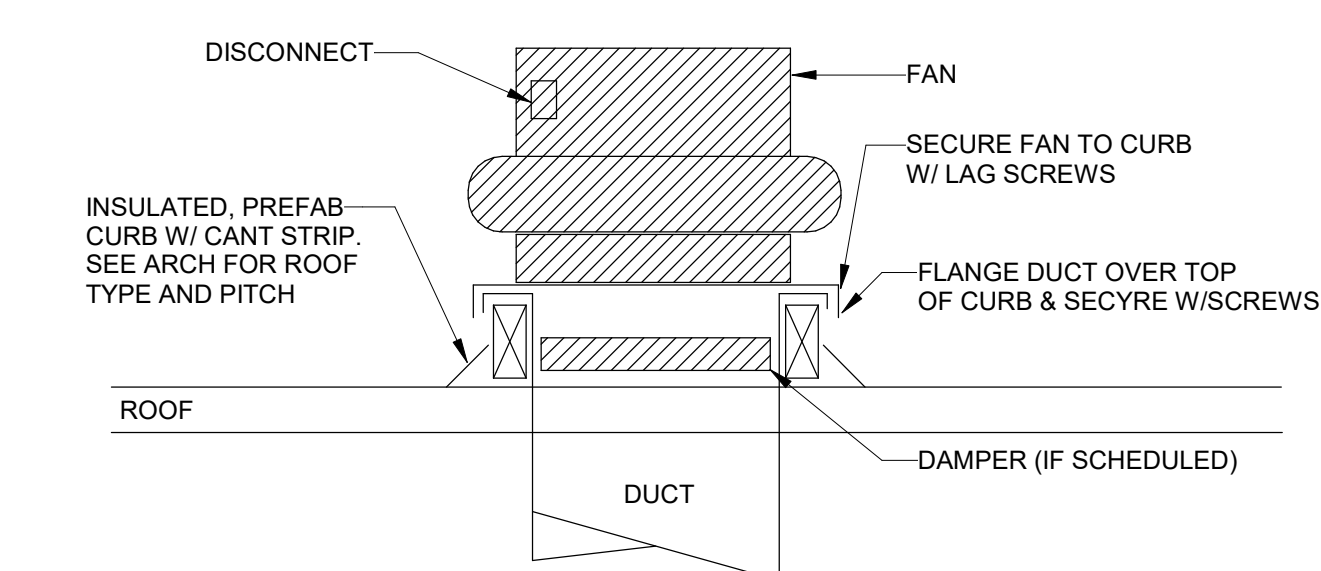


7 ROOF MOUNTED EXHAUST FAN
NOT TO SCALE

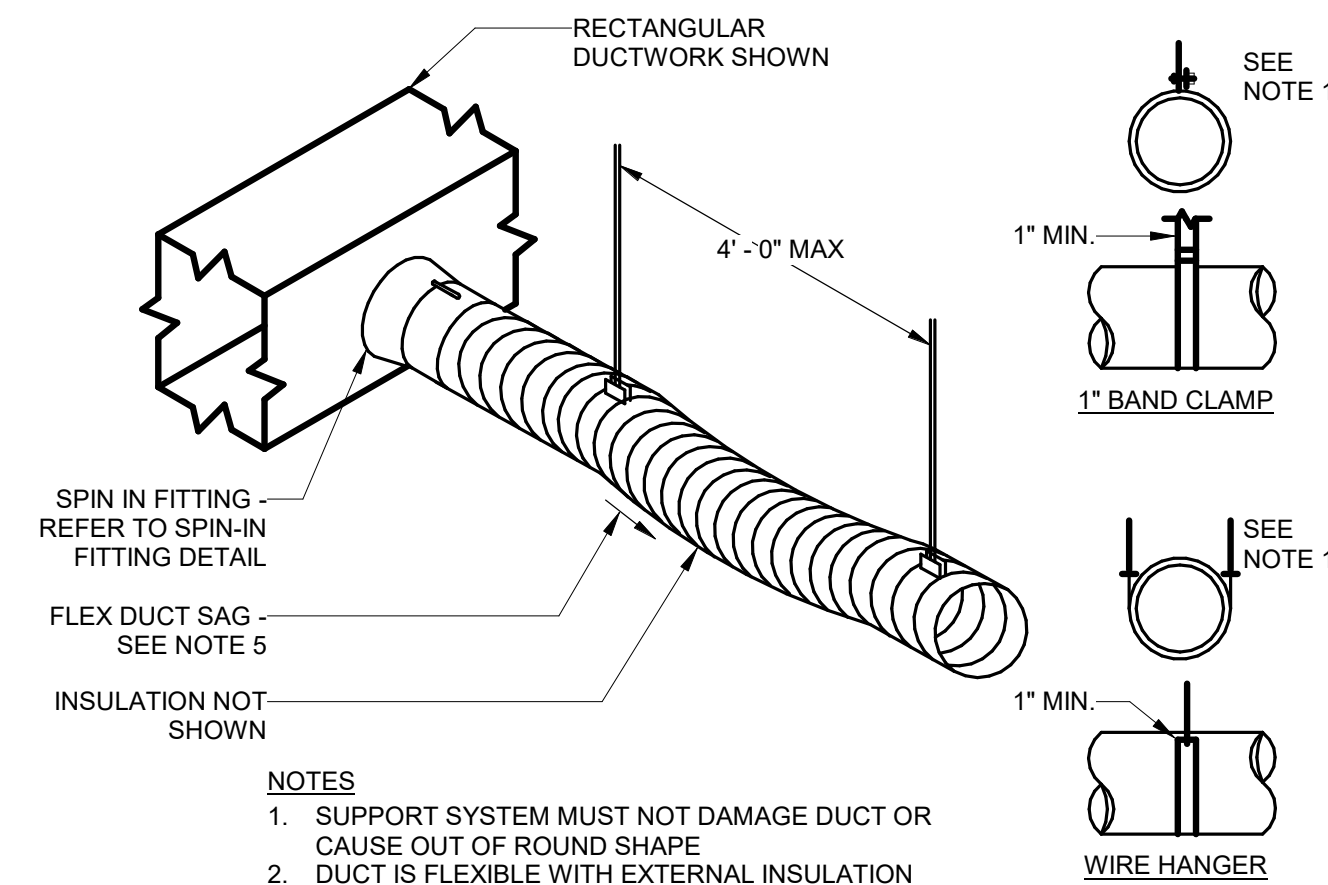


- NOTES:
1. SUPPORT SYSTEM MUST NOT DAMAGE DUCT OR CAUSE OUT OF ROUND SHAPE
 2. DUCT IS FLEXIBLE WITH EXTERNAL INSULATION AND VAPOR BARRIER JACKETING
 3. MINIMUM CENTER LINE BEND RADIUS IS ONE DIAMETER (OR INSIDE RADIUS OF D/2)
 4. DUCT SHOULD EXTEND STRAIGHT FOR SEVERAL INCHES FROM A CONNECTION BEFORE BENDING
 5. MAXIMUM SAG OF 1/2\"/>

1 FLEX DUCT SUPPORT REQUIREMENTS
NOT TO SCALE

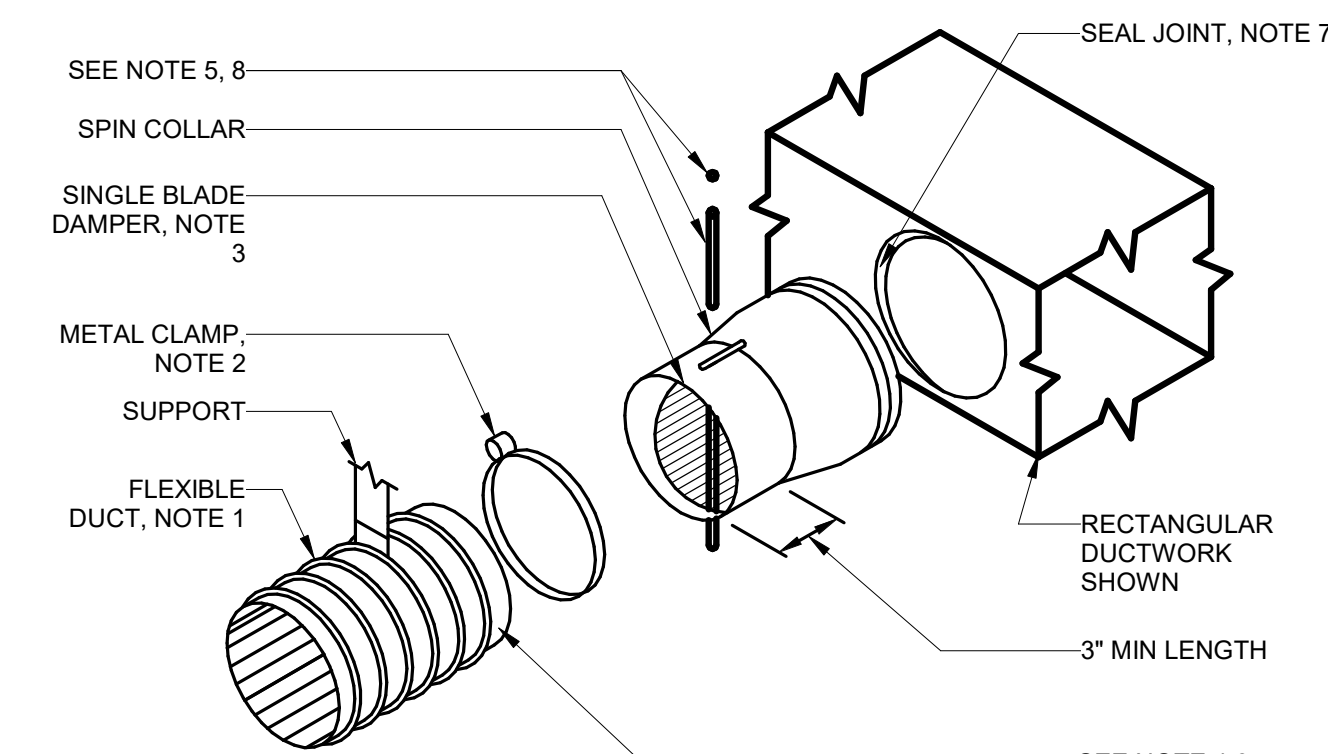


- NOTES:
1. SUPPORT AS REQUIRED
 2. BAND FLEX TO COLLAR 1/2\"/>

2 SPIN-IN FITTING WITH DAMPER
NOT TO SCALE

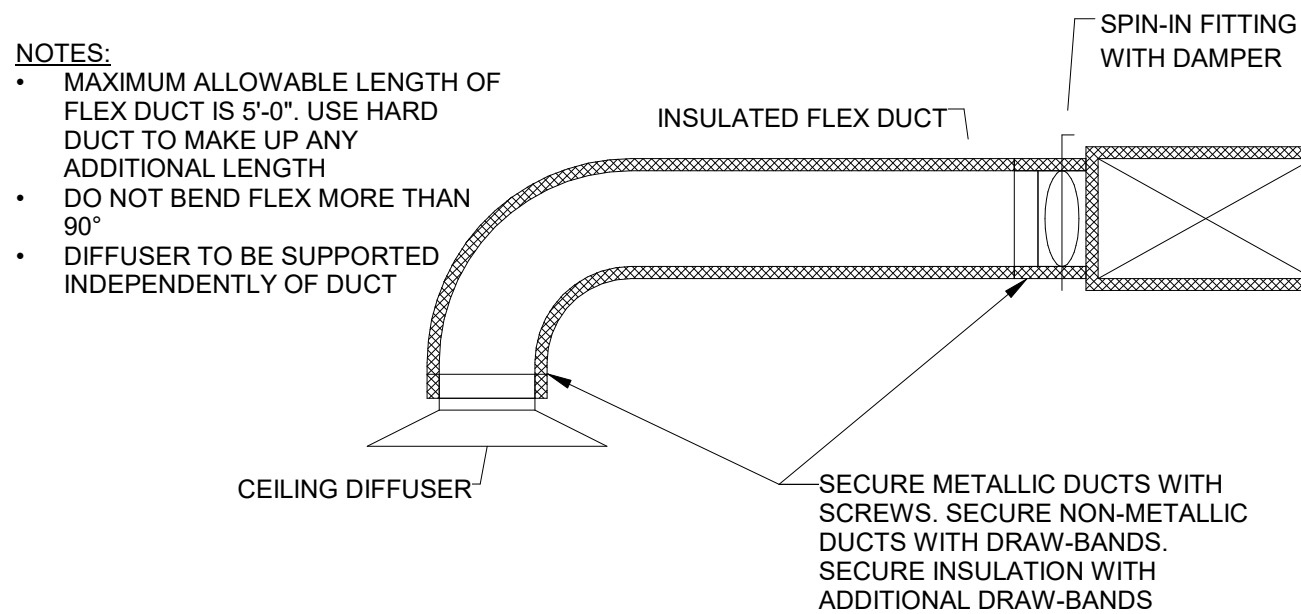

3 DIFFUSER CONNECTION
NOT TO SCALE

- NOTES:
- MAXIMUM ALLOWABLE LENGTH OF FLEX DUCT IS 5'-0\"/>

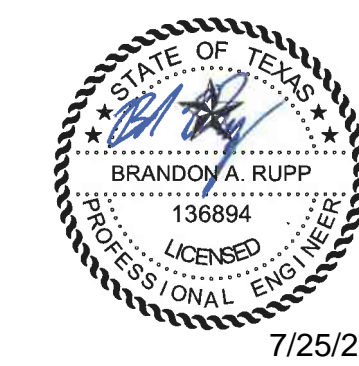

Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
06/30/22	ISSUE FOR CONSTRUCTION






**LEGENT NORTH HOUSTON
 SURGICAL HOSPITAL**
 24429 TOMBALL PKWY, SUITE 100
 TOMBALL, TX 77375


Drawn	BAR
Checked	SSM
Date	06/30/22
PROJECT No.	
Revisions	
06/30/22	ISSUE FOR CONSTRUCTION

SHEET TITLE
**MECHANICAL
 DETAILS**

SHEET NO.
M511

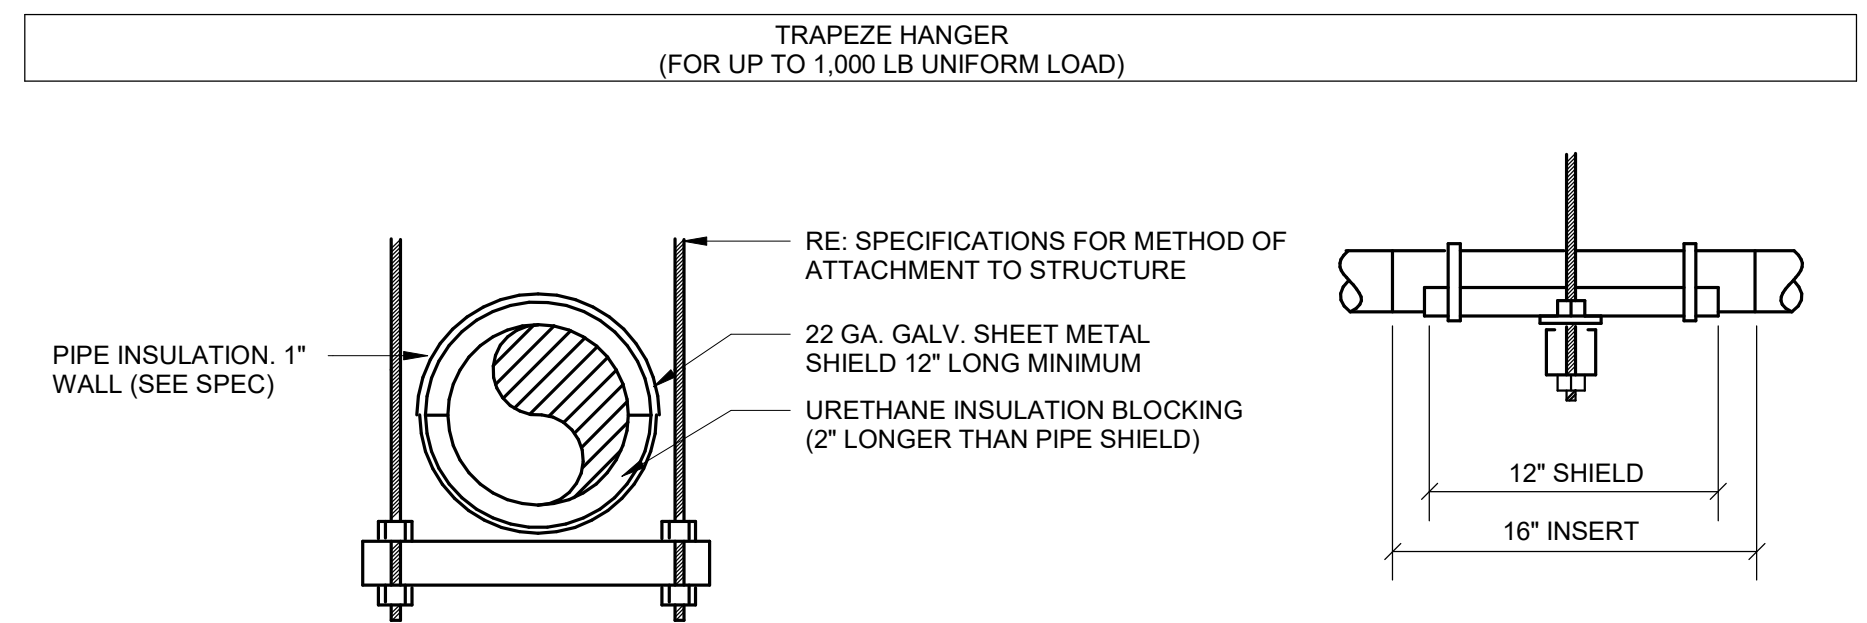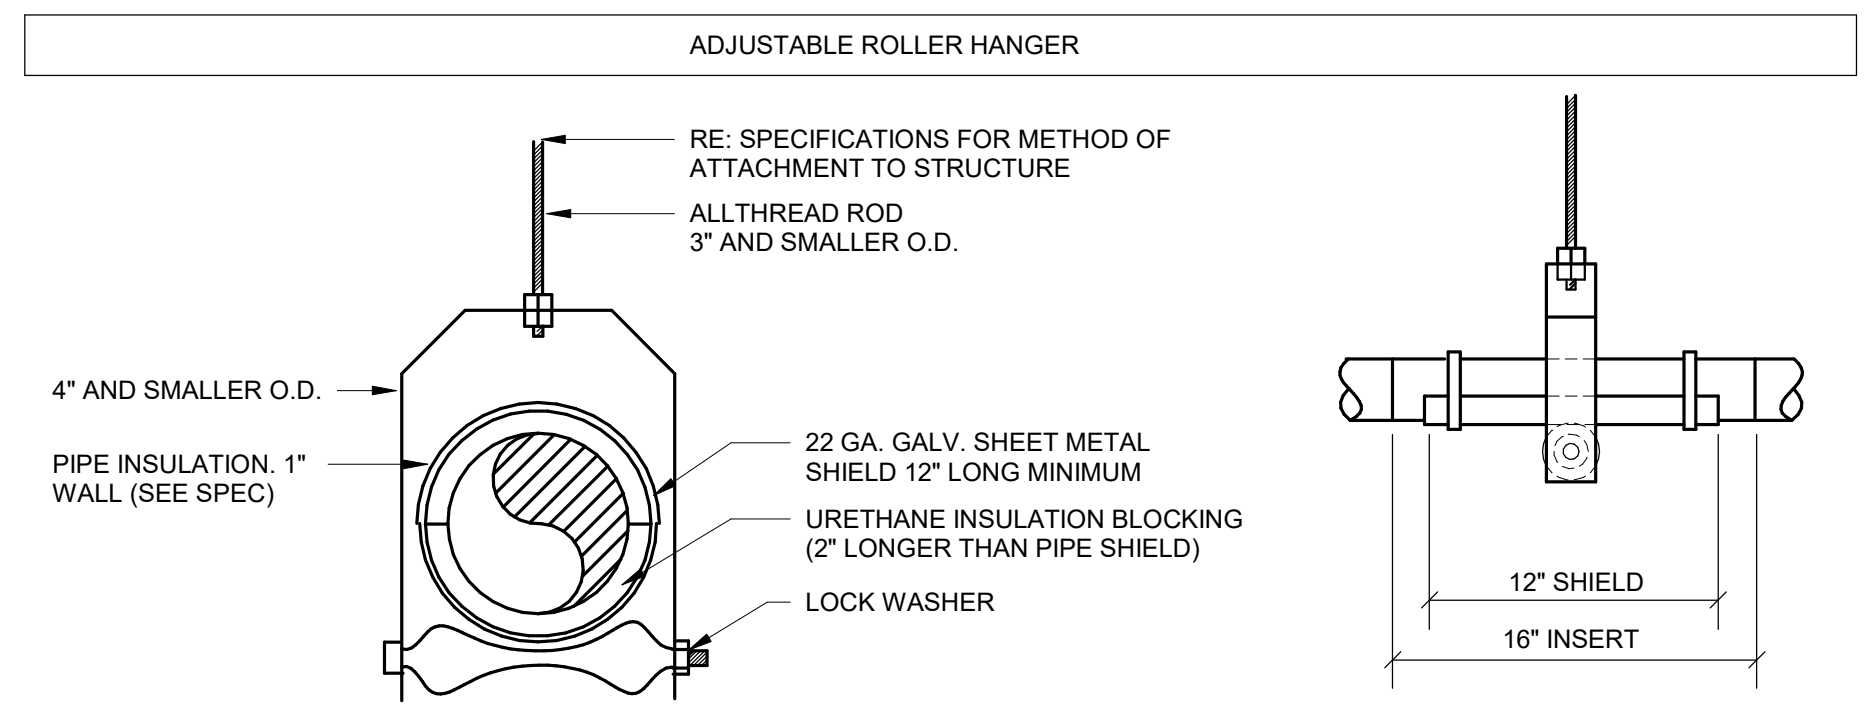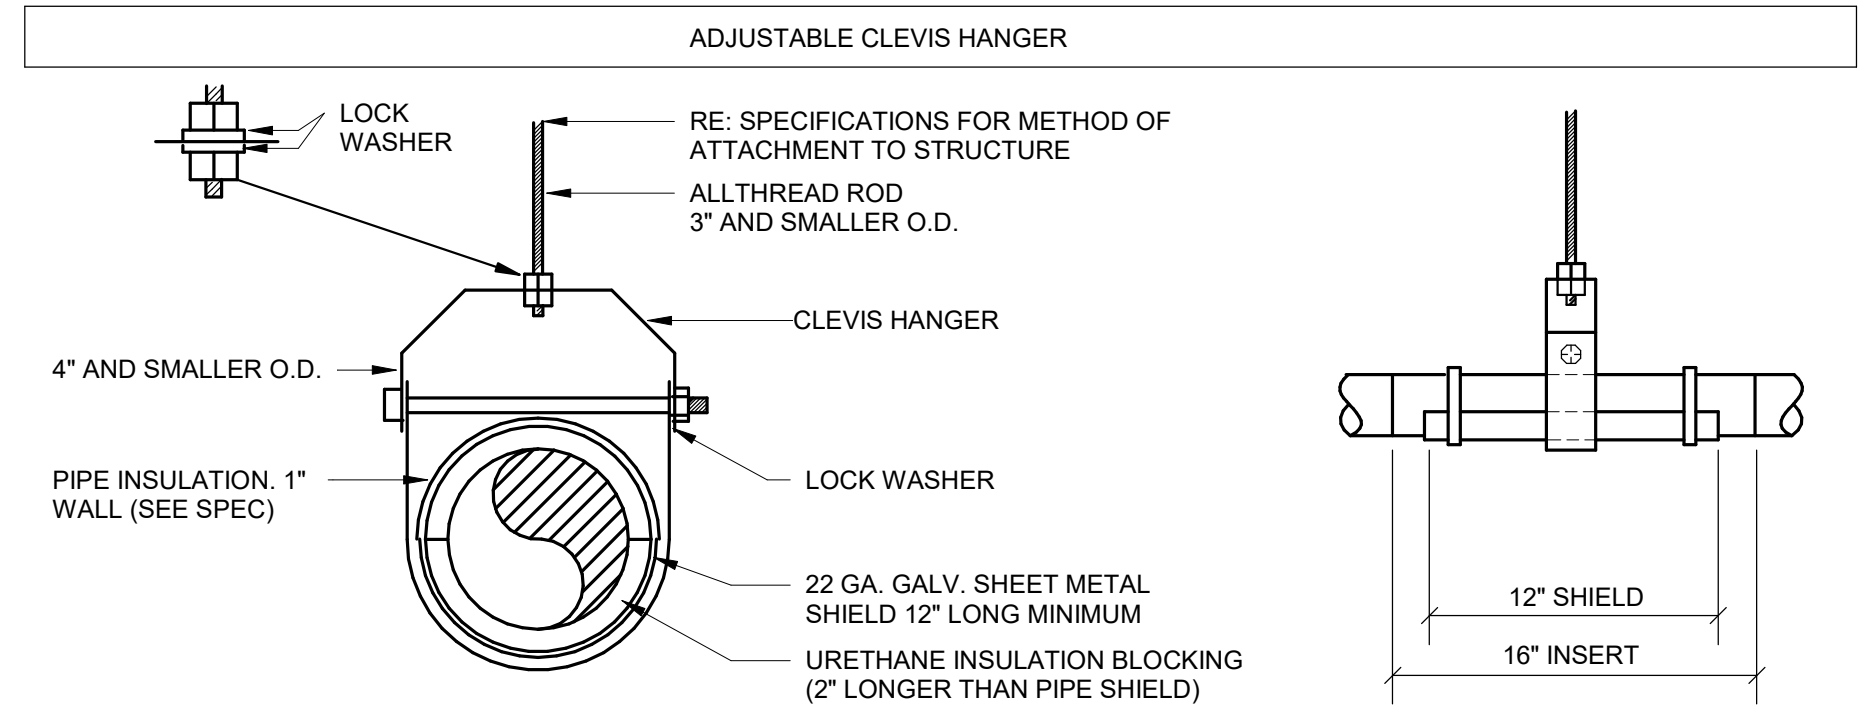


4 PIPE HANGER DETAIL
 NOT TO SCALE

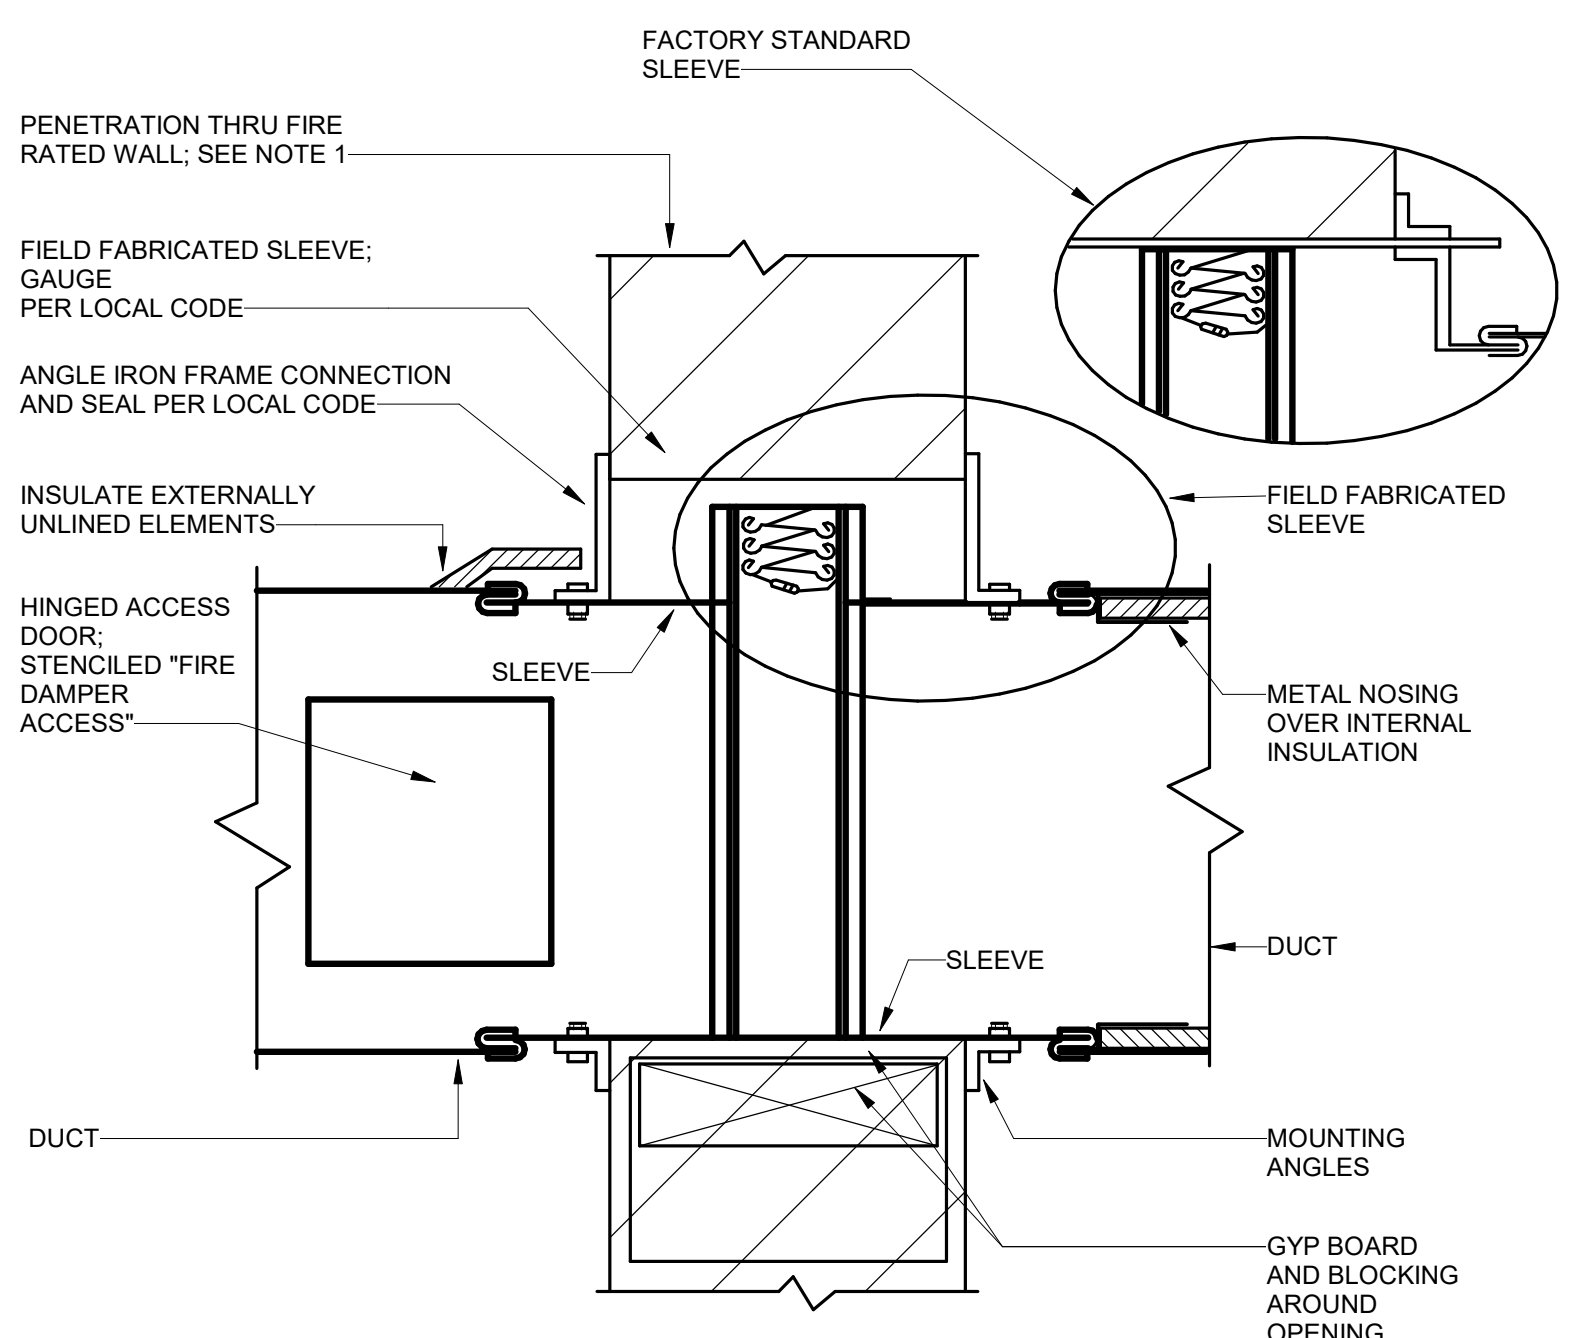


- NOTES:**
1. MAKE OPENING 1/8" PER FOOT LARGER THAN DAMPER DIMENSIONS WITH 1/4" MIN REQD
 2. MOUNTING ANGLES, SLEEVE GAUGE, LENGTH OF SLEEVE, SLEEVE ATTACHMENT, AND OTHER CONSTRUCTION DETAILS SHALL BE PER DAMPER SUPPLIER'S INSTRUCTIONS TO MAINTAIN UL LISTING AND TO CONFORM WITH NFPA 90A OR LOCAL REQUIREMENTS
 3. DAMPER CONSTRUCTED AND TESTED PER UL 555, UL LABELED, 1-1/2 HOUR FIRE RATING WITH 212°F FUSIBLE LINK
 4. SEAL BETWEEN WALL AND SLEEVE W/ APPROVED FIRE STOP MATERIAL
 5. TYPE 'B' DAMPER SHOWN; 'C' DAMPERS ARE SIMILAR. DO NOT USE TYPE 'A' WITH THE CURTAIN EXTENDING INTO THE AIR STREAM

5 CURTAIN TYPE FIRE DAMPER-VERIT. MTD. 1-1/2 HR
 NOT TO SCALE

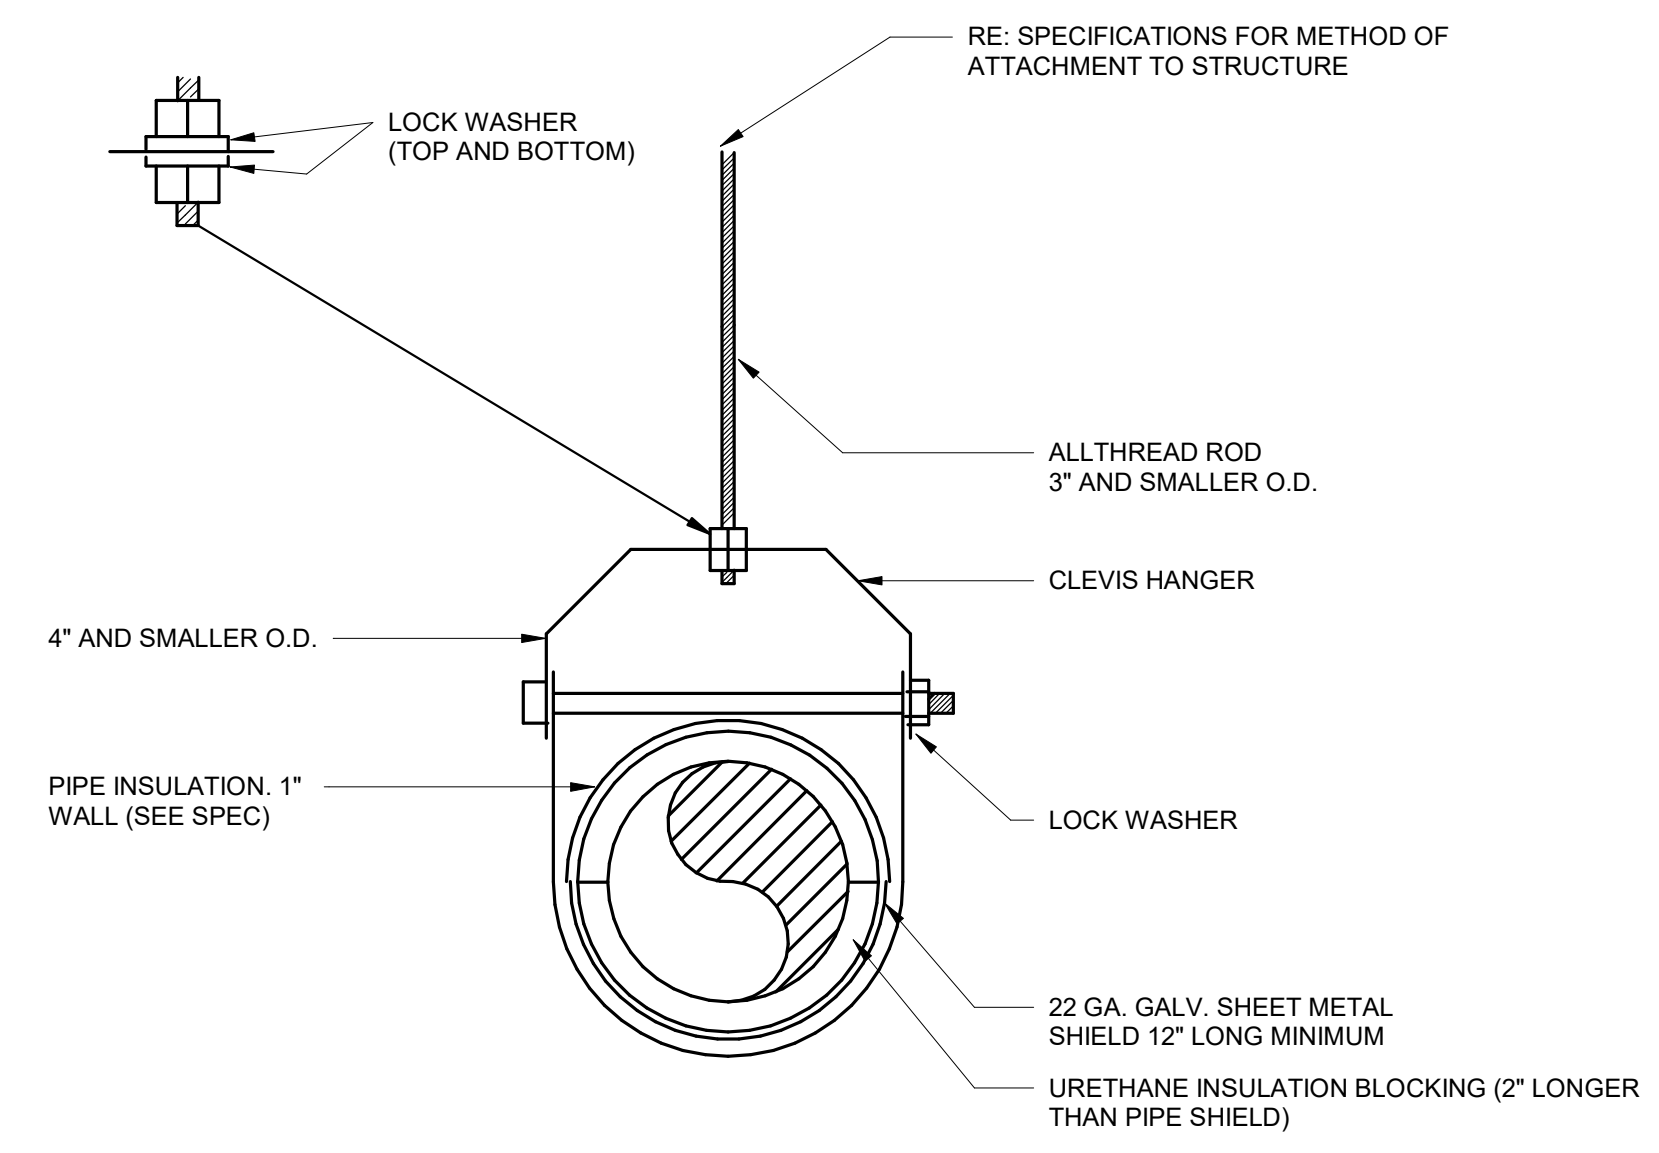


1 SINGLE PIPE HANGER
 NOT TO SCALE

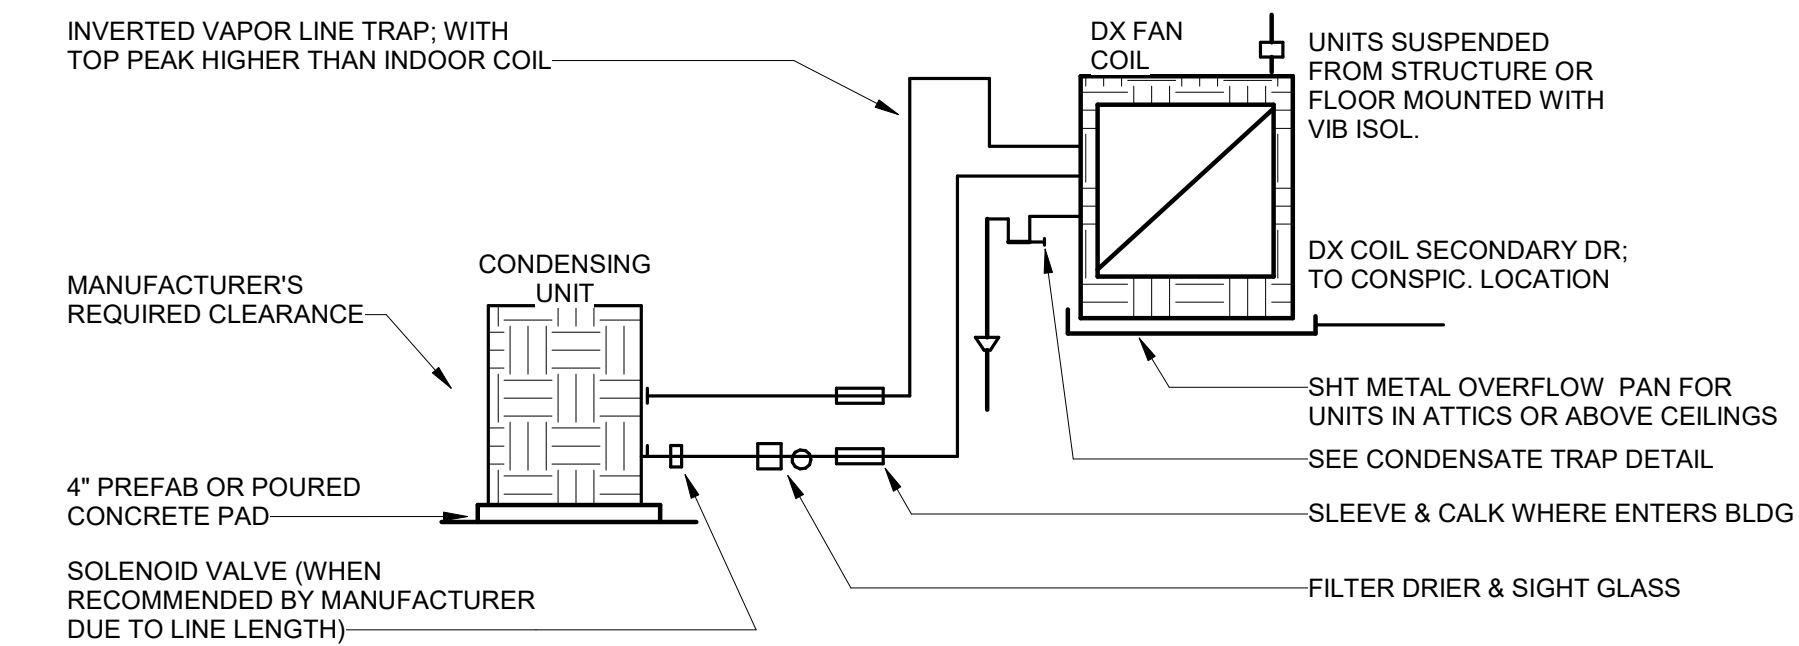

- NOTES:**
1. SUCTION LINE TO INSULATED; INSULATION INSIDE BUILDING TO HAVE 25/50 FLAME/SMOKE RATING
 2. HVAC CONTRACTOR RESPONSIBLE FOR LOW VOLTAGE CONTROL WIRING; ELECTRICAL CONTRACTOR PROVIDES LINE VOLTAGE WIRING & DISCONNECTS
 3. SIZE REFRIG LINES AS PER MANUFACTURER
 4. DUCT SUPPLY & RETURN, PROVIDE FLEX DUCT CONNECTION ON SUPPLY & RETURN DUCT (UNLESS FIBERGLASS DUCT)

2 DIRECT EXPANSION COOLING COIL AND CONDENSING UNIT
 NOT TO SCALE

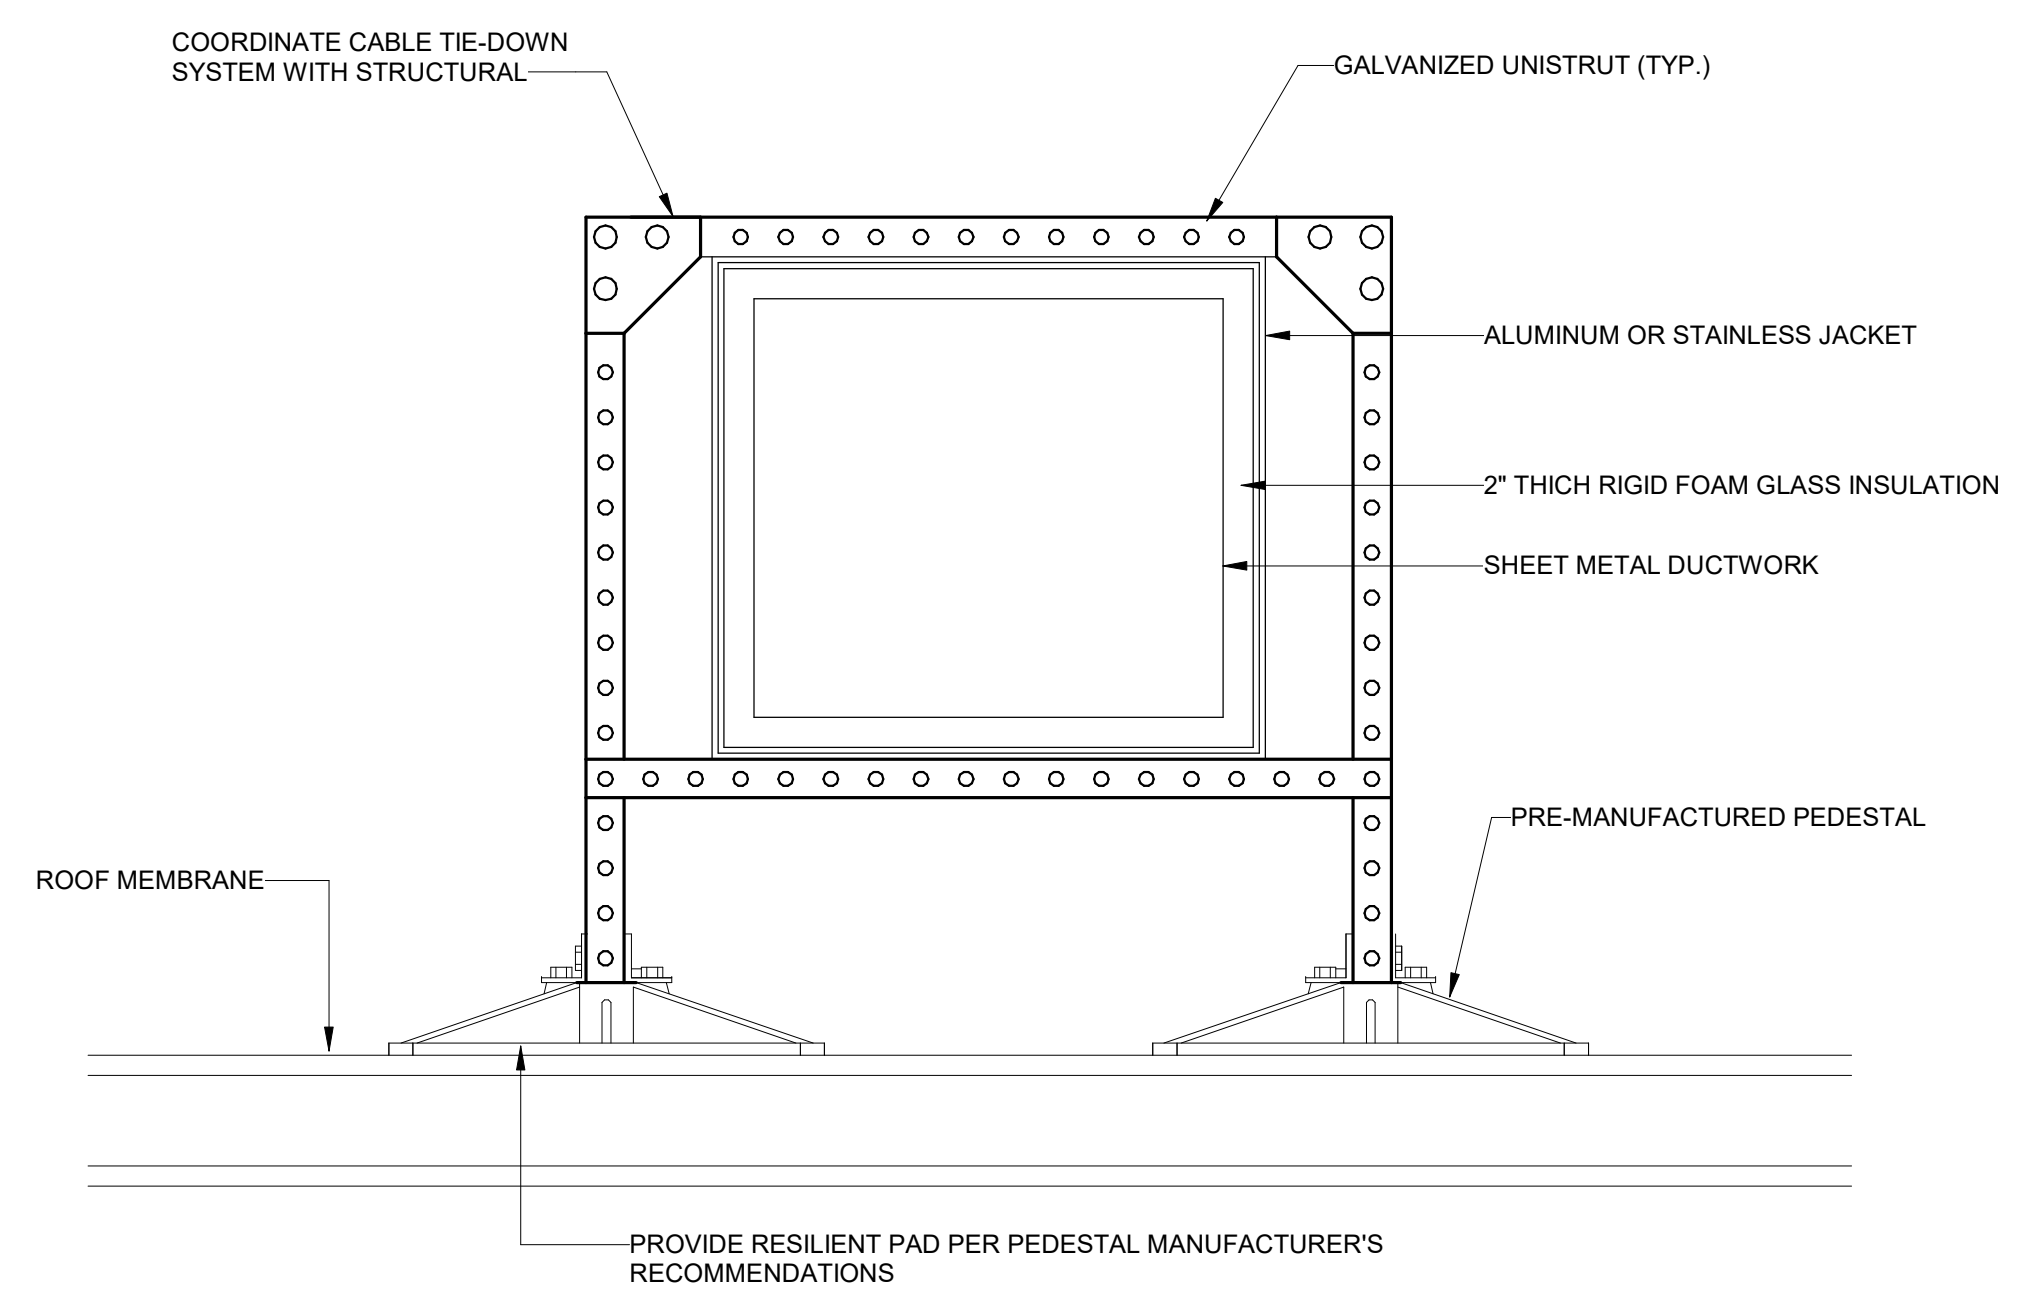

3 ROOF DUCT SUPPORT DETAIL
 12" = 1'-0"



DX RTU SCHEDULE

TAG	AREA SERVED	MANUFACTURER/MODEL	DISCHARGE CONFIGURATION	INTAKE CONFIGURATION	SUPPLY FANS			RETURN FANS			COOLING COIL				HOT GAS REHEAT COIL		COMPRESSORS			PRIMARY FILTER	SECONDARY FILTER	ELECTRICAL		OPERATING WEIGHT (LBS)	NOTES	
					QUANTITY	TOTAL AIRFLOW (CFM)	OUTSIDE AIRFLOW (CFM)	ESP	QUANTITY	TOTAL AIRFLOW (CFM)	ESP	TOTAL COOLING (MBH)	SENSIBLE COOLING (MBH)	AIR ENT. COIL, DB/WB (* F)	AIR LVG COIL, DB/WB (* F)	MINIMUM HEATING (MBH)	AIR LVG, DB/WB (*F)	QUANTITY	TYPE	REFRIGERANT	MERV	MERV	VOLTS/PH/HZ			FLA/MCA/MOCP (A)
RTU-2-1	HOSPITAL OR	AAON - RNA-070-D-0-3	VERTICAL	VERTICAL	2	14180	2500	3.5	2	14180	1.0	740.2	400.0	73/62	47/45	123.0	55	4	FULLY MODULATING	R410A	8, 2" THICK	17	460/3/60	186/193/200	6190	ALL

NOTES:

- ALL COMPRESSORS SHALL BE FULLY MODULATING.
- PROVIDE THERMALLY BROKEN PANELS WITH EXPANDED FOAM INSULATION (R-13).
- PROVIDE STAINLESS STEEL DRAIN PANS.
- PROVIDE QTY.(2) DIRECT DRIVE MODULATING (VFD/ECM) PLENUM SUPPLY FANS.
- PROVIDE QTY.(2) DIRECT DRIVE MODULATING (VFD/ECM) RETURN FANS.
- PROVIDE MINIMUM 6 ROW EVAPORATOR COIL.
- PROVIDE FULL MODULATING HOT GAS REHEAT.
- PROVIDE VFD CONDENSER FANS WITH HEAD PRESSURE CONTROL.
- PROVIDE FACTORY INSTALLED UV LIGHTS (SEE SPECIFICATIONS) DOWNSTREAM OF THE EVAPORATOR COIL.
- PROVIDE FACTORY INSTALLED BACNET NATIVE CONTROLLER.
- PROVIDE OUTSIDE AIR MONITOR OAM II AIRFLOW STATION (OR EQUAL). FACTORY PROVIDE UNIT WITH MOUNTING SCREEN (AMCA STANDARD 610 CERTIFICATION). IF UNABLE TO PROVIDE FROM FACTORY, CONTROLS CONTRACTOR PROVIDE AND COORDINATE INSTALLATION FOR STATED ASSEMBLY (OR EQUAL).
- IF UNABLE TO PLACE FINAL FILTER IN UNIT, PROVIDE FINAL FILTER CURB WITH HEPA FILTER RACK.
- PROVIDE WITH KIP-RT ROOFTOP EQUIPMENT PAD BETWEEN UNIT AND CURB.
- REQUIRED BTU/H ARE NET; FAN HEAT HAS NOT BEEN SUBTRACTED.
- EXTERNAL STATIC INCLUDES DUCTWORK, DIFFUSERS, & DIRT ACCUMULATION ON FILTERS.
- EVAPORATOR SHALL BE PROVIDED WITH INTERNAL FLOAT SWITCH AND SHALL SHUT UNIT OFF IF PRIMARY DRAIN BECOMES RESTRICTED.
- PROVIDE ALL MANUFACTURER'S RECOMMENDED CLEARANCES.
- IF PROVIDED WITH FILTERED CURB, CONTRACTOR SHALL PROVIDE LEVEL EQUIPMENT PLATFORM. PLATFORM SHALL BE A MINIMUM OF 30" WIDE FROM EQUIPMENT WITH GUARDS A MINIMUM OF 42" HIGH WITH HORIZONTAL AND VERTICAL MEMBERS SPACED TO PREVENT A 21" SPHERE FROM PASSING THROUGH. OBTAIN STAMPED DRAWINGS AND PLATFORM FROM STEEL SOLUTIONS INC (OR EQUIVALENT MANUFACTURER). CONTRACTOR SHAL FIELD VERIFY EXISTING FIELD CONDITIONS AND EQUIPMENT BEFORE PURCHASE AND CONSTRUCTION. THE PLATFORM IS INTENDED TO BE A "DELEGATED DESIGN" ITEM.
- MOTOR(S) SHALL BE PREMIUM EFFICIENCY.
- COORDINATE FINAL CONTROLS REQUIREMENTS WITH OWNER'S VENDOR.
- UNIT SHALL BE CONNECTED TO EMERGENCY GENERATOR.
- PROVIDE WITH HAIL GUARDS.
- PROVIDE ROOF CURB WITH SUFFICIENT HEIGHT SUCH THAT THE OUTSIDE AIR INTAKE IS A MINIMUM OF 36" ABOVE THE ROOF.
- PROVIDE WITH SMOKE DETECTOR IN THE SUPPLY AND RETURN DUCTWORK. PROVIDE SUPPLY SIDE SMOKE DETECTOR DOWNSTREAM OF FINAL FILTER IN THE MAIN SUPPLY DUCT. UNIT OPERATION SHALL CEASE WHEN A SMOKE DETECTOR IS ENERGIZED.
- PROVIDE WITH DIFFERENTIAL PRESSURE MEASURING DEVICE THAT IS READILY ACCESSIBLE AND PROVIDES READING OF DIFFERENTIAL STATIC PRESSURE ACROSS EACH FILTER BED TO INDICATE WHEN FILTER NEEDS CHANGED. CONNECT TO BAS. SEE SPECIFICATIONS.

CHILLED WATER RTU WITH ELECTRIC HEAT SCHEDULE

TAG	AREA SERVED	MANUFACTURER/MODEL	DISCHARGE CONFIGURATION	INTAKE CONFIGURATION	SUPPLY FAN			HEATING COIL - AIR SIDE					COOLING COIL - AIR SIDE				COOLING COIL- WATER SIDE		PRIMARY FILTER	DOWNSTREAM FILTER	ELECTRICAL		OPERATING WEIGHT (LBS)	NOTES
					TOTAL AIRFLOW (CFM)	OUTSIDE AIRFLOW (CFM)	ESP	AIRFLOW (CFM)	AIR ENT. COIL, DB (* F)	AIR LVG COIL, DB (*F)	KW REQUIRED	CONTROL	TOTAL COOLING (MBH)	SENSIBLE COOLING (MBH)	AIR ENT. COIL, DB/WB (* F)	AIR LVG COIL, DB/WB (* F)	FLOW RATE (GPM)	EWT-LWT (*F)	MERV	MERV	VOLTS/PH/HZ	FLA/MCA/MOCP(A)		
RTU-2-2	NON-CRITICAL	TEMTRON	HORIZONTAL	HORIZONTAL	4125	1030	3.0	2060	45	55	8	SCR	191.2	116.4	81 / 68	55/53	38.2	44-54	8, 2" DEPTH	14, 12" DEPTH	460/3/60	17/22/25	3005	ALL

NOTES:


- PROVIDE WITH KIP-RT ROOFTOP EQUIPMENT PAD BETWEEN UNIT AND CURB.
- PROVIDE WITH MERV 14 FILTER BED DOWNSTREAM OF THE SUPPLY FAN, COOLING COIL, AND HEATING COIL.
- REQUIRED BTU/H ARE NET; FAN HEAT HAS NOT BEEN SUBTRACTED.
- EXTERNAL STATIC INCLUDES DUCTWORK, DIFFUSERS, & DIRT ACCUMULATION ON FILTERS.
- MOTOR(S) SHALL BE PREMIUM EFFICIENCY.
- IF MODEL NUMBER & SCHEDULE CONFLICT; MOST STRINGENT REQUIREMENTS APPLY.
- EVAPORATOR SHALL BE PROVIDED WITH INTERNAL FLOAT SWITCH AND SHALL SHUT UNIT OFF IF PRIMARY DRAIN BECOMES RESTRICTED.
- PROVIDE ALL MAUFACTURER'S RECOMMENDED CLEARANCES.
- CONTROLS (CONTROLLERS, SENSORS, VALVES, ETC.) SHALL BE PROVIDED BY B.A.S. CONTRACTOR.
- PROVIDE ROOF CURB WITH SUFFICIENT HEIGHT SUCH THAT THE OUTSIDE AIR INTAKE IS A MINIMUM OF 36" ABOVE THE ROOF.
- PROVIDE WITH OUTSIDE AIR MONITOR OAM II AIFLOW STATION (OR EQUAL). MONITOR TO BE FACTORY MOUNTED.
- PROVIDE WITH SMOKE DETECTOR IN THE SUPPLY AND RETURN DUCTWORK. PROVIDE SMOKE DETECTOR DOWNSTREAM OF FINAL FILTER IN THE MAIN SUPPLY DUCT. UNIT OPERATION SHALL CEASE WHEN A SMOKE DETECTOR IS ENERGIZED.
- PROVIDE WITH HAIL GUARDS.
- PROVIDE WITH FACTORY INSTALLED VFD'S FOR SUPPLY FAN INSIDE UNIT ENCLOSURE.
- PROVIDE WITH DIFFERENTIAL PRESSURE MEASURING DEVICE THAT IS READILY ACCESSIBLE AND PROVIDES READING OF DIFFERENTIAL STATIC PRESSURE ACROSS EACH FILTER BED TO INDICATE WHEN FILTER NEEDS CHANGED. CONNECT TO BAS. SEE SPECIFICATIONS.

AIR DEVICE SCHEDULE

TAG	SERVICE	MANUFACTURER AND MODEL	DESCRIPTION	FACE SIZE	NECK SIZE	CFM	MATERIAL	NOTES
A	SUPPLY	TITUS TLF-AA	LAMINAR FLOW DIFFUSER W/ INSULATED PLENUM	24" x 48"	10" Ø	0-275	ALUMINUM	1,2,3,4,5,7
B	RETURN	TITUS 30R	SIDE WALL RETURN GRILLE	16" x 24"	-	0-950	ALUMINUM	3,4,7
C	SUPPLY	TITUS OMNI	SQUARE PLAQUE DIFFUSER	24" x 24"	6" Ø	0-100	ALUMINUM	1,2,4,7
					8" Ø	101-200		
					10" Ø	201-400		
					12" Ø	401-600		
D	RETURN	TITUS PAR	PERFORATED RETURN GRILLE	24" x 24"	6" Ø	0-100	ALUMINUM	1,4,7
					8" Ø	101-200		
					10" Ø	201-400		
					12" Ø	401-600		
					14" Ø	601-750		
E	EXHAUST	TITUS PAR	PERFORATED EXHAUST GRILLE	24" x 24"	6" Ø	0-100	ALUMINUM	1,4,7
					8" Ø	101-200		
					10" Ø	201-400		
					12" Ø	401-600		
F	EXHAUST	TITUS PAR	PERFORATED EXHAUST GRILLE	12" x 12"	6" Ø	0-60	ALUMINUM	1,4,7
G	SUPPLY	TITUS 300FL	SIDE WALL SUPPLY DIFFUSER	8" x 6"	-	0-200	ALUMINUM	2,4
H	RETURN	TITUS 350R	SIDE WALL RETURN GRILLE	8" x 6"	-	0-200	ALUMINUM	2,4

NOTES:

- 4-WAY UNLESS SHOWN DIFFERENT.
- PROVIDE BALANCING DAMPER AT RUNOUT TAKEOFF UNLESS DAMPER IS LOCATED OVER AN INACCESSIBLE CEILING. IF OVER INACCESSIBLE PROVIDE REMOTE CABLE DRIVEN DAMPER.
- SUPPLY DIFFUSER SHALL BE INSTALLED TO ALLOW FOR INTERNAL CLEANING.
- PROVIDE APPROPRIATE INSTALLATION TRIM KIT BASED ON THE CEILING/WALL TYPE THAT THE AIR DEVICE IS BEING INSTALLED ON.
- PROVIDE WITH EQUALIZATION BAFFLE
- EXTERNALLY INSULATE SLOT DIFFUSER PLENUMS.
- FACTORY EXTERNALLY INSULATE ALL DIFFUSERS. NO LINERS.

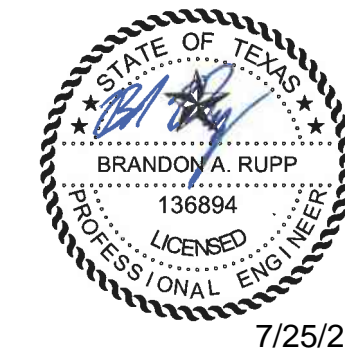

7/25/2022

DX SPLIT SYSTEM (HEAT PUMP) SCHEDULE

TAG	MANUFACTURER/ MODEL	TYPE	AREA SERVED	FAN COIL						CONDENSING UNIT						
				FAN		COOLING COIL				TAG	MANUFACTURER/ MODEL	AMBIENT TEMP. (°F)	VOLTS/PH/HZ	MOP/MCA/FLA	OPERATING WEIGHT (LBS)	NOTES
				TOTAL AIRFLOW (CFM)	OUTSIDE AIRFLOW (CFM)	TOTAL COOLING (MBH)	SENSIBLE COOLING (MBH)	AIR ENT. COIL, DB/WB (° F)	AIR LVG COIL, DB/WB (° F)							
FCU-2-1	LG - LSN180HSV5	WALL MOUNTED	ELECTRICAL - 280	700	0	21.4	16.7	77/64	55/54	CU-2-1	LG - LSU180HSV5	100	208/1/60	20/13/9.9	120	1,2,3,4
FCU-2-2	LG - LSN180HSV5	WALL MOUNTED	ELECTRICAL - 281	700	0	21.4	16.7	77/64	55/54	CU-2-2	LG - LSU180HSV5	100	208/1/60	20/13/9.9	120	1,2,3,4
FCU-2-3	LG - LDN097HV4	HORIZONTAL DUCTED	ELEVATOR MACHINE ROOM	200	0	7.7	5.4	80/67	55/54	CU-2-3	LG - LUU097HV	100	208/1/60	15/12/9.6	90	1,2,3,4
FCU-2-4	LG - LHN488HV	HORIZONTAL DUCTED	STAIR - ST1	1765	0	40.5	38.3	75/62	55/54	CU-2-4	LG - LUU480HHV	100	208/1/60	40/32/25.6	210	1,2,3,4
FCU-2-5	LG - LDN097HV4	HORIZONTAL DUCTED	ELEVATOR MACHINE ROOM	200	0	7.7	5.4	80/67	55/54	CU-2-5	LG - LUU097HV	100	208/1/60	15/12/9.6	90	1,2,3,4
FCU-2-6	LG - LSN180HSV5	WALL MOUNTED	STAIR - ST2	700	0	16.1	15.2	75/62	55/54	CU-2-6	LG - LSU180HSV5	100	208/1/60	20/13/9.9	120	1,2,3,4
FCU-2-7	LG - LSN180HSV5	WALL MOUNTED	IT - 230	700	0	16.1	15.2	75/62	55/54	CU-2-7	LG - LSU180HSV5	100	208/1/60	20/13/9.9	120	1,2,3,4
FCU-2-8	LG - LDN127HV4	HORIZONTAL DUCTED	ELEVATOR NO. 3	300	0	11.5	9.6	80/67	55/54	CU-2-8	LG - LUU127HV	100	208/1/60	15/12.3/10.1	90	1,2,3,4,5

NOTES:
 1. PROVIDE WITH SINGLE POINT ELEC CONNECTION THAT INCLUDES INTERNAL FUSING AND CONTACTORS FOR STARTERS FOR MOTORS.
 2. PROVIDE WITH CONCEALED CONDENSATE PUMP.
 3. PROVIDE WITH FACTORY DISCONNECT.
 4. CONNECT BACK TO B.A.S.
 5. PROVIDE TEMPERATURE SENSOR IN RETURN AIR DUCT.

FAN SCHEDULE

TAG	SERVICE	FAN TYPE	AIRFLOW (CFM)	ESP	DRIVE	MOTOR HP	VOLTAGE/PH/HZ	MANUFACTURER/MODEL	NOTES
EF-2-1	EXHAUST	ROOF UPBLAST	1910	1.0	DIRECT	3/4	115/1/60	GREENHECK CUE-140-VG	1,2,3,4,5,6
EF-2-2	EXHAUST	ROOF DOWNBLAST	630	0.6	DIRECT	1/6	115/1/60	GREENHECK G-095-VG	1,3,4,5,6
EF-2-3	EXHAUST	ROOF UPBLAST	155	0.3	DIRECT	1/10	115/1/60	GREENHECK CUE-080-VG	1,3,4,5,6
EF-2-4	EXHAUST	CENTRIFUGAL FUME EXHAUST FAN	365	0.5	DIRECT	1	460/3/60	GREENHECK FJI-10-BI-100	1,-4,7-12
EF-2-5	EXHAUST	ROOF DOWNBLAST	520	0.5	DIRECT	1/10	115/1/60	GREENHECK G-090-VG	1,3,4,5,6

NOTES:
 1. PROVIDE WITH FACTORY DISCONNECT.
 2. FAN SHALL BE CONTROLLED BY ROOM PRESSURE MONITOR.
 3. FAN SHALL RUN CONTINUOUSLY (24/7/365).
 4. CONNECT FAN BACK TO B.A.S.
 5. PROVIDE WITH GREENHECK VARI-GREEN (HAND/OFF/AUTO) CONTROLLER.
 6. PROVIDE WITH MOTORIZED DAMPER.
 7. PROVIDE WITH RESTRAINED ISOLATORS AND GESS EQUIPMENT SUPPORTS.
 8. PROVIDE WITH FACTORY VFD WITH MOUNTING BRACKET AND DISCONNECT HOUSED IN NEMA TYPE 3R RATED ENCLOSURE SUITABLE FOR MOUNTING ON ROOF.
 9. PROVIDE WITH FIXED NOZZLE DISCHARGE.
 10. PROVIDE WITH 10 FOOT VERTICAL STACK.
 11. PROVIDE WITH HORIZONTAL CONNECTION TO FAN INLET.
 12. FAN SHALL BE CIRCUITED TO EMERGENCY POWER.

HUMIDIFIER SCHEDULE

TAG	MANUFACTURER/ MODEL	UNIT SERVED	TYPE	DUCT SIZE	SUPPLY AIRFLOW RATE (CFM)	HUMIDIFICATION RATE (LB/HR)	WATER TYPE	CYLINDER QUANTITY	ELECTRICAL		NOTES
									TOTAL INPUT POWER (KW)	VOLTS/PH/HZ	
HUM-2-1	CONDAIR EL 100	RTU-2-1	ELECTRODE STEAM	62" x 22"	14180	75.7	TAP	1	37.4	480/3/60	ALL

NOTES:
 1. PROVIDE DUCT MOUNTED STEAM DISTRIBUTOR, STEAM AND CONDENSATE PIPING, MOUNTING ACCESSORIES INCLUDING MOUNTED PLATES FOR RIGID SUPPORT OF DUCT MOUNTED DISTRIBUTOR.
 2. PROVIDE WITH CONDENSATE RETURN PUMP AS REQUIRED.
 3. PROVIDE ELECTRIC CONTROLS - ON/OFF AIR FLOW PROVING SWITCH, DUCT MOUNTED HIGH LIMIT SENSOR, & ROOM HUMIDITY SENSOR. B.A.S. SHALL CONTROL WHEN UNIT TURNS ON. COORDINATE WORK WITH B.A.S. CONTRACTOR.
 4. INSTALL IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATION.
 5. VERIFY ABSORPTION DISTANCE TO BE WITHIN MANUFACTURER'S RECOMMENDATION BEFORE INSTALLING HUMIDIFIER AND DISTRIBUTOR.

SINGLE DUCT AIR TERMINAL UNIT SCHEDULE

TAG	SYSTEM	INLET SIZE	AIRFLOW		ELECTRIC HEATING COIL					MANUFACTURER AND MODEL	NOTES
			MAX CFM	MIN CFM	EAT (°F)	LAT (°F)	KW	STAGES	VOLTAGE/PHASE		
VAV-2-1	RTU-2-1	14" Ø	2070	2070	55	75	13.5	SCR	460/3	TITUS DESV	1,2,3
VAV-2-2	RTU-2-1	14" Ø	2020	2020	55	75	13	SCR	460/3	TITUS DESV	1,2,3
VAV-2-3	RTU-2-1	14" Ø	2015	2015	55	75	13	SCR	460/3	TITUS DESV	1,2,3
VAV-2-4	RTU-2-1	14" Ø	1790	1790	55	75	11.5	SCR	460/3	TITUS DESV	1,2,3
VAV-2-5	RTU-2-1	8" Ø	410	325	55	75	3	SCR	277/1	TITUS DESV	1,2,3
VAV-2-6	RTU-2-1	8" Ø	570	525	55	75	4	SCR	277/1	TITUS DESV	1,2,3
VAV-2-7	RTU-2-1	12" Ø	1170	1170	55	75	7.5	SCR	460/3	TITUS DESV	1,2,3
VAV-2-8	RTU-2-1	10" Ø	710	710	55	75	5	SCR	460/3	TITUS DESV	1,2,3
VAV-2-9	RTU-2-1	6" Ø	370	195	55	75	2.5	SCR	277/1	TITUS DESV	1,2,3
VAV-2-10	RTU-2-1	10" Ø	705	140	55	85	7	SCR	460/3	TITUS DESV	1,2,3
VAV-2-11	RTU-2-1	6" Ø	210	210	55	75	1.5	SCR	277/1	TITUS DESV	1,2,3
VAV-2-12	RTU-2-2	10" Ø	720	500	55	75	5	SCR	277/1	TITUS DESV	1,2,3
VAV-2-13	RTU-2-2	10" Ø	910	220	55	85	9	SCR	460/3	TITUS DESV	1,2,3
VAV-2-14	RTU-2-2	10" Ø	835	735	55	75	5.5	SCR	460/3	TITUS DESV	1,2,3
VAV-2-15	RTU-2-2	6" Ø	320	250	55	85	3.5	SCR	277/1	TITUS DESV	1,2,3
VAV-2-16	RTU-2-2	6" Ø	210	210	55	85	2.5	SCR	277/1	TITUS DESV	1,2,3
VAV-2-17	RTU-2-2	8" Ø	405	250	55	75	3	SCR	277/1	TITUS DESV	1,2,3
VAV-2-18	RTU-2-2	10" Ø	720	420	55	85	7	SCR	460/3	TITUS DESV	1,2,3
RVAV-2-1	RTU-2-1	14" Ø	1870	1870	-	-	-	-	-	TITUS DECV	1,2,3
RVAV-2-2	RTU-2-1	14" Ø	1820	1820	-	-	-	-	-	TITUS DECV	1,2,3
RVAV-2-3	RTU-2-1	14" Ø	1815	1815	-	-	-	-	-	TITUS DECV	1,2,3
RVAV-2-4	RTU-2-1	14" Ø	1590	1590	-	-	-	-	-	TITUS DECV	1,2,3
RVAV-2-5	RTU-2-1	10" Ø	785	785	-	-	-	-	-	TITUS DECV	1,2,3
RVAV-2-6	RTU-2-1	8" Ø	390	390	-	-	-	-	-	TITUS DECV	1,2,3
RVAV-2-7	RTU-2-1	10" Ø	790	790	-	-	-	-	-	TITUS DECV	1,2,3
RVAV-2-8	RTU-2-1	10" Ø	500	500	-	-	-	-	-	TITUS DECV	1,2,3
RVAV-F	RTU-2-1	14" Ø	2190	440	-	-	-	-	-	TITUS DECV	1,2,3
VAV-F	RTU-2-1	14" Ø	2190	440	55	75	14	SCR	460/3	TITUS DESV	1,2,3

NOTES:
 1. PROVIDE INTEGRAL DISCONNECT SWITCH (DOOR INTERLOCK TYPE). COORDINATE WITH ELECTRICAL CONTRACTOR.
 2. PROVIDE 24 VOLT CONTROL TRANSFORMER. COORDINATE DDC CONTROLS WITH CONTROLS CONTRACTOR PRIOR TO PURCHASE.
 3. UNIT SHALL BE DOUBLE-WALLED.

ELECTRIC UNIT HEATER SCHEDULE

TAG	AREA SERVED	AIRFLOW (CFM)	HEATING OUTPUT (KW)	VOLTS/PH/HZ	MANUFACTURER/MODEL	NOTES
EUH-2-1	FUTURE OFFICE	310	5.0	480/3/60	REZNOR EGEB	1,2,3
EUH-2-2	FUTURE OFFICE	310	5.0	480/3/60	REZNOR EGEB	1,2,3

NOTES:
 1. PROVIDE WITH SINGLE STAGE WALL THERMOSTAT.
 2. PROVIDE CEILING BRACKET FOR HORIZONTAL DISCHARGE.
 3. PROVIDE WITH FACTORY DISCONNECT.