MAINTENANCE CATWALK. COORDINATE EQU
WITH MAINTENANCE CATWALK INSTALLATIO
ACCESSIBILITY OF ALL EQUIPMENT.

3 COORDINATE DISHWASHER EXHAUST DUCT
SLOPE EXHAUST DUCT 1/4" PER FOOT TOW
DISHWASHER HOOD. PROVIDE TRANSITION
TO RIGIDLY CONNECT TO EXHAUST FAN.

4 PROVIDE FIELD FABRICATED PLENUM BOX
NECESSARY TO ACCOMMODATE DIFFERING
HEIGHTS OR OBSTRUCTIONS. COORDINATE
AND ARCHITECTURAL RCP.

5 MOUNT FCU-1 18'-0" A.F.F.

6 MOUNT FCU-3 15'-10" A.F.F.

7 MOUNT FCU-4 18'-0" A.F.F.

8 MOUNT FCU-5 14'-1" A.F.F.

9 MOUNT FCU-6 18'-0" A.F.F.

10 MOUNT FCU-7 16'-8" A.F.F.

11 MOUNT FCU-8 18'-0" A.F.F.

12 FIELD ADJUST LINEAR SLOT AIR DEFLECTIO
THROW DIRECTION SHOWN BY ARROWS.

13 WHERE CABLE OPERATED DAMPER ACTUAT
NEEDED, LINEAR SLOT SHALL BE LONG ENO
ACCOMMODATE REMOTE OPERATOR ACCE
SLOT LENGTH WILL NOT MATCH PLENUM BO
CEILING CUPS SHALL BE ALLOWED.

14 WALL MOUNT LINEAR SLOTS IN SOFFIT 13' A
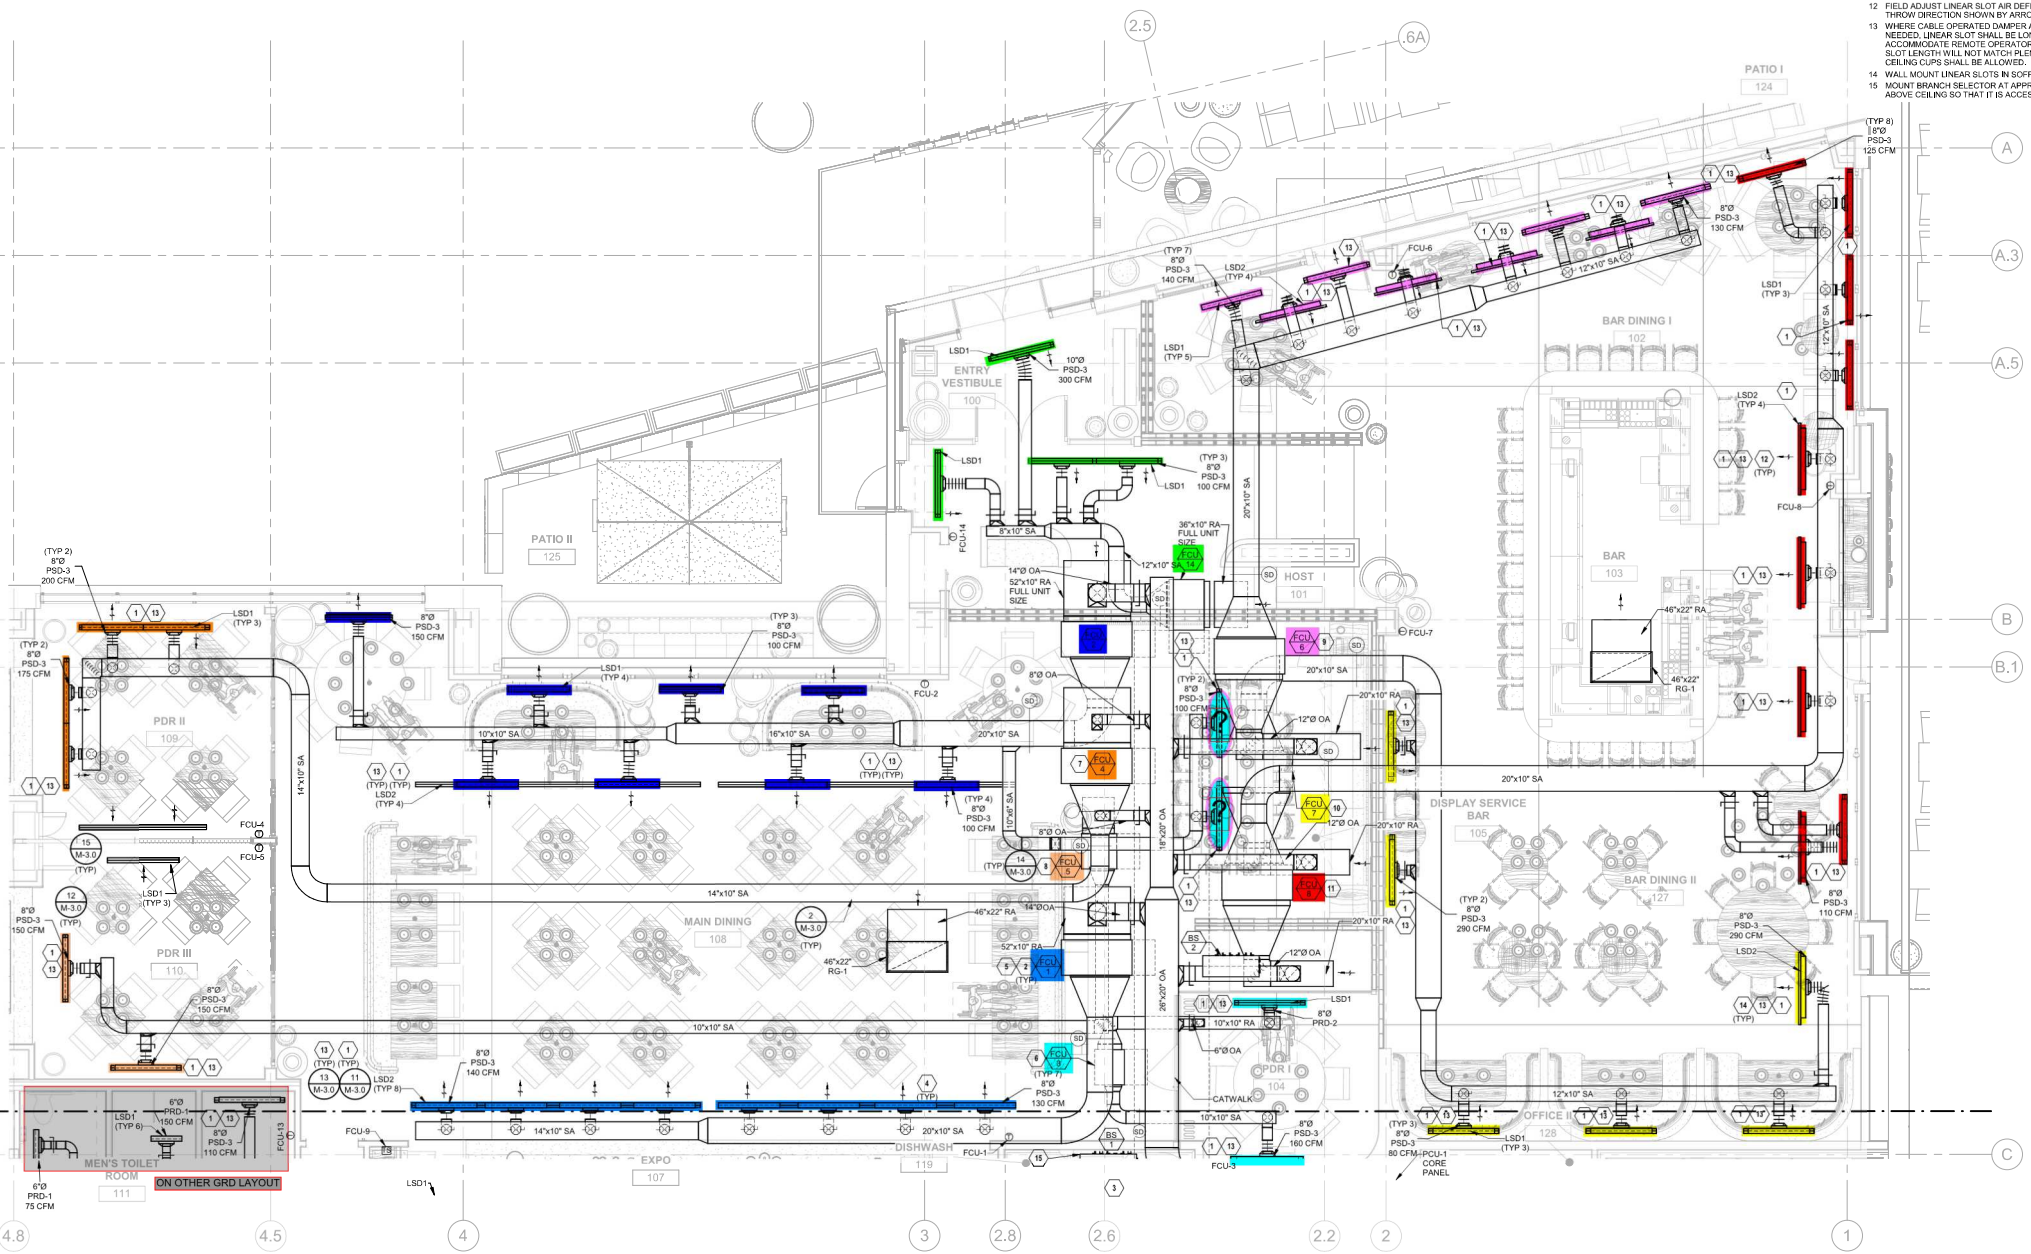
15 MOUNT BRANCH SELECTOR AT APPROXIMA
ABOVE CEILING SO THAT IT IS ACCESSIBLE