

# MECHANICAL SHEET INDEX

M001	MECHANICAL GENERAL INFORMATION
M101	MECHANICAL FLOOR PLAN
M150	MECHANICAL ROOF PLAN
M501	MECHANICAL DETAILS
M590	MECHANICAL SPECIFICATIONS
M591	MECHANICAL SPECIFICATIONS
M592	MECHANICAL SPECIFICATIONS
M601	MECHANICAL SCHEDULES
M630	MECHANICAL ENERGY CODE COMPLIANCE
M631	MECHANICAL ENERGY CODE COMPLIANCE
M701	CAPTIVE AIR DRAWINGS
M702	CAPTIVE AIR DRAWINGS
M703	CAPTIVE AIR DRAWINGS
M704	CAPTIVE AIR DRAWINGS
M705	CAPTIVE AIR DRAWINGS
M706	CAPTIVE AIR DRAWINGS
M707	CAPTIVE AIR DRAWINGS
M708	CAPTIVE AIR DRAWINGS
M709	CAPTIVE AIR DRAWINGS
M710	CAPTIVE AIR DRAWINGS

## RESPONSIBILITY MATRIX

DESCRIPTION	FURNISHED			INSTALLED			REMARKS
	GC	OWNER	LL	GC	OWNER	LL	
<b>DIVISION 23: HEATING, VENTILATING, AND AIR CONDITIONING</b>							
<b>23.1 HVAC DUCTWORK AND PIPING IDENTIFICATION</b>							
HVAC DUCTWORK SYSTEM IDENTIFICATION	•			•			
PIPING SYSTEM IDENTIFICATION	•			•			
UTILITY SHUT OFF IDENTIFICATION IN KITCHEN	•			•			
VALVE TAGS AND CHART	•			•			
HVAC DAMPER IDENTIFICATION	•			•			
<b>23.2 ROOF CURBS</b>							
EXHAUST FAN CURBS	•			•			
ROOFTOP UNIT CURBS	•			•			
CONDENSING UNIT CURBS	•			•			
KITCHEN EXHAUST FAN CURBS	•			•			
<b>23.3 HVAC DUCTWORK SYSTEM COMPONENTS</b>							
HVAC DUCTWORK	•			•			
GREASE DUCTWORK	•			•			
OUTSIDE AIR DUCTWORK	•			•			
SUPPLY AND RETURN AIR DUCTWORK	•			•			
RESTROOM EXHAUST AIR DUCTWORK	•			•			
INSULATION AND FIRE WRAP	•			•			
DAMPERS	•			•			
SMOKE DETECTORS	•			•			
SUPPLY, RETURN, AND EXHAUST GRILLS AND REGISTERS	•			•			
<b>23.4 MECHANICAL PIPING SYSTEM COMPONENTS</b>							
WALK-IN COOLER AND FREEZER CONDENSER REFRIGERANT LINE SETS	•			•			A
REFRIGERANT PIPING FOR HVAC EQUIPMENT	•			•			
VALVES AND ACCESSORIES (E.G. AIR VENTS)	•			•			
<b>23.5 HVAC EQUIPMENT</b>							
RESTROOM EXHAUST FAN	•			•			
KITCHEN EXHAUST FAN WITH CURB EXTENSION	•			•			
DUCTED AND NON-DUCTED HEATING AND COOLING UNITS	•			•			
WALK-IN COOLER AND FREEZER CONDENSING UNITS	•			•			A
<b>23.6 KITCHEN EXHAUST WITH FIRE SUPPRESSION SYSTEM</b>							
HOOD CONTROL PANEL	•			•			
REMOTE HOOD SWITCHES IN OFFICE	•			•			
KITCHEN EXHAUST HOOD	•			•			
STRUCTURAL SUPPORT	•			•			
ELECTRICAL AND CONTROL WIRING	•			•			
TANK SYSTEM	•			•			B
TANK SYSTEM WIRING AND UTILITIES CONNECTION	•			•			
TANK SYSTEM GAS VALVE	•			•			
PULL STATION	•			•			
<b>23.7 MECHANICAL SAFETY SENSORS</b>							
CO2 MONITOR	•			•			
<b>23.8 COMMISSIONING ACTIVITIES</b>							
GREASE EXHAUST WATER LEAKAGE TEST	•			•			
TEST AND BALANCE (TAB) REPORT	•			•			
GENERAL NOTES:							
1. INFORMATION CONTAINED WITHIN IS BASED ON OUR INTERPRETATION OF THE FINAL EXECUTED WORK LETTER.							
2. CONTRACTOR TO CONFIRM ALL SCOPE WITH FINAL WORK LETTER PRIOR TO PROCUREMENT OF EQUIPMENT.							
REMARKS:							
A. WALK-IN COOLER AND FREEZER CONDENSING UNITS FURNISHED AND INSTALLED BY OWNER VENDOR.							
B. GENERAL CONTRACTOR TO COORDINATE TANK INSTALLATION TIME WITH OWNER VENDOR AND FACILITATE SYSTEM SIGN-OFF.							

## SUBMITTAL MATRIX

SUBMITTAL DESCRIPTION	Required Review Time (Business Days)	Architect of Record	Shake Shack	Physical Sample Required	Submittal for Record	Submittal for Record Only
Diffusers, Grills & Registers	5	X				
Ductwork Layout (if there are significant changes in field)	5	X			X	
HVAC Equipment (if Captive Air - Submitted by Owner Vendor directly to Owner/AOR prior to construction)	5	X			X	
MFP Tests, Start-Up, and Programming Reports	5	X			X	

## GENERAL NEW NOTES:

- PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE PROJECT. REVIEW THE GENERAL NOTES, SPECIFICATIONS AND OTHER DRAWINGS FOR ADDITIONAL REQUIREMENTS WHICH MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT, ENGINEER AND/OR OWNER OF CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID.
- COORDINATE THE INSTALLATION OF THE MECHANICAL SYSTEMS WITH OTHER TRADES TO ENSURE A NEAT AND ORDERLY INSTALLATION. INSTALL DUCTWORK AND PIPING TIGHT TO STRUCTURE AS POSSIBLE. COORDINATE WITH OTHER TRADES TO AVOID CONFLICTS. COORDINATE INSTALLATION OF DUCTWORK AND PIPING TO AVOID CONFLICTS WITH ELECTRICAL PANELS, LIGHTING FIXTURES, ETC. ANY MODIFICATIONS REQUIRED DUE TO LACK OF COORDINATION WILL BE THE RESPONSIBILITY OF THE CONTRACTOR AT NO EXTRA COST TO THE OWNER.
- WHERE SHUTDOWN OF EXISTING SYSTEMS IS REQUIRED DURING NEW WORK, COORDINATE SHUTDOWN TIME AND DURATION WITH THE OWNER TO MINIMIZE DOWNTIME. NOTIFY OWNER SEVEN (7) DAYS PRIOR TO INTERRUPTION OF SERVICE.
- PROVIDE TEMPORARY BARRIERS TO CONTAIN DUST AND DEBRIS RESULTING FROM THE PERFORMANCE OF THE WORK TO THE AREAS WHERE WORK IS BEING PERFORMED.
- ALL MECHANICAL EQUIPMENT SHOWN ON THE MECHANICAL PLANS SHALL BE PROVIDED BY DIVISION 23 UNLESS OTHERWISE NOTED.
- NEW MECHANICAL EQUIPMENT, DUCTWORK AND PIPING ARE SHOWN AT APPROXIMATE LOCATIONS. FIELD MEASURE FINAL DUCTWORK AND PIPING LOCATIONS PRIOR TO FABRICATION AND MAKE ADJUSTMENTS AS REQUIRED TO FIT THE DUCTWORK AND PIPING WITHIN THE AVAILABLE SPACE. VERIFY THAT FINAL EQUIPMENT LOCATIONS MEET MANUFACTURER'S RECOMMENDATIONS REGARDING SERVICE CLEARANCE AND PROPER AIRFLOW CLEARANCE AROUND EQUIPMENT.
- REFER TO ARCHITECTURAL DRAWINGS FOR RELATED CONSTRUCTION DETAILS AS APPLICABLE TO THE HVAC SYSTEM. VERIFY CHASES AND PENETRATIONS SHOWN ON ARCHITECTURAL DRAWINGS THAT ARE INTENDED FOR DUCTWORK AND PIPING MEET REQUIREMENTS.
- COORDINATE LOCATION OF ROOF MOUNTED HVAC EQUIPMENT AND ROOF PENETRATIONS WITH THE ARCHITECTURAL AND STRUCTURAL DRAWINGS.
- INDOOR AIR QUALITY MEASURES. PROTECT INSIDE OF (INSTALLED AND DELIVERED) DUCTWORK AND HVAC UNITS FROM EXPOSURE TO DUST, DIRT, PAINT AND MOISTURE. REPLACE INSULATION THAT HAS BECOME WET AT ANY TIME DURING CONSTRUCTION. DRYING THE INSULATION IS NOT ACCEPTABLE. SEAL ANY TEARS OR JOINTS OF INTERNAL FIBERGLASS INSULATION. REMOVE DEBRIS FROM CEILING/RETURN AIR PLENUM INCLUDING DUST. AN INDEPENDENT PROFESSIONAL DUCT CLEANING COMPANY SHALL VACUUM CLEAN ANY DUCTWORK CONNECTED TO HVAC UNITS THAT WERE OPERATED DURING THE CONSTRUCTION PERIOD AFTER NEW FILTERS ARE INSTALLED AND PRIOR TO TURNING SYSTEM OVER TO THE OWNER. THE INTERNAL SURFACES AND ASSOCIATED COILS OF ANY HVAC UNITS THAT WERE OPERATED SHALL ALSO BE CLEANED.
- INSTALL DUCTWORK AND PIPING PARALLEL TO BUILDING COLUMN LINES UNLESS OTHERWISE SHOWN OR NOTED.
- OVERHEAD HANGERS AND SUPPORTS FOR EQUIPMENT, DUCTWORK AND PIPING SHALL BE FASTENED TO BUILDING JOISTS OR BEAMS. DO NOT ATTACH HANGERS AND SUPPORTS TO THE ABOVE FLOOR SLAB OR ROOF STRUCTURE WHERE CONCRETE INSERTS IN CONCRETE SLABS ARE ALLOWED BY THE SPECIFICATIONS.
- COORDINATE LOCATION OF EQUIPMENT SUPPORTS WITH LOCATION OF EQUIPMENT ACCESS PANELS/DOORS TO ENABLE SERVICE OF EQUIPMENT AND/OR FILTER REPLACEMENT.
- SEAL PENETRATIONS THROUGH THE BUILDING COMPONENTS IN ACCORDANCE WITH THE CONTRACT SPECIFICATIONS. FIREPROOF PENETRATIONS THROUGH FIRE RATED COMPONENTS IN ACCORDANCE WITH UL REQUIREMENTS.
- COORDINATE THE EXACT MOUNTING SIZE AND FRAME TYPE OF DIFFUSERS, REGISTERS AND GRILLES WITH THE SUPPLIER TO MEET THE CEILING, WALL AND DUCT INSTALLATION REQUIREMENTS.
- ADJUST LOCATION OF CEILING DIFFUSERS, REGISTERS AND GRILLES AS REQUIRED TO ACCOMMODATE FINAL CEILING GRID AND LIGHTING LOCATIONS.
- PAINT PORTIONS OF DUCTWORK AND INSULATION THAT ARE EXPOSED TO VIEW BY THE INSTALLATION OF DIFFUSERS, REGISTERS, AND GRILLES IN CEILINGS OR WALLS FLAT BLACK. PORTIONS INCLUDE BOTH THE INTERIOR OF UNLINED DUCTWORK AND THE EXTERIOR OF DUCTWORK AND INSULATION.
- LOCATE AND SET THERMOSTATS AND HUMIDISTATS AT LOCATIONS SHOWN ON PLANS. VERIFY EXACT LOCATIONS WITH ARCHITECT PRIOR TO INSTALLATION. INSTALL DEVICES WITH TOP OF DEVICE AT MAXIMUM 48" AFF TO MEET ADA REQUIREMENTS UNLESS NOTED OTHERWISE ON PLANS. PROVIDE INSULATED BACKINGS FOR THERMOSTATS MOUNTED ON EXTERIOR BUILDING WALLS. INSTALL WIRING IN CONDUIT PROVIDED BY DIVISION 26. AT A MINIMUM, PROVIDE CONDUIT IN THE WALL FROM THE JUNCTION BOX TO 6" ABOVE THE CEILING.
- COORDINATE THE LOCATION AND ELEVATION OF WALL MOUNTED DEVICES WITH PRESENTATION BOARDS, DISPLAY CABINETS, SHIELDS OR OTHER COMPONENTS SHOWN ON THE ARCHITECTURAL DRAWINGS THAT ARE TO BE INSTALLED UNDER OTHER DIVISIONS. CONTRACTOR WILL NOT BE REIMBURSED FOR RELOCATION OF WALL-MOUNTED DEVICES CAUSED BY A LACK OF COORDINATION.
- PROVIDE A MANUAL BALANCING DAMPER IN EACH DUCT TAKEOFF FROM SUPPLY, RETURN, OUTDOOR AND EXHAUST AIR DUCTS.
- PROVIDE A PREFABRICATED 45 DEGREE, HIGH EFFICIENCY, RECTANGULAR/ROUND BRANCH DUCT TAKEOFF FITTING FOR BRANCH DUCT CONNECTIONS AND TAKE-OFFS TO INDIVIDUAL DIFFUSERS, REGISTERS AND GRILLES. PROVIDE WITH INTEGRAL MANUAL BALANCING DAMPER AND LOCKING QUADRANT WHERE INDICATED ON PLANS.
- BRANCH DUCTWORK TO AIR OUTLETS SHALL BE SAME SIZE AS OUTLET NECK SIZE UNLESS OTHERWISE NOTED.
- REFER TO SPECIFICATIONS FOR DUCTWORK AND PIPING INSULATION REQUIREMENTS. DUCT SIZES ON MECHANICAL PLANS INDICATE CLEAR INSIDE AIRFLOW DIMENSIONS. INCREASE SHEET METAL SIZES ACCORDINGLY TO ACCOUNT FOR THICKNESS OF DUCT LINER.
- FLEXIBLE DUCTWORK SHALL NOT EXCEED 50' IN LENGTH AND SHALL BE INSTALLED AND SUPPORTED TO AVOID SHARP BENDS AND SAGGING. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- PROVIDE EQUIPMENT VENTS AND FLUES PER EQUIPMENT MANUFACTURERS RECOMMENDATIONS AND EQUIPMENT SPECIFICATIONS. KEEP PENETRATIONS THROUGH ROOF A MINIMUM OF 10'-0" FROM HVAC EQUIPMENT FRESH AIR INLETS AND 2'-0" FROM ROOF PARAPETS.
- PROVIDE TYPE I GREASE HOOD EXHAUST DUCTWORK OF MINIMUM 16 GAUGE BLACK IRON WITH LIQUID TIGHT WELDS, WITH ACCESS PANELS FOR GREASE CLEANING AS REQUIRED BY NFPA 98 AND LOCAL CODES. SLOPE DUCT BACK TOWARDS HOOD AT MINIMUM OF 1/4" PER LINEAL FOOT MAINTAINING 18" CLEARANCE TO COMBUSTIBLE MATERIALS. INSTALL GREASE DUCTS IN AN APPROVED FIRE-RATED ENCLOSURE SEPARATED FROM THE EXHAUST DUCT BY A MINIMUM OF 6" AND MAXIMUM OF 12". VENTILATE ENCLOSURE TO THE OUTSIDE AIR IF REQUIRED BY CODE. AS AN OPTION, IF APPROVED BY LOCAL CODES, PROVIDE AN APPROVED WRAP SYSTEM IN LIEU OF THE RATED DUCT ENCLOSURE SYSTEM. DUCT WRAP SYSTEM SHALL MEET UL REQUIREMENTS FOR GREASE DUCT ENCLOSURES.
- PROVIDE A NEW SET OF AIR FILTERS IN UNITS PRIOR TO TESTING, ADJUSTING AND BALANCING AND BEFORE TURNING SYSTEM(S) OVER TO OWNER.
- TEMPORARY INSTALLATIONS OF INFECTION CONTROL MEASURES DURING CONSTRUCTION SHALL BE COORDINATED WITH THE FACILITY'S INFECTION CONTROL STAFF. PRIOR TO CONSTRUCTION PROVIDE ALL REQUIRED TEMPORARY INSTALLATIONS, INCLUDING DETAILS OF THE INFECTION CONTROL MEASURES SUCH AS TEMPORARY BARRIERS AND MEMBRANES, PORTABLE EXHAUST FANS AND TEMPORARY DUCTWORK. TEMPORARY INSTALLATIONS MUST NOT HAVE A NEGATIVE IMPACT ON EXISTING SYSTEMS NOR CAUSE UNSAFE CONDITIONS. TEMPORARY INSTALLATIONS SHALL MAINTAIN ADEQUATE EGRESS AND SHALL NOT OBSTRUCT EXISTING EXITS. CREATE A FIRE HAZARD OR REDUCE REQUIRED FIRE RESISTANCE. TEMPORARY VENTILATION SYSTEMS SHALL NOT CAUSE THE AIR BALANCE OF ADJACENT ROOMS OR SPACES TO BE IMPACTED OR ALTER THE PERFORMANCE OF PERMANENT BUILDING VENTILATION SYSTEMS. AIRFLOW MEASUREMENTS SHALL BE TAKEN TO VERIFY ADJACENT ROOMS OR SPACES ARE NOT IMPACTED.

## MECHANICAL SYMBOLS

STANDARD MOUNTING HEIGHT		HVAC DUCTWORK AND ACCESSORIES		PIPING SYMBOLS																																																																																																																																																																																																																																																																																	
<p>48"</p> <p>48"</p>	<p>THERMOSTATS (USER ADJUSTABLE/TOP OF DEVICE)</p> <p>CONTROLS (TOP OF DEVICE)</p>		LINEAR SLOT DIFFUSER		DIRECTION OF FLOW																																																																																																																																																																																																																																																																																
<p>INSTALL DEVICES AT THE MOUNTING HEIGHTS SHOWN ABOVE UNO IN THE CONSTRUCTION DOCUMENTS. MOUNTING HEIGHTS LISTED ABOVE OR ELSEWHERE IN THE CONSTRUCTION DOCUMENTS ARE AFF TO BOTTOM OF DEVICE UNO. ALL DEVICES SHALL BE INSTALLED IN COMPLIANCE WITH CURRENT ADA AND LOCAL REQUIREMENTS.</p>	<p>INSULATED FLEXIBLE DUCT (MAX. 5'-0" LONG)</p> <p>BRANCH DUCT WITH 45° RECTANGLE-ROUND BRANCH FITTING AND MANUAL VOLUME DAMPER</p> <p>ELBOW WITH TURNING VANES</p> <p>BRANCH DUCT WITH BELL-MOUTH FITTING &amp; MANUAL VOLUME CONTROL DAMPER</p> <p>RETURN, EXHAUST, OR OUTSIDE AIR DUCT UP</p> <p>RETURN, EXHAUST, OR OUTSIDE AIR DUCT DOWN</p> <p>SUPPLY AIR DUCT UP</p> <p>SUPPLY AIR DUCT DOWN</p> <p>EQUIPMENT WITH FLEXIBLE DUCT CONNECTION</p>		<p>16" (NECK SIZE) CSD-1 (TYPE) 300 CFM (CFM OF SUPPLY DIFFUSER OR REGISTER)</p> <p>24x24 (NECK SIZE) CEG-1 (TYPE) 600 CFM (CFM OF EXHAUST GRILLE)</p> <p>MANUAL VOLUME DAMPER</p> <p>SQUARE TO ROUND TRANSITION</p> <p>DUCT MOUNTED SMOKE DETECTOR (SD=SUPPLY/RD=RETURN)</p> <p>ROUND DUCT TAG INDICATING DIAMETER</p> <p>RECTANGULAR DUCT TAG INDICATING INTERNAL DUCT DIMENSIONS.</p> <p>FLAT OVAL DUCT TAG INDICATING INTERNAL DUCT DIMENSIONS</p> <p>RISER DESIGNATION</p> <p>FIRE DAMPER</p> <p>FIRE SMOKE DAMPER</p> <p>SMOKE DAMPER</p> <p>VOLUME DAMPER</p> <p>MOTORIZED DAMPER</p> <p>BACKDRAFT DAMPER</p>	<p>CONTROL VALVE</p> <p>THREE-WAY CONTROL VALVE</p> <p>SHUTOFF VALVE</p> <p>CHECK VALVE</p> <p>BALANCING VALVE WITH PRESSURE PORTS</p> <p>TRIPLE DUTY VALVE WITH PRESSURE PORTS</p> <p>STRAINER</p> <p>STRAINER WITH BLOWDOWN VALVE</p> <p>RELIEF / SAFETY VALVE</p> <p>SOLENOID VALVE</p> <p>PRESSURE REDUCING VALVE</p> <p>GAS PRESSURE REGULATOR</p> <p>THERMOSTATIC MIXING VALVE</p> <p>PIPE ANCHOR</p> <p>EXPANSION JOINT</p> <p>PIPE GUIDE</p> <p>PIPING SUPPORT</p> <p>F &amp; T TRAP</p> <p>BUCKET TRAP</p> <p>THERMOSTATIC TRAP</p> <p>BACKFLOW PREVENTER</p> <p>PRESSURE GAUGE</p> <p>THERMOMETER</p> <p>PRESSURE AND TEMPERATURE TEST PLUG</p> <p>UNION</p> <p>FLANGE CONNECTION</p> <p>VACUUM RELIEF VALVE</p> <p>AUTOMATIC AIR VENT</p> <p>MANUAL AIR VENT</p> <p>PRESSURE / VACUUM SWITCH</p> <p>CLEANOUT</p> <p>ELBOW UP</p> <p>ELBOW DOWN</p> <p>TEE UP</p> <p>TEE DOWN</p> <p>ELBOW UP WITH SHUT-OFF VALVE (SOV)</p> <p>ELBOW DOWN WITH SHUT-OFF VALVE (SOV)</p> <p>TEE UP WITH SHUT-OFF VALVE (SOV)</p> <p>TEE DOWN WITH SHUT-OFF VALVE (SOV)</p> <p>REDUCER</p> <p>RECIRCULATION PUMP</p> <p>P-TRAP</p> <p>GAS COCK</p> <p>TOP BEAM CLAMP</p> <p>TRAPEZE HANGER</p> <p>FLEXIBLE CONNECTION</p>																																																																																																																																																																																																																																																																																	
<p>MECHANICAL PLAN NOTE CALLOUT</p> <p>MECHANICAL EQUIPMENT DESIGNATION (CONTRACTOR FURNISHED AND INSTALLED UNLESS NOTED OTHERWISE)</p> <p>CONNECTION POINT OF NEW WORK TO EXISTING</p> <p>DETAIL REFERENCE. UPPER NUMBER INDICATES DETAIL NUMBER LOWER NUMBER INDICATES SHEET NUMBER</p> <p>SECTION CUT DESIGNATION</p>		<p>ALL DUCT DIMENSIONS SHOWN ON DRAWINGS ARE INSIDE DIMENSIONS. REFER TO DUCTWORK SPECIFICATIONS FOR DUCTWORK INSULATION AND LINER INFORMATION.</p> <p>HVAC CONTROL DEVICES</p> <p>HUMIDISTAT</p> <p>THERMOSTAT</p> <p>CARBON MONOXIDE SENSOR</p> <p>CARBON DIOXIDE SENSOR</p> <p>DIFFERENTIAL PRESSURE SENSOR</p> <p>FLOW SWITCH</p> <p>HUMIDITY SENSOR</p> <p>PULL STATION</p> <p>REMOTE TESTING STATION WITH INDICATING LIGHT</p> <p>STATIC PRESSURE</p> <p>SWITCH</p> <p>TEMPERATURE SENSOR</p>																																																																																																																																																																																																																																																																																			
<p>ABBREVIATIONS</p> <table border="1"> <tr><td>AC</td><td>AIR CONDITIONING</td><td>HWP</td><td>HEATING WATER PUMP</td></tr> <tr><td>ACC</td><td>AIR COOLED CHILLER</td><td>IN WC</td><td>INCHES OF WATER COLUMN</td></tr> <tr><td>ACCU</td><td>AIR COOLED CONDENSING UNIT</td><td>L</td><td>LEAVING AIR</td></tr> <tr><td>AF</td><td>ABOVE FINISHED CEILING</td><td>LAT</td><td>LEAVING AIR TEMPERATURE</td></tr> <tr><td>AFB</td><td>ABOVE FINISHED FLOOR</td><td>LD</td><td>LEAVING DRY BULB</td></tr> <tr><td>AFD</td><td>ABOVE FINISHED GRADE</td><td>LP</td><td>LOW PRESSURE</td></tr> <tr><td>AHJ</td><td>AUTHORITY HAVING JURISDICTION</td><td>LWB</td><td>LEAVING WET BULB</td></tr> <tr><td>AH</td><td>AIR HANDLING UNIT</td><td>MFR</td><td>MANUFACTURER</td></tr> <tr><td>AH</td><td>ANALOG INPUT</td><td>MIN</td><td>MINIMUM</td></tr> <tr><td>AO</td><td>ANALOG OUTPUT</td><td>MAU</td><td>MAKE-UP AIR UNIT</td></tr> <tr><td>AP</td><td>ACCESS PANEL</td><td>MAX</td><td>MAXIMUM</td></tr> <tr><td>APD</td><td>AIR PRESSURE DROP</td><td>MBH</td><td>1000 BTU PER HOUR</td></tr> <tr><td>AWG</td><td>AMERICAN WIRE GAUGE</td><td>MD</td><td>MOTORIZED DAMPER</td></tr> <tr><td>B</td><td>BUILDING AUTOMATION SYSTEM</td><td>MFR</td><td>MANUFACTURER</td></tr> <tr><td>BB</td><td>BACKBONE</td><td>N/A</td><td>NOT APPLICABLE</td></tr> <tr><td>BD</td><td>BACKDRAFT DAMPER</td><td>N/C</td><td>NORMALLY CLOSED</td></tr> <tr><td>BD</td><td>BLOWDOWN</td><td>NOM</td><td>NOMINAL</td></tr> <tr><td>BFC</td><td>BELOW FINISHED CEILING</td><td>NC</td><td>NOISE CRITERIA</td></tr> <tr><td>BFF</td><td>BELOW FINISHED FLOOR</td><td>NF</td><td>NON-FUSED</td></tr> <tr><td>BFG</td><td>BELOW FINISHED GRADE</td><td>NIC</td><td>NOT IN CONTRACT</td></tr> <tr><td>BFP</td><td>BOILER FEED PUMP</td><td>NOISE</td><td>NOISE CRITERIA</td></tr> <tr><td>BHP</td><td>BRAKE HORSEPOWER</td><td>PICV</td><td>PRESSURE INDEP. CONTROL VALVE</td></tr> <tr><td>BI</td><td>BINARY INPUT</td><td>PROVIDE</td><td>FURNISH AND INSTALL</td></tr> <tr><td>BO</td><td>BOTTOM OF DUCT</td><td>QTY</td><td>QUANTITY</td></tr> <tr><td>BOS</td><td>BOTTOM OF STRUCTURE</td><td>RA</td><td>RETURN AIR</td></tr> <tr><td>BTU</td><td>BRITISH THERMAL UNIT</td><td>RC</td><td>ROOM CRITERIA</td></tr> <tr><td>CFM</td><td>CUBIC FEET PER MINUTE</td><td>RD</td><td>RETURN DUCT</td></tr> <tr><td>CH</td><td>CHILLER</td><td>REA</td><td>RELIEF AIR</td></tr> <tr><td>CLG</td><td>COOLING</td><td>RF</td><td>RETURN FAN</td></tr> <tr><td>CO</td><td>CLEANOUT</td><td>RFR</td><td>REFRIGERANT</td></tr> <tr><td>CP</td><td>CONDENSATE PUMP</td><td>RH</td><td>RELATIVE HUMIDITY</td></tr> <tr><td>CPT</td><td>CONTROL POINT</td><td>RM</td><td>REVOLUTIONS PER MINUTE</td></tr> <tr><td>CRAC</td><td>COMPUTER ROOM AIR CONDITIONING UNIT</td><td>RTU</td><td>ROOFTOP UNIT</td></tr> <tr><td>CRU</td><td>COMPUTER ROOM UNIT</td><td>SA</td><td>SUPPLY AIR</td></tr> <tr><td>CT</td><td>COOLING TOWER</td><td>SCP</td><td>STEAM CONDENSATE PUMP</td></tr> <tr><td>CV</td><td>CONTROL VALVE</td><td>SD</td><td>SMOKE DETECTOR</td></tr> <tr><td>CWP</td><td>CONDENSER</td><td>SD</td><td>SUPPLY DUCT</td></tr> <tr><td>CU</td><td>WATER PUMP</td><td>SF</td><td>SUPPLY FAN</td></tr> <tr><td>CHWP</td><td>CHILLED WATER PUMP</td><td>SH</td><td>SCOPE OF WORK</td></tr> <tr><td>DB</td><td>DECIBELS</td><td>SP</td><td>STATIC PRESSURE</td></tr> <tr><td>DBA</td><td>DECIBEL AVERAGE</td><td>ST</td><td>STEAM TRAP</td></tr> <tr><td>DDC</td><td>DIRECT DIGITAL CONTROL</td><td>STM</td><td>STEAM</td></tr> <tr><td>DI</td><td>DIGITAL INPUT</td><td>TBD</td><td>TO BE DETERMINED</td></tr> <tr><td>DISC</td><td>DISCONNECT</td><td>TCIC</td><td>TEMPERATURE CONTROLS CONTRACTOR</td></tr> <tr><td>DN</td><td>DOWN</td><td>TC</td><td>TEMPERATURE CONTROL</td></tr> <tr><td>DX</td><td>DUCT SILENCER</td><td>TF</td><td>TRANSFER FAN</td></tr> <tr><td>(E)</td><td>EXISTING</td><td>TFA</td><td>TO FLOOR ABOVE</td></tr> <tr><td>EA</td><td>EXHAUST AIR</td><td>TFB</td><td>TO FLOOR BELOW</td></tr> <tr><td>EAT</td><td>ENTERING</td><td>TH</td><td>TOTAL HEAT CAPACITY</td></tr> <tr><td>EA</td><td>AIR TEMPERATURE</td><td>TSP</td><td>TOTAL STATIC PRESSURE</td></tr> <tr><td>ED</td><td>EXHAUST DUCT</td><td>TT</td><td>TEMPERATURE TRANSMITTAL</td></tr> <tr><td>EDB</td><td>ENTERING DRY BULB</td><td>TYP</td><td>TYPICAL</td></tr> <tr><td>EF</td><td>EXHAUST FAN</td><td>UF</td><td>UNDERFLOOR</td></tr> <tr><td>EFF</td><td>EFFICIENCY</td><td>UG</td><td>UNDERGROUND</td></tr> <tr><td>EMS</td><td>ENERGY MANAGEMENT SYSTEM</td><td>US</td><td>UNDERSLAB</td></tr> <tr><td>ESP</td><td>EXTERNAL STATIC PRESSURE</td><td>UH</td><td>UNIT HEATER</td></tr> <tr><td>ETR</td><td>EXISTING TO REMAIN</td><td>UNO</td><td>UNLESS NOTED OTHERWISE</td></tr> <tr><td>EWB</td><td>ENTERING WET BULB</td><td>VAV</td><td>VARIABLE AIR VOLUME</td></tr> <tr><td>EWT</td><td>ENTERING WATER</td><td>VEL</td><td>VELOCITY</td></tr> <tr><td>FCU</td><td>FAN COIL UNIT</td><td>VFD</td><td>VARIABLE FREQUENCY DRIVE</td></tr> <tr><td>FFA</td><td>FROM FLOOR ABOVE</td><td>VRF</td><td>VARIABLE REFRIGERANT FLOW</td></tr> <tr><td>FFB</td><td>FROM FLOOR BELOW</td><td>VRV</td><td>VARIABLE REFRIGERANT VOLUME</td></tr> <tr><td>FF</td><td>FINISHED FLOOR</td><td>W</td><td>WITH</td></tr> <tr><td>FPI</td><td>FINS PER INCH</td><td>WO</td><td>WITHOUT</td></tr> <tr><td>PFM</td><td>FEET PER MINUTE</td><td>WB</td><td>WET BULB</td></tr> <tr><td>GC</td><td>GENERAL CONTRACTOR</td><td>WC</td><td>WATER COLUMN</td></tr> <tr><td>GPM</td><td>GALLONS PER MINUTE</td><td>WPD</td><td>WATER PRESSURE DROP</td></tr> <tr><td>HP</td><td>HAND-OFF-AUTOMATIC HORSEPOWER</td><td>XP</td><td>EXPLOSION PROOF</td></tr> <tr><td>HTG</td><td>HEATING</td><td></td><td></td></tr> </table>		AC	AIR CONDITIONING	HWP	HEATING WATER PUMP	ACC	AIR COOLED CHILLER	IN WC	INCHES OF WATER COLUMN	ACCU	AIR COOLED CONDENSING UNIT	L	LEAVING AIR	AF	ABOVE FINISHED CEILING	LAT	LEAVING AIR TEMPERATURE	AFB	ABOVE FINISHED FLOOR	LD	LEAVING DRY BULB	AFD	ABOVE FINISHED GRADE	LP	LOW PRESSURE	AHJ	AUTHORITY HAVING JURISDICTION	LWB	LEAVING WET BULB	AH	AIR HANDLING UNIT	MFR	MANUFACTURER	AH	ANALOG INPUT	MIN	MINIMUM	AO	ANALOG OUTPUT	MAU	MAKE-UP AIR UNIT	AP	ACCESS PANEL	MAX	MAXIMUM	APD	AIR PRESSURE DROP	MBH	1000 BTU PER HOUR	AWG	AMERICAN WIRE GAUGE	MD	MOTORIZED DAMPER	B	BUILDING AUTOMATION SYSTEM	MFR	MANUFACTURER	BB	BACKBONE	N/A	NOT APPLICABLE	BD	BACKDRAFT DAMPER	N/C	NORMALLY CLOSED	BD	BLOWDOWN	NOM	NOMINAL	BFC	BELOW FINISHED CEILING	NC	NOISE CRITERIA	BFF	BELOW FINISHED FLOOR	NF	NON-FUSED	BFG	BELOW FINISHED GRADE	NIC	NOT IN CONTRACT	BFP	BOILER FEED PUMP	NOISE	NOISE CRITERIA	BHP	BRAKE HORSEPOWER	PICV	PRESSURE INDEP. CONTROL VALVE	BI	BINARY INPUT	PROVIDE	FURNISH AND INSTALL	BO	BOTTOM OF DUCT	QTY	QUANTITY	BOS	BOTTOM OF STRUCTURE	RA	RETURN AIR	BTU	BRITISH THERMAL UNIT	RC	ROOM CRITERIA	CFM	CUBIC FEET PER MINUTE	RD	RETURN DUCT	CH	CHILLER	REA	RELIEF AIR	CLG	COOLING	RF	RETURN FAN	CO	CLEANOUT	RFR	REFRIGERANT	CP	CONDENSATE PUMP	RH	RELATIVE HUMIDITY	CPT	CONTROL POINT	RM	REVOLUTIONS PER MINUTE	CRAC	COMPUTER ROOM AIR CONDITIONING UNIT	RTU	ROOFTOP UNIT	CRU	COMPUTER ROOM UNIT	SA	SUPPLY AIR	CT	COOLING TOWER	SCP	STEAM CONDENSATE PUMP	CV	CONTROL VALVE	SD	SMOKE DETECTOR	CWP	CONDENSER	SD	SUPPLY DUCT	CU	WATER PUMP	SF	SUPPLY FAN	CHWP	CHILLED WATER PUMP	SH	SCOPE OF WORK	DB	DECIBELS	SP	STATIC PRESSURE	DBA	DECIBEL AVERAGE	ST	STEAM TRAP	DDC	DIRECT DIGITAL CONTROL	STM	STEAM	DI	DIGITAL INPUT	TBD	TO BE DETERMINED	DISC	DISCONNECT	TCIC	TEMPERATURE CONTROLS CONTRACTOR	DN	DOWN	TC	TEMPERATURE CONTROL	DX	DUCT SILENCER	TF	TRANSFER FAN	(E)	EXISTING	TFA	TO FLOOR ABOVE	EA	EXHAUST AIR	TFB	TO FLOOR BELOW	EAT	ENTERING	TH	TOTAL HEAT CAPACITY	EA	AIR TEMPERATURE	TSP	TOTAL STATIC PRESSURE	ED	EXHAUST DUCT	TT	TEMPERATURE TRANSMITTAL	EDB	ENTERING DRY BULB	TYP	TYPICAL	EF	EXHAUST FAN	UF	UNDERFLOOR	EFF	EFFICIENCY	UG	UNDERGROUND	EMS	ENERGY MANAGEMENT SYSTEM	US	UNDERSLAB	ESP	EXTERNAL STATIC PRESSURE	UH	UNIT HEATER	ETR	EXISTING TO REMAIN	UNO	UNLESS NOTED OTHERWISE	EWB	ENTERING WET BULB	VAV	VARIABLE AIR VOLUME	EWT	ENTERING WATER	VEL	VELOCITY	FCU	FAN COIL UNIT	VFD	VARIABLE FREQUENCY DRIVE	FFA	FROM FLOOR ABOVE	VRF	VARIABLE REFRIGERANT FLOW	FFB	FROM FLOOR BELOW	VRV	VARIABLE REFRIGERANT VOLUME	FF	FINISHED FLOOR	W	WITH	FPI	FINS PER INCH	WO	WITHOUT	PFM	FEET PER MINUTE	WB	WET BULB	GC	GENERAL CONTRACTOR	WC	WATER COLUMN	GPM	GALLONS PER MINUTE	WPD	WATER PRESSURE DROP	HP	HAND-OFF-AUTOMATIC HORSEPOWER	XP	EXPLOSION PROOF	HTG	HEATING		
AC	AIR CONDITIONING	HWP	HEATING WATER PUMP																																																																																																																																																																																																																																																																																		
ACC	AIR COOLED CHILLER	IN WC	INCHES OF WATER COLUMN																																																																																																																																																																																																																																																																																		
ACCU	AIR COOLED CONDENSING UNIT	L	LEAVING AIR																																																																																																																																																																																																																																																																																		
AF	ABOVE FINISHED CEILING	LAT	LEAVING AIR TEMPERATURE																																																																																																																																																																																																																																																																																		
AFB	ABOVE FINISHED FLOOR	LD	LEAVING DRY BULB																																																																																																																																																																																																																																																																																		
AFD	ABOVE FINISHED GRADE	LP	LOW PRESSURE																																																																																																																																																																																																																																																																																		
AHJ	AUTHORITY HAVING JURISDICTION	LWB	LEAVING WET BULB																																																																																																																																																																																																																																																																																		
AH	AIR HANDLING UNIT	MFR	MANUFACTURER																																																																																																																																																																																																																																																																																		
AH	ANALOG INPUT	MIN	MINIMUM																																																																																																																																																																																																																																																																																		
AO	ANALOG OUTPUT	MAU	MAKE-UP AIR UNIT																																																																																																																																																																																																																																																																																		
AP	ACCESS PANEL	MAX	MAXIMUM																																																																																																																																																																																																																																																																																		
APD	AIR PRESSURE DROP	MBH	1000 BTU PER HOUR																																																																																																																																																																																																																																																																																		
AWG	AMERICAN WIRE GAUGE	MD	MOTORIZED DAMPER																																																																																																																																																																																																																																																																																		
B	BUILDING AUTOMATION SYSTEM	MFR	MANUFACTURER																																																																																																																																																																																																																																																																																		
BB	BACKBONE	N/A	NOT APPLICABLE																																																																																																																																																																																																																																																																																		
BD	BACKDRAFT DAMPER	N/C	NORMALLY CLOSED																																																																																																																																																																																																																																																																																		
BD	BLOWDOWN	NOM	NOMINAL																																																																																																																																																																																																																																																																																		
BFC	BELOW FINISHED CEILING	NC	NOISE CRITERIA																																																																																																																																																																																																																																																																																		
BFF	BELOW FINISHED FLOOR	NF	NON-FUSED																																																																																																																																																																																																																																																																																		
BFG	BELOW FINISHED GRADE	NIC	NOT IN CONTRACT																																																																																																																																																																																																																																																																																		
BFP	BOILER FEED PUMP	NOISE	NOISE CRITERIA																																																																																																																																																																																																																																																																																		
BHP	BRAKE HORSEPOWER	PICV	PRESSURE INDEP. CONTROL VALVE																																																																																																																																																																																																																																																																																		
BI	BINARY INPUT	PROVIDE	FURNISH AND INSTALL																																																																																																																																																																																																																																																																																		
BO	BOTTOM OF DUCT	QTY	QUANTITY																																																																																																																																																																																																																																																																																		
BOS	BOTTOM OF STRUCTURE	RA	RETURN AIR																																																																																																																																																																																																																																																																																		
BTU	BRITISH THERMAL UNIT	RC	ROOM CRITERIA																																																																																																																																																																																																																																																																																		
CFM	CUBIC FEET PER MINUTE	RD	RETURN DUCT																																																																																																																																																																																																																																																																																		
CH	CHILLER	REA	RELIEF AIR																																																																																																																																																																																																																																																																																		
CLG	COOLING	RF	RETURN FAN																																																																																																																																																																																																																																																																																		
CO	CLEANOUT	RFR	REFRIGERANT																																																																																																																																																																																																																																																																																		
CP	CONDENSATE PUMP	RH	RELATIVE HUMIDITY																																																																																																																																																																																																																																																																																		
CPT	CONTROL POINT	RM	REVOLUTIONS PER MINUTE																																																																																																																																																																																																																																																																																		
CRAC	COMPUTER ROOM AIR CONDITIONING UNIT	RTU	ROOFTOP UNIT																																																																																																																																																																																																																																																																																		
CRU	COMPUTER ROOM UNIT	SA	SUPPLY AIR																																																																																																																																																																																																																																																																																		
CT	COOLING TOWER	SCP	STEAM CONDENSATE PUMP																																																																																																																																																																																																																																																																																		
CV	CONTROL VALVE	SD	SMOKE DETECTOR																																																																																																																																																																																																																																																																																		
CWP	CONDENSER	SD	SUPPLY DUCT																																																																																																																																																																																																																																																																																		
CU	WATER PUMP	SF	SUPPLY FAN																																																																																																																																																																																																																																																																																		
CHWP	CHILLED WATER PUMP	SH	SCOPE OF WORK																																																																																																																																																																																																																																																																																		
DB	DECIBELS	SP	STATIC PRESSURE																																																																																																																																																																																																																																																																																		
DBA	DECIBEL AVERAGE	ST	STEAM TRAP																																																																																																																																																																																																																																																																																		
DDC	DIRECT DIGITAL CONTROL	STM	STEAM																																																																																																																																																																																																																																																																																		
DI	DIGITAL INPUT	TBD	TO BE DETERMINED																																																																																																																																																																																																																																																																																		
DISC	DISCONNECT	TCIC	TEMPERATURE CONTROLS CONTRACTOR																																																																																																																																																																																																																																																																																		
DN	DOWN	TC	TEMPERATURE CONTROL																																																																																																																																																																																																																																																																																		
DX	DUCT SILENCER	TF	TRANSFER FAN																																																																																																																																																																																																																																																																																		
(E)	EXISTING	TFA	TO FLOOR ABOVE																																																																																																																																																																																																																																																																																		
EA	EXHAUST AIR	TFB	TO FLOOR BELOW																																																																																																																																																																																																																																																																																		
EAT	ENTERING	TH	TOTAL HEAT CAPACITY																																																																																																																																																																																																																																																																																		
EA	AIR TEMPERATURE	TSP	TOTAL STATIC PRESSURE																																																																																																																																																																																																																																																																																		
ED	EXHAUST DUCT	TT	TEMPERATURE TRANSMITTAL																																																																																																																																																																																																																																																																																		
EDB	ENTERING DRY BULB	TYP	TYPICAL																																																																																																																																																																																																																																																																																		
EF	EXHAUST FAN	UF	UNDERFLOOR																																																																																																																																																																																																																																																																																		
EFF	EFFICIENCY	UG	UNDERGROUND																																																																																																																																																																																																																																																																																		
EMS	ENERGY MANAGEMENT SYSTEM	US	UNDERSLAB																																																																																																																																																																																																																																																																																		
ESP	EXTERNAL STATIC PRESSURE	UH	UNIT HEATER																																																																																																																																																																																																																																																																																		
ETR	EXISTING TO REMAIN	UNO	UNLESS NOTED OTHERWISE																																																																																																																																																																																																																																																																																		
EWB	ENTERING WET BULB	VAV	VARIABLE AIR VOLUME																																																																																																																																																																																																																																																																																		
EWT	ENTERING WATER	VEL	VELOCITY																																																																																																																																																																																																																																																																																		
FCU	FAN COIL UNIT	VFD	VARIABLE FREQUENCY DRIVE																																																																																																																																																																																																																																																																																		
FFA	FROM FLOOR ABOVE	VRF	VARIABLE REFRIGERANT FLOW																																																																																																																																																																																																																																																																																		
FFB	FROM FLOOR BELOW	VRV	VARIABLE REFRIGERANT VOLUME																																																																																																																																																																																																																																																																																		
FF	FINISHED FLOOR	W	WITH																																																																																																																																																																																																																																																																																		
FPI	FINS PER INCH	WO	WITHOUT																																																																																																																																																																																																																																																																																		
PFM	FEET PER MINUTE	WB	WET BULB																																																																																																																																																																																																																																																																																		
GC	GENERAL CONTRACTOR	WC	WATER COLUMN																																																																																																																																																																																																																																																																																		
GPM	GALLONS PER MINUTE	WPD	WATER PRESSURE DROP																																																																																																																																																																																																																																																																																		
HP	HAND-OFF-AUTOMATIC HORSEPOWER	XP	EXPLOSION PROOF																																																																																																																																																																																																																																																																																		
HTG	HEATING																																																																																																																																																																																																																																																																																				

CONSULTANTS

**HENDERSON**  
ENGINEERS

8345 LENEVA DRIVE, SUITE 300  
LENEVA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM

250004654  
AZ CORPORATE NO. 101470-0  
EXPIRES 9/30/2024

SEAL SIGNATURE:

EXPIRES ON: 09/30/2026

04/22/2024

HEI 2024-04-22 PERMIT/BID SET

NO.	BY	DATE	DESCRIPTION

**SHAKE SHACK**

SHAKE SHACK  
GOODYEAR, AZ

GOODYEAR CIVIC SQUARE  
PARCEL #501-2A-983  
GOODYEAR, AZ 85395  
SHACK #1515

PERMIT/BID SET

MECHANICAL GENERAL INFORMATION

DRAWN BY: *Author*

CHECKED BY: *Checker*

JOB NO: 2350004654


M001

**MECHANICAL GENERAL NOTES:**

- DO NOT ROUTE ANY DUCTWORK OR PIPING ABOVE ELECTRICAL PANELS.
- REFER TO SHEET M001 FOR ADDITIONAL GENERAL NOTES AND REQUIREMENTS.
- REFER TO DETAILS AND SCHEDULES SHEETS FOR FURTHER INFORMATION.
- MOUNT ALL THERMOSTATS AND SENSORS CONTROLLING HVAC EQUIPMENT AT 48" AFF UNLESS OTHERWISE NOTED.

**MECHANICAL PLAN NOTES:**

- TYPE I GREASE HOOD EXHAUST DUCTWORK SHALL BE MINIMUM 16 GAUGE STEEL OR MINIMUM 18 GAUGE STAINLESS STEEL WITH LIQUID TIGHT WELDS.
- INSTALL ACCESS PANELS FOR CLEANING AS REQUIRED BY NFPA 96 AND LOCAL CODES. TRANSITION GREASE DUCTWORK AS REQUIRED TO HOOD AND FAN CONNECTIONS. PROVIDE 45° MAX OFFSETS AS REQUIRED TO COORDINATE WITH STRUCTURE. PROVIDE RADIUS ELBOWS WITHOUT TURNING VANES. SLOPE HORIZONTAL GREASE DUCT BACK TOWARDS HOOD AT MINIMUM OF 1/4" PER LINEAL FOOT. GREASE DUCTS SHALL BE CONTAINED IN A UL APPROVED GREASE DUCT WRAP SYSTEM.
- INSTALL "DUCTMATE ULTIMATE DOOR" ON DUCTS 12" OR LARGER AND INSTALL "DUCTMATE P2 SANDWICH ACCESS DOOR" FOR DUCTS LESS THAN 12" ON GREASE DUCT FOR CLEANING IN LOCATION SHOWN AT A MINIMUM AND AS REQUIRED BY NFPA 96 AND LOCAL CODES.
- TYPE I HOODS SHALL BE FURNISHED COMPLETE WITH INTERNALLY PIPED FIRE SUPPRESSION SYSTEM AND EXTERNAL FOAM SUPPLY BOTTLES WITH REMOTE PULL CONTROLS AND IN COMPLIANCE WITH NFPA 96 DIVISION 23 SHALL COORDINATE COMPLETE INSTALLATION WITH FIRE PROTECTION CONTRACTOR TO MEET APPROVAL OF LOCAL INSPECTOR AND CODE COMPLIANCE INCLUDING TESTING.
- HOOD SHALL OVERHANG THE COOKING SURFACE BY AT LEAST 6" ON BOTH SIDES.
- MOUNT THERMOSTATS, HUMIDITY SENSORS, AND TEMPERATURE SENSORS ON WALL. THERMOSTATS AND SENSOR(S) SHALL BE LABELED TO MATCH THE UNIT TAG AND CORRESPOND TO THE ELECTRICAL LEGEND IN THE ELECTRICAL PANELBOARD SERVING THE EQUIPMENT. COORDINATE COLOR WITH ARCHITECT.
- COMBINATION TEMPERATURE SENSOR AND HUMIDITY SENSOR.
- MOUNT TEMPERATURE SENSOR PROVIDED WITH KITCHEN EXHAUST HOODS ON WALL.
- INSTALL HOOD FIRE SUPPRESSION MANUAL PULL STATION. COORDINATE EXACT LOCATION WITH FIRE SUPPRESSION SYSTEM INSTALLER AND THE AUTHORITY HAVING JURISDICTION.
- CARBON DIOXIDE SENSOR WITH REMOTE ALARM REPEATER FURNISHED BY OWNER'S CO2 VENDOR AND LOCATED AT 12" AFF. THE SENSOR SHALL BE EQUIPPED WITH A LOCAL AUDIBLE AND VISUAL ALARM. THE LOW-LEVEL ALARM SHALL ACTIVATE THE LOCAL AUDIBLE AND VISUAL ALARM. IF THE BUILDING HAS A FIRE ALARM, PROVIDE THE APPROPRIATE FIRE ALARM INTERFACE MODULE TO INTERLOCK WITH THE BUILDING FIRE ALARM SYSTEM. THE HIGH-LEVEL CO2 ALARM SHALL SIGNAL BUILDING FIRE ALARM WHEN EQUIPPED. LOW LEVEL ALARM - 0.5% = 5000 PPM. HIGH LEVEL ALARM - 3.0% = 30,000 PPM.
- INSTALL DUCT SMOKE DETECTOR IN RETURN AIR PLENUM.
- INSTALL EMERGENCY ALARM IN MANAGER'S OFFICE TO INDICATE CARBON MONOXIDE AND CARBON DIOXIDE DETECTION IN MECHANICAL ROOM. PROVIDE LIGHT IN OFFICE WITH TAG FOR EACH ALARM.
- PROVIDE COMBUSTION AIR AND EXHAUST PIPE AND ROUTE TO CONCENTRIC THROUGH ROOF.
- REFRIGERANT PIPING UP TO CU-1 ON ROOF, REF 1/1M150.
- CONTRACTOR TO COORDINATE 1" UNDERCUT ON DOOR FOR EXHAUST AIR PATH.
- AIR CURTAIN MOUNTED ABOVE DOOR. INSTALL PER MANUFACTURER'S RECOMMENDATIONS.
- PROVIDE 1/4" GALVANIZED CONSTRUCTION HARDWARE CLOTH SCREEN OVER OPEN END OF RETURN DUCT. PROVIDE DUCT LINER IN BOOT. RETURN AIR DUCT SHALL BE MINIMUM 36" HORIZONTAL EXTENSION FOR SOUND ATTENUATION.
- PROVIDE SA DUCT THROUGH ROOF. FULL SIZE OF UNIT OPENING, AND CONNECT TO UNIT WITH FLEXIBLE CONNECTOR. TRANSITION 45 DEGREES THROUGH ROOF CURB.
- PROVIDE RA DUCT THROUGH ROOF. FULL SIZE OF UNIT OPENING, AND CONNECT TO UNIT WITH FLEXIBLE CONNECTOR. TRANSITION 45 DEGREES THROUGH ROOF CURB.
- PROVIDE EA DUCT THROUGH ROOF. TRANSITION TO EXHAUST FAN INLET SIZE WITHIN CURB.
- 9"X9" GREASE EXHAUST DUCT UP TO KEF-1 ON ROOF.
- 8"X8" GREASE EXHAUST DUCT UP TO KEF-2 ON ROOF.
- 8"X8" GREASE EXHAUST DUCT UP TO KEF-3 ON ROOF.
- ROUTE DUCTWORK LEVEL, TIGHT TO STRUCTURE, AND ABOVE LIGHTS. COORDINATE WITH STORM DRAINAGE, STRUCTURAL, AND ELECTRICAL.
- INSTALL LOUVER CENTERED IN DOOR WITH BOTTOM OF LOUVER AT 0'-6" AFF.
- TRANSITION 6" OUTDOOR AIR DUCT TO 4" FLEXIBLE DUCTWORK AND CONNECT TO UNIT.
- INSTALL RETURN AIR GRILLE IN WALL AT 13'-0" AFF.
- BALANCE RETURN AIR DAMPER TO 800 CFM.

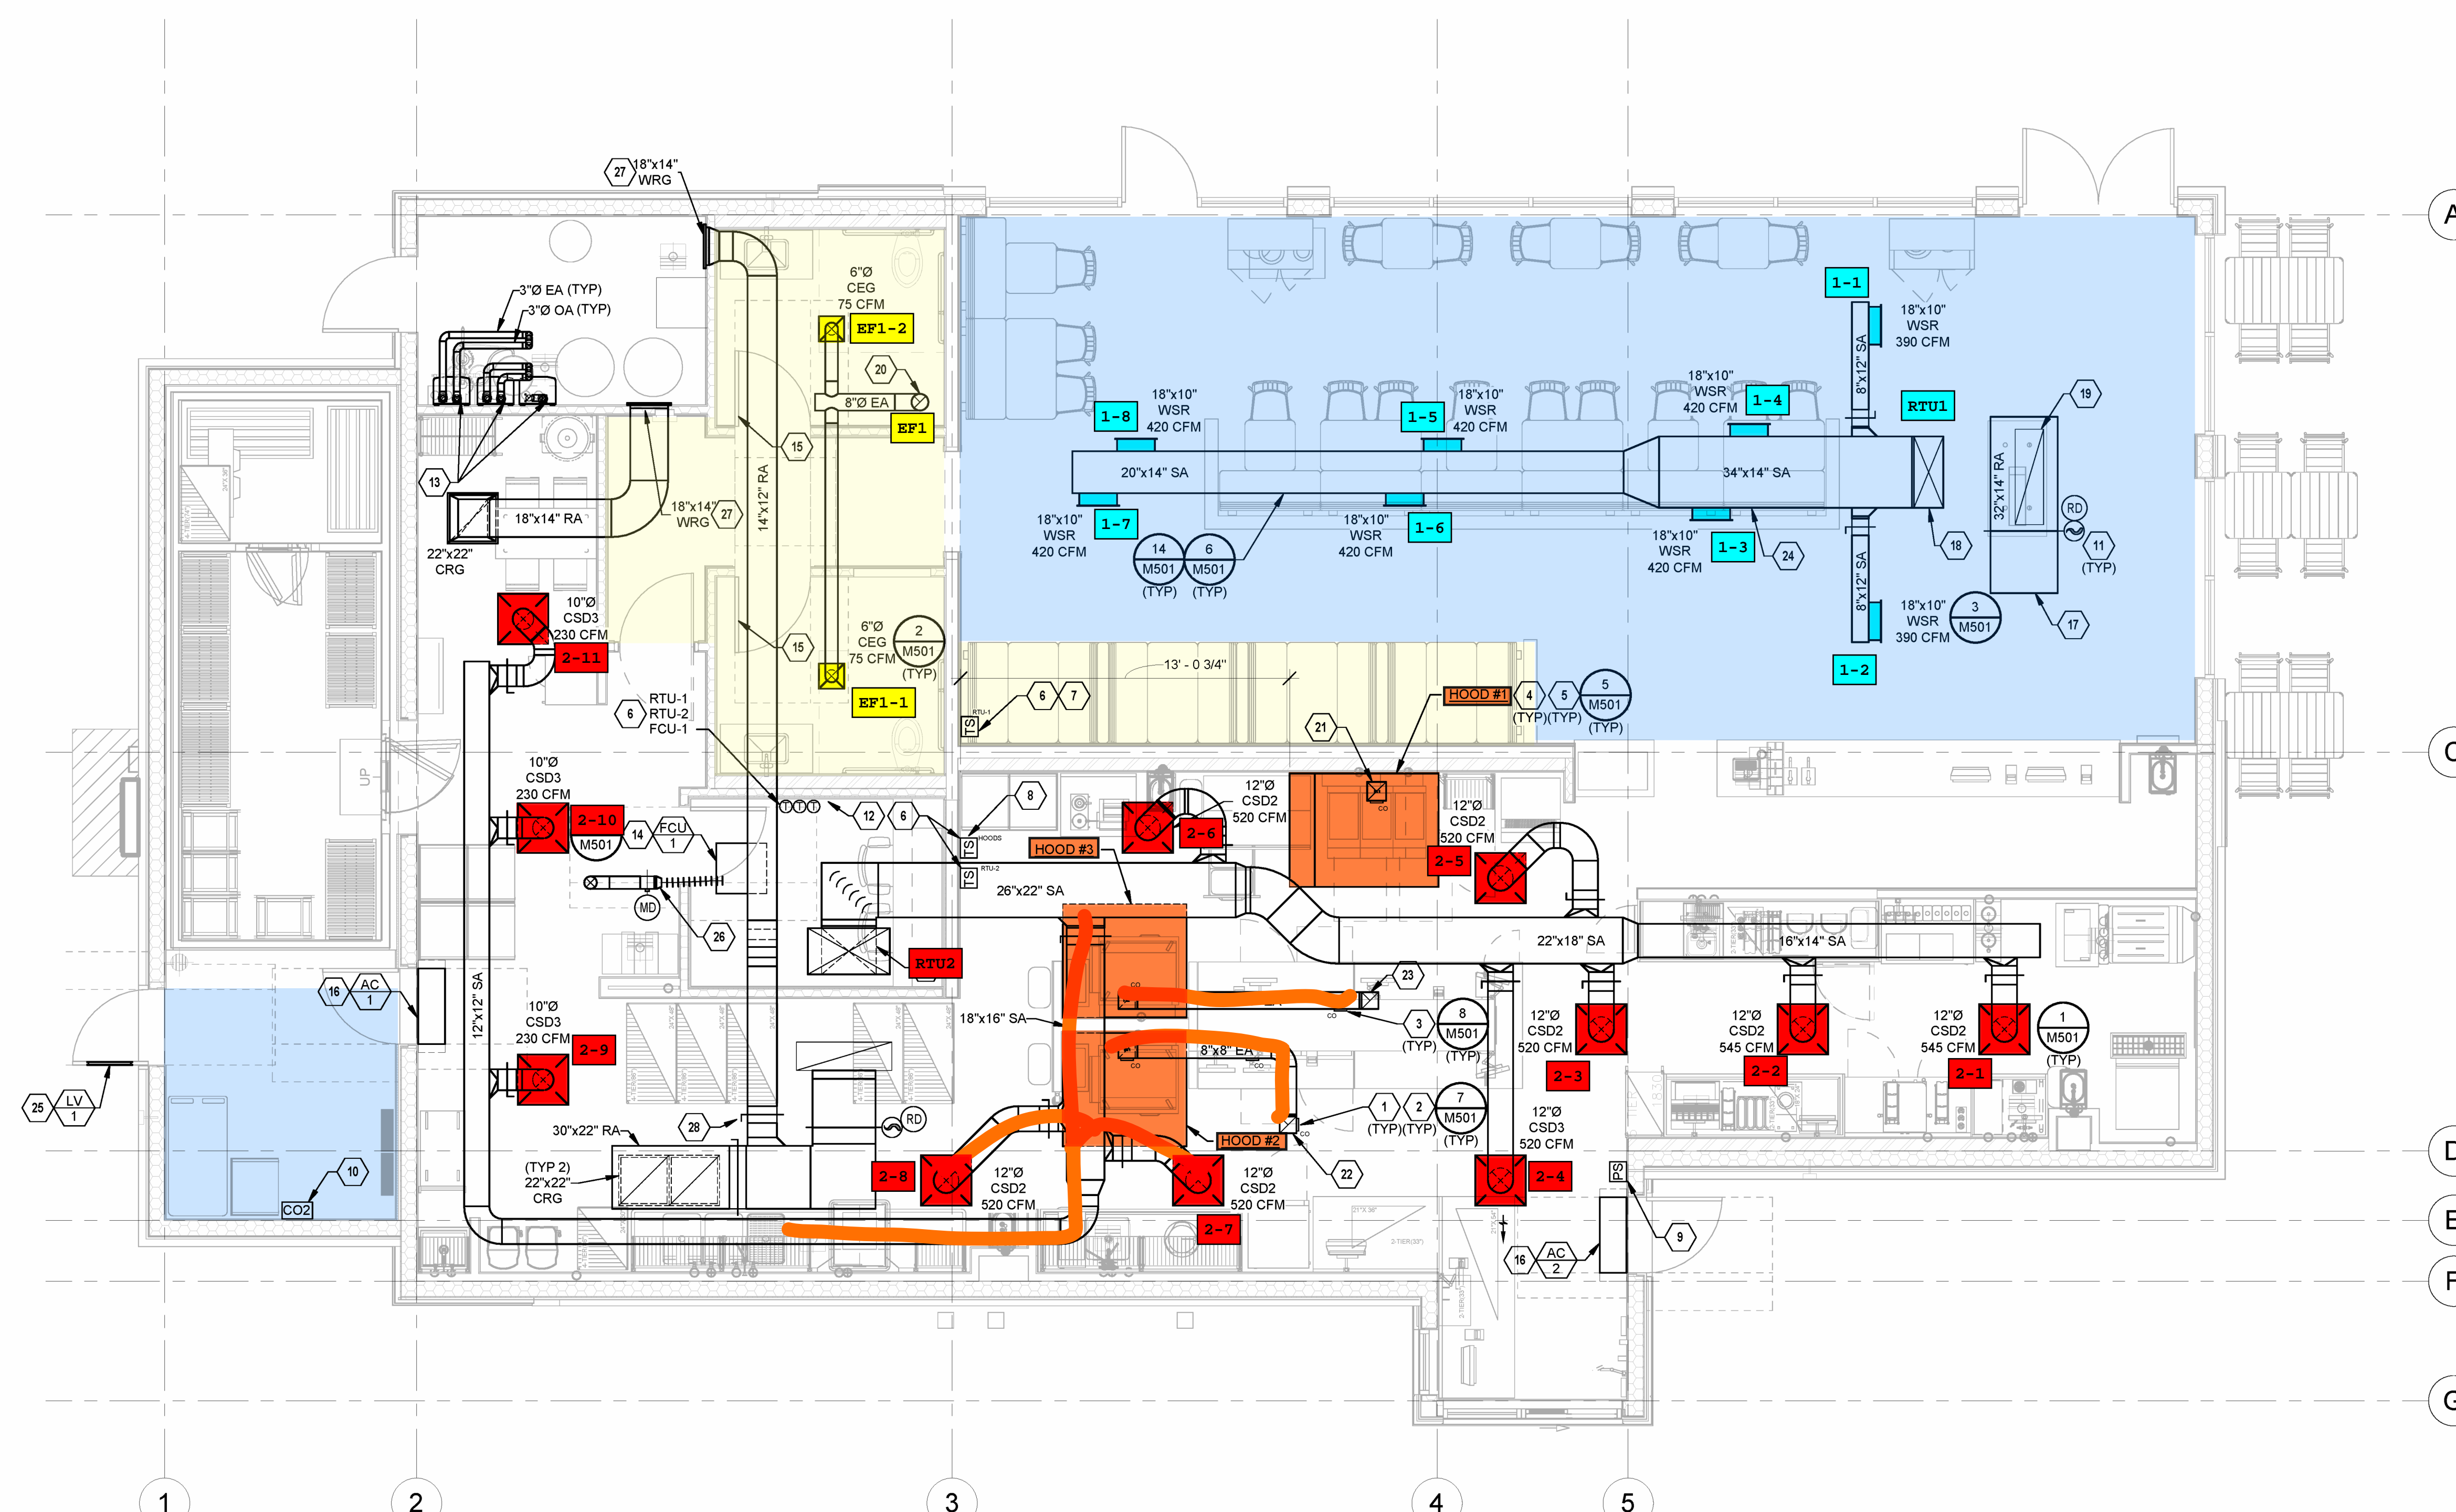

**1 MECHANICAL FLOOR PLAN**  
1/4" = 1'-0"

ALL GREASE DUCT TO BE WATER TESTED BY ENVIROMATIC AT MECHANICAL CONTRACTOR'S EXPENSE. CONTACT OWNER'S NATIONAL ACCOUNT VENDOR:  
ENVIROMATIC  
DON PFLEIDERER  
1.800.325.8476  
inspections@enviromatic.com

THE BUILDING'S HVAC SYSTEMS SHALL BE BALANCED BY NATIONAL TAB (NO EXCEPTIONS) AND CONTRACTED BY THE GENERAL CONTRACTOR.  
CONTACT:  
WILL TURNBOUGH  
will@natontab.com  
855-662-6822 ext1704

**Bergmeyer**  
CONSULTANTS  
875 N. High St.  
Columbus, OH 43215  
360.900.8887  
806 South Figueroa St.  
Los Angeles, CA 90017  
213.337.1090  
617.542.1025

**HENDERSON**  
ENGINEERS  
6345 LEXENA DRIVE, SUITE 300  
LEXENA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001  
WWW.HENDERSONENGINEERS.COM  
AZ CORPORATE NO. 10470-0  
EXPIRES 9/30/2024

SEAL SIGNATURE:  
EXPIRES ON: 09/30/2026  
NATHAN T. LOVE  
04/22/2024

SHAKE SHACK  
SHAKE SHACK  
GOODYEAR, AZ  
GOODYEAR CIVIC SQUARE  
PARCEL #501-2A-983  
GOODYEAR, AZ 85395  
SHACK #1515  
PERMIT/BID SET

MECHANICAL FLOOR PLAN

DRAWN BY: Author  
CHECKED BY: Checker  
JOB NO: 235004654

**M101**

CONSULTANTS  
**HENDERSON**  
 ENGINEERS  
 6345 LENEVA DRIVE, SUITE 200  
 LENEVA, KS 66214  
 TEL 913.742.5000 FAX 913.742.5001  
 WWW.HENDERSONENGINEERS.COM  
 235004654  
 AZ CORPORATE NO. 10470-0  
 EXPIRES 9/30/2024

SEAL SIGNATURE:  
 EXPIRES ON: 09/30/2026  
  
 04/22/2024

NO.	BY	DATE	DESCRIPTION
HE1		2024-04-22	PERMIT/BID SET


**SHAKE SHACK**  
 SHAKE SHACK  
 GOODYEAR, AZ  
 GOODYEAR CIVIC SQUARE  
 PARCEL #501-2A-983  
 GOODYEAR, AZ 85395  
 SHACK #1515  
 PERMIT/BID SET

MECHANICAL ROOF PLAN


DRAWN BY: Author  
 CHECKED BY: Checker  
 JOB NO: 2350004654

M150


- MECHANICAL PLAN NOTES:**
- 1 PROVIDE CONCENTRIC VENT MODEL NUMBER PVC-3CT.
  - 2 MAINTAIN ALL OUTSIDE AIR INTAKES A MINIMUM OF 10'-0" RADIUS FROM EXHAUST, TYPICAL.
  - 3 CONTRACTOR SHALL VERIFY WITH EQUIPMENT SUPPLIER EXACT ROUTING AND SIZE OF INSULATED REFRIGERANT PIPING. SINGLE LINESET SHOWN FOR CLARITY. INSTALL PER MANUFACTURER'S RECOMMENDATIONS.
  - 4 TURN DOWN #2 INTAKE AND END OPEN OVER ROOF (MIN. 24") WITH INSECT SCREEN.
  - 5 CONTRACTOR SHALL COORDINATE WITH NATIONAL TAB TO PROVIDE UV-PH1 INDOOR AIR PURIFICATION SYSTEM, MODEL PH-PIG-24V. INSTALL IN UNIT BLOWER COMPARTMENT PER MANUFACTURER'S INSTRUCTIONS.
  - 6 AREA RESERVED FOR REFRIGERATION CONDENSER(S) PROVIDED BY KITCHEN EQUIPMENT CONTRACTOR. COORDINATE EQUIPMENT LOCATION AND CONDENSER INSTALLATION WITH KITCHEN EQUIPMENT CONTRACTOR.
  - 7 REFERENCE PLUMBING DRAWINGS FOR CONDENSATE DRAIN ROUTING AND TERMINATION REQUIREMENTS.

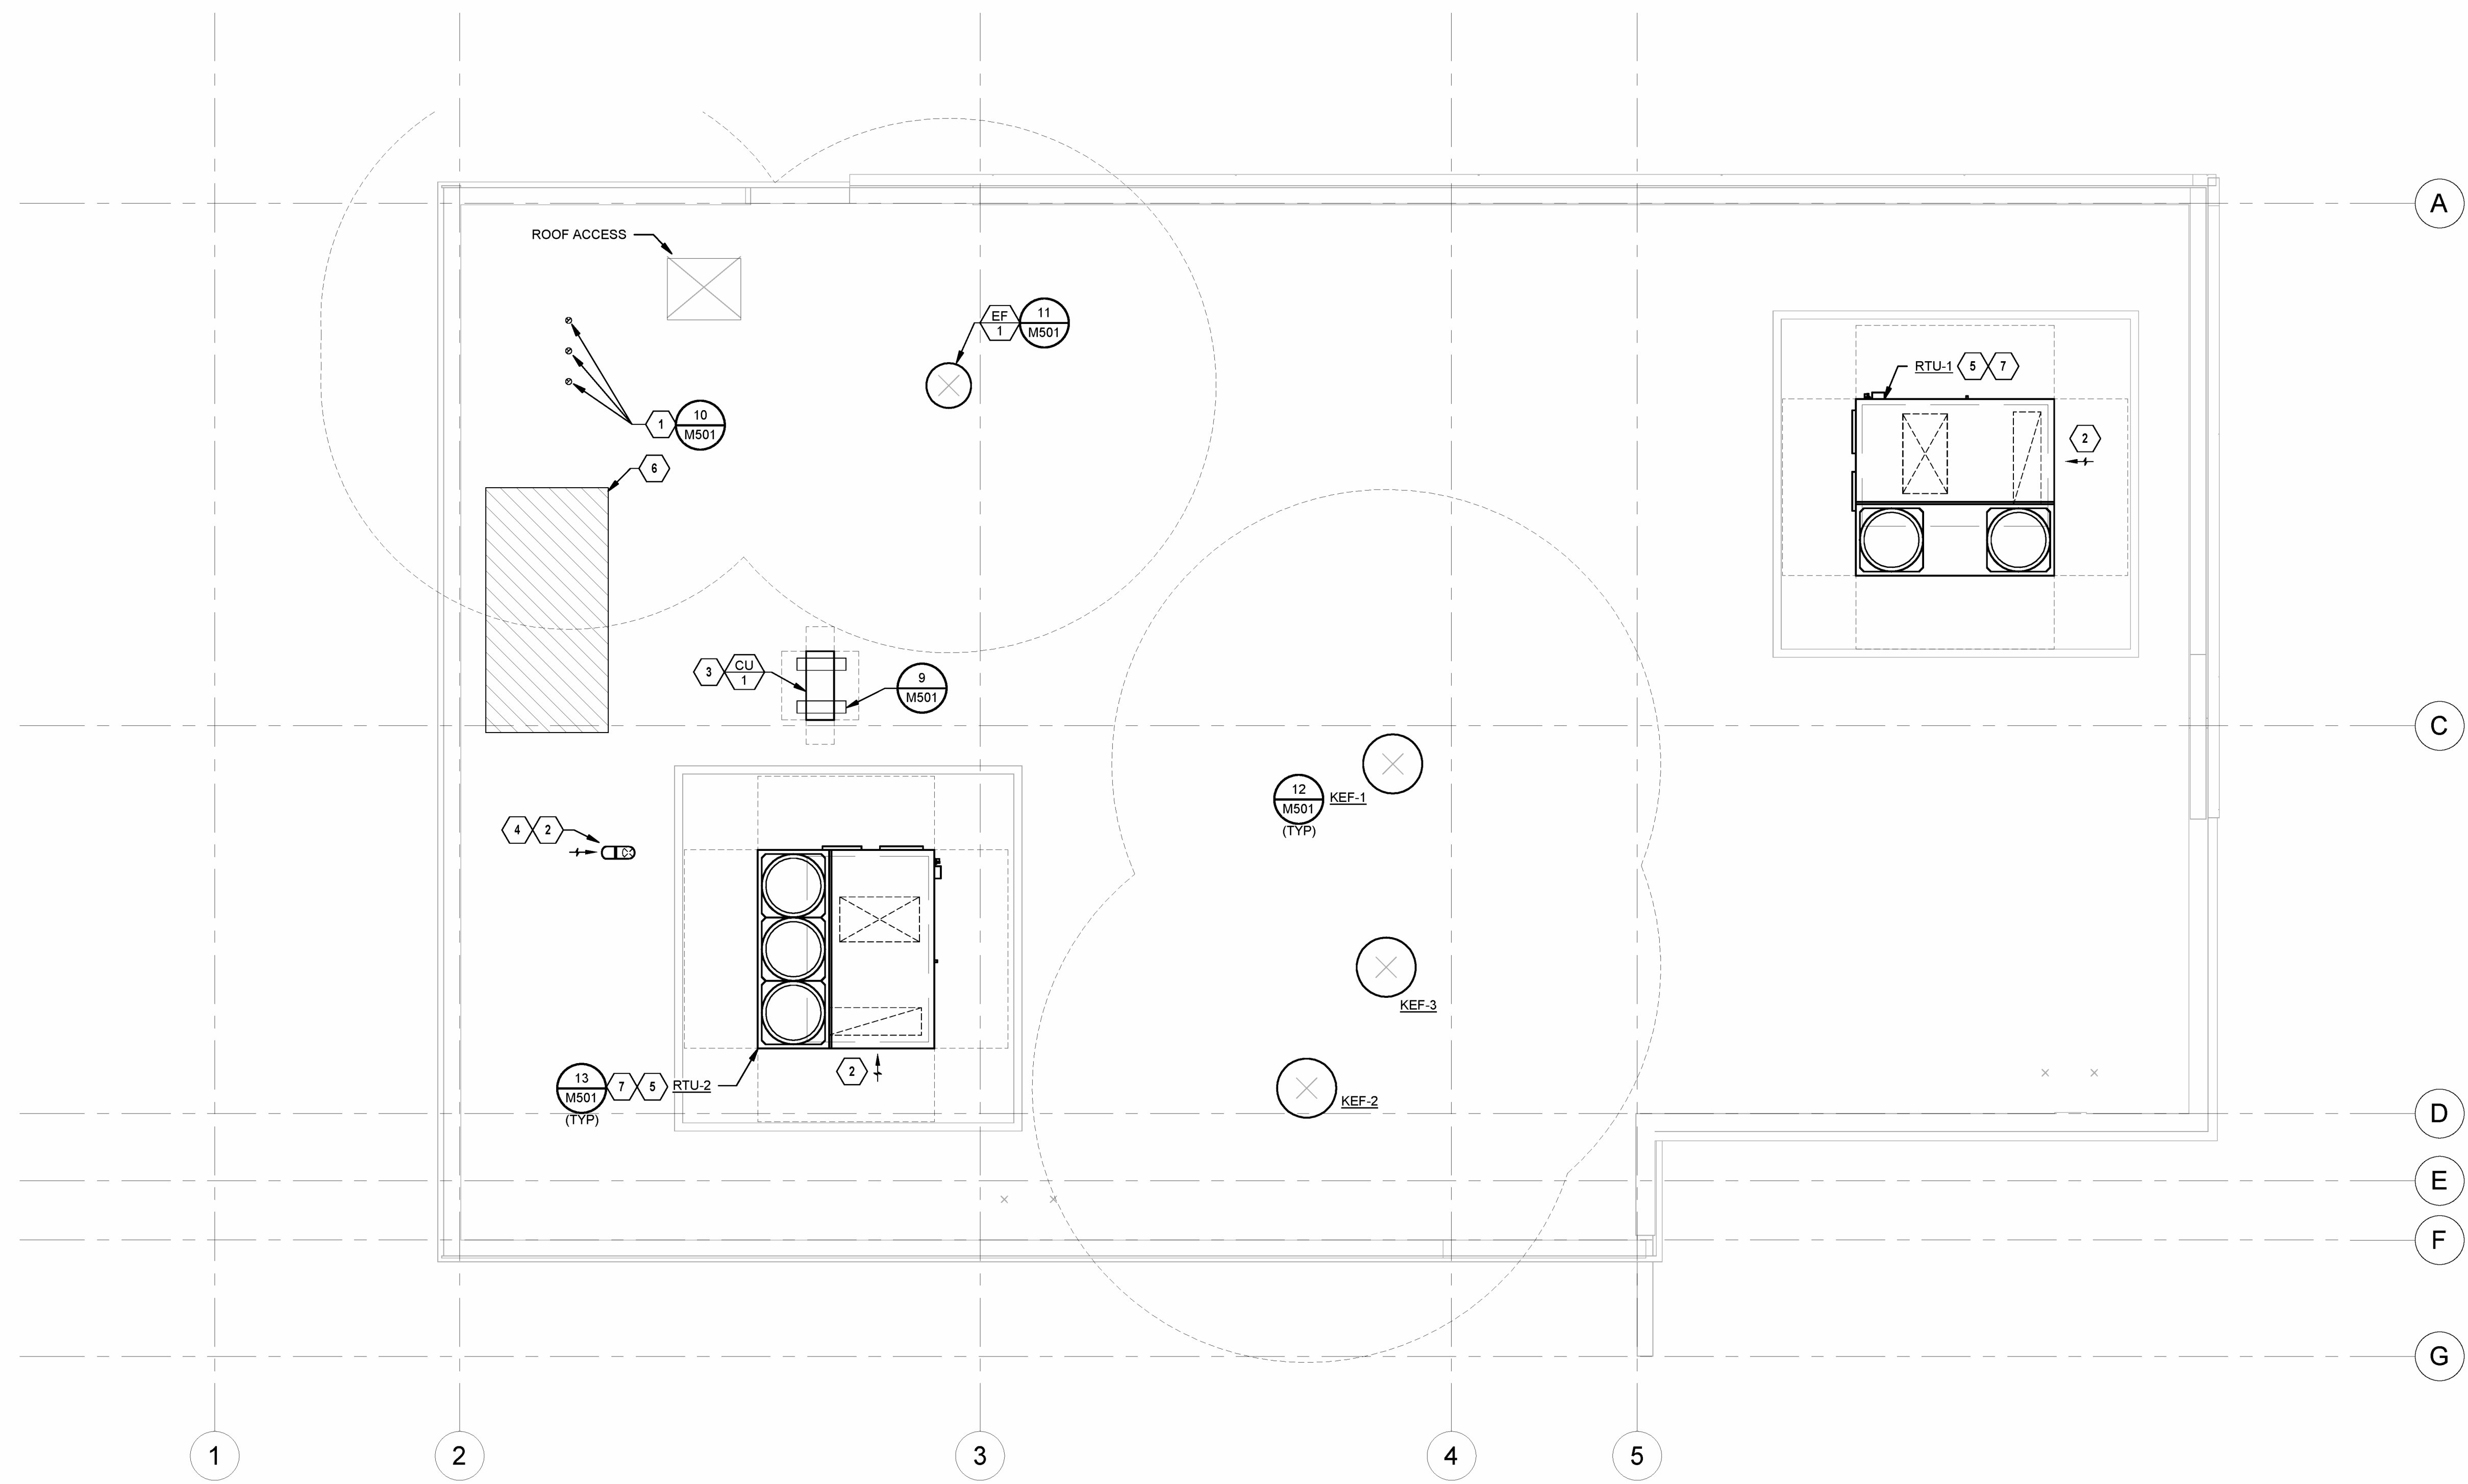


1 MECHANICAL ROOF PLAN  
 1/4" = 1'-0"

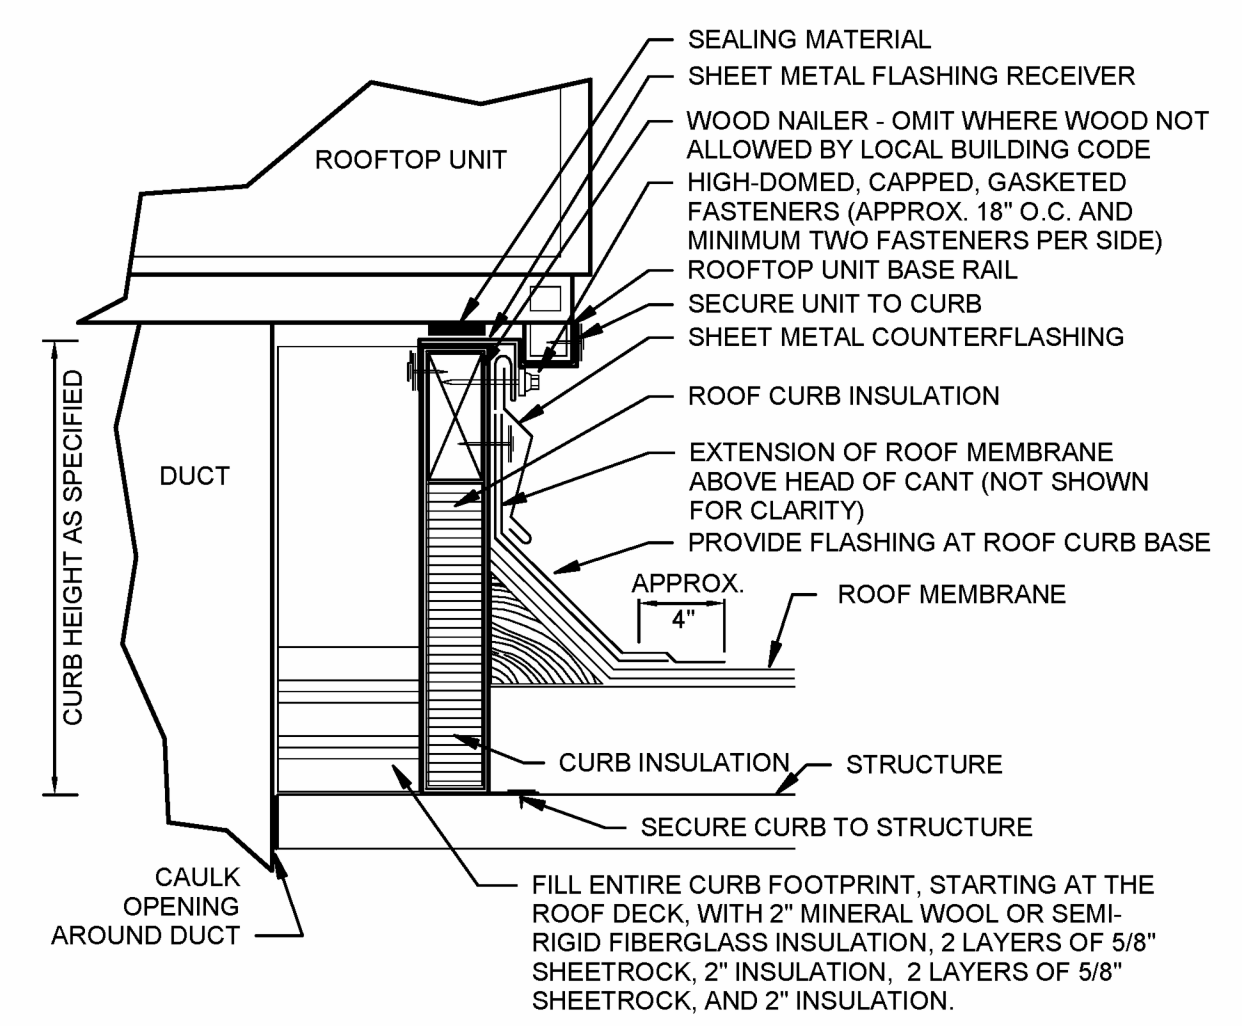


- NOTES:
- CUT METAL DECKING TO ALLOW CURB INSTALLATION ON STEEL FRAMING. AFTER CURB IS SET IN PLACE, TRIM REMAINING METAL DECKING AND INSTALL WITHIN CURB. TACK WELD DECKING TO SUPPORT STEEL. DO NOT WELD INTERIOR DECKING TO ROOF CURB. PROVIDE ADDITIONAL CROSS FRAMING TO SUPPORT INTERIOR DECKING AND FILL MATERIAL AS REQUIRED.
  - REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS FOR ROOF CURBS, ANCHORING AND SEISMIC/WIND RESISTANCE.

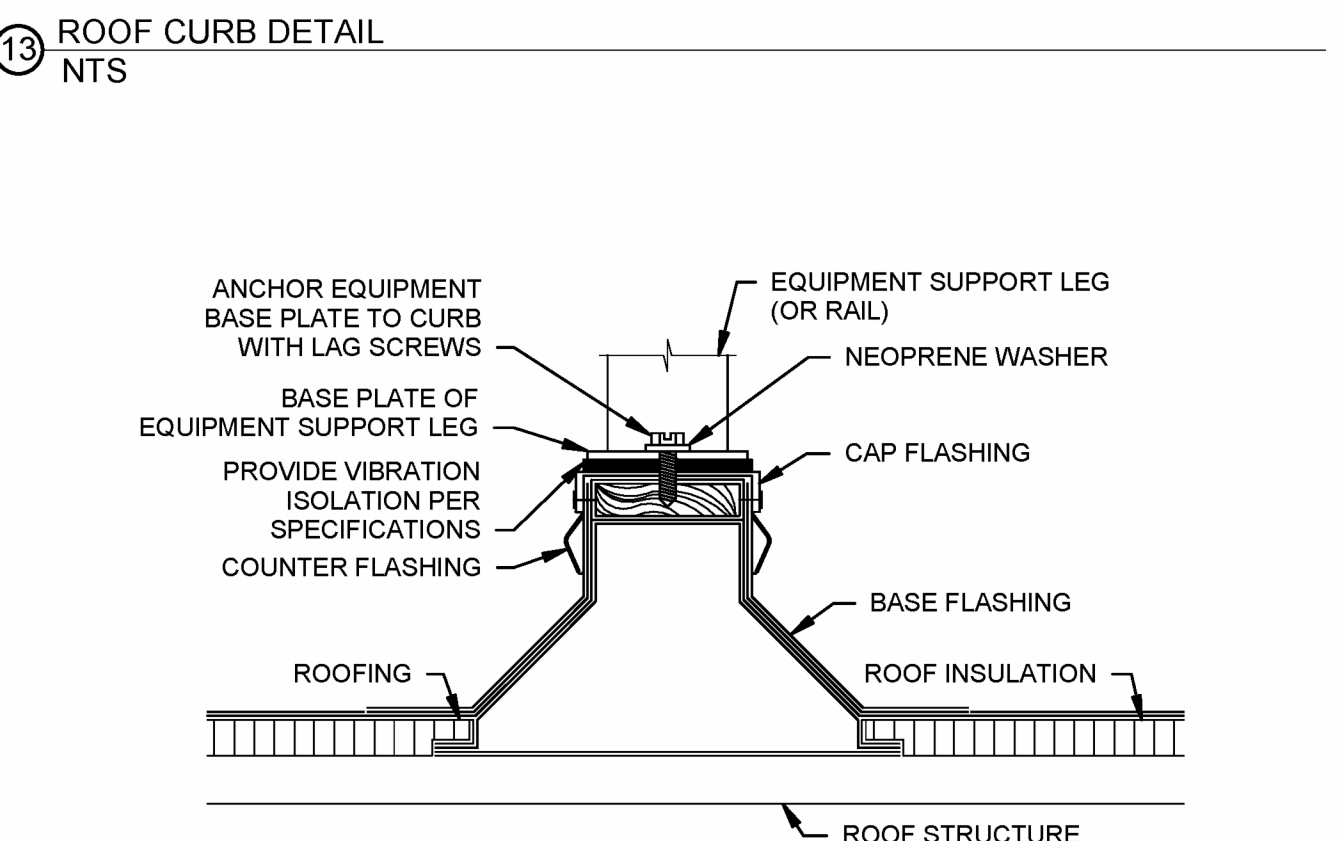

- NOTES:
- REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS FOR EQUIPMENT SUPPORTS, ANCHORING AND SEISMIC/WIND RESISTANCE.

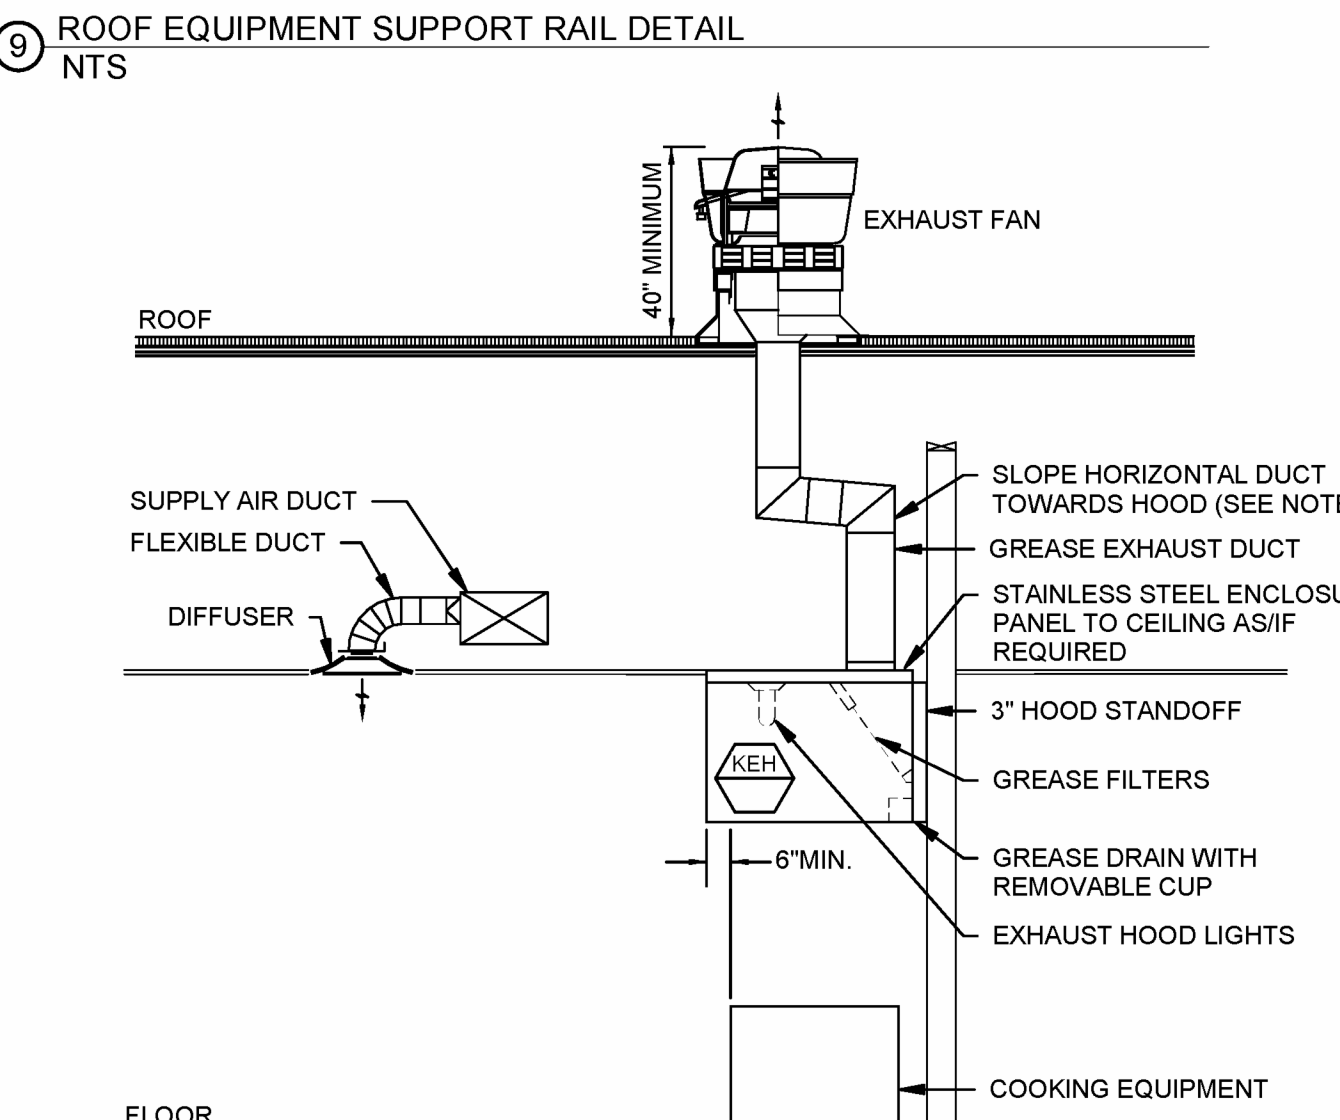


- NOTES:
- SUBMIT SHOP DRAWINGS OF ALL HOOD SYSTEMS TO CITY FOR APPROVAL PRIOR TO INSTALLATION.
  - TOTAL HOOD SYSTEM TO BE IN COMPLETE CONFORMANCE WITH NFPA, AND ALL LOCAL CODES AND REGULATIONS.
  - COORDINATE ALL FIRE PROTECTION SYSTEMS WITH FIRE PROTECTION CONTRACTOR WHO SHALL ALSO BE RESPONSIBLE FOR ALL PERMITS AND TESTING REQUIRED.
  - PROVIDE WRAP SYSTEM WHERE APPROVED BY LOCAL CODES IN LIEU OF RATED ENCLOSURE.
  - PROVIDE ACCESS PANELS AS REQUIRED BY LOCAL CODE AND PER PLAN.
  - HOODS SHALL EXTEND MINIMUM 6" BEYOND ALL OPEN SIDES AND FRONT EDGE OF FOOD COOKING EQUIPMENT BEING SERVED.

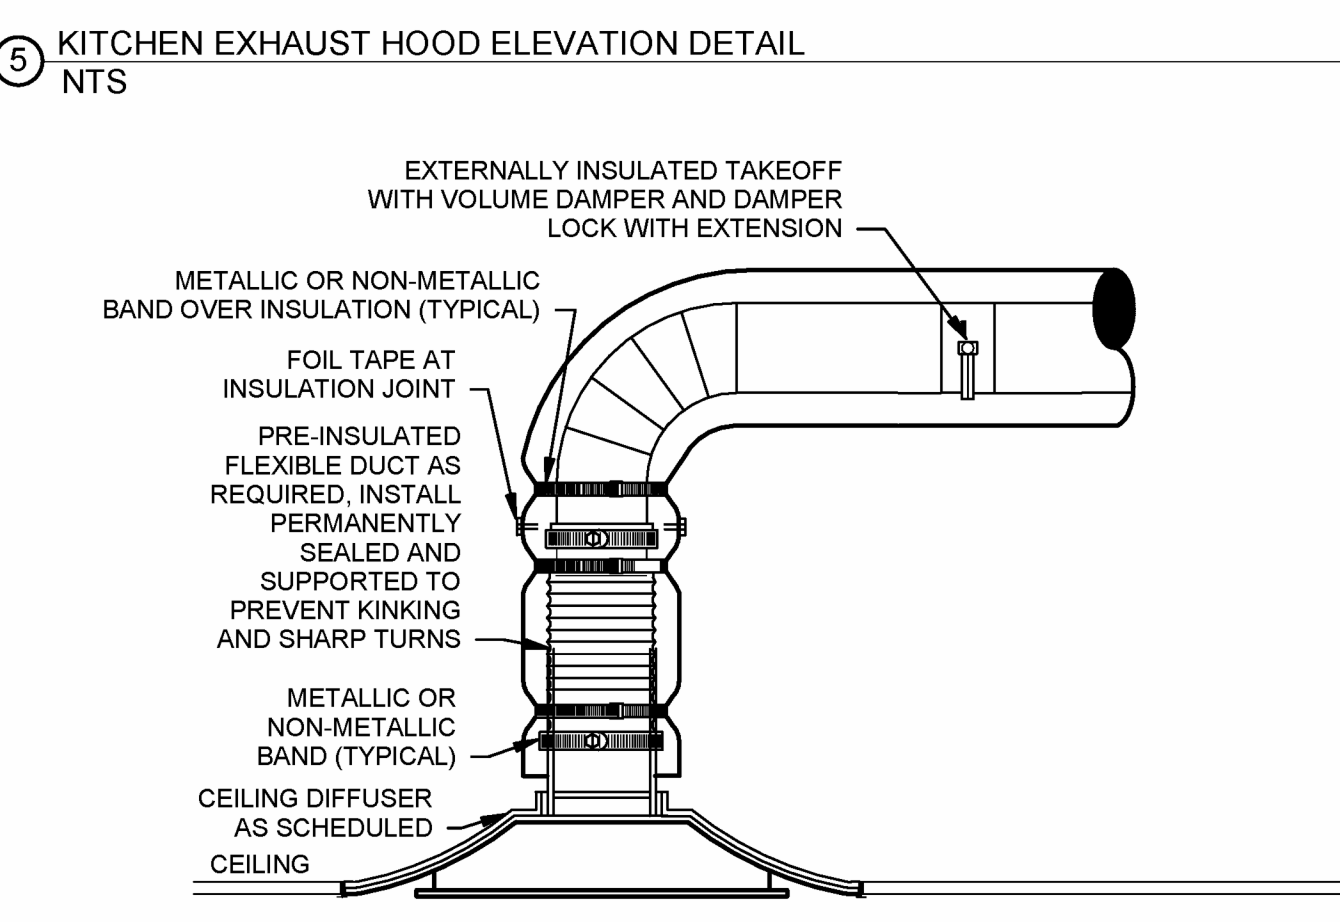


- NOTES:
- FLEXIBLE DUCT LENGTH MAY NOT EXCEED 5'-0". EXTEND RIGID DUCT AS REQUIRED.
  - REFER TO SPECIFICATIONS FOR FLEXIBLE DUCTWORK INSTALLATION REQUIREMENTS.




- NOTES:
- FLEXIBLE DUCT LENGTH MAY NOT EXCEED 5'-0". EXTEND RIGID DUCT AS REQUIRED.
  - REFER TO SPECIFICATIONS FOR FLEXIBLE DUCTWORK INSTALLATION REQUIREMENTS.

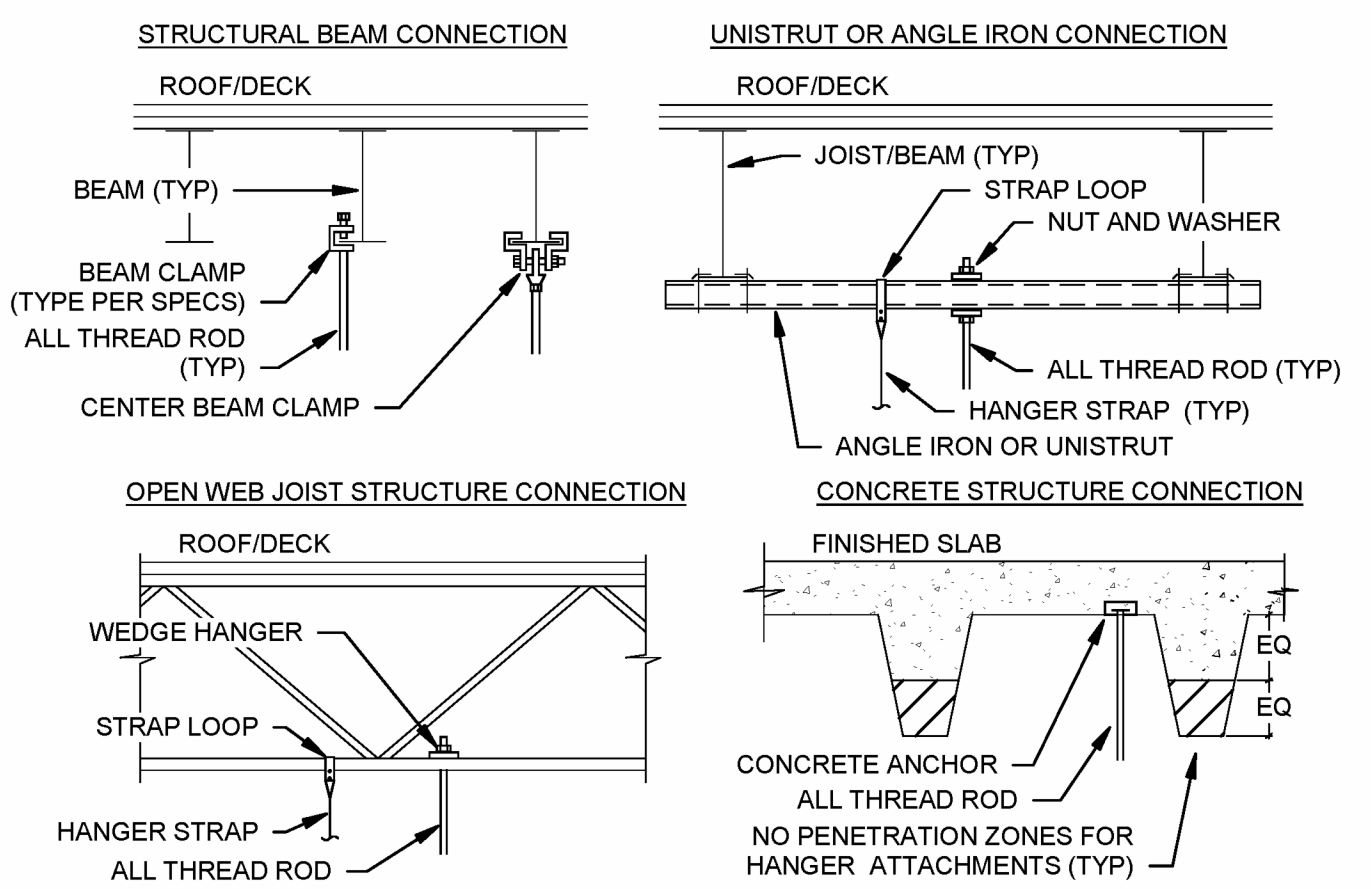


- NOTES:
- ALL ATTACHMENTS SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS AND SHALL BE APPROVED FOR THE SPECIFIC APPLICATION.
  - COORDINATE ALL ATTACHMENTS WITH ARCHITECT AND STRUCTURAL ENGINEER.
  - REFER TO SPECIFICATIONS FOR MORE INFORMATION ON APPROVED ATTACHMENT METHODS.
  - REFER TO SPECIFICATIONS FOR REQUIREMENTS RELATING TO SEISMIC INSTALLATIONS.
  - FOR OPEN WEB JOIST STRUCTURE, CONTRACTOR MAY HANG FROM TOP CHORD AND RUN DUCT AND PIPING THROUGH WEB JOIST WHEN APPROPRIATE. ANY CONCENTRATED LOADS NOT OCCURRING AT JOIST PANEL POINTS MUST BE REVIEWED BY A STRUCTURAL ENGINEER FOR FIELD INSTALLED PANEL BRACE REQUIREMENTS.

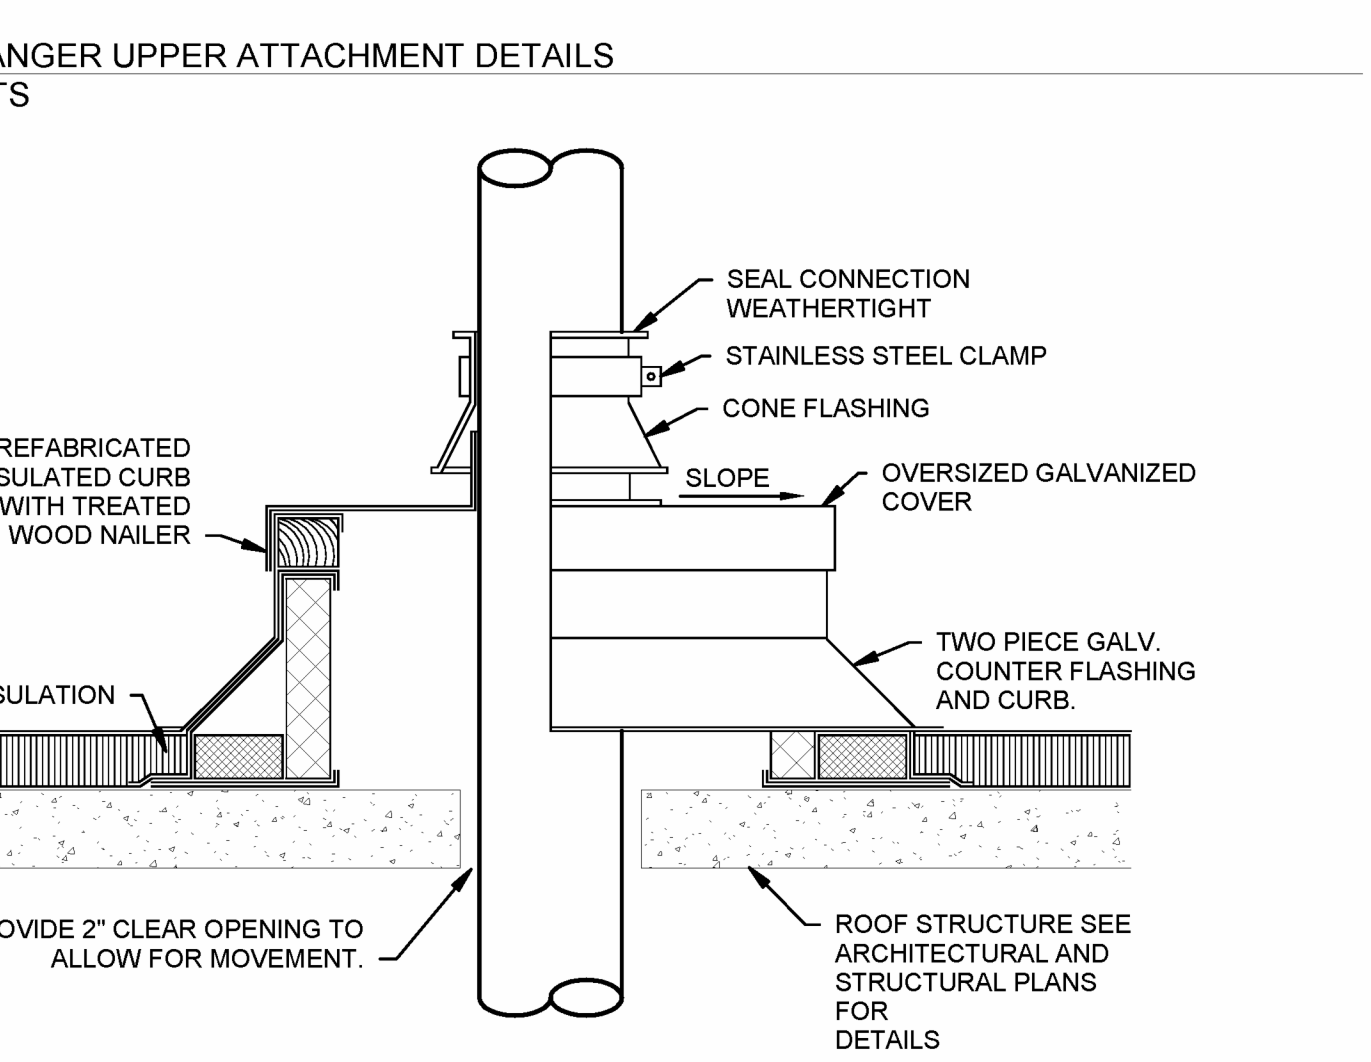

10 ROUND AIR DUCT OR PIPE PENETRATION THROUGH ROOF DETAIL NTS

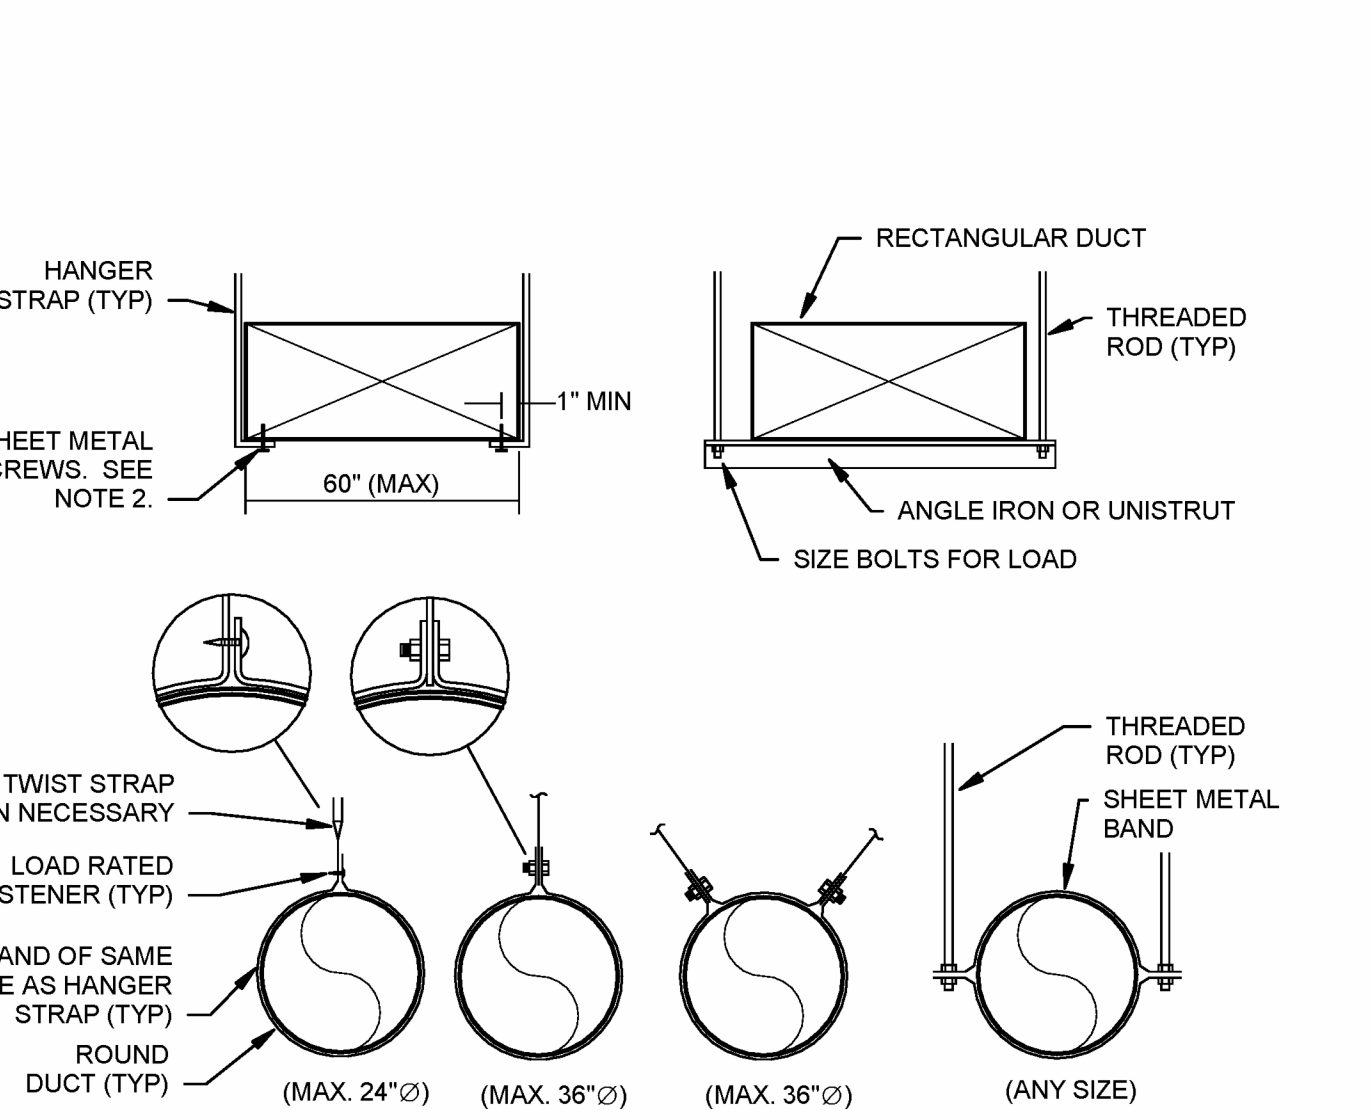


- NOTES:
- USE THREADED ROD FOR RECTANGULAR DUCTS LARGER THAN 60" WIDE.
  - OMIT SHEET METAL SCREWS IF HANGER STRAP IS CONTINUOUS AND LOOPS UNDER ENTIRE RECTANGULAR DUCT.
  - FOR ROUND DUCTS LARGER THAN 36", USE TWO HANGER RODS TO SUPPORT DUCT FROM EACH SIDE.
  - HANGERS MUST NOT DEFORM DUCT SHAPE.

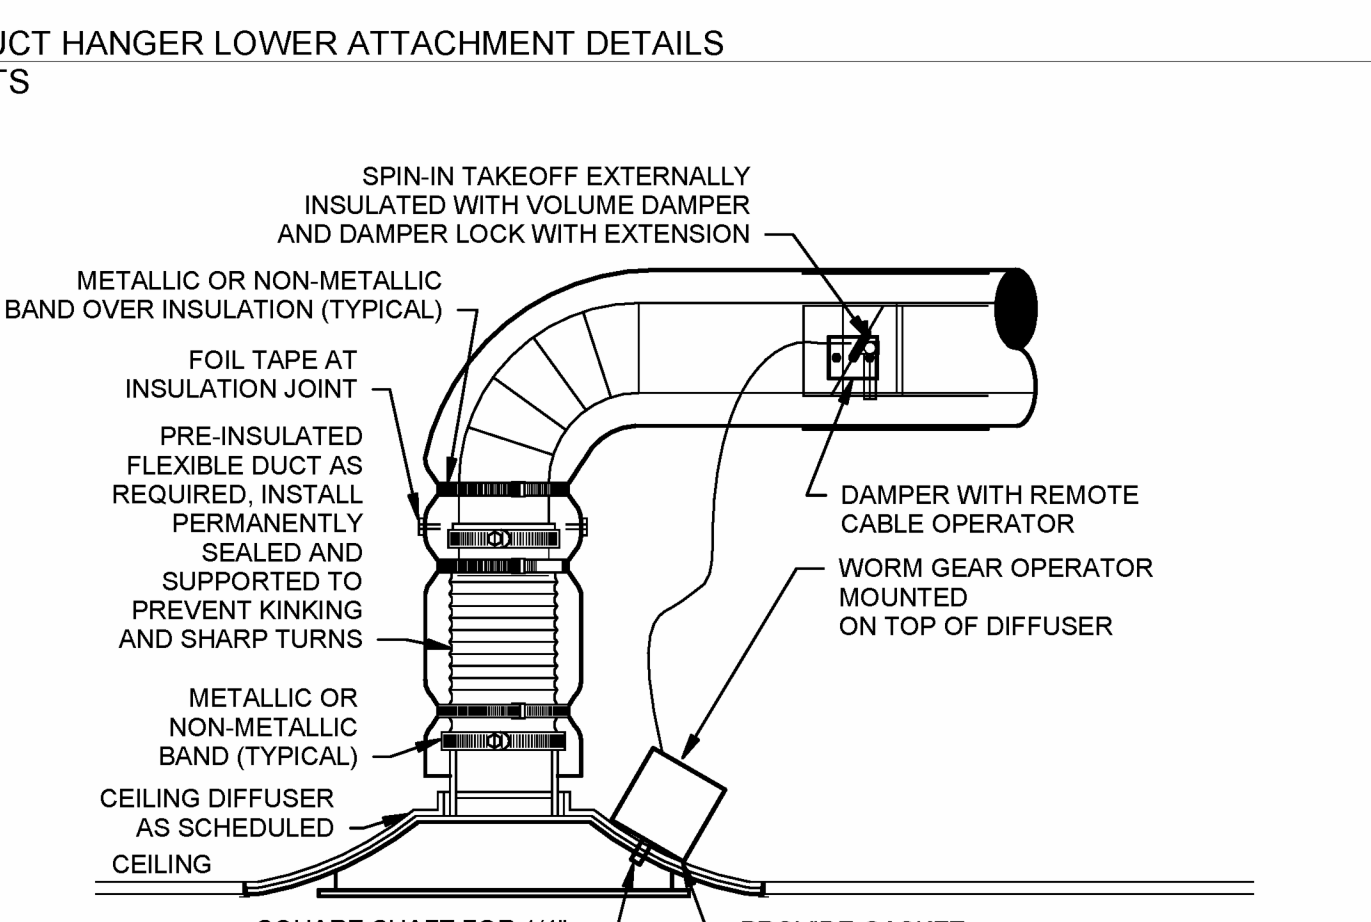


- NOTES:
- FLEXIBLE DUCT LENGTH MAY NOT EXCEED 5'-0". EXTEND RIGID DUCT AS REQUIRED.
  - REFER TO SPECIFICATIONS FOR FLEXIBLE DUCTWORK INSTALLATION REQUIREMENTS.



2 HARD CEILING DIFFUSER DETAIL NTS

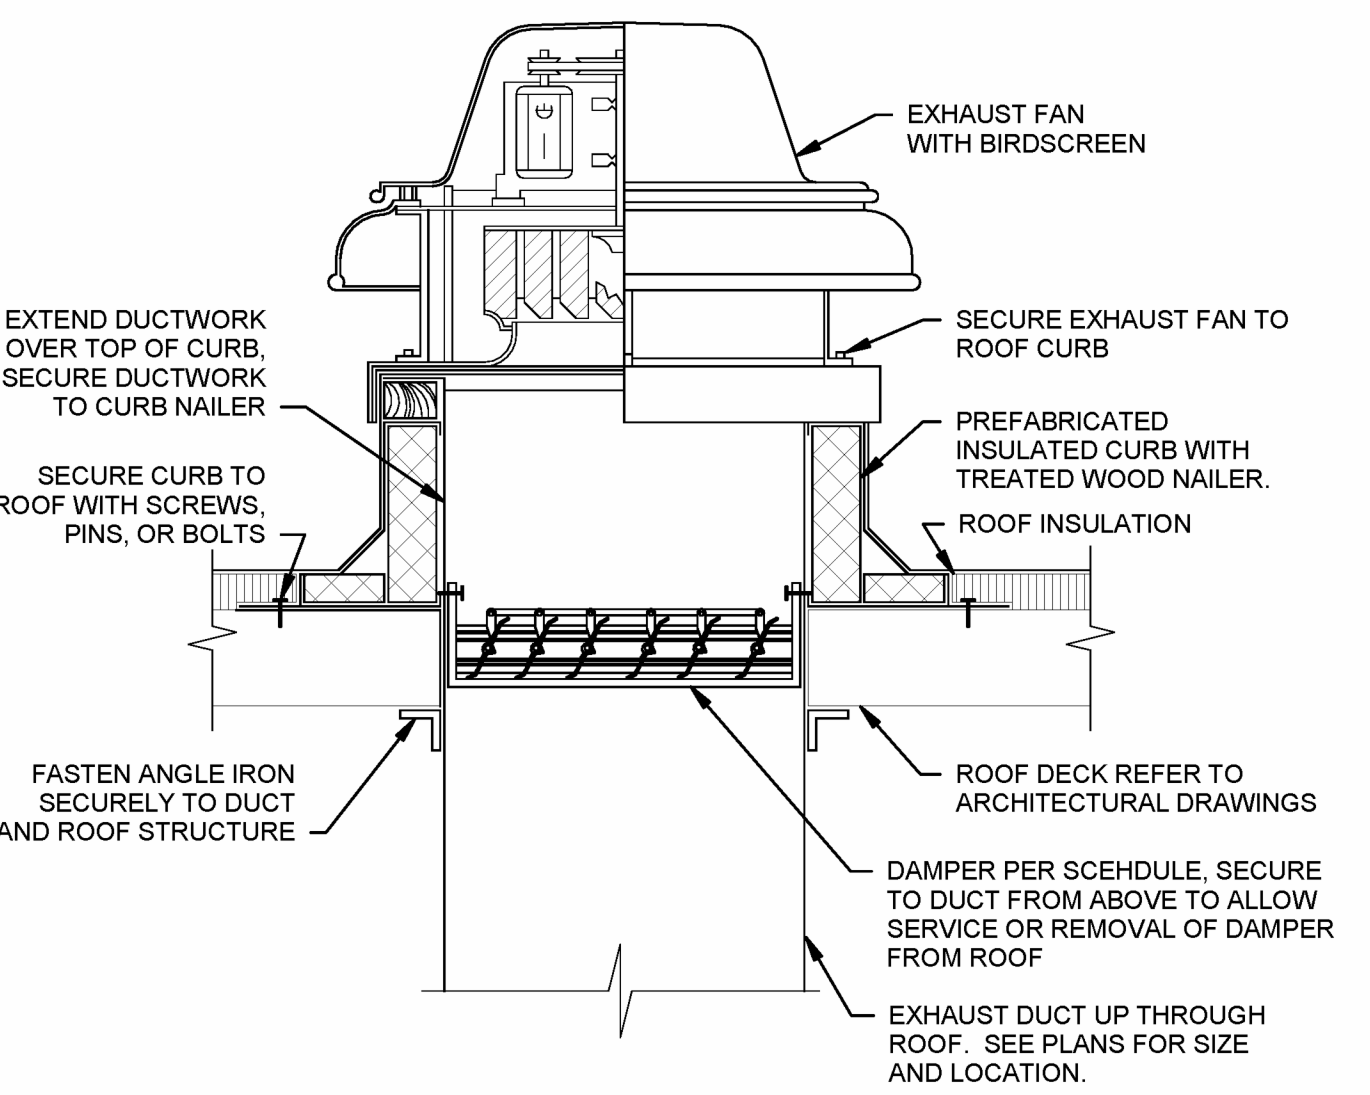


11 DOWNBLAST EXHAUST FAN DETAIL NTS

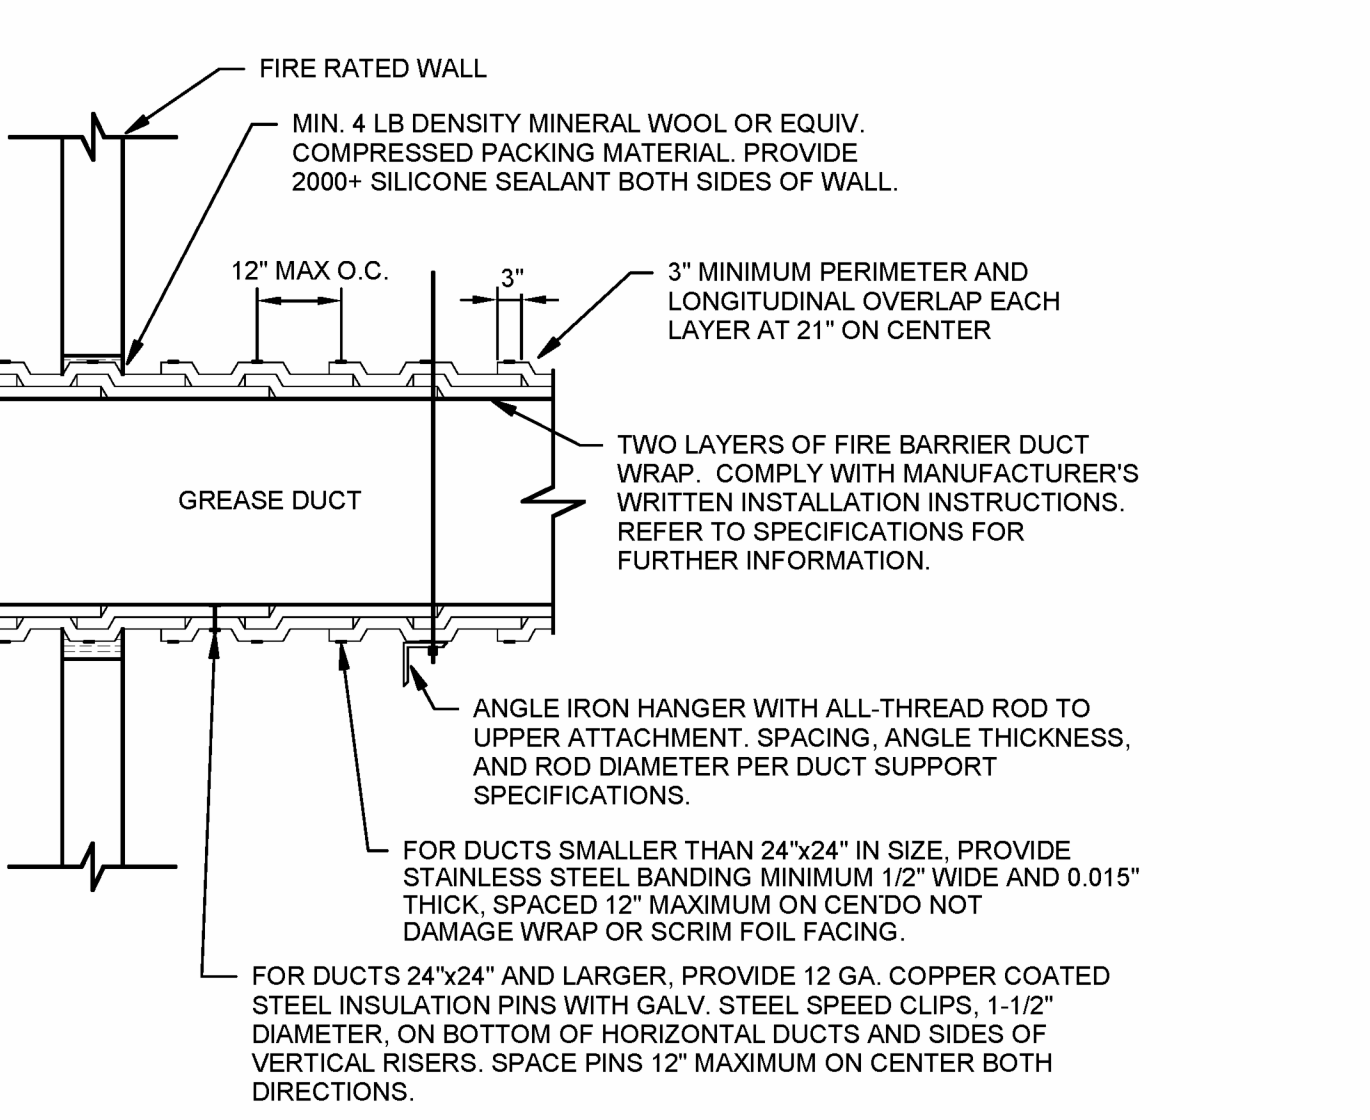


- NOTES:
- INSTALL GREASE EXHAUST AND FIRE RATED DUCT WRAP IN ACCORDANCE WITH THE MANUFACTURER'S APPROVED INSTRUCTIONS AND UL LISTED INSTALLATION DETAILS. TECHNIQUES THAT DIFFER FROM THE ABOVE METHOD ARE ACCEPTABLE IF THEY ARE UL TESTED AND APPROVED.

7 GREASE DUCT FIRE WRAP INSULATION INSTALLATION DETAIL NTS

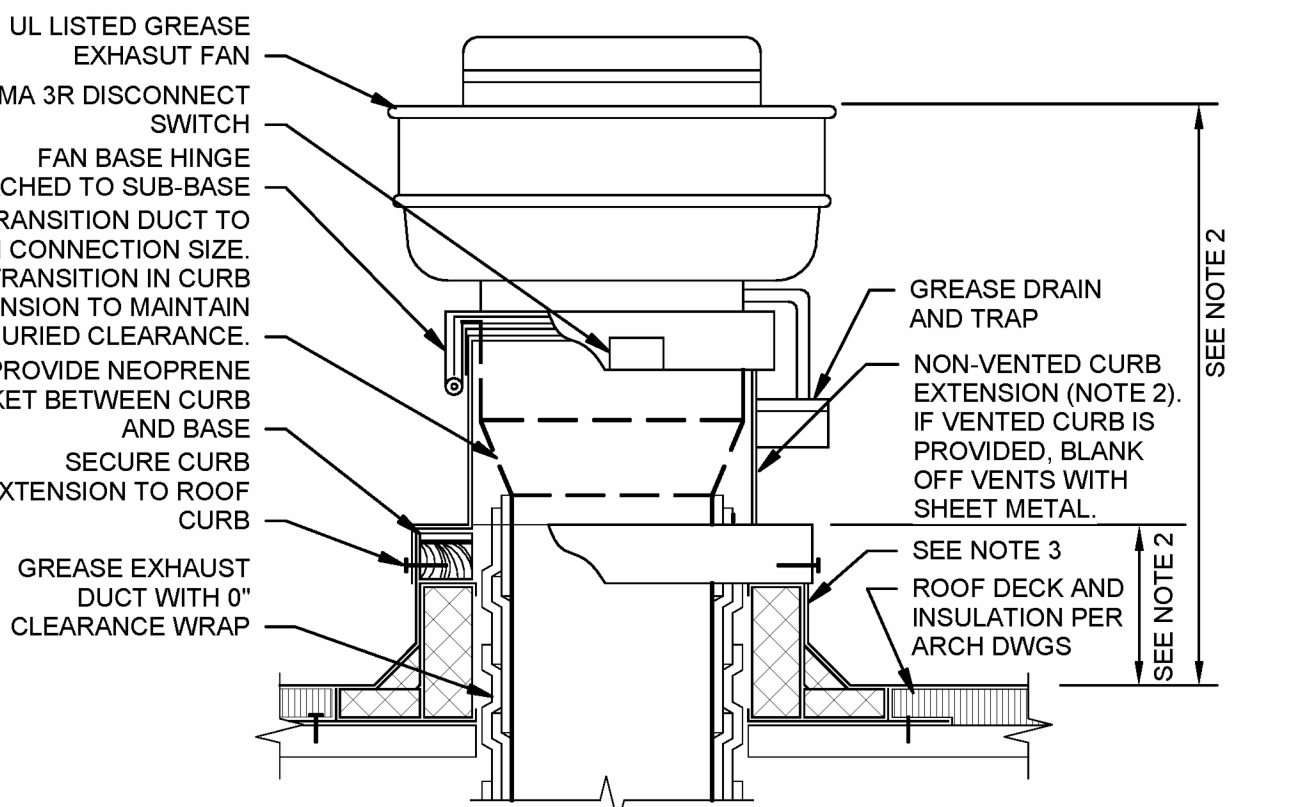


- NOTES:
- ARRANGEMENT SHOWN IS SCHEMATIC. ADJUST TO SUIT FIELD CONDITIONS AND MEET LOCAL CODE.
  - PROVIDE CURB EXTENSION MADE FROM NON-COMBUSTIBLE MATERIAL OF HEIGHT REQUIRED TO MOUNT FAN BASE A MINIMUM 18 INCHES ABOVE COMBUSTIBLE CURB MATERIAL AND DISCHARGE GREASE OUTLET A MINIMUM OF 40 INCHES ABOVE ROOF SURFACE OR ANY ADJACENT BUILDING STRUCTURE WITHIN 10 FEET OF OUTLET, WHICHEVER IS HIGHER.
  - PREFABRICATED INSULATED ROOF CURB WITH TREATED WOOD NAILER, CANT, AND STEP AS REQUIRED TO ACCOMMODATE ROOF INSULATION, FRAME AND SECURE CURB TO ROOF WITH METHOD CONSISTENT WITH ROOF CONSTRUCTION. ROOF CURB SHALL BEAR ON ROOF STRUCTURE. FOR SLOPED ROOFS, PROVIDE CURB WITH DIMENSIONS CAPABLE OF COMPENSATING ROOF SLOPE TO ENSURE FAN IS INSTALLED LEVEL. REFER TO ARCHITECTURAL DRAWINGS AND CURB MANUFACTURER'S DETAILS FOR MORE INFORMATION.
  - HIGH WIND STRAPINGS: PROVIDE STAINLESS STEEL STRAPS OF LENGTH, WIDTH, THICKNESS, AND SPACING SUFFICIENT TO SECURE FAN TO CURB TO WITHSTAND WIND SPEED REQUIREMENTS PER LOCAL CODE. WRAP STRAPS OVER FAN AND SECURELY ATTACH TO OPPOSITE SIDE OF THE CURB.

12 UPBLAST GREASE EXHAUST FAN DETAIL NTS

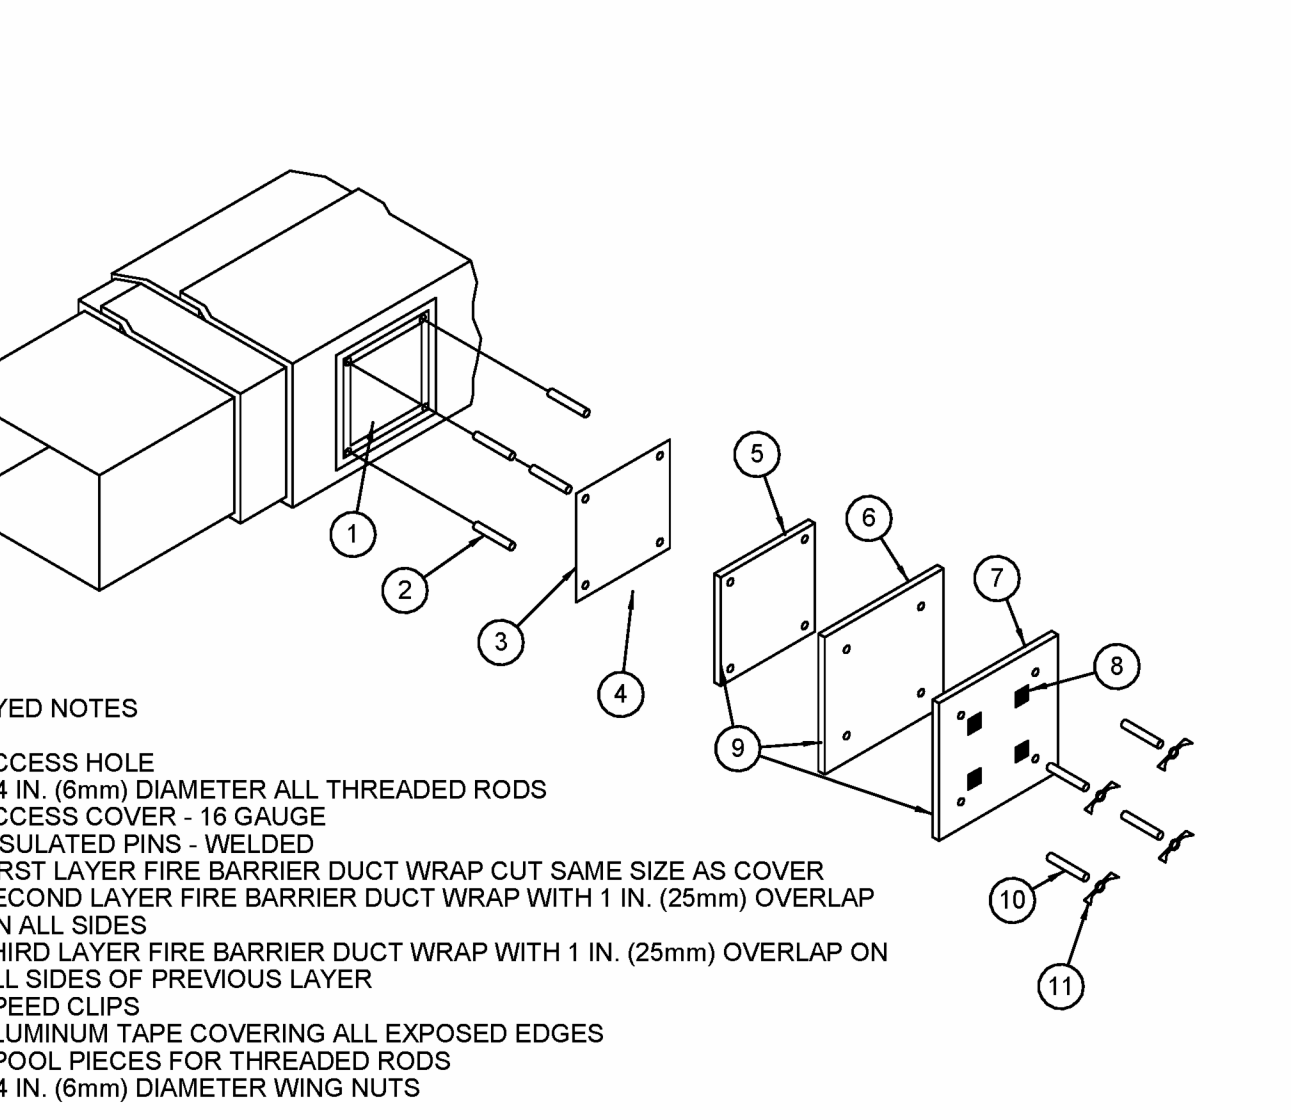

- NOTES:
- FOR REFERENCE ONLY. INSTALL PER MANUFACTURER'S RECOMMENDATIONS.
  - AT CONTRACTOR'S OPTION, A LISTED UL 1978 GREASE ACCESS DOOR PRODUCT MAY BE SUBSTITUTED FOR THE ACCESS DOOR PICTURED IN THIS DETAIL. DOOR SHALL BE RATED FOR UP TO 2,300°F AND MEET NFPA96 STANDARDS. BOLTS SHALL BE LONG ENOUGH FOR DUCT WRAP SYSTEM (WHEN USED), INSTALL IN ACCORDANCE WITH MANUFACTURER'S LITERATURE.

8 GREASE DUCT CLEANOUT ACCESS DOOR DETAIL NTS

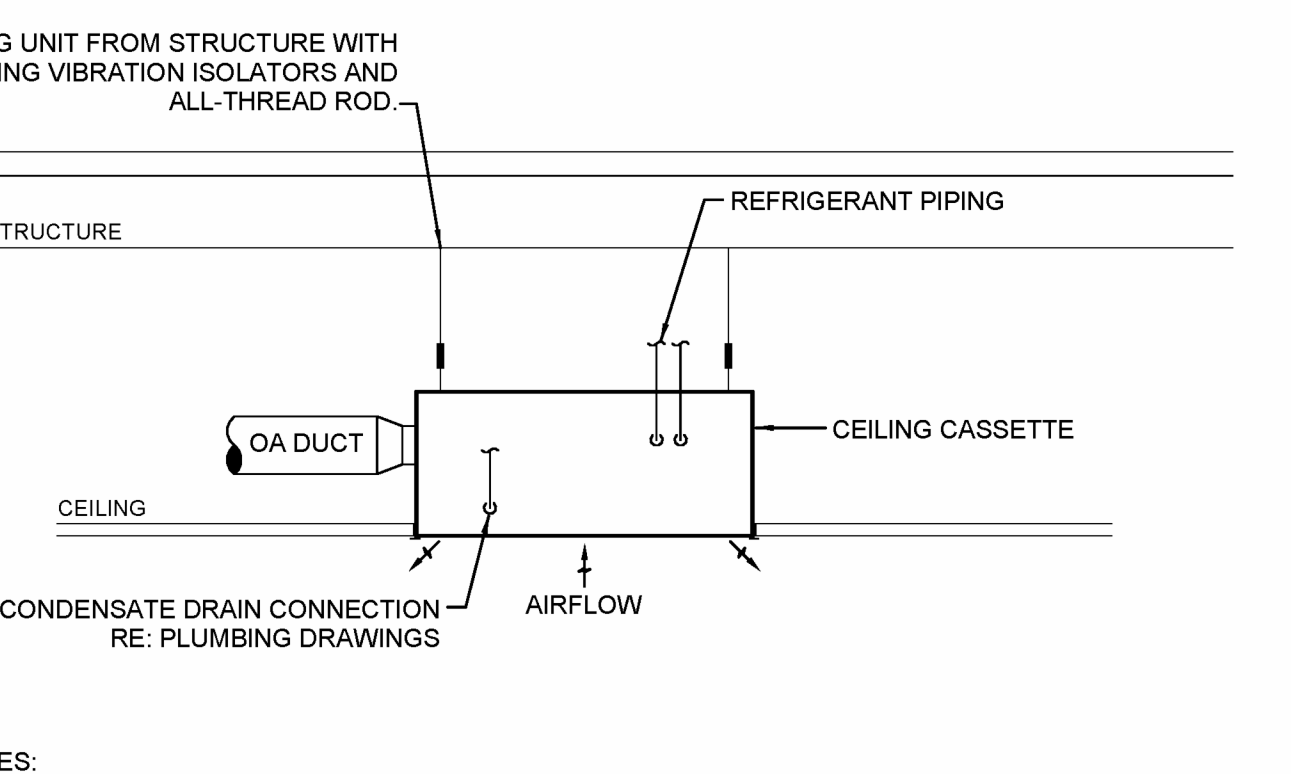

- NOTES:
- ARRANGEMENT SHOWN IS SCHEMATIC. ADJUST TO SUIT FIELD CONDITIONS AND MEET LOCAL CODE REQUIREMENTS.
  - SET DAMPER TO DELIVER SCHEDULED OUTSIDE AIR FLOW.
  - REFER TO MANUFACTURER'S RECOMMENDATIONS FOR MAXIMUM CONDENSATE DRAIN LIFT HEIGHTS.
  - REFER TO MANUFACTURER'S RECOMMENDATIONS FOR HORIZONTAL CONDENSATE DRAIN LIFT CONNECTION FROM THE UNIT.

4 CEILING CASSETTE DETAIL NTS



3 DUCT MOUNTED REGISTER DETAIL NTS

Division 23: TABLE OF CONTENTS

GENERAL MECHANICAL REQUIREMENTS

1. GENERAL INSTRUCTIONS

- A. GENERAL REQUIREMENTS
B. DEFINITIONS
C. PRE-BID SITE VISIT
D. MATERIAL AND WORKMANSHIP
E. MANUFACTURERS
F. COORDINATION
G. ORDINANCES AND CODES
H. PROTECTION OF EQUIPMENT AND MATERIALS
I. SUBSTITUTIONS
J. SUBMITTALS
K. ELECTRONIC DRAWINGS FILES
L. RECORD DRAWINGS (AS-BUILT DRAWINGS)
M. OPERATION AND MAINTENANCE INSTRUCTIONS
N. SPARE PARTS
O. TRAINING
P. WARRANTIES

2. GENERAL MATERIALS AND INSTALLATION

- A. BUILDING OPERATION
B. EXISTING EQUIPMENT REUSE AND REMOVAL
C. EXCAVATION AND BACKFILLING
D. COINCIDENTAL DAMAGE
E. CUTTING AND PATCHING
F. ROUGH-IN
G. STRUCTURAL SUPPORT SYSTEMS
H. PRE-ENGINEERED ROOF EQUIPMENT SUPPORTS AND CURBS
I. ACCESS PANELS AND DOORS
J. PENETRATIONS
K. FIRE STOPPING
L. MOTORS AND STARTERS
M. VARIABLE FREQUENCY DRIVES
N. ELECTRICAL WIRING WITH OTHERS
O. EQUIPMENT FURNISHED BY OTHERS
P. SYSTEM TESTING, ADJUSTING, AND BALANCING
Q. VIBRATION ISOLATION
R. SEISMIC CONTROLS FOR MEFP SYSTEMS
S. AIR FILTERS
T. REFRIGERANT AND OIL
U. IDENTIFICATION

3. DUCT INSULATION, DUCTWORK, ACCESSORIES, FLUES AND FANS

- A. DUCT INSULATION
B. DUCTWORK
C. FLEXIBLE DUCT
D. PLASTIC FLUE GAS VENTS
E. AIR DEVICES
F. CONTROL DAMPERS
G. LOUVERS, PLENUMS, SCREENS
H. EXHAUST AIR SYSTEMS
I. KITCHEN EXHAUST AIR SYSTEMS

4. HVAC EQUIPMENT

- A. ROOFTOP UNITS (GAS FIRED HEAT) 3-25 TONS
B. ELECTRIC UNIT HEATERS
C. SPLIT DUCTLESS AIR-CONDITIONING SYSTEMS
D. AIR CURTAINS

5. PIPING AND PIPING SPECIALTIES

- A. REFRIGERANT PIPING AND INSULATION
B. SYSTEM EVACUATION AND CHARGING

6. TEMPERATURE CONTROLS

- A. GENERAL REQUIREMENTS
B. WIRING
C. THERMOSTAT CONTROL EQUIPMENT
D. SENSORS AND RELAYS

7. SEQUENCE OF OPERATION

- A. FAN COIL UNIT CONTROL
B. KITCHEN EXHAUST FAN CONTROL
C. ROOFTOP UNIT CONTROL
D. RESTROOM EXHAUST FAN (EF-1) CONTROL
E. AIR CURTAIN CONTROL
F. ELECTRIC UNIT HEATER CONTROL

8. ALTERNATIVES

- A. DESCRIPTION

9. COMMISSIONING OF MECHANICAL SYSTEM

- A. GENERAL
B. EXECUTION

Division 23: HEATING, VENTILATING, AND AIR CONDITIONING

1. GENERAL INSTRUCTIONS

A. GENERAL REQUIREMENTS

All requirements under Division 01 and the general and supplementary conditions of these specifications apply to this section and division. Where the requirements of this section and division exceed those of Division 01, this section and division take precedence. Become thoroughly familiar with all its contents so as to requirements that affect this division, section, or both. Work required under this division includes all materials, equipment, transportation, services, and labor required to complete the entire system as required by the drawings and specifications, or reasonably inferred to be necessary to facilitate the function of each system as implied by the design and the equipment specified.

The specifications and drawings for the project are complementary, and any portion of work described in one shall be provided as if described in both. In the event of discrepancies, notify the Engineer and request clarification prior to proceeding with the work involved.

Drawings are graphic representations of the work upon which the contract is based. They show the materials and their relationship to one another, including sizes, shapes, locations, and connections. They convey the scope of work, indicating the intended general arrangement of the systems without showing all of the exact details, elevations, offsets, control lines, and other installation requirements. Use the drawings as a guide when laying out the work and to verify that materials and equipment will fit into the designated spaces, and which when installed per manufacturers' requirements, will ensure a complete, coordinated, satisfactory, and properly operating system.

B. DEFINITIONS

Division: References contained in this specification follow the numbering system defined in the Construction Specifications Institute (CSI) MasterFormat 2004 Edition. Specification Divisions 01 through 13 provided with this project may reference the CSI MasterFormat 1995 Edition. The corresponding division references between the 2004 Edition and 1995 Edition are as follows:
2004 Edition 1995 Edition
1. Division 21 - Fire Suppression Division 15
2. Division 22 - Plumbing Division 16
3. Division 23 - HVAC Division 15
4. Division 26 - Electrical Division 16
5. Division 27 - Communications Division 16
6. Division 28 - Electronic Safety and Security Division 16

Furnish: "to supply and deliver to the project site, ready for loading, unpacking, assembly, installation and similar operations."

Install: "to perform all operations at the project site including, but not limited to, the actual unloading, unpacking, assembling, erecting, placing, anchoring, applying, working to dimension, finishing, curing, protecting, cleaning, testing, commissioning, starting up and similar operations, complete, and ready for the intended use."

Provide: "to furnish and install."

Furnished by Owner (or Owner-Furnished) or Furnished by Others: "an item furnished by the Owner or under other divisions or contracts, and installed under the requirements of this division, complete and ready for intended use, including all items and services incidental to the work necessary for proper installation and operation. Include the installation under the warranty required by this division."

Engineer: Where referenced in this division, "Engineer" is the Engineer of Record and the Design Professional for the work under this division, and is a consultant to, and an authorized representative of the Architect, as defined in the General and/or Supplementary Conditions. When used in this division, "Engineer" means increased involvement by and obligations to the Engineer, in addition to involvement by and obligations to the Architect.

AHJ: The local code and/or inspection agency (Authority) Having Jurisdiction over the work.

NRTL: Nationally recognized testing laboratory, as defined and listed by OSHA in 29 CFR 1910.7 (e.g., UL, ETL, CSA), and acceptable to the AHJ over this project. Nationally recognized testing laboratories and standards listed are used only to identify the characteristics required and are not intended to restrict the use of other NRTLs that are acceptable to the AHJ and standards that meet the specified criteria.

Substitution: Changes in products, materials, equipment, and methods of construction from those required by the Contract Documents and proposed by Contractor. Substitutions include Value Engineering proposals.

1. Substitutions for Cause: Changes proposed by Contractor that are required due to changed Project conditions, such as unavailability of product, regulatory changes, or unavailability of required warranty terms.

2. Substitutions for Convenience: Changes proposed by Contractor or Owner that are not required in order to meet other Project requirements but may offer advantage to Contractor or Owner.

The terms "approved equal," "equivalent," or "equal" are used synonymously and shall mean "accepted by or acceptable to the Engineer as equivalent to the item or manufacturer specified". The term "approved" shall mean labeled, listed, or both, by an NRTL, and acceptable to the AHJ over this project.

C. PRE-BID SITE VISIT

Prior to submitting bid, visit the site of the proposed work and become fully informed as to the conditions under which the work is to be done. Failure to comply with this requirement shall not be considered sufficient justification to request or obtain extra compensation over and above the contract price.

D. MATERIAL AND WORKMANSHIP

Provide new material, equipment, and apparatus under this contract unless otherwise stated herein, of best quality normally used for the purpose in good commercial practice, and free from defects. Install material and equipment in accordance with the manufacturer's installation instructions. Model numbers listed in the specifications or shown on the drawings are not necessarily intended to designate the required trim, written descriptions of the trim govern model numbers.

Pipe, pipe fittings, pipe specialties and valves shall be manufactured in plants located in the United States or certified to meet the specified ASTM and ANSI standards.

Work performed under this contract shall provide a neat and "workmanlike" appearance when completed, to the satisfaction of the Architect and Engineer. Workmanship shall be the finest possible by experienced mechanics. Installations shall comply with applicable codes and laws.

The complete installation shall function as designed and intended with respect to efficiency, capacity, noise level, etc. Abnormal noise caused by rattling equipment, piping, ducts, air devices, and squeaks in rotating components shall not be acceptable. Materials and equipment shall be of commercial specification grade in quality. Light duty and residential grade equipment shall not be accepted unless otherwise indicated.

Remove from the premises waste material present as a result of work, including cartons, crating, paper, stickers, and/or excavation material not used in backfilling, etc. Clean equipment installed under this contract to present a neat and clean installation at the termination of the work.

Repair or replace public and private property damaged as a result of work performed under this contract to the satisfaction of authorities and regulations having jurisdiction. Provide all safety lights, guards, and warning signs required for the performance of the work and for the safety of the public.

E. MANUFACTURERS

In other articles where lists of manufacturers are introduced, subject to compliance with requirements, provide products by one of the manufacturers specified.

Where a list is provided, manufacturers are listed alphabetically and not in accordance with any ranking or preference. Where manufacturers are not listed, provide products subject to compliance with requirements from manufacturers that have been actively involved in manufacturing the specified product for no less than 5 years.

F. COORDINATION

Coordinate work with that of other trades so that the various components of the systems are installed at the proper time, will fit the available space, and will allow proper service access to those items requiring maintenance. Components which are installed without regard to the above shall be relocated at no additional cost to the Owner.

Unless otherwise indicated, the General Contractor shall provide chases and openings in building construction required for installation of the systems under this contract. Coordinate work with other trades and equipment. Where chases and openings are required, Contractor shall keep informed as to the work of other trades engaged in the construction of the project and shall execute work in a manner as to not interfere with or delay the work of other trades.

Figured dimensions shall be taken in preference to scale dimensions. Contractor shall take his own measurements at the building, as variations may occur. Contractor shall be held responsible for errors that could have been avoided by proper checking and inspection. Provide materials with trim that will properly fit the types of ceiling, wall, or floor finishes actually installed. Model numbers listed in the specifications or shown on the drawings are not intended to designate the required trim.

G. ORDINANCES AND CODES

Work performed under this contract shall, at a minimum, be in conformance with applicable national, state and local codes having jurisdiction. Equipment furnished and associated installation work performed under this contract shall be in strict compliance with current applicable codes adopted by the local AHJ, including any amendments and standards as set forth by the following:
1. National Electrical Code (NEC)
2. National Fire Protection Association (NFPA)
3. Underwriters Laboratories (UL)
4. Occupational Safety and Health Administration (OSHA)
5. American Society of Mechanical Engineers (ASME)
6. American Society of Heating, Refrigerating, and Air Conditioning Engineers (ASHRAE)
7. American National Standards Institute (ANSI)
8. American Society of Testing and Materials (ASTM)
9. Other national standards and codes where applicable.

Where the contract documents exceed the requirements of the referenced codes, standards, etc., the contract documents shall take precedence. Where conflicts between various codes, ordinances, rules, and regulations exist, comply with the most stringent.

Promptly bring all conflicts observed between codes, ordinances, rules, regulations, referenced standards, and these documents to the attention of the Architect and Engineer for final resolution. Contractor will be held responsible for any violation of the law.

Procure and pay for permits and licenses required for the accomplishment of the work herein described. Where required, obtain, pay for, and furnish certificates of inspection to Owner.

H. PROTECTION OF EQUIPMENT AND MATERIALS

Store and protect from damage equipment and materials delivered to job site. For materials and equipment susceptible to changing weather conditions, dampness, or temperature variations, store inside in conditioned spaces. For materials and equipment not susceptible to these conditions, cover with waterproof, tear-resistant, heavy tarp or polyethylene plastic as required to protect from plaster, dust, dirt, paint, water, or physical damage. Replace insulation that has become wet at any time during construction. Drying the insulation is not acceptable. Seal any tears or joints of internal fiberglass insulation. Equipment and material damaged by construction activities shall be rejected and Contractor shall furnish new equipment and material of a like kind at his own expense.

Keep premises broom clean and communication wiring for work performed under this contract. Piping, equipment, etc. shall have a neat and clean appearance at the termination of the work. Remove debris from ceiling/return air plenum, including dust.

Plug, seal, or cap open ends of ductwork and piping systems while stored and installed during construction when not in use to prevent the entrance of debris into the systems. Remove temporary protection prior to starting equipment and turning the system over to the owner.

I. SUBSTITUTIONS

Materials, products, equipment, and systems described in the Bidding Documents establish a standard of required function, dimension, appearance and quality to be met by the proposed substitution. The base bid shall include only the products from manufacturers specifically named in the drawings and specifications. To request a substitution, request the Substitution Request Form from the Architect or Engineer. Complete and send the Substitution Request Form for each material, product, equipment, or system that is proposed to be substituted. The burden of proof of the merit of the proposed substitution is upon the proposer.

Unless stated otherwise in writing to the Engineer by the Contractor, Contractor warrants to the Engineer, Architect, and Owner the following:

- 1. Proposed substitution has been fully investigated and determined to meet or exceed the specified Work in all respects unless stated otherwise in the substitution request.
2. Proposed substitution is consistent with the Contract Documents and will produce indicated results, including functional clearances, maintenance service, and sourcing of replacement parts.
3. Proposed substitution has received necessary approvals of authorities having jurisdiction.
4. Same warranty will be furnished for proposed substitution as for specified Work.
5. If accepted substitution fails to perform as required, Contractor shall replace substitute material or system with that originally specified and bear cost of replacement.
6. Coordination, installation and changes in the Work as necessary for accepted substitution will be complete in all respects.

No substitutions will be considered unless the Substitution Request Form is completed and attached with the appropriate substitution documentation. No substitution will be considered prior to receipt of bids unless written request for approval to bid has been received by the Engineer at least ten (10) calendar days prior to the date for receipt of bids.

If the proposed substitution is approved prior to receipt of bids, such approval will be stated in an addendum. Bidders shall not rely upon approvals made in any other way. Verbal approval will not be given. No substitutions will be considered after the contract is awarded unless specifically provided in the contract documents.

J. SUBMITTALS

Assemble and submit for review shop drawings, material lists, manufacturer product literature for equipment to be furnished, and items requiring coordination between contractors under this contract. Provide submittals in sufficient detail so as to demonstrate compliance with these contract documents and the design concept. Prior to transmitting submittals, verify that the equipment submitted is mutually compatible and suitable for the intended use, will fit the available space, and maintain manufacturer recommended service clearances. If size of equipment furnished makes necessary any change in location or configuration, submit a shop drawing showing the proposed layout.

Transmit submittals as early as required to support the project schedule. Allow for two weeks Engineer review time, plus 10% from mailing time via the Architect, plus a duplication of this time for resubmittal, if allowed. If you resubmit these sections request for resubmittal.

Submittals shall contain the project name, applicable specification section, submittal date, equipment identification acronym as used on the drawings, and the Contractor's stamp. The stamp shall certify that the submittal has been checked by the Contractor, complies with the drawings and specifications, and is coordinated with other trades. Manufacturer product literature shall include shop drawings, product data, performance sheets, and similar data required by this division. Highlight, mark, list, or indicate the materials, performance criteria, and accessories that are being proposed. General product catalog data not specifically noted to be part of the specified product will be rejected and returned without review.

Submittals and shop drawings shall not contain the firm name, logo, seal, or signature of the Engineer. They must be copies of the work product of the Engineer. If the Contractor desires to use elements of such product, refer to paragraph "Electronic Drawing Files" for procedures to be used.

Separate submittals according to individual specification sections. Illegible submittals will be rejected and returned without review. Catalog data shall be properly bound, identified, indexed and filed as a 3-ring binder. Each item or model number shall be clearly marked and accessories indicated. Label the catalog data with the equipment identification acronym or number as used on the drawings and include performance curves, capacities, sizes, weights, materials, finishes, wiring diagrams, electrical requirements and deviations from specified equipment materials. For equipment with motor starters or VFDs, include short circuit current ratings. Mark out inapplicable items. Shop drawings will be returned without review if the above mentioned requirements are not met.

Provide the quantity of submittals required by Division 01. If not indicated and hard-copy sets are provided, submit a minimum of six (6) copies. Refer to Division 01 for acceptance of electronic submittals for this project. For electronic submittals, Contractor shall submit the documents in accordance with the procedures specified in Division 01. Contractor shall notify the Architect and Engineer that the submittals have been posted in Division 01. Contractor shall include the website, user name, and password information needed to access the submittals. For submittals sent by e-mail, Contractor shall copy the designated representatives of the Architect and Engineer. Contractor shall allow for the Engineer review time as specified above in the contract documents. Contractor shall submit only the documents required to purchase the materials and/or equipment in the electronic submittal.

The checking and subsequent acceptance of submittals by the Engineer and/or Architect shall not relieve the Contractor from responsibility for deviations from the drawings and specifications, errors in dimensions, details, size of members, or quantities, omissions of components or fittings, coordination of electrical requirements; and not coordinating items with actual building conditions and adjacent work. Proceed with the procurement and installation of equipment only after receiving approved shop drawings relative to each item.

K. ELECTRONIC DRAWING FILES

In preparation of shop drawings or record drawings, Contractor may, at his option, obtain electronic drawing files in AutoCAD or DXF format on CD-ROM disk, DVD disk, flash drive or direct download, as desired, from the Engineer for a shipping and handling fee of \$200 for a drawing set up to 12 sheets and \$15 per sheet for each additional sheet. Contact the Architect for written authorization and Engineer for the necessary release agreement form and to specify shipping method and drawing format. In addition to payment, the written authorization from the Architect and release agreement form from the Engineer must be received before electronic drawing files will be sent.

L. RECORD DRAWINGS (AS-BUILT DRAWINGS)

During progress of the work in this division, Contractor shall maintain an accurate record of all changes made during the installation of the system. Upon completion of the work, all record information to three identical sets of the approved shop drawings. Insert one set into each copy of the manual described below.

See Division 01 and General Conditions for additional information.

M. OPERATION AND MAINTENANCE INSTRUCTIONS

During the course of construction, collect and compile a complete brochure of equipment furnished and installed on this project. Include operational and maintenance instructions, manufacturer's catalog sheets, wiring diagrams, parts lists, approved submittals and shop drawings, warranties, and descriptive literature, as furnished by the equipment manufacturer. Include an inside cover sheet that lists the project name, date, Owner, Architect, Engineer, General Contractor, Sub-Contractor, and an index of contents.

Submit three copies of literature bound in approved binders with index and tabs separating equipment types to the Architect, for Engineer's review, at the termination of the work. Paper clips, staples, rubber bands, loose-leaf binding, and mailing envelopes are not considered approved binders. Final approval of systems installed under this contract shall be withheld until this equipment brochure is received and deemed complete by the Architect and Engineer. Instruct workmen to save required literature shipped with the equipment itself for inclusion in this brochure.

Include Record Drawings as described above.

Refer to Division 01 for acceptance of electronic manuals for this project. For electronic manuals, refer to paragraph "Submittals" for requirements.

N. SPARE PARTS

Furnish to Owner, with receipt, the following spare parts for the equipment furnished for this project:

- 1. One set of spare filters of each type required for each unit. In addition to the spare set of filters, install new filters prior to testing, adjusting, and balancing work and before turning system over to Owner.
2. Furnish one complete set of belts for each fan.
3. Furnish three operating keys for each type of air outlet and inlet that require them.

O. TRAINING

At a time mutually agreed upon between the Owner and Contractor, provide the services of a factory trained and authorized representative to train Owner's designated personnel on the operation and maintenance of the equipment provided for this project.

Provide training to include, but not be limited to, an overview of the system and/or equipment as it relates to the facility as a whole; operation and maintenance procedures and schedules related to startup and shutdown, troubleshooting, servicing, preventive maintenance and appropriate operator intervention; and review of data included in the operation and maintenance manuals.

Submit a certification letter to the Architect stating that the Owner's designated representative has been trained as specified herein. Letter shall include date, time, attendees and subject of training. The Contractor and the Owner's representative shall sign the certification letter indicating agreement that the training has been provided.

Schedule training with Owner with at least 7 days advance notice.

P. WARRANTIES

Warrant each system and each element thereof against all defects due to faulty workmanship, design, or material for a period of 12 months from date of Substantial Completion, unless specific items are noted to carry a longer warranty in the construction documents or manufacturer's standard warranty exceeds 12 months. Remedy all defects, occurring within the warranty period(s), as stated in the General Conditions and Division 01.

Warranties shall include labor and material, including travel expenses. Make repairs or replacements without any additional costs to the Owner, and to the satisfaction of the Owner, Architect, and Engineer.

Perform the remedial work promptly, upon written notice from the Engineer or Owner.

At the time of Substantial Completion, deliver to the Owner all warranties, in writing and properly executed, including term limits for warranties extending beyond the one year period and any actions the Owner must take in order to maintain warranty status. Each warranty instrument shall be addressed to the Owner and state the commencement date and term.

2. GENERAL MATERIALS AND INSTALLATION

A. BUILDING OPERATION

Comply with the schedule of operations as outlined in the architectural portions of this specification. Accomplish work requiring interruption of building operation at a time when the building is not in operation and only with written approval of building Owner and/or tenant. Coordinate interruption of building operation with the Owner and/or tenant a minimum of seven (7) days in advance of work.

B. EXISTING EQUIPMENT REUSE AND REMOVAL

Remove all unused equipment, ductwork, piping, and associated supports. Cap ductwork and piping at mains and seal air and water tight.

Provide items of HVAC systems modification required because of building remodeling, as noted on the drawings or necessary for proper operation. Match existing materials and construction techniques when modifying existing systems unless specified otherwise. Coordinate additional requirements with General Contractor and Architect.

Seal airtight existing ductwork required to be abandoned in place or not in use at the termination of the work.

Cap and seal weathertight existing roof curbs and roof openings to be abandoned in place as a result of equipment removal.

Clean and seal existing ductwork, diffusers, registers, and grilles intended for reuse as required or as indicated on drawings.

Clean and refurbish existing HVAC equipment intended for reuse as required for proper operation including replacement of filters, belts, motors, remote controls, and safety interlocks.

C. EXCAVATION AND BACKFILLING

Perform excavation and backfill required for installation of underground work under this contract. Trenches shall be of sufficient width. Crib or brace trenches to prevent cave-in or settlement. Do not excavate trenches close to columns and walls of new building without prior consultation with the Architect. Use pumping equipment if required to keep trenches free of water. Backfill trenches in maximum 6 inch layers of well-graded dry earth in a manner to prevent future settlement.

Excavation as specified herein shall be classified as common excavation. Common excavation shall comprise the satisfactory removal and disposition of material of whatever substances and of every description encountered, including rock, if any, within the limits of the work as specified and shown on the drawings. Excavation shall be performed to the lines and grades indicated on the drawings. Dispose of excavated materials that are considered unsuitable for backfill and surplus of excavated material which is not required for backfill to the satisfaction of the Architect.

D. COINCIDENTAL DAMAGE

Repair streets, sidewalks, drives, paving, walls, finishes, and other facilities damaged in the course of the work. Repair materials shall match existing construction. Repair work shall meet all requirements of the Owner, local authorities having jurisdiction, and meet the satisfaction of the Architect.

E. CUTTING AND PATCHING

Conform to the requirements in Division 01. Cut walls, floors, ceilings, and other portions of the facility as required to install work under this division. Obtain permission from the Architect prior to cutting. Do not cut or disturb structural members without prior approval from the Architect and Structural Engineer. For post-tension slabs, x-ray slab and closely coordinate all core drill locations with Architect and Structural Engineer prior to performing any work. Obtain approval from Architect and Structural Engineer for all core drills and penetrations at least four days prior to performing work. Penetrations shall be made as small as possible while maintaining required clearances between the building element penetrated and the system component. Patch around openings to match the adjacent construction including fire ratings, if applicable. Repair and refinish areas disturbed by work to the condition of adjoining surfaces in a manner satisfactory to the Architect.

F. ROUGH-IN

Coordinate without delay all roughing-in with other divisions. Conceal piping, conduit, and rough-in structure in unfinished areas and where otherwise shown.

G. STRUCTURAL SUPPORT SYSTEMS

Structural steel used for support of equipment, ductwork and piping shall be new, clean, and conform to ASTM Designation A-36.

Support mechanical components from the building structure. Do not support mechanical components from ceilings, other mechanical or electrical components, and other non-structural elements.

H. PRE-ENGINEERED ROOF EQUIPMENT SUPPORTS AND CURBS

Provide prefabricated equipment support rails and roof curbs manufactured by AEB Industries, Custom Curb, Inc., Pace Company, Thybor or approved equal. Provide with fully tapered raised cant and step to match roof insulation thickness, welded, minimum 18 gauge galvanized steel shell, internally reinforced to load bearing factors of equipment being supported, minimum 1-1/2 inch thick, 3 pound rigid insulation internal to shell to maintain continuous roof insulation where required, factory installed wood nailer, and minimum 18 gauge joist with counterflashing where equipment does not fully cover the equipment support. Provide sloped roof equipment supports to enable level installation. Provide rigid backing material behind cant to maintain cant shape. Provide multiple support rails to uniformly support the equipment. Attach to roof structure according to manufacturer's installation instructions.

Attach equipment directly to pre-engineered roof equipment support using one of the following methods:

- 1. Rail Equipment Supports: Secure each equipment support leg to the rail with a minimum of 4 points of connection per leg.
2. Roof Curbs: Secure each curb with a minimum of 4 fasteners, located along the length of the curb. Alternatively, secure equipment to the curb using hold-down brackets. Provide minimum 6 inch long, 1/4 gauge galvanized steel brackets sized to wrap around top of curb and under equipment base rail with sufficient horizontal offset to cover overlap gap between the equipment and curb nailing. Secure brackets to equipment and curb nailing using a minimum of 8 points of connection per bracket. Provide one bracket at each corner along the length of the unit.
3. Hold-Down Brackets: Coordinate with the curb manufacturer to determine the quantity of [III] or IV and a Design Wind Speed of [XXX] mph.
4. Submit signed and sealed drawings that indicate the design and installation requirements of pre-engineered roof supports can withstand the design criteria listed. Include installation requirements for anchoring to the roof structure. The Engineer is not responsible and will not provide the seal and signature. Deliver submittal to the local AHJ for approval prior to installation of the contractor provided, pre-engineered roof supports.
5. Provide seismic restraints in accordance with Article "Seismic Controls for MEFP Systems."

I. ACCESS PANELS AND DOORS

Refer to Architectural documents for specification of access panels and doors.

Provide access doors for all concealed equipment and duct and piping accessories that require service where indicated or as required, except where above lay-in ceilings. Access doors shall be adequately sized for the devices served with a minimum size of 18 inches x 18 inches. Access doors should be of the proper construction for type of construction in which it is installed. Obtain Architect's approval of type, size, location and color before ordering. Provide factory-fabricated and assembled units, complete with attachment devices and fasteners ready for installation, concealed hinges, flush screwdriver-operated cam lock, and anchor studs. Provide access doors manufactured by Greenbeck, Milcor, Titus, Zum, or equal.

J. PENETRATIONS

Provide sleeves for pipes passing through above grade concrete or masonry walls, concrete floor or roof slabs. Sleeves are not required for core drilled holes in existing masonry walls, concrete floors or roofs. Provide 10 gauge galvanized steel sleeves for sleeves 6 inches and smaller. Provide galvanized steel metal sleeves for larger than 6 inches. Schedule 40 PVC sleeves are acceptable for installation in areas without return air plenums.

Seal elevated floor, exterior wall and roof penetrations waterproofed and weathertight with non-shrink, non-hardening commercial sealant. Pack with mineral wool and seal both ends with minimum of 1/2 inch sealant.

Seal around penetrations of fire rated assemblies. Coordinate fire ratings and locations with the architectural drawings. Refer to architectural specifications for fire stopping. Provide a product schedule for UL listing, location, wall or floor rating and installation drawing for each penetration fire stop system.

Extend pipe insulation for insulated pipe through floor, wall and roof penetrations, including fire rated walls and floors. The vapor barrier shall be maintained. Size sleeve for a minimum of 1 inch annular clear space between inside of sleeve and outside of insulation.

Provide prefabricated roof curbs where pipes and/or ductwork penetrate elevated slabs or the roof to the exterior. Provide cover over curb of weather-resistant material and seal duct or pipe penetrations through the cover. Provide pipe collar of weather-resistant material with stainless steel pipe clamps for piping penetrations.

Provide box frames for rectangular openings welded 12 gauge galvanized steel attached to forms and of a maximum dimension established by the Architect. Notify the General Contractor or Architect before installing any box openings not shown on the Architectural or Structural drawings.

Seal concrete or masonry exterior wall penetrations below grade with "wall pipes" and mechanical sleeve seals. Provide cast iron "wall pipes" with integral waterstop ring manufactured by Jay R. Smith, Josam, Wade, Watts or Zum. Provide modular mechanical sleeve seals, manufactured by Calpic, Metraflex, or Thundertite / Link Seal.

Seal elevated concrete slab with water proof membrane penetrations with "wall pipes" and water proof sealant. Secure waterproof membrane flashing between "wall pipe" clamping flange and clamping ring. Provide cast iron "wall pipes" with integral waterstop ring manufactured by Jay R. Smith, Josam, Wade, Watts or Zum.

Provide sleeves for horizontal pipe passing through or under foundation. Sleeves shall be cast iron soil pipe two nominal pipe sizes larger than the pipe served.

Provide Schedule 40 PVC pipe sleeves for vertical pressure pipe passing through concrete slab on grade. Sleeves shall be one nominal pipe size larger than the pipe served and two pipe sizes larger than pipe served for ductile iron pipes with restraining rods. Seal water-tight with silicone caulk.

Provide 1/2 inch thick cellular foam insulation around perimeter of non-pressure pipe passing thru concrete slab on grade. Insulation shall extend to 2 inches above and below the concrete slab.

K. FIRESTOPPING

Sealants and accessories shall have fire-resistance ratings indicated, as established by testing identical assemblies in accordance with UL 2079 or ASTM E 814, or other NRTL acceptable to AHJ.

Manufacturers: Hilli, RectorSeal, Specified Technologies Inc., United States Gypsum Company, or 3M corp.

Through and Membrane Penetration Firestopping Systems Product Schedule: Provide UL listing, location, wall or floor rating, and installation drawing for each penetration fire stop system.

Where project conditions require modification to qualified testing and inspecting agency's illustrations for a particular firestopping condition, submit illustration, with modifications marked, approved by penetration firestopping manufacturer's fire-protection engineer as an engineering judgment or equivalent fire-resistance-rated assembly. Include qualifications data for testing agency.

L. MOTORS AND STARTERS



Provide remote sensors where indicated on the drawings and integrate them with the thermostat control equipment. Remote sensors shall have the following features:

1. Wired connection.
2. Temperature sensor.
3. Humidity sensor.
4. Blank faceplate.
5. Where multiple remote sensors are shown for a single unit, the sensors shall be provided in a single device.

Dry-bulb temperature sensors at a minimum shall be accurate to +/- 2 degrees Fahrenheit over the range of 40 to 80 degrees Fahrenheit. Wet-bulb temperature shall be calculated using dry-bulb temperature and humidity and shall be accurate to +/- 2 degrees Fahrenheit. Enthalpy shall be calculated using dry-bulb temperature and humidity and shall be accurate to +/- 3 BTU/lb over the range of 20 to 36 BTU/lb. Humidity sensors at a minimum shall be accurate within +/- 3 percent full range between 20 and 95 percent, with drift less than 1 percent full scale per year. Pressure transmitters at a minimum shall be accurate to +/- 1 percent full scale with drift less than 1 percent full scale per year.

Smoke detectors furnished and installed as indicated in this section or as scheduled on the plans (or heat detectors, if permitted by code) shall shut down each associated unit supply fan upon activation where required by code. Provide remote visual and audible alarm device in an approved location if smoke detectors are not connected to a fire alarm panel and label device as "Air Duct Detector Trouble".

Provide 24 Volt or 120 Volt timeswitches Intermatic Series FM1D20 or equal programmable type with 7-day programming with up to two "ons" and "offs" per day. Battery backup shall provide 48 hours of memory retention. Override timer switches shall be spring wound, 5-hour, normally open type. Coordinate 120 V wiring of timeswitch with electrical contractor if 120 V model is provided.

Provide relays with contact rating, configuration, and coil voltage that is suitable for the application. Relay shall be general purpose, enclosed plug-in type and protected by a heat and shock resistant duct cover. Number of contacts and operational function shall be as required. Transient suppression shall be provided as an integral part of the relay. Contactors shall be single coil, electrically operated, mechanically held, double-break, silver-to-silver type protected by arcing contacts. Positive locking shall be obtained without the use of hooks, latches, or semi-permanent magnets. Operating and release times shall be 100 milliseconds or less.

#### 7. SEQUENCE OF OPERATION

##### A. FAN COIL UNIT CONTROL

During occupied hours, operate fan coil unit supply fan continuously and open outdoor air damper to maintain minimum ventilation. Cycle stage(s) of DX cooling and electric heating to maintain room thermostat set point (75 degrees Fahrenheit cooling, 70 degrees Fahrenheit heating). Duct mounted smoke detectors shall shutdown unit upon alarm.

During unoccupied hours, cycle the fan coil unit supply fan and cooling or heating system to maintain unoccupied setback temperature set points. Outdoor air motorized damper shall be closed during unoccupied hours.

Connect the Outdoor air motorized damper to the same time clock as the restroom exhaust.

##### B. KITCHEN EXHAUST FAN CONTROL

Kitchen exhaust fan shall be energized through on-off switches at the associated exhaust hoods or cooking equipment or through a master kitchen ventilation control panel as indicated on the drawings. Kitchen fans shall be interlocked to operate with cooking appliances, make-up air and other air-handling equipment providing fresh air to the kitchen area as noted or scheduled on the drawings.

##### C. ROOFTOP UNIT CONTROL

Refer to RTU CONTROL MATRIX on Sheet M601 for required rooftop unit control options.

##### D. RESTROOM EXHAUST FAN (EF-1) CONTROL

Operate exhaust fans continuously during occupied hours and shut down during unoccupied hours. Provide a 7-day timeclock to switch each system between occupied and unoccupied operation.

##### E. AIR CURTAIN CONTROL

Interlock air curtain with door limit switch to energize when the door opens. Units scheduled with heating coils shall cycle the stages of heat to maintain room temperature setpoint of 70 F (adj).

#### 8. ALTERNATES

##### A. DESCRIPTION

Refer to the architectural portion of the specification for list of alternates. Applicable sections of the base specifications shall apply to all work required by the alternate unless otherwise specified. Determine whether or not and how each alternate affects work. Include labor, materials, equipment, and transportation services necessary for and incidental to the completion of work under each particular alternate. Furnish separate bid for each alternate applicable to work, stating the amount to be added or deducted from the base bid.

#### 9. COMMISSIONING OF MECHANICAL SYSTEMS

##### Commissioning of HVAC System

##### A. PART 1 GENERAL

###### 1.1 SUMMARY

a. Section includes Cx process requirements for the following HVAC systems, assemblies, and equipment:

1. Air handling units (Supply fans, return fan, packaged units, roof top units, specialized fans)
  2. Exhaust fans
  3. Fan coil units and terminal units
  4. Condensing units
  5. Make-Up air units
  6. Ductwork and piping
- b. Related Requirements:
1. Section 019113 "General Commissioning Requirements" for general Cx process requirement and CxA responsibilities.

###### 1.2 INFORMATIONAL SUBMITTALS

a. Construction Checklists: Draft construction checklists will be created by CxA for Contractor review.

b. Construction Checklists: Installation and Performance test checklists for systems, assemblies, subsystems, equipment, and components to be part of the Cx process and according to requirement in Section 019113 "General Commissioning Requirement".

1. Refrigerant piping, including the following:
  - a. Refrigerant piping, fittings, and specialties.
  - b. Refrigerant charge.
  - c. General duty and specialty valves.
  - d. Meters and gauges.
2. Air distribution systems, including the following:
  - a. Supply, return, and exhaust systems.
  - b. Metal ducts, liners, and fittings.
  - c. Nonmetal ducts and fittings.
  - d. Air-duct accessories, including volume dampers, fire and smoke dampers, turning vanes, sound attenuators, and flexible connectors.
  - e. Duct-mounted access doors and panels.
3. Kitchen exhaust system, including the following:
  - a. Exhaust and makeup air system.
  - b. Metal ducts, liners, and fittings.
  - c. Air-duct accessories, including volume dampers, fire and smoke dampers, turning vanes, sound attenuators, and flexible connectors.
  - d. Duct-mounted access doors and panels.
  - e. Exhaust fans.
  - f. Make-Up air unit
4. Air-handling equipment, including the following:
  - a. Fans and motors.
  - b. Indoor air-handling units with and without coils, dampers, and filters.
  - c. Outdoor air-handling units with and without coils, dampers, and filters.

##### B. PART 3 EXECUTION

###### 3.1 CONSTRUCTION CHECKLISTS

a. Complete detailed construction checklists (prefunctional checklists) prepared by the CxA for HVAC systems, assemblies, subsystems, equipment, and components.

1. Air and hydronic distribution systems, including the following:
  - a. Supply, return, outdoor-air, and exhaust-air distribution systems.
  - b. Automatic dampers.
  - c. Control valves.
2. Heating and cooling terminal and unitary equipment, including the following:
  - a. Unit heaters.
  - b. Fan coil units.
  - c. Electric heating.
3. TAB verification.

###### 3.2 CONSTRUCTION CHECKLIST REVIEW

a. Review and provide written comments on draft construction checklists. CxA will create required draft construction checklists and provide item to Contractor.

b. Return draft construction checklist review comments within 5 days of receipt.

c. When review comments have been resolved, the CxA will provide final construction checklists marked "Approved for Use, (date)."

d. Use only construction checklists marked "Approved for Use, (date)."

###### 3.3 Cx TESTING PREPARATION

a. Certify that HVAC systems, subsystems, and equipment have been installed, calibrated, and started and that they are operating according to the Contract Documents and approved submittals.

b. Set systems, subsystems, and equipment into operating mode to be tested according to approved test procedures (for example, normal shutdown, normal auto position, normal manual position, unoccupied cycle, and alarm conditions).

###### 3.4 Cx TESTS COMMON TO HVAC SYSTEMS

a. Comply with construction checklist requirements, including installation checks, startup, and performance tests requirements for HVAC systems and equipment.

b. Measure capacities and effectiveness of systems, assemblies, subsystems, equipment and components, including operational and control functions, to verify compliance with acceptance criteria.

c. Coordinate schedule with, and perform Cx activities at the direction of CxA.

d. Provide technicians, instrumentation, tools, and equipment to perform and document the following:

1. Construction checklist verification tests.
2. Construction checklist verification tests demonstrations
3. Cx test demonstrations.

#### 3.5 START-UP DOCUMENTATION COMMON TO ALL SYSTEMS

a. The following Start-Up Documentation (Checklists and Tests) shall be considered common to all systems:

1. Checkout shall proceed from lower level devices to larger components to the entire system operation.
2. Verify labeling is affixed per specification and visible.
3. Verify prerequisite procedures are done.
4. Inspect for damage and ensure none is present.
5. Verify system is installed per the manufacturer's recommendations.
6. Verify system has undergone Start-Up per the manufacturer's recommendations.
7. Verify that access is provided for inspection, operation and repair.
8. Verify that access is provided for eventual replacement of the equipment.
9. Verify that record drawings, submittal data and O&M documentation accurately reflect the installed systems.
10. Verify all gauges and test ports are provided as required by contract documents and manufacturer's recommendations.
11. Verify all recorded nameplate data is accurate.
12. Verify that the installation ensures safe operation and maintenance.
13. Verify all rotating and moving parts are properly lubricated.
14. Verify specified replacement material/stock has been provided as required by the Contract Documents.
15. Verify all monitoring and ensure all alarms are active and set per requirements.

#### 3.6 MECHANICAL IDENTIFICATION

a. Include all applicable "Start-Up Checks Common to All Systems".

b. Start-Up Checks: Perform the following checks:

1. Verify all valve tags, piping, duct, and equipment labeling corresponds with drawings and indexes and meets requirements specified. Correct any deficiencies for all piping and duct system.
2. Adjusting: Relocate any mechanical identification device which has become visually blocked by work of this division or other divisions.
3. Cleaning: Clean face of identification devices, and glass frames of valve charts.

#### 3.7 MECHANICAL INSULATION

a. Include all applicable "Start-Up Checks Common to All Systems".

b. Start-Up Checks: Examine all piping, systems and equipment specified to be insulated.

1. Ensure quality of insulation. Patch and repair all insulation damaged after installation.
2. Ensure the integrity of vapor barrier around cold surfaces.

#### 3.8 PIPING GENERAL

a. Include all applicable "Start-Up Checks Common to All Systems".

b. Start-Up Checks: These procedures apply to all installed piping systems, including underground site utilities.

1. Inspect all piping for proper installation, adequate support (with appropriate vibration isolation where applicable) and adequate isolation valves for required service.
2. Provide notifications of pipe cleaning and flushing activities.
3. Flush and clean all piping and clean all strainers. Provide documentation of all related procedures.
4. Ensure adequate drainage is provided at low points and venting is provided at high points.
5. Ensure facilities to effectively drain and fill the system are in place.
6. Ensure air is thoroughly removed from the system as applicable.
7. Provide notification of pressure testing.
8. Pressure and/or leak test all applicable systems in accordance with the requirements in the applicable Division 23 specification.
9. Sterilize applicable piping systems as specified in the individual sections and as required by regulatory authorities.
10. Submit pressure test reports that document the pressure testing results with certification of the results. Include drawings/diagrams indicating sections of pipe that are tested with the corresponding report.
11. Set and adjust fill, pressure, or level controls to the required setting.

#### 3.9 AC MOTORS

a. Include all applicable "Start-Up Checks Common to All Systems".

b. Start-Up Checks: Perform the following checks during start-up and as specified in manufacturer's instructions.

1. Verify proper alignment, installation, and rotation.
2. Verify properly sized overloads are in place.

c. Start-Up Tests: Perform the following tests, measurements, or procedures during start-up and as specified in the manufacturer's instruction.

1. Measure voltage available to all phases. Measure amps and RPM after motor has been placed in operation and is under load.
2. Record all motor nameplate data.

#### 3.10 PACKAGED HEATING AND COOLING UNITS

a. Include all applicable "Start-Up Checks Common to All Systems".

b. Refer to AC Motors in this section.

c. General: Provide the services of a factory-authorized service representative to test and inspect unit installation, provide startup service, and to demonstrate and train Owner's maintenance personnel is required by the Owner.

b. Start-Up Checks: Perform the following inspections/checks during start-up:

1. Test controls and demonstrate compliance with requirements. Replace damaged or malfunctioning controls and equipment.
2. Install new filters after start-up.

###### 3.11 TERMINAL UNITS

a. Include all applicable "Start-Up Checks Common to All Systems".

b. Start-Up Checks: Perform the following inspections/checks during start-up:

1. After construction is completed, including painting if applicable, clean unit exposed surfaces.
2. Clean factory-finished surfaces. Repair any marred or scratches surfaces with manufacturer's touch-up paint.
3. Verify adequate access for maintenance.
4. Check power and control voltages.
5. Check rotation of fan where applicable.
6. Check operation of water leak sensors.
7. Check calibration and operation of the controlling elements.
8. Check control valves for correct close-off and fail position.
9. Install new filter units for terminals requiring same.

###### 3.12 FANS

a. Include all applicable "Start-Up Checks Common to All Systems".

b. General: Provide the services of a factory-authorized service representative to test and inspect exhaust fan installation, provide startup service, and to demonstrate and train Owner's maintenance personnel is required by the Owner.

c. Start-Up Checks: Perform the following inspections/checks during start-up:

1. Inspect the field assembly of components and installation of the units, piping, ductwork, and electrical connections.
2. Clean unit cabinet interiors to remove foreign material and construction dirt and dust. Vacuum clean fan wheel, fan cabinet, coils entering air face. Ensure volatile irritants are contained and kept out of occupied spaces.
3. Adjust and lubricate dampers and linkages for proper damper operation.
4. Verify the unit is secure on mountings and supporting devices and connections for ductwork, and electrical are complete. Verify proper thermal overload protection is installed in motors, starters, and disconnects.
5. Ensure vibration isolation integrity is maintained with the fan installation and associated connections.
6. Lubricate bearings, pulleys, belts, and other moving parts with factory-recommended lubricants.
7. Stroke all dampers to ensure free and full travel.

###### 3.13 DUCTWORK ACCESSORIES

a. Include all applicable "Start-Up Checks Common to All Systems".

b. Start-Up Checks: Perform the following checks during start-up and as specified:

1. Cleaning: Clean factory-finished surfaces. Repair any marred or scratches surfaces with manufacturer's touch-up paint.

c. Start-Up Tests: In addition to specifications, perform the following as a minimum:

1. Operate installed ductwork accessories to demonstrate compliance with requirements. Test for air leakage while system is operating. Repair or replace faulty accessories, as required to obtain proper operation and leak proof performance.
2. Label access doors in accordance with Division 21 Section "Mechanical Identification"
3. Adjusting: Adjust ductwork accessories for proper settings, install fusible links in-fire dampers and adjust for proper action.

#### END OF SECTION 23

**Bergmeyer**

CONSULTANTS

878 N. High St.  
Columbus, OH 43215  
360.900.8887

806 South Figueroa St.  
Los Angeles, CA 90017  
213.337.1090

1 Shogren St.  
Boston, MA 02210  
617.542.1025

www.bergmeyer.com

CONSULTANTS

**HENDERSON**  
ENGINEERS

6345 LENEVA DRIVE, SUITE 300  
LENEVA, KS 66214  
TEL 913.742.5000 FAX 913.742.5001

235004654  
WWW.HENDERSONENGINEERS.COM

AZ CORPORATE NO. 10470-0  
EXPIRES 9/30/2024

SEAL SIGNATURE:

EXPIRES ON: 09/30/2026

19111  
NATHAN T. LOVE

04/22/2024

NO.	BY	DATE	DESCRIPTION
HE1		2024-04-22	PERMIT/BID SET



SHAKE SHACK  
GOODYEAR, AZ

GOODYEAR CIVIC SQUARE  
PARCEL #501-2A-983  
GOODYEAR, AZ 85395  
SHACK #1515

PERMIT/BID SET

MECHANICAL  
SPECIFICATIONS

DRAWN BY: Author

CHECKED BY: Checker

JOB NO: 2350004654

M592

### ROOFTOP UNIT CONTROL MATRIX

CONTROL FEATURE	UNITS	RTU-1		RTU-2		NOTES
		SETPOINT	OR Y/N	SETPOINT	OR Y/N	
CONTROL STRATEGY						
SPACE TEMPERATURE CONTROL		Y				
HEATING AND COOLING SET POINTS						
COOLING MODE ENABLE - SPACE TEMPERATURE - OCCUPIED SETPOINT	"F DB	75	75			
COOLING MODE ENABLE - SPACE TEMPERATURE - UNOCCUPIED SETPOINT	"F DB	80	80			
COOLING - SUPPLY AIR TEMPERATURE SETPOINT	"F DB	55	55			
HEATING MODE ENABLE - SPACE TEMPERATURE - OCCUPIED SETPOINT	"F DB	70	70			
HEATING MODE ENABLE - SPACE TEMPERATURE - UNOCCUPIED SETPOINT	"F DB	60	60			
HEATING - SUPPLY AIR TEMPERATURE SETPOINT	"F DB	85	85			
DEAD BAND - MINIMUM HEATING AND COOLING TEMPERATURE SETPOINT DIFFERENCE	"F DB	5	5			
DEHUMIDIFICATION MODE ENABLE - OUTSIDE AIR DEW POINT	"F DP	55	55	F		
DEHUMIDIFICATION - COOLING CONTROL - COIL LEAVING AIR TEMPERATURE SETPOINT	"F DB	DYNAMIC	DYNAMIC	F		
DEHUMIDIFICATION - REHEAT CONTROL - SUPPLY AIR TEMPERATURE SETPOINT	"F DB	70	70	F		
PROGRAMMED CONTROL FEATURES						
HVAC SYSTEM OCCUPIED/UNOCCUPIED MODE - PROGRAMMABLE THERMOSTAT		Y		Y		B
OPTIMUM START SEQUENCE						
EQUIPMENT COMPONENTS, ACCESSORIES AND CONTROL FEATURES						
COOLING COIL (DX - MODULATING CAPACITY)	Y	Y		K		
DEHUMIDIFICATION - MODULATING HOT GAS REHEAT	Y	Y		K		
HEATING - NATURAL GAS - MODULATING	Y	Y		K		
RETURN AIR PATH WITH MOTORIZED RETURN AIR DAMPER FOR UNOCCUPIED OPERATION	Y	Y		D, T		
OUTSIDE AIR DAMPER - MOTOR OPERATED	Y	Y		J, T		
RELIEF/EXHAUST AIR DAMPER - BAROMETRIC	Y	N				
RELIEF/EXHAUST AIR DAMPER - MOTOR OPERATED	N	Y		J		
OUTSIDE SUPPLY AIR AIRFLOW MONITORING	Y	Y		F		
REMOTE TEMPERATURE SENSOR	N	Y		B		
REMOTE COMBINATION TEMPERATURE AND HUMIDITY SENSOR	Y	N		B		
INTEGRATED ECONOMIZER - DIFFERENTIAL ENTHALPY ENABLE (OA ENTHALPY < RA ENTHALPY)	BTU/LB	Y	Y	U		
SUPPLY FAN CONTROL METHODS						
ON DURING OCCUPIED MODE	Y	Y				
CYCLE WITH LOADS DURING UNOCCUPIED HOURS	Y	Y				
VARIABLE VOLUME - STAGED FAN CONTROL IN RESPONSE TO ACTIVE COOLING COIL STAGES	Y	Y		K, V		
SAFETIES, INTERLOCKS, AND ALARMS						
GAS VALVE SAFETY	Y	Y		F		
RETURN AIR SMOKE DETECTOR - SAFETY SHUTDOWN	Y	Y		F		
LOW LIMIT FREEZE STAT - FREEZE PROTECTION SAFETY SHUTDOWN	Y	Y		F		
DIFFERENTIAL PRESSURE SWITCH - FILTER CHANGE ALARM	Y	Y		F		
FIRE ALARM CONTROL PANEL - SAFETY SHUTDOWN INTERLOCK	Y	Y		F		
OUTSIDE AIR DAMPER AND SWITCH - SAFETY SHUTDOWN	Y	Y		S		
KITCHEN EXHAUST SYSTEM INTERLOCK	Y	Y		L		

DIV. 23 CONTRACTOR SHALL PROVIDE CONTROL PANEL(S), WIRING, THERMOSTAT(S), TEMPERATURE SENSOR(S), HUMIDISTAT(S), AND/OR CO2 SENSOR(S) WHERE SHOWN ON THE DRAWINGS AND AS REQUIRED TO FACILITATE THE SCHEDULED CONTROL, MODULES AND SEQUENCES OF OPERATION. EACH UNIT SHALL CONTROL BASED ON ITS OWN INTERNAL SAFETIES, TIME DELAYS, AND SEQUENCES UNLESS NOTED OTHERWISE. COORDINATE WITH OWNER, GENERAL BUILDING AND EQUIPMENT SCHEDULES DURING STARTUP. REFERENCE DIVISION SPECIFICATIONS FOR INDIVIDUAL DEVICE REQUIREMENTS.

**NOTES:**  
 B. DIVISION 23 CONTRACTOR SHALL PROVIDE DEVICE.  
 D. DURING UNOCCUPIED OPERATION, EXHAUST AND OUTSIDE AIR DAMPERS SHALL CLOSE. THE RETURN AIR DAMPER SHALL OPEN TO PERMIT RECIRCULATION OF INDOOR AIR THROUGH UNIT.  
 E. DIVISION 28 CONTRACTOR SHALL PROVIDE DEVICE.  
 F. DEVICE SHALL BE FACTORY MOUNTED AND PRE-WIRED FOR OPERATION SUBJECT TO THE ONBOARD CONTROLLER.  
 J. DAMPER SHALL BE CLOSED DURING UNOCCUPIED MODE.  
 K. UNITARY CONTROLLER SHALL MODULATE AND/OR CYCLE SUPPLY FAN SPEED AND COIL CAPACITY SUBJECT TO THE INTERNAL SAFETIES AND SEQUENCES TO MAINTAIN SCHEDULED SETPOINTS.  
 L. INTERLOCK RTU WITH KITCHEN EXHAUST HOOD SYSTEM(S) TO SHUT DOWN UPON SIGNAL FROM HOOD FIRE EXTINGUISHING SYSTEM. INTERLOCK RTU WITH KITCHEN EXHAUST FAN TO ENERGIZE WHEN HOOD SYSTEM IS ENERGIZED FOR PRESSURIZATION.  
 N. UNITS THAT PROVIDE VENTILATION AIR TO MULTIPLE ZONES AND OPERATE IN CONJUNCTION WITH ZONE HEATING AND COOLING SYSTEMS SHALL NOT USE HEATING OR HEAT RECOVERY TO WARM SUPPLY AIR TO A TEMPERATURE GREATER THAN VALUE INDICATED WHEN THE OUTSIDE AIR TEMPERATURE EXCEEDS 70F.  
 O. VENTILATION ONLY MODE PROVIDES OUTSIDE AIR DIRECTLY TO SPACE WITHOUT HEATING OR COOLING WHEN OUTDOOR ARE FAVORABLE. VENTILATION ONLY MODE CAN BE INTERRUPTED ON A CALL FOR DEHUMIDIFICATION.  
 P. PROVIDE END SWITCH ON THE OUTSIDE AIR DAMPER AND INTERLOCK THE SWITCH WITH THE SUPPLY FAN TO KEEP IT FROM STARTING IF END SWITCH IS NOT MADE.  
 Q. DURING UNOCCUPIED OPERATION, OUTSIDE AIR DAMPERS SHALL CLOSE AND RETURN AIR DAMPER SHALL MODULATE.  
 U. IF SETPOINT VALUE LISTED, IT INDICATES ECONOMIZER HIGH LIMIT SHUTOFF. UNIT SHALL BE IN ECONOMIZER IF CONDITIONS ARE LESS THAN SETPOINT. THE FOLLOWING SENSORS SHALL DETERMINE ECONOMIZER ON POINT: OUTSIDE AIR TEMPERATURE; DIVISION 23 PROVIDED AS PART OF ECONOMIZER CONTROL MODULE. RETURN AIR TEMPERATURE; DIVISION 23 PROVIDED AS PART OF ECONOMIZER CONTROL MODULE. OUTSIDE AIR HUMIDITY; DIVISION 23 PROVIDED AS PART OF ECONOMIZER CONTROL MODULE. RETURN AIR HUMIDITY; DIVISION 23 PROVIDED AS PART OF ECONOMIZER CONTROL MODULE.  
 V. PROVIDE STAGED FAN CONTROL WITH MINIMUM 2 FAN SPEEDS. LOW SPEED SHALL NOT EXCEED 66% OF FULL SPEED AND SHALL DRAW NO MORE THAN 40% OF FAN POWER AT FULL SPEED.

### GRILLE, REGISTER, AND DIFFUSER SCHEDULE

MARK	MANUFACTURER	SERVICE	MODEL	CONSTRUCTION MATERIAL	FACE TYPE	MOUNTING LOCATION	FACE SIZE (IN)	MAX. NC	NOTES
CGG	E.H. PRICE	EXHAUST GRILLE W/ DAMPER	800	STEEL	EGGCRATE SURFACE	12x12	30	A B C F G H	
CRG	E.H. PRICE	RETURN GRILLE	800	STEEL	EGGCRATE SURFACE	24x24	30	A B C F H	
CS01	E.H. PRICE	SUPPLY DIFFUSER	SCD	STEEL	SQUARE CONE SURFACE	12x12	30	A B C F H J K L	
CS02	E.H. PRICE	SUPPLY DIFFUSER	SCD	STEEL	SQUARE CONE SURFACE	24x24	30	A B C F H K	
CS03	E.H. PRICE	SUPPLY DIFFUSER	PDOR	STEEL	PERFORATED SURFACE	24x24	30	A B C F H	
WRG	E.H. PRICE	RETURN GRILLE W/ DAMPER	8300	STEEL	LOWER FACE	30	A B C D F H		
WSR	E.H. PRICE	SUPPLY REGISTER W/ DAMPER	9200	STEEL	LOUVERED FACE	30	A B C D E F G H		

MODEL NUMBERS SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER AND MODEL NUMBERS ONLY. REVIEW THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS TO DETERMINE THE EXACT MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.

**NOTES:**  
 A. EQUIPMENT FURNISHED AND INSTALLED PER THE EQUIPMENT RESPONSIBILITY SCHEDULE. REF ARCHITECTURAL DRAWINGS.  
 B. NECK SIZE SHOWN ON DRAWINGS. PROVIDE BRANCH DUCT TO MATCH NECK SIZE UNLESS OTHERWISE SHOWN ON DRAWINGS.  
 C. DIFFUSERS SHALL BE PREFINISHED TO MATCH CEILING/WALL EXPOSED DUCT COLOR (COORDINATE WITH ARCHITECT).  
 D. FRONT BLADES PARALLEL TO LONG DIMENSION.  
 E. DOUBLE DEFLECTION BARS SHALL BE ADJUSTABLE.  
 F. FRAME TYPE TO MATCH CEILING/WALL CONSTRUCTION. COORDINATE WITH ARCHITECTURAL REFLECTED CEILING/WALL PLAN.  
 G. PROVIDE OPPOSED BLADE DAMPER ADJUSTABLE FROM FACE OF DEVICE.  
 H. PROVIDE DIFFUSERS, LINEAR SLOTS, AND GRILLES WITH NO EXPOSED MOUNTING SCREWS.  
 J. CONTRACTOR SHALL PROVIDE REMOTE CABLE OPERATED VOLUME DAMPER BY METROPOLITAN AIR TECHNOLOGIES MODEL RT-200 WITH EXTERNAL WORM GEAR OPERATOR OR EQUIVALENT YOUNG REGULATORY BUTTERFLY DAMPER WITH 225/225 CONTROLLER. OPERATOR SHALL HAVE SQUARE DRIVE FOR 1/4" NUT DRIVER. DAMPER ASSEMBLY SHALL INCLUDE GALVANIZED STEEL DUCT WITH ROLLED BEAD STIFFENERS, REINFORCED BLADE, SELF LUBRICATING BEARING AND WORM GEAR MOUNTING PLATE. DAMPER SHALL BE INSTALLED IN BRANCH DUCT NOT INLET OF PLENUM DIFFUSER. (RE: 2M501)  
 K. 4-WAY THROW PATTERN UNLESS OTHERWISE INDICATED BY FLOW ARROWS ON DRAWINGS.  
 L. PROVIDE RAPID MOUNT FRAME FOR INSTALLATION IN HARD CEILING.

### PROJECT DESIGN CONDITIONS

CLIMATE CONDITIONS				BUILDING OPERATING HOURS			
WEATHER STATION				MONDAY - FRIDAY			
CLIMATE ZONE				SATURDAY			
HEATING (DB)				SUNDAY			
COOLING (DB/MCWB)				HOLIDAY			
LUKE APB, AZ, USA				TBD BY OWNER			
28				TBD BY OWNER			
99.6%				TBD BY OWNER			
0.4%				TBD BY OWNER			

SPACE / UNIT DESCRIPTION	SET POINTS								SPACE OPERATING HOURS				NOTES		
	COOLING / DEHUMIDIFICATION				HEATING / HUMIDIFICATION				OCCUPIED / UNOCCUPIED						
	OCC	UNOCC	MAX	MIN	OCC	UNOCC	MIN	MAX	CONTROL METHOD	BASE PPM	MAXIMUM PPM	M-F	SAT	SUN	
DINING AREAS	75	80	90%	70	70	60	NA	NA	NA	NA	NA	TBD	TBD	TBD	A, B, C
OFFICES	75	80	90%	70	70	60	NA	NA	NA	NA	NA	TBD	TBD	TBD	A, B, C
MECHANICAL ROOM	NA	NA	NA	NA	70	60	NA	NA	NA	NA	NA	TBD	TBD	TBD	A, B, C
KITCHEN/BOH	75	80	90%	70	70	60	NA	NA	NA	NA	NA	TBD	TBD	TBD	A, B, C

**NOTES:**  
 A. ZONE LEVEL SET POINT CONDITIONS SHALL BE AS SCHEDULED UNLESS OTHERWISE SCHEDULED OR NOTED ON THE DRAWINGS FOR ROOM SPECIFIC SPACE CONDITIONS.  
 B. ZONE LEVEL OCCUPANCY HOUR SCHEDULE SHALL BE PER BUILDING OPERATING HOURS UNLESS OTHERWISE SCHEDULED.  
 C. ZONE LEVEL CONTROLS SHALL BE CAPABLE OF OPERATING WITH INDEPENDENT OCCUPANCY SCHEDULES.

### ROOFTOP UNIT SCHEDULE (DX COOLING, NATURAL GAS HEAT)

MARK	MANUFACTURER	MODEL	NOMINAL TONS	UNIT TYPE	SUPPLY FAN				COOLING COIL				HEAT EXCHANGER				ELECTRICAL				WEIGHT (LBS)	NOTES								
					CFM	ESP (IN)	HP	VFD (Y/N)	TH (MBH)	SH (MBH)	EAT (°F DB)	(°F WB)	(°F DB)	REFR TYPE	MIN EFF (IEER)	MIN NO STAGES	MIN OUT (MBH)	NOM INPUT (MBH)	MIN EFF (%)	EAT (°F DB)			(°F DB)	MIN NO STAGES	MIN O/A CFM	VPH	MCA	MCCP	DISC TYPE	
RTU-1	CAPTVEAIRE	CASRTU3H-150-24-12-5T	12.5	SINGLE ZONE	3,300	0.8	5	Y	117.7	117.0	84.8	63.4	52.4	50.9	R410A	21.3	3	87.5	108.0	81	60.5	85	2	900	208/1	82	90	NF	2436	A-O
RTU-2	CAPTVEAIRE	CASRTU3H-150-24-20T	20	SINGLE ZONE	4,900	0.8	5	Y	209.9	209.5	90.4	65.1	52.0	50.6	R410A	18.2	3	158.8	196	81	65	85	2	2100	208/1	114	125	NF	2889	A-O

**\*EQUIPMENT FURNISHED AND INSTALLED PER THE RESPONSIBILITY SCHEDULE. REF ARCHITECTURAL DRAWINGS. EQUIPMENT SHALL BE OBTAINED THROUGH SHAKE SHACK NATIONAL ACCOUNT. REFER TO T.12 / VENDOR LIST FOR MORE INFORMATION.**  
 MODEL NUMBERS SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER AND MODEL NUMBERS ONLY. REVIEW THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS TO DETERMINE THE EXACT MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.

**NOTES:**  
 A. REFER TO ROOFTOP UNIT CONTROL MATRIX FOR CONTROL FEATURES, MODULES, AND ACCESSORIES THAT SHALL BE PROVIDED WITH THE EQUIPMENT.  
 B. EQUIPMENT SIZED FOR 100% AMBIENT TEMPERATURE.  
 C. PROVIDE 2" MERV 8 EFFICIENT PLEATED THROWAWAY AIR FILTERS.  
 D. PROVIDE FACTORY MOUNTED DISCONNECT INSTALLED ON SERVICE SIDE OF UNIT.  
 E. STARTERS FOR ALL MOTORS SHALL BE FURNISHED INTEGRAL WITH UNIT.  
 F. PROVIDE SINGLE POINT POWER CONNECTION.  
 G. COORDINATE SIZE OF CONDUCTOR TERMINATION LUGS WITH CONDUCTOR SIZES SHOWN ON ELECTRICAL DRAWINGS.  
 H. PROVIDE 125 VAC, 20 AMP DUPLEX CONVENIENCE RECEPTACLE MOUNTED TO UNIT READY FOR FIELD WIRING WITH A COVER UL LISTED FOR WET AND DAMPER LOCATIONS WHEN IN USE.  
 I. SPECIFIED FAN ESP ACCOUNTS FOR DUCT LOSSES EXTERNAL TO UNIT.  
 J. PROVIDE MOTOR HORSEPOWER TO OVERCOME INTERNAL UNIT STATIC PRESSURE DROP PLUS SPECIFIED EXTERNAL STATIC PRESSURE DROP. NOMINAL MOTOR HP SHALL BE NO LARGER THAN THE FIRST AVAILABLE NOMINAL MOTOR SIZE GREATER THAN THE REQUIRED BHP.  
 K. PROVIDE INSULATED ROOF CURB WITH MINIMUM HEIGHT REQUIRED TO MAINTAIN BOTTOM OF EQUIPMENT A MINIMUM OF 14 INCHES ABOVE FINISHED ROOF SURFACE. PROVIDE SLOPED CURB IF NEEDED TO MATCH ROOF SLOPE. COORDINATE WITH ROOF INSULATION THICKNESS AND ROOF TAPER AT INSTALLED LOCATION. COORDINATE CURB TYPE WITH DRAWINGS.  
 L. SCHEDULED WEIGHT IS THE MAXIMUM ALLOWABLE OPERATING WEIGHT OF THE EQUIPMENT ONLY.  
 M. COOLING COIL LAT IS LEAVING AIR TEMPERATURE OF COIL.  
 N. PROVIDE FACTORY MOUNTED DISCONNECT INSTALLED ON SERVICE SIDE OF UNIT.  
 O. PROVIDE HEATER TO MEET OR EXCEED SCHEDULED MINIMUM MBH OUTPUT. NOMINAL INPUT IS BASED ON LISTED MANUFACTURER'S STANDARD PRODUCT. COORDINATE EQUIPMENT GAS LOAD WITH PLUMBING CONTRACTOR IF DIFFERENT FROM THAT SCHEDULED. MEET MINIMUM EFFICIENCY SCHEDULED.

owner provided

### FAN COIL UNIT SCHEDULE (HEAT PUMP)

MARK	MFR	MODEL	SUPPLY FAN				COOLING COIL				HEAT PUMP HEATING COIL				ELECTRICAL				WEIGHT (LBS)	NOTES					
			CFM	ESP (IN)	NOM HP	VFD	TH (MBH)	SH (MBH)	EAT (°F DB)	(°F WB)	(°F DB)	REFR TYPE	MIN EFF (SEER)	MIN NO STAGES	MIN OUT (MBH)	NOM INPUT (MBH)	MIN EFF (%)	EAT (°F DB)			(°F DB)	MIN NO STAGES	MIN O/A CFM	VPH	MCA
FCU-1	CARRIER	40MBCG18	420	0.025	0.061		10.6	9.1	76.8	63.9	57.0	55.5	R410A	9.2	13.8	64.6	85	40	208/1	N/A	N/A	N/A	NF	45	A-1

**\*EQUIPMENT SHALL BE OBTAINED THROUGH SHAKE SHACK NATIONAL ACCOUNT. REFER TO T002 / VENDOR LIST FOR MORE INFORMATION.**  
 MODEL NUMBERS SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER AND MODEL NUMBERS ONLY. REVIEW THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS TO DETERMINE THE EXACT MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.

**NOTES:**  
 A. EQUIPMENT FURNISHED AND INSTALLED PER THE RESPONSIBILITY SCHEDULE. REF ARCHITECTURAL DRAWINGS.  
 B. ASSOCIATED CONDENSING UNIT SHALL BE BY THE SAME MANUFACTURER.  
 C. FOR COOLING: EQUIPMENT SIZED FOR 85°F AMBIENT TEMPERATURE. HEAT PUMP HEATING CAPACITY BASED ON AMBIENT TEMPERATURE LISTED.  
 D. PROVIDE UNIT WITH CLEANABLE AIR FILTERS.  
 E. PROVIDE WITH 7-DAY PROGRAMMABLE THERMOSTAT WITH STAGED HEATING AND COOLING CAPABILITY AS REQUIRED FOR OPERATION OF HEATING AND COOLING CONTROLS.  
 F. DISCONNECT SWITCH FURNISHED BY DIVISION 26 CONTRACTOR.  
 G. PROVIDE SINGLE POINT POWER CONNECTION.  
 H. PROVIDE WITH SPRING VIBRATION ISOLATION AND ALL-THREAD HANGING RODS.  
 I. REFERENCE PLUMBING PLANS FOR CONDENSATE DRAIN PIPING FROM UNIT.

owner provided

### BUILDING AIR BALANCE SUMMARY NORMAL OPERATION

UNIT NO.	SUPPLY (CFM)	OUTDOOR (CFM)	EXHAUST (CFM)	PERCENT O/A/S/A
RTU-1	3,300	900	--	27%
RTU-2	4,900	2,100	--	43%
FCU-1	420	40	--	10%
KEF-1	--	--	860	--
KEF-2	--	--	738	--
KEF-3	--	--	738	--
EF-1	--	--	150	--
TOTALS	8,620	3,040	2,486	--
<b>TOTAL AIRFLOW AVAILABLE FOR PRESSURIZATION (CFM)</b>				<b>554</b>
<b>PERCENT POSITIVE PRESSURIZATION</b>				<b>18.2%</b>

### BUILDING AIR BALANCE SUMMARY ECONOMIZER MODE

UNIT NO.	SUPPLY (CFM)	OUTDOOR (CFM)	EXHAUST (CFM)	PERCENT O/A/S/A
RTU-1	3,300	3,300	--	100%
RTU-2	4,900	4,900	--	100%
FCU-1	420	40	--	10%
KEF-1	--	--	860	--
KEF-2	--	--	738	--
KEF-3	--	--	738	--
EF-1	--	--	150	--
RELIEF RTU-1	--	--	2,400	--
RELIEF RTU-2	--	--	2,800	--
TOTALS	8,620	8,240	7,686	--
<b>TOTAL AIRFLOW AVAILABLE FOR PRESSURIZATION (CFM)</b>				<b>554</b>
<b>PERCENT POSITIVE PRESSURIZATION</b>				<b>6.7%</b>

### HEAT PUMP CONDENSING UNIT SCHEDULE

MARK	SERVICE	MANUFACTURER	MODEL	REFR TYPE	COOLING CAPACITY				HEATING CAPACITY				ELECTRICAL				WEIGHT (LBS)	NOTES
					TH (MBH)	AMBIENT (DB)	MIN EFF (SEER)	CAP (MBH)	AMBIENT (DB)	MIN EFF COP 47°F	MCA	MCCP	VPH	DISC TYPE				
CU-1	FCU-1	CARRIER	38MARBG18AA3	R410A	10.6	98.0	19.0	9.2	13.8	3.3	18	25	208/1	102.5	A-H			

**\*EQUIPMENT SHALL BE OBTAINED THROUGH SHAKE SHACK NATIONAL ACCOUNT. REFER TO T002 / VENDOR LIST FOR MORE INFORMATION.**  
 MODEL NUMBERS SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER AND MODEL NUMBERS ONLY. REVIEW THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS TO DETERMINE THE EXACT MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.

**NOTES:**  
 A. EQUIPMENT FURNISHED AND INSTALLED PER THE RESPONSIBILITY SCHEDULE. REF ARCHITECTURAL DRAWINGS.  
 B. EQUIPMENT CAPACITY SCHEDULED IS MINIMUM CAPACITY THAT MUST BE PROVIDED AT AMBIENT TEMPERATURE INDICATED.  
 C. CONTRACTOR SHALL VERIFY WITH EQUIPMENT SUPPLIER EXACT QUANTITY AND SIZE OF REFRIGERANT PIPING.  
 D. PROVIDE LIQUID LINE FILTER DRYER AND SIGHT GLASS.  
 E. PROVIDE PREFABRICATED EQUIPMENT SUPPORT RAILS.  
 F. DISCONNECT SWITCH FURNISHED BY DIVISION 26 CONTRACTOR.  
 G. STARTERS FOR ALL MOTORS SHALL BE FURNISHED INTEGRAL WITH UNIT.  
 H. COORDINATE SIZE OF CONDUCTOR TERMINATION LUGS WITH CONDUCTOR SIZES SHOWN ON ELECTRICAL DRAWINGS.

owner provided

### AIR CURTAIN SCHEDULE

MARK	SERVICE AREA	MANUFACTURER	MODEL	LENGTH (IN)	MAX AIRFLOW (CFM)	UNIT SPECS		MOTOR	VPH/Hz	NOTES
						HEATING CAPACITY (KW)	HEATING CAPACITY (BTU/H)			
AC-1	SERVICE ENTRY	MARS	STD2	36	1379	N/A	1/2	115/1		A-F
AC-2	SERVICE ENTRY	MARS	STD2	36	1379	N/A	1/2	115/1		A-F

MODEL NUMBERS SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER AND MODEL NUMBERS ONLY. REVIEW THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS TO DETERMINE THE EXACT MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.


**NOTES:**  
 A. EQUIPMENT FURNISHED AND INSTALLED PER THE RESPONSIBILITY SCHEDULE. REF ARCHITECTURAL DRAWINGS.  
 B. MOUNT UNIT PER MANUFACTURER'S RECOMMENDATIONS TO FACE OF WALL AND SUPPORT VERTICALLY.  
 C. PROVIDE INTEGRAL STARTER AND DISCONNECT SWITCH.  
 D. REFER TO SEQUENCE OF OPERATION FOR UNIT CONTROLS.  
 E. PROVIDE AIR CURTAIN WITH NORMALLY CLOSED DOOR LIMIT SWITCH FOR INSTALLATION ON DOOR. THE AIR CURTAIN SHALL ENERGIZE WHEN DOOR OPENS.  
 F. PROVIDE WITH DELAY MICROSWITCH WITH ADJUSTABLE DELAY TIMERS PRE MOUNTED IN THE AIR CURTAIN PANEL.

### LOUVER SCHEDULE

MARK	SERVICE	MANUFACTURER	MODEL	SIZE (W x H)	CFM	MIN FREE AREA (SF)	MAX VEL (FPM)	MAX APD (IN W.C.)	NOTES
LV-1	INTAKE	RUSKIN	ELF15J	20" x 20"	350	1.23	283	0.02	A-F

MODEL NUMBERS SHALL NOT BE CONSIDERED COMPLETE AND MATERIAL SHALL NOT BE ORDERED BY MANUFACTURER AND MODEL NUMBERS ONLY. REVIEW THE COMPLETE DESCRIPTION, NOTES AND SPECIFICATIONS TO DETERMINE THE EXACT MATERIAL AND ACCESSORIES TO BE ORDERED. THE MANUFACTURERS LISTED ARE THE BASIS FOR THE DESIGN.

**NOTES:**  
 A. PROVIDE 1/4" MESH ALUMINUM BRD SCREEN.  
 B. PROVIDE ANODIZED FINISH. COLOR AS SELECTED BY ARCHITECT.  
 C. FRAME TYPE SHALL MATCH WALL CONSTRUCTION, COORDINATE WITH ARCHITECT.  
 D. PROVIDE WINDBOUNDE-DEBRIS-IMPACT RESISTANCE LOUVER AS DEFINED IN THE SPECIFICATIONS.  
 E. PROVIDE LOUVER WITH WIND DRIVEN RAIN PERFORMANCE AS DEFINED IN THE SPECIFICATIONS.  
 F. PROVIDE LOUVER WITH SECURITY BARS.

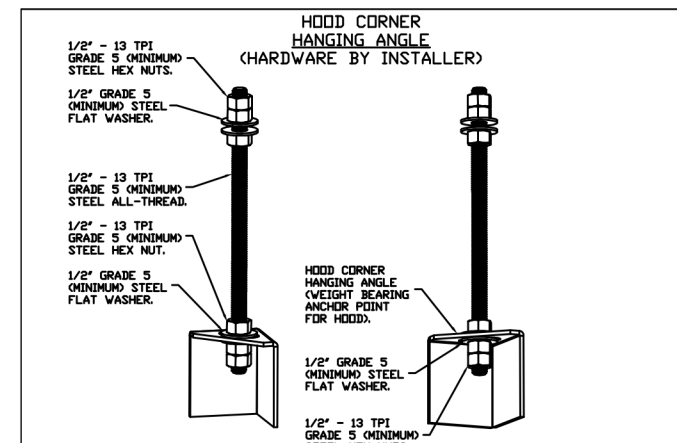

HOOD STYLE / MODEL	450 DEGREES cfm/ft.	600 DEGREES cfm/ft.	700 DEGREES cfm/ft.
CANOPY ND-2	150	200	250
CANOPY ND-2 W/ END PANELS	105	140	175
SLOPED SNO-2	228	294	-
ISLAND ND-2M	269	300	350
ISLAND ND-2I	346	422	475

ETL HOOD LISTING DETAIL	
EXHAUST CFM = LENGTH OF HOOD X CFM/INCH (EQD)	
SUPPLY CFM = EXHAUST CFM X PERCENTAGE REQUIRED	
TOTAL DUCT AREA (sq. in.) = 144 X $\frac{CFM}{FRICK}$	
DUCT LENGTH = $\frac{TOTAL DUCT AREA}{DUCT WIDTH}$	

**CAPTIVE-VE AIR HOODS BUILT IN COMPLIANCE WITH**

ETL LISTED UNDER ETL File number 3054804-001/002

**BUILDING CODES**

MATERIAL	CLEARANCE REDUCTION SYSTEM
NON-COMBUSTIBLE	NONE REQUIRED
LIMITED-COMBUSTIBLE	3" UNINSULATED STANDOFF
COMBUSTIBLE	1" INSULATED STANDOFF



**CLEARANCE TO COMBUSTIBLES**

- INSTALLATION**
1. ALL ELECTRICAL "FIELD" CONNECTIONS AND RELATED INTERCONNECTIONS BY ELECTRICAL CONTRACTORS.
  2. ALL PLUMBING "FIELD" CONNECTIONS AND RELATED INTERCONNECTIONS BY PLUMBING CONTRACTORS.
  3. HANGING BRACKETS LOCATED AND WELDED AS SHOWN ON PLANS. ALL OTHER HANGING MATERIALS PROVIDED BY INSTALLING CONTRACTORS.
  4. ALL CONNECTIONS FROM CAPTIVEVEIR HOOD PER MECHANICAL CONTRACTOR'S PLANS.
  5. COOKING EQUIPMENT TO SHUT OFF IN EVENT OF FIRE.
  6. EXHAUST FANS TO TURN ON IN EVENT OF FIRE.
  7. ALL LIGHT FIXTURES SHOWN INSTALLED BY CAPTIVEVEIR ARE FACTORY PREWIRED. INTERCONNECTIONS BETWEEN HOODS AND TO SWITCHES ARE BY ELECTRICAL CONTRACTOR.
  8. LAMPS FOR LIGHT FIXTURES BY INSTALLING CONTRACTORS.
  9. SEISMIC RESTRAINTS ARE RESPONSIBILITY OF INSTALLING CONTRACTOR.
  10. INSTALLING CONTRACTORS ASSUME ALL RELATED RESPONSIBILITY FOR VERIFICATION OF DIMENSIONAL DATA CONTAINED ON THESE DOCUMENTS FOR OCCUPANCY, INTERSECTION AND DETERMINATION OF CODE REQUIREMENTS IN EFFECT PRIOR TO ANY RELEASE FOR PRODUCTION OF EQUIPMENT SHOWN.

- BALANCE**
11. KITCHEN HOODS MUST BE BALANCED WITH KITCHEN.
  12. RESTAURANT SHALL BE NEGATIVE WITH RESPECT TO AMBIENT PRESSURE.
  13. RESTAURANT SHALL BE POSITIVE WITH RESPECT TO AMBIENT PRESSURE.

- ADDITIONAL**
14. WRITTEN HOOD DIMENSIONS HAVE PRECEDENCE OVER SCALE.
  15. SIGNED AND "APPROVED" COPIES OF THIS DOCUMENT MUST BE RECEIVED BY THE FACTORY PRIOR TO COMMENCEMENT OF INSTALLATION.

**GENERAL NOTES**

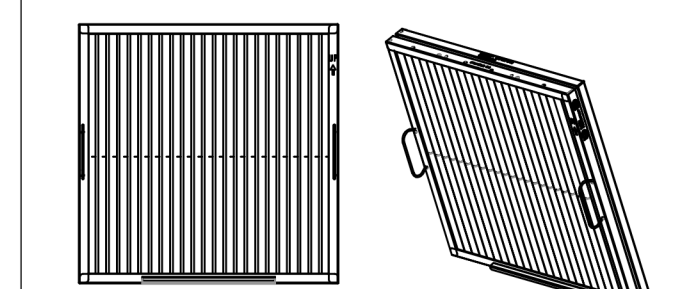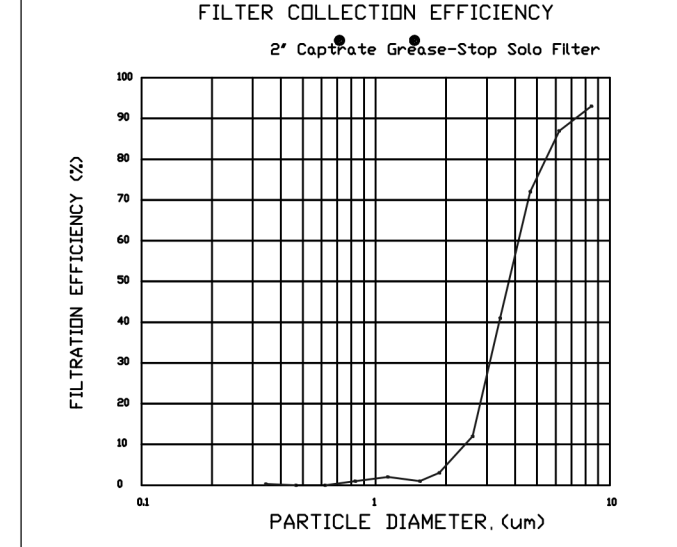

CaptiveAire Captrate Solo Filter  
ETL Listed Grease Extracting Filters  
Made From 430 Stainless Steel

**FILTER DETAIL**

FOR QUESTIONS, CALL THE  
Eastern PA Mechanical  
REGION 108  
PHONE: (267) 504-4126  
EMAIL: reg108@captiveaire.com

**HOOD INFORMATION - JOB#6657868**





HOOD NO	TAG	MODEL	MANUFACTURER	LENGTH	MAX COOKING TEMP	TYPE	APPLIANCE DUTY	DESIGN CFM/FT	TOTAL EXH CFM	EXHAUST PLENUM RISERS(S)				HOOD CONSTRUCTION	HOOD CONFIG			
										WIDTH	LENG	HEIGHT	DIA		CFM	VEL	SP	END TO
1	FRYER	5430 ND-2	CAPTIVEAIRE	4' 11"	450 DEG	I	MEDIUM	175	860	9'	9'	4'	860	1529	-0.494'	430 SS WHERE EXPOSED	ALDNE	ALDNE
2	GRILL(South)	5430 ND-2	CAPTIVEAIRE	4' 11"	450 DEG	I	MEDIUM	150	738	8'	8'	4'	738	1660	-0.417'	430 SS WHERE EXPOSED	ALDNE	FRONT
3	GRILL(North)	5430 ND-2	CAPTIVEAIRE	4' 11"	450 DEG	I	MEDIUM	150	738	8'	8'	4'	738	1660	-0.417'	430 SS WHERE EXPOSED	ALDNE	BACK

**HOOD INFORMATION**

HOOD NO	TAG	TYPE	FILTER(S)			LIGHT(S)			UTILITY CABINET(S)			FIRE SYSTEM PIPING	HOOD HANGING WEIGHT				
			QTY	HEIGHT	LENGTH	EFFICIENCY @ 7 MICRONS	QTY	TYPE	WIRE GUARD	LOCATION	SIZE			TYPE	SIZE	ELECTRICAL MODEL #	SWITCHES QUANTITY
1	FRYER	CAPTRATE SOLD FILTER	3	20"	16"	85% SEE FILTER SPEC	2	RECESSED ROUND	NO	LEFT	12"x54"x30"	TANK FS	4.0/4.0/4.0	SC-230110MA	1 LIGHT 1 FAN	YES	747 LBS
2	GRILL(South)	CAPTRATE SOLD FILTER	3	20"	16"	85% SEE FILTER SPEC	2	RECESSED ROUND	NO							YES	356 LBS
3	GRILL(North)	CAPTRATE SOLD FILTER	3	20"	16"	85% SEE FILTER SPEC	2	RECESSED ROUND	NO							YES	356 LBS

**HOOD OPTIONS**

HOOD NO	TAG	OPTION
1	FRYER	FIELD WRAPPER 12.00" HIGH FRONT, LEFT, RIGHT. RIGHT QUARTER END PANEL 23" TOP WIDTH, 0" BOTTOM WIDTH, 23" HIGH 430 SS. LEFT QUARTER END PANEL 23" TOP WIDTH, 0" BOTTOM WIDTH, 23" HIGH 430 SS. INSULATION FOR BACK OF HOOD. RISER SENSOR INSTALL 6IN PLEN.
2	GRILL(South)	FIELD WRAPPER 12.00" HIGH FRONT, LEFT, RIGHT. LEFT END STANDOFF (FINISHED) 1" WIDE 54" LONG INSULATED. INSULATION FOR BACK OF HOOD. RISER SENSOR INSTALL 6IN PLEN. RIGHT VERTICAL END PANEL 27" TOP WIDTH, 21" BOTTOM WIDTH, 80" HIGH INSULATED 430 SS. LEFT WALL AS END PANEL.
3	GRILL(North)	FIELD WRAPPER 12.00" HIGH FRONT, LEFT, RIGHT. RIGHT END STANDOFF (FINISHED) 1" WIDE 54" LONG INSULATED. INSULATION FOR BACK OF HOOD. RISER SENSOR INSTALL 6IN PLEN. LEFT VERTICAL END PANEL 27" TOP WIDTH, 21" BOTTOM WIDTH, 80" HIGH INSULATED 430 SS. RIGHT WALL AS END PANEL.

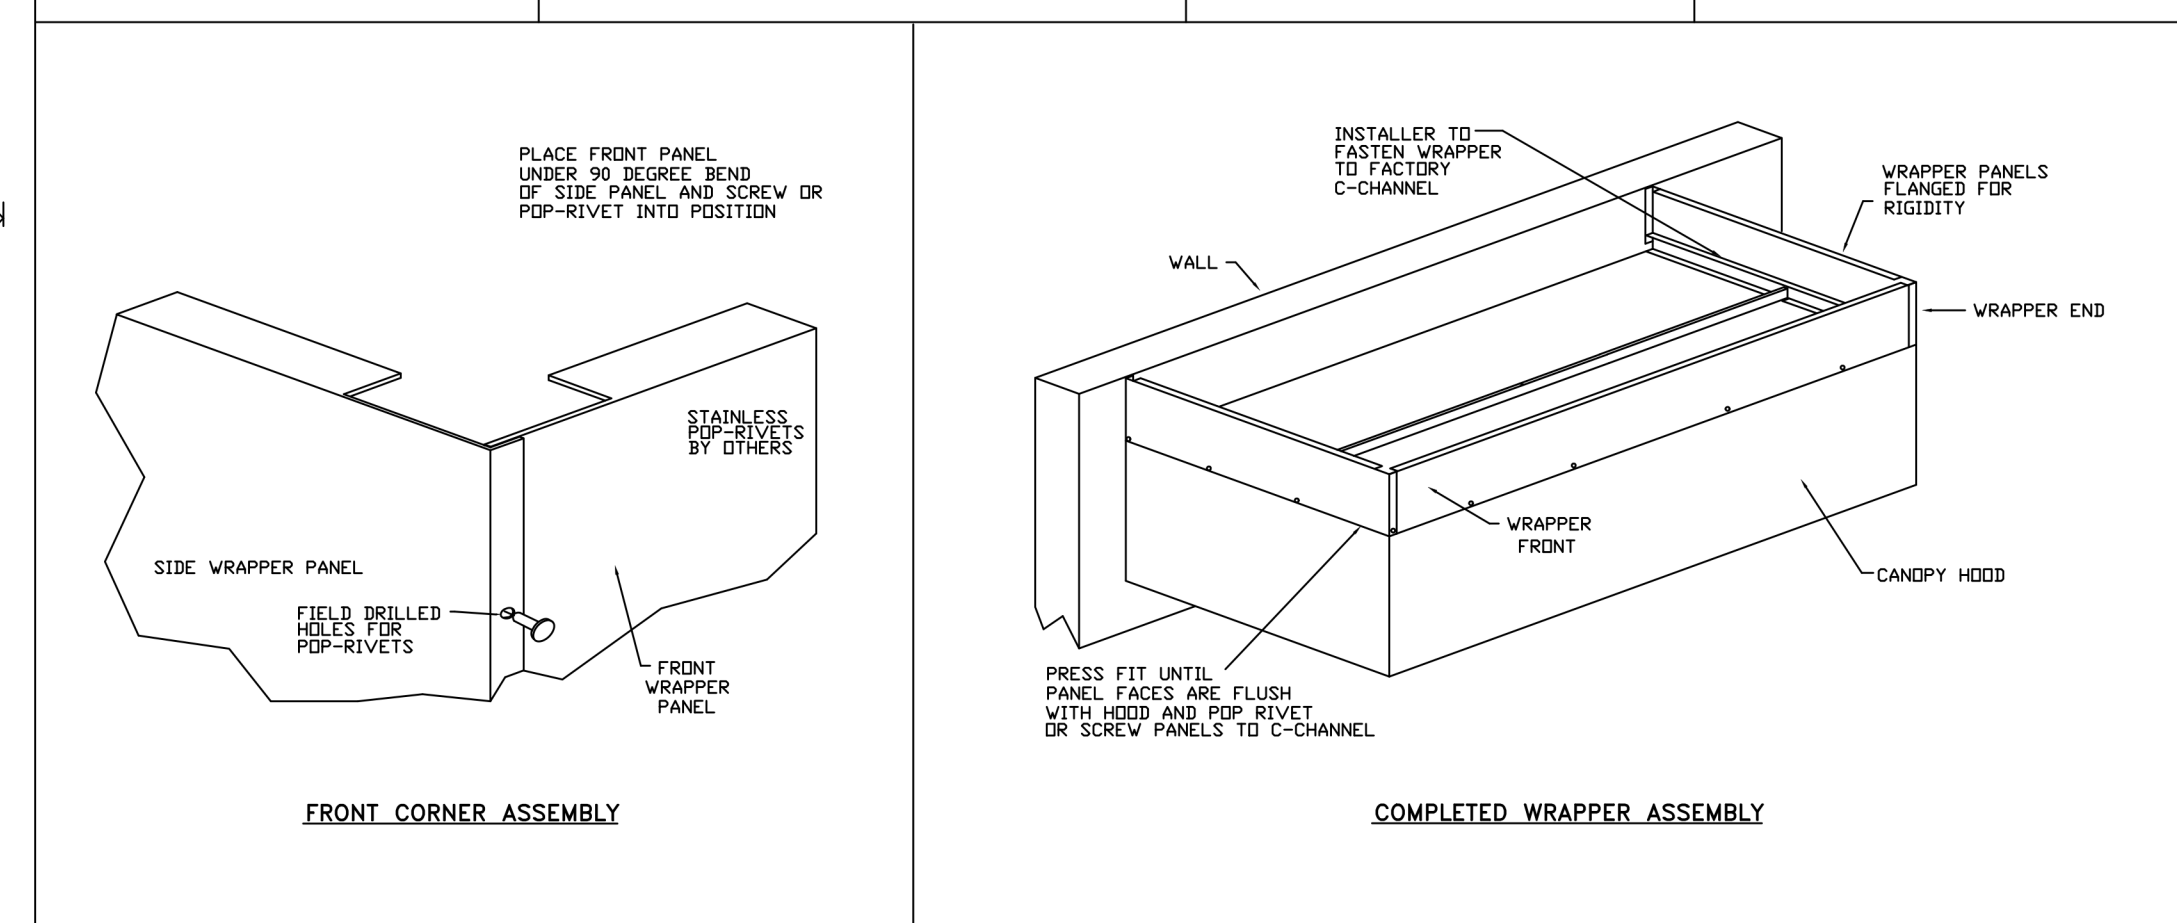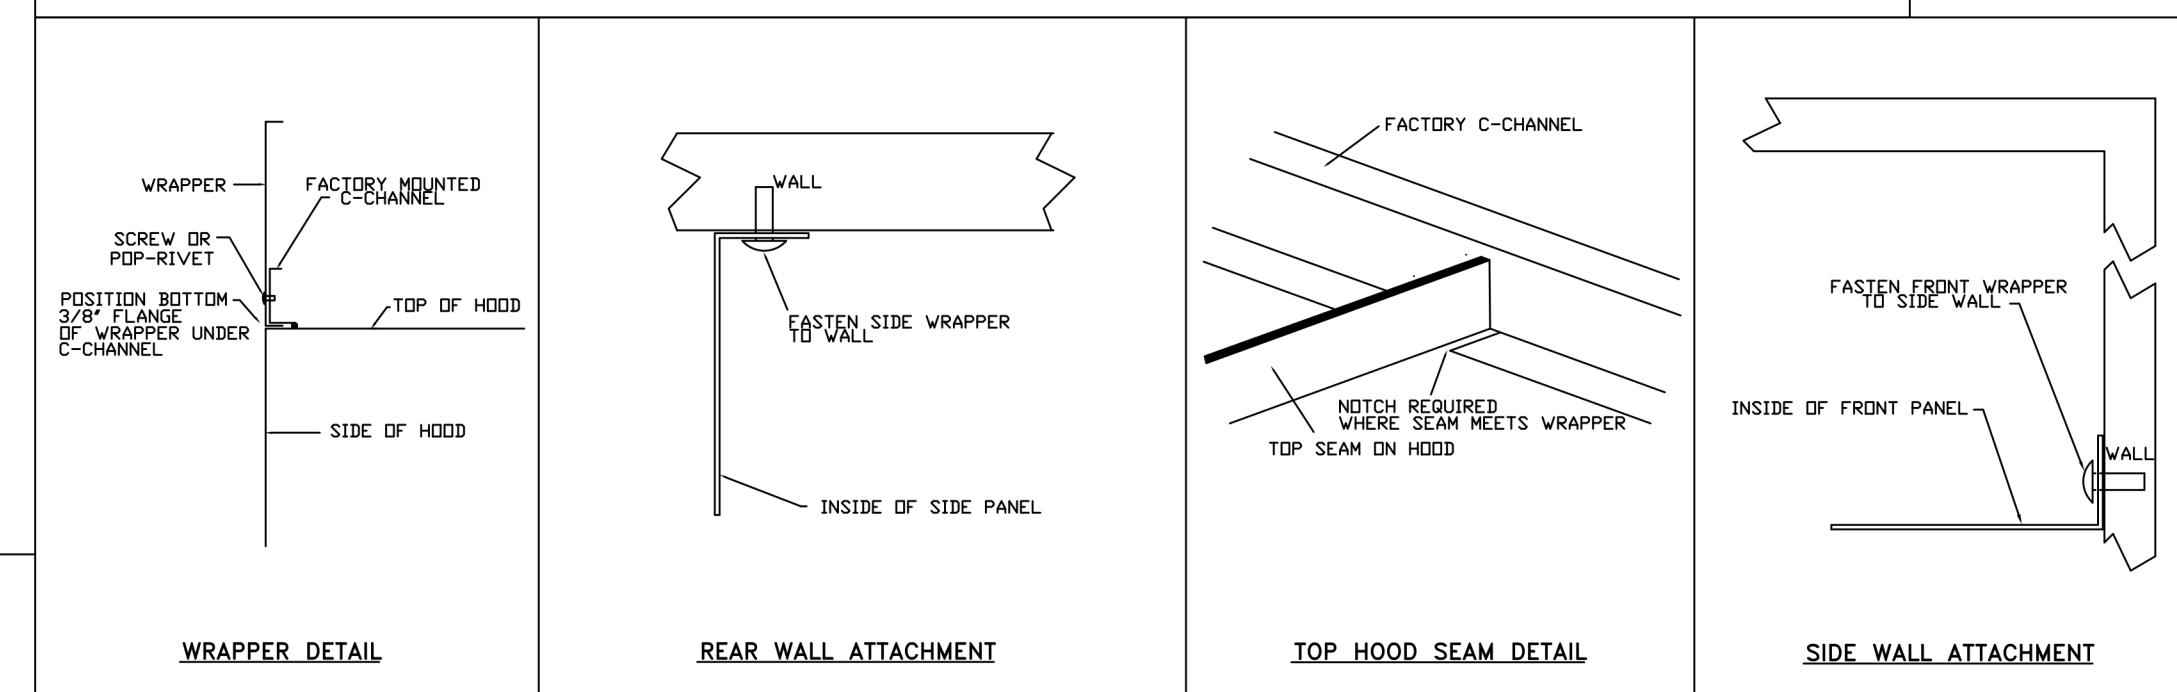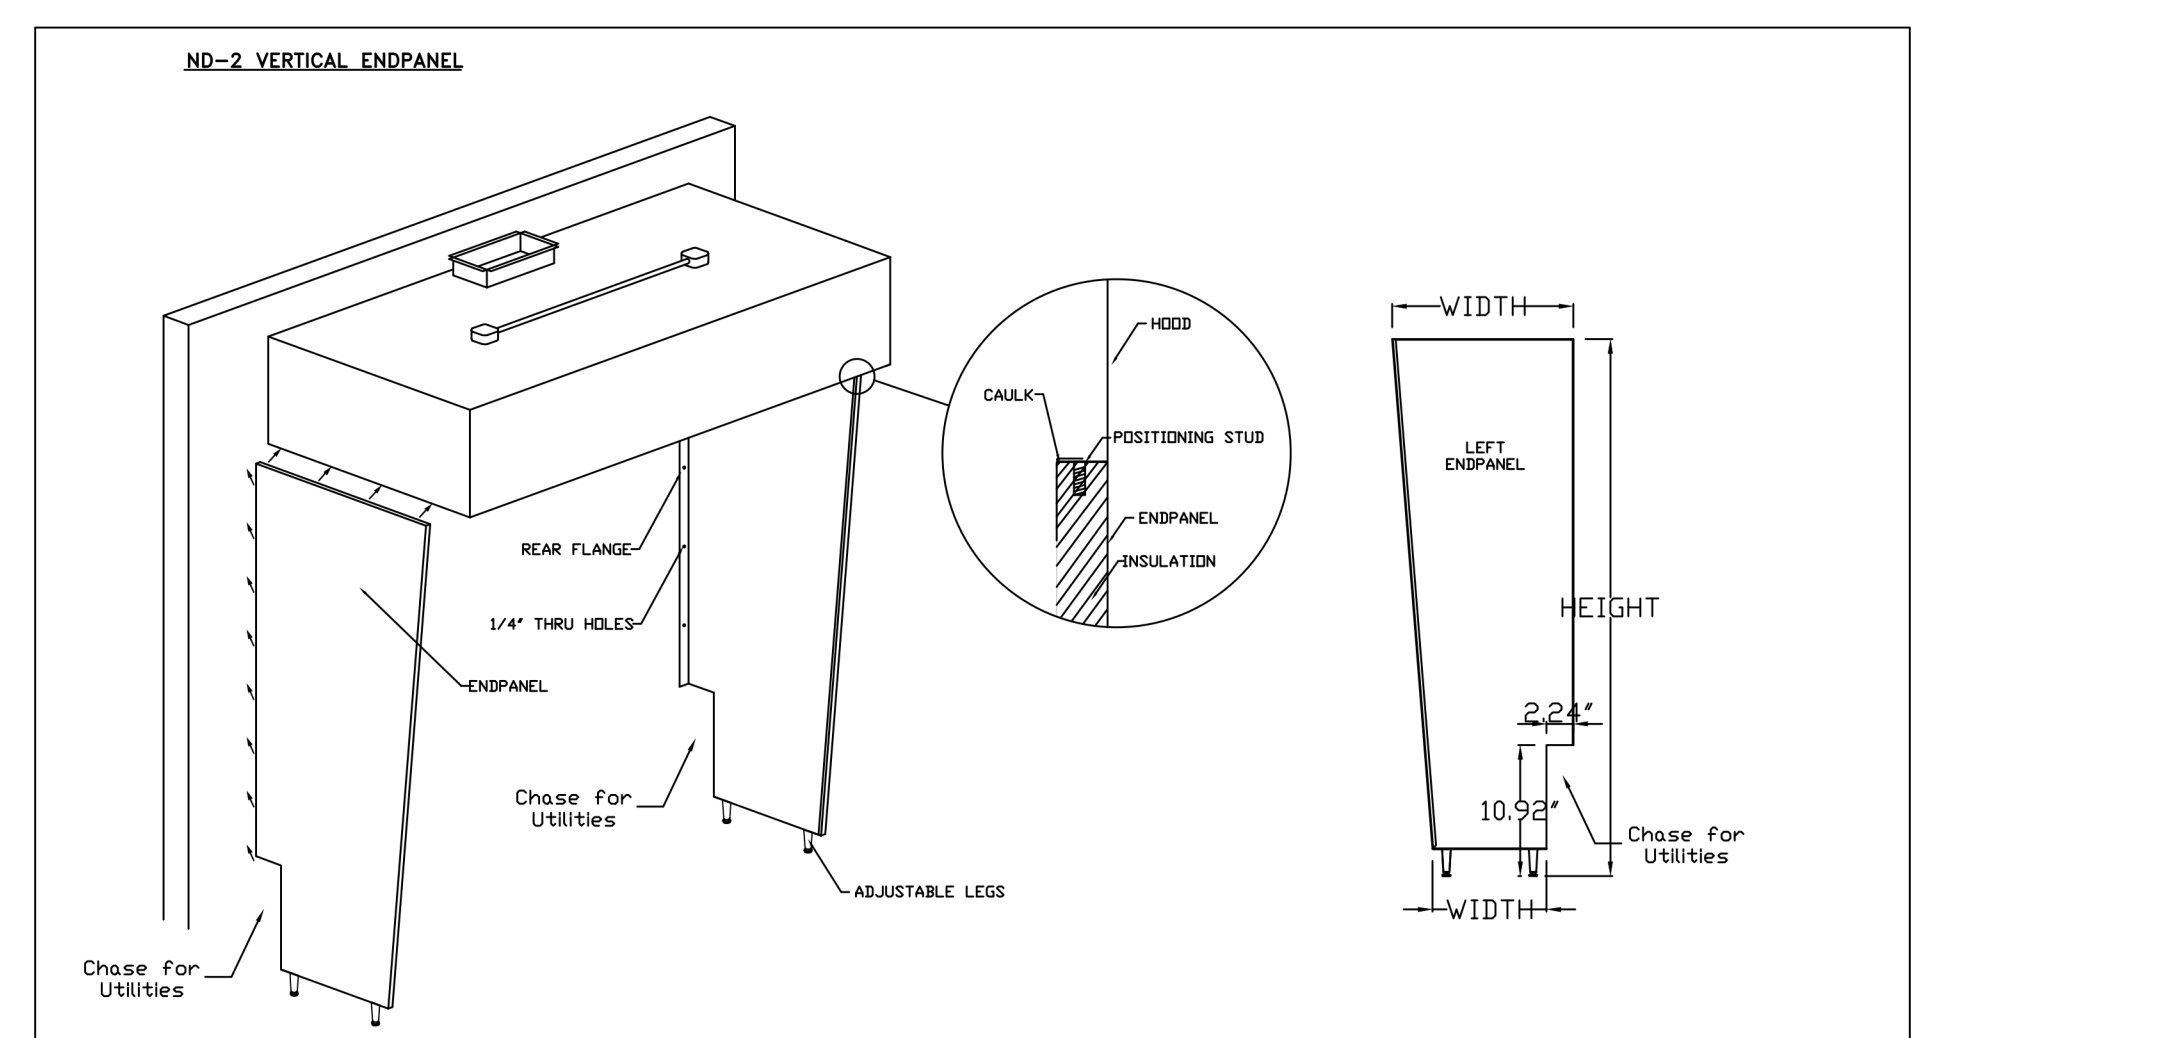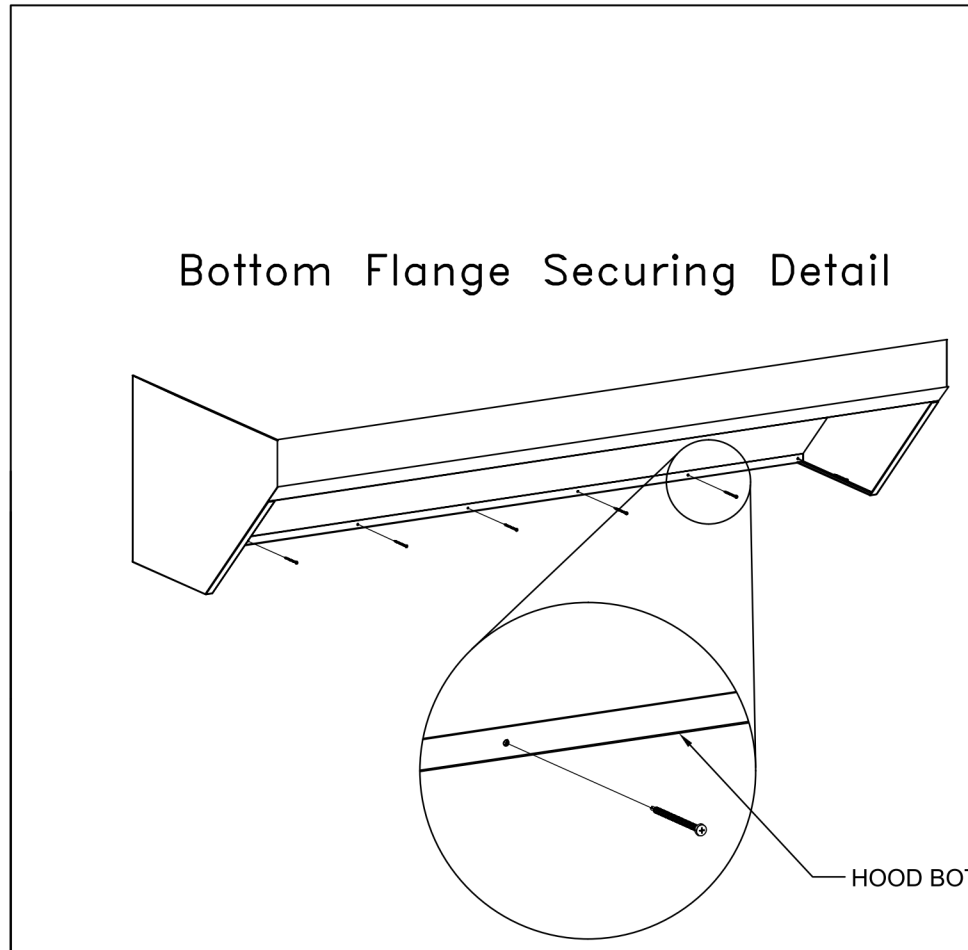

**REVISIONS**

NO.	DESCRIPTION	DATE

**CAPTIVEVEIR**  
Eastern PA Mechanical  
www.captiveaire.com

PO Box 2520, 1 Union Ave, Bethlehem, PA 18004 PHONE: (267) 504-4126 EMAIL: reg108@captiveaire.com

Snake Shack-1515-Goodyear, AZ(Kitchen)  
GOODYEAR, AZ, 85395

**DATE:** 3/5/2024  
**DWG.#:** 6657868  
**DRAWN BY:** Joe.shilba  
**SCALE:** 3/4" = 1'-0"  
**MASTER DRAWING**

**SHEET NO.**  
1

**NOTE:**  
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

**Bergmeyer**

CONSULTANTS:

SEAL SIGNATURE:

FOR REFERENCE ONLY

HEI 2024-04-22 PERMIT/BID SET  
NO. BY DATE DESCRIPTION

**SHAKE SHACK**

SHAKE SHACK  
GOODYEAR, AZ

GOODYEAR CIVIC SQUARE  
PARCEL #501-2A-983  
GOODYEAR, AZ 85395  
SHACK #1515



PERMIT/BID SET

CAPTIVEAIRE DRAWINGS

DRAWN BY: Author  
CHECKED BY: Checker  
JOB NO: 235004654

**M701**

875 N High St.  
Columbus, OH 43215  
380.900.8887  
www.bergmeyer.com

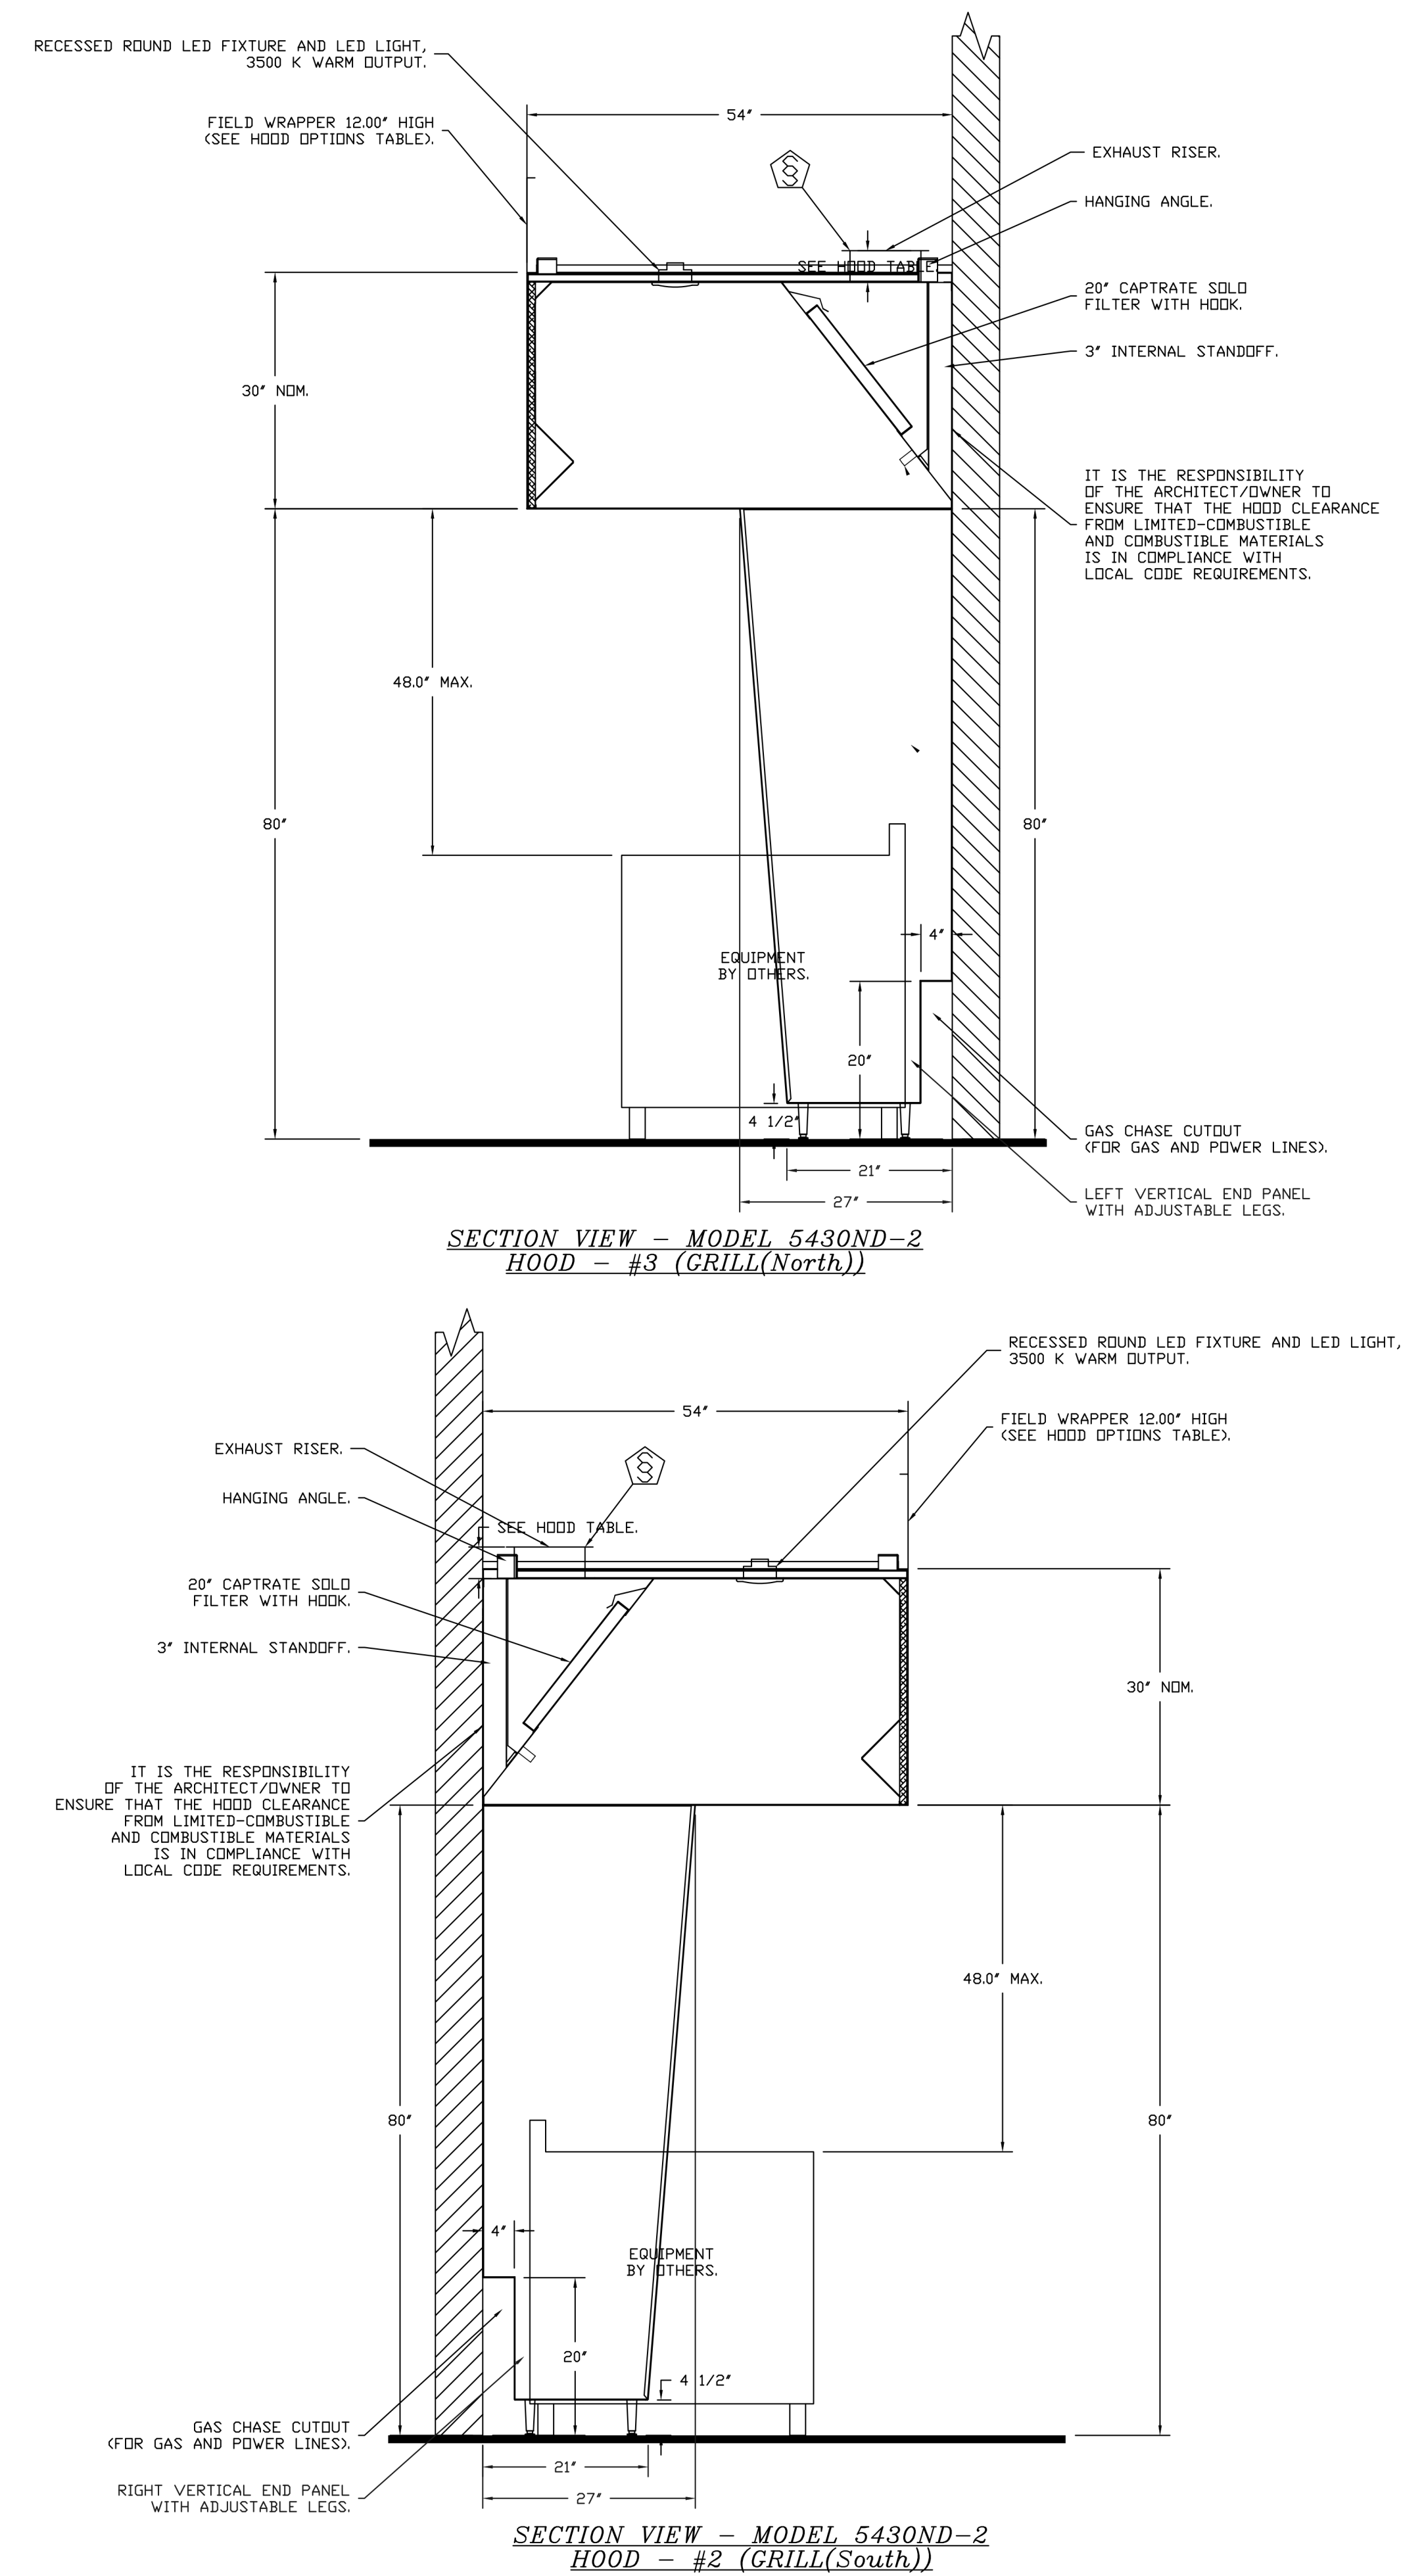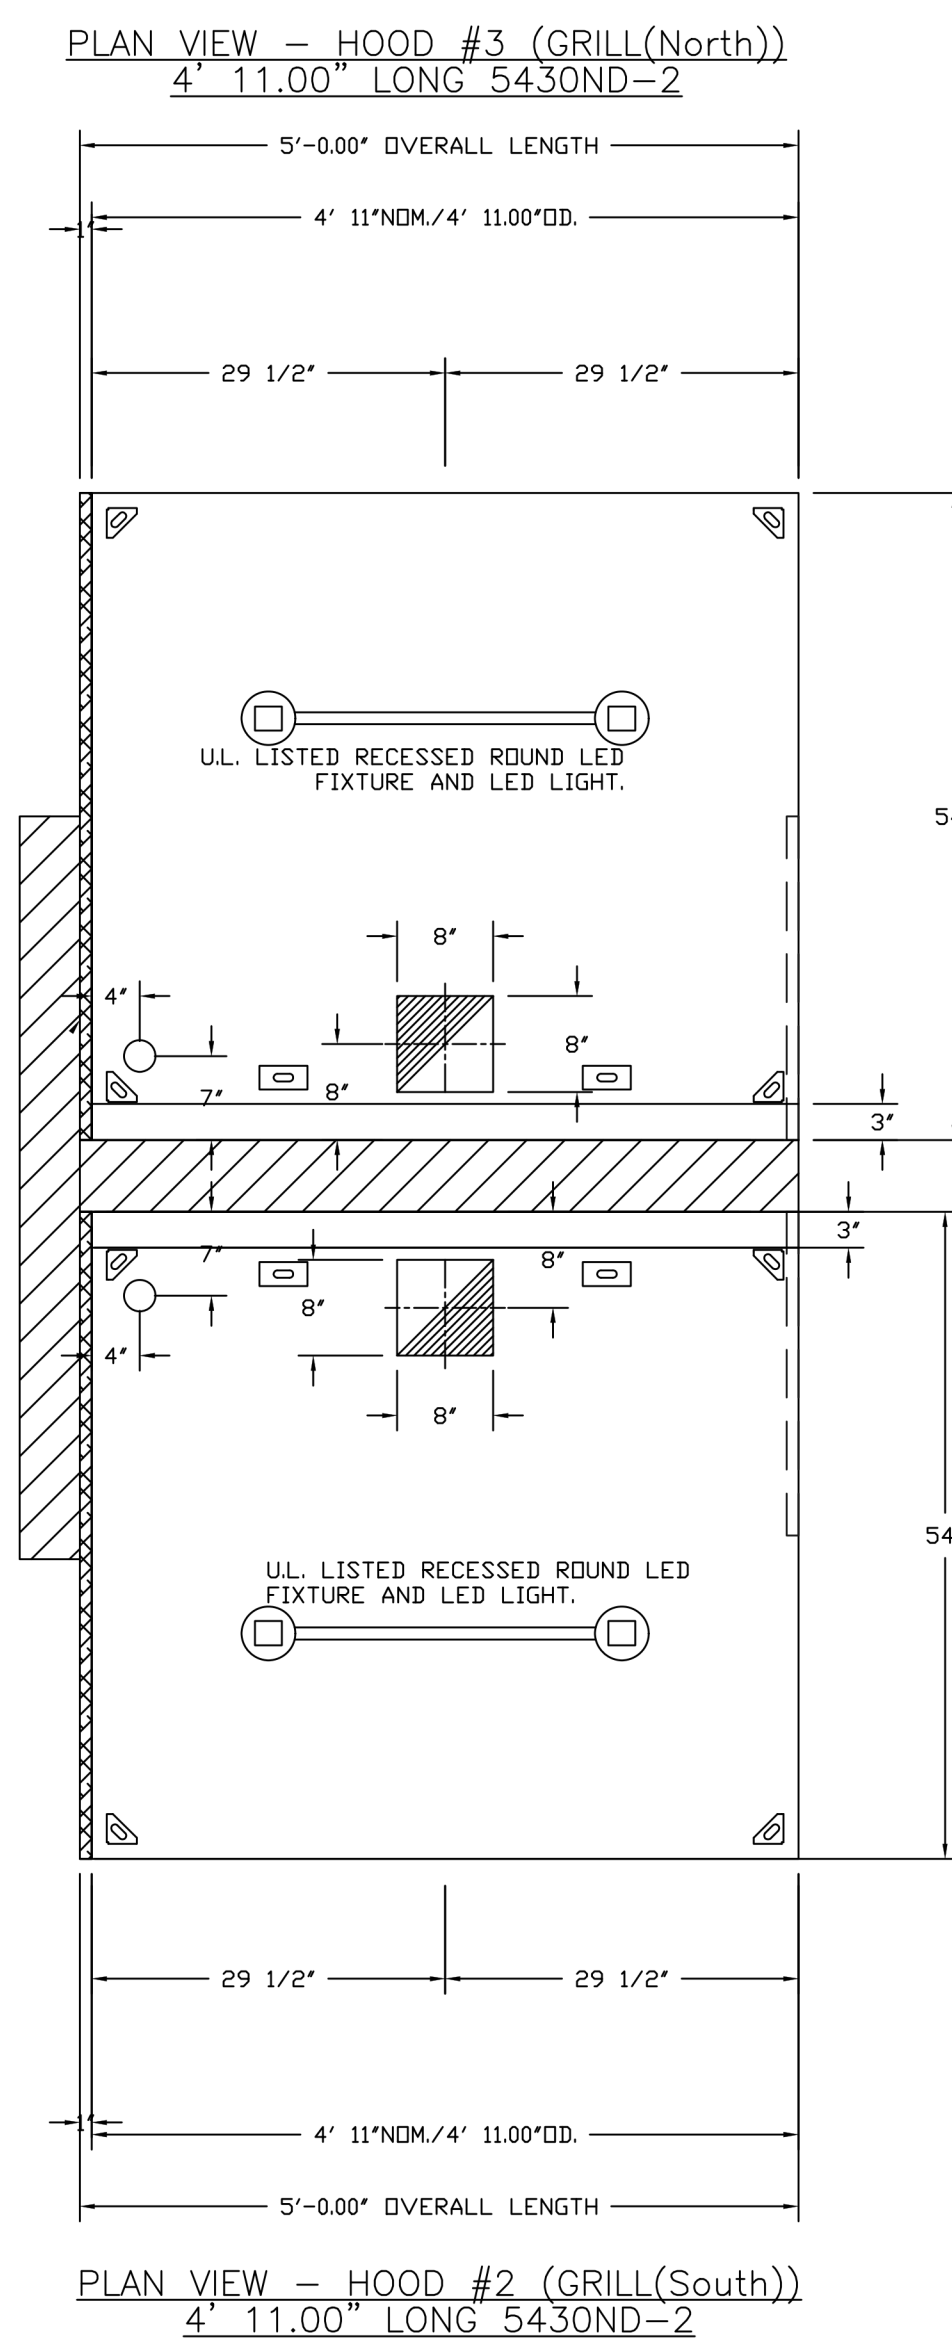

REVISIONS	
DESCRIPTION	DATE

**CAPTIVE**  
Eastern PA Mechanical  
www.captiveaire.com  
PO Box 2520, 1 Union Ave, Erie, PA 16504 PHONE: (814) 834-4126 EMAIL: reg108@captiveaire.com

Shake Shack-1515-Goodyear, AZ(Kitchen)  
GOODYEAR, AZ, 85395

**DATE:** 3/5/2024  
**DWG.#:** 6657868  
**DRAWN BY:** Joe.shilba  
**SCALE:** 3/4" = 1'-0"  
**MASTER DRAWING**

**SHEET NO.**  
2

**NOTE:**  
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

**Bergmeyer**

CONSULTANTS:

SEAL SIGNATURE:

FOR REFERENCE ONLY

NO.	BY	DATE	PERMIT/BID SET	DESCRIPTION
HE1	2024-04-22	PERMIT/BID SET		

**SHAKE SHACK**

SHAKE SHACK  
GOODYEAR, AZ

GOODYEAR CIVIC SQUARE  
PARCEL #501-2A-983  
GOODYEAR, AZ 85395  
SHACK #1515

PERMIT/BID SET

CAPTIVEAIRE DRAWINGS

DRAWN BY: Author  
CHECKED BY: Checker  
JOB NO: 2350004654

**M702**

www.bergmeyer.com  
875 N High St, Columbus, OH 43215  
800 South Figueroa St, Los Angeles, CA 90017  
215.337.1090  
386.900.8887



**FIRE SYSTEM INFORMATION – JOB#6657868**

FIRE SYSTEM NO	TAG	TYPE	SIZE	MAX FP	DESIGN FP	INSTALLATION	
						SYSTEM	LOCATION ON HOOD
1		TANK FS	4.0/4.0/4.0	60	54	FIRE CABINET LEFT	LEFT, HOOD 1

**CAS VALVE(S)**

FIRE SYSTEM NO	TAG	TYPE	SIZE	SUPPLIED BY
1		SC ELECTRICAL	2.000	CAPTIVEAIRE SYSTEMS

**NOTES**

- FIELD PIPE DROPS AS SHOWN
- PIPING, ELBOWS, TEES, AND NOZZLES SUPPLIED BY CAS.
- FIELD INSTALLED DROP; FACTORY WILL PROVIDE QTY 2 60IN LONG PIECES OF CHROME PLATED PIPING SHIPPED LOOSE TO BE FIELD-INSTALLED.
- SHIP LOOSE DROP; FACTORY WILL PROVIDE THE EXACT CHROME PIPE LENGTH NEEDED SHIPPED LOOSE TO BE FIELD-INSTALLED.
- RELOCATE NOZZLES IF FLOW PATTERN IS BLOCKED BY SHELVEING, SALAMANDERS, ETC.
- OVERLAPPING COVERAGE SHALL NOT BE USED ON ANY APPLIANCE WITH AN OBSTRUCTION.
- IF APPLICABLE, EXTENDED PRE-PIPED DROPS ARE SHIPPED LOOSE.
- FACTORY PIPING EXTENDS A MAXIMUM OF 6" ABOVE THE TOP OF THE HOOD.
- APPLIANCE DIMENSIONS LISTED REPRESENT THE COOKING SURFACE SIZE, NOT THE OVERALL APPLIANCE SIZE.
- THIS FIRE SYSTEM COMPLIES WITH U.L. 300 REQUIREMENTS.
- DL-F NOZZLE PART NUMBER REPLACES 3070-3/8H-10-SS

JOB #: 6657868.

JOB NAME: SHAKE SHACK-1515-GOODYEAR, AZ(KITCHEN).

SYSTEM SIZE: TANK-SP-3 DESIGN FP: 54, MAXIMUM FP: 60.

HOOD # 1 4' 11.00" LONG x 54" WIDE x 30" HIGH.

RISER # 1 SIZE: 9" x 9".

HOOD # 1 METAL BLOW-OFF CAPS INCLUDED.

HOOD # 2 4' 11.00" LONG x 54" WIDE x 30" HIGH.

RISER # 1 SIZE: 8" x 8".

HOOD # 2 METAL BLOW-OFF CAPS INCLUDED.

HOOD # 3 4' 11.00" LONG x 54" WIDE x 30" HIGH.

RISER # 1 SIZE: 8" x 8".

HOOD # 3 METAL BLOW-OFF CAPS INCLUDED.


- HEAVY-DUTY APPLIANCES (RATED 600°F) WILL REQUIRE AN ADDITIONAL DOWNSTREAM FIRESTAT IN THE EVENT THAT THE DUCTWORK CONTAINS ANY HORIZONTAL RUNS OVER 25 FT IN LENGTH.

- MEDIUM TO LIGHT-DUTY APPLIANCES (RATED 450°F) WILL NOT REQUIRE ANY ADDITIONAL DOWNSTREAM DETECTION.


**LEGEND – FIRE CABINET TANK SYSTEM**

- 4 GALLON TANK.
- PRIMARY ACTUATOR RELEASE.
- SECONDARY ACTUATOR RELEASE.
- PRESSURE SUPERVISION SWITCH.
- PRIMARY HOSE ASSEMBLY.
- SECONDARY HOSE ASSEMBLY.
- REMOTE MANUAL ACTUATION DEVICE.

SYSTEM REQUIRES A MINIMUM OF 7 FT OF EQUIVALENT PIPE LENGTH BETWEEN TANK AND NEAREST APPLIANCE NOZZLE FOR MOST APPLIANCES. EACH 90 DEGREE ELBOW ADDS 13 FT OF EQUIVALENT LENGTH. SEE MANUAL FOR DETAILS.

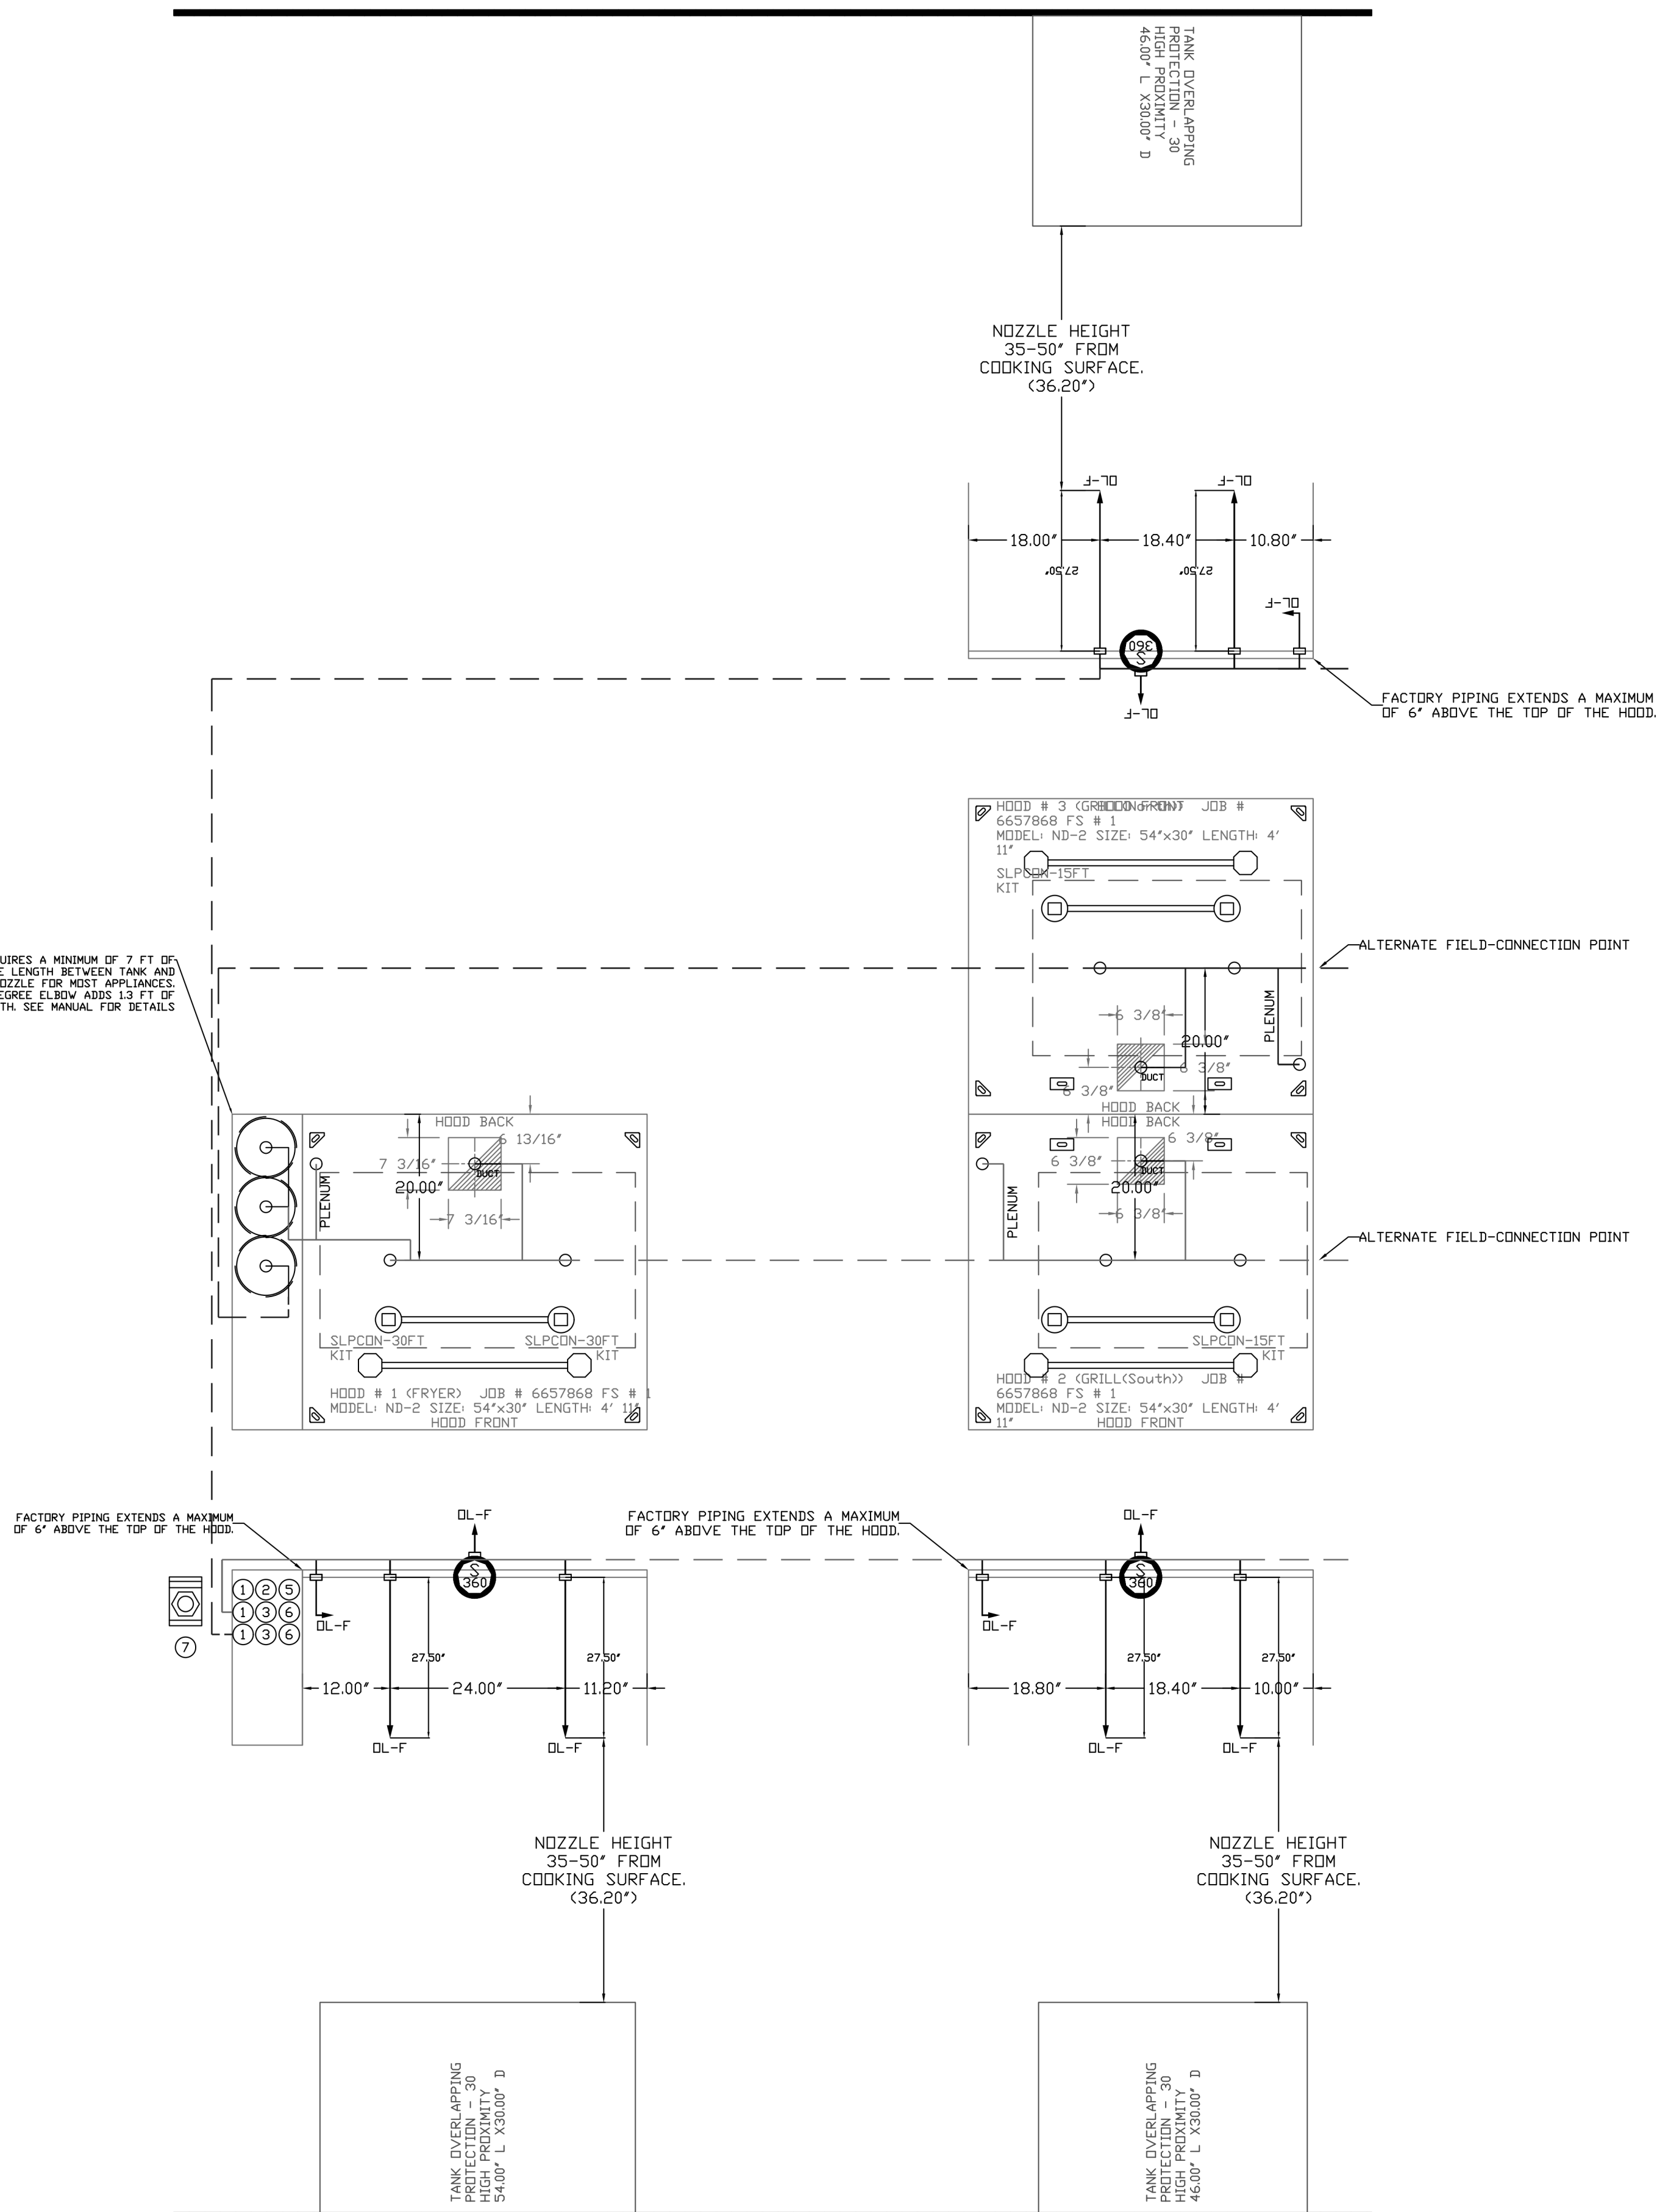

REVISIONS	
DESCRIPTION	DATE

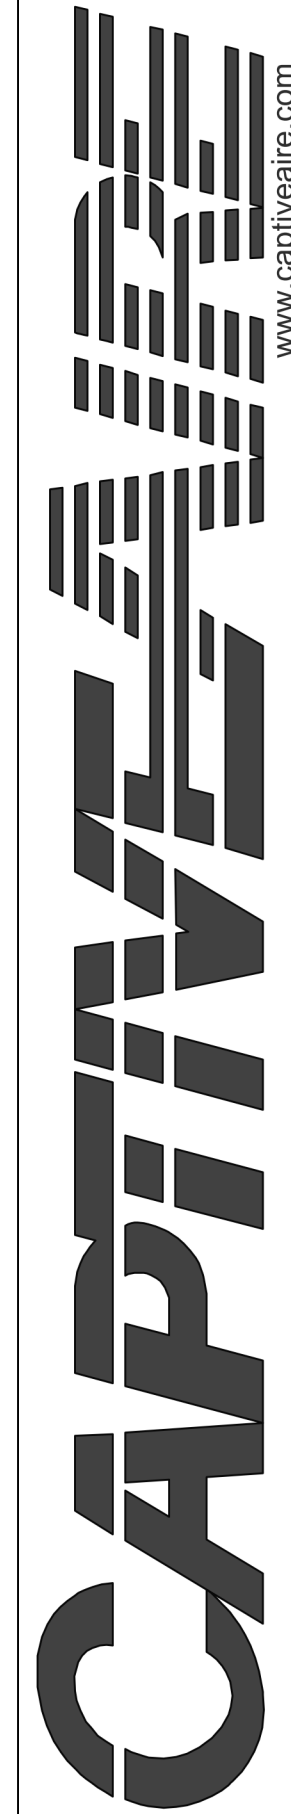

Eastern PA Mechanical  
PO Box 2520, 1 Union Ave, Bethlehem, PA 18004 PHONE: (607) 504-4126 EMAIL: reg108@captivaire.com

Shake Shack-1515-Goodyear, AZ(Kitchen)  
GOODYEAR, AZ, 85395

<b>DATE:</b> 3/5/2024
<b>DWG.#:</b> 6657868
<b>DRAWN BY:</b> Joe.shilba
<b>SCALE:</b> 3/4" = 1'-0"
<b>MASTER DRAWING</b>
<b>SHEET NO.</b> 4

**NOTE:**  
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

CONSULTANTS:

SEAL SIGNATURE:

FOR REFERENCE ONLY

HEI | 2024-04-22 | PERMIT/BID SET

NO.	BY	DATE	DESCRIPTION
-----	----	------	-------------

SHAKE SHACK  
GOODYEAR, AZ

GOODYEAR CIVIC SQUARE  
PARCEL #501-2A-983  
GOODYEAR, AZ 85395  
SHACK #1515

PERMIT/BID SET

CAPTIVEAIRE DRAWINGS

DRAWN BY: Author  
CHECKED BY: Checker  
JOB NO: 235004654

# M704

**EXHAUST FAN INFORMATION - JOB#6657868**

FAN UNIT NO	TAG	QTY	FAN UNIT MODEL #	MANUFACTURER	CFM	ESP	RPM	MOTOR ENCL	HP	BHP	PHASE	VOLT	FLA	DISCHARGE VELOCITY	WEIGHT (LBS)	SDNES
1	KEF-1	1	DU50HFA	CAPTIVEAIRE	860	1.000	1460	TEAD-ECM	0.500	0.3220	1	208	3.8	327 FPM	79	14.6
2	KEF-2	1	DU50HFA	CAPTIVEAIRE	738	1.000	1419	TEAD-ECM	0.500	0.2950	1	208	3.8	281 FPM	79	13.9
3	KEF-3	1	DU50HFA	CAPTIVEAIRE	738	1.000	1419	TEAD-ECM	0.500	0.2950	1	208	3.8	281 FPM	79	13.9

**FAN OPTIONS**

FAN UNIT NO	TAG	QTY	DESCRIPTION
1	KEF-1	1	GREASE BDX
		1	ECM WIRING PACKAGE - EXHAUST - MDDBUS CONTROL -MSC- (TELCD), CCW ROTATION
		1	FAN BASE CERAMIC SEAL - DU/DR50HFA - INSTALLED AT PLANT - FOR GREASE DUCTS
2	KEF-2	1	GREASE BDX
		1	ECM WIRING PACKAGE - EXHAUST - MDDBUS CONTROL -MSC- (TELCD), CCW ROTATION
		1	FAN BASE CERAMIC SEAL - DU/DR50HFA - INSTALLED AT PLANT - FOR GREASE DUCTS
3	KEF-3	1	GREASE BDX
		1	ECM WIRING PACKAGE - EXHAUST - MDDBUS CONTROL -MSC- (TELCD), CCW ROTATION
		1	FAN BASE CERAMIC SEAL - DU/DR50HFA - INSTALLED AT PLANT - FOR GREASE DUCTS



**FAN ACCESSORIES**

FAN UNIT NO	TAG	EXHAUST				SUPPLY		
		GREASE CUP	GRAVITY DAMPER	WALL MOUNT	SIDE DISCHARGE	GRAVITY DAMPER	MOTORIZED DAMPER	WALL MOUNT
1	KEF-1	YES						
2	KEF-2	YES						
3	KEF-3	YES						

**CURB ASSEMBLIES**

NO	DN FAN	TAG	WEIGHT	ITEM	SIZE
1	# 1	KEF-1	34 LBS	CURB	19.500"W X 19.500"L X 24.000"H HINGED.
2	# 2	KEF-2	34 LBS	CURB	19.500"W X 19.500"L X 24.000"H HINGED.
3	# 3	KEF-3	34 LBS	CURB	19.500"W X 19.500"L X 24.000"H HINGED.

**FANS #1 (KEF-1), #2 (KEF-2), #3 (KEF-3) - DU50HFA EXHAUST FAN**

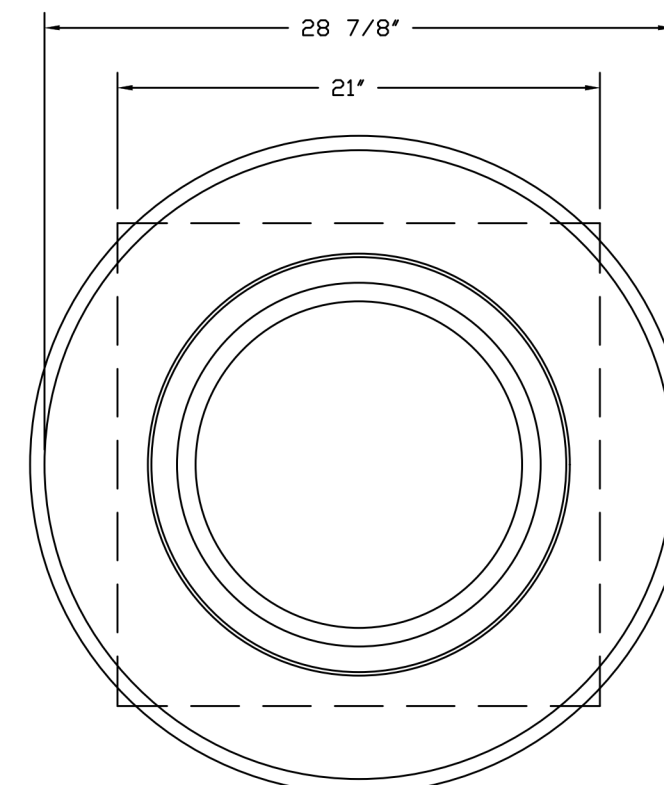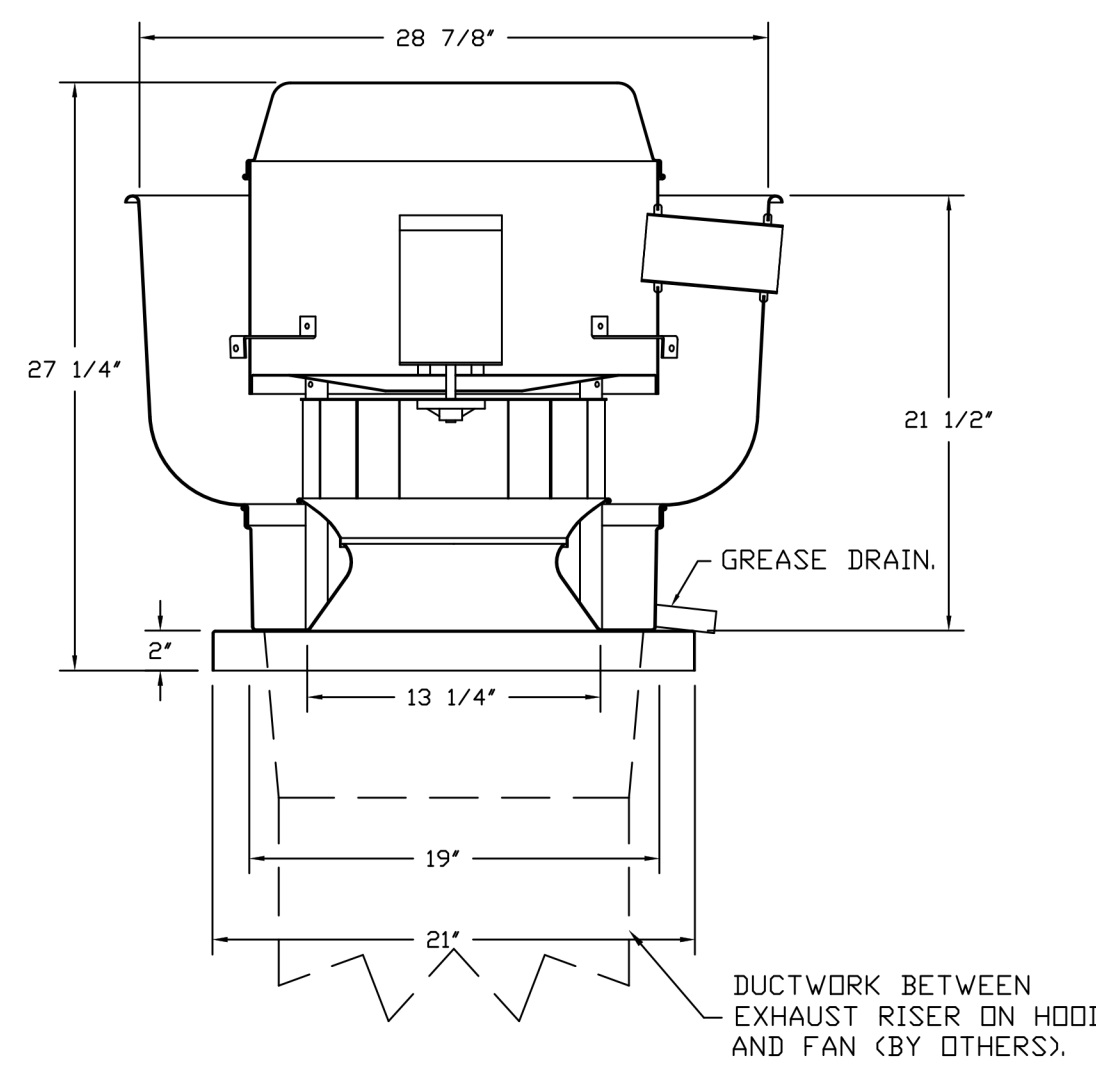

TOP VIEW

**FEATURES:**


- DIRECT DRIVE CONSTRUCTION (NO BELTS/PULLEYS).
- ROOF MOUNTED FANS.
- RESTAURANT MODEL.
- UL705 AND UL762 AND ULC-S645
- VARIABLE SPEED CONTROL.
- INTERNAL WIRING.
- THERMAL OVERLOAD PROTECTION (SINGLE PHASE).
- HIGH HEAT OPERATION 300°F (149°C).
- GREASE CLASSIFICATION TESTING.
- NEMA 3R SAFETY DISCONNECT SWITCH.

**NORMAL TEMPERATURE TEST**  
EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING AIR AT 300°F (149°C) UNTIL ALL FAN PARTS HAVE REACHED THERMAL EQUILIBRIUM, AND WITHOUT ANY DETERIORATING EFFECTS TO THE FAN WHICH WOULD CAUSE UNSAFE OPERATION.

**ABNORMAL FLARE-UP TEST**  
EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING BURNING GREASE VAPORS AT 600°F (316°C) FOR A PERIOD OF 15 MINUTES WITHOUT THE FAN BECOMING DAMAGED TO ANY EXTENT THAT COULD CAUSE AN UNSAFE CONDITION.

**DEFINITIONS**

- GREASE BDX.
- ECM WIRING PACKAGE - EXHAUST - MDDBUS CONTROL -MSC- (TELCD), CCW ROTATION.
- FAN BASE CERAMIC SEAL - DU/DR50HFA - INSTALLED AT PLANT - FOR GREASE DUCTS.
- 2 YEAR PARTS WARRANTY.

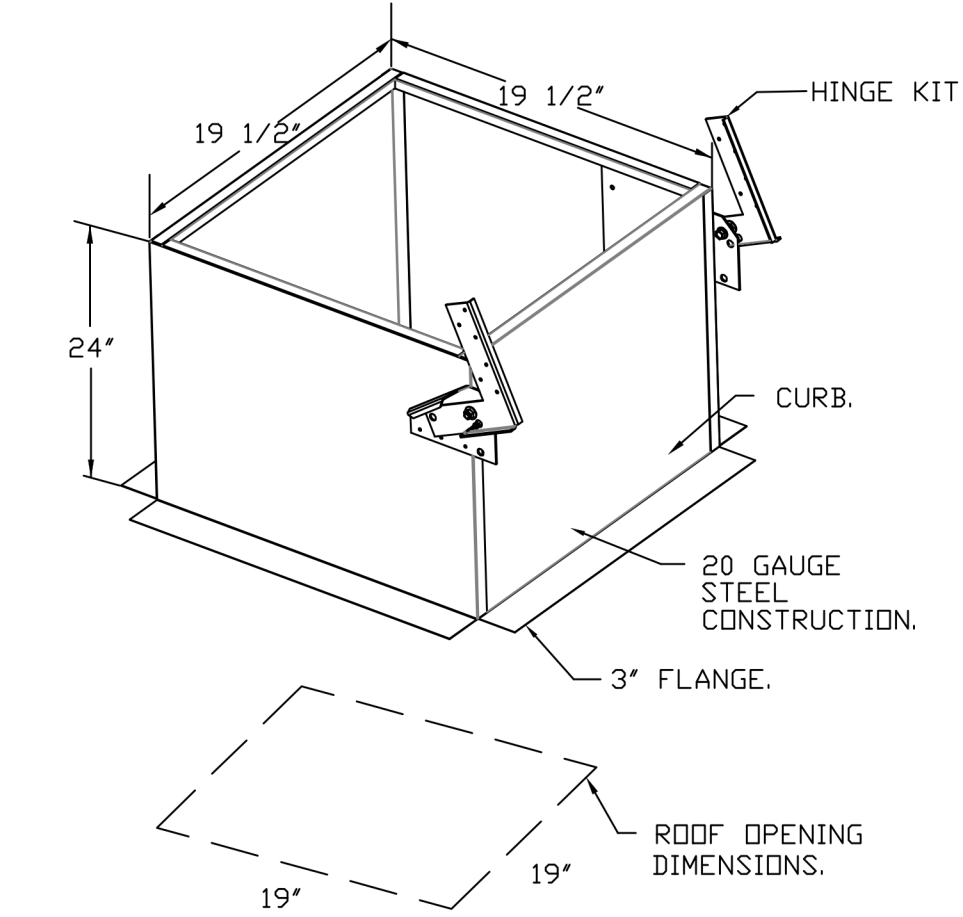

**REVISIONS**

NO.	DESCRIPTION	DATE




**CAPTIVE**  
Eastern PA Mechanical  
www.captiveaire.com

PO Box 2520, 1 Union Ave, Erie, PA 16504 PHONE: (814) 834-4126 EMAIL: reg108@captiveaire.com

CONSULTANTS:

SEAL SIGNATURE:

FOR REFERENCE ONLY

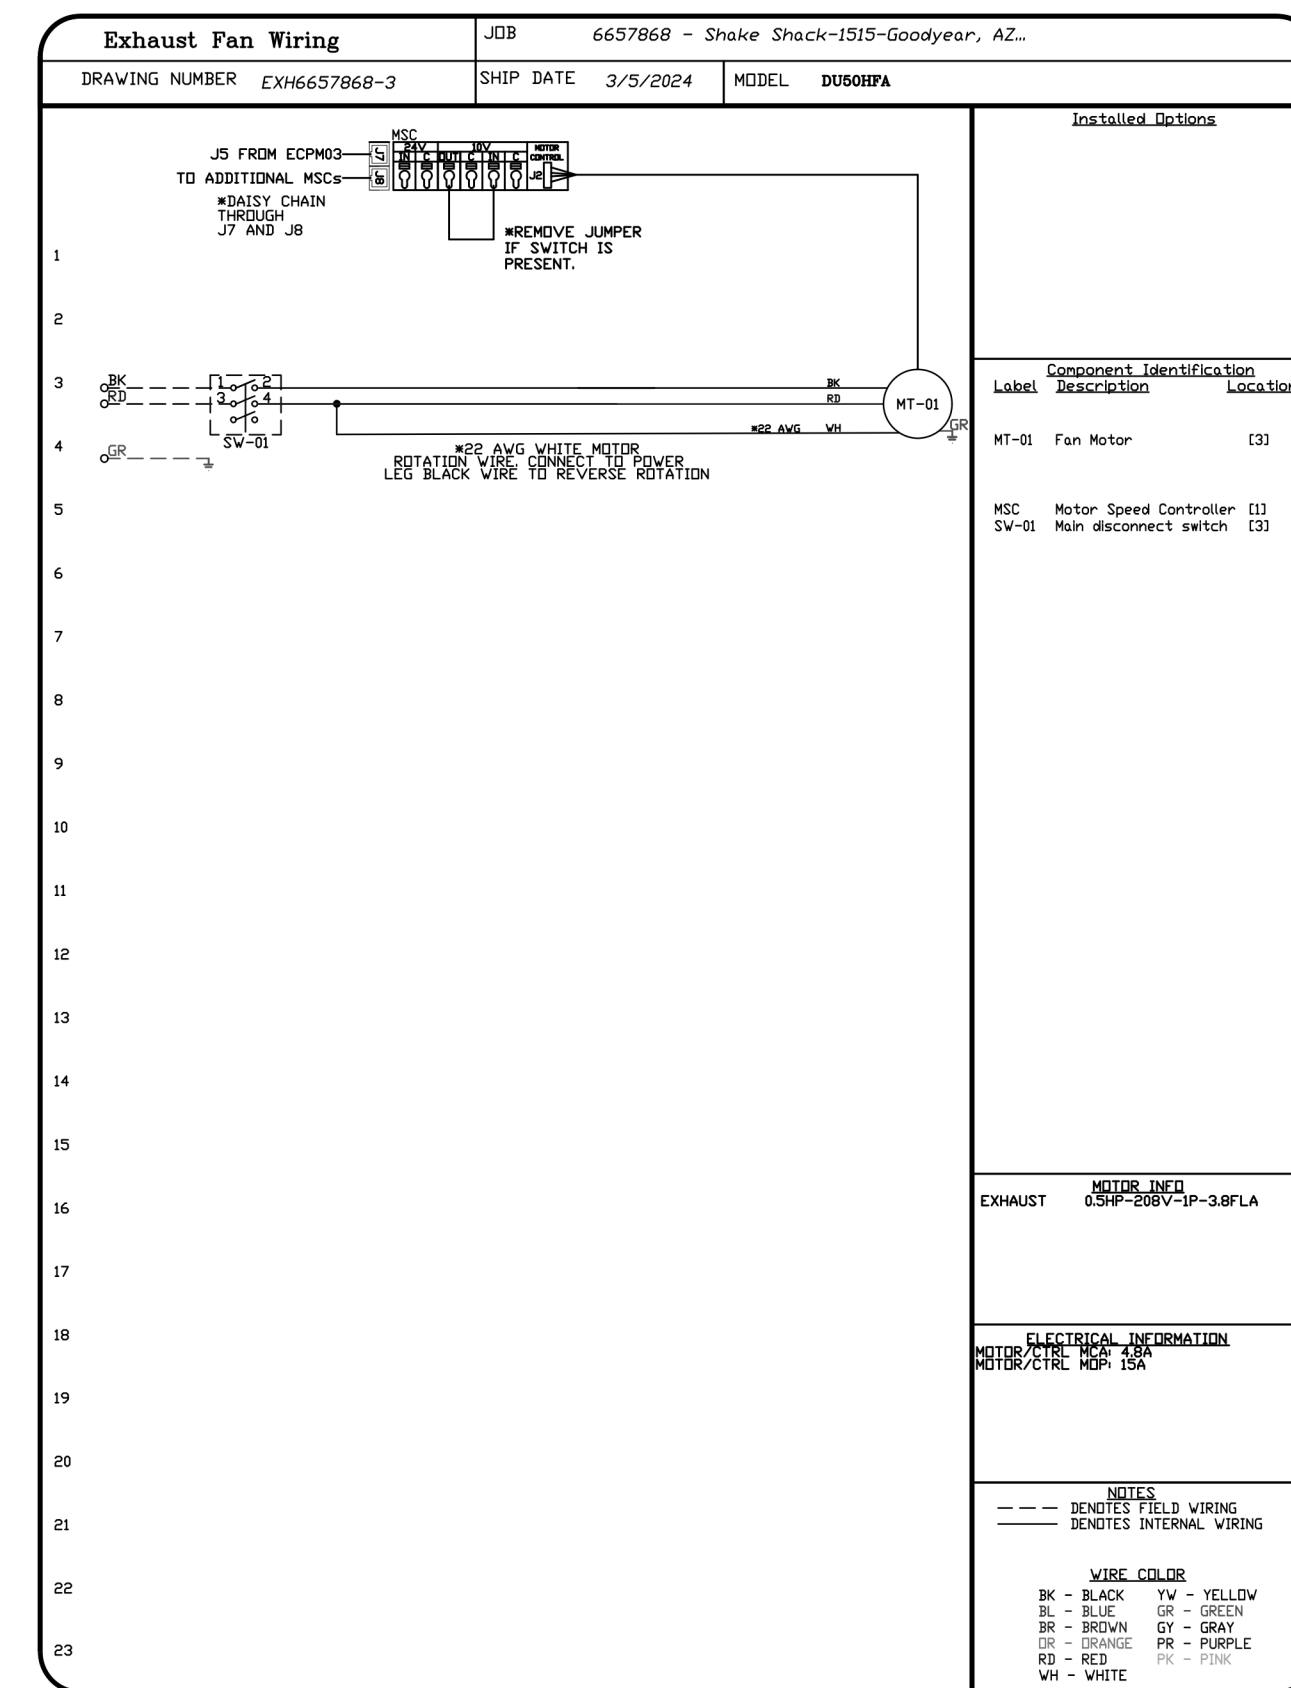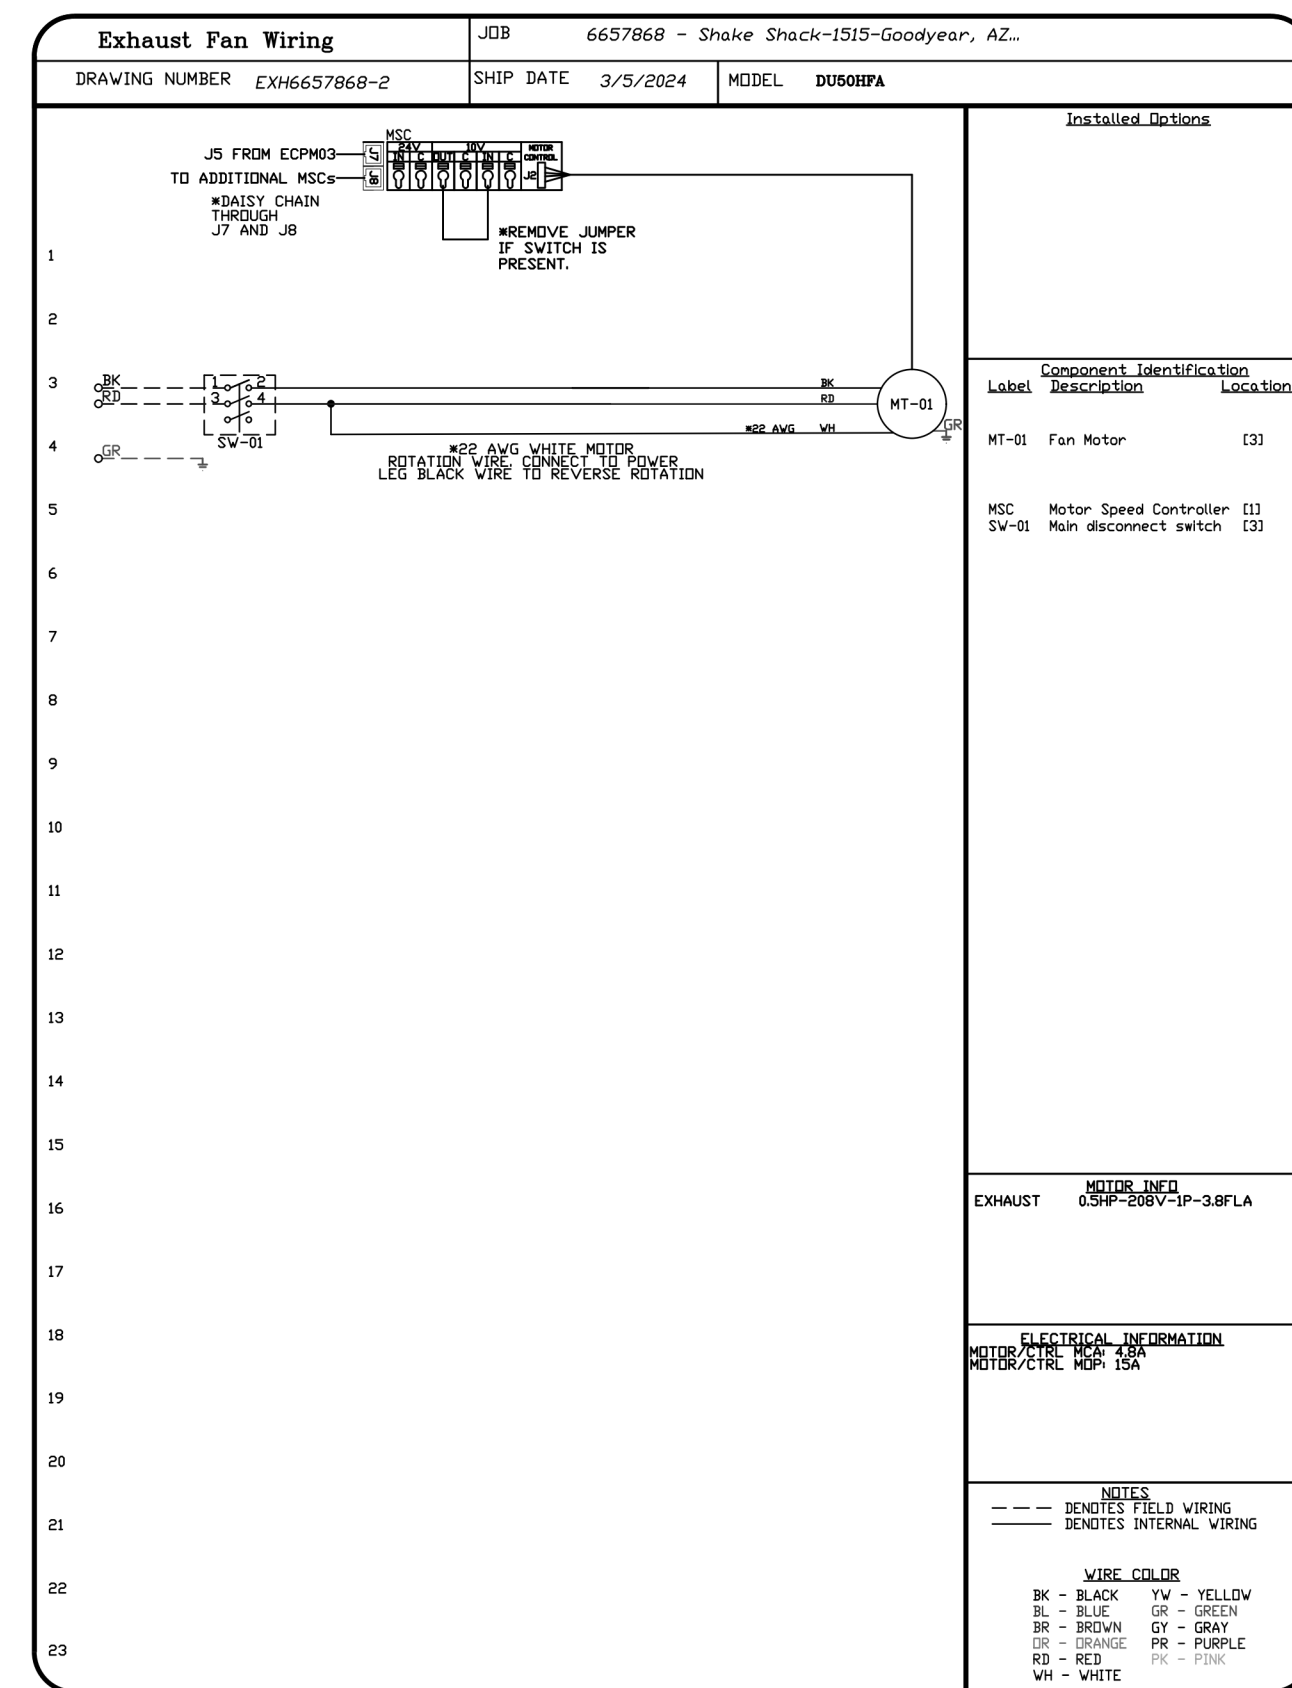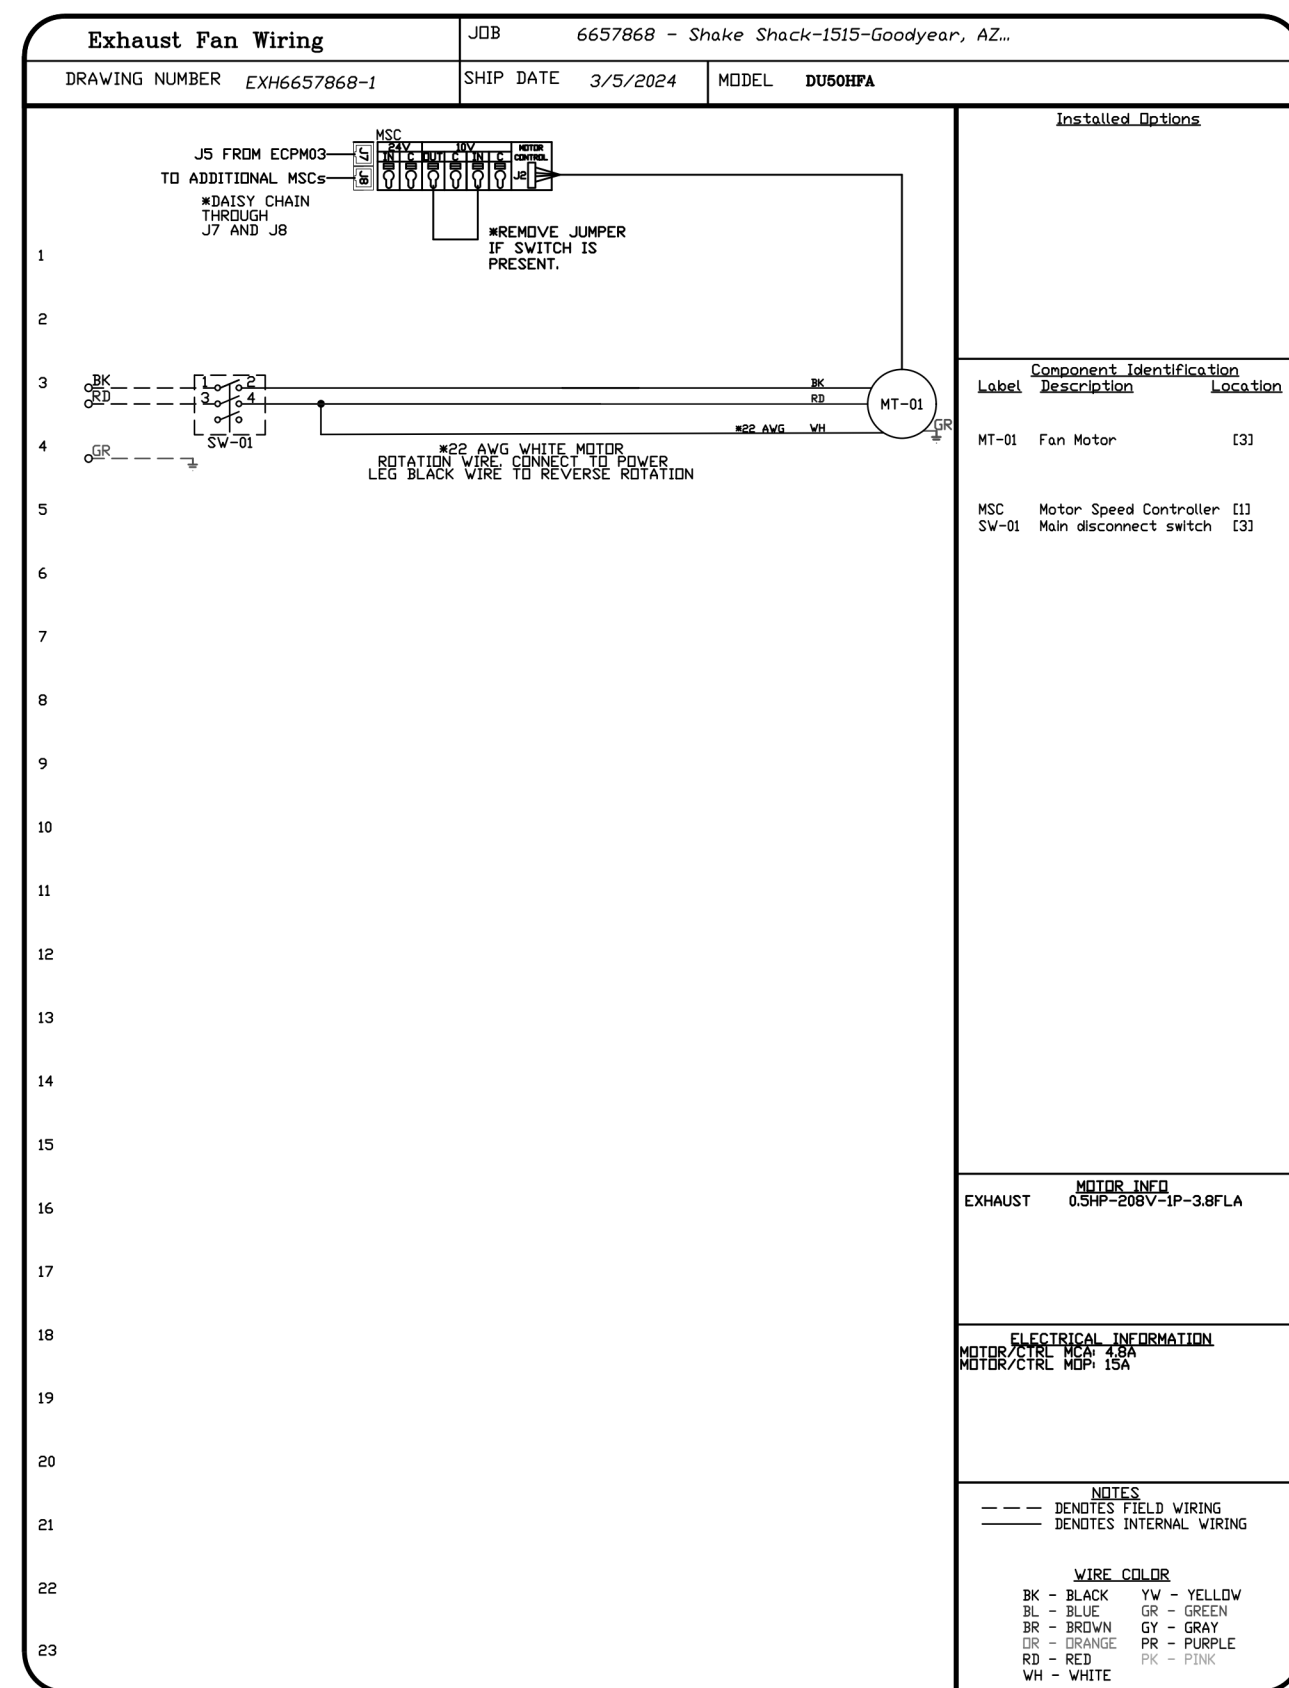

Shake Shack-1515-Goodyear, AZ(Kitchen)  
GOODYEAR, AZ, 85395

DATE: 3/5/2024  
DWG.#: 6657868  
DRAWN BY: Joe Shilba  
SCALE: 3/4" = 1'-0"  
MASTER DRAWING  
SHEET NO. 5

**NOTE:**  
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

HEI 2024-04-22 PERMIT/BID SET

SHAKE SHACK

SHAKE SHACK  
GOODYEAR, AZ

GOODYEAR CIVIC SQUARE  
PARCEL #501-2A-983  
GOODYEAR, AZ 85395  
SHACK #1515

PERMIT/BID SET

CAPTIVEAIRE DRAWINGS

DRAWN BY: Author


CHECKED BY: Checker

JOB NO: 2350004654

M705


**Bergmeyer**  
875 N High St.  
Columbus, OH 43215  
380.900.8887  
www.bergmeyer.com



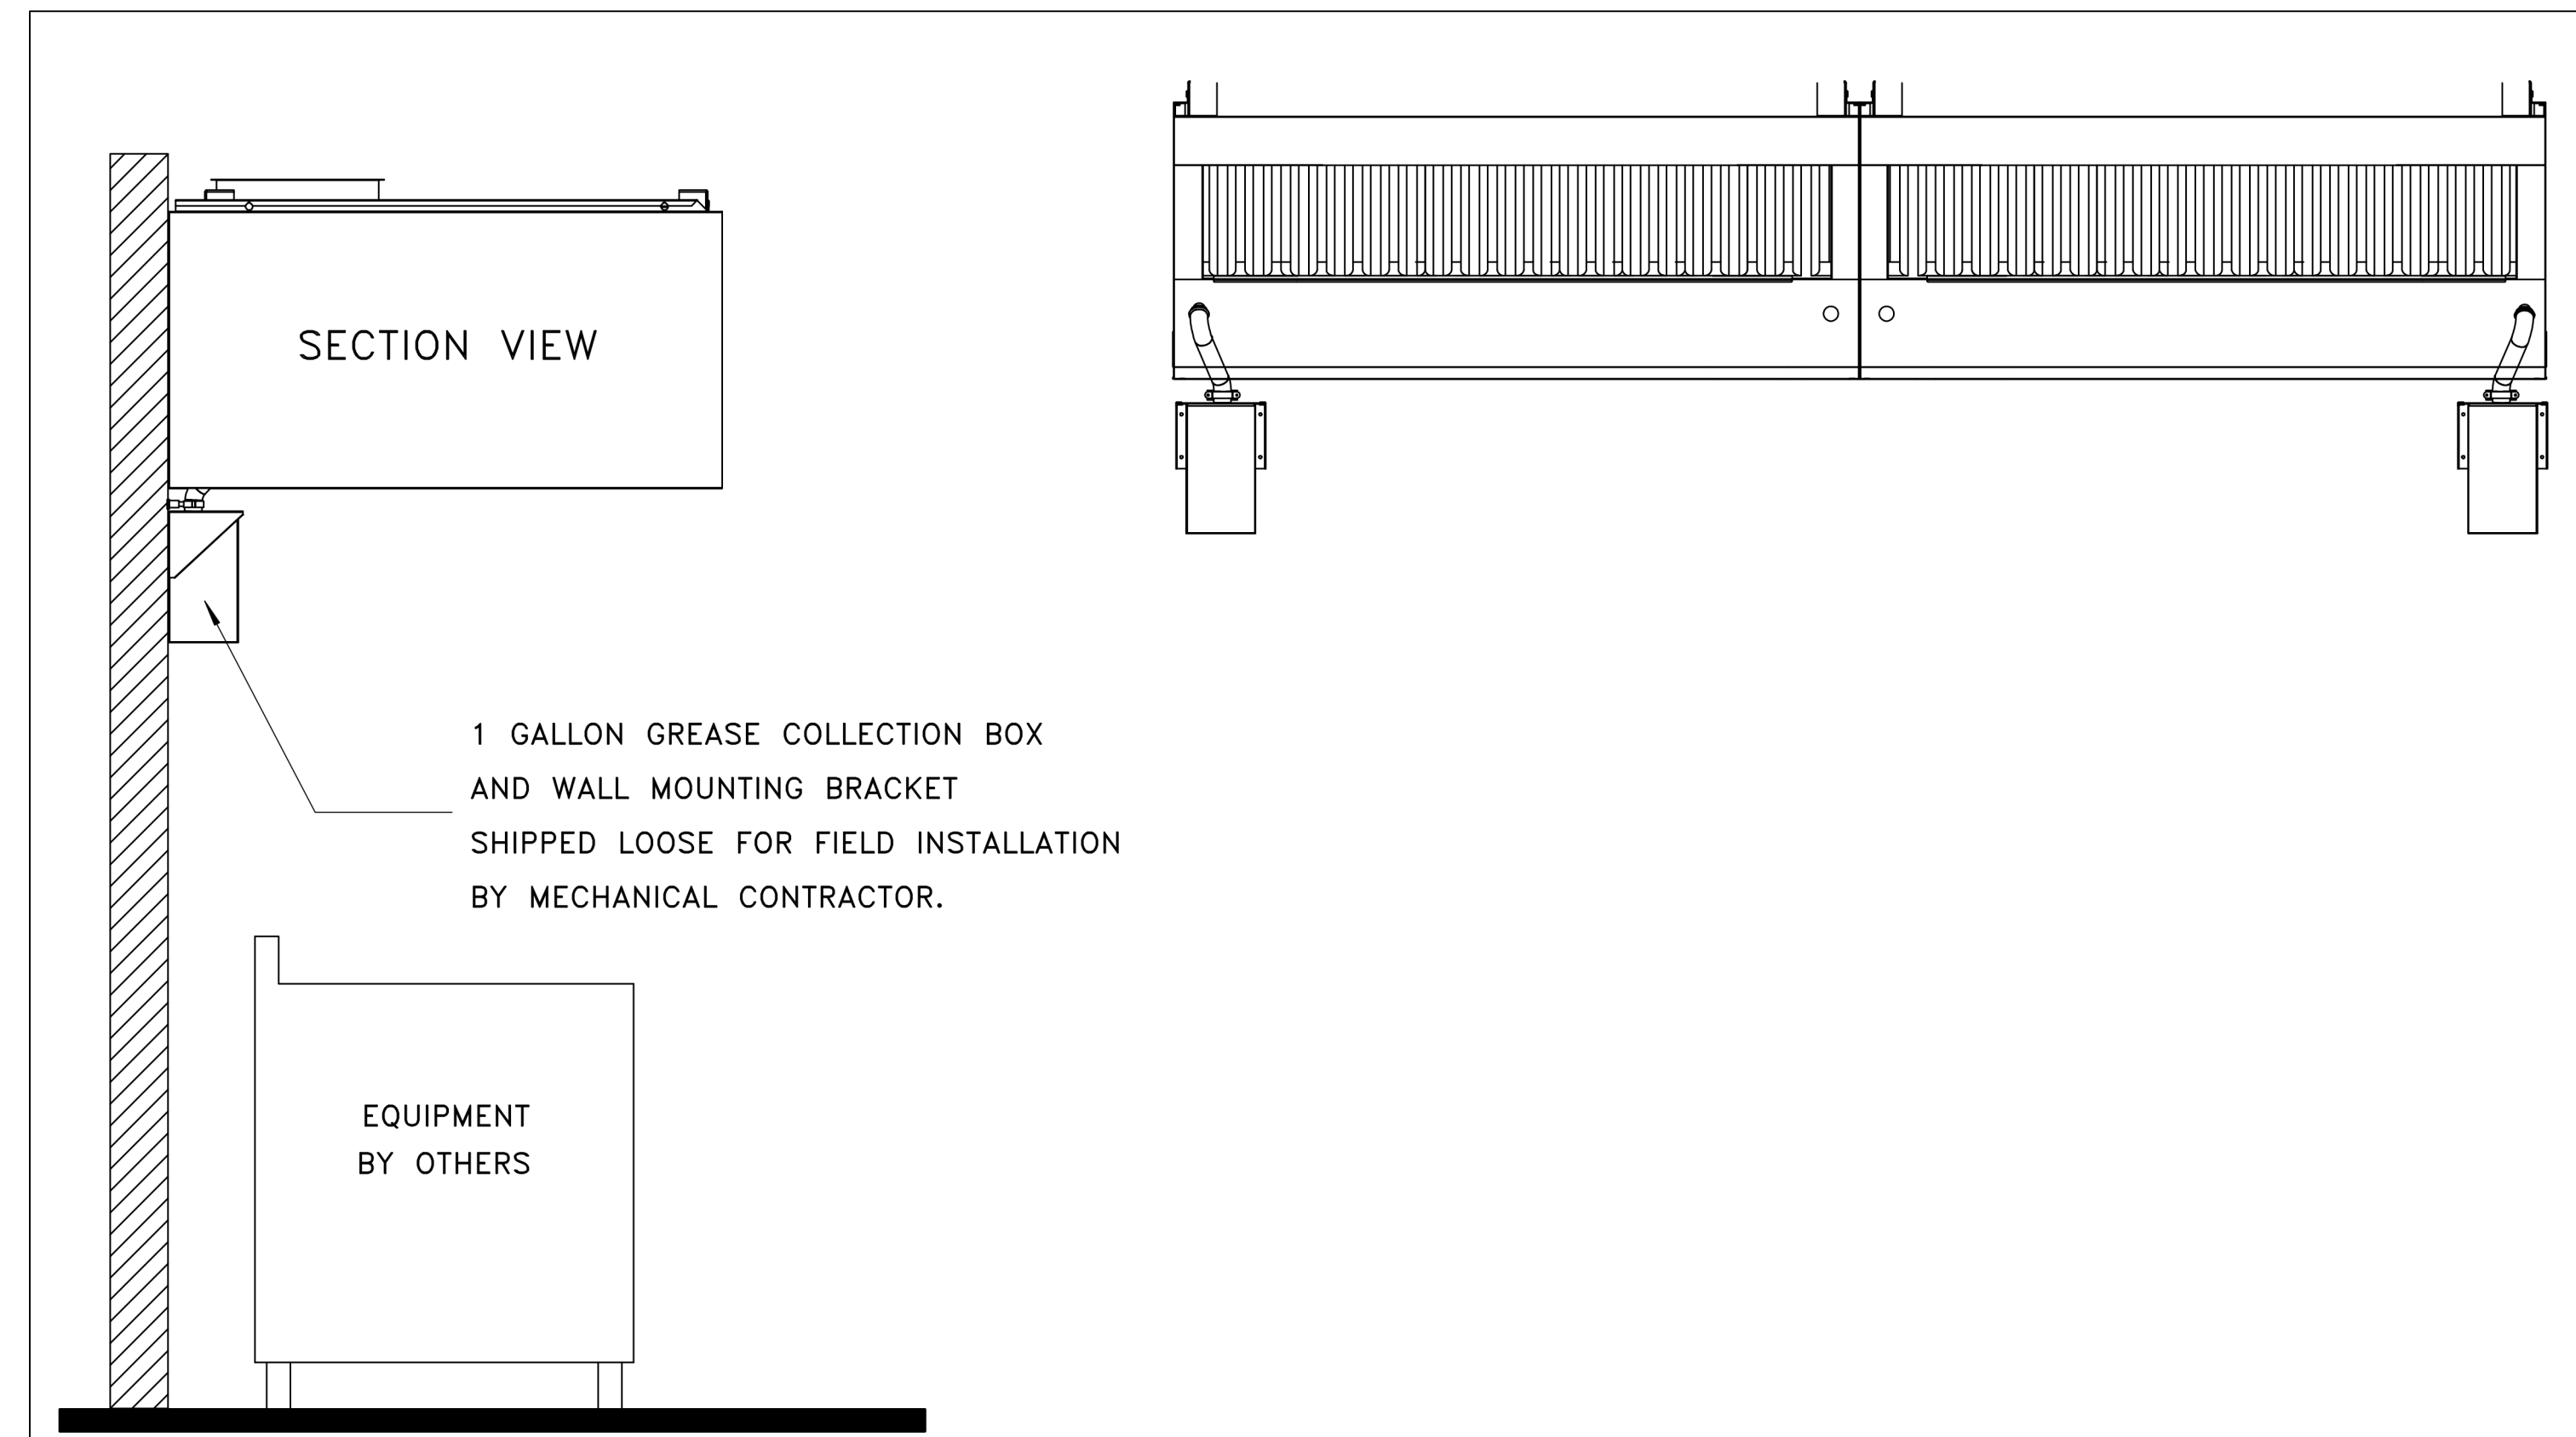

1 GALLON GREASE COLLECTION BOX AND WALL MOUNTING BRACKET SHIPPED LOOSE FOR FIELD INSTALLATION BY MECHANICAL CONTRACTOR.

EQUIPMENT BY OTHERS

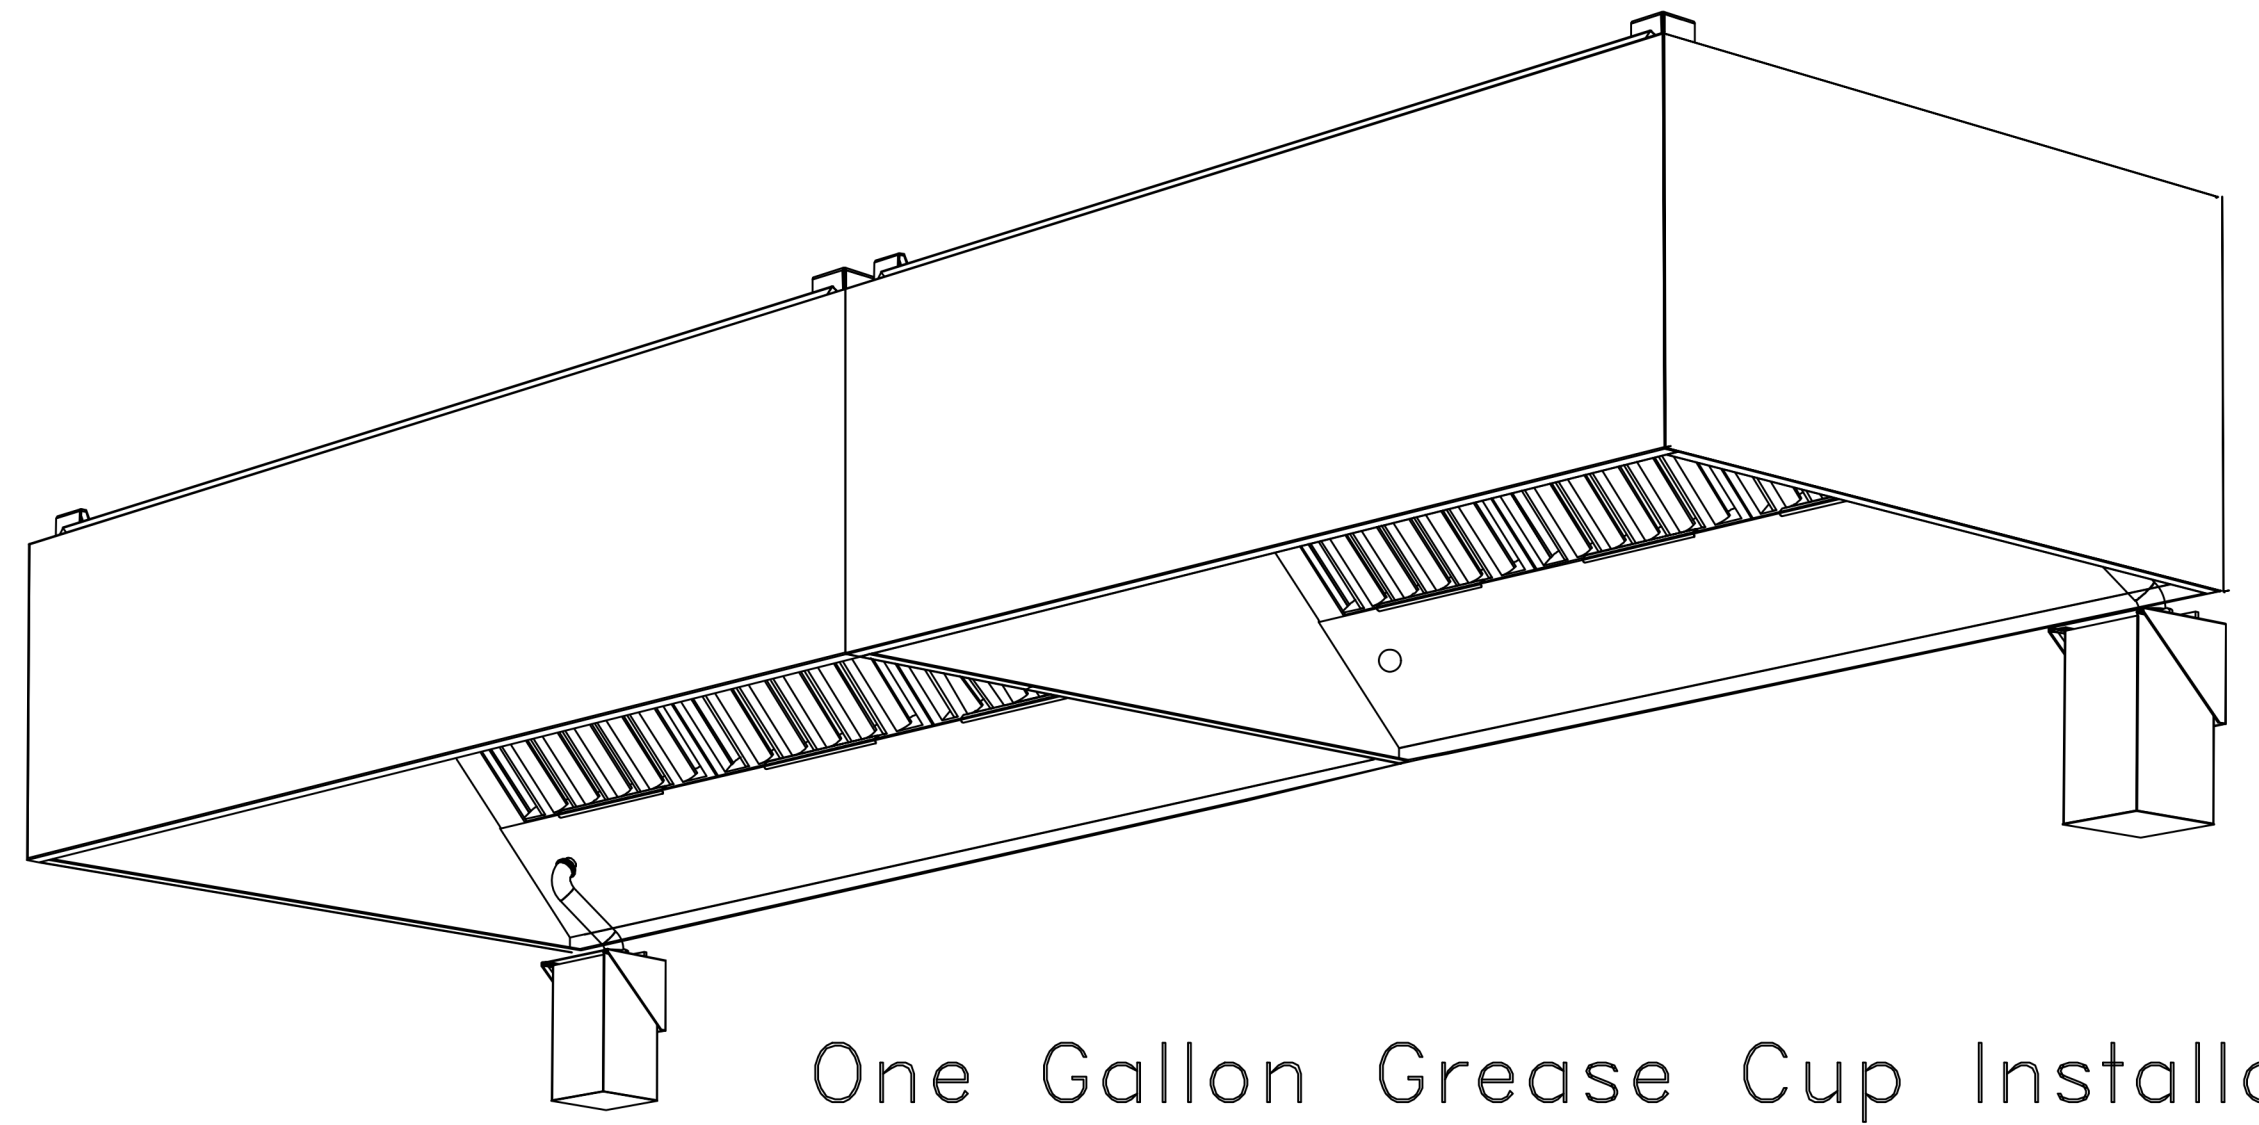


One Gallon Grease Cup Installation

Instructions below outline single, or dual, one gallon grease cup installation for ND-2 hood models.

The one gallon grease cup comes as an assembly of stainless steel wall mounting bracket and one gallon cup. The mounting bracket should be installed 2" from the edge of the containment plenum and 3"-4" below the bottom of the hood.

Piping from the hood grease drain should route to the opening of the grease cup, but not into the cup, otherwise the cup will not be able to be removed and emptied.

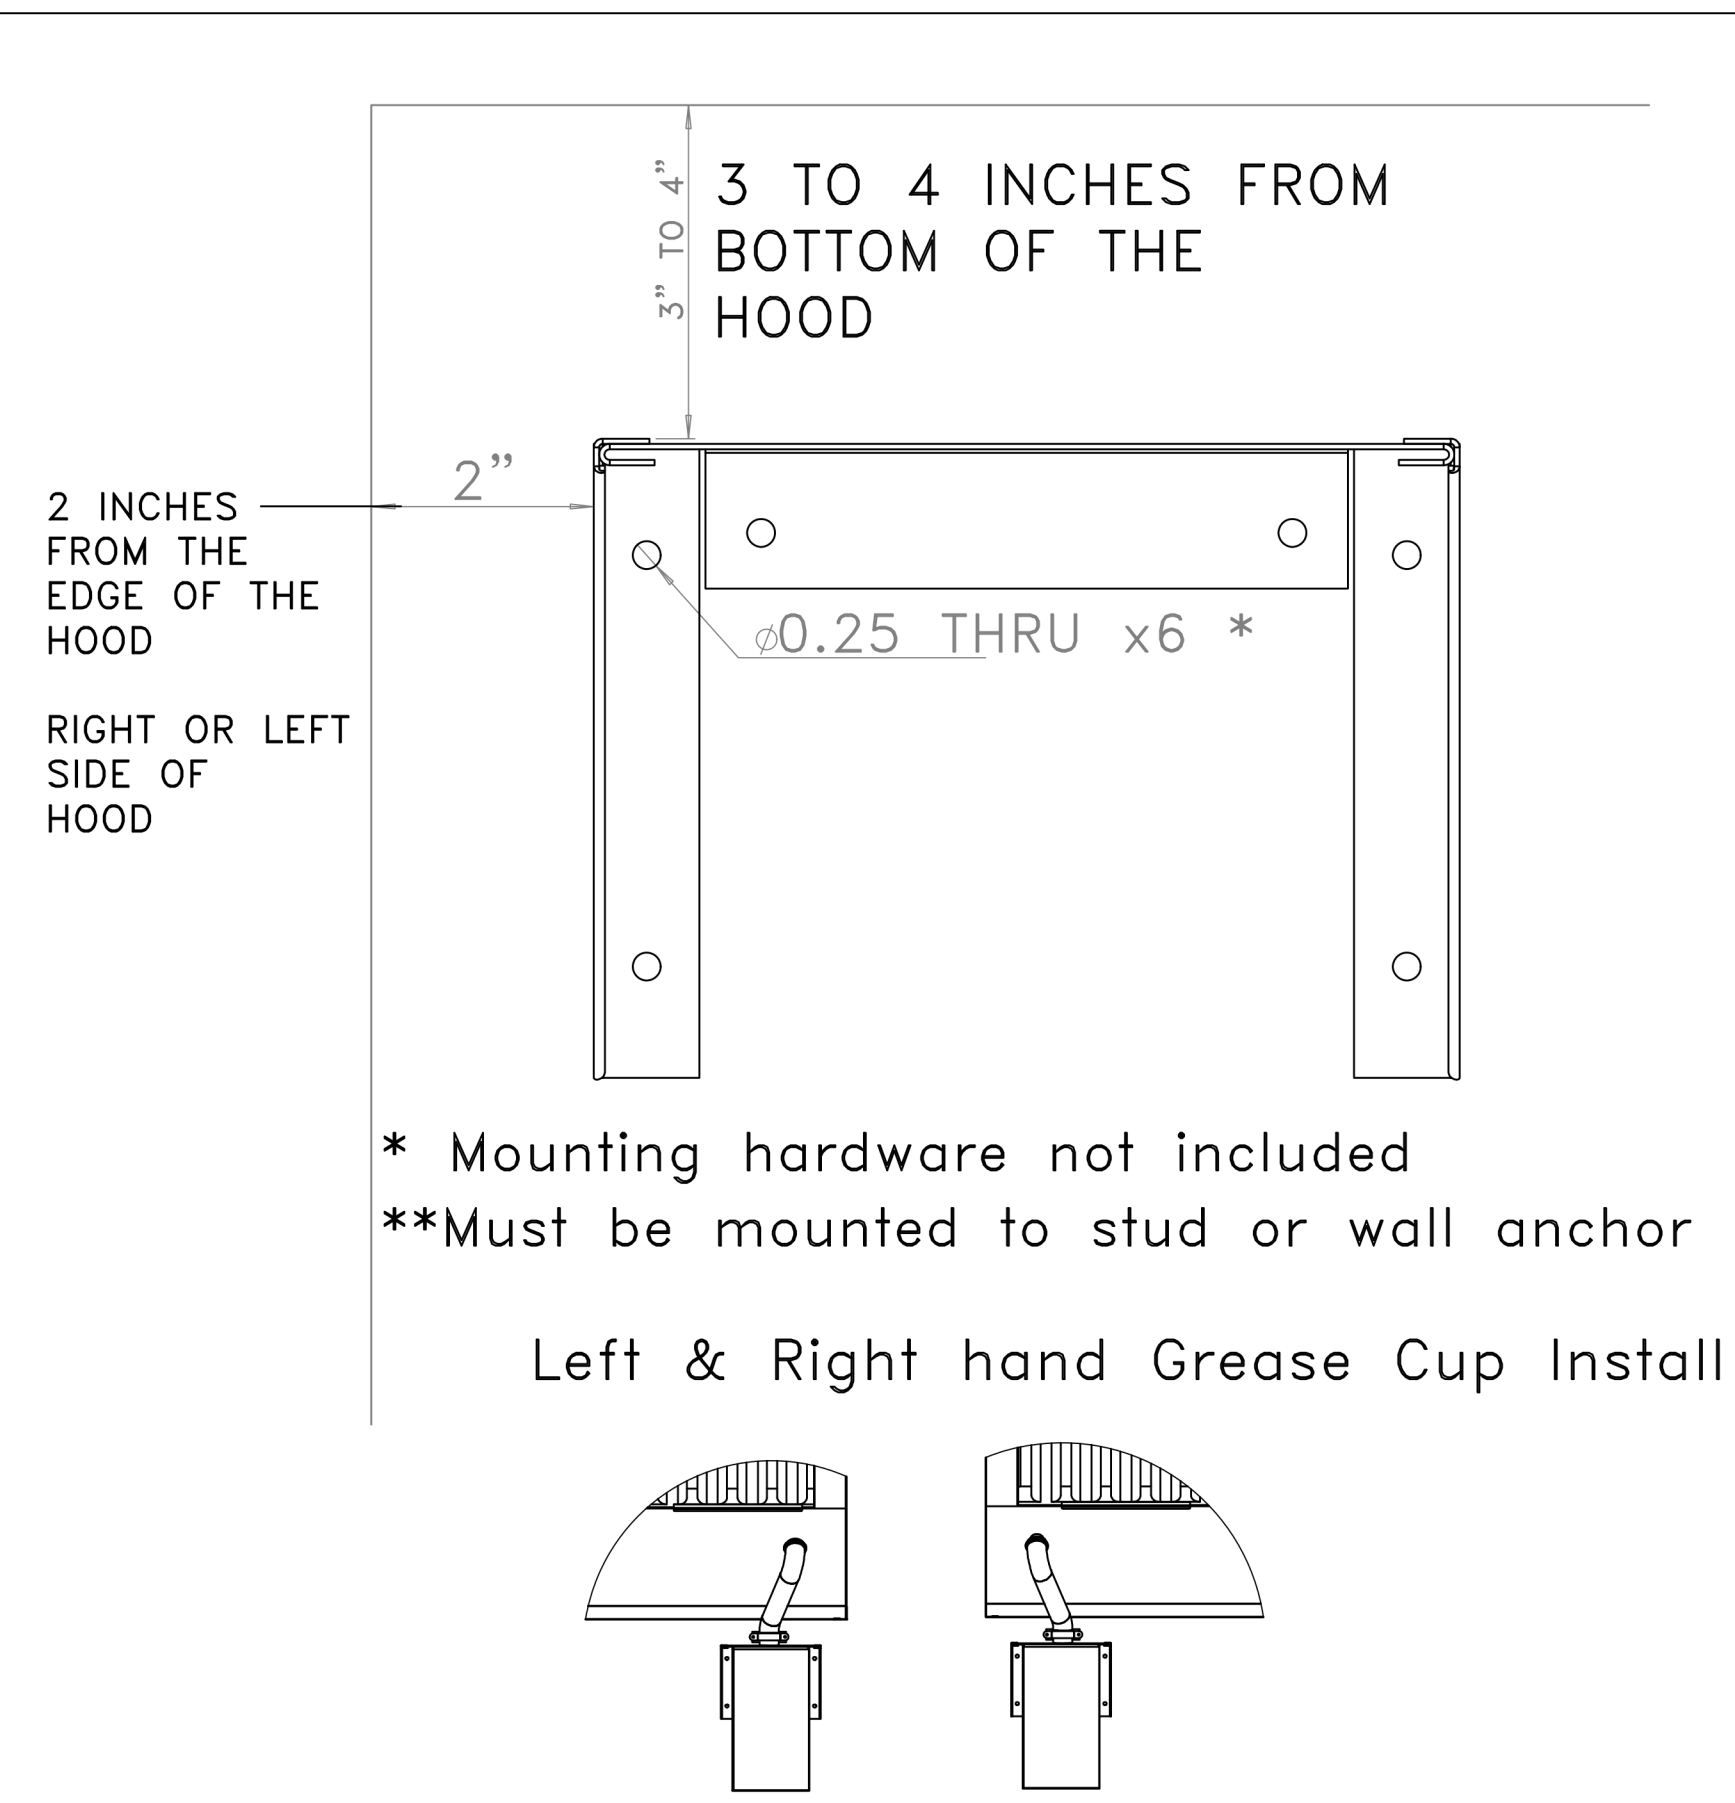


2 INCHES FROM THE EDGE OF THE HOOD

3 TO 4 INCHES FROM BOTTOM OF THE HOOD

0.25 THRU x6 \*


\* Mounting hardware not included  
\*\*Must be mounted to stud or wall anchor

Left & Right hand Grease Cup Install

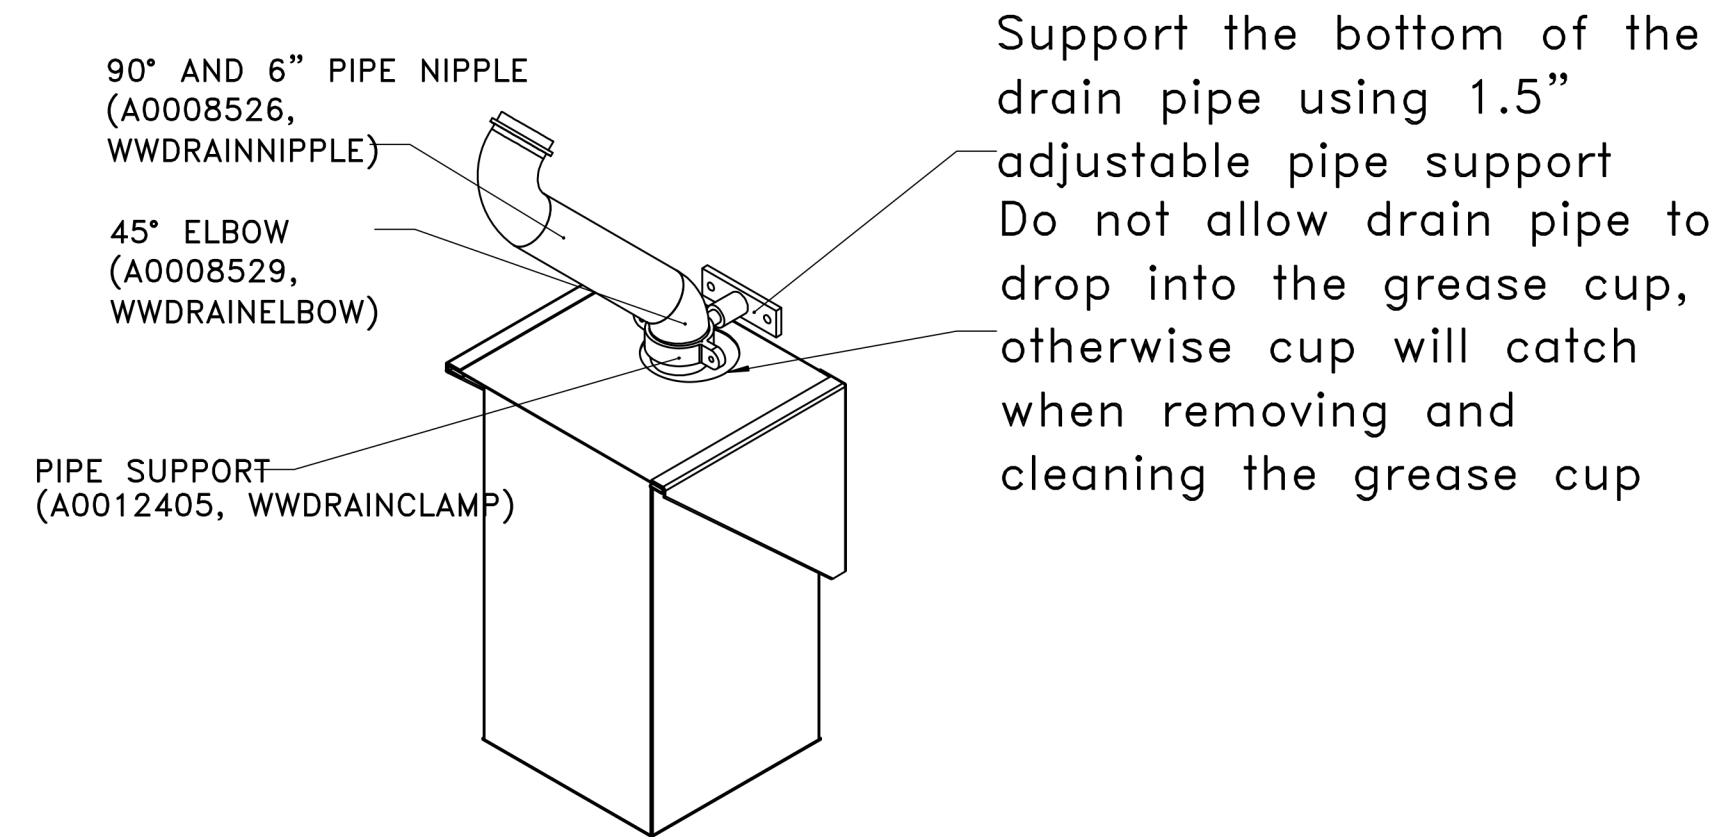

Support the bottom of the drain pipe using 1.5" adjustable pipe support. Do not allow drain pipe to drop into the grease cup, otherwise cup will catch when removing and cleaning the grease cup

Gallon Grease Cup Assembly

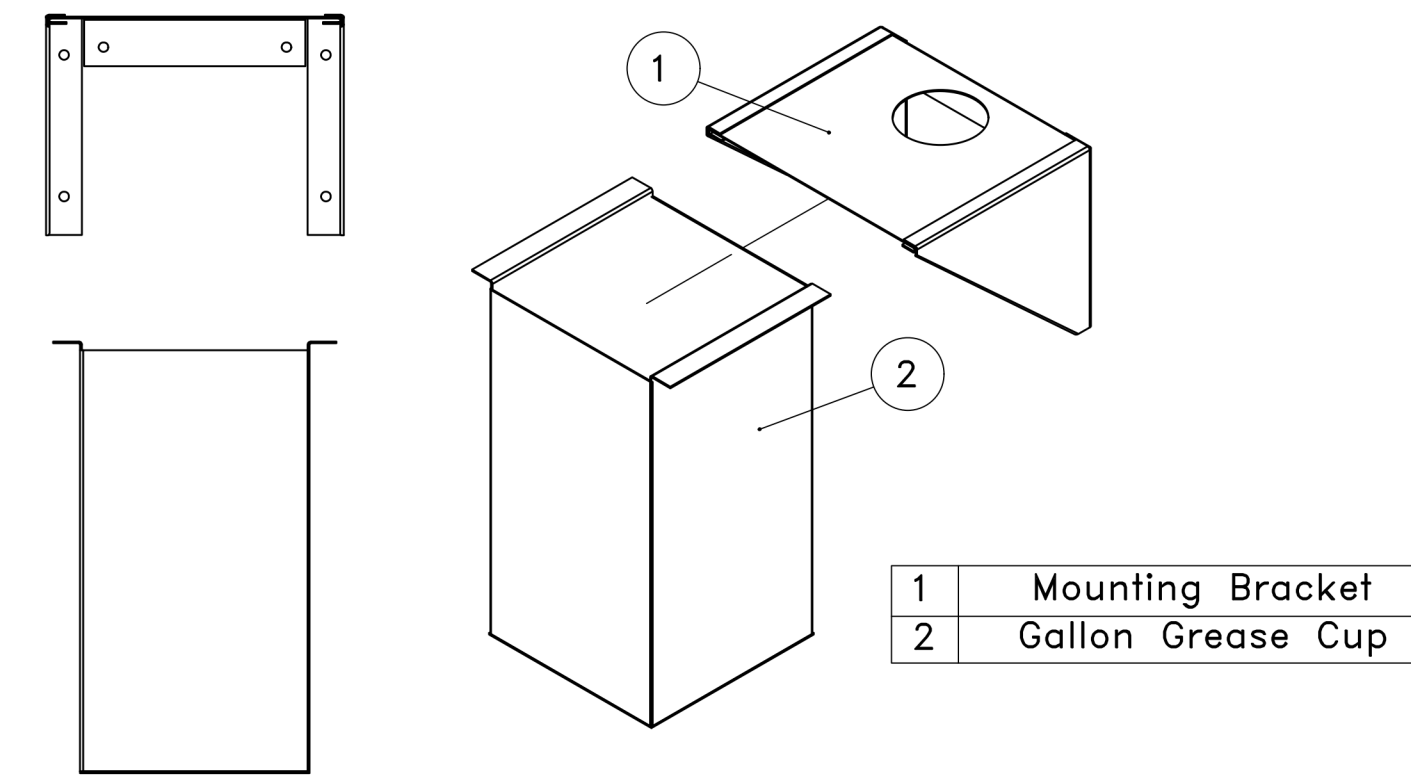

1 GALLON GREASE COLLECTION BOX AND WALL MOUNTING BRACKET SHIPPED LOOSE FOR FIELD INSTALLATION BY MECHANICAL CONTRACTOR.

REVISIONS	
DESCRIPTION	DATE

**CAPTIVE**  
Eastern PA Mechanical  
PO Box 2520, 1 Union Ave, Erie, PA 16504 PHONE: (814) 834-4126 EMAIL: reg108@captiveaire.com

Shake Shack-1515-Goodyear, AZ(Kitchen)  
GOODYEAR, AZ, 85395

DATE: 3/5/2024  
DWG.#: 6657868  
DRAWN BY: Joe.shilba  
SCALE: 3/4" = 1'-0"  
MASTER DRAWING

SHEET NO. 7

NOTE:  
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

**Bergmeyer**

CONSULTANTS:

SEAL SIGNATURE:

FOR REFERENCE ONLY

NO.	BY	DATE	PERMIT/BID SET	DESCRIPTION

**SHAKE SHACK**

SHAKE SHACK  
GOODYEAR, AZ

GOODYEAR CIVIC SQUARE  
PARCEL #501-2A-983  
GOODYEAR, AZ 85395  
SHACK #1515

PERMIT/BID SET

CAPTIVEAIRE DRAWINGS

DRAWN BY: Author  
CHECKED BY: Checker  
JOB NO: 2350004654

**M707**





