

FLOOR DRAIN SCHEDULE

PLAN MARK	MANUFACTURER	MODEL NUMBER	SERVICE	TOP/GRATE SIZE	WASTE SIZE	REMARKS
FD-1	SIoux CHIEF	842-PB	FLOOR DRAIN	5-1/2"Ø	2"	1,3
FS-1	SIoux CHIEF	861	FLOOR SINK	12"x12"	3"	2
TD-1	ZURN	ZB86-PS	TRENCH DRAIN	40"x6"	2"	


- REMARKS:**
1. PROVIDE WITH NICKEL BRONZE STRAINER.
 2. PROVIDE WITH STAINLESS STEEL SCREEN AND PVC HALF OPEN STRAINER
 3. PROVIDE WITH TRAP SEAL.

PIPING MATERIAL & INSULATION SCHEDULE

PIPING SYSTEM	SIZE	TYPE/SCHED	MATERIAL	ACCEPTABLE FITTINGS	FIELD TEST PRESSURE/TIME	ALLOWABLE IN PLENUMS	INSULATION TYPE	THICKNESS
DOMESTIC COLD WATER	1/2"-2-1/2"	L	COPPER	SOLDER, PRO-PRESS	130 PSI - 1/2HR	YES	FIBERGLASS W/ ASJ	1/2"
DOMESTIC HOT WATER & HW RETURN	1/2"-2-1/2"	L	COPPER	SOLDER, PRO-PRESS	130 PSI - 1/2HR	YES	FIBERGLASS W/ ASJ	1"
DOM. HOT & COLD BELOW GRADE	1/2"-1-1/4"	K	COPPER	CONTINUOUS TUBING, BRAZED	130 PSI - 1/2HR	YES	ELASTOMERIC	3/4" (HOT ONLY)
DOMESTIC COLD WATER	3"-6"	L	COPPER	BRAZED, PRO-PRESS	130 PSI - 1/2HR	YES	FIBERGLASS W/ ASJ	1/2"
DOMESTIC HOT WATER	3"-6"	L	COPPER	BRAZED, PRO-PRESS	130 PSI - 1/2HR	YES	FIBERGLASS W/ ASJ	1-1/2"
NATURAL GAS - ABOVE GRADE	2-1/2" & Up	SCH. 40	STEEL - SEAMED	WELDED	75 PSI - 1HR	YES	----	----
NATURAL GAS - ABOVE GRADE	1/2"-2"	SCH. 40	STEEL - SEAMLESS	THREADED IRON	75 PSI - 1HR	YES	----	----
NATURAL GAS BELOW GRADE	ALL	SDR-11	POLYETHYLENE	FUSION JOINTS	100 PSI - 1HR	NO	----	----
SOIL & WASTE ABOVE GRADE	1-1/2"-6"	NO HUB / SERVICE WT.	CAST IRON	NO HUB	10 FT - 1/2HR	YES	----	----
SOIL & WASTE ABOVE GRADE	2"-8"	SCH. 40	PVC	SOLVENT JOINED	10 FT - 1/2HR	NO	----	----
SOIL & WASTE BELOW GRADE	2"-8"	SCH. 40	PVC	SOLVENT JOINED	10 FT - 1/2HR	NO	----	----
CONDENSATE DRAIN ON ROOF	3/4"-2"	SCH. 40	PVC	SOLVENT JOINED	10 FT - 1/2HR	NO	----	----
CONDENSATE DRAIN INTERIOR	1/2"-2"	L	COPPER	SOLDER, PRO-PRESS	10 FT - 1/2HR	YES	FIBERGLASS W/ ASJ	1/2" (PLENUM ONLY)
FIRE SERVICE BELOW GRADE	4"-8"	AWWA C151	DUCTILE IRON	AWWA C111, MECH JOINTS	130 PSI - 1/2HR	YES	----	----
DOM. WATER SERVICE BELOW GRADE	4"-8"	AWWA C151	DUCTILE IRON	AWWA C111, MECH JOINTS	130 PSI - 1/2HR	YES	----	----
DOM. WATER SERVICE BELOW GRADE	1"-3"	K	COPPER	CONTINUOUS TUBING, BRAZED	130 PSI - 1/2HR	YES	----	----
DOM. WATER SERVICE BELOW GRADE	1"-3"	DR 9	HDPE	CONTINUOUS TUBING, FUSED	130 PSI - 1/2HR	NO	----	----

- NOTES:**
1. ALL PIPING AND MATERIALS IN PLENUMS MUST MEET ASTM E84 FLAME/SMOKE RATING OF 25/50.
 2. ALL INSULATION THICKNESSES SHALL MEET ASHRAE 90.1 - 2007 REQUIREMENTS AT A MINIMUM.
 3. REFER TO SPECIFICATIONS FOR MORE DETAILED INFORMATION.


FLOOR PLAN - WASTE & VENT
1/4" = 1'-0"

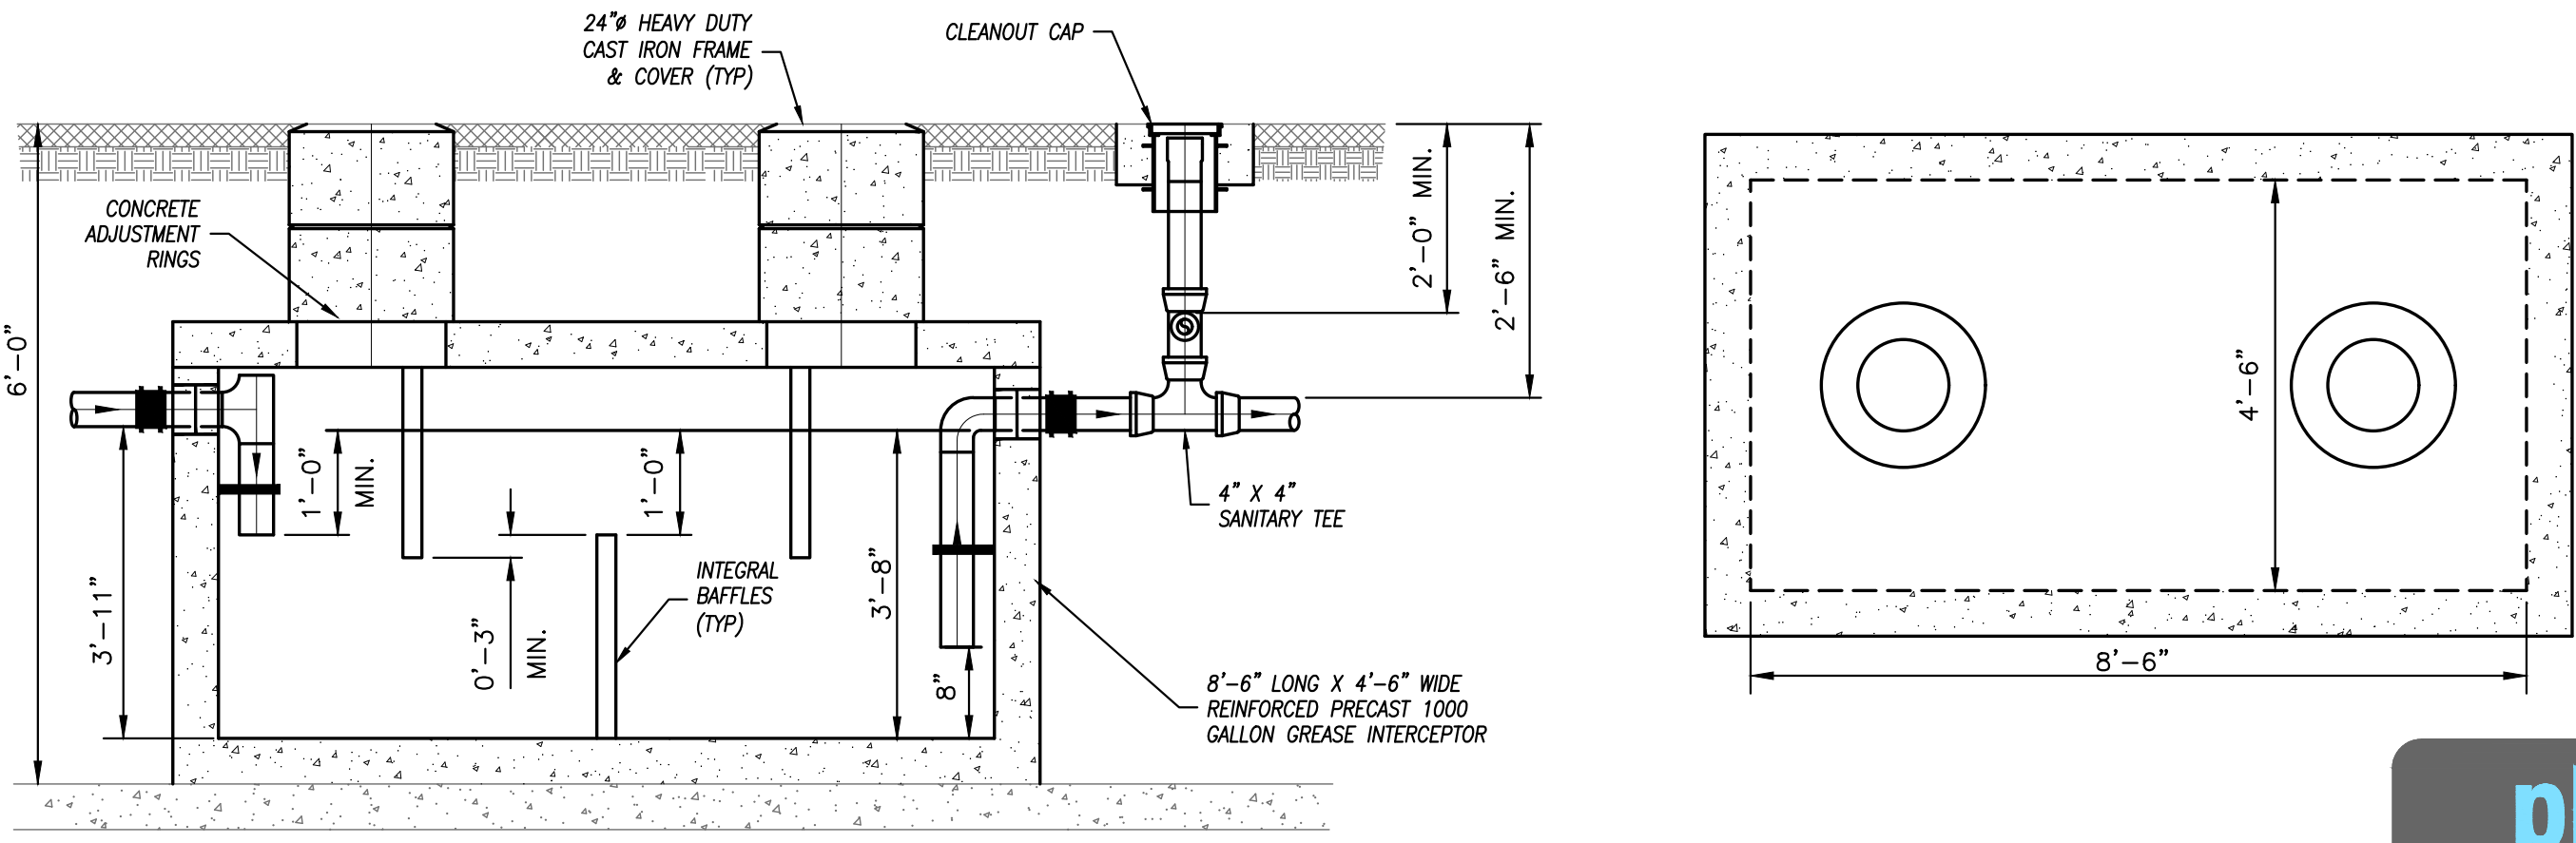

GREASE TRAP DETAIL
NO SCALE

GENERAL PLUMBING NOTES

1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL PLUMBING CODE, LOCAL AND STATE CODES, AND REQUIREMENTS OF THE AHI.
2. NO PIPING SHALL BE INSTALLED WHERE IT WILL BE SUBJECT TO FREEZING TEMPERATURES. PIPING IN EXTERIOR WALLS SHALL BE INSTALLED ON THE WARM SIDE OF BUILDING INSULATION, INSULATED AND THE CHASE SHALL BE VENTILATED WITH GRILLES ALLOWING INDOOR AMBIENT CONDITIONS TO CIRCULATE THROUGH THE CHASE.
3. PROVIDE CLEANOUTS IN THE FOLLOWING LOCATIONS:
 - 3.1. IN ALL HORIZONTAL DRAINS (WITHIN THE BUILDING) NOT MORE THAN 100 FEET APART.
 - 3.2. IN BUILDING SEWERS LOCATED NO MORE THAN 100 FEET APART MEASURED FROM THE UPSTREAM ENTRANCE OF THE CLEANOUT.
 - 3.3. EACH CHANGE OF DIRECTION OF THE BUILDING DRAIN OR HORIZONTAL WASTE OR SOIL LINES GREATER THAN 45 DEGREES WHERE MORE THAN ONE CHANGE OF DIRECTION OCCURS IN A RUN OF PIPING, ONLY ONE CLEANOUT SHALL BE REQUIRED FOR EACH 40 FEET OF DEVELOPED LENGTH OF THE DRAINAGE PIPING.
 - 3.4. AT THE BASE OF EACH WASTE OR SOIL STACK.
 - 3.5. NEAR THE JUNCTION OF THE BUILDING DRAIN AND BUILDING SEWER.

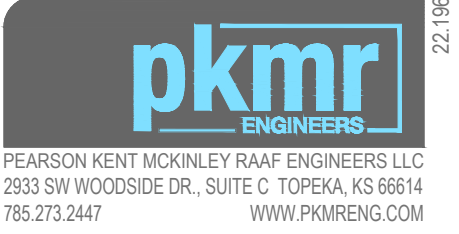

PEARSON KENT MCKINLEY RAAF ENGINEERS LLC
2933 SW WOODSIDE DR., SUITE C TOPEKA, KS 66614
785.273.2447 WWW.PKMRENG.COM

Plumbing Waste & Vent Plan

Freddy's Frozen Custard & Steakhouses
Lot 6 @ 502 E Expressway 83
Westlaco, Texas



303 north main street, mcpherson kansas 67202.41.4353


Contract Date	
Rev No. 1	
Rev No. 2	
Rev No. 3	
Rev No. 4	
Rev No. 5	
Rev No. 6	
Project Number:	21.11
DWG File	
Designed By:	plan4
Drawn By:	NSG
Approved By:	SWM
Date:	5/25/22



PEARSON KENT MCKINLEY RAAF ENGINEERS LLC #F-7875

SHEET NUMBER
M100

11 x 17 = 1/2 scale

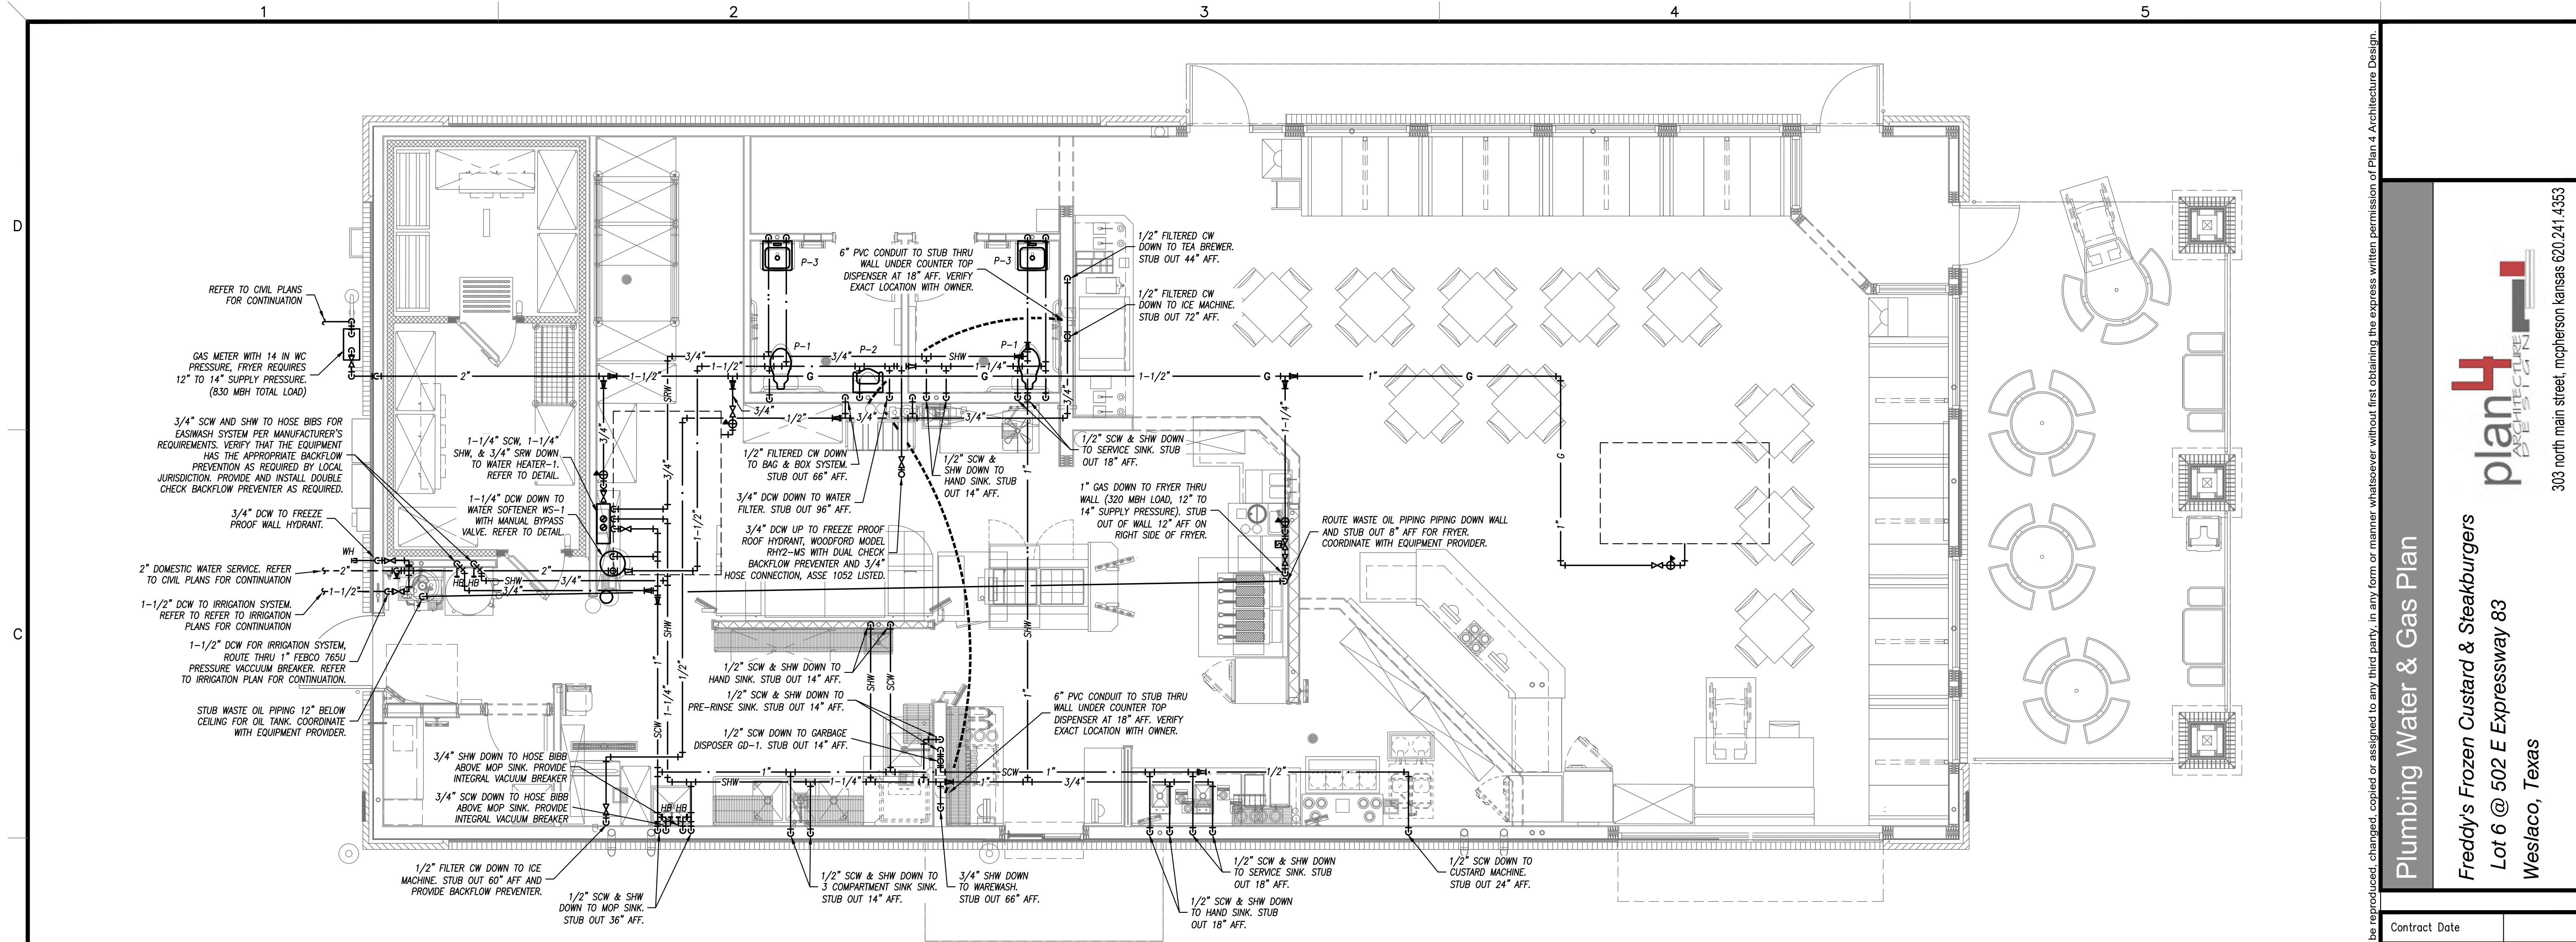

FLOOR PLAN - DOMESTIC WATER & GAS
1/4" = 1'-0"

PLUMBING FIXTURE SCHEDULE								
PLAN MARK	FIXTURE MODEL	FIXTURE DESCRIPTION	FITTINGS MODEL	FITTINGS DESCRIPTION	PIPE SIZES			
					WASTE	VENT	DCW	DHW
P-1	AMERICAN STANDARD 2305.100 CHURCH 9500C	ADA COMPLIANT WATER CLOSET: FLUSH VALVE, WHITE ELONGATED BOWL, FLOOR MOUNTED, 1.6 GALLON SIPHON JET FLUSHING ACTION SEAT: WHITE, SOLID PLASTIC, OPEN FRONT, ELONGATED	SLOAN ROYAL 111 SFSM-1.6	BATTERY POWERED, SENSOR ACTIVATED, FLUSH METER CHROME PLATED WITH SENSOR UNIT AND BATTERIES WITH VACUUM BREAKER FLUSH CONNECTION, AND SPUD COUPLING FOR 1 1/2" TOP SPUD. PROVIDE WITH WALL AND SPUD FLANGES. 1.6 GALLON FLUSH WITH OVERRIDE COVER.	4"	2"	1-1/4"	--
P-2	AMERICAN STANDARD 6042.005	ADA COMPLIANT URINAL: WHITE WALL HUNG URINAL 0.5 GALLON SIPHON JET FLUSHING ACTION. MOUNT FIXTURE RIM AT 17" ABOVE FLOOR WITH FLOOR MOUNTED, HEAVY DUTY TUBULAR STEEL SUPPORT CARRIER	SLOAN ROYAL 186 SFSM-0.5	BATTERY POWERED, SENSOR ACTIVATED, FLUSH METER CHROME PLATED WITH SENSOR UNIT AND BATTERIES WITH VACUUM BREAKER FLUSH CONNECTION, AND SPUD COUPLING FOR 3/4" TOP SPUD. PROVIDE WITH WALL AND SPUD FLANGES. 0.5 GALLON FLUSH.	2"	2"	1"	--
P-3	AMERICAN STANDARD 0355.012	ADA COMPLIANT LAVATORY: WHITE WALL HUNG LAVATORY 20"x18" WITH 4" BACK FAUCET HOLES ON 4" CENTERS, WITH CONCEALED ARM CARRIER. PROVIDE HANDLE STOP VALVES AND FLEXIBLE METAL WATER RISERS. MOUNT TOP OF RIM AT 34" ABOVE FLOOR	SLOAN SF-2450	SENSOR OPERATED ELECTRONICS FAUCET: CHROME FINISH 1/2" CONNECTIONS, VANDAL RESISTANT 0.5 GPM., NO POP UP HOLE CHROME PLATED BRASS GRID DRAIN, TAILPIECE, AND P-TRAP INSULATE THE TAILPIECE, P-TRAP, AND WATER RISERS PROVIDE WITH THERMOSTATIC MIXING VALVE AND BATTERIES	2"	2"	1/2"	1/2"

WATER HEATER SCHEDULE						
PLAN MARK	MANUFACTURER	MODEL NUMBER	GALLONS	CAPACITY	ELECTRICAL	NOTES
WH-1	NAVEN	NPE-240A	TANKLESS	199,000 BTUH MAX	120V, 200W	1,2

NOTES LEGEND
1 - PROVIDE INSTALLATION PER MANUFACTURER'S RECOMMENDATIONS, INCLUDING INTAKE AND EXHAUST VENTING.
2 - PROVIDE WITH INTERNAL RETICULATION PUMP.

WATER SOFTENER SCHEDULE				
PLAN MARK	MANUFACTURER	MODEL NUMBER	GRAINS	DIMENSIONS
WS-1	3M PURIFICATION	CFSM1254	56,800	37" X 63" X 15"D

NOTES LEGEND
1. PROVIDE (2) BAGS OF SALT, AND START-UP WHEN REQUIRED

GARBAGE DISPOSAL				
PLAN MARK	MANUFACTURER	MODEL NUMBER	ELECTRICAL CHARACTERISTICS	MAX. RPM
GD-1	WASTE KING	1000-1	6A, 120V, 1Ø	1725

Architect hereby expressly reserves its common law copyright and other property rights in these plans. These plans and drawings are not to be reproduced, changed, copied or assigned to any third party, in any form or manner whatsoever without first obtaining the express written permission of Plan 4 Architecture Design.

plan4 ARCHITECTURE
303 north main street, mcperson kansas 620.241.4353

Plumbing Water & Gas Plan
Freddy's Frozen Custard & Steakhburgers
Lot 6 @ 502 E Expressway 83
Weslaco, Texas


Contract Date	
Rev No. 1	
Rev No. 2	
Rev No. 3	
Rev No. 4	
Rev No. 5	
Rev No. 6	
Project Number:	21.11
DWG File	
Designed By:	plan4
Drawn By:	NSG
Approved By:	SWM
Date:	5/25/22

STATE OF TEXAS
SCOTT W. MCKINLEY
93375
LICENSED PROFESSIONAL ENGINEER
PEARSON KENT MCKINLEY RAAF
ENGINEERS LLC
#F-7875


pkmr ENGINEERS
PEARSON KENT MCKINLEY RAAF ENGINEERS LLC
2933 SW WOODSIDE DR., SUITE C TOPEKA, KS 66614
785.273.2447 WWW.PKMRENG.COM

11 x 17 = 1/2 scale


SHEET NUMBER
M101

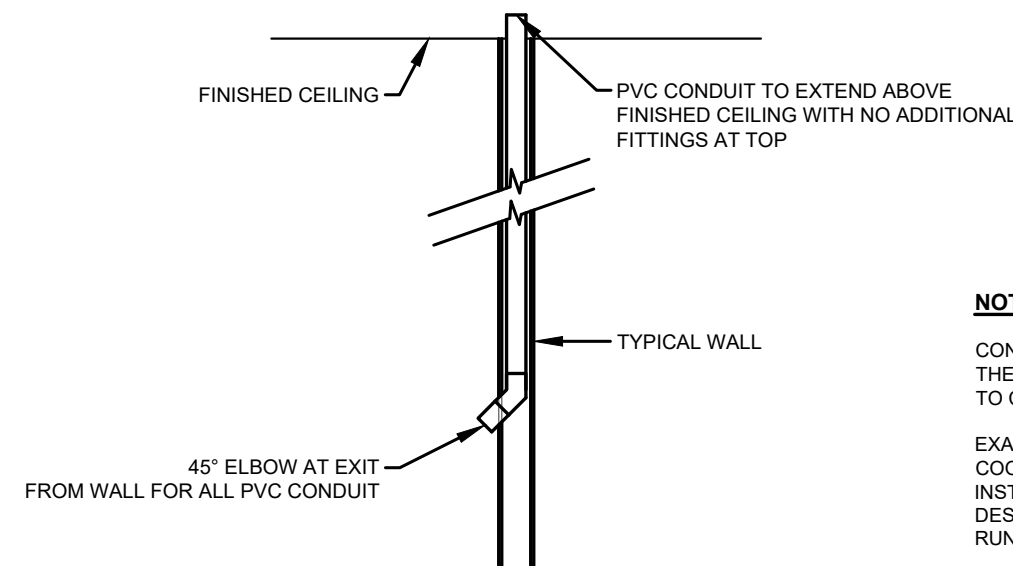


SODA & REFRIG. CONDUIT IN WALL DETAIL
NO SCALE

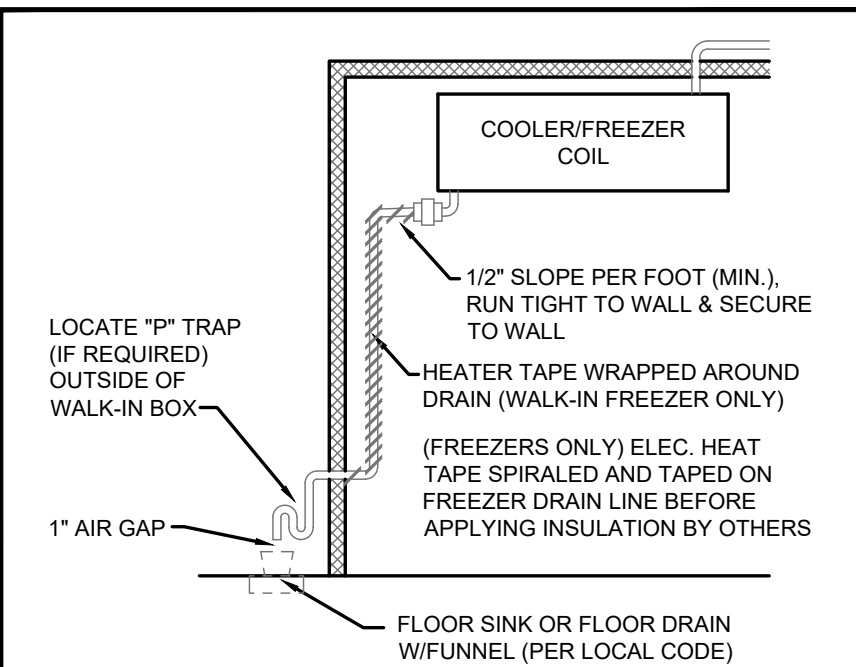


WALK-IN DRAIN LINE DETAIL
NOT TO SCALE

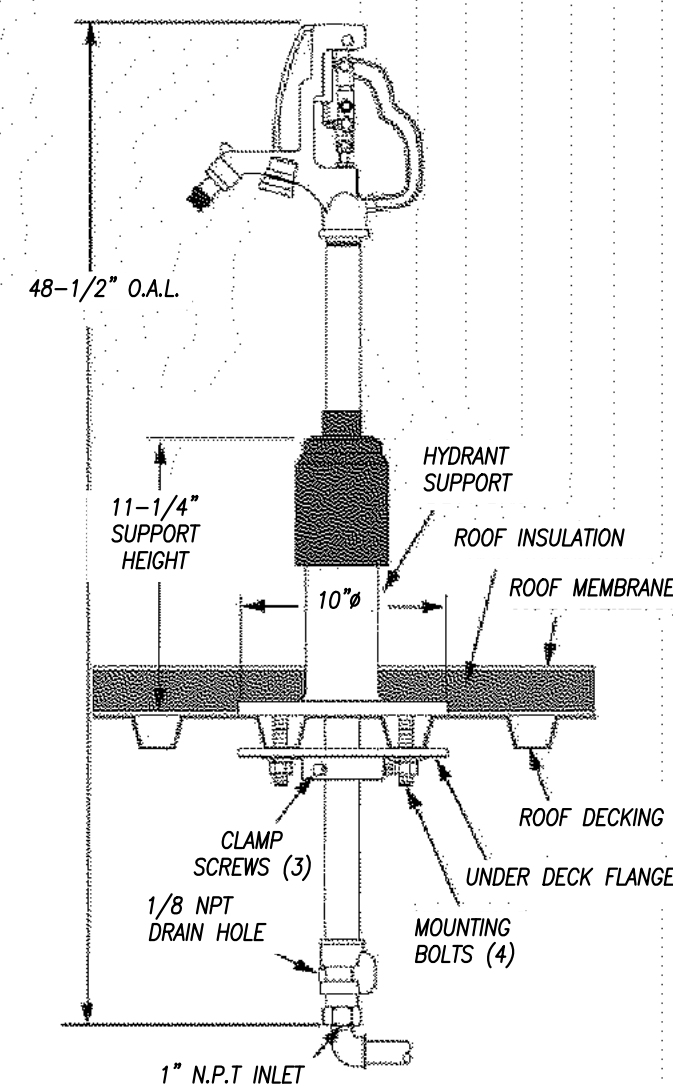


ROOF HYDRANT DETAIL
SCALE: NONE

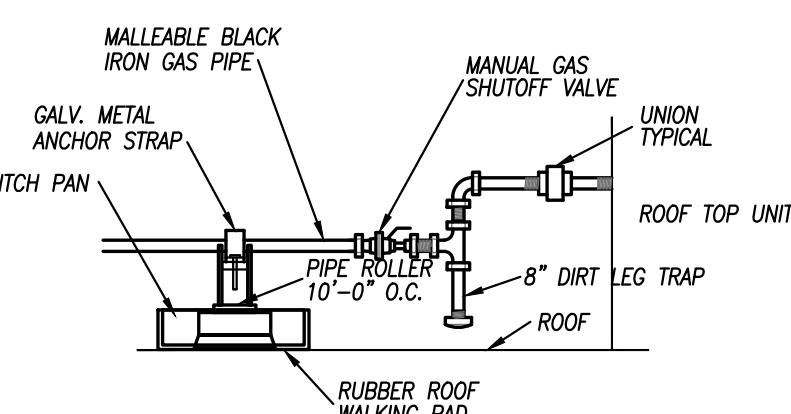


ROOF TOP UNIT GAS CONNECTION DETAIL
NO SCALE

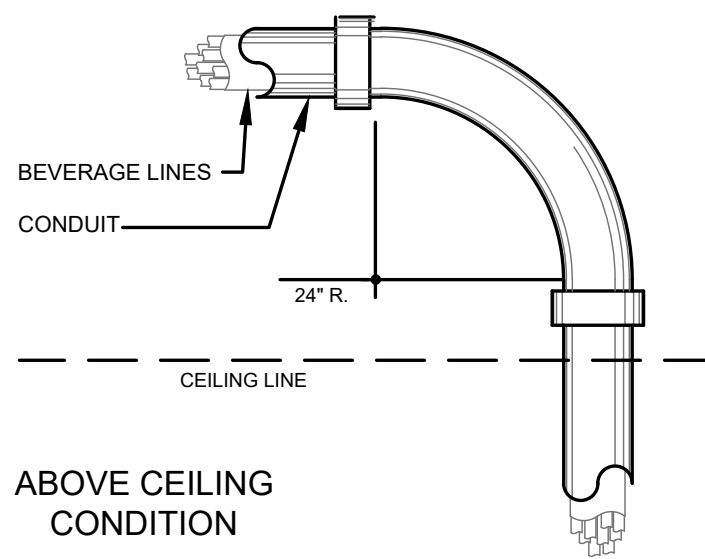


BEVERAGE SYSTEM CONDUIT DETAIL
NO SCALE

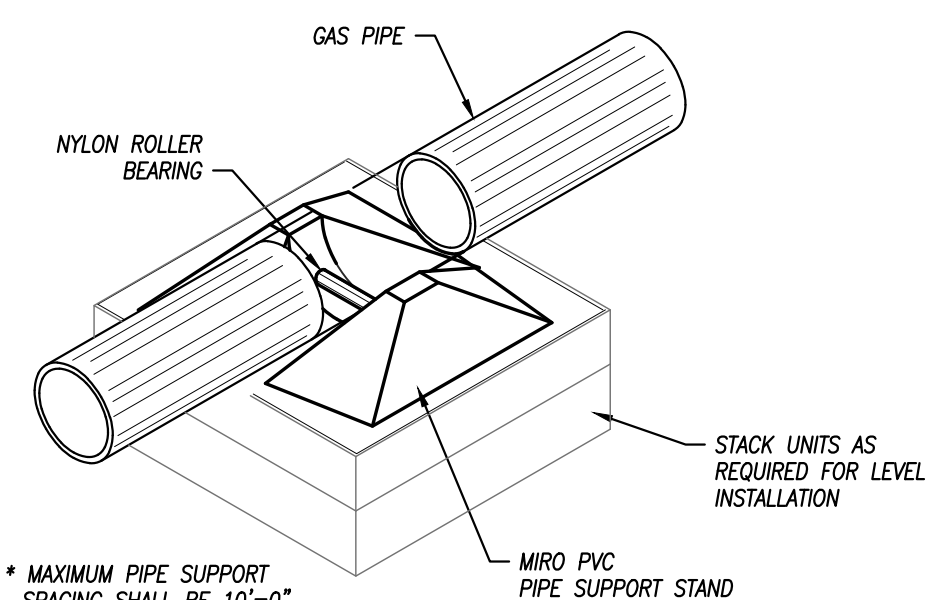


ROOF SUPPORT FOR GAS LINE
NOT TO SCALE

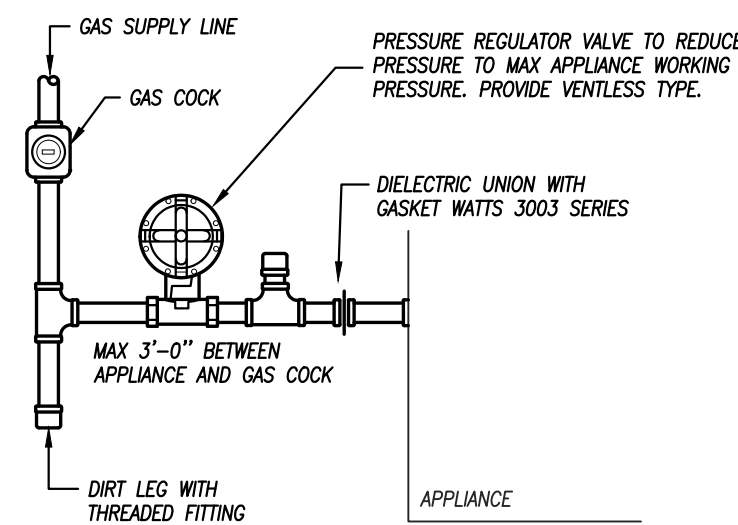


TYPICAL GAS CONNECTION
NOT TO SCALE

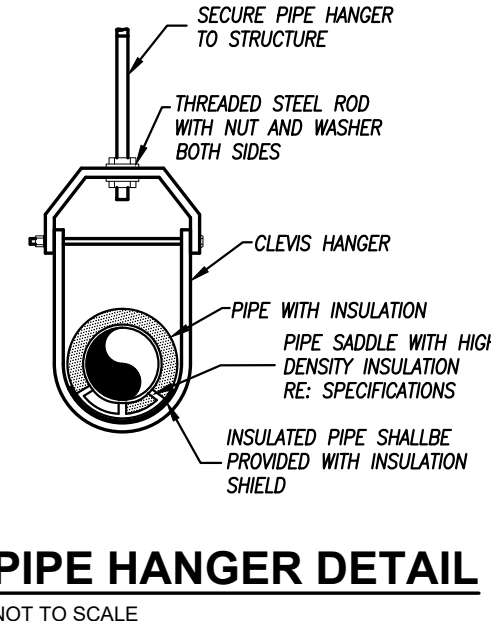

PIPE HANGER DETAIL
NOT TO SCALE

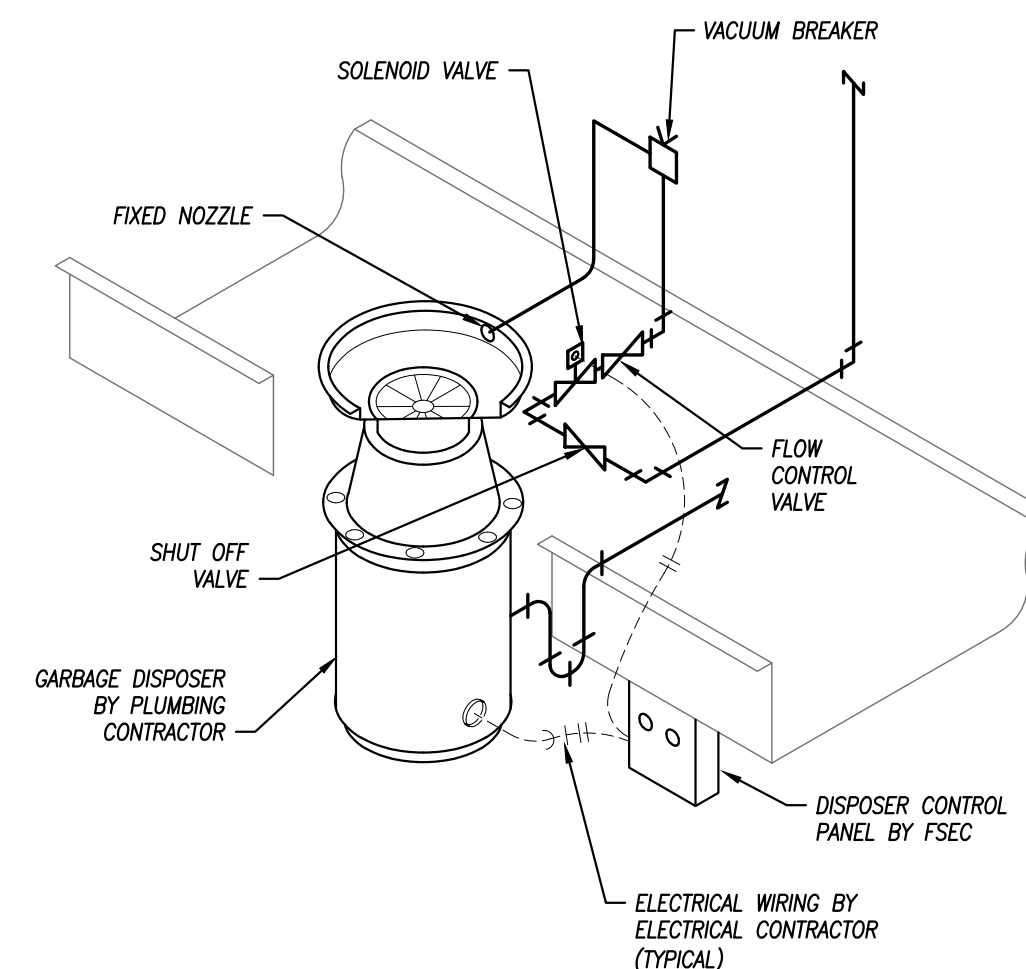


GARBAGE DISPOSER CONNECTION DETAIL
NOT TO SCALE

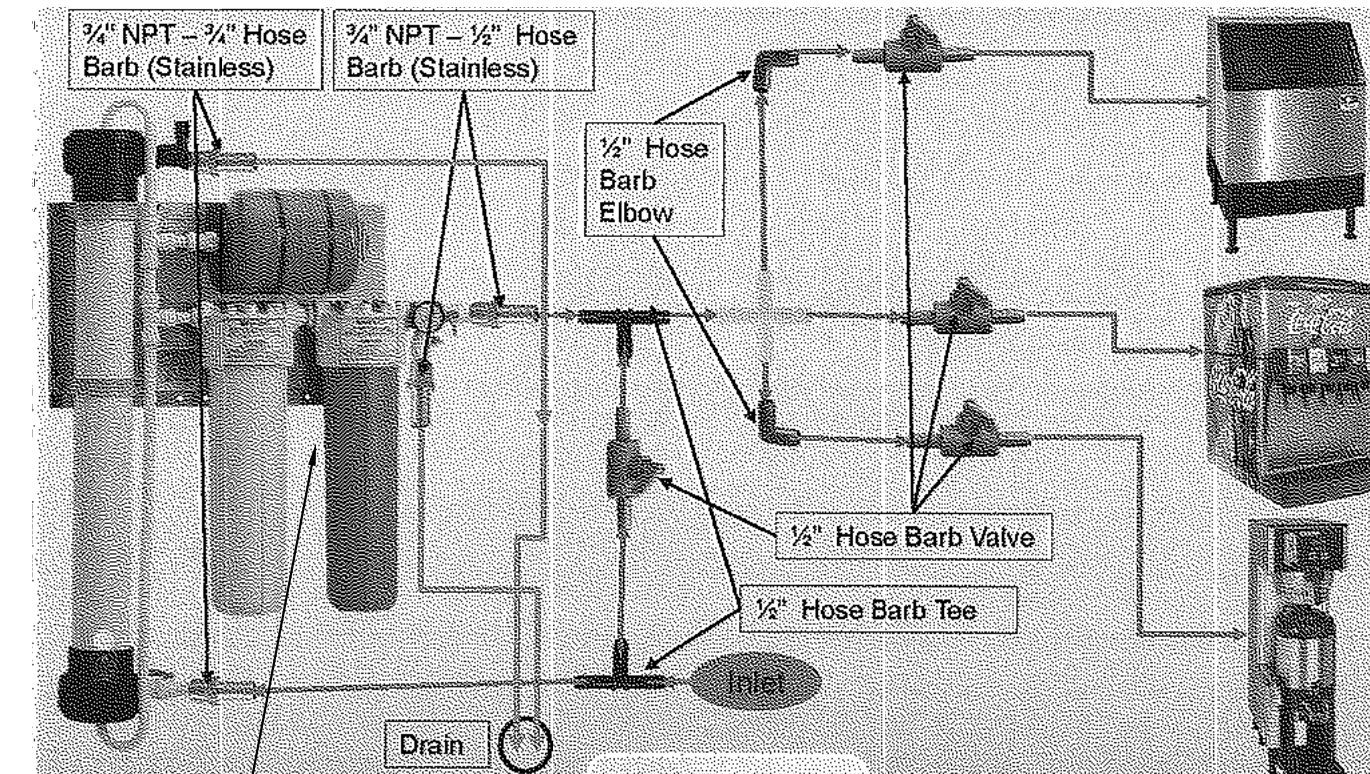


WATER FILTER DETAIL
NO SCALE


NOTES:
1. MOUNT VACUUM BREAKER ABOVE FIXTURE BACKSPLASH, MINIMUM OF 6" ABOVE FLOOR RIM. DRILL BACKSPLASH FOR PIPES. PROVIDE SILICONE SEALANT AROUND PIPE THRU BACKSPLASH. USE CHROME-PLATED PIPING WHEN EXPOSED ABOVE BACKSPLASH.
2. ARRANGEMENT SHOWN IS SCHEMATIC. ADJUST TO SUIT FIELD CONDITIONS. WIRING IS BY ELECTRICAL CONTRACTOR.

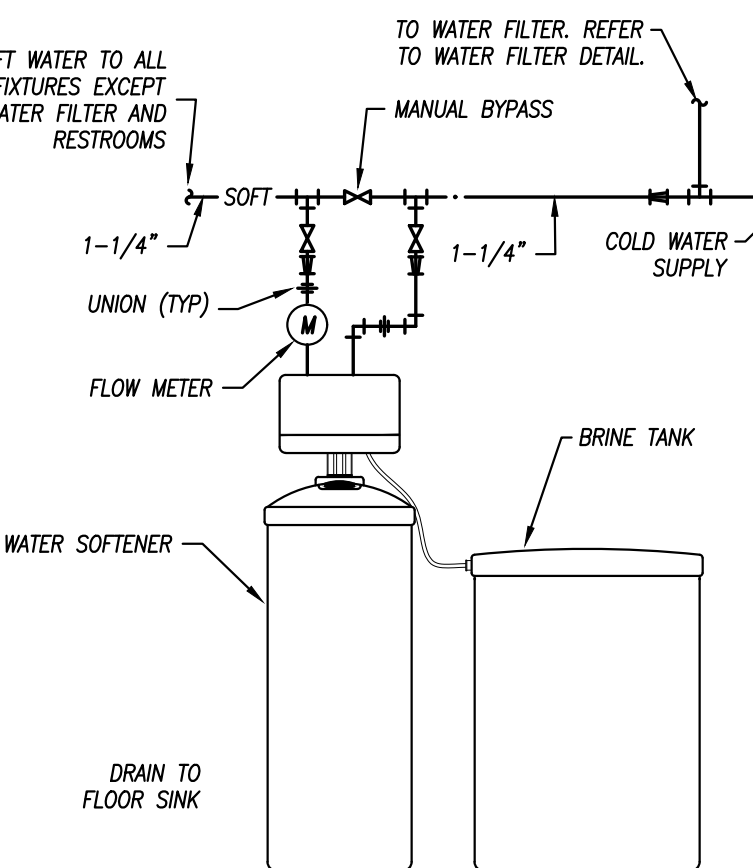


WATER SOFTENER DETAIL
NOT TO SCALE

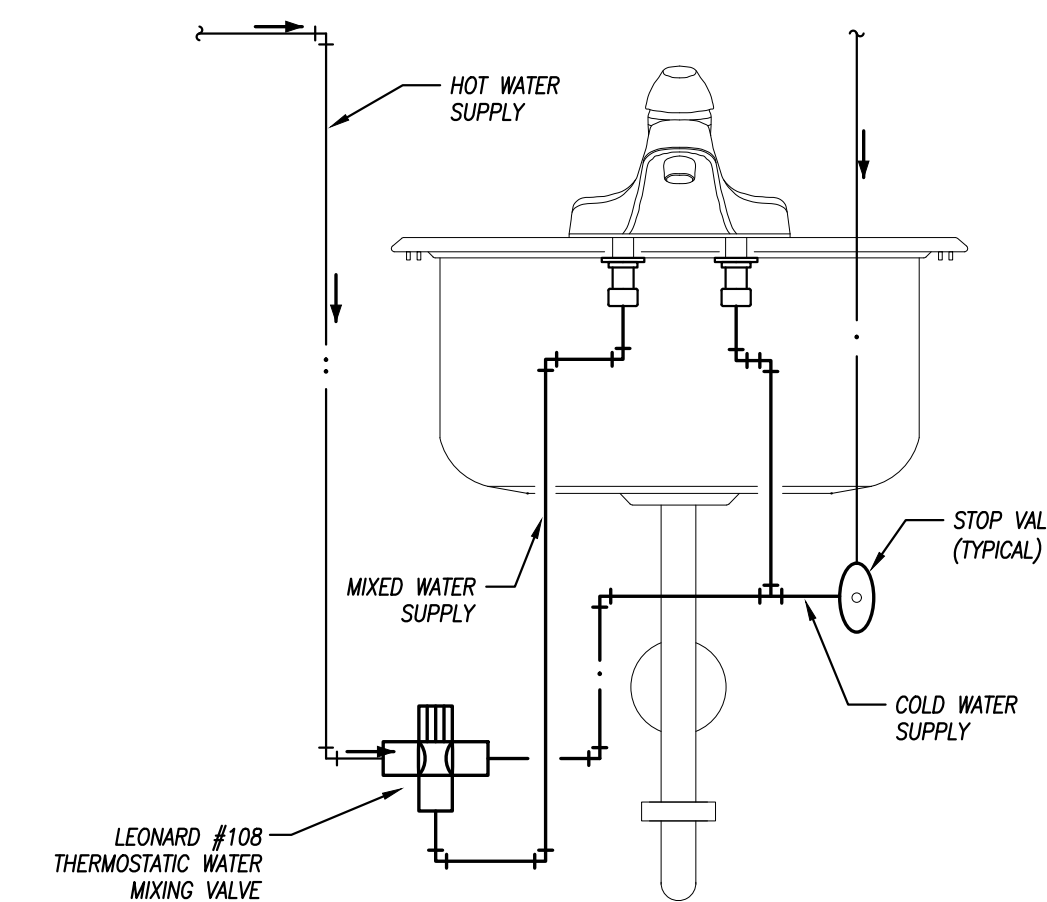

MIXING VALVE SCHEMATIC
NOT TO SCALE

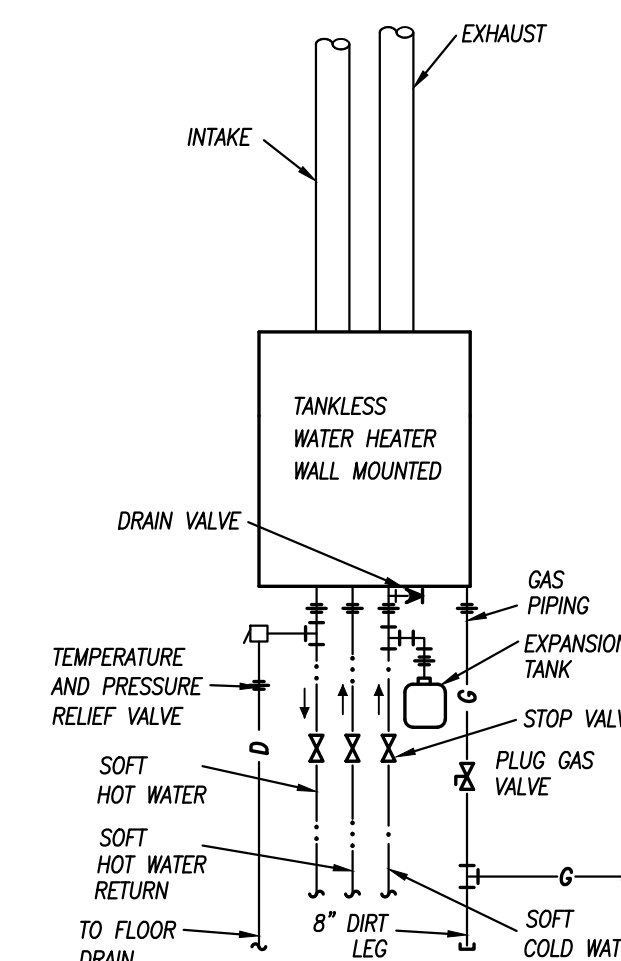

TANKLESS GAS WATER HEATER DETAIL
NO SCALE

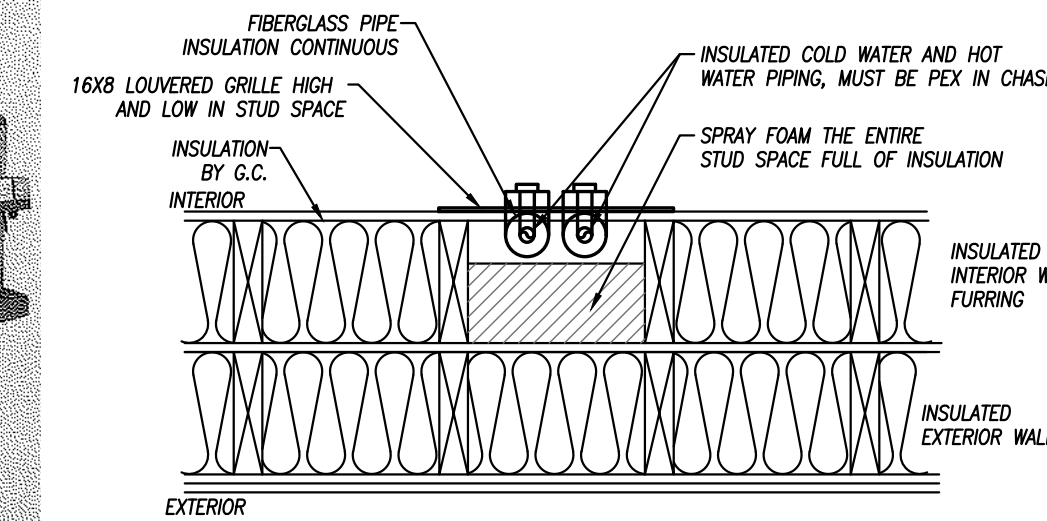

EXTERIOR WALL WATER PIPING DETAIL
NO SCALE

NOTES:
1. WHERE POSSIBLE RUN PIPING IN INTERIOR WALLS OR UP THROUGH FLOOR
2. IF NOT POSSIBLE, THIS DETAIL MUST BE FOLLOWED, OR PIPING WILL FREEZE

Architect hereby expressly reserves its common law copyright and other property rights in these plans. These plans and drawings are not to be reproduced, changed, copied or assigned to any third party, in any form or manner whatsoever without first obtaining the express written permission of Plan 4 Architecture Design.

plan 4 ARCHITECTURE
 303 north main street, mcpherson kansas 67241-1435
Freddy's Frozen Custard & Steakhangers
 Lot 6 @ 502 E Expressway 83
 Westlaco, Texas


Contract Date	
Rev No. 1	
Rev No. 2	
Rev No. 3	
Rev No. 4	
Rev No. 5	
Rev No. 6	
Project Number:	21.11
DWG File	
Designed By:	plan4
Drawn By:	NSG
Approved By:	SWM
Date:	5/25/22

STATE OF TEXAS
 SCOTT W. MCKINLEY
 93375
 LICENSED PROFESSIONAL ENGINEER
 05/25/22
 PEARSON KENT MCKINLEY RAAF
 ENGINEERS LLC
 #F-7875

pkmr
 ENGINEERS
 PEARSON KENT MCKINLEY RAAF ENGINEERS LLC
 2933 SW WOODSIDE DR., SUITE C TOPEKA, KS 66614
 785.273.2447 WWW.PKMRENG.COM

11 x 17 = 1/2 scale

SHEET NUMBER
M102

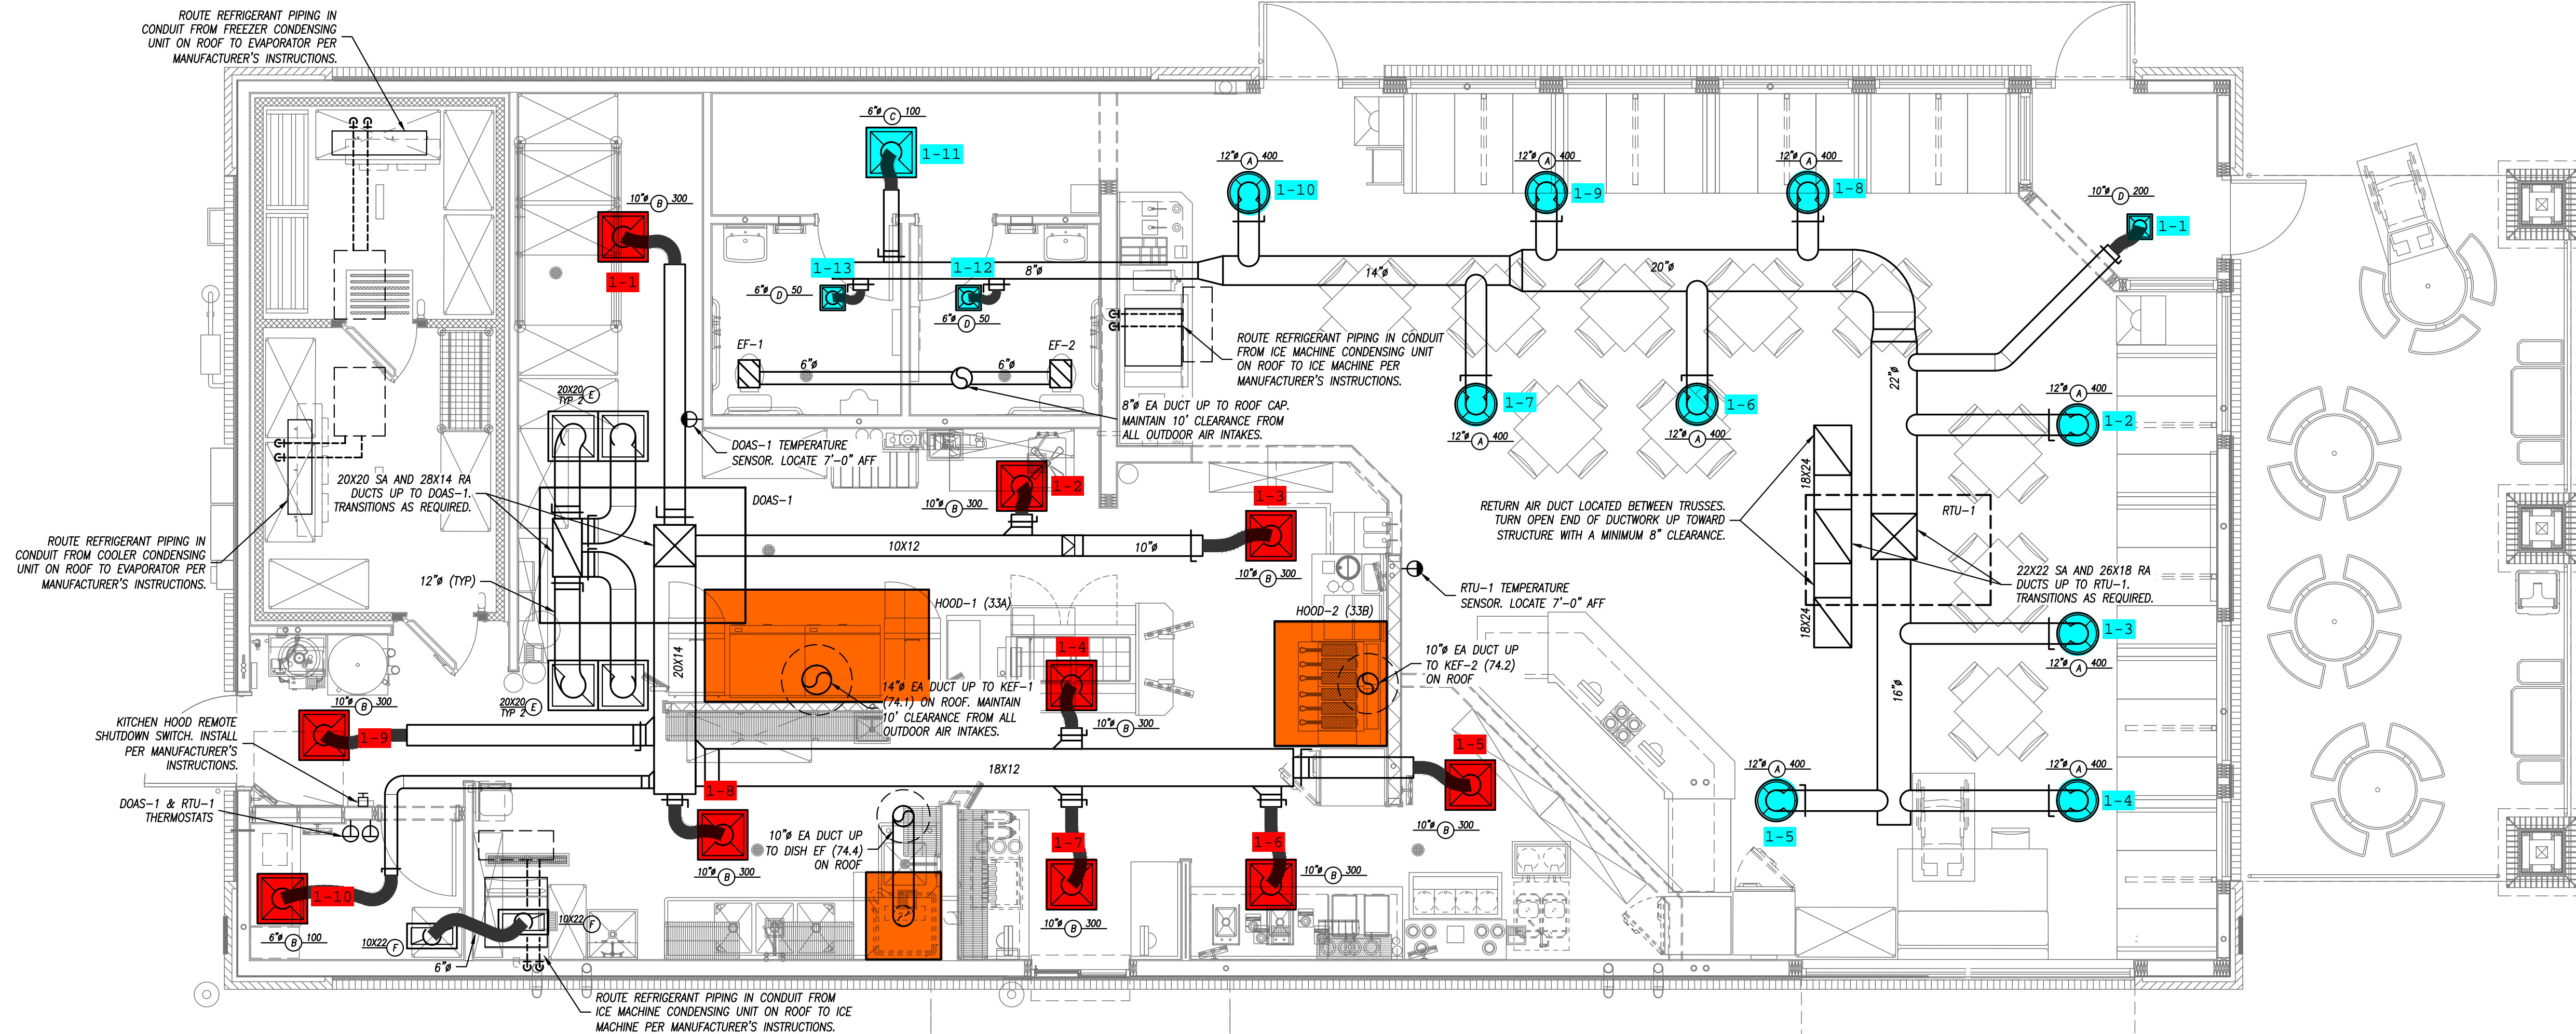

FLOOR PLAN - HVAC
1/4" = 1'-0"

HVAC NOTES:

- DUCT RUNOUTS TO DIFFUSERS SHALL BE THE SAME SIZE AS THE DIFFUSER NECK.
- RTU-1 & DOAS-1 FANS TO BE RUNNING WHILE EXHAUST HOODS ARE IN OPERATION.
- MECHANICAL CONTRACTOR SHALL INSTALL THE CAPTIVE AIR EQUIPMENT THAT THE OWNER IS PURCHASING FROM TRIMARK. CONTACT SAM SIEBER AT TRIMARK, 913-998-7583 TO COORDINATE PRICING, DELIVERY, SCHEDULE, AND MISCELLANEOUS PIECES AND PARTS REQUIRED FOR INSTALL.

GRILLE, REGISTER & DIFFUSER SCHEDULE

PLAN MARK	MANUFACTURER	MODEL NUMBER	SERVICE	MOUNT TYPE	VOLUME DAMPER	MATERIAL	MATERIAL COLOR	NOTES
A	TITUS	TMR	SUPPLY	FLANGE	YES	STEEL	WHITE	
B	TITUS	PAS/3	SUPPLY	GRID	NO	STEEL	WHITE	2
C	TITUS	TMS/3	SUPPLY	GRID	NO	STEEL	WHITE	2
D	TITUS	TMS/3	SUPPLY	FLANGE	YES	STEEL	WHITE	3
E	AMER. LOUVER CO.	STRATUS	RETURN	FLANGE	NO	STEEL	WHITE	1
F	TITUS	PAR/3	RETURN	FLANGE	NO	STEEL	WHITE	

NOTES LEGEND

- PLASTIC FILTER RETURN. FILTER TO BE AMERICAN AIR FILTER (AFF) FRONTLINE GREEN 1", WITH AFF AMERIFRAME SIZE 20X20X1
- PAN TO FIT A 2'X2' GRID.
- 12"X12" FACE

ROOF TOP UNIT SCHEDULE - THREE PHASE ELECTRIC WITH GAS HEAT

PLAN MARK	MANUFACTURER	MODEL NUMBER	SIZE	REFRIGERANT	MINIMUM EFFICIENCY	AIRFLOW	COMPRESSORS	COOLING CAPACITY	CFM	OA CFM	EXTERNAL STATIC	(OUTPUT) HEATING CAPACITY	ELECTRICAL	WEIGHT	FILTER	NOTES
RTU-1	TRANE	YSC102H3ELA	10 TON	R-410A	11.0 EER	DOWN	(2) SCROLLS	112,600 BTUH	4,000	800	0.8"	105 MBH	208 V, 3 PH, 60 AMP	1060 LBS	MERV 4	1,2,3,4

NOTES LEGEND

- PROVIDE ROOF CURB, DISCONNECT SWITCH, HAIL GUARDS, AND ECONOMIZER
- PROVIDE WALL MOUNTED 7-DAY PROGRAMMABLE THERMOSTAT
- PROVIDE INTERNAL VIBRATION ISOLATION FOR THE RTU FAN AND COMPRESSORS
- RTU IS BEING PRE-PURCHASED BY OWNER. RTU WILL BE EITHER TRANE, YORK, CARRIER, OR LENNOX MODELS. MODIFY DUCTWORK AS REQUIRED FOR UNIT SUPPLY AND RETURN LAYOUT.

EXHAUST FAN SCHEDULE

PLAN MARK	MANUFACTURER	MODEL NUMBER	MOUNTING	SERVICE	CFM	STATIC PRESSURE	ELECTRICAL	DRIVE	DISCONNECT	DAMPER	NOTES
EF-1	COOK	GC-146	CEILING	EXHAUST	75	1/4"	31W, 120V, 1 PH.	DIRECT	YES	BACKDRAFT	1
EF-2	COOK	GC-146	CEILING	EXHAUST	75	1/4"	31W, 120V, 1 PH.	DIRECT	YES	BACKDRAFT	1

NOTES LEGEND

- PROVIDE CEILING GRILLE, VARI-SPEED CONTROLLER, AND ROOF JACK FOR EF-1 & EF-2

HVAC Plans

Freddy's Frozen Custard & Steakburgers
Lot 6 @ 502 E Expressway 83
Westlaco, Texas



303 north main street, mcperson kansas 620.241.4353

Contract Date	
Rev No. 1	
Rev No. 2	
Rev No. 3	
Rev No. 4	
Rev No. 5	
Rev No. 6	
Project Number:	21.11
DWG File	
Designed By:	plan4
Drawn By:	NSG
Approved By:	SWM
Date:	5/25/22



PEARSON KENT MCKINLEY RAAF
ENGINEERS LLC
#F-7875



PEARSON KENT MCKINLEY RAAF ENGINEERS LLC
2933 SW WOODSIDE DR., SUITE C TOPEKA, KS 66614
785.273.2447 WWW.PKMRENG.COM

11 x 17 = 1/2 scale

SHEET NUMBER

M200

Architect hereby expressly reserves its common law copyright and other property rights in these plans. These plans and drawings are not to be reproduced, changed, copied or assigned to any third party, in any form or manner whatsoever without first obtaining the express written permission of Plan 4 Architecture Design.

NATIONAL ACCOUNT INFORMATION

FREDDY'S FROZEN CUSTARD HAS NATIONAL ACCOUNT AGREEMENTS FOR ROOF TOP UNITS WITH LENNOX, YORK, AND TRANE. NO ALTERNATE MANUFACTURERS ARE ALLOWED.

FOR LENNOX EQUIPMENT CONTACT:
DAVE EBNER, LENNOX INDUSTRIES NATIONAL ACCOUNT MANAGER, (651) 223-1582, Dave.Ebner@Lennoxind.com

FOR YORK EQUIPMENT CONTACT:
DAVID WALMSLEY, NATIONAL ACCOUNTS - YORK, (774) 291-0884, david.walmsley@yji.com

FOR TRANE EQUIPMENT EQUAL TO UNITS SPECIFIED CONTACT:
TONY FISCHELS, TRANE ACCOUNT MANAGER - NATIONAL ACCOUNTS, (303) 209-3239 (OFFICE), (303) 653-6728 (MOBILE)
TONY.FISCHELS@TRANE.COM

OUTDOOR AIR CALCULATIONS

UNIT	AREA (SQFT)	OCCUPANCY CLASSIFICATION	OCCUPANT DENSITY #/1000 SQFT	PEOPLE OUTDOOR AIRFLOW RATE IN BREATHING ZONE, (Rp) CFM/PERSON	AREA OUTDOOR AIRFLOW RATE IN BREATHING ZONE, (Ra) CFM/SQFT	EXHAUST AIRFLOW RATE CFM/SQFT	BREATHING ZONE OUTDOOR AIRFLOW (Vbz)	ZONE AIR DISTRIBUTION EFFECTIVENESS (EZ)	ZONE OUTDOOR AIRFLOW (CFM)
RTU-1	870	DINING ROOMS	70	7.5	0.18		613	0.8	767
	160	CORRIDORS	0	0	0.06		10	0.8	12
								TOTAL	779

AIR BALANCE SCHEDULE

SUPPLY AIR UNIT	OUTSIDE AIRFLOW (CFM)	RETURN AIRFLOW (CFM)	SUPPLY AIRFLOW (CFM)	OA/OA	%	EXHAUST AIR UNIT	EXHAUST AIRFLOW (CFM)
RTU-1	800	3200	4000	20.0%		KEF-1	1600
						KEF-2	775
DOAS-1	2800	0	2800	100.0%		DISH EF	525
						EF-1, EF-2	150
TOTAL	3600	3200	6800	52.9%		TOTAL	3050

RESULTING BUILDING PRESSURIZATION: 650CFM


CONTRACTOR TO COORDINATE AIR BALANCING WITH TAB CONTRACTOR. THE BUILDING HVAC SYSTEM SHALL BE BALANCED BY NATIONAL TAB HIRED BY THE OWNER. CONTACT JASON NEISES AT NATIONAL TAB 885-682-8822 x 703

DUCTWORK INSULATION SCHEDULE

PURPOSE	DUTY	DUCT		INSULATION			NOTES
		LOCATION	STYLE	MATERIAL	APPLICATION	THICKNESS	
SUPPLY	LOW PRESSURE/VELOCITY	CONCEALED	RECTANGULAR	FIBERGLASS	LINED	1/2"	---
		CONCEALED	ROUND	MINERAL FIBER	WRAPPED	1-1/2"	---
		EXPOSED	RECTANGULAR	FIBERGLASS	LINED	1/2"	---
	ALL	EXPOSED	ROUND	FIBERGLASS	LINED	1/2"	---
		UNCONDITIONED ATTICS	ALL	MINERAL FIBER	WRAPPED	1-1/2"	1
		EXTERIOR	ALL	FLEXIBLE ELASTOMERIC	WRAPPED	2"	---
RETURN	LOW PRESSURE/VELOCITY	CONCEALED	RECTANGULAR	FIBERGLASS	LINED	1/2"	---
		CONCEALED	ROUND	MINERAL FIBER	WRAPPED	1-1/2"	---
		EXPOSED	RECTANGULAR	FIBERGLASS	LINED	1/2"	---
	ALL	EXPOSED	ROUND	FIBERGLASS	LINED	1/2"	---
		RETURN/TRANSFER BOOTHS	RECTANGULAR	FIBERGLASS	LINED	1/2"	---
		UNCONDITIONED ATTICS	ALL	MINERAL FIBER	WRAPPED	1-1/2"	1
EXHAUST	LOW PRESSURE/VELOCITY	EXTERIOR	ALL	FLEXIBLE ELASTOMERIC	WRAPPED	2"	---
		CONCEALED	RECTANGULAR	FIBERGLASS	LINED	1/2"	---
		CONCEALED	ROUND	FIBERGLASS	LINED	1/2"	2
		EXPOSED	RECTANGULAR	FIBERGLASS	LINED	1/2"	---
	GREASE HOOD EXHAUST	ALL	ALL	FIBERGLASS	LINED	1/2"	2


- NOTES:**
- IN ADDITION TO OTHER SCHEDULED INSULATION.
 - PROVIDE LINER ONLY WITHIN 10' OF FAN FOR ACOUSTICS.
 - INSTALL FROM UNIT DISCHARGE TO FIRST DUCT ELBOW, THEN 10' FURTHER. NOT REQUIRED INSIDE CHASES OR MECHANICAL ROOMS, BUT SHALL BE INSTALLED ON REMAINING DUCTWORK WHEN 10' DIMENSION FALLS OUTSIDE ROOM.

- GENERAL REMARKS (APPLICABLE TO ALL TYPES):**
- ALL DUCTWORK, INSULATION AND MATERIALS IN PLENUMS MUST MEET ASTM E84 FLAME/SMOKE RATING OF 25/50.
 - ALL INSULATION THICKNESSES SHALL MEET ASHRAE 90.1 - 2010 REQUIREMENTS AT A MINIMUM.
 - REFER TO SPECIFICATIONS FOR MORE DETAILED INFORMATION FOR INSULATION PRODUCTS AND SYSTEMS.

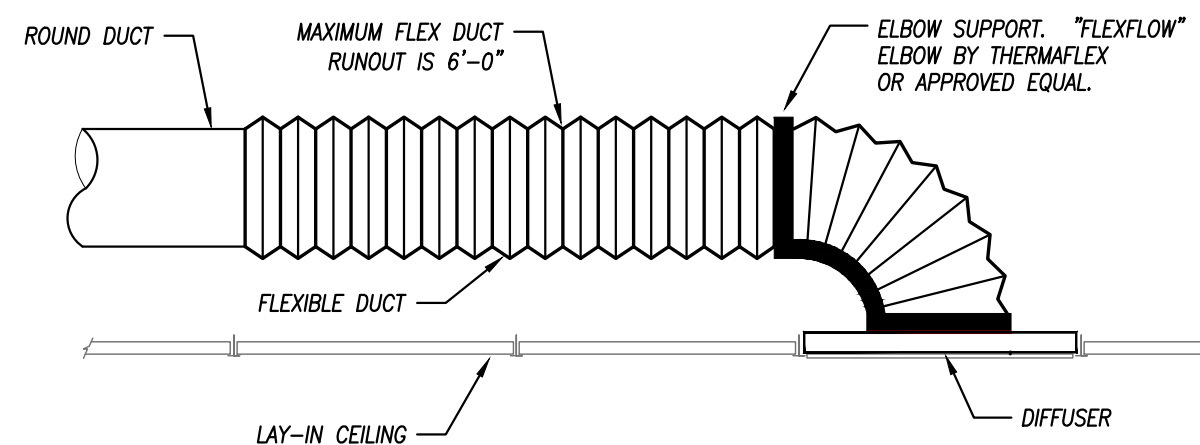


- NOTES:**
- NOTE: INSTALL FLEXIBLE DUCTWORK SUPPORTS AT ALL ROUND NECK OUTLETS/INLETS UNLESS OTHERWISE NOTED ON DRAWINGS.
 - FLEXIBLE DUCTWORK IS NOT TO BE USED IN UNACCESSIBLE LOCATIONS. (ABOVE GYP. BOARD CEILINGS, ETC.)


FLEXIBLE DUCT CONNECTION TO DIFFUSER
NOT TO SCALE

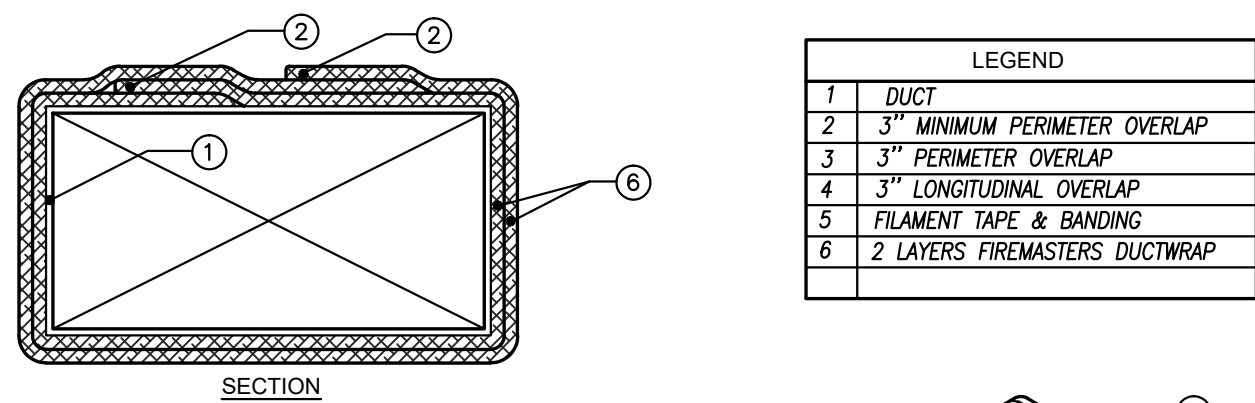


- INSTALLATION:**
FOR DETAILED INSTALLATION & INSTRUCTIONS, REFER TO FIREMASTERS DUCT WRAP INSTALLATION GUIDE.

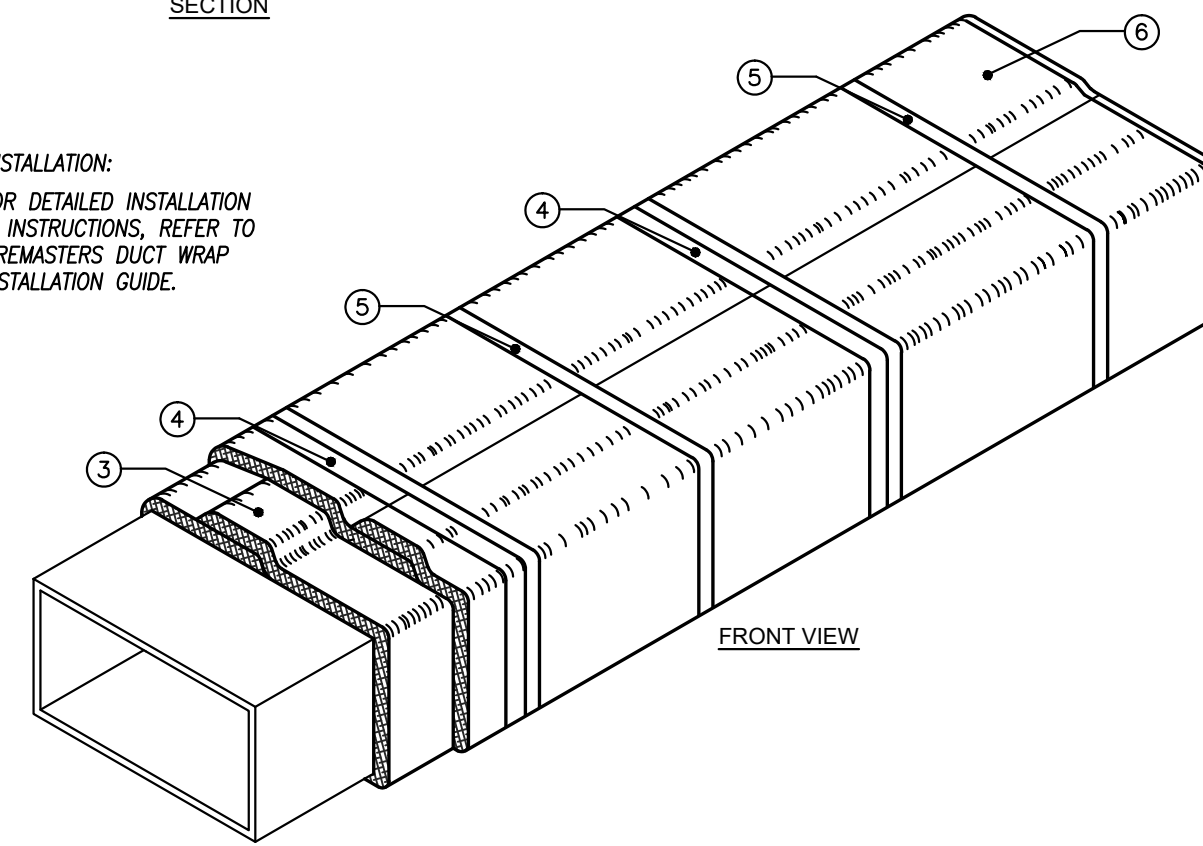

GREASE DUCT FIRE RATING DIAGRAM
NOT TO SCALE

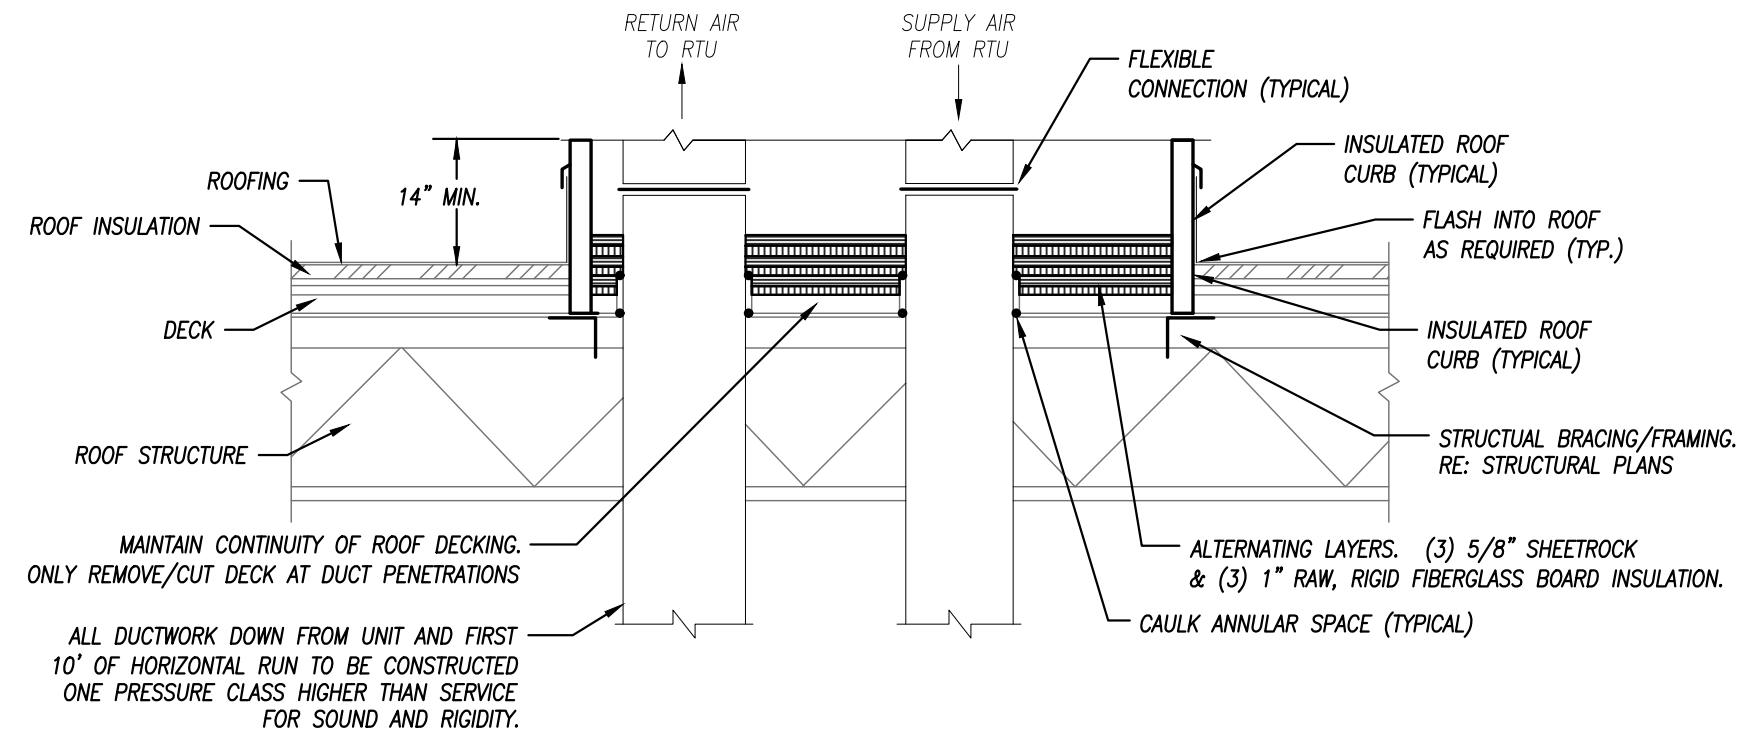

ROOFTOP UNIT CURB DETAIL
NOT TO SCALE

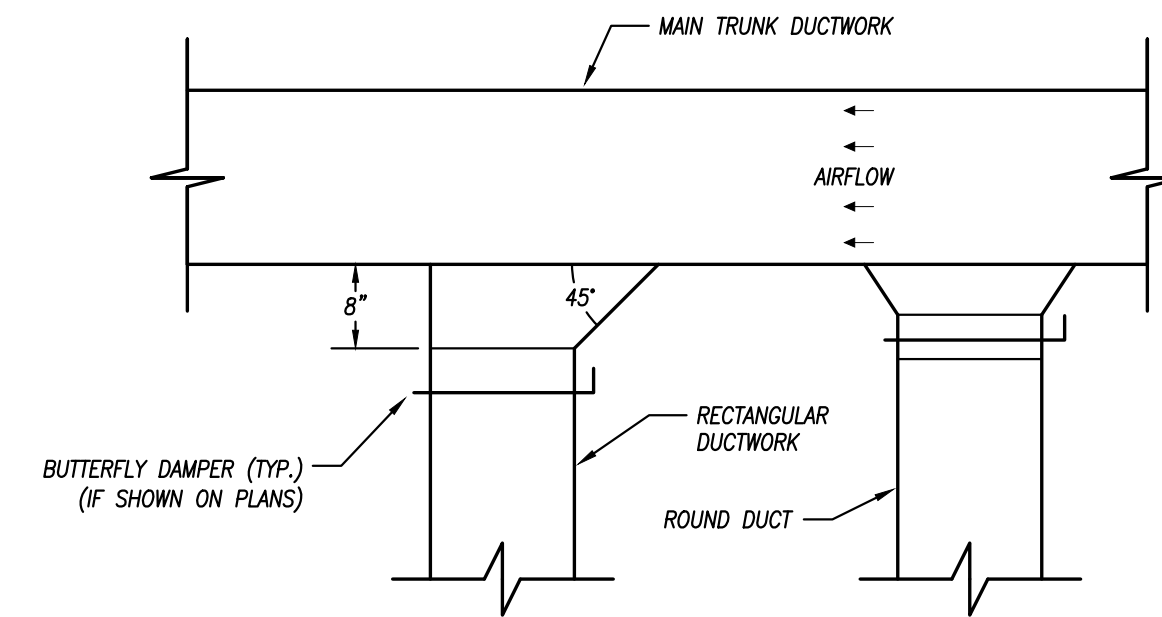

DUCTWORK TAKEOFF
NOT TO SCALE

HVAC Details & Schedules

Freddy's Frozen Custard & Steakhouses
Lot 6 @ 502 E Expressway 83
Weslaco, Texas



303 north main street, mcpherson kansas 620.241.4363

Contract Date	
Rev No. 1	
Rev No. 2	
Rev No. 3	
Rev No. 4	
Rev No. 5	
Rev No. 6	
Project Number:	21.11
DWG File	
Designed By:	plan4
Drawn By:	NSG
Approved By:	SWM
Date:	5/25/22



PEARSON KENT MCKINLEY RAAF ENGINEERS LLC
2933 SW WOODSIDE DR., SUITE C TOPEKA, KS 66614
785.273.2447 WWW.PKMRENG.COM

11 x 17 = 1/2 scale

SHEET NUMBER

M201