

NEW HOODS: SEE HOOD PAVEMENT/RELOC. WIRING DIAGRAM ON SHEET 1441 FOR MORE INFORMATION.

CLEARANCE ABOVE CEILING.


RE-BALANCE TO 450 CFM SUPPLY AIR EACH

RE-BALANCE TO 525 CFM SUPPLY AIR EACH

GC TO HIRE VENTILATION CLEANING CONTRACTOR TO CLEAN ALL EXISTING DUCTWORK TO CLEAN ALL EXISTING DUCTWORK THAT IS TO REMAIN.

FIELD VERIFY EXISTING AIR DEVICE NECK SIZE PRIOR TO ORDERING REPLACEMENT. TYPICAL

GC TO CONFIRM EXACT LOCATION OF ACH3 MAIN DUCT RUNS RELATIVE TO PROPOSED NEW WALL PRIOR TO START OF CONSTRUCTION. HERE IS A CONSULT FOR IF DETERMINED.

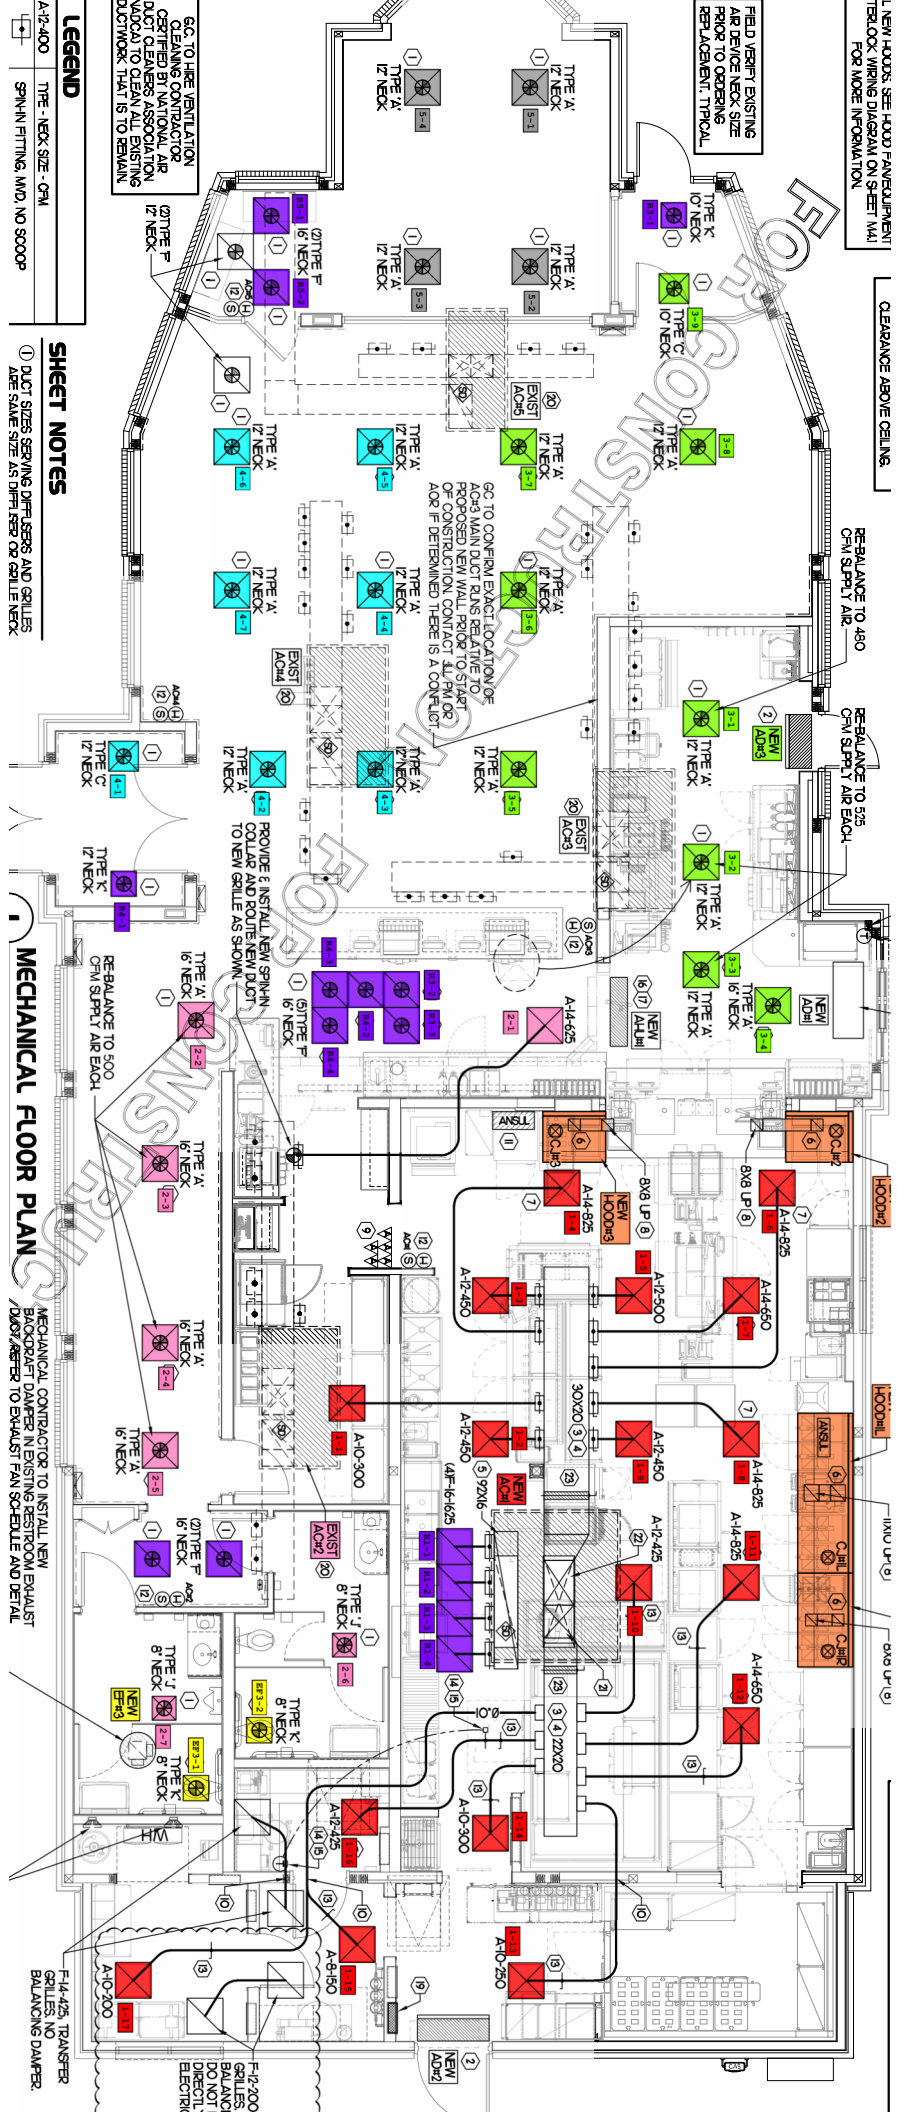

SHEET NOTES
 ① DUCT SIZES SERVING DIFFUSERS AND GRILLES ARE SAME SIZE AS DIFFUSER OR GRILLE NECK

MECHANICAL FLOOR PLAN

MECHANICAL CONTRACTOR TO INSTALL NEW BACKDRAFT DAMPER IN EXISTING RESTROOM EXHAUST DUCT/REGISTER TO EXHAUST FAN SCHEDULE AND DETAIL

F-14-425 TRANSFER GRILLES IN EXISTING RESTROOM DO NOT DIRECTLY ELECTRICAL

LEGEND

A-2-400	TYPE - NECK SIZE - CFM
SPIN-IN FITTING, MFD, NO SCOOP	