KEYED NOTES - SHEET M2.3.1

1 PROVIDE INSULATION PAD TO BE INSTALLED BETWEEN THERMOSTAT AND PERIMETER WALL FOR THERMOSTATS MOUNTED ON EXTERIOR COLUMN/WALLS.

2 CONDENSING UNIT TO BE PLACED ON THE ROOF. EXACT LOCATION TO BE COORDINATED WITH THE ARCHITECT AND THE BUILDING. REFRIGERANT PIPING TO NOT EXCEED 150'.

3 INSTALL CONDENSING UNIT ON SUPPORTS EQUAL TO BIGFOOT SYSTEMS IN PITCH PAN ON ROOF. VERIFY EXACT LOCATION WITH ARCHITECT AND BUILDING REPRESENTATIVE. SIZE AND INSTALL REFRIGERANT LINES PER MANUFACTURER'S RECOMMENDATION.

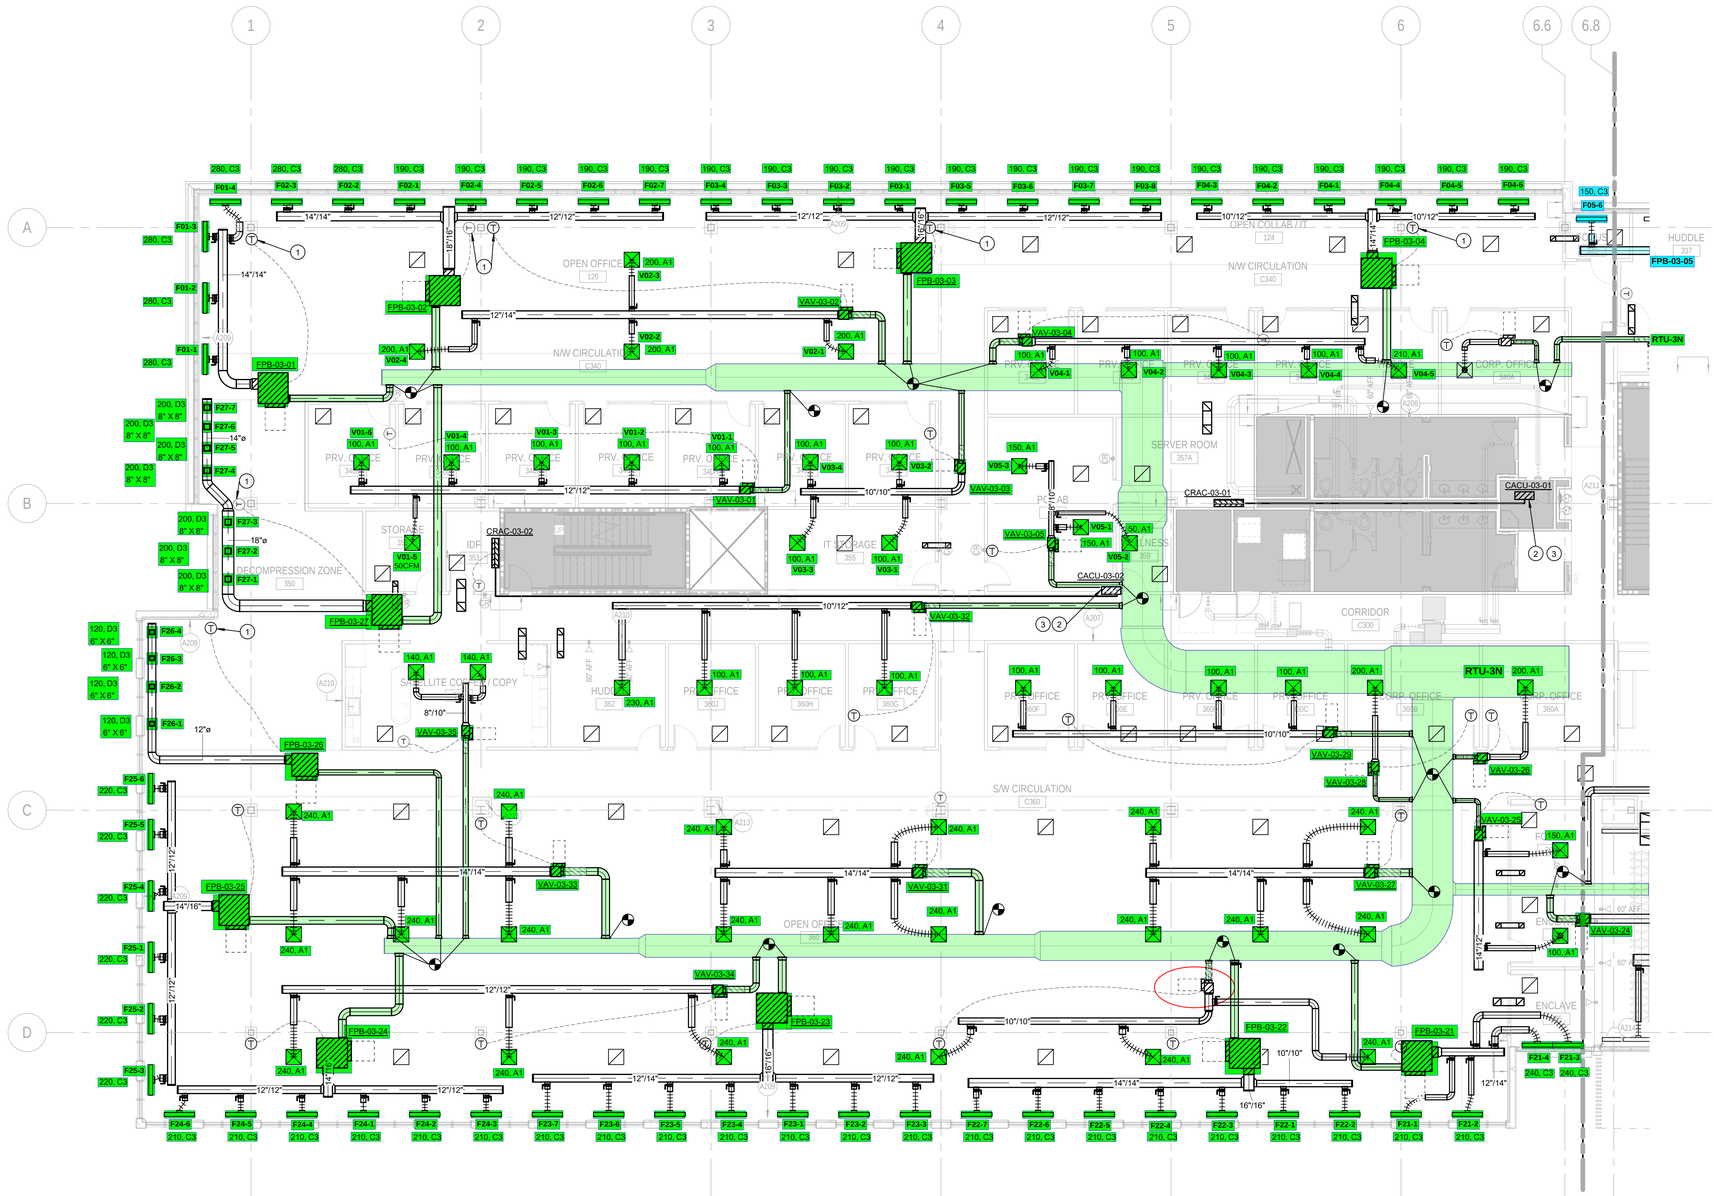

1 LEVEL 3 MECHANICAL PLAN - AREA A
1/8" = 1'-0"

Plot Date: 1/15/2025 4:17:20 PM PMI

Horace Mann

HORACE MANN
International Business Park
6275 W Plano Pkwy
Plano, TX

SMITHGROUP
3333 WELBORN STREET
SUITE 100
DALLAS, TX 75219
214.559.4851
smithgroup.com

Novom Group
AV/IT CONSULTANT
1540 Keller Pkwy, Suite 108-422
Keller, TX 76248
(817) 709-5578

Purdy-McGuire, Inc
MECHANICAL/ELECTRICAL/PLUMBING ENGINEER
17300 Dallas Pkwy, #3000
Dallas, TX 75248
(972) 239-5357

ISSUED FOR | DATE

SEALS AND SIGNATURES

STATE OF TEXAS
TODD M. JOHNSON
86955
LICENSED
PROFESSIONAL ENGINEER
11/15/24

KEYPLAN

NORTH

A

SHEET TITLE

LEVEL 3 MECHANICAL PLAN - AREA A

© 2024 Purdy - McGuire
Mechanical - Electrical Engineers
17300 North Dallas Parkway Suite 300
Dallas, TX 75248-1147
Firm Registration # F-1511
Tel: 972/239-5357
Fax: 972/239-5231
www.purdy-mcguire.com

PMI JOB NO. 24040.007
PROJECT MGR. TODD JOHNSON

THIS DRAWING SHALL NOT BE REPRODUCED FOR ANY PROJECT OTHER THAN THE PROJECT NOTED IN THE TITLE BLOCK, WITHOUT THE WRITTEN CONSENT OF PURDY-McGUIRE, INC. DALLAS, TX

15472

PROJECT NUMBER

CD M2.3.1

SHEET NUMBER

KEYED NOTES - SHEET M2.3.2

1 PROVIDE INSULATION PAD TO BE INSTALLED BETWEEN THERMOSTAT AND PERIMETER WALL FOR THERMOSTATS MOUNTED ON EXTERIOR COLUMN/WALLS.

2 CONDENSING UNIT TO BE PLACED ON THE ROOF. EXACT LOCATION TO BE COORDINATED WITH THE ARCHITECT AND THE BUILDING. REFRIGERANT PIPING TO NOT EXCEED 150'.

3 PROVIDE SOUND INSULATION BLANKET SYSTEM EQUAL TO BRD HUSHCORE FOR FAN POWERED BOX.

4 DUCTS OVERSIZED IN THESE ROOMS TO REDUCE NOISE. WHERE THE SCHEDULE WOULD HAVE THESE DUCTS AT 8"DIA; WE WANT THESE SPECIFIC DUCTS TO BE 10"DIA.

5 PROVIDE YOUNG REGULATOR FOR VOLUME DAMPER CONTROLS. REFER TO GENERAL NOTES FOR ADDITIONAL INFORMATION.

6 INSTALL CONDENSING UNIT ON SUPPORTS EQUAL TO BIGFOOT SYSTEMS IN PITCH PAN ON ROOF. VERIFY EXACT LOCATION WITH ARCHITECT AND BUILDING REPRESENTATIVE. SIZE AND INSTALL REFRIGERANT LINES PER MANUFACTURER'S RECOMMENDATION.

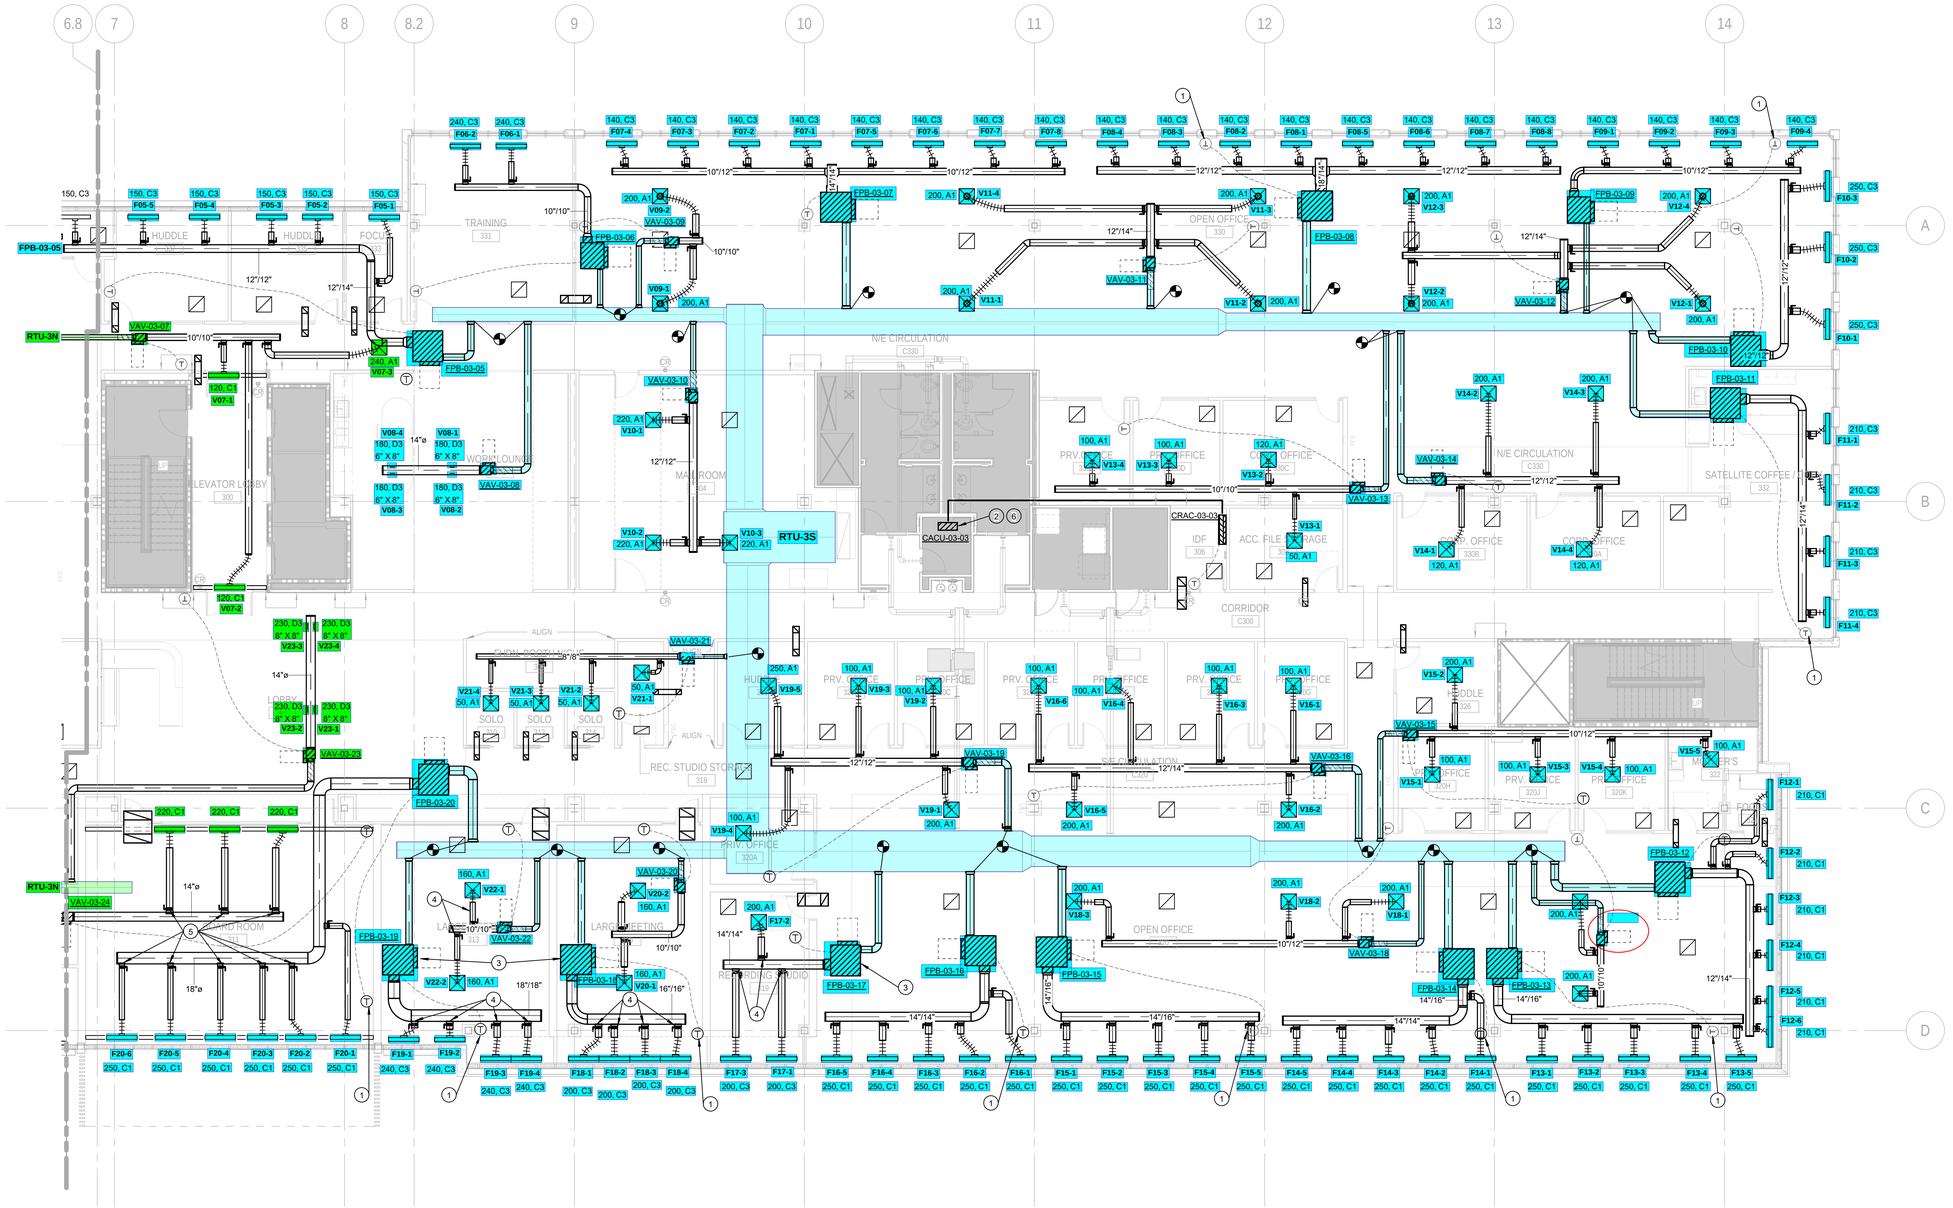

1 LEVEL 3 MECHANICAL PLAN - AREA B
1/8" = 1'-0"

Horace Mann

HORACE MANN
International Business Park
6275 W Plano Pkwy
Plano, TX

SMITHGROUP
3333 WELBORN STREET
SUITE 100
DALLAS, TX 75219
214.559.4851
smithgroup.com

Novom Group
AV/IT CONSULTANT
1540 Keller Pkwy, Suite 108-422
Keller, TX 76248
(817) 709-5578

Purdy-McGuire, Inc
MECHANICAL/ELECTRICAL/PLUMBING ENGINEER
17300 Dallas Pkwy, #3000
Dallas, TX 75248
(972) 239-5357

ISSUED FOR | DATE

SEALS AND SIGNATURES

STATE OF TEXAS
TODD M. JOHNSON
86955
LICENSED
PROFESSIONAL ENGINEER
11/19/25

KEYPLAN



SHEET TITLE
LEVEL 3 MECHANICAL PLAN - AREA B

PROJECT NUMBER
15472

CD M2.3.2
SHEET NUMBER

© 2024 Purdy - McGuire
Mechanical - Electrical Engineers
17300 North Dallas Parkway Suite 300
Dallas, TX 75248-1147
Firm Registration # F-1511
Tel: 972/239-5357
Fax: 972/239-5231
www.purdy-mcguire.com

PMI JOB NO. 24040.007
PROJECT MGR. TODD JOHNSON

THIS DRAWING SHALL NOT BE REPRODUCED FOR ANY PROJECT OTHER THAN THE PROJECT NOTED IN THE TITLE BLOCK, WITHOUT THE WRITTEN CONSENT OF PURDY-McGUIRE, INC. DALLAS, TX

PMI
1/15/2025 4:17:32 PM
Plot Date: