

- PLAN NOTES:
- PROVIDE ICC 500 COMPLIANT SECURITY GRILLES IN PENETRATION THROUGH WALL IN THIS LOCATION.
 - MOUNT NITROUS OXIDE SENSOR (NO2) BETWEEN 12"-18" ABOVE FINISHED FLOOR. INTERLOCK SENSOR WITH EXHAUST FAN (EF-X) TO ENERGIZE EF-X UPON DETECTION OF NITROUS OXIDE LEVELS ABOVE 25 PPB (ADD).
 - MOUNT CARBON MONOXIDE SENSOR (CO) BETWEEN 12"-18" FROM BOTTOM OF STRUCTURE. INTERLOCK SENSOR WITH EXHAUST FAN (EF-X) TO ENERGIZE EF-X UPON DETECTION OF CARBON MONOXIDE ABOVE 50 PPM (ADD).
 - PROVIDE THERMOSTAT WITH TAMPER RESISTANT COVER.
 - REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATION.

HOEFER WELKER
 11460 Tomahawk Creek Pkwy
 Suite 400
 Leawood, KS 66211
 P: 913.307.3700
 www.hoeferwelker.com
COPYRIGHT © BY HOEFER WELKER, LLC


smith & boucher
 engineers
 25618 west 103rd St. olathe, ks 66061
 phone 913.345.2127 fax 913.345.0617
 project number 2212000

CONSTRUCTION SET

GRAIN VALLEY POLICE

719 NW RD MIZE ROAD, GRAIN VALLEY, MO 64029

REVISION DATES:
 3 ASI 3 02.23.2023

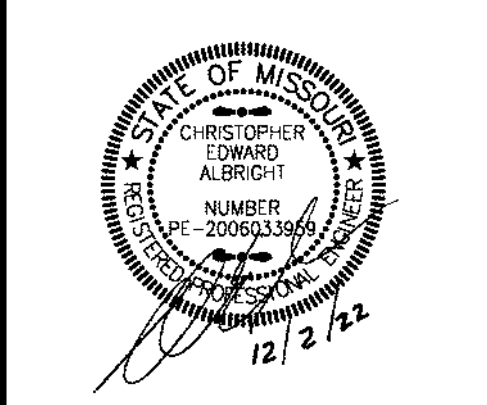

PROFESSIONAL SEAL
M1.11
 ISSUE DATE: DECEMBER 2, 2022
 HOEFER WELKER #: 118091

HVAC PLAN

A1 HVAC PLAN
 1/8" = 1'-0"