


- KEYED NOTES:
- 1 RELOCATE EXISTING VAV DRIVER
  - 2 LINED SHEET METAL FLENNH RILL SIZE OF CONNECTION
  - 3 THIS CORE 90 24/44 LINED SHEET METAL FLENNH ROUND COLLAR SIZE AS NOTED
  - 4 RTU-9 SENSOR AT 18" AFF
  - 5 INSULATED ROUND FLEXIBLE DUCT THEREAFTER MAX LENGTH 6FT FOR CONNECTION TO CEILING SUPPLY/RETURN ONLY

N
2
M1.0

## PART PLAN - HVAC

SCALE: 1/8" = 1'-0"

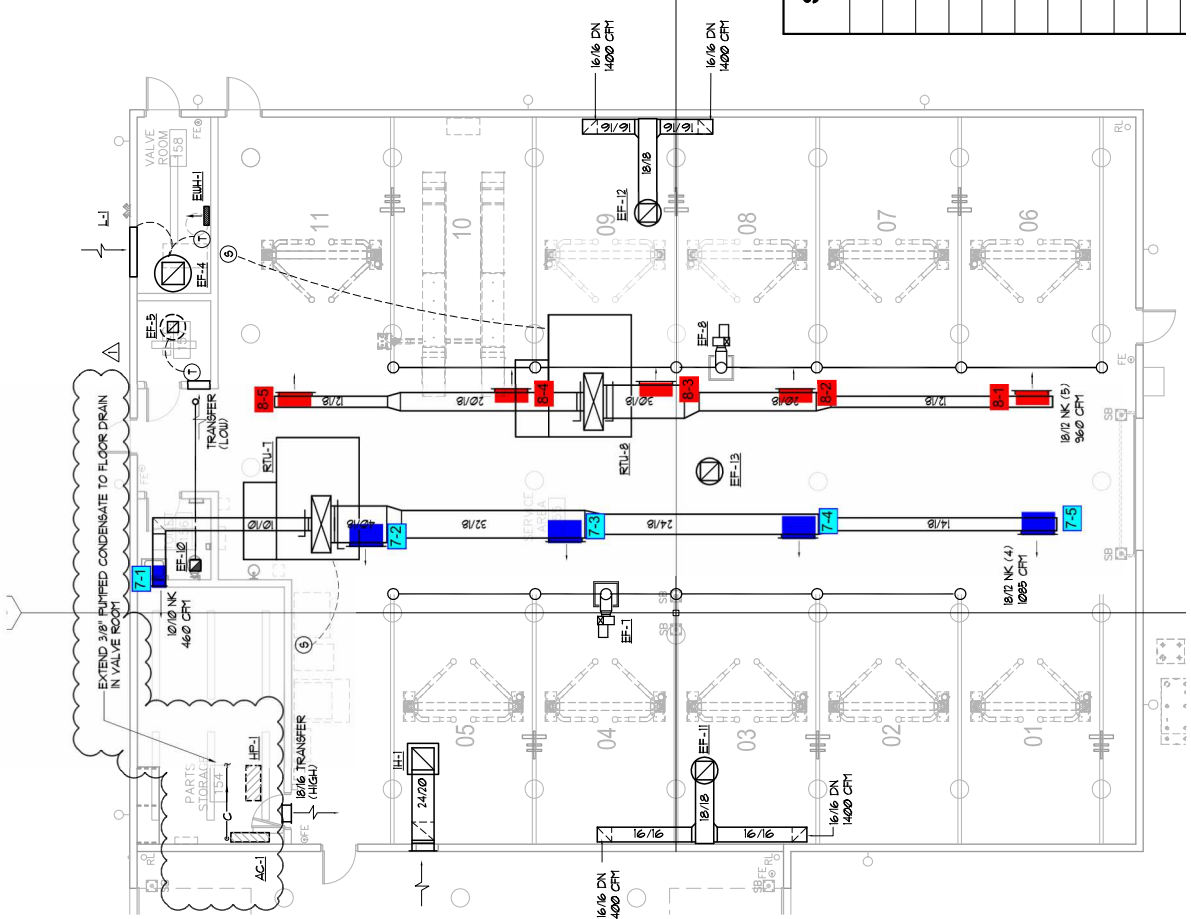

N
2
M1.0

## PART PLAN - HVAC

SCALE: 1/8" = 1'-0"