

5 AND AS DETAILED

TURAL AND
OTLE ON EXHAUST

'PICAL.
(KEY OPERATED
AL.

EE ELECTRICAL
RS ON FACE OF
EME HALO WOULD

IDE AIR INTAKES.
EXHAUST FAN EF-1
ER FLUE AND


DOM AT

D-VERIFIED TO
EN OPENING FOR

EMENT.

WATER HEATER
FLUE TO ROOF

WATER HEATER
COMBUSTION AIR INTAKE
TO ROOF

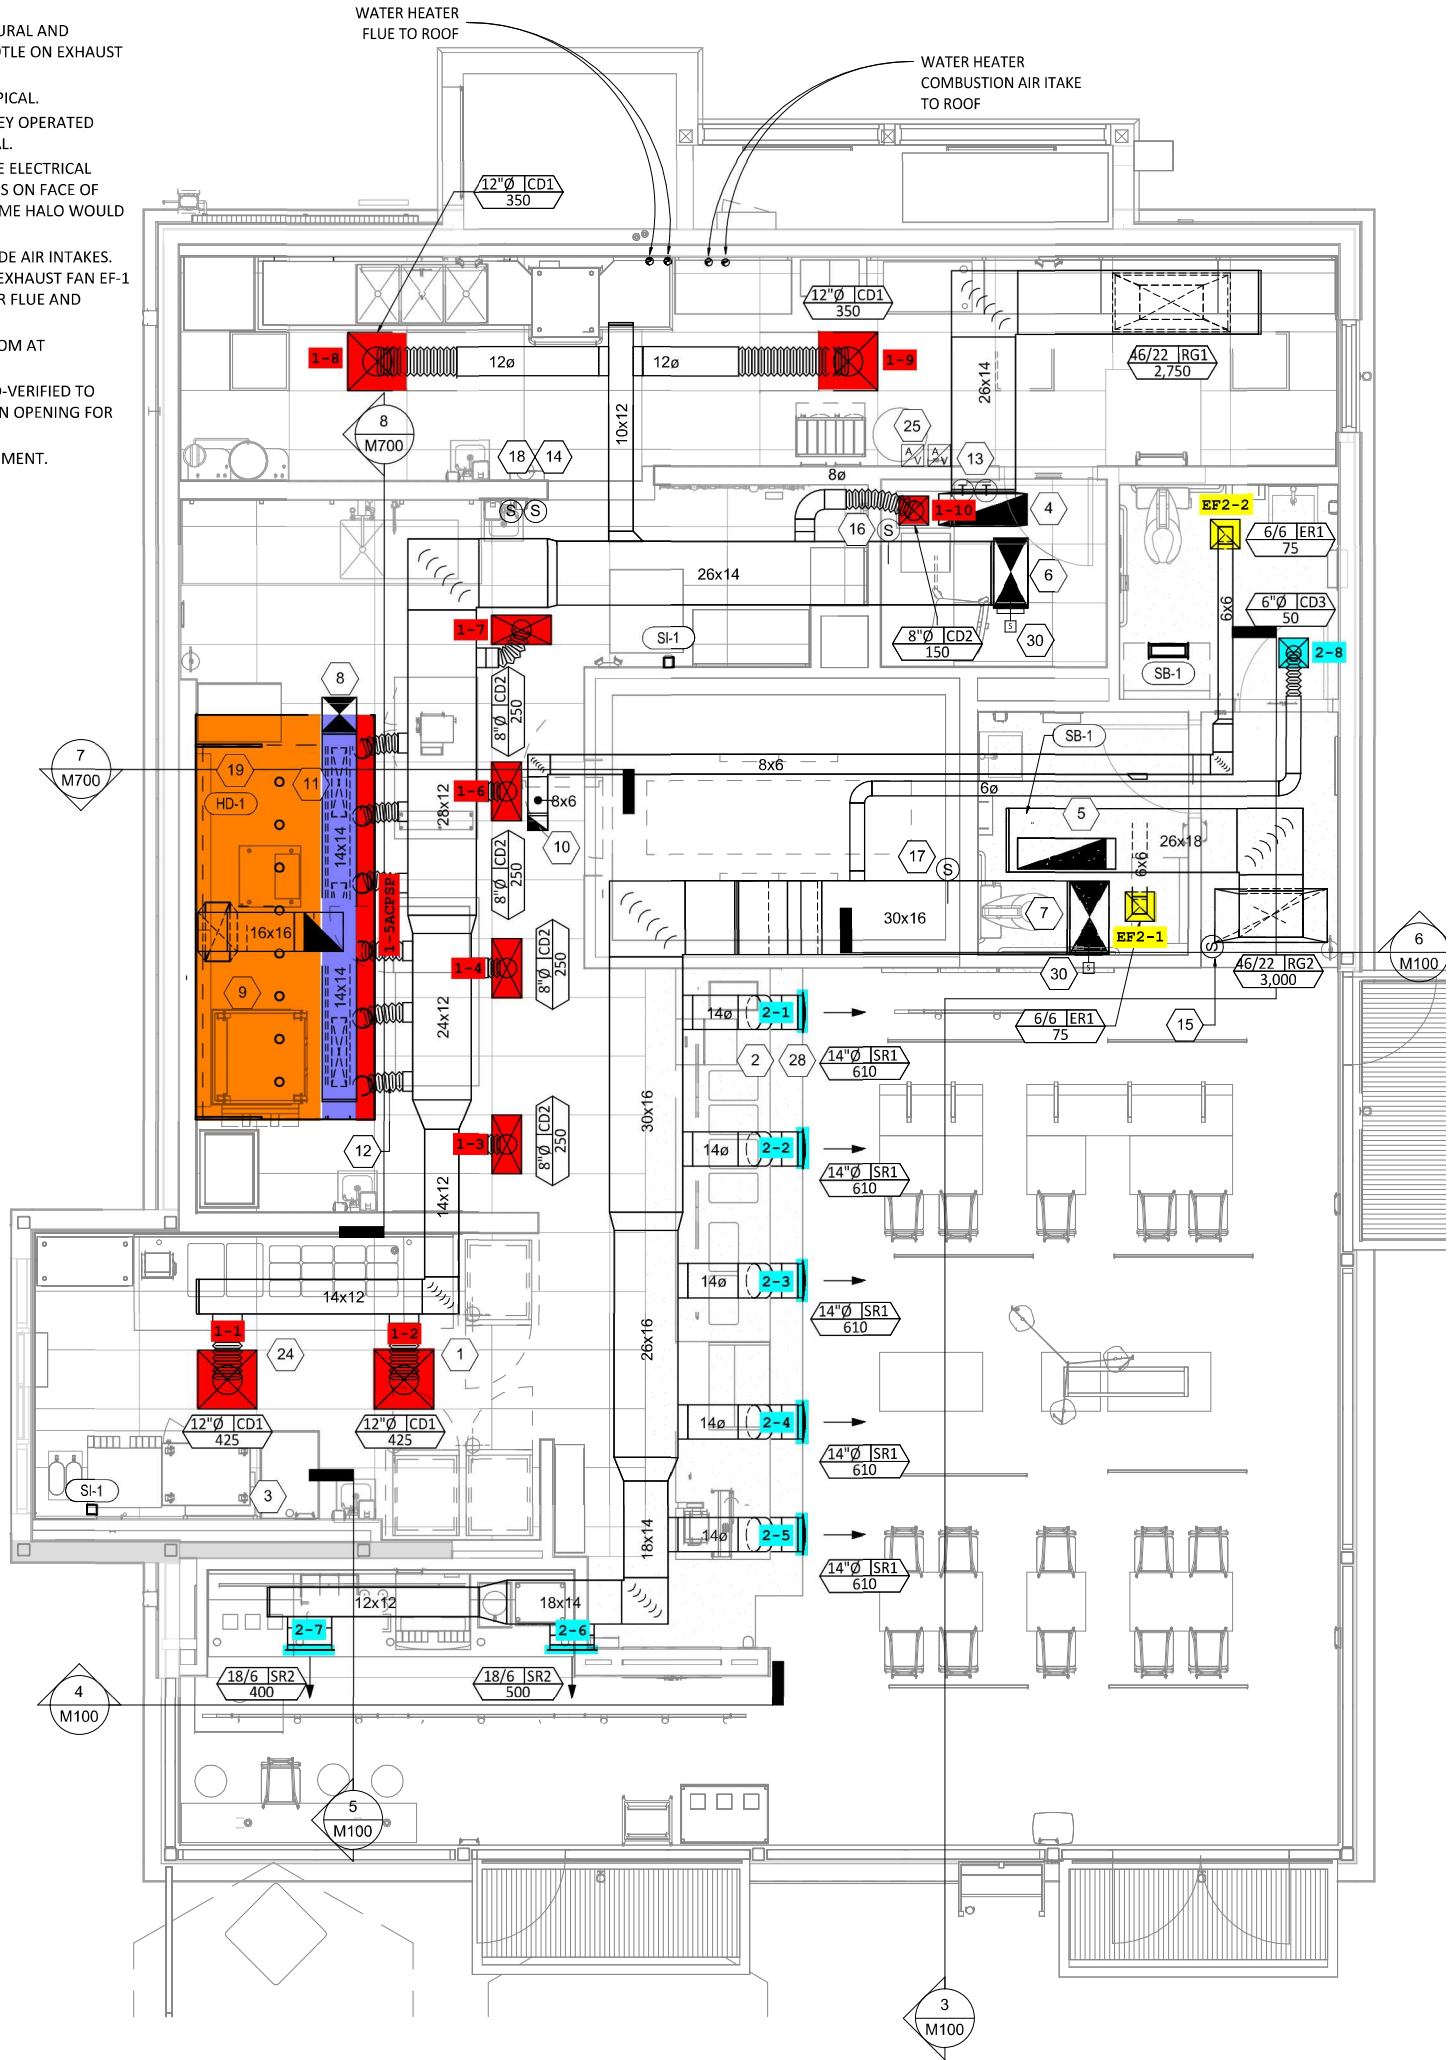

7
M700

4
M100

5
M100

3
M100

6
M100