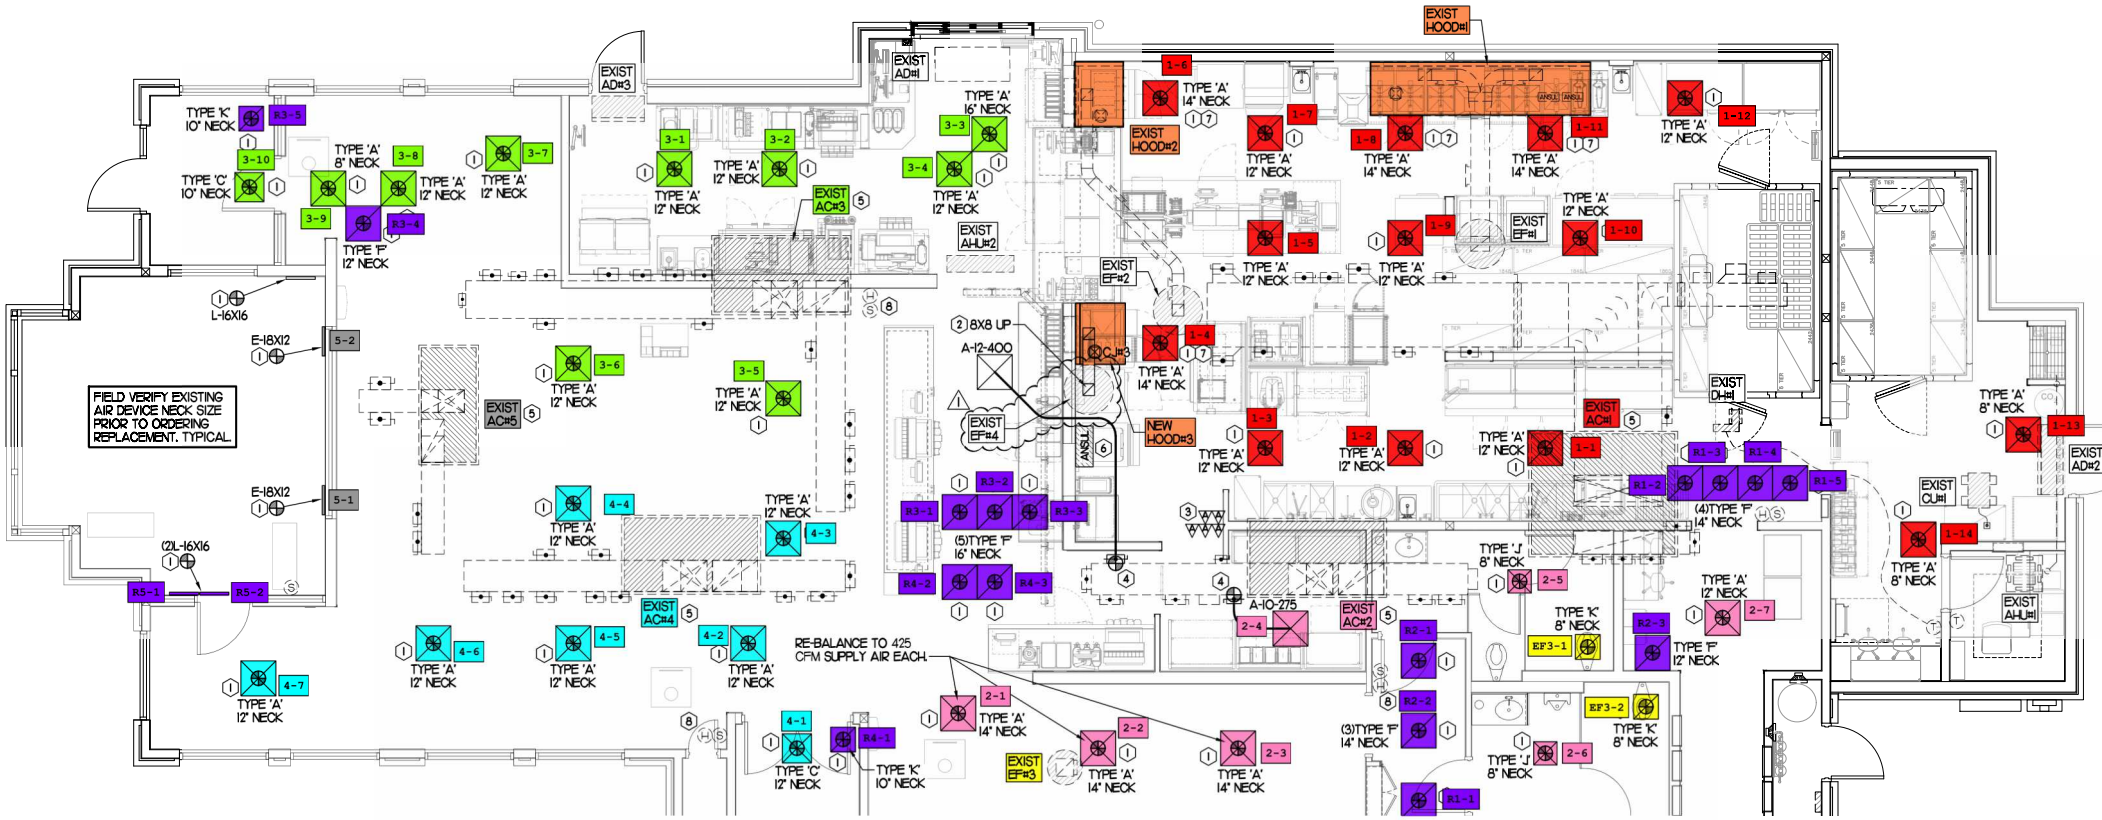
FIELD VERIFY EXISTING AIR DEVICE NECK SIZE PRIOR TO ORDERING REPLACEMENT. TYPICAL.
RE-BALANCE TO 425 CFM SUPPLY AIR EACH
EXIST HOOD#1
EXIST HOOD#2
NEW HOOD#3
EXIST AD#1
EXIST AD#2
EXIST AD#3
EXIST AC#1
EXIST AC#2
EXIST AC#3
EXIST AC#4
EXIST AC#5
EXIST EF#1
EXIST EF#2
EXIST EF#3
EXIST EF#4
EXIST CU#1
EXIST CU#2
EXIST CU#3
EXIST AH-U#1
EXIST AH-U#2
8X8 UP
A-12-400
A-10-275
L-16X16
E-18X12
(2)L-16X16
TYPE 'A' 12" NECK
TYPE 'A' 14" NECK
TYPE 'A' 16" NECK
TYPE 'A' 8" NECK
TYPE 'C' 10" NECK
TYPE 'K' 10" NECK
TYPE 'F' 12" NECK
TYPE 'K' 8" NECK
TYPE 'J' 8" NECK
(5)TYPE 'F' 16" NECK
(4)TYPE 'F' 14" NECK
(3)TYPE 'F' 14" NECK