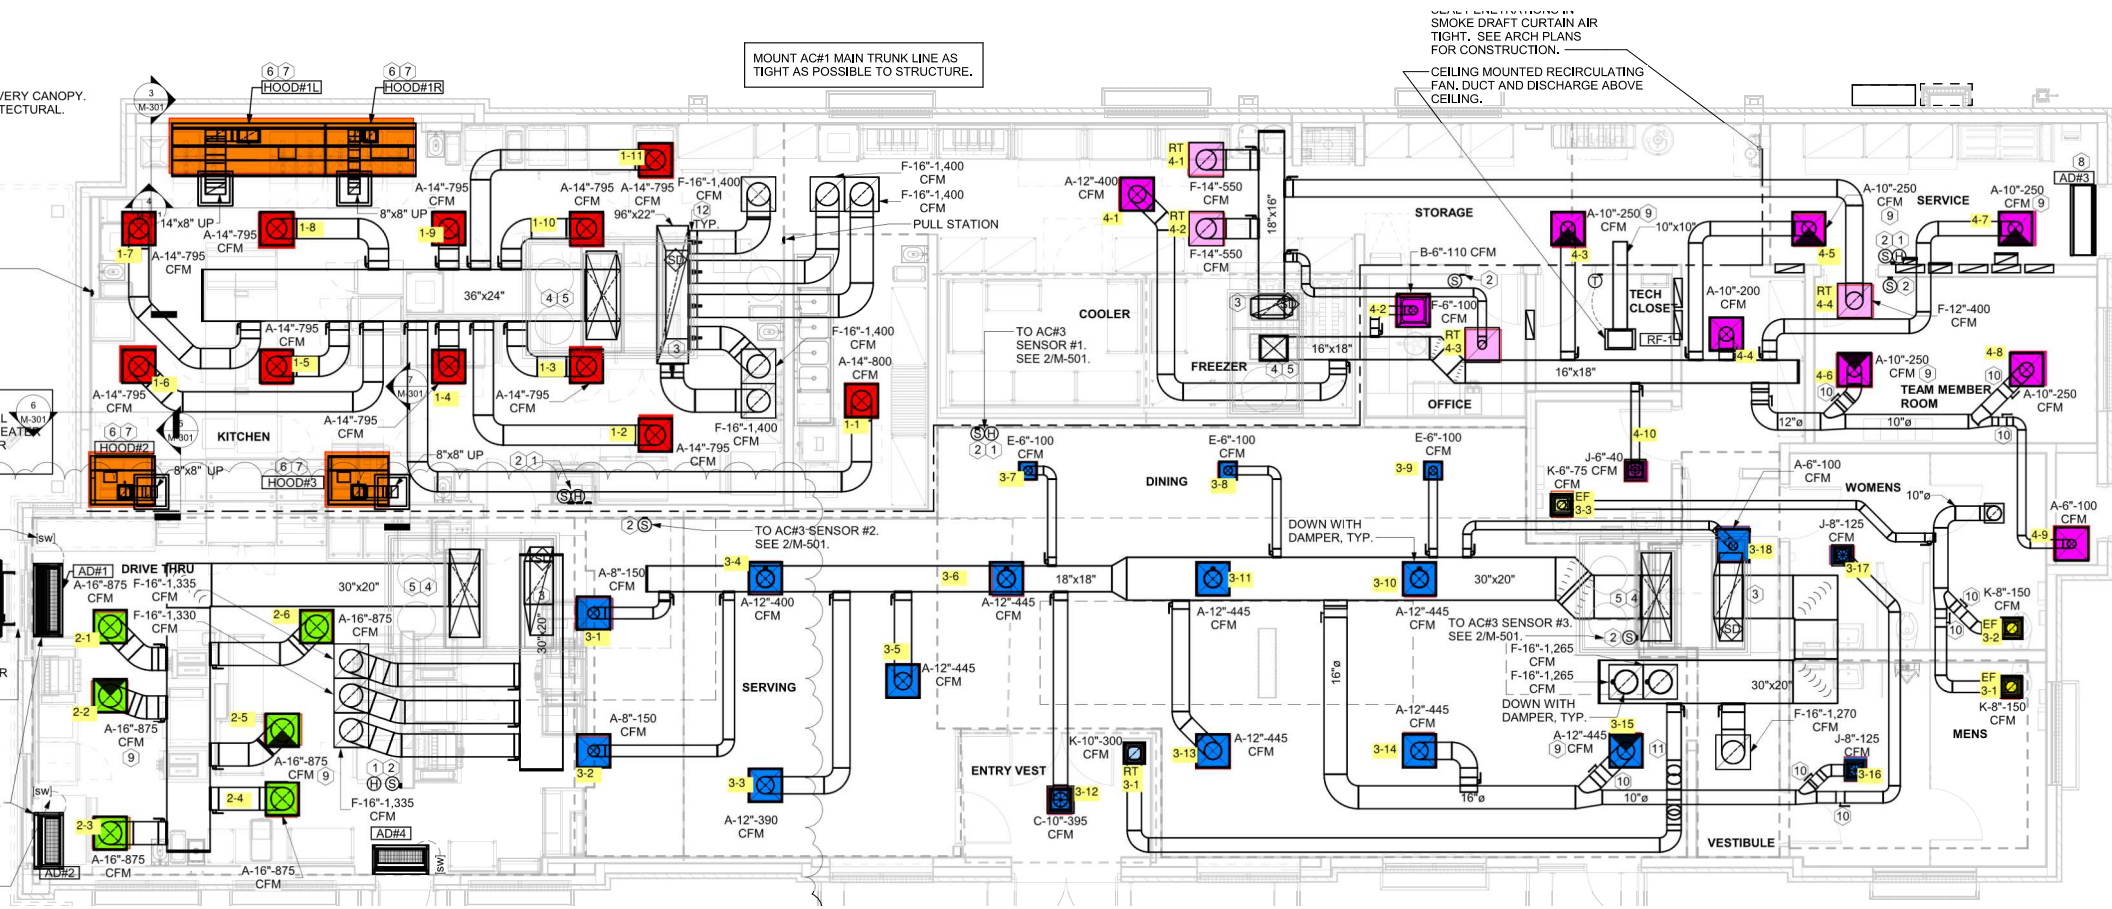
MOUNT AC#1 MAIN TRUNK LINE AS TIGHT AS POSSIBLE TO STRUCTURE.
SMOKE DRAFT CURTAIN AIR TIGHT. SEE ARCH PLANS FOR CONSTRUCTION.
CEILING MOUNTED RECIRCULATING FAN. DUCT AND DISCHARGE ABOVE CEILING.
HOOD#1L
HOOD#1R
HOOD#2
HOOD#3
KITCHEN
DRIVE THRU
SERVING
DINING
COOLER
FREEZER
STORAGE
OFFICE
TECH CLOSET
SERVICE
TEAM MEMBER ROOM
WOMENS
MENS
ENTRY VEST
VESTIBULE
PULL STATION
TO AC#3 SENSOR #1. SEE 2/M-501.
TO AC#3 SENSOR #2. SEE 2/M-501.
TO AC#3 SENSOR #3. SEE 2/M-501.
DOWN WITH DAMPER, TYP.
AD#1
AD#2
AD#3
AD#4
RF-1