

TERMINATIONS THROUGH ROOF.  
 DETAIL 15. INSTALL THE REFRIGERANT LINE  
 CONDENSER. IF REFRIGERANT PIPING TO  
 STAINLESS STEEL SHROUD AS SHOWN


INSTALLATION INSTRUCTIONS AND AS  
 NOTED ON NG5.

UNITS MAILED IN THE ARCHITECTURAL AND  
 EQUIPMENT FURNISHED BY CHIPOTLE

1 UNIT PER DETAIL 1/M700. TYPICAL.  
 1 UNIT PER DETAIL 1/M700. TYPICAL.  
 1 UNIT PER DETAIL 1/M700. TYPICAL.  
 1 UNIT PER DETAIL 6/M700. SEE ELECTRICAL  
 ALL UV WARNING STICKERS ON FACE OF  
 THROUGH WHICH THE REME HALO

TERMINATION AND OUTSIDE AIR  
 FOR COMBUSTION AIR INTAKE AND  
 FOR MORE INFORMATION ON WATER

ON OPPOSITE SIDE OF ROOM AT  
 IN IG ROOM.

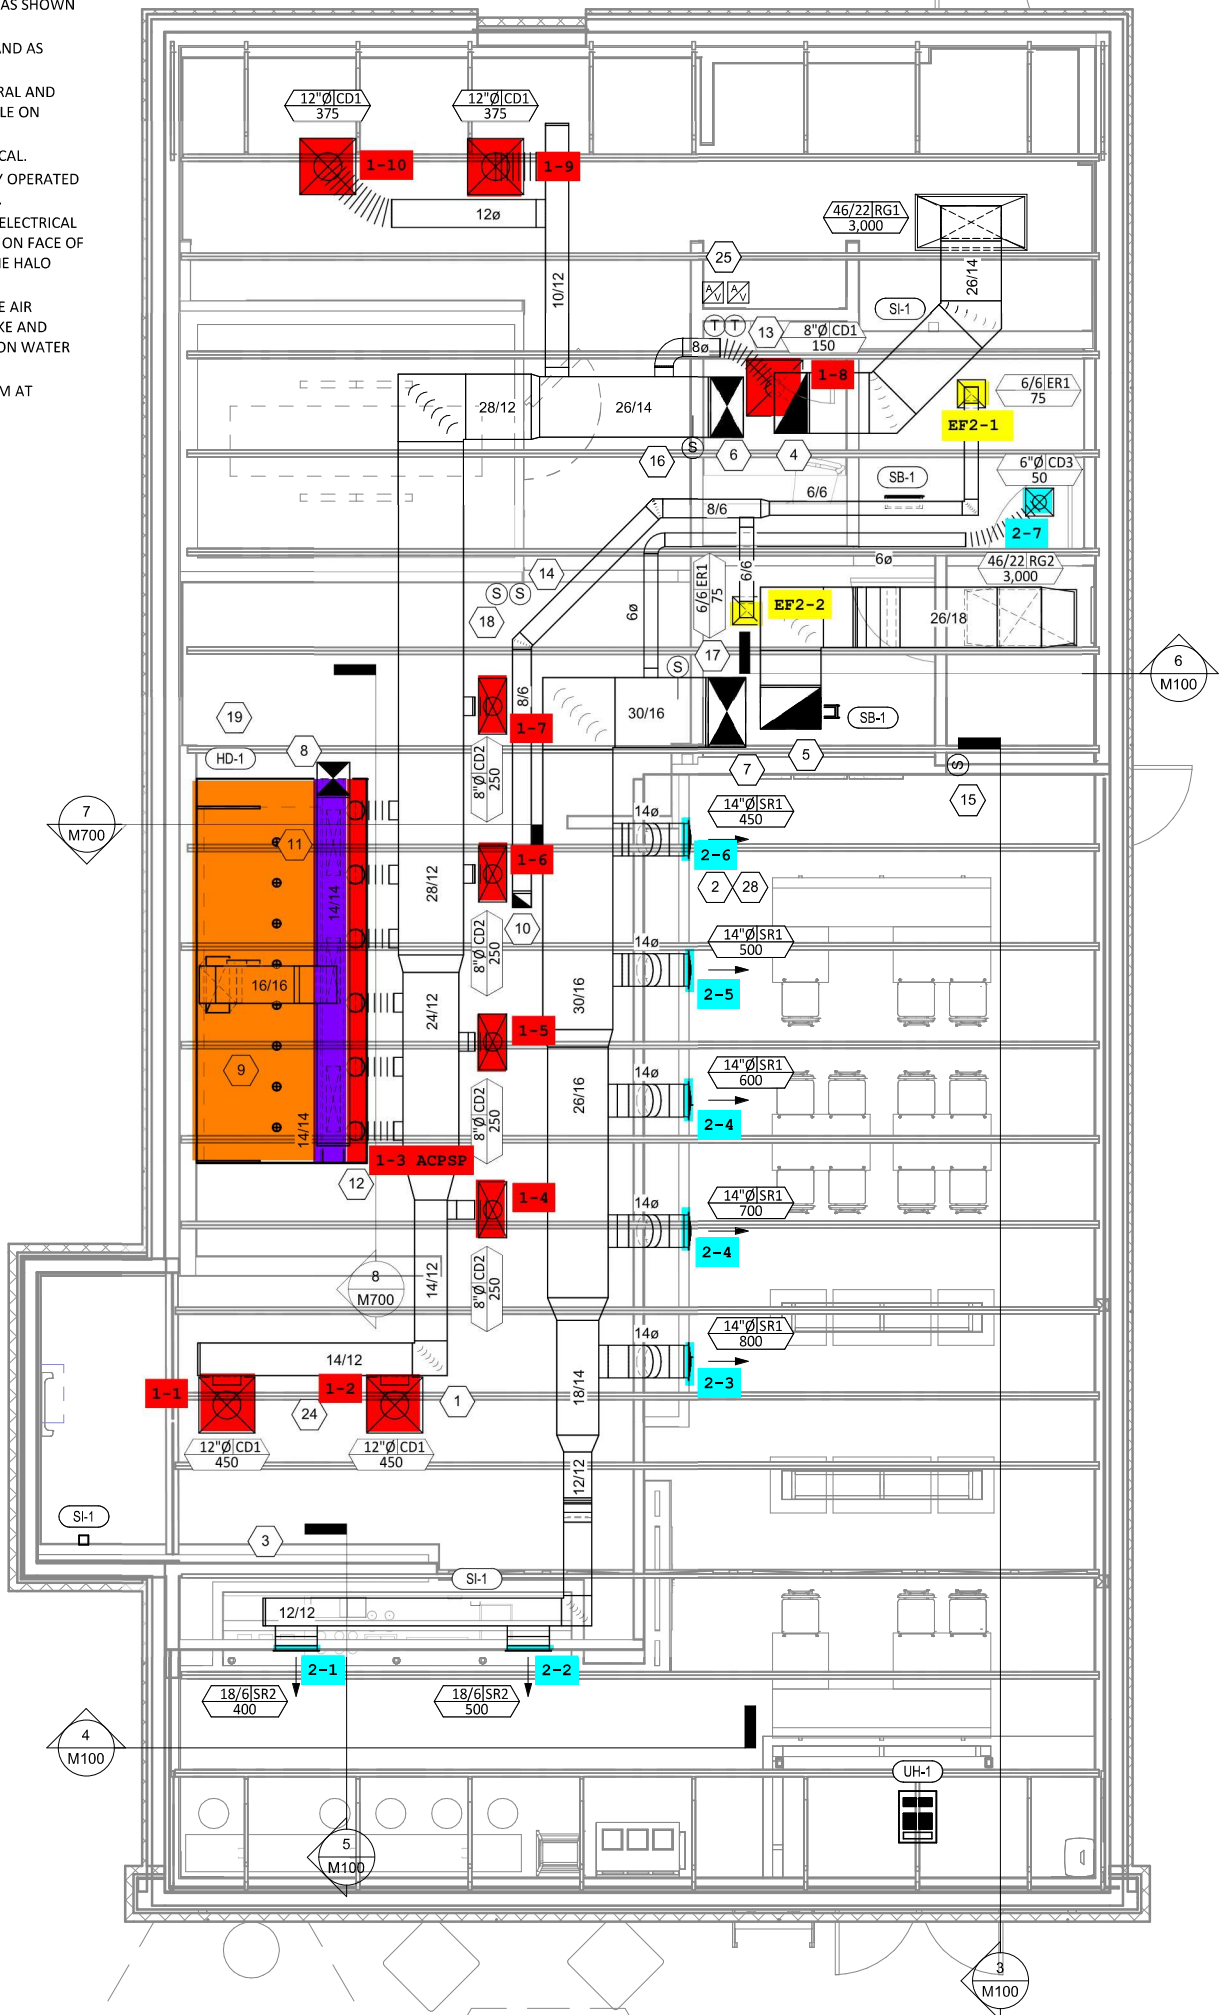

WATER  
 ON AIR INTAKE

