H.E.S. SYSTEM

MECHANICAL CONTRACTOR TO PROVIDE AND INSTALL SUNCOAST H.E.S. SYSTEM FOR ALL NEW HOODS. SEE HOOD FAN/EQUIPMENT INTERLOCK WIRING DIAGRAM ON SHEET M4.1 FOR MORE INFORMATION.

EXISTING CONDITIONS SHOWN ARE FROM AS-BUILT DRAWINGS. MECHANICAL CONTRACTOR SHALL FIELD VERIFY EXACT LOCATIONS OF ALL DUCT AND DIFFUSERS. IF MAJOR DIFFERENCES OCCUR IN FIELD CONTACT CHICK-FIL-A CONSTRUCTION MANAGER.

HOLD DUCT AT AC#1 & AC#6 AS HIGH AS POSSIBLE DUE TO LIMITED CLEARANCE ABOVE CEILING.

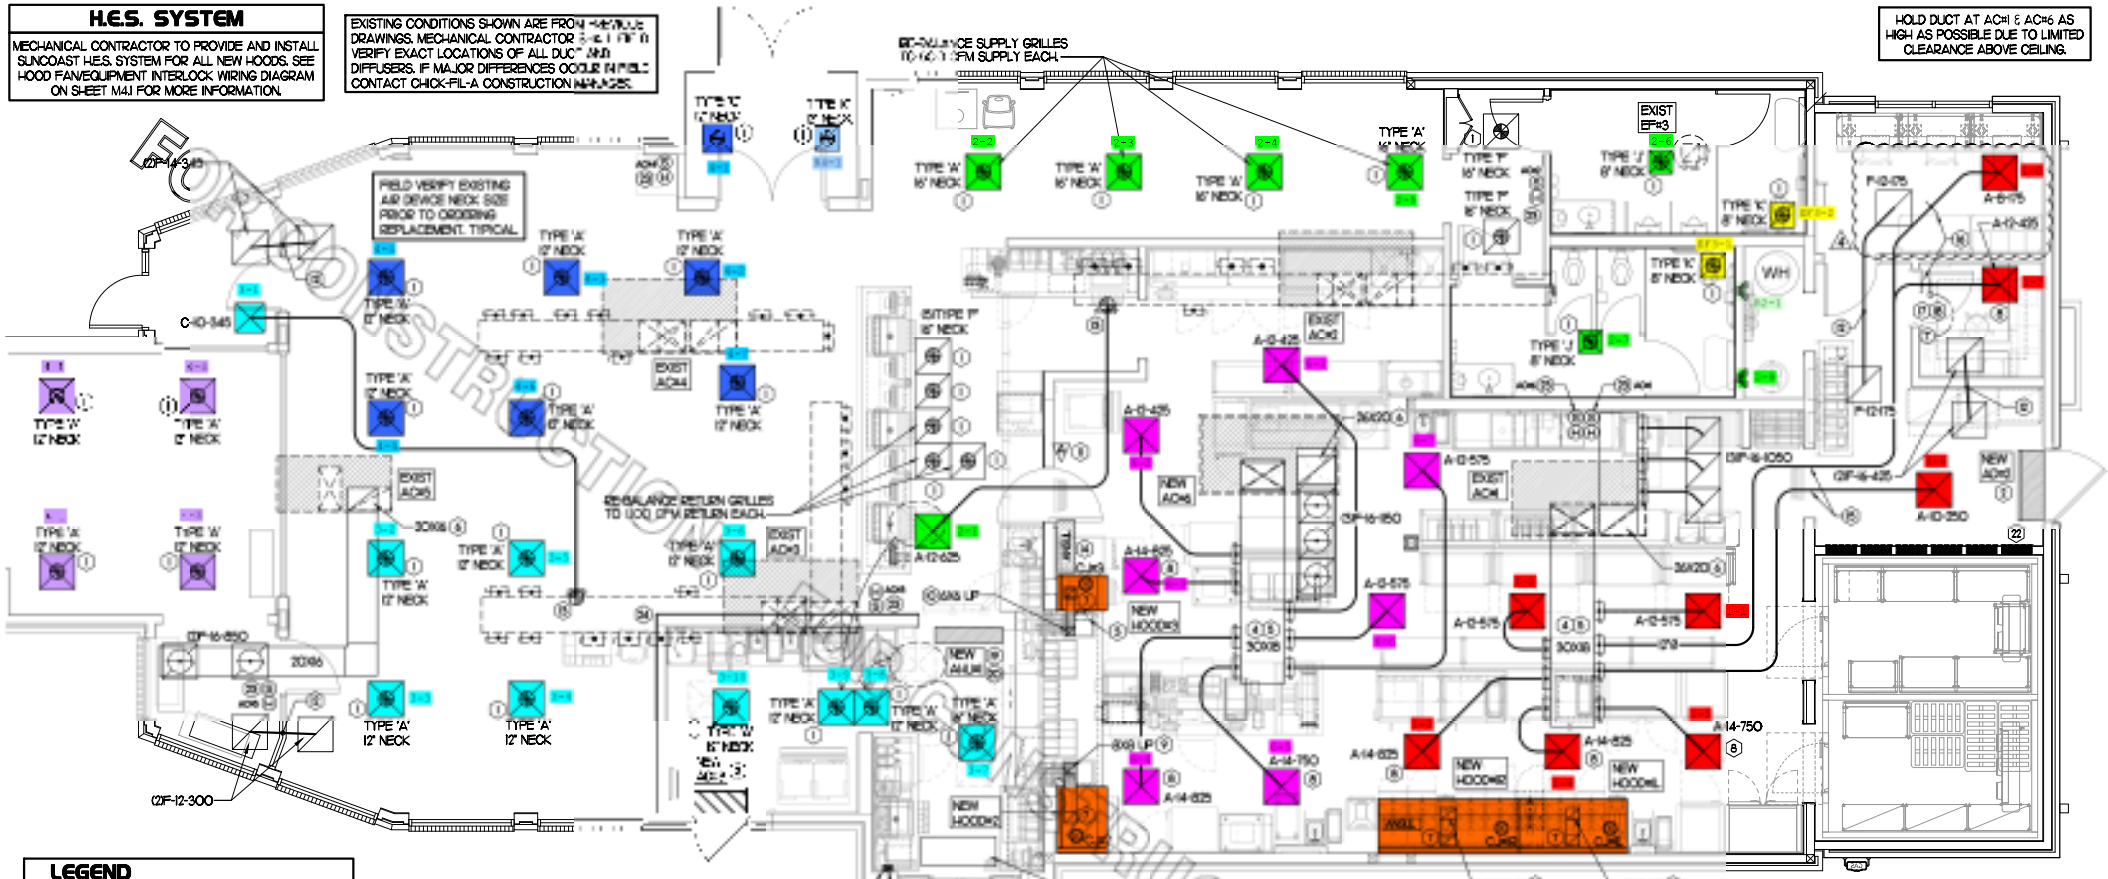

LEGEND

A-12-400	TYPE - NECK SIZE - CFM
	SPIN-IN FITTING, MVD, NO SCOOP
(S)	REMOTE TEMPERATURE SENSOR

SHEET NOTES

KEY NOTES (THIS SHEET ONLY)

1 MECHANICAL FLOOR PLAN

SCALE: 1/4"=1'-0"