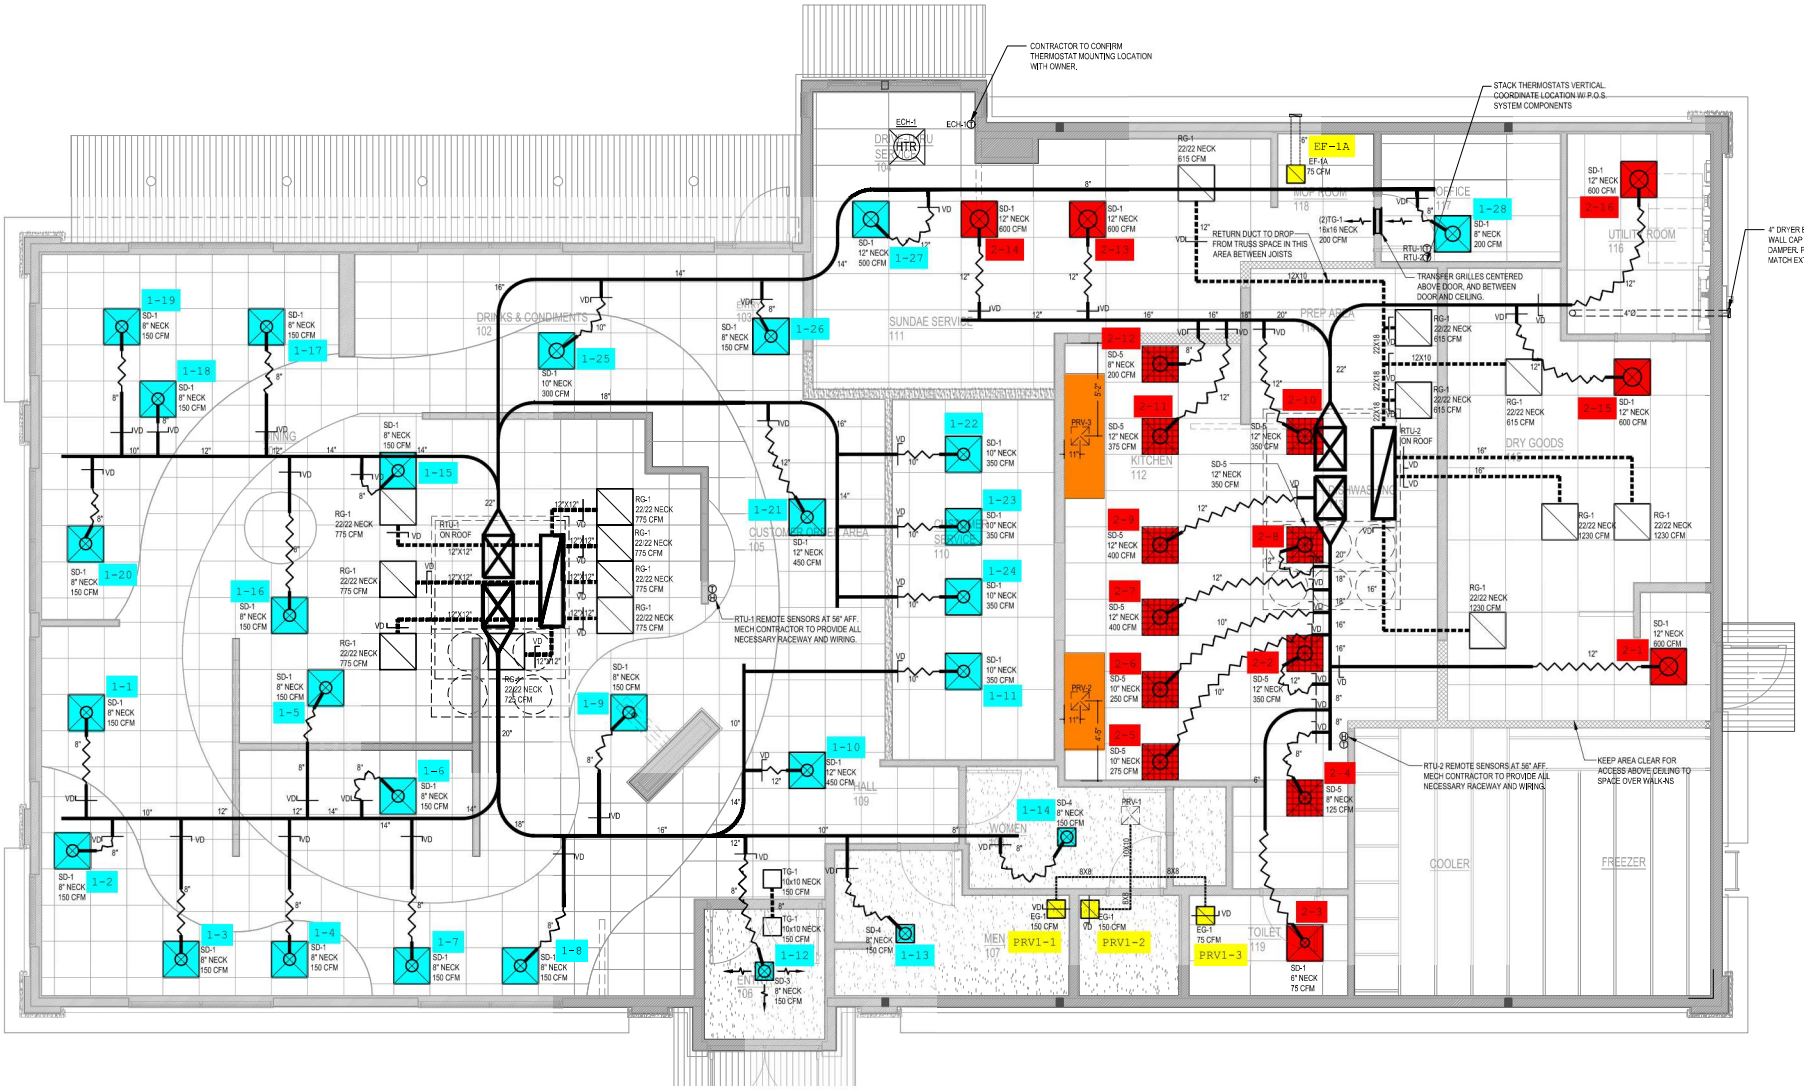
CONTRACTOR TO CONFIRM THERMOSTAT MOUNTING LOCATION WITH OWNER.
STACK THERMOSTATS VERTICAL. COORDINATE LOCATION W/ P.O.S. SYSTEM COMPONENTS
4" DRYER EXHAUST TO HOODED WALL CAP w/ BACKDRAFT DAMPER. PAINT WALL CAP TO MATCH EXTERIOR.
RETURN DUCT TO DROP FROM TRUSS SPACE IN THIS AREA BETWEEN JOISTS
TRANSFER GRILLES CENTERED ABOVE DOOR, AND BETWEEN DOOR AND CEILING.
RTU-1 REMOTE SENSORS AT 56" AFF. MECH CONTRACTOR TO PROVIDE ALL NECESSARY RACEWAY AND WIRING.
RTU-2 REMOTE SENSORS AT 56" AFF. MECH CONTRACTOR TO PROVIDE ALL NECESSARY RACEWAY AND WIRING.
KEEP AREA CLEAR FOR ACCESS ABOVE CEILING TO SPACE OVER WALK-INS
DRINKS & CONDIMENTS 102
SUNDAE SERVICE 111
KITCHEN 112
DRY GOODS 113
UTILITY ROOM 116
OFFICE 117
MOP ROOM 118
TOILET 119
COOLER
FREEZER
WOMEN
MEN 107
HALL 109
CUSTOMER AREA 105
EF-1A
PRV1-1
PRV1-2
PRV1-3
RTU-1 ON ROOF
RTU-2 ON ROOF