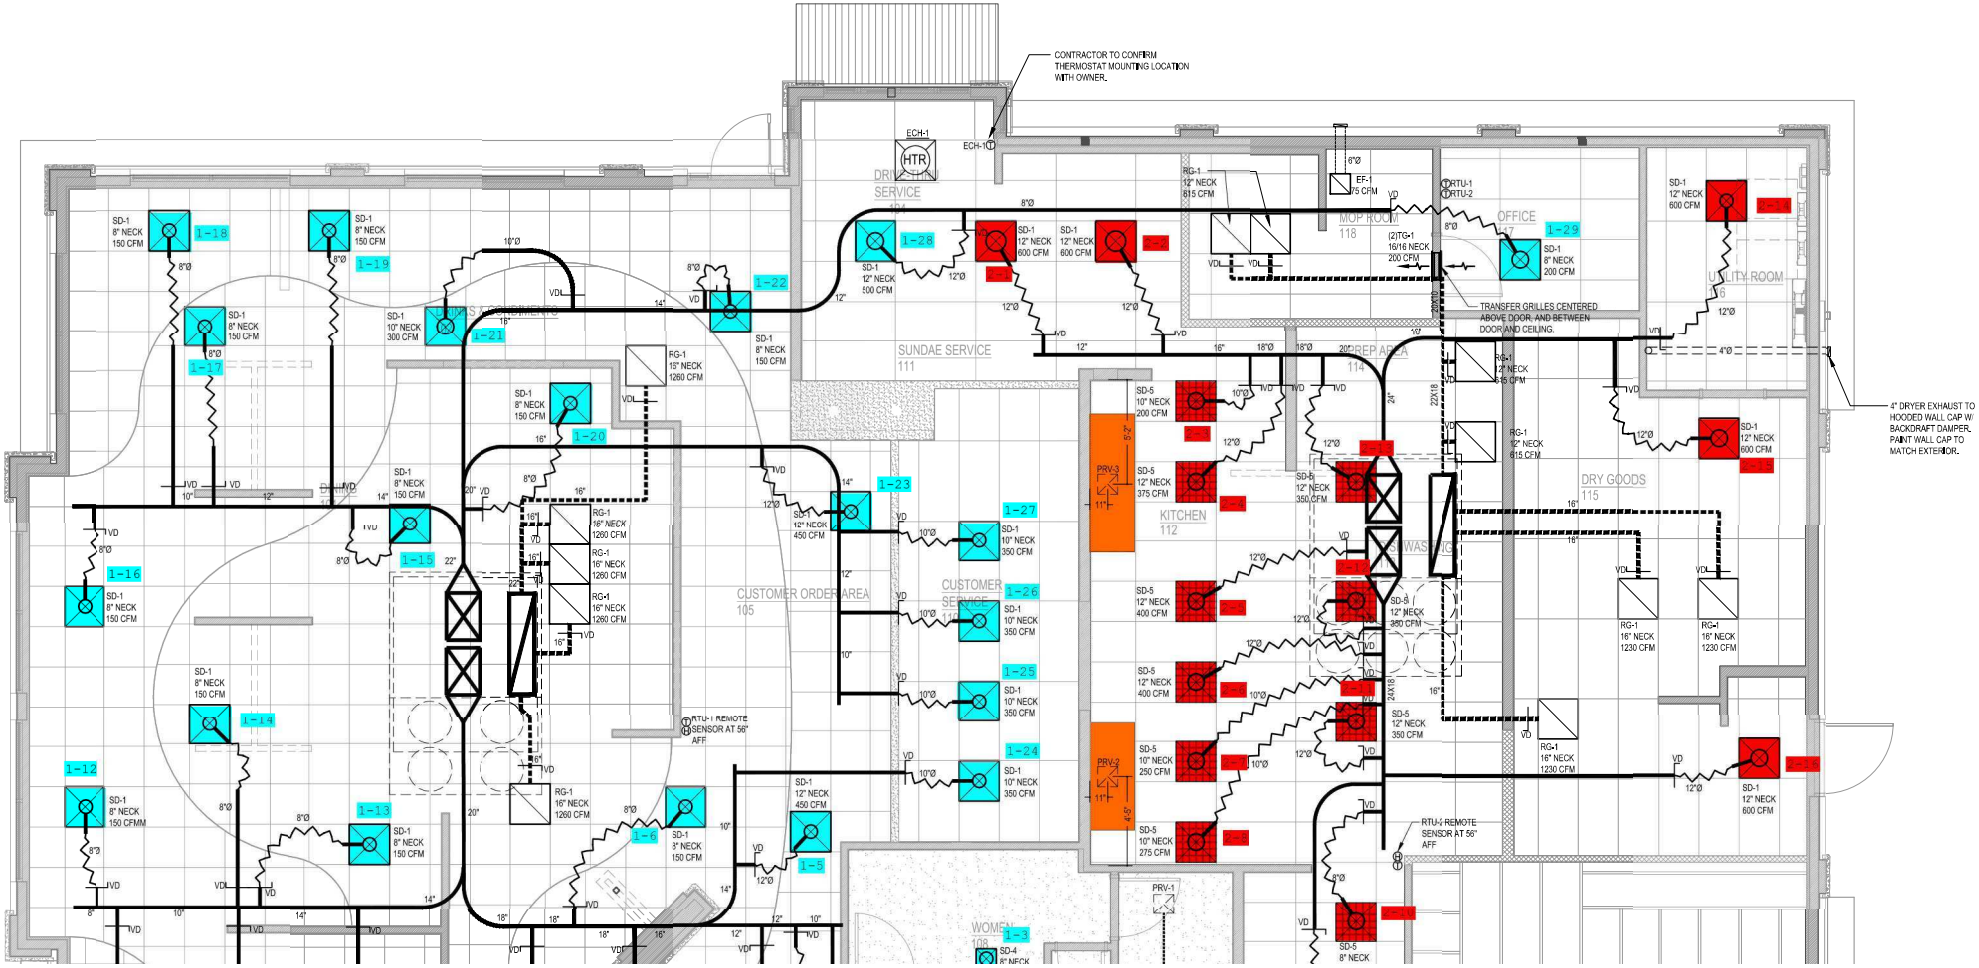
CONTRACTOR TO CONFIRM THERMOSTAT MOUNTING LOCATION WITH OWNER.
ECH-1
HTR
DRIVE THRU SERVICE 104
SUNDAE SERVICE 111
MOP ROOM 118
OFFICE 117
UTILITY ROOM 116
PREP AREA 114
KITCHEN 112
DRY GOODS 115
CUSTOMER ORDER AREA 105
CUSTOMER SERVICE 110
WOMEN 108
PRV-1
PRV-2
PRV-3
EF-1
RTU-1
RTU-2
12/TG-1 16/16 NECK 200 CFM
TRANSFER GRILLES CENTERED ABOVE DOOR AND BETWEEN DOOR AND CEILING.
4" DRYER EXHAUST TO HOODED WALL CAP W/ BACKDRAFT DAMPER. PAINT WALL CAP TO MATCH EXTERIOR.
RTU-1 REMOTE SENSOR AT 56" AFF
SD-1 8" NECK 150 CFM
SD-1 10" NECK 300 CFM
SD-1 12" NECK 450 CFM
SD-1 12" NECK 600 CFM
SD-1 10" NECK 350 CFM
SD-1 12" NECK 600 CFM
SD-1 8" NECK 200 CFM
SD-5 10" NECK 200 CFM
SD-5 12" NECK 375 CFM
SD-5 12" NECK 400 CFM
SD-5 10" NECK 250 CFM
SD-5 10" NECK 275 CFM
SD-5 12" NECK 350 CFM
RG-1 16" NECK 1260 CFM
RG-1 16" NECK 1230 CFM
RG-1 12" NECK 615 CFM
FG-1 13" NECK 1260 CFM