

DOR TO INSTALL  
 )LENOID VALVE,  
 RE CONTROL, LOW  
 ND SLOPE REFRIGERANT  
 ION SHALL COMPLY WITH  
 SET UNDER THE ROOF  
 LE IN WALK-IN COOLER  
 MANUFACTURER'S

DETAILED IN THE  
 TO INSTALL REFRIGERANT  
 E, TEMPERATURE  
 JW AMBIENT CONTROLS,  
 NT LINES PER  
 ATIONS THROUGH ROOF.

15. INSTALL THE  
 OF THE REMOTE  
 D TO PUBLIC VIEW  
 HE ARCHITECTURAL

.LATION INSTRUCTIONS  
 DRAWINGS.

LED IN THE  
 SE VIROGUARD SYSTEM


PER DETAIL 1/M700.

ATOR WITH REMOTE KEY  
 OR. MOUNT UNIT 60"

PER DETAIL 6/M700. SEE  
 ON. INSTALL UV  
 ON ANY RTU ACCESS  
 E IF OPENED.

MINATION AND OUTSIDE  
 TER COMBUSTION AIR  
 RAWINGS FOR MORE  
 R TERMINATIONS.

OPPOSITE SIDE OF  
 HE DINING ROOM.

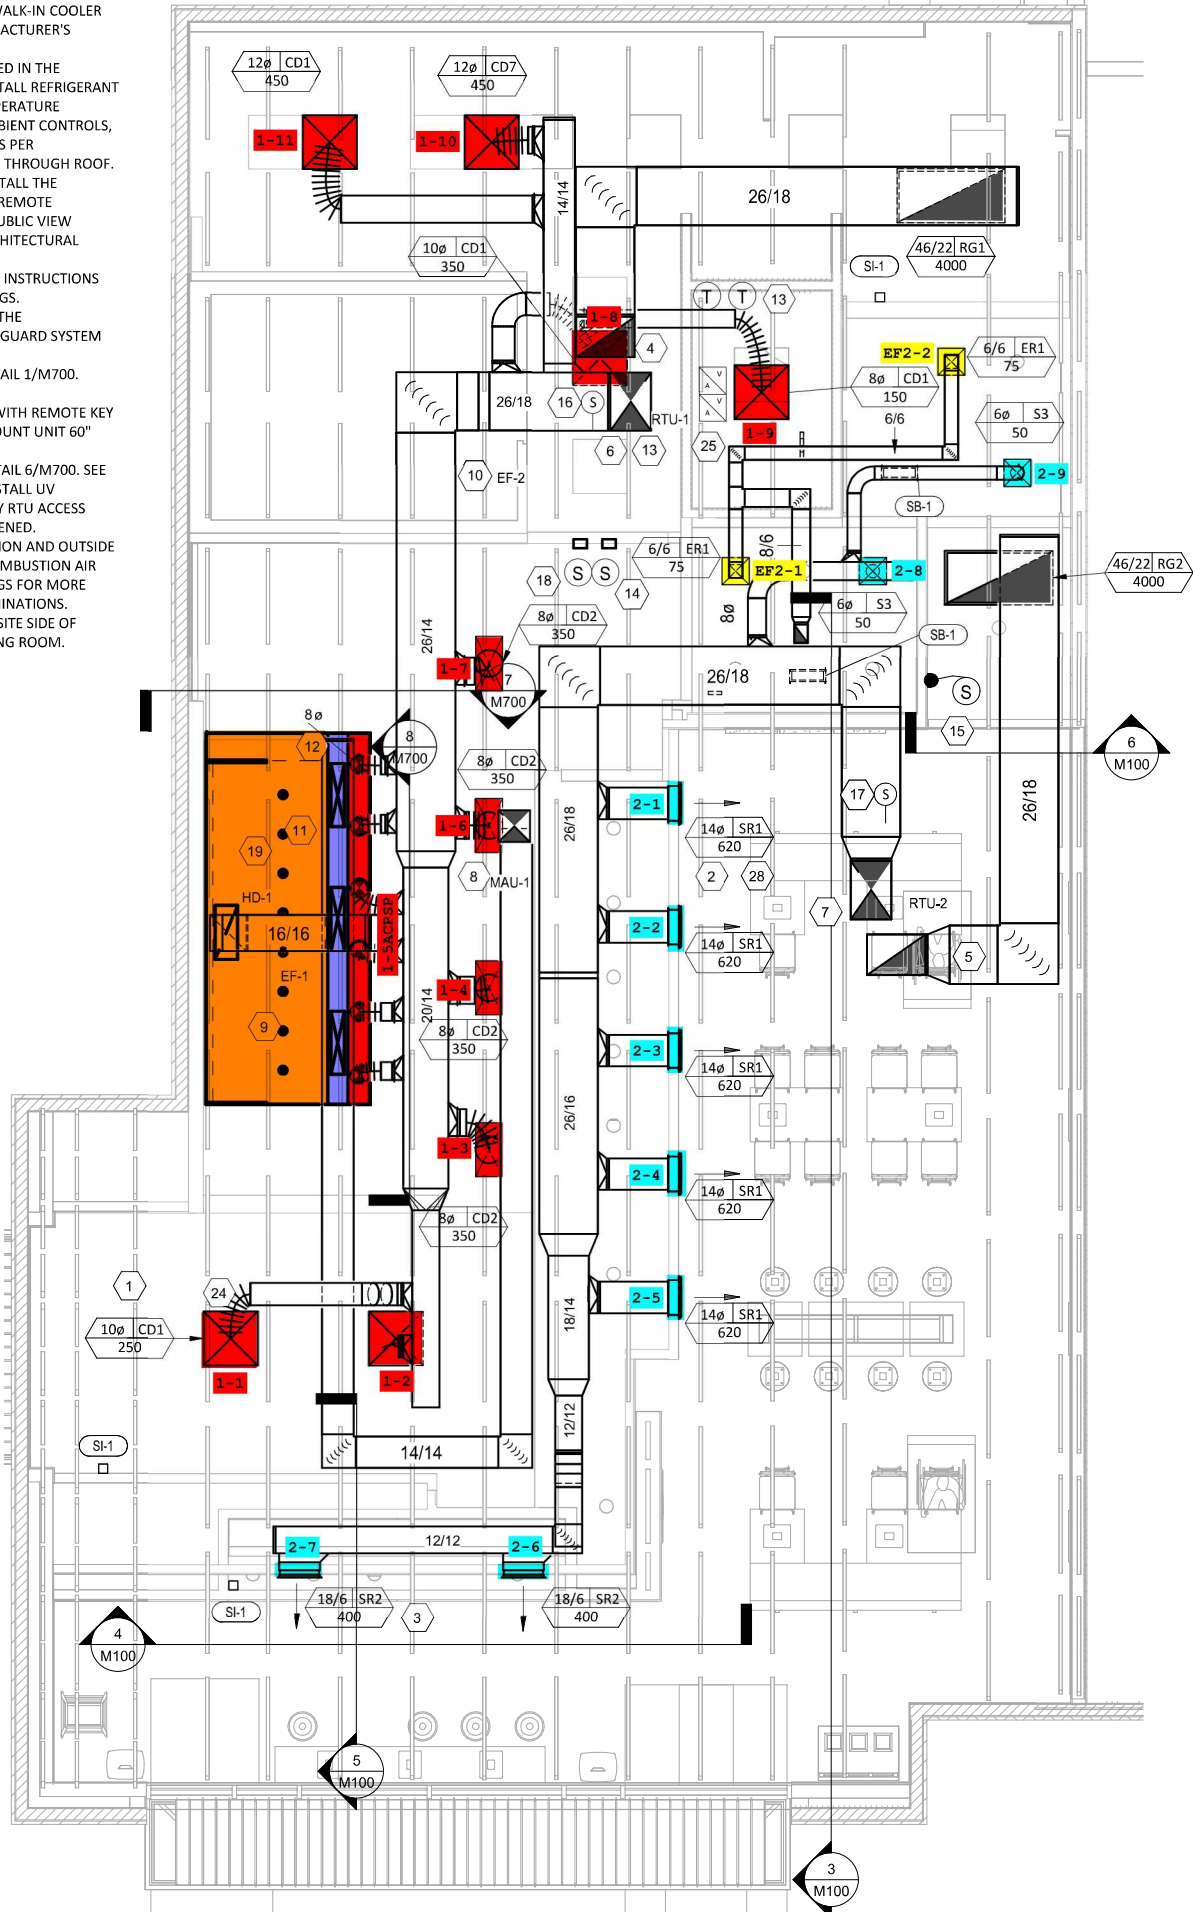

HVAC FLOOR PLAN