

DIAMETER OF 0.5W AT ELBOWS IN

CONNECTIONS.  
48" AFF. COORDINATE WITH  
ACTION BOX). COORDINATE  
ACTION BOX). COORDINATE  
H CONNECTION. PROVIDE  
H CONNECTION. PROVIDE  
PROVIDE (2) #18 G.

ARCHITECTURAL AND  
BUILDING CODE, AND  
ENERGIZE THE EXHAUST AND  
ED WATER AND AIR TIGHT.  
INDEPENDENT TESTING AGENCY FOR



INGS. INSTALL REFRIGERANT  
CONTROL, LOW AMBIENT  
STALLATION SHALL COMPLY  
UNIT. CUT 2-1/2" HOLE IN  
ATER LINE SET IS INSTALLED.  
ALL REFRIGERANT LINE SET,  
OW AMBIENT CONTROLS, AND  
RATIONS THROUGH ROOF.  
WITHIN 3' OF THE REMOTE  
SHOWN IN THE

DO STRUCTURAL DRAWINGS.  
CREASE VIROGUARD SYSTEM

CH SMOKE DETECTOR.

CTION INFORMATION. INSTALL  
WOULD BE VISIBLE IF

BETWEEN WATER HEATER  
ATER FLUE AND COMBUSTION

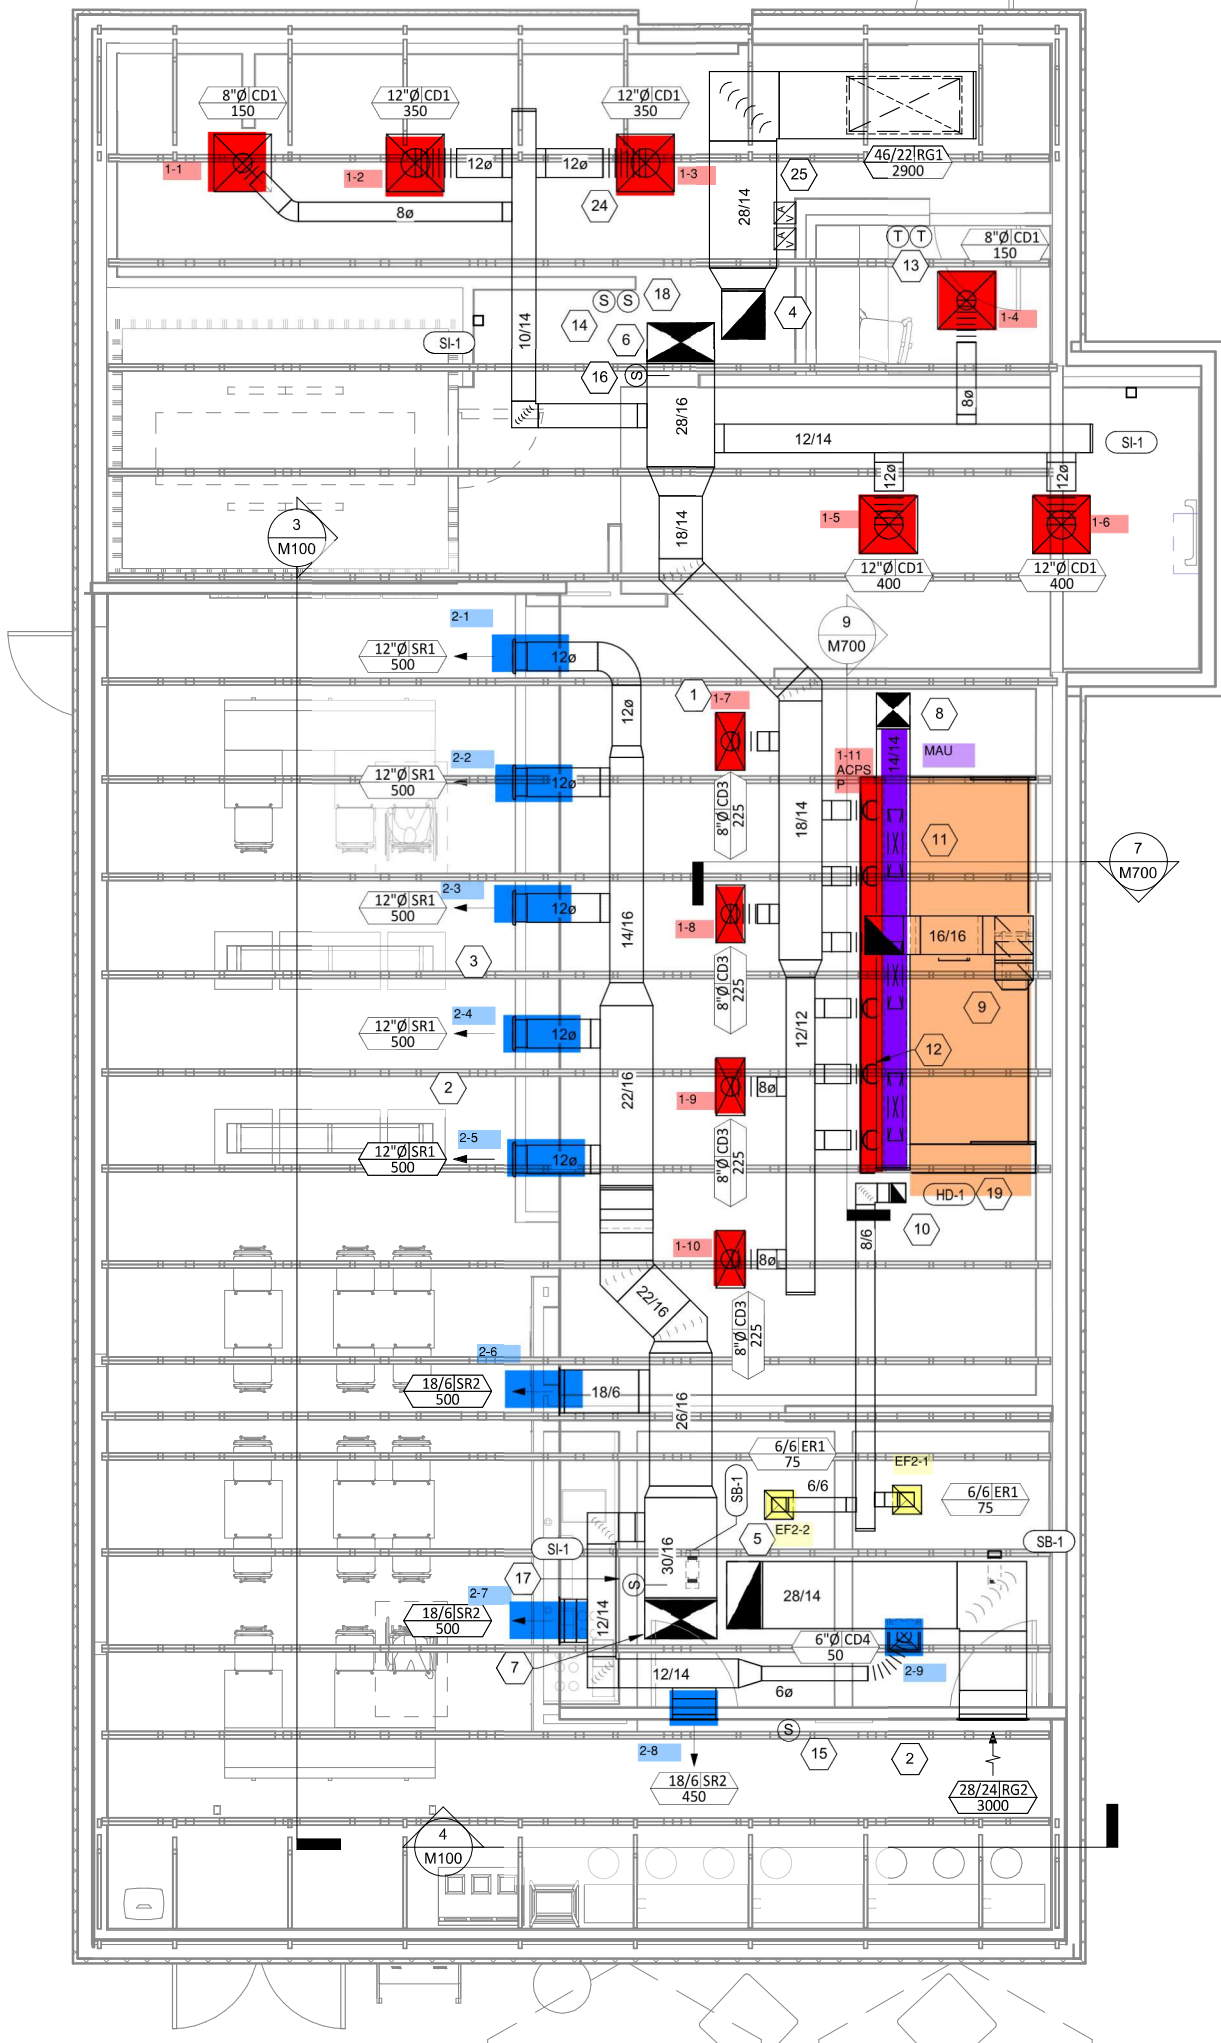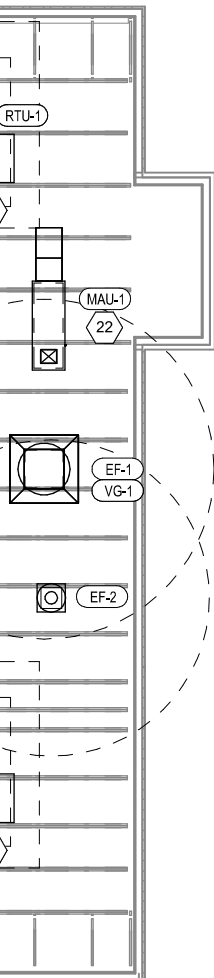

COPY  
THIS  
AND  
CHIP  
USE  
EXTE  
CHIP

Issue R  
05/20  
08/20

# Revision

Drawn  
JEJ

Project  
2301

Center

HV