

WITH AIR HANDLERS TO WITHIN 3' OF THE MAIN LINE SET AND SEAL SET IS INSTALLED.
 ARCHITECTURAL AND EXPANSION VALVE, SOLENOID CONTROL, LOW AMBIENT LINES PER HIGH ROOF. INSTALLATION LINE SET UNDER THE ROOF SERVICE MAKER IS EXPOSED TO ARCHITECTURAL

CTIONS AND AS DETAILED IN


ARCHITECTURAL AND BY CHIPOTLE ON EXHAUST

7000. TYPICAL.
 NOTE KEY OPERATED RESET.

7000. SEE ELECTRICAL TICKERS ON FACE OF THE REME HALO WOULD

OUTSIDE AIR INTAKES, AND EXHAUST FAN EF-1 HEATER FLUE AND

DE OF ROOM AT

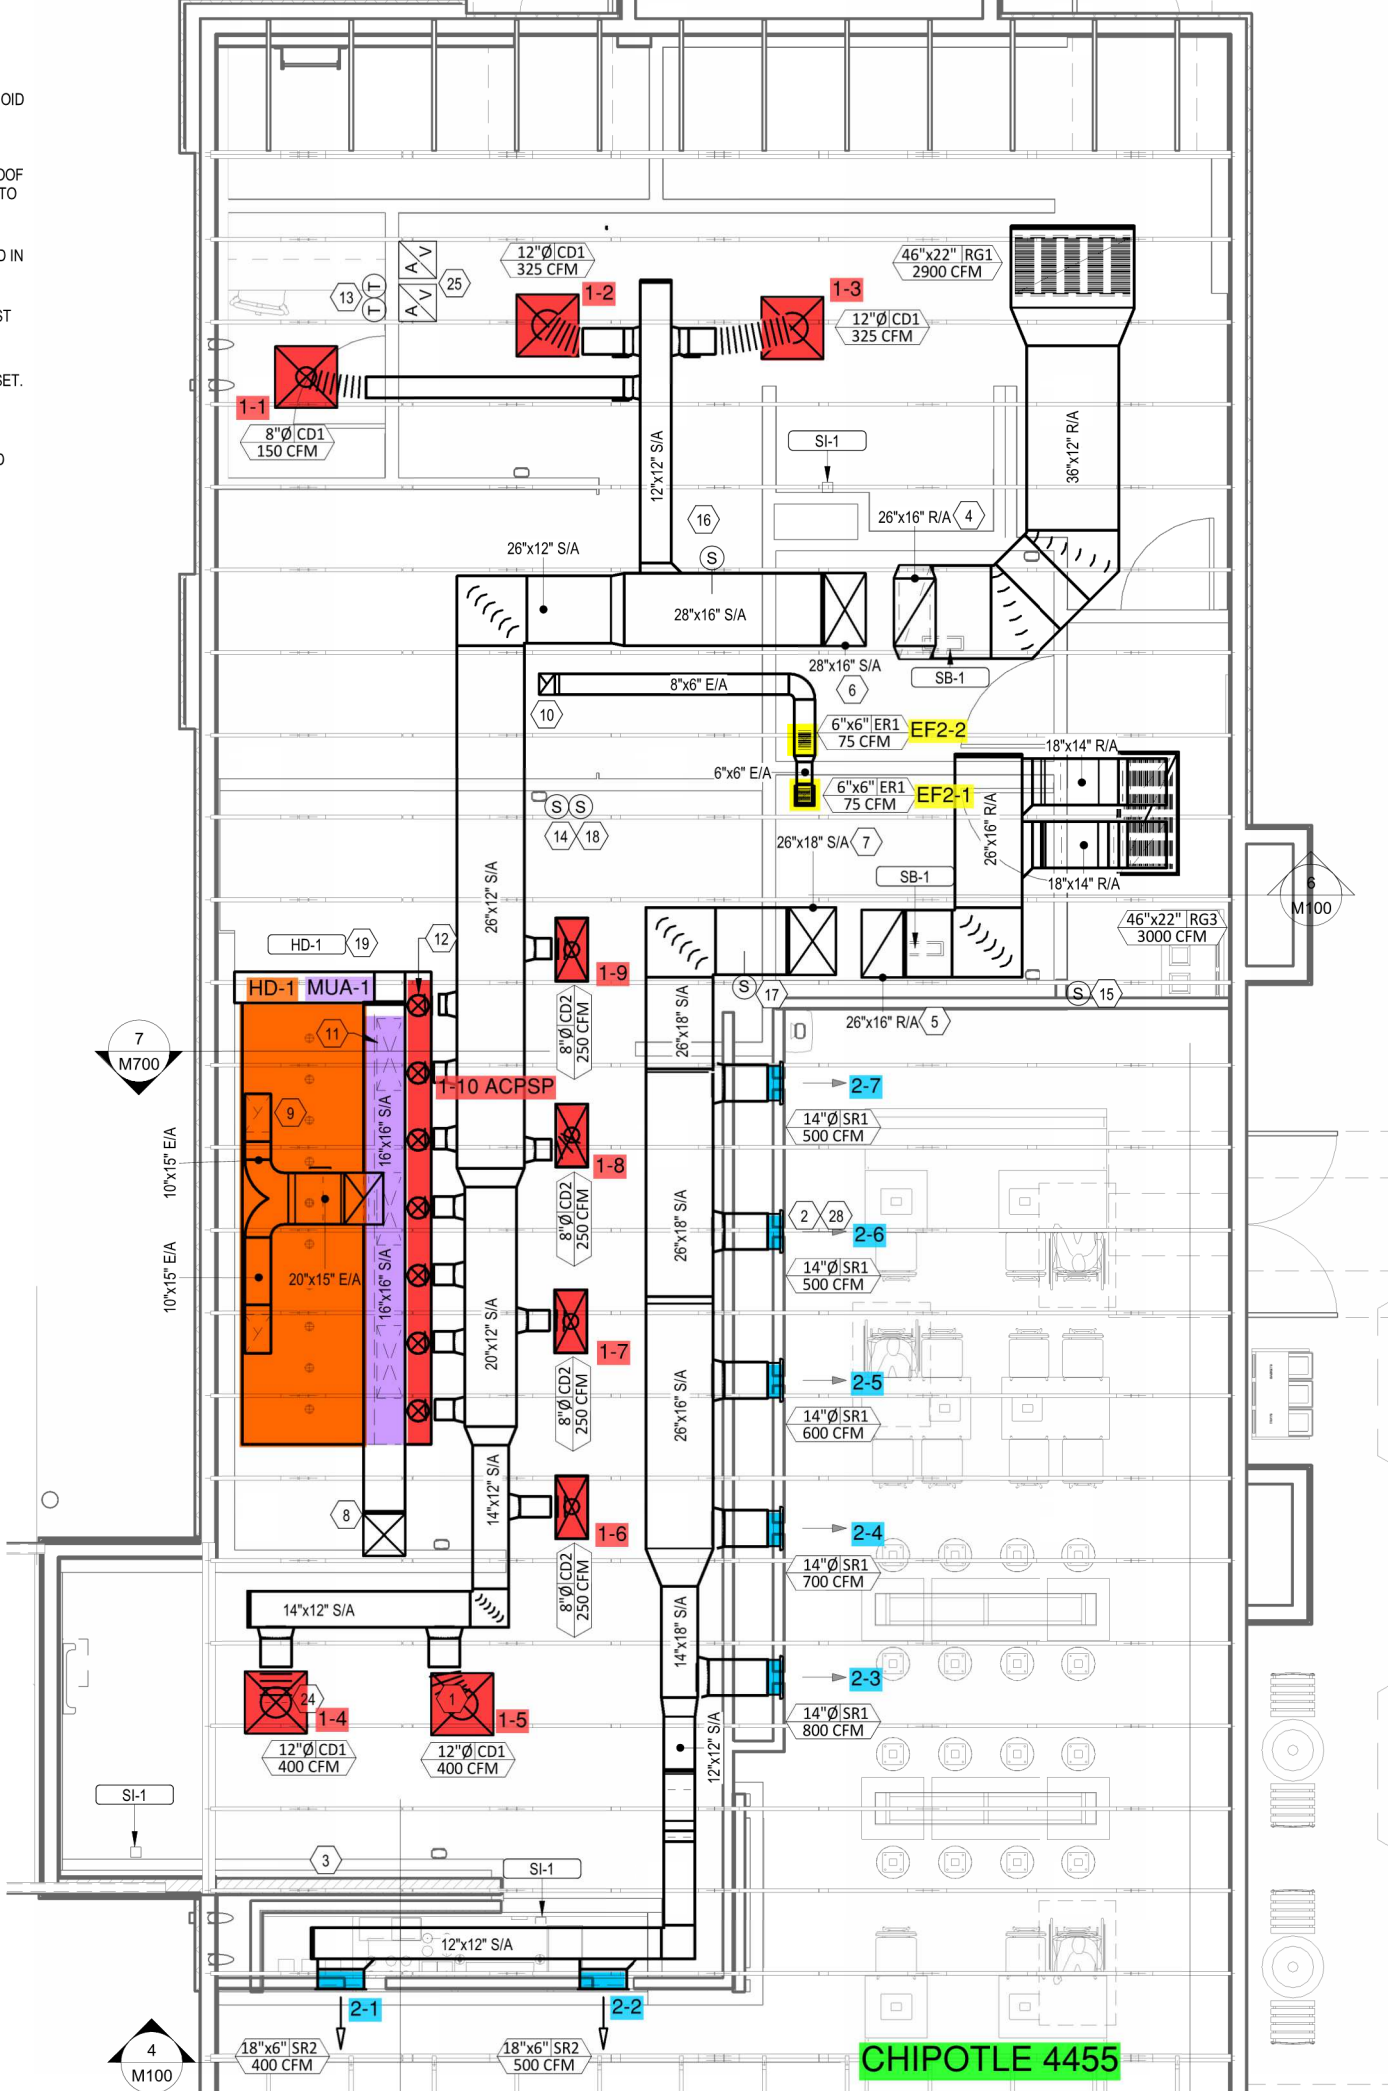

CHIPOTLE 4455