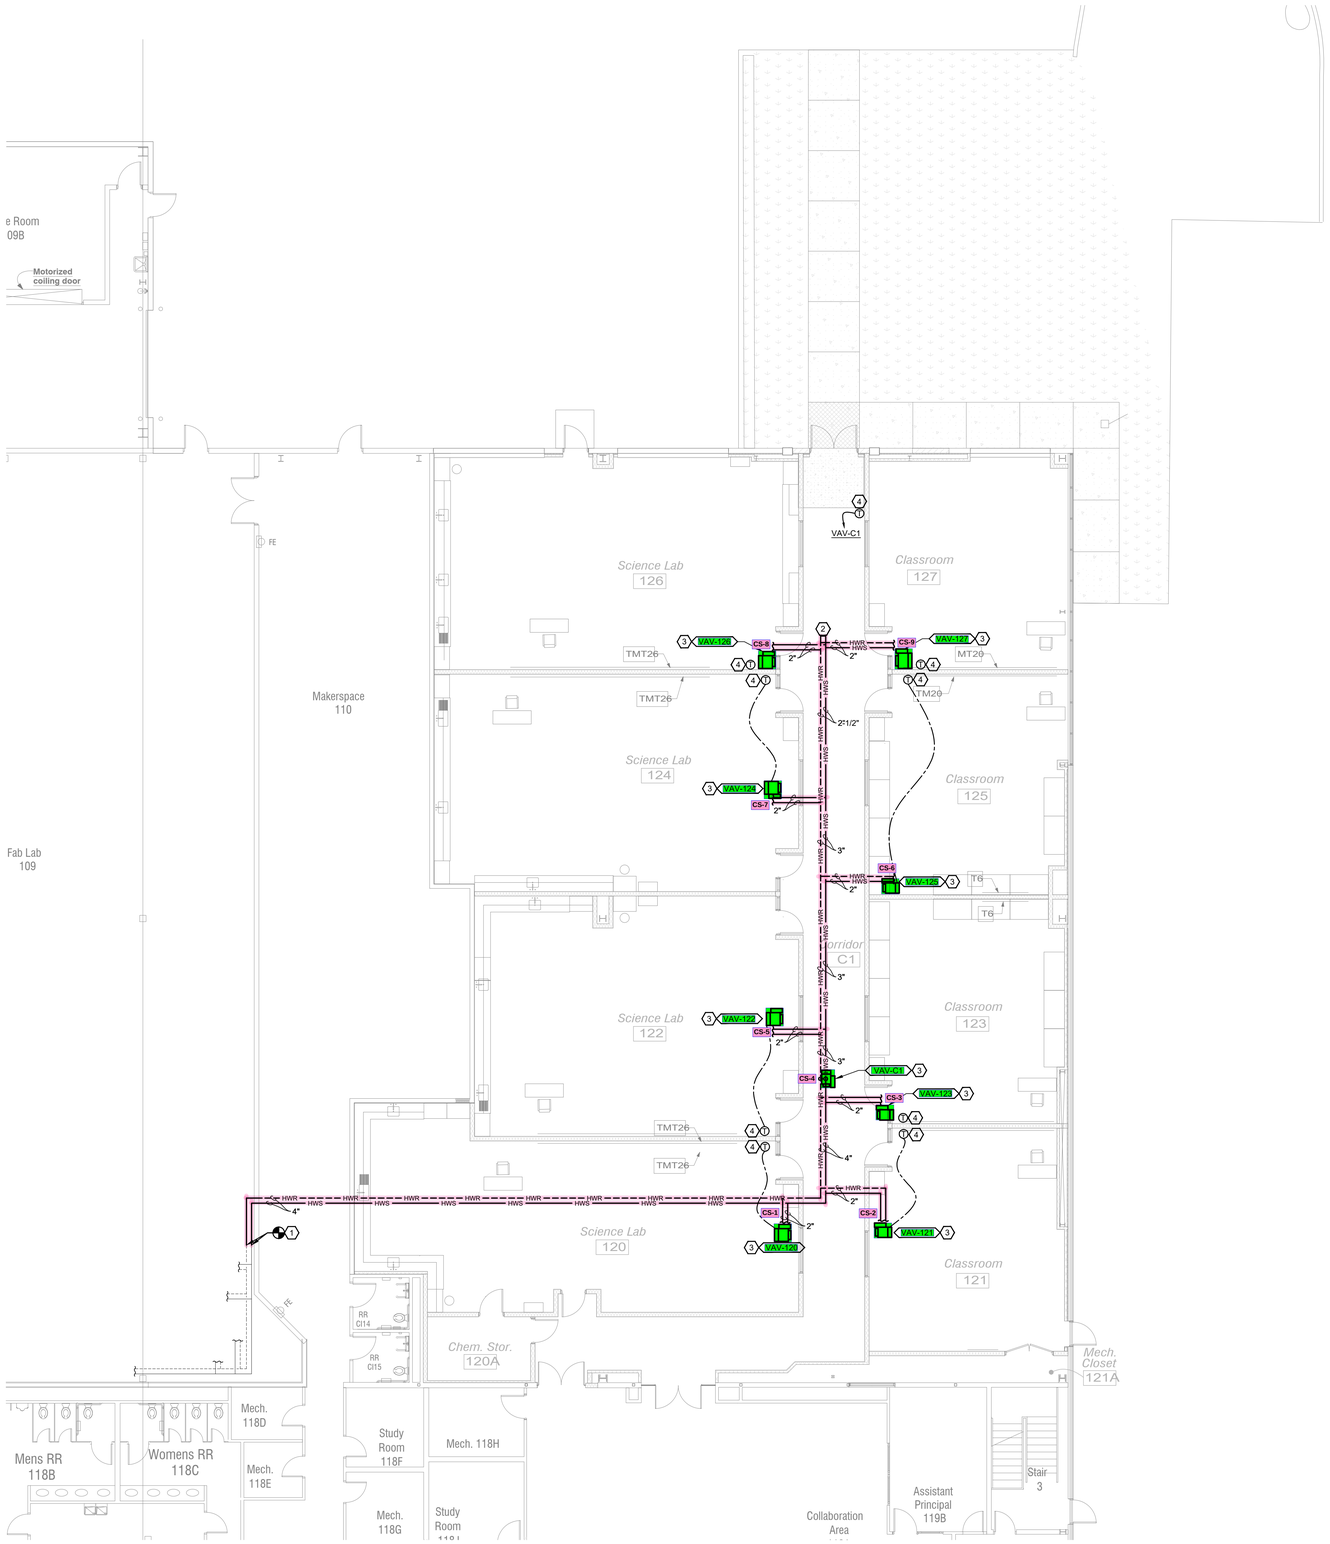

1 FLOOR PLAN - MECH PIPING

SCALE: 1/8"=1'-0"

GENERAL NOTES:

A. REFER TO SHEET M0.1 FOR GENERAL NOTES.

B. ALL CONTROL WIRING SHALL BE ROUTED IN CONDUIT.

SHEET KEYNOTES:

1. CONNECT NEW HOT WATER PIPE TO EXISTING AND ROUTE ABOVE CEILING TO MAKE CONNECTIONS TO NEW VAV EQUIPMENT.
2. END OF LINE BYPASS DETAIL.
3. MAKE CONNECTIONS AS NECESSARY TO VAV BOX - HOT WATER COIL.
4. THERMOSTAT TO BE INSTALLED AT 48" AFF. PROVIDE CONTROL WIRING TO ASSOCIATED EQUIPMENT.

KEYPLAN



SHROUT TATE MECHANICAL AND ELECTRICAL ENGINEERS WILSON

Lexington – Louisville – Charleston

www.stweng.com

BID DOCUMENTS

STATE OF KENTUCKY • PROFESSIONAL ENGINEER • 01/08/24

Ignite Institute Renovations

Erlanger, Kentucky

Boone Co. Board of Education

Matt Turner - Superintendent

SHEET TITLE

FLOOR PLAN - MECH PIPING

BG # 23-468

REH # 129-423

DATE 02/08/2024

M2.1