


ISSUES

1	05/31/2024	ISSUE FOR PERMIT
2		
3		
4		
5		
6		
7		
8		
9		
10		

REVISIONS

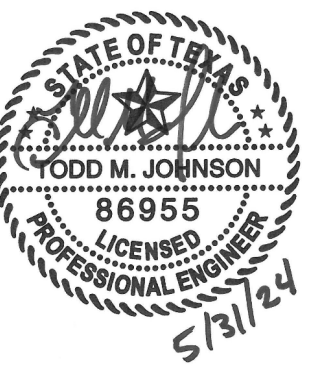

GENERAL NOTES:

REFERENCE IM02-17A AND IM02-17B FOR RETURN AIR BOOT SIZES AND RETURN AIR SIDEWALL GRILLE SIZES


ALL THERMOSTATS TO 5 DEGREE DEAD BAND.

DUCTWORK TAGGED XX'Y' XX" Ø EQUATES TO PAINT GRADE SPIRAL FLAT OVAL DUCT.

CONTRACTOR TO COORDINATE WITH EXISTING BUILDING STOCK OF TERMINAL UNITS FOR PURCHASE PRIOR TO PURCHASE OF NEW UNITS.

KEYED NOTES - SHEET IM02-07A


- 1 PROVIDE ALTERNATE PRICE TO PROVIDE SOUND INSULATION BLANKET SYSTEM EQUAL TO BRD HUSHCORE FOR FAN POWERED BOX. IF SELECTED, COORDINATE FABRIC COLOR WITH ARCHITECT.
- 2 PROVIDE FULL SIZE INLET FAN SOUND ATTENUATOR FOR FAN POWERED BOX.
- 3 PROVIDE PAINT GRADE SHEET METAL COVER FOR EXISTING DUCTWORK. REF IM05-01 FOR DETAIL.
- 4 ALL CONTROL WIRING MUST BE IN CONDUIT.
- 5 PROVIDE INSULATION PAD TO BE INSTALLED BETWEEN THERMOSTAT AND PERIMETER WALL FOR THERMOSTATS MOUNTED ON EXTERIOR COLUMN WALLS.
- 6 ROOM ONLY CONTAINS 1 COPIER.
- 7 ACCESS ON BOTTOM.
- 8 PROVIDE EQUAL SPACING ON ALL SIDEWALL GRILLES.
- 9 EXISTING LOCATION OF TERMINAL BOX TO BE RELOCATED/REMOVED. REMOVE EXISTING MEDIUM AND LOW PRESSURE DUCTWORK AS INDICATED ON DRAWINGS.
- 10 PROVIDE SYSTEM TO NOTIFY BUILDING AUTOMATION SYSTEM AND TO DIAL MNS.
- 11 NEW LOCATION OF TERMINAL BOX. MOUNT BOX FROM STRUCTURE ABOVE. ENSURE BOX CLEARANCES ARE MAINTAINED AT NEW LOCATION. EXTEND NEW MEDIUM AND LOW PRESSURE DUCT AS INDICATED ON DRAWINGS. COORDINATE RELOCATION WITH OTHER TRADES INVOLVED.
- 12 PROVIDE UNIT WITH INTEGRATED SUPPLY AND RETURN GRILLE.
- 13 INSULATED CONDENSATE DRAIN PIPING ABOVE CEILING. EXTEND AND DISCHARGE TO NEAREST JANITORS MOP SINK. CONDENSATE PIPING SHOWN OFF WALL FOR CLARITY ONLY. ALL PIPING SHALL BE INSTALLED AS HIGH AS POSSIBLE.

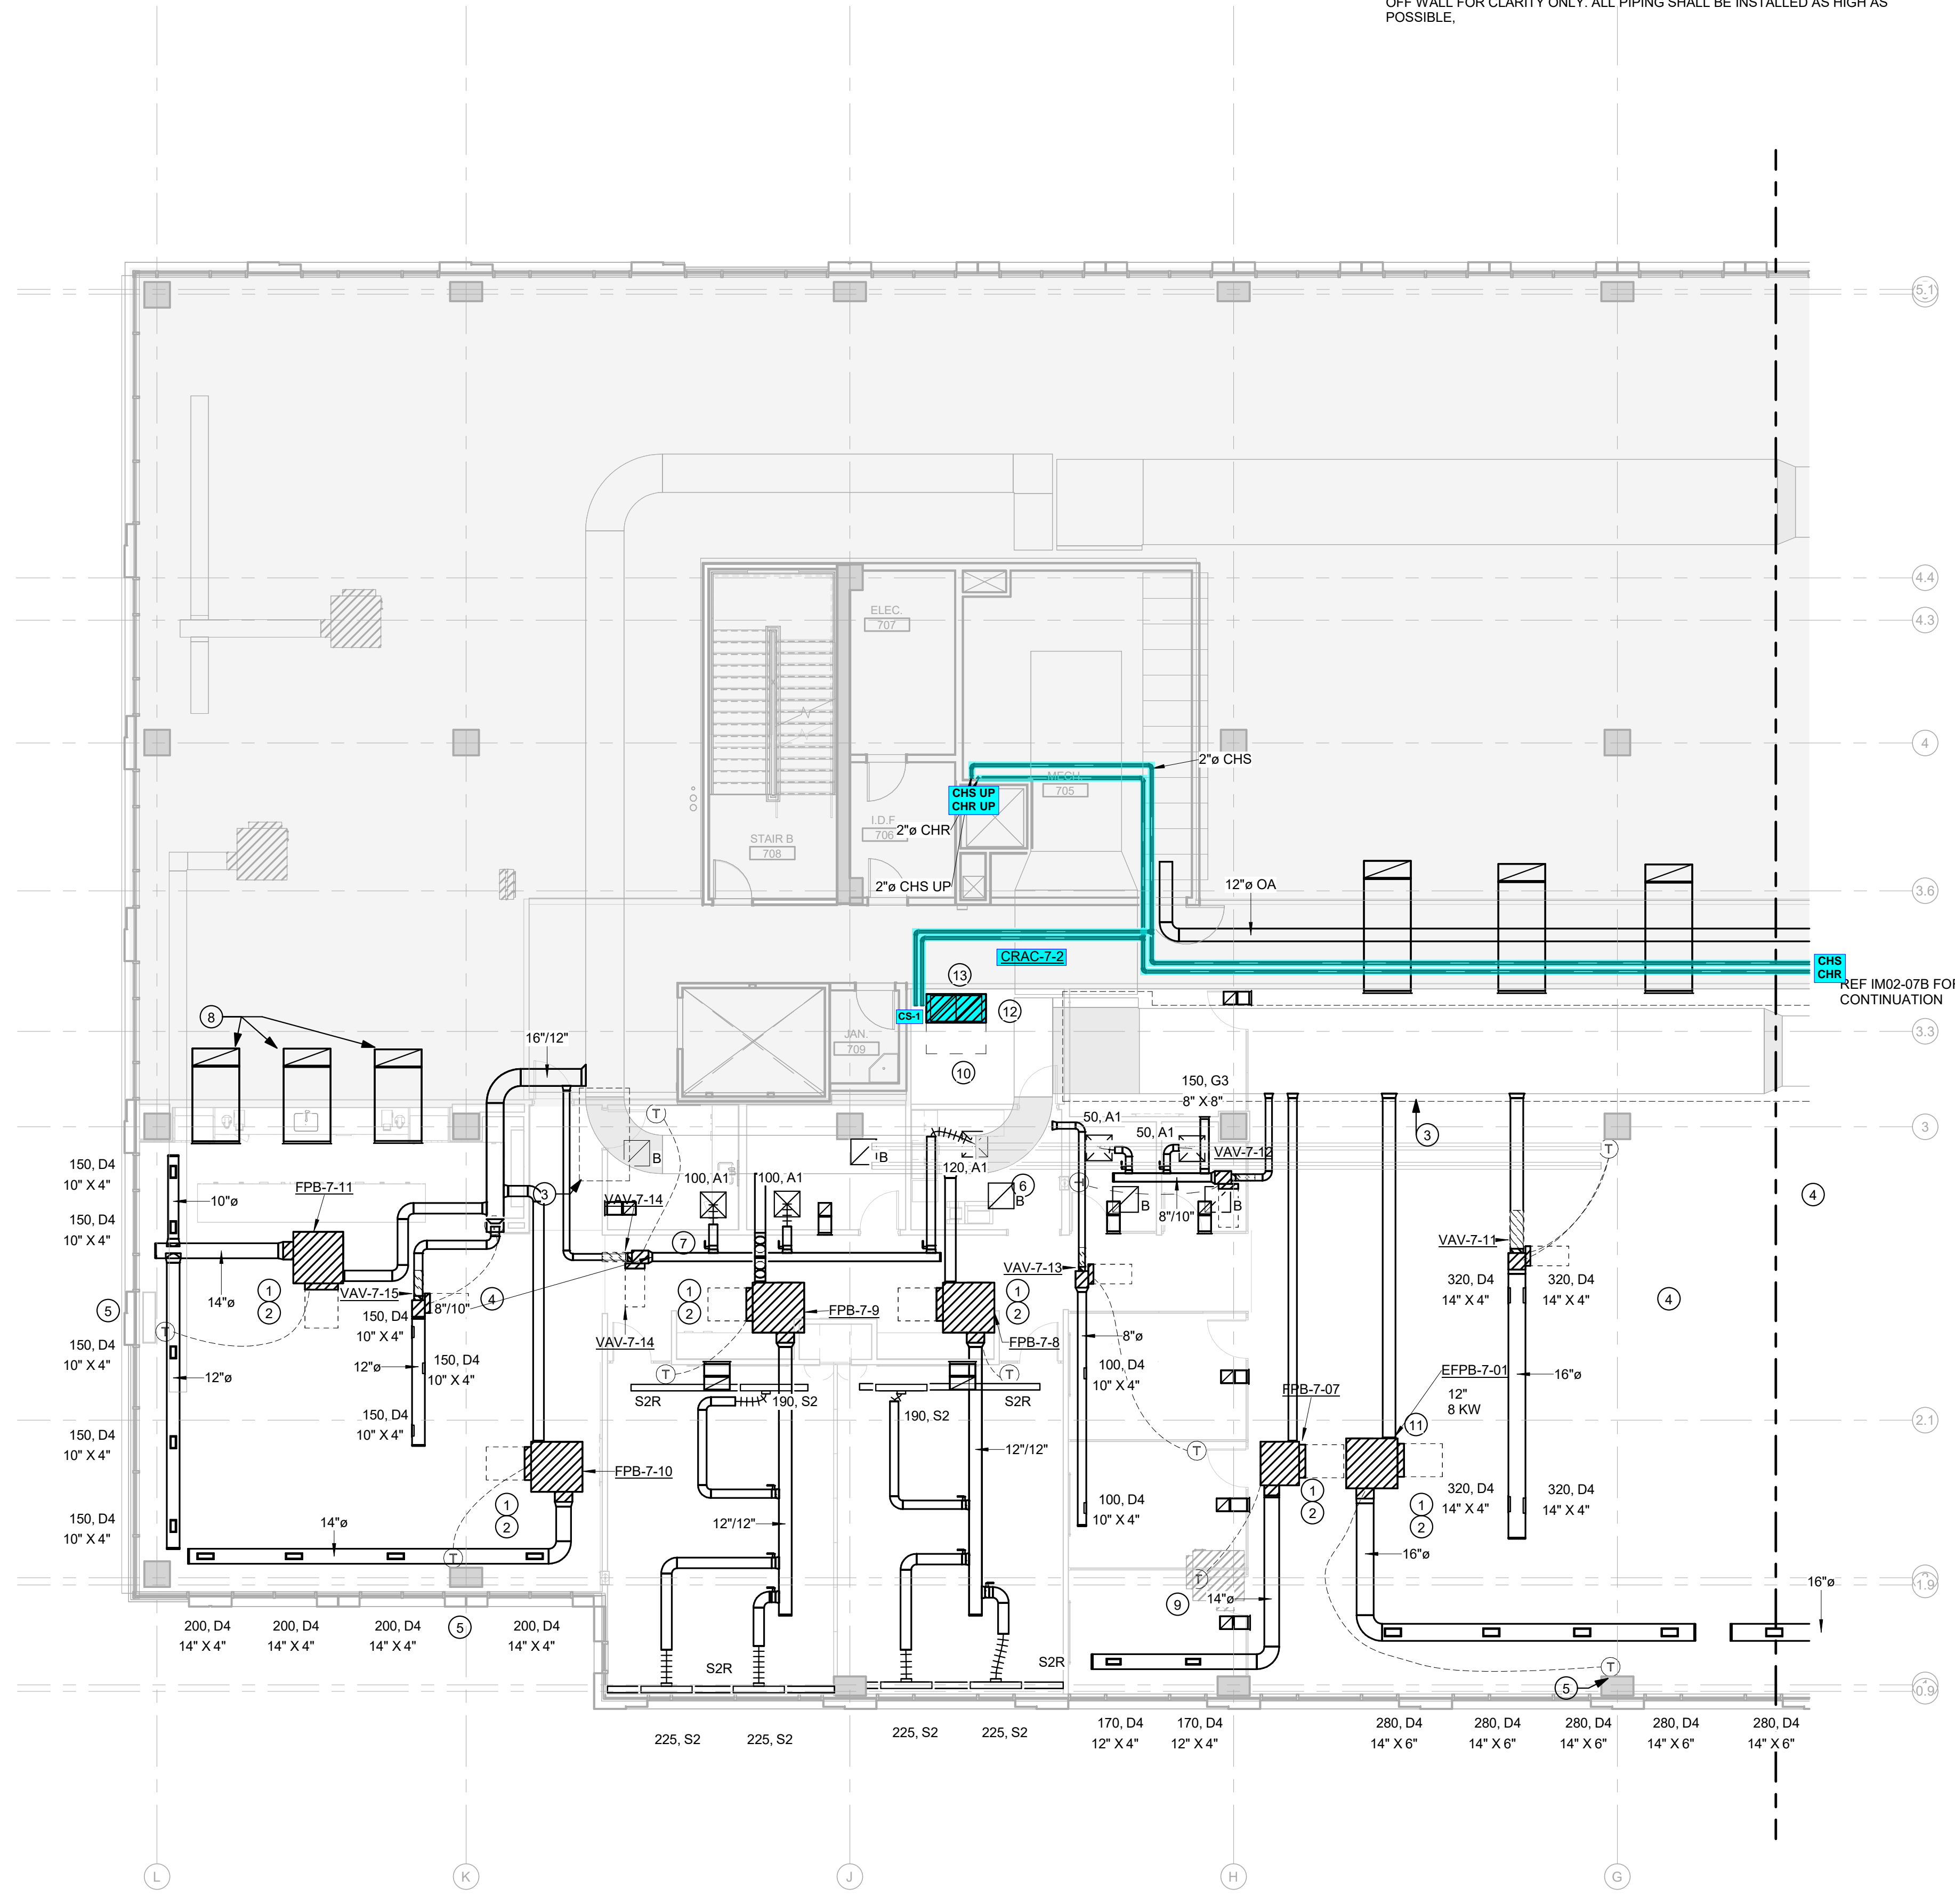

1 LEVEL 7 MECHANICAL PLAN - SEGMENT A
1/8" = 1'-0"

MN8 Energy
2999 Olympus Boulevard, Suite 700, Coppell TX 75019

KEYPLAN

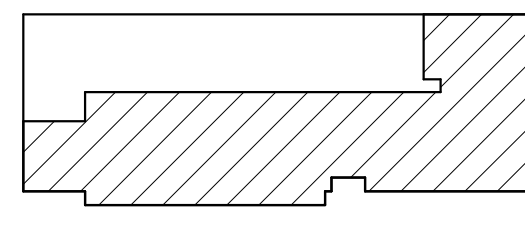

LEVEL 7
MECHANICAL
PLAN - SEGMENT
A

© 2024 Purdy - McGuire
Mechanical - Electrical Engineers
Suite 200
17300 North Dallas Parkway
Dallas, TX 75248-1147
PFD Registration # P-1511
Tel: 972-239-5307
Fax: 972-239-5231
www.purdy-mcguire.com

PM: JOB NO. 23115.001
PROJECT MGR. C. BARTON, B. JARRETT
MECHANICAL L. GIBBON, C. BURGESS
ELECTRICAL C. KARRIE
PLUMBING T. ZANGLINSKI
MECHANICAL C. KARRIE
ELECTRICAL T. ZANGLINSKI

JOB 23422.0000
DATE 05.31.2024
SHEET

IM02-07A

ISSUES

1	05/31/2024	ISSUE FOR PERMIT
2		
3		
4		
5		
6		
7		
8		
9		
10		

REVISIONS

KEYED NOTES - SHEET IM02-07B

- 1 PROVIDE ALTERNATE PRICE TO PROVIDE SOUND INSULATION BLANKET SYSTEM EQUAL TO BRD HUSHCORE FOR FAN POWERED BOX. IF SELECTED, COORDINATE FABRIC COLOR WITH ARCHITECT.
- 2 PROVIDE FULL SIZE INLET FAN SOUND ATTENUATOR FOR FAN POWERED BOX
- 3 PROVIDE PAINT GRADE SHEET METAL COVER FOR EXISTING DUCTWORK. REF IM05-01 FOR DETAIL.
- 4 ALL CONTROL WIRING MUST BE IN CONDUIT
- 5 RELOCATE EXISTING UNIT HEATER
- 6 ROOM ONLY CONTAINS 1 COPIER
- 7 PROVIDE INSULATION PAD TO BE INSTALLED BETWEEN THERMOSTAT AND PERIMETER WALL FOR THERMOSTATS MOUNTED ON EXTERIOR COLUMNWALLS.
- 8 ACCESS ON BOTTOM
- 9 PROVIDE NERC COMPLIANT SECURITY MESH FOR DUCTWORK CROSSING INTO THE COMMAND CENTER
- 10 EXISTING LOCATION OF TERMINAL BOX TO BE RELOCATED/REMOVED. REMOVE EXISTING MEDIUM AND LOW PRESSURE DUCTWORK AS INDICATED ON DRAWINGS.
- 11 OFFSET DUCT TO AVOID CEILING
- 12 INSULATED CONDENSATE DRAIN PIPING ABOVE CEILING. EXTEND AND DISCHARGE TO NEAREST JANITORS MOP SINK. CONDENSATE PIPING SHOWN OFF WALL FOR CLARITY ONLY. ALL PIPING SHALL BE INSTALLED AS HIGH AS POSSIBLE.
- 13 INTEGRATE OPERATION OF OAF 7-1 AND EDH 7-3 WITH FCU 7-1 AND FCU 7-2 OPERATION.


GENERAL NOTES:

REFERENCE IM02-17A AND IM02-17B FOR RETURN AIR BOOT SIZES AND RETURN AIR SIDEWALL GRILLE SIZES

ALL THERMOSTATS TO 5 DEGREE DEAD BAND.

DUCTWORK TAGGED XX' XX" Ø EQUATES TO PAINT GRADE SPIRAL FLAT OVAL DUCT

CONTRACTOR TO COORDINATE WITH EXISTING BUILDING STOCK OF TERMINAL UNITS FOR PURCHASE PRIOR TO PURCHASE OF NEW UNITS.

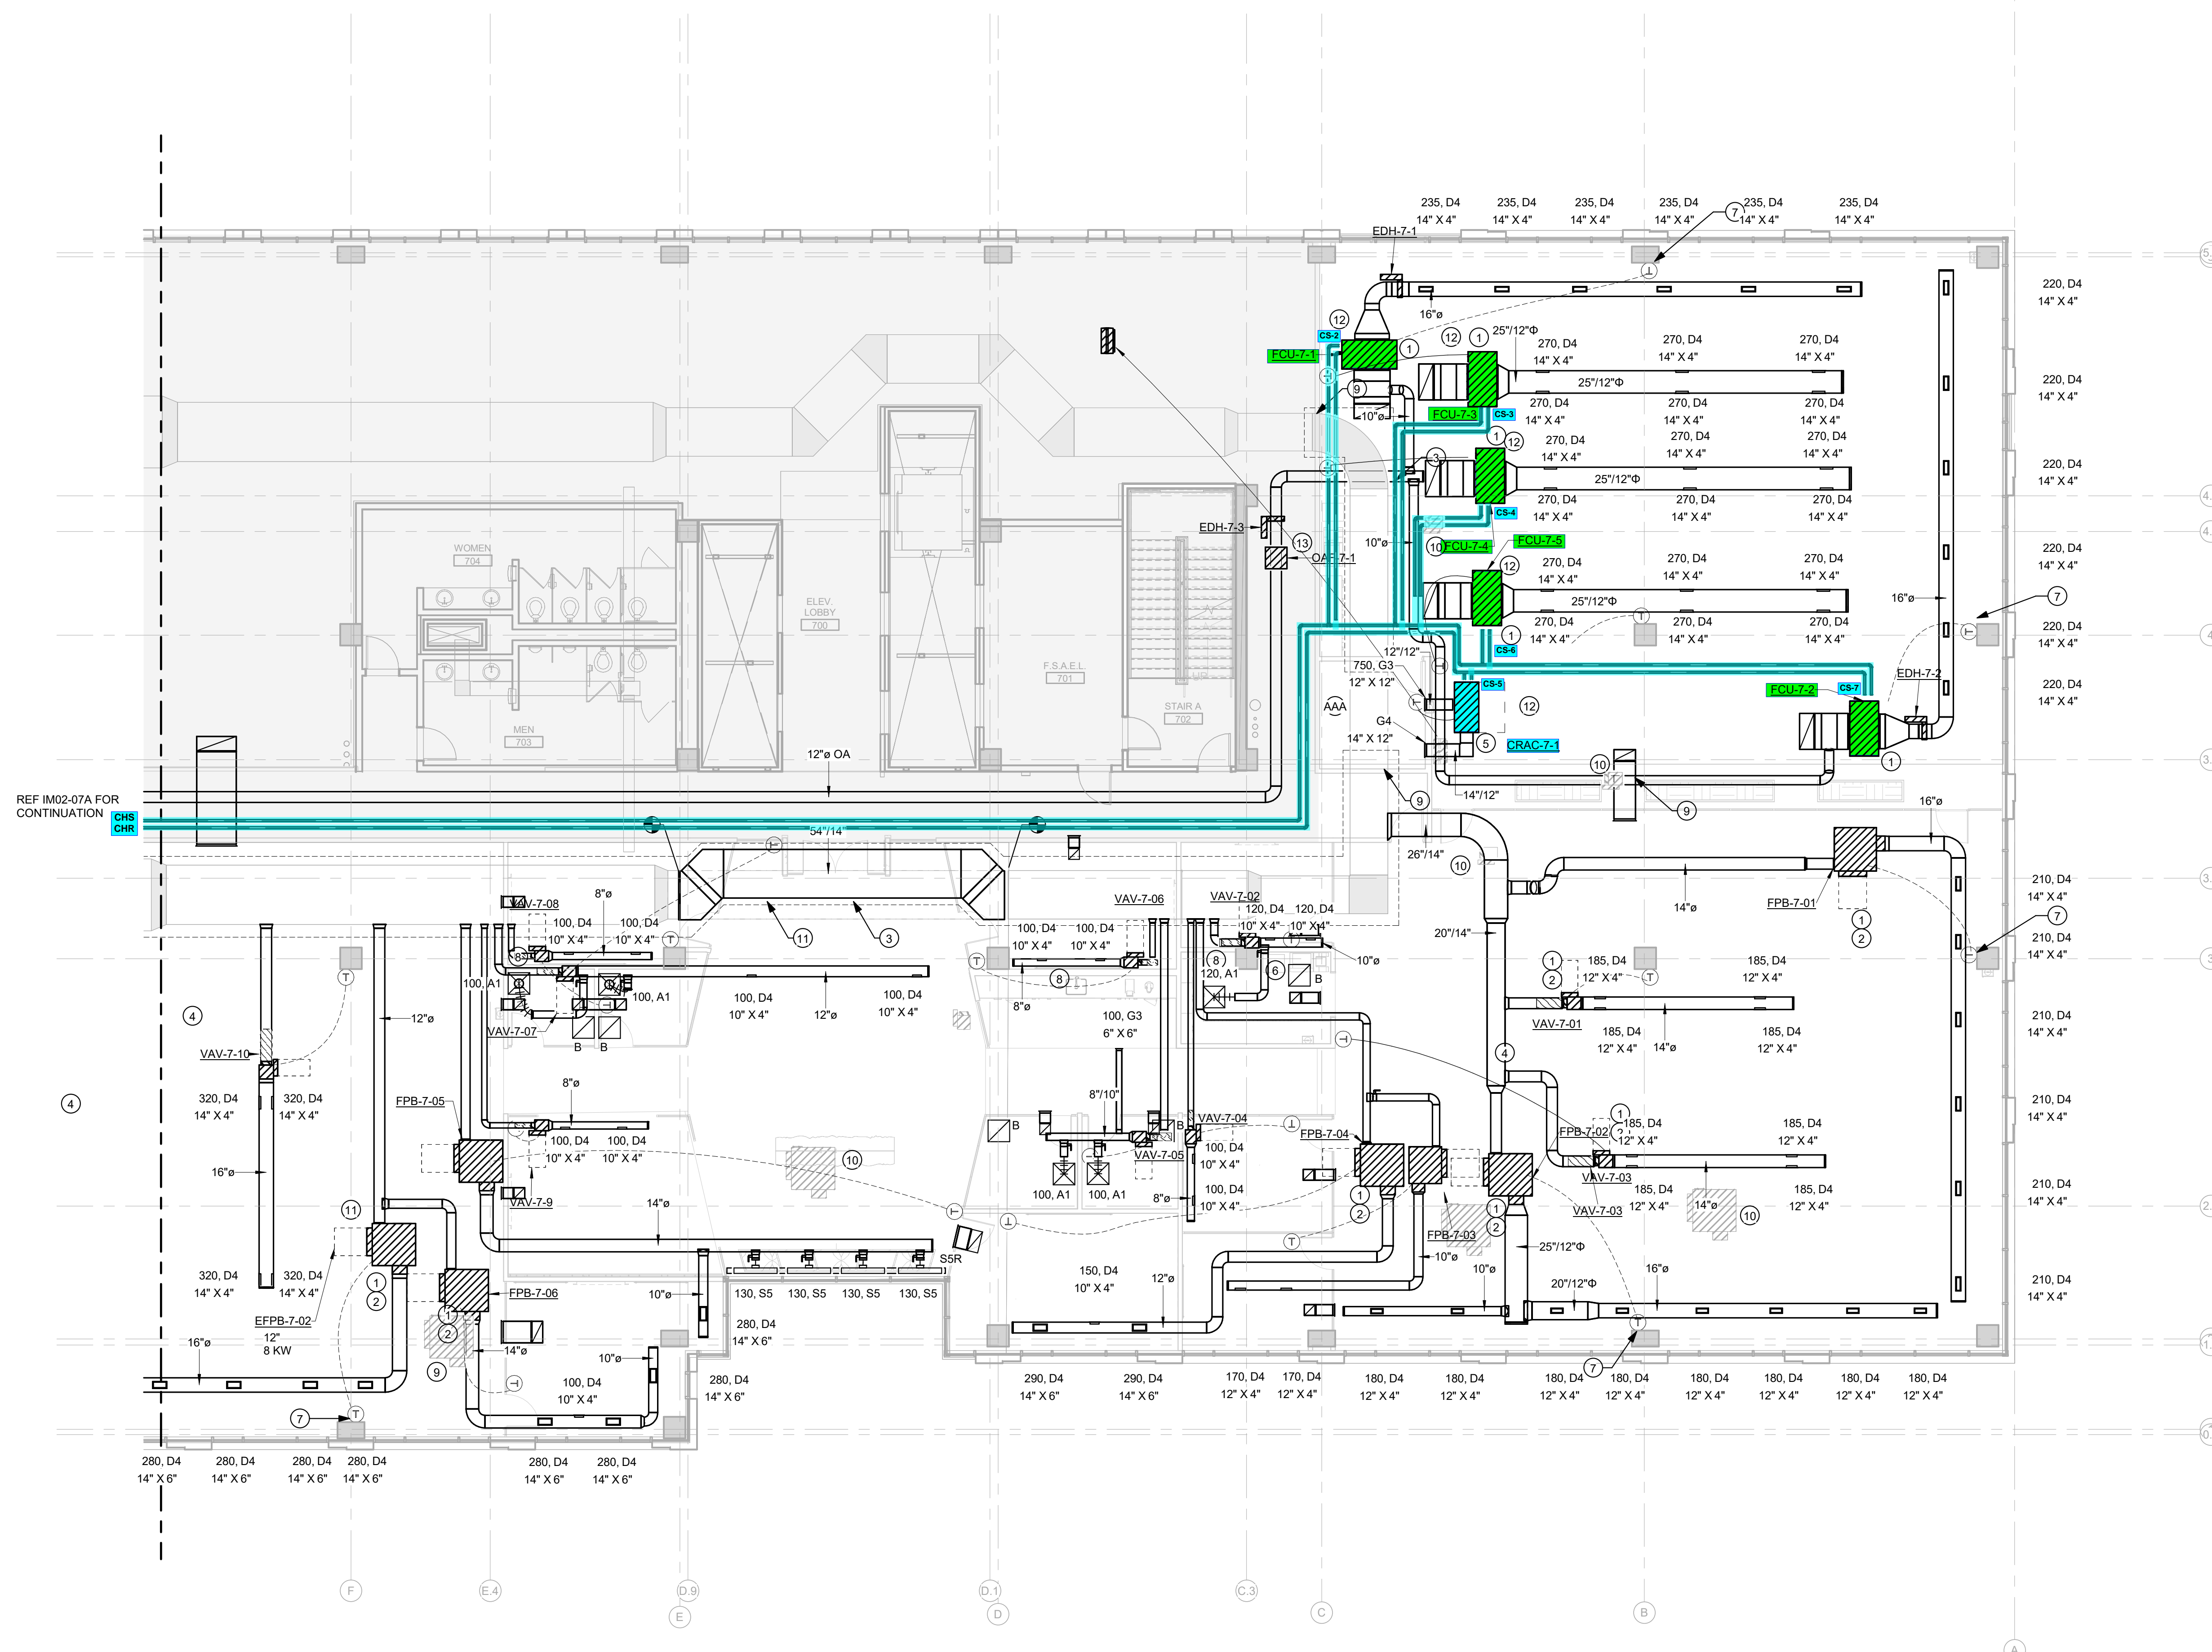


1 LEVEL 7 MECHANICAL PLAN - SEGMENT B
1/8" = 1'-0"




MN8 Energy
2999 Olympus Boulevard, Suite 700, Coppell TX 75019

KEYPLAN

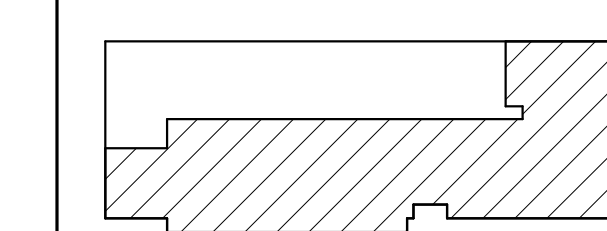

LEVEL 7 MECHANICAL PLAN - SEGMENT B

© 2024 Purdy - McGuire
Mechanical/Electrical Engineers
17300 North Dallas Parkway
Suite 200
Dallas, TX 75248-1147
P.E. Registration # P-1511
Tel: 972-239-5327
Fax: 972-239-5231
www.purdy-mcguire.com



PM: JOB NO. 23115.001
PROJECT MGR. C. BARTON & J. ARRETT
MECHANICAL L. GIBBERN & C. BURGESS
ELECTRICAL C. KARRIS
PLUMBING L. ZANJULINSKI
Piping Design: J. ZANJULINSKI
THIS DRAWING SHALL NOT BE REPRODUCED FOR ANY PROJECT OTHER THAN THE PROJECT NOTED IN THE TITLE BLOCK, WITHOUT THE WRITTEN CONSENT OF PURDY-MCGUIRE, INC. DALLAS, TX.

JOB 23422.0000
DATE 05.31.2024
SHEET


IM02-07B

5/31/2024 9:55:23 AM IM02-07B/LEVEL 7 MECHANICAL PLAN - SEGMENT B


ISSUES

1	05/31/2024	ISSUE FOR PERMIT
2		
3		
4		
5		
6		
7		
8		
9		
10		

REVISIONS

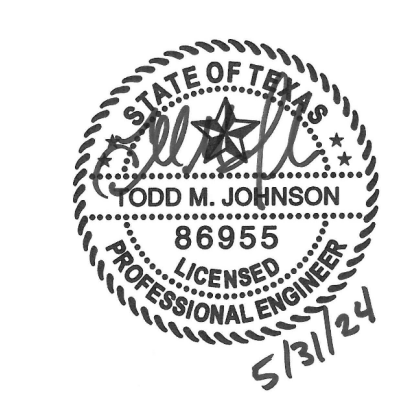


MN8 Energy
2999 Olympus Boulevard, Suite 700, Coppell TX 75019

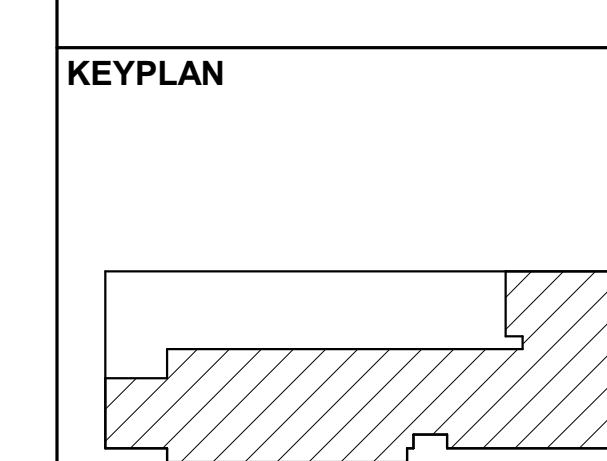

ROOF LEVEL MECHANICAL PLAN

JOB 23422.0000
DATE 05.31.2024
SHEET **iM02-21**

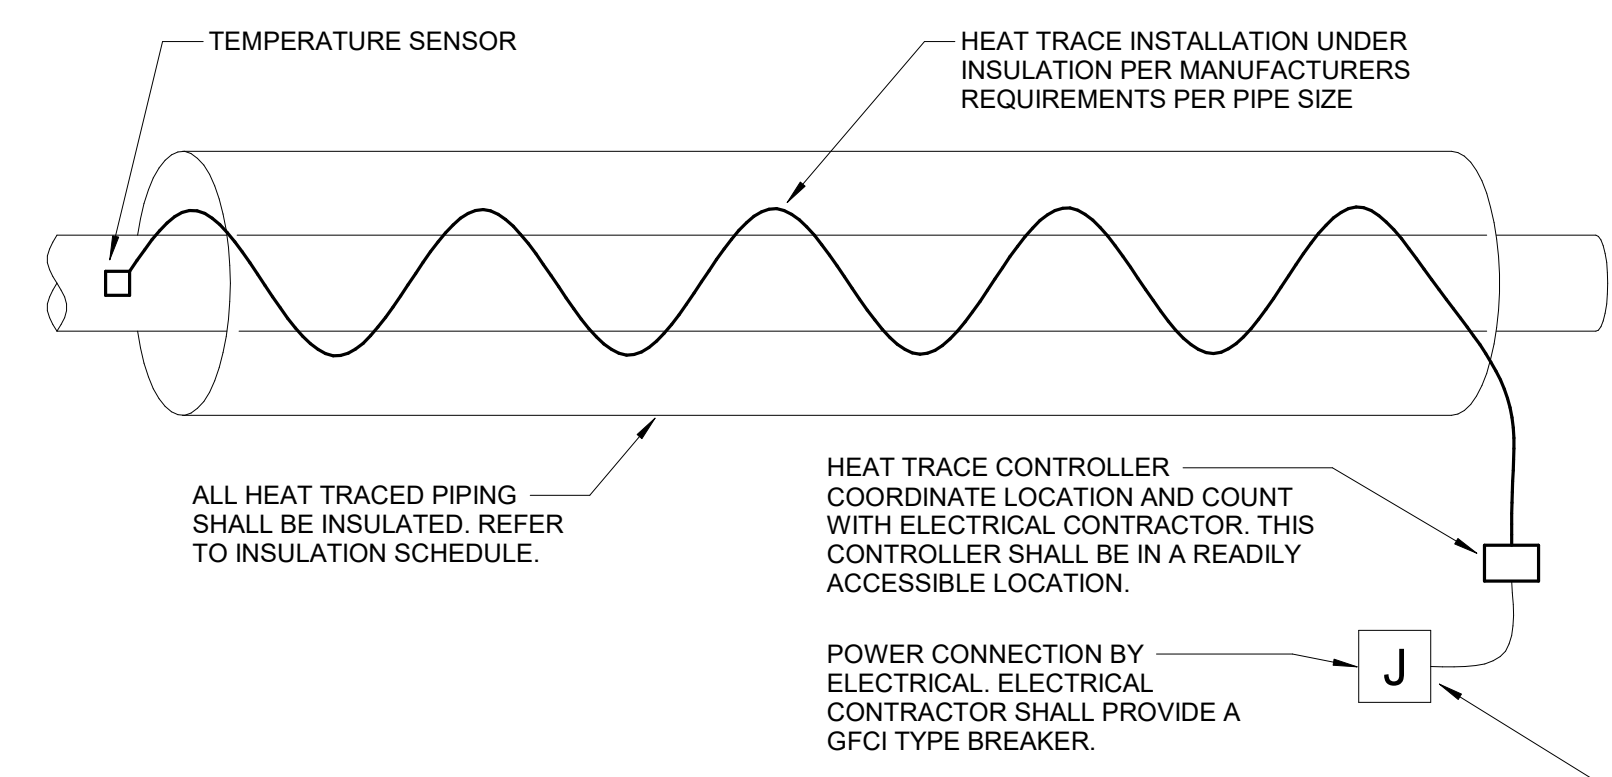


HEAT TRACE LOCATIONS	
SYSTEMS	APPLICATIONS
CHILLED/HEATING WATER	APPLY HEAT TRACING TO ALL HYDRONIC CHILLED AND/OR HEATING PIPING IN UNCONDITIONED SPACES OR WHERE EXPOSED TO EXTERIOR CONDITIONS.

HEAT TRACE NOTES:
 A. THE ARRANGEMENT SHOWN IN THIS DETAIL IS SCHEMATIC ONLY. FOLLOW THE SPECIFIC HEAT TRACE MANUFACTURER INSTRUCTIONS FOR HEAT TRACE PRODUCT TYPE AND INSTALLATION ON PIPE, FITTINGS, VALVES, AND ACCESSORIES. REFER TO INSULATION SCHEDULE.
 B. PROVIDE ADHESIVE WARNING LABELS PURCHASED FROM HEAT TRACE MANUFACTURER SPACED AT 10' ON CENTER MAXIMUM ON ALL INSULATION OVER HEAT TRACING CABLE INDICATING THAT THE PIPE IS HEAT TRACED.
 C. TEMPERATURE SENSING WIRES SHALL BE INSTALLED 90 DEGREES FROM THE NEAREST HEAT TRACE LINE ALONG PIPE.
 D. COORDINATE HEAT TRACE WATTAGE, CIRCUITS, AND CONTROLLER LOCATION WITH ELECTRICAL CONTRACTOR.
 E. ALL HEAT TRACED PIPING SHALL BE INSULATED. REFER TO INSULATION SCHEDULE.
 F. SUBJECT TO COMPLIANCE WITH ALL REQUIREMENTS LISTED IN THIS DETAIL AND THE SPECIFICATIONS, ACCEPTABLE MANUFACTURERS INCLUDE THE FOLLOWING:
 a. BASIS OF DESIGN:
 • RAYCHEM INVENT, A DIVISION OF TYCO THERMAL CONTROLS
 • OTHER EQUAL MANUFACTURERS
 b. CHROMALOX, INC.; WIEGARD INDUSTRIAL DIVISION; EMERSON ELECTRIC COMPANY; EASY HEAT INC.

KEYED NOTES - SHEET iM02-21

- HEAT TRACE: PROVIDE 277V HEAT TRACING AND INSULATION ON ALL NEW MECHANICAL HYDRONIC PIPING ON ROOF. ACTUAL INSTALLED LENGTH TO BE CONFIRMED BY CONTRACTOR. COORDINATE EXACT CIRCUITS AND LOAD WITH ELECTRICAL CONTRACTOR. RE: DETAIL THIS SHEET FOR MORE INFORMATION.
- PROVIDE LOW LEAKAGE MOTORIZED DAMPER, BUGSCREEN, HOOD, BACKDRAFT DAMPER AND DUCTWORK TO OPEN WHEN OAHU 11-1 IS NOT OPERATING.

2 HEAT TRACE DETAIL
NOT TO SCALE

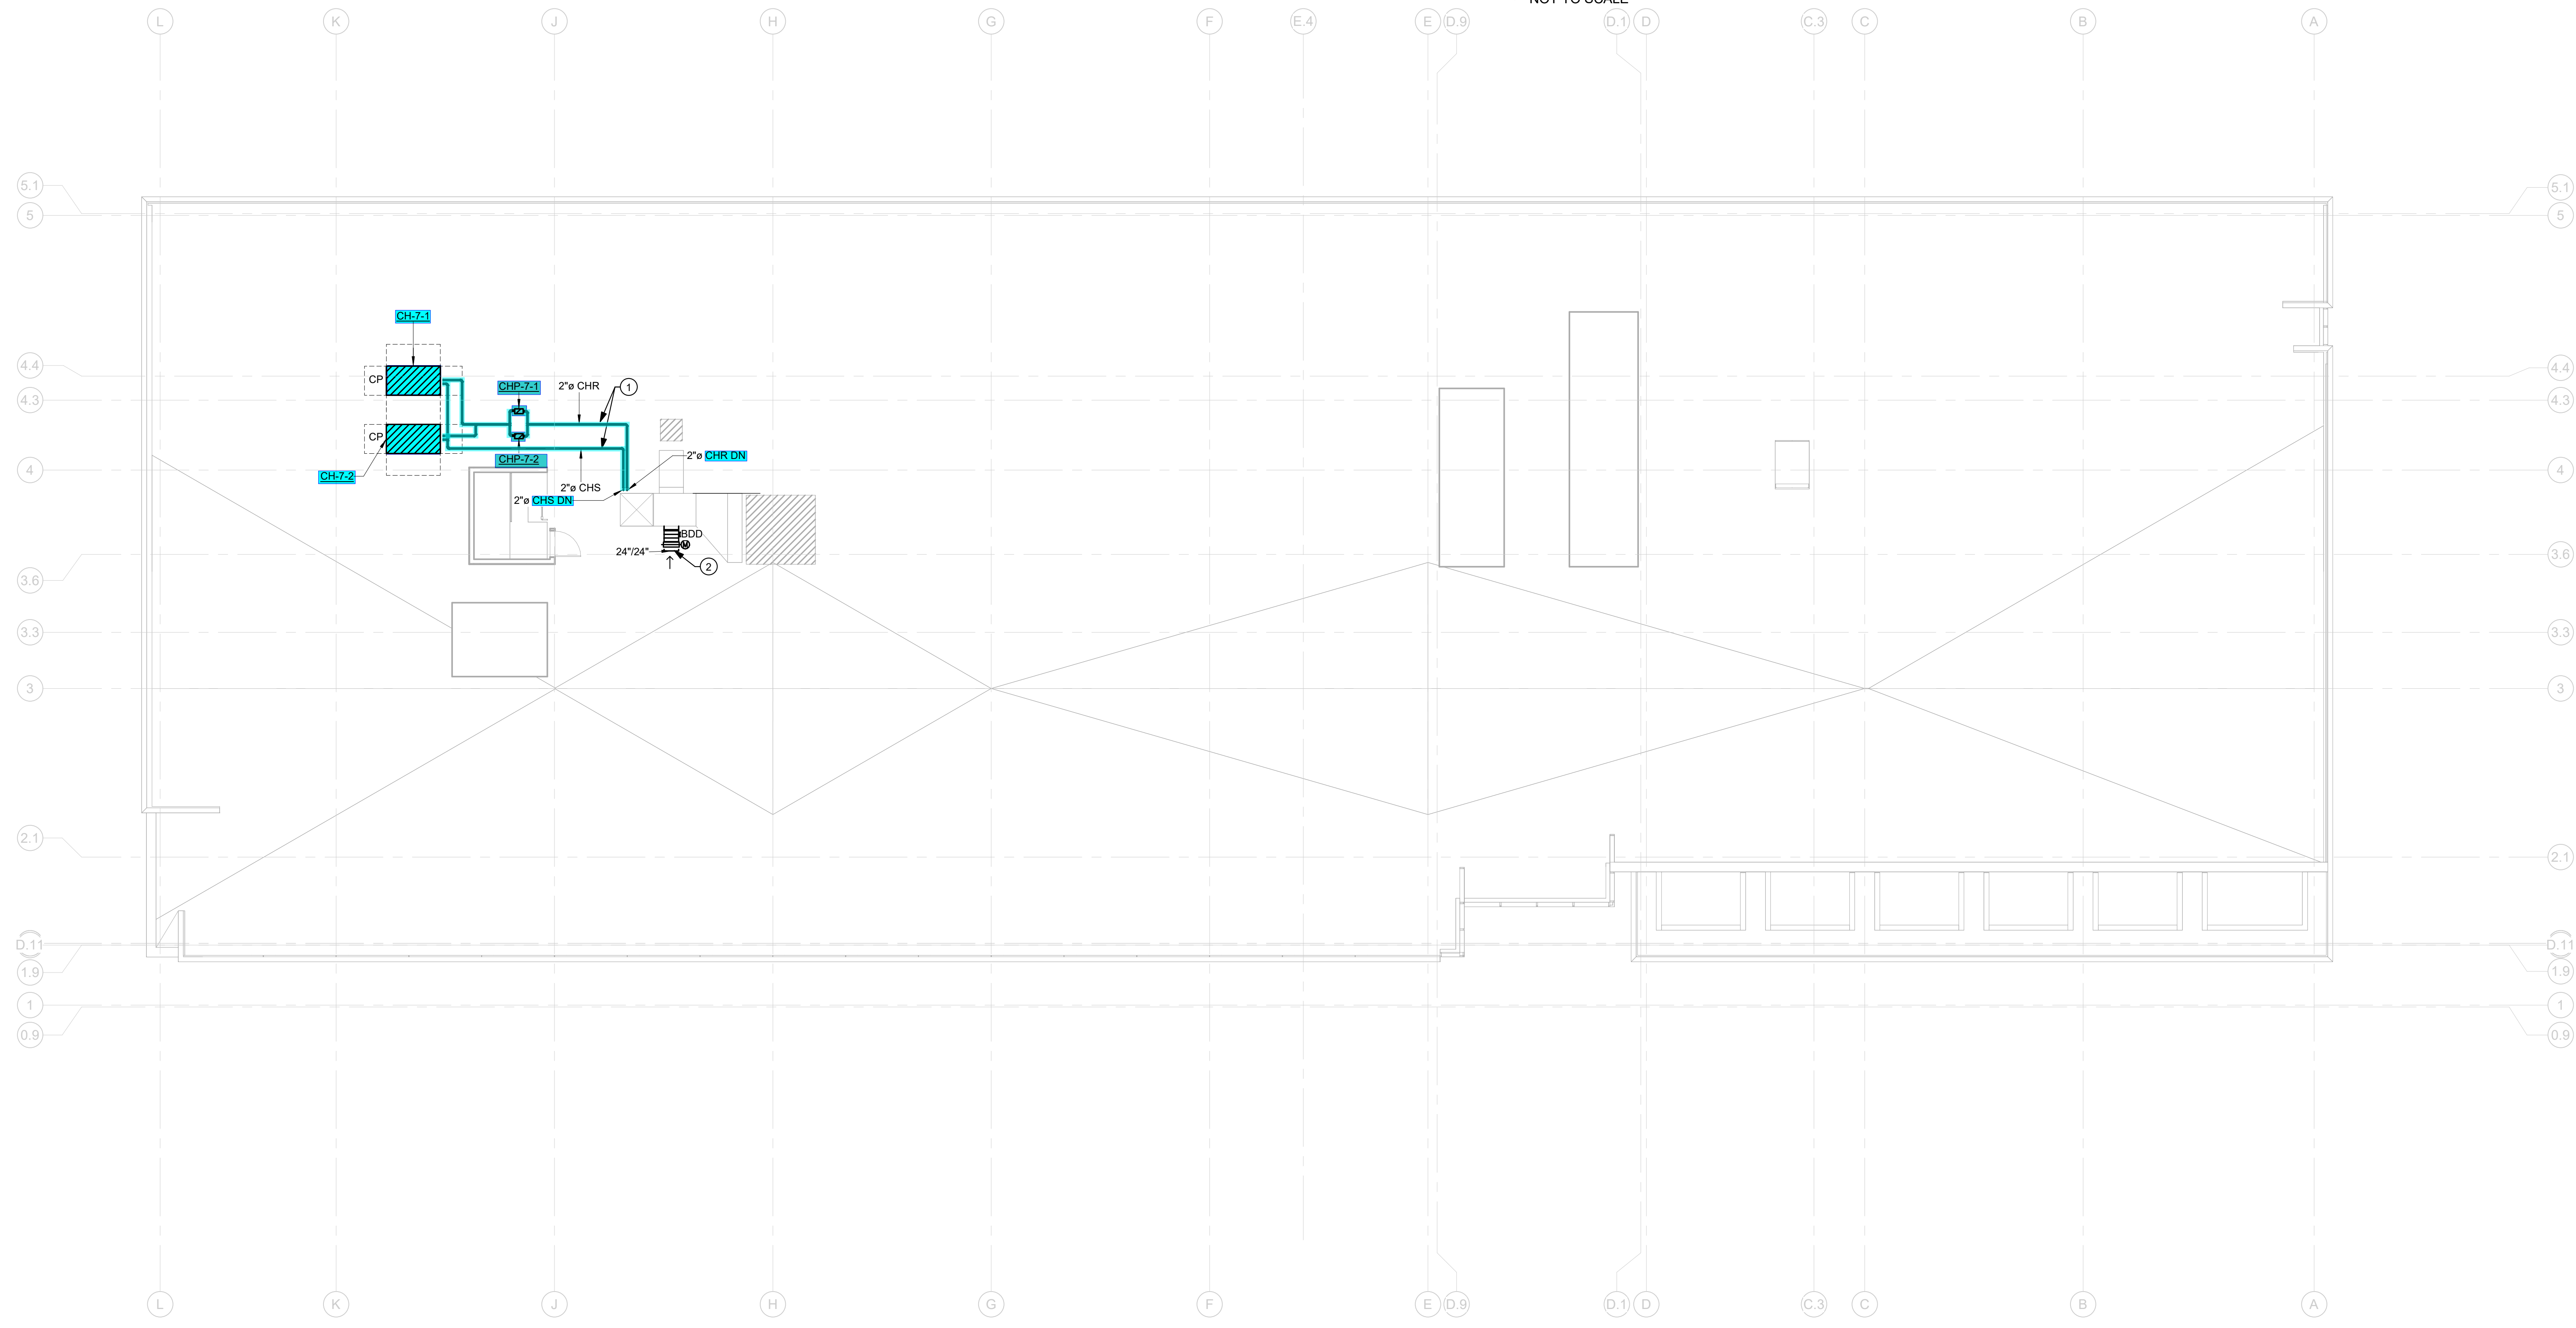

1 ROOF LEVEL MECHANICAL PLAN
3/32" = 1'-0"

5/31/2024 9:55:33 AM iM02-21 ROOF LEVEL MECHANICAL PLAN

© 2024 Purdy - McGuire
 Mechanical - Electrical Engineers
 17500 North Dallas Parkway
 Suite 200
 Dallas, TX 75248-1147
 P.E. Registration # P-1511
 Tel: 972-239-6307
 Fax: 972-239-6231
 www.purdy-mcguire.com

PLAN
N

PMA JOB NO. 23115.001
 PROJECT MGR. C. BARTON, B. JARRETT
 MECHANICAL L. GIBSON, C. BURGESS
 ELECTRICAL C. KARRIG
 PLUMBING L. ZANULINSKI

THIS DRAWING SHALL NOT BE REPRODUCED FOR ANY PROJECT OTHER THAN THE PROJECT NOTED IN THE TITLE BLOCK WITHOUT THE WRITTEN CONSENT OF PURDY-McGUIRE, INC. DALLAS, TX.