

Report By:

National TAB
1329 E. KEMPER ROAD
SUITE 4210
CINCINNATI, OH 45246



Report: TAB REPORT
Function: Test, Adjust, & Balance
Date: 02/04/2026
Completed By: National TAB

PROJECT
01-19-26 CULVERS #459 KENOSHA, WI

8124 Sheridan Rd

Kenosha, WI 53143

Client
Budderfly

National TAB

Project: 01-19-26 CULVERS #459 KENOSHA, WI

Table Of Contents

Section	Page #
AHU/RTU	3
FAN - Exhaust	9
Kitchen Hood Type I	17
Kitchen Hood Type II	21

National TAB

Project: 01-19-26 CULVERS #459 KENOSHA, WI

System/Unit: AHU/RTU



Asset: RTU1

AREA:DINING

Unit Data	
	Actual
MFG	CARRIER
Serial Num	2623P24754
Model Num	48LCE017D2A5A4R5C0

Motor Data	
	Actual
Motor MFG	MARATHON
Horsepower	5
Motor Rpm	1765
Phase	3
Rated Voltage	230
Rated Amperage	12.6

Test Data	
	Actual
SF CFM	5206
SF RPM	686
MOTOR RPM	1364
RA CFM	3641
OA CFM	1565
RL Voltage	208.3/208.8/209.2
RL Amperage	4.35/4.61/4.35
SF System SetPt	77%
OA Damper Position	30%
OA Damper Type	ECONOMIZER


Performance Data	
	Actual
MA Plenum SP	-0.21"
Fan Suction SP	-0.39"
Fan Discharge SP	0.363"
Total ESP	0.533"
Fan Total SP	0.753"

Completed By: Luke Gustafson on 01/21/2026

Notes:
[1] UNITS DO NOT HAVE

Written By: Michael McDonnell on 02/04/2026

Unit Data - PHOTO LOG

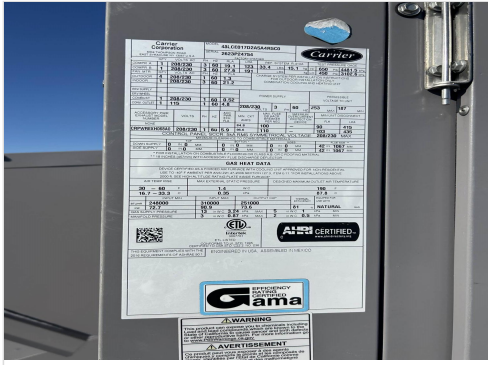

01/20/2026



01/20/2026

National TAB

Project:01-19-26 CULVERS #459 KENOSHA, WI

AHU/RTU



Diffuser Supply (GRD)

RTU1/DINING

Asset									
Asset Name	Location	Type	Size	DESIGN CFM	AK	CFM(1)	CFM(2)	FINAL CFM	% to design
SGRD1									
SGRD2									
SGRD3									
SGRD4									
SGRD5									
SGRD6									
SGRD7									
SGRD8									
SGRD9									
SGRD10									
SGRD11									
SGRD12									
Total				0		0	0	0	0%

National TAB

Project: 01-19-26 CULVERS #459 KENOSHA, WI

System/Unit: AHU/RTU



Asset: RTU2

AREA:KITCHEN

Unit Data	
	Actual
MFG	CARRIER
Serial Num	2923P25596
Model Num	48LCE020D2A5A4R5C0

Motor Data	
	Actual
Motor MFG	MARATHON
Horsepower	5
Motor Rpm	1765
Phase	3
Rated Voltage	230
Rated Amperage	12.6

Test Data	
	Actual
SF CFM	5106
SF RPM	829
MOTOR RPM	1684
RA CFM	3666
OA CFM	1440
RL Voltage	208.0/208.8/208.7
RL Amperage	5.3/5.4/5.5
SF System SetPt	95%
OA Damper Position	28%
OA Damper Type	ECONOMIZER

Performance Data	
	Actual
MA Plenum SP	-0.39"
Fan Suction SP	-0.566"
Fan Discharge SP	0.57"
Total ESP	0.96"
Fan Total SP	1.136"

Completed By: Luke Gustafson on 01/21/2026

Notes:

[1] 267,246,523,502,325 CFM for cookline diffusers

Written By: Luke Gustafson on 01/21/2026

National TAB
 Project:01-19-26 CULVERS #459 KENOSHA, WI
AHU/RTU



Diffuser Supply (GRD)

RTU2/KITCHEN

Asset									
Asset Name	Location	Type	Size	DESIGN CFM	AK	CFM(1)	CFM(2)	FINAL CFM	% to design
SGRD1									
SGRD2									
SGRD3									
SGRD4									
SGRD5									
SGRD6									
SGRD7									
SGRD8									
SGRD9									
SGRD10									
SGRD11									
SGRD12									
Total				0		0	0	0	0%

National TAB

Project: 01-19-26 CULVERS #459 KENOSHA, WI

System/Unit: FAN - Exhaust



Asset: EF1

AREA:HD1

Unit Data	
	Actual
MFG	ACCUREX
Model Num	XRUB-141-7-G
Serial Num	12951361 1205

Motor Data	
	Actual
Horsepower	0.75
Motor Rpm	1740
Phase	3
Voltage (rated)	208
Amperage (rated)	2.65

Test Data	
	Actual
CFM	1325
Fan RPM	1107
Motor RPM	1770
RL Voltage	NOT ACCESIBLE
RL Amperage	NOT ACCESIBLE

Completed By: Luke Gustafson on 01/22/2026

Unit Data - PHOTO LOG



01/20/2026



01/20/2026

National TAB

Project: 01-19-26 CULVERS #459 KENOSHA, WI

System/Unit: FAN - Exhaust



Asset: EF2

AREA:HD2


Unit Data	
	Actual
MFG	ACCUREX
Model Num	XRUB-161XP-15-G
Serial Num	12851362 1205

Motor Data	
	Actual
Horsepower	1.50
Motor Rpm	NOT LEGIBLE
Phase	3
Voltage (rated)	208
Amperage (rated)	5.10

Test Data	
	Actual
CFM	1408
Fan RPM	2190
Motor RPM	1765
RL Voltage	NOT ACCESIBLE
RL Amperage	NOT ACCESIBLE

Completed By: Luke Gustafson on 01/22/2026

Unit Data - PHOTO LOG

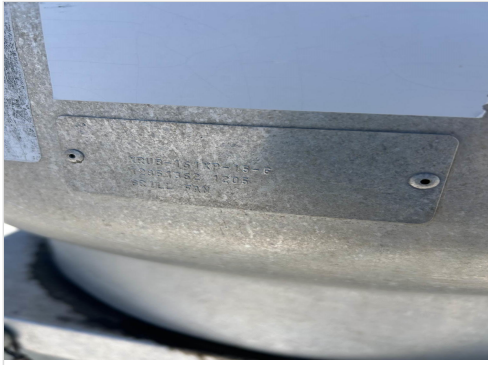

01/20/2026



01/20/2026

National TAB

Project: 01-19-26 CULVERS #459 KENOSHA, WI

System/Unit: FAN - Exhaust



Asset: EF3

AREA:DISHWASHER/ROOFTOP

Unit Data	
	Actual
MFG	ACCUREX
Model Num	XRED-090-D-X
Serial Num	12851364 1205

Test Data	
	Actual
CFM	0 [1]

Motor Data	
	Actual
Horsepower	1/15
Motor Rpm	1550
Phase	NL
Voltage (rated)	120
Amperage (rated)	1.2

Completed By: Luke Gustafson on 01/21/2026

Notes:

[1] Unit not operational, needs service/see issue

Written By: Luke Gustafson on 01/21/2026

Unit Data - PHOTO LOG



01/20/2026



01/20/2026

National TAB

Project: 01-19-26 CULVERS #459 KENOSHA, WI

System/Unit: FAN - Exhaust



Asset: EF4

AREA:RESTROOMS/ROOFTOP

Unit Data	
	Actual
MFG	ACCUREX
Model Num	XRED-090-D-X
Serial Num	12851363 1205

Test Data	
	Actual
CFM	0 [1]

Motor Data	
	Actual
Horsepower	1/15
Motor Rpm	1550
Phase	NL
Voltage (rated)	120
Amperage (rated)	1.2

Completed By: Luke Gustafson on 01/21/2026

Notes:


[1] Unit not operational, needs service/see issue

Written By: Luke Gustafson on 01/21/2026

Unit Data - PHOTO LOG



01/20/2026

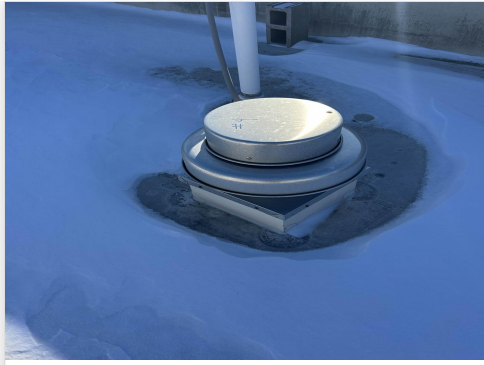

01/20/2026

National TAB

Project: 01-19-26 CULVERS #459 KENOSHA, WI

System/Unit: Kitchen Hood Type I



Asset: HD1

AREA:KITCHEN

Unit Data	
	Actual
MFG	ACCUREX
Model Num	XXEP-6.92-S
Job / Serial Num	12860277
Hood length	86"
Hood Width	23"
Hood Height	61"

Test Data Exhaust		
	Design	Actual
Filter Type	-	ACCUREX XTRACTOR
Filter Size 1	-	16X16
Filter Qty 1	-	5
Filter AK factor size 1	-	1.53
Filter Total AK Area	-	7.65
Filter1 FPM	-	189
Filter2 FPM	-	171
Filter3 FPM	-	171
Filter4 FPM	-	160
Filter5 FPM	-	175
CFM	-	1325

Cooking Equipment	
	Actual
Item 1	FRYER

Completed By: Luke Gustafson on 01/21/2026

Unit Data - PHOTO LOG



01/20/2026



01/20/2026

National TAB

Project: 01-19-26 CULVERS #459 KENOSHA, WI

System/Unit: Kitchen Hood Type I



Asset: HD2

AREA:KITCHEN

Unit Data	
	Actual
MFG	NL
Model Num	NL
Job / Serial Num	NL
Hood length	64"
Hood Width	26"
Hood Height	61"

Test Data Exhaust		
	Design	Actual
Filter Type	-	ACCUREX XTRACTOR
Filter Size 1	-	16X16
Filter Qty 1	-	4
Filter AK factor size 1	-	1.53
Filter Total AK Area	-	6.12
Filter1 FPM	-	265
Filter2 FPM	-	219
Filter3 FPM	-	208
Filter4 FPM	-	228
CFM	-	1408

Cooking Equipment	
	Actual
Item 1	GRILL

Completed By: Luke Gustafson on 01/21/2026

Unit Data - PHOTO LOG



01/20/2026



01/20/2026

National TAB

Project: 01-19-26 CULVERS #459 KENOSHA, WI

System/Unit: Kitchen Hood Type II



Asset: HD(Type2)1

AREA:KITCHEN

Unit Data		
	Design	Actual
MFG	NA	ACCUREX
Model Num	NA	XD3-3.50-S
Serial Num	-	12860279
Type	-	TYPE II
Hood length	-	42"
Hood Width	-	42"

Test Data		
	Design	Actual
Exhaust CFM	-	0 [1]

Completed By: Luke Gustafson on 01/21/2026

Notes:

[1] Unit not operational, needs service/see issue

Written By: Luke Gustafson on 01/21/2026

Unit Data - PHOTO LOG



01/20/2026



01/20/2026