


1 HVAC FLOOR PLAN
M1.0 NOT TO SCALE

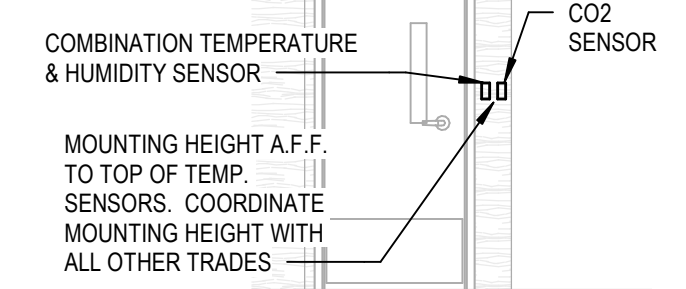

2 HVAC SENSOR ELEVATION
M1.0 1/4" = 1'-0"

KEY NOTES:

- 1 REMOVE TEST STATIONS FOR SMOKE DETECTORS FOR RTU-1, 2 & 3. TEST STATIONS TO BE MOUNTED ON THE MANAGERS OFFICE WALL. SECURITY CONTRACTOR SHALL WIRE RTU FACTORY MOUNTED SMOKE DETECTORS TO SECURITY/FIRE ALARM PANEL. MECHANICAL CONTRACTOR SHALL PROVIDE TEST STATION AND WIRING BETWEEN COMPONENTS AS WELL AS WIRING TO SHUT DOWN THE AC FAN UPON ACTIVATION OF THE SMOKE DETECTOR. G.C. TO TEST THE SMOKE DETECTOR FUNCTIONS WITH THE WAWA PROJECT MANAGER.
- 2 WALL MOUNTED SENSOR(S) FOR EACH MECHANICAL UNIT PER ROOFTOP UNIT SCHEDULE ON SHEET M3.0. G.C. SHALL INSTALL AND WIRE TO UNIT. BAS CONTRACTOR SHALL CONNECT TO MECHANICAL UNIT ONLY.
- 3 COORDINATE EXACT LOCATION OF EXHAUST FAN PENETRATION WITH ARCHITECTURAL ROOF PLAN. INSTALL GALVANIZED DUCTWORK DOWN FROM FAN INTO CEILING/URST SPACE, AND CONNECT TO CEILING GRILLES.
- 4 REFER TO TYPICAL DUCT PLENUM DETAIL ON SHEET M3.0.
- 5 DUCT TAKE OFF ON BOTTOM OF DUCT. PROVIDE DAMPER AFTER TAKE OFF.
- 6 COORDINATE DUCT WITH STRUCTURE IN THIS LOCATION. COORDINATE TAKEOFF LOCATIONS WITH TRUSS WEB OPENINGS.
- 7 PROVIDE SURFACE MOUNT ADAPTER FRAME TO ALLOW ACCESS TO CEILING ABOVE THROUGH DIFFUSER OPENING. SEE AIR DEVICE SCHEDULE.
- 8 ROUTE DUCT UNDER STRUCTURAL MEMBERS AT THIS LOCATION.
- 9 COORDINATE AND ROUTE MAIN DUCT HIGH IN JOIST SPACE. AVOID CONFLICTS WITH UTILITIES.
- 10 TRANSFER AIR DUCT ASSEMBLY.
- 11 PROVIDE SEALED 20" x 20" PLENUM BOX ASSEMBLY ABOVE TRANSFER GRILLES TO ALLOW FLEX TRANSFER DUCT CONNECTIONS.
- 12 ROUND DUCT UNDER THE STRUCTURE JOIST.

PERMITTING NOTE:

ALL REFRIGERATION EQUIPMENT INCLUDING WALK-IN COOLERS AND REFRIGERATORS WILL BE SUBMITTED UNDER A SEPARATE PERMIT.

SHEET GENERAL NOTE:

A. MECHANICAL CONTRACTOR SHALL ADJUST ALL LINEAR SLOT DIFFUSERS TO A GENERALLY VERTICAL FLOW. ADJUSTMENT SHALL BE MADE SO AS TO AVOID AIRBLOWS ON SENSORS, REFRIGERATION CASES, OR OPEN FOOD REFRIGERATION EQUIPMENT.

HVAC LEGEND

SYMBOL	DESCRIPTION
	NEW RECTANGULAR OR ROUND DUCT
	FLEXIBLE DUCT
	SUPPLY AIR DUCTWORK UP THROUGH PLAN
	RETURN AIR DUCTWORK UP THROUGH PLAN
	EXHAUST AIR DUCTWORK UP THROUGH PLAN
	90° ELBOW WITH TURNING VANES
	MANUAL AIR VOLUME CONTROL DAMPER
	4 WAY SUPPLY DIFFUSER
	2 WAY OPPOSED SUPPLY DIFFUSER
	2 WAY CORNER SUPPLY DIFFUSER
	1 WAY SUPPLY DIFFUSER
	RETURN AIR DEVICE
	EXHAUST AIR DEVICE
	AIR CURTAIN
	LINEAR SLOT DIFFUSER WITH PLENUM
	COMBINATION TEMPERATURE/HUMIDITY SENSOR
	TEMPERATURE SENSOR
	CO2 SENSOR
	TYPE MARK
	MECHANICAL EQUIPMENT TAG
	CONDENSATE PIPING
	ROOF MOUNTED EXHAUST FAN
	PACKAGED ROOFTOP AIR CONDITIONER

2600 Meiland Center Parkway
Suite #200
Meiland, FL 32751
P (407) 661-9100
F (407) 661-9101
c-p.com



COPYRIGHT ©. All rights reserved. Specifications, computer files, field data, notes and other documents are instruments of service prepared by CuHaci & Peterson, C.A.P. & P. and shall remain the property of C.A.P. & P. Any use or reproduction of this document without written permission from C.A.P. & P. is a violation of Federal copyright laws.

CLIENT NAME
WAWA
260 WEST BALTIMORE PIKE
WAWA, PENNSYLVANIA 19063

PROJECT NAME
WAWA F110 L V2021.1
STORE #6303
4330 NEW JESUP HWY
BRUNSWICK, GA 31520


DATE
02/15/2024

Revision Schedule	No.	Description	Date
	1	PRE-BID SET	01/08/2023
	2	BID SET	11/29/2023
	3	CONSTRUCTION SET	02/15/2024

PROJECT NO.
220554
DATE
04-06-2023
DRAWN
JSP
CHECKED
ESD

M1.0

HVAC FLOOR PLAN

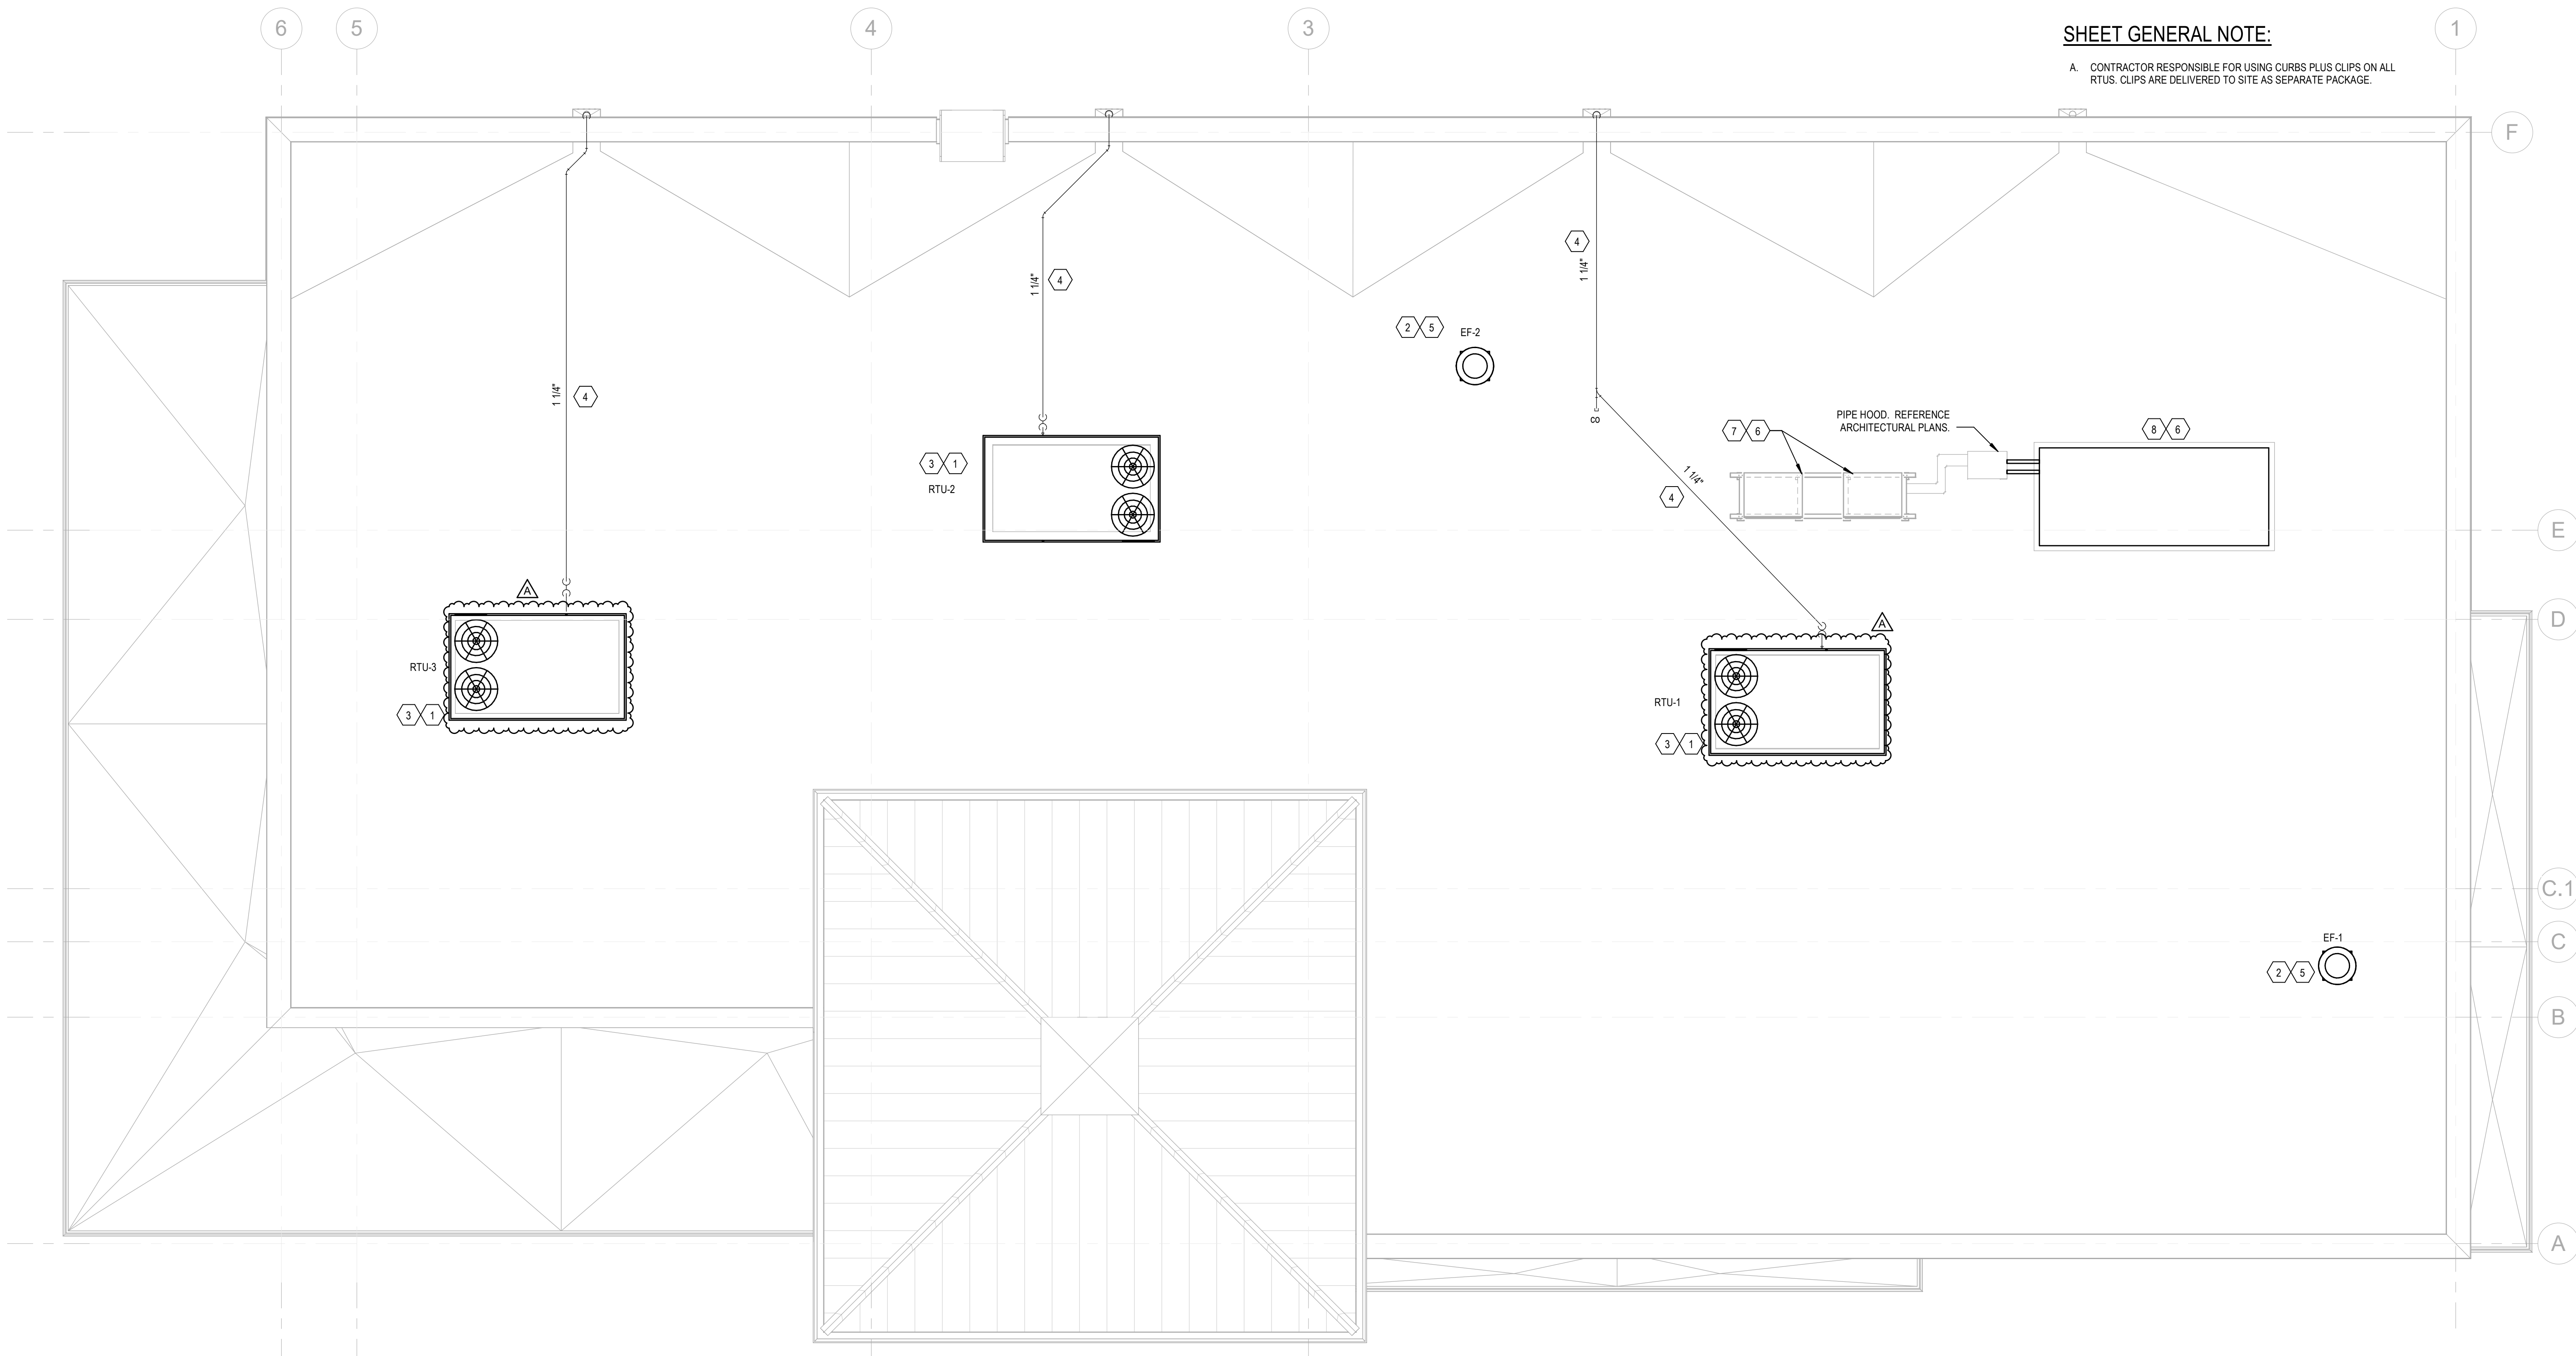

KEY NOTES:

- 1 FACTORY INSTALLED SMOKE DETECTORS IN MAIN SUPPLY AND RETURN OF EACH ROOFTOP UNIT.
- 2 INSTALL ROOF MOUNTED EXHAUST FAN PER DETAIL ON SHEET M3.0. COORDINATE EXACT LOCATION OF FAN PENETRATION WITH ARCHITECTURAL ROOF PLAN. TRANSITION GALVANIZED DUCTWORK AS NECESSARY FROM FAN INTO CEILING/JOIST SPACE. SEE SHEET M1.0 FOR CONTINUATION.
- 3 PROVIDE FLEXIBLE CONNECTIONS BETWEEN ALL DUCTWORK AND MECHANICAL UNITS.
- 4 ROUTE SCH. 40 PVC CONDENSATE DRAIN PIPING ALONG ROOF. SUPPORT PIPING PER DETAIL ON SHEET M3.0.
- 5 MAINTAIN A MINIMUM 10' CLEARANCE BETWEEN OUTSIDE AIR INTAKES AND EXHAUST TERMINATIONS ON ROOF.
- 6 FOOD SERVICE REFRIGERATION EQUIPMENT PROVIDED BY OTHERS.
- 7 FOOD SERVICE REFRIGERATION EQUIPMENT MOUNTED ON PRE-ENGINEERED RACK. REFER TO "CONDENSING UNIT ROOFING SUPPORT DETAIL" ON ARCHITECTURAL SHEETS FOR FLORIDA PRODUCT APPROVAL INFORMATION.
- 8 FOR SPECIFIC WIND LOADING REQUIREMENTS NOT TO EXCEED 130 MPH, SEE STRUCTURAL DRAWINGS.

SHEET GENERAL NOTE:

- A CONTRACTOR RESPONSIBLE FOR USING CURBS PLUS CLIPS ON ALL RTUS. CLIPS ARE DELIVERED TO SITE AS SEPARATE PACKAGE.

1 HVAC ROOF PLAN
M2.0 1/4" = 1'-0"

CLIENT NAME
WAWA
260 WEST BALTIMORE PIKE
WAWA, PENNSYLVANIA 19063

PROJECT NAME
WAWA F110 L V2021.1
STORE #6303
4330 NEW JESUP HWY
BRUNSWICK, GA 31520

SHEET TITLE
HVAC ROOF PLAN

02/15/2024

Revision Schedule	
No.	Description
1	PRE-BID SET
2	BID SET
3	CONSTRUCTION SET


PROJECT NO.
220554

DATE
04-06-2023

DRAWN
JSP



CHECKED
ESD

BUILDING LOCATION BRUNSWICK, GA.	WIND SPEED ZONE (WIC FIGURE 1609A) 130 MPH
-------------------------------------	--

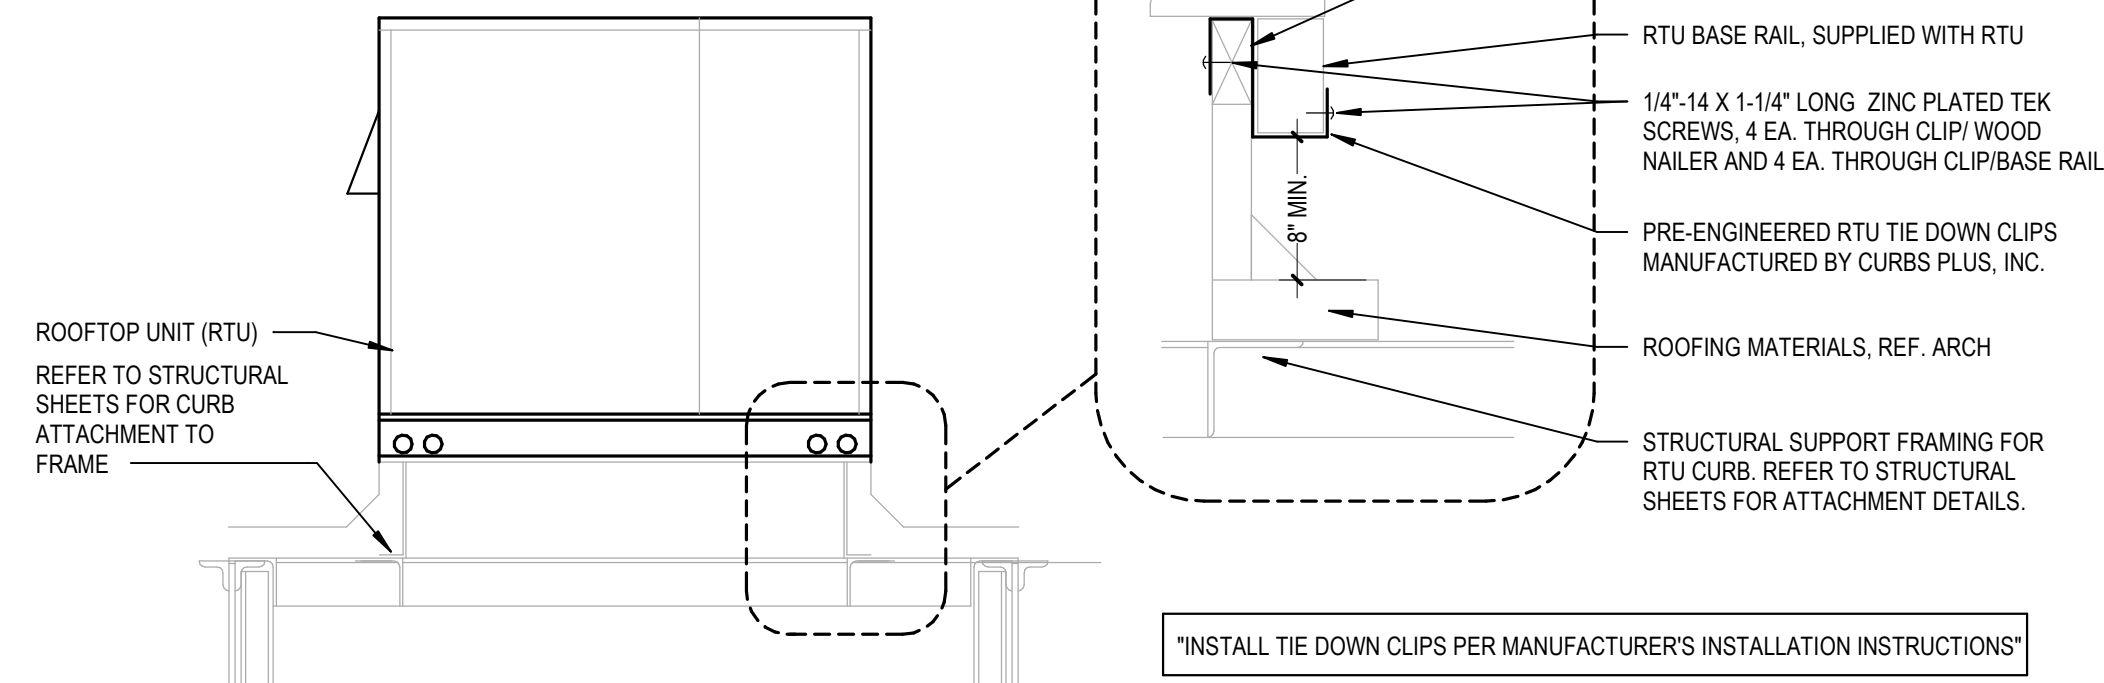


1 RTU TIE-DOWN DETAIL
M3.0 NOT TO SCALE

2 CEILING DIFFUSER RUNOUT DETAIL
M3.0 NOT TO SCALE

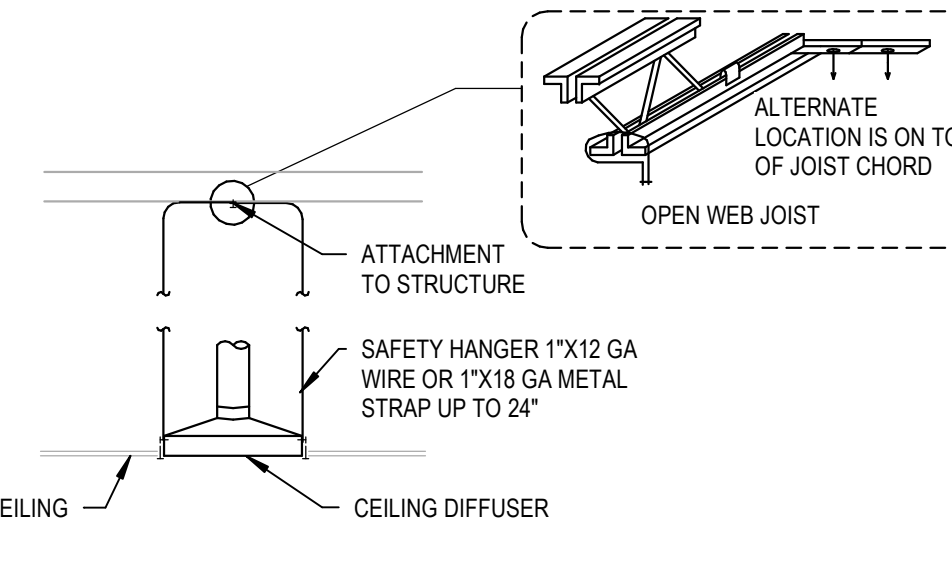
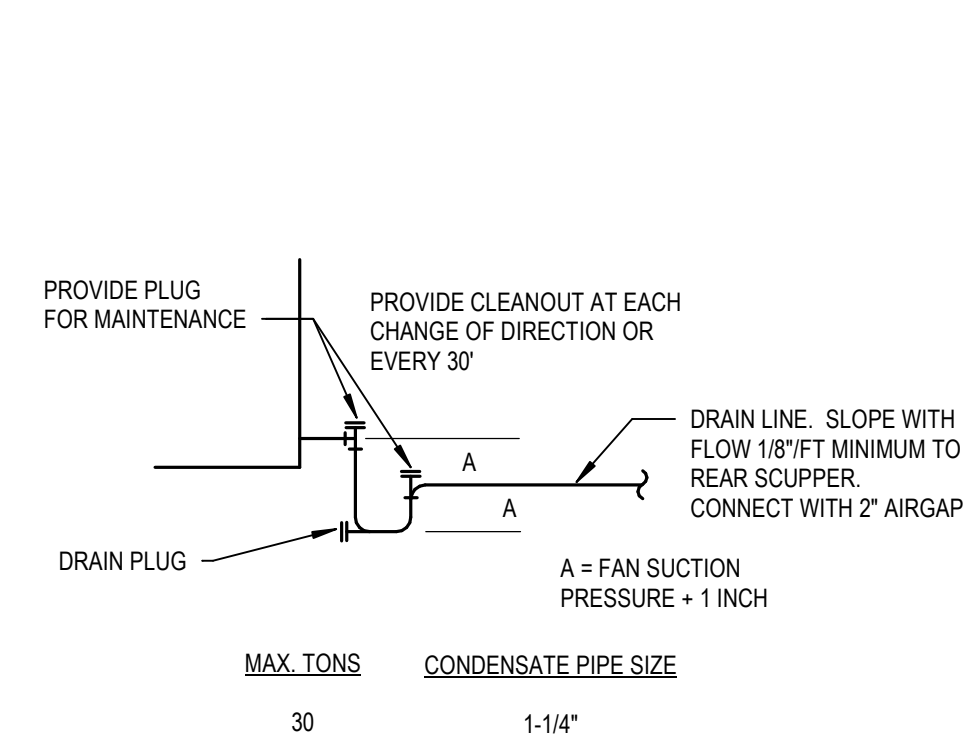


3 CEILING MOUNTED AIR DIFFUSER SUPPORT DETAIL
M3.0 NOT TO SCALE

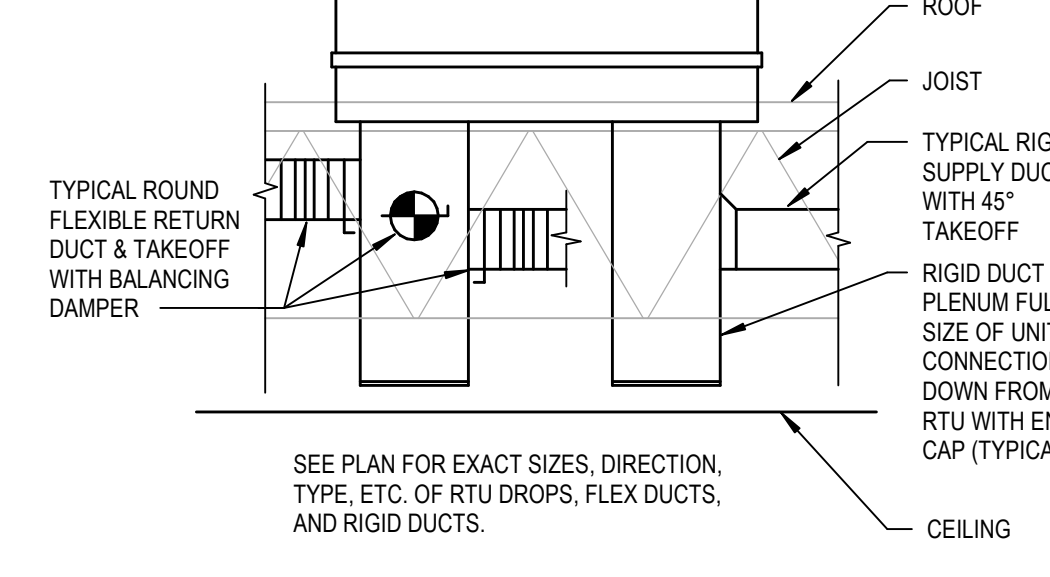


4 TYPICAL DUCT PLENUM DETAIL
M3.0 NOT TO SCALE

5 CONDENSATE DRAIN TRAP DETAIL
M3.0 NOT TO SCALE

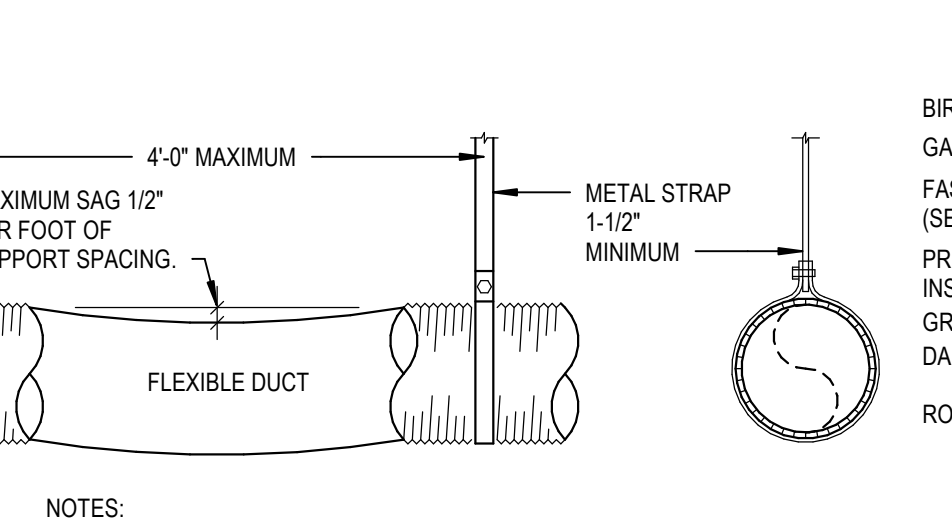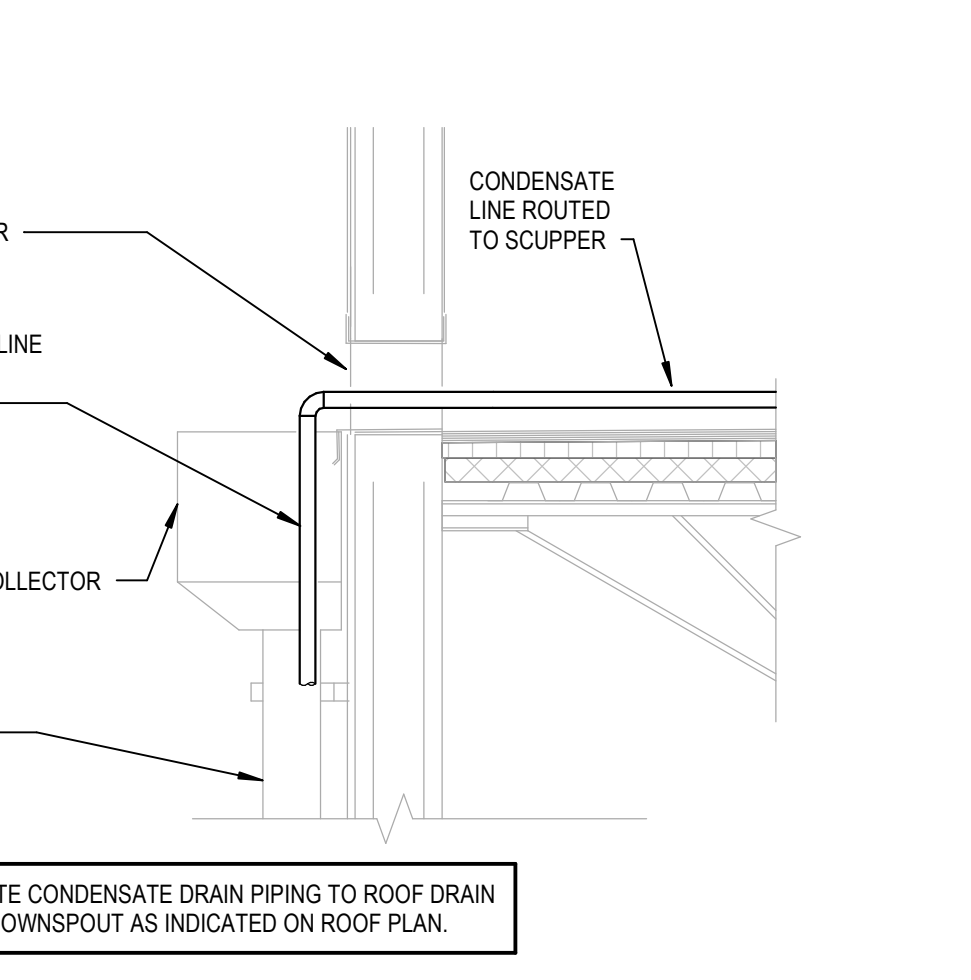


6 FLEX DUCT SUPPORT DETAIL
M3.0 NOT TO SCALE

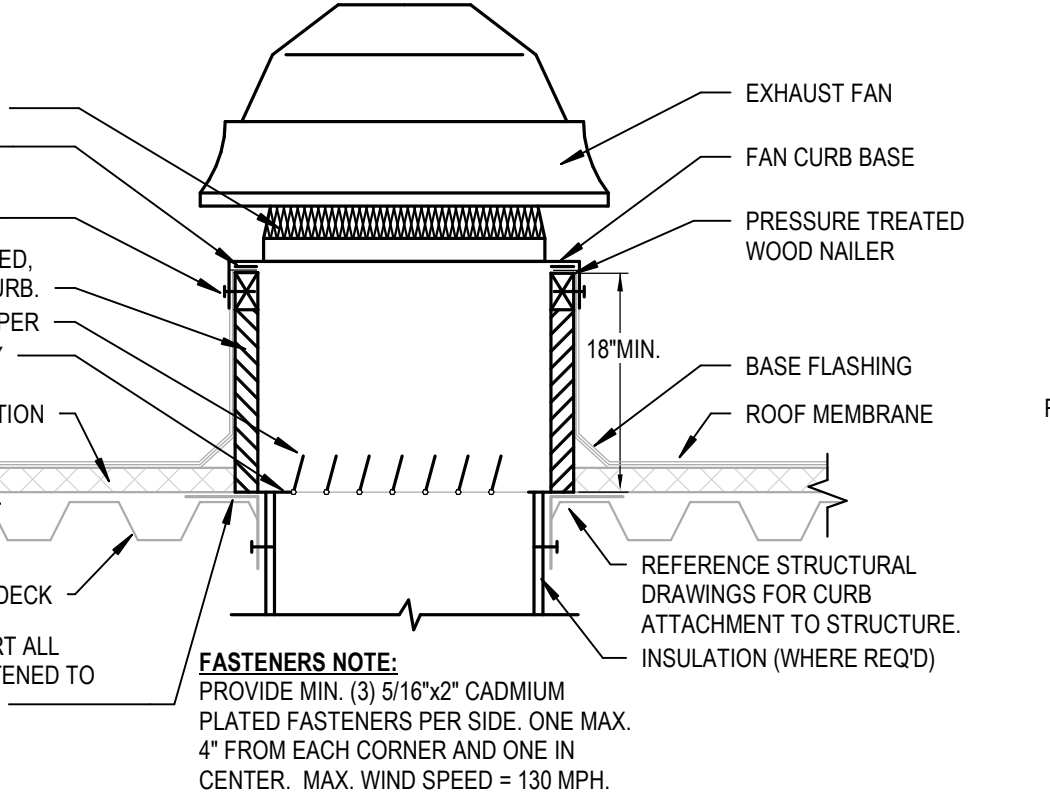


7 ROOF FAN MOUNTING DETAIL
M3.0 NOT TO SCALE

8 CONDENSATION TERMINATION DETAIL
M3.0 NOT TO SCALE

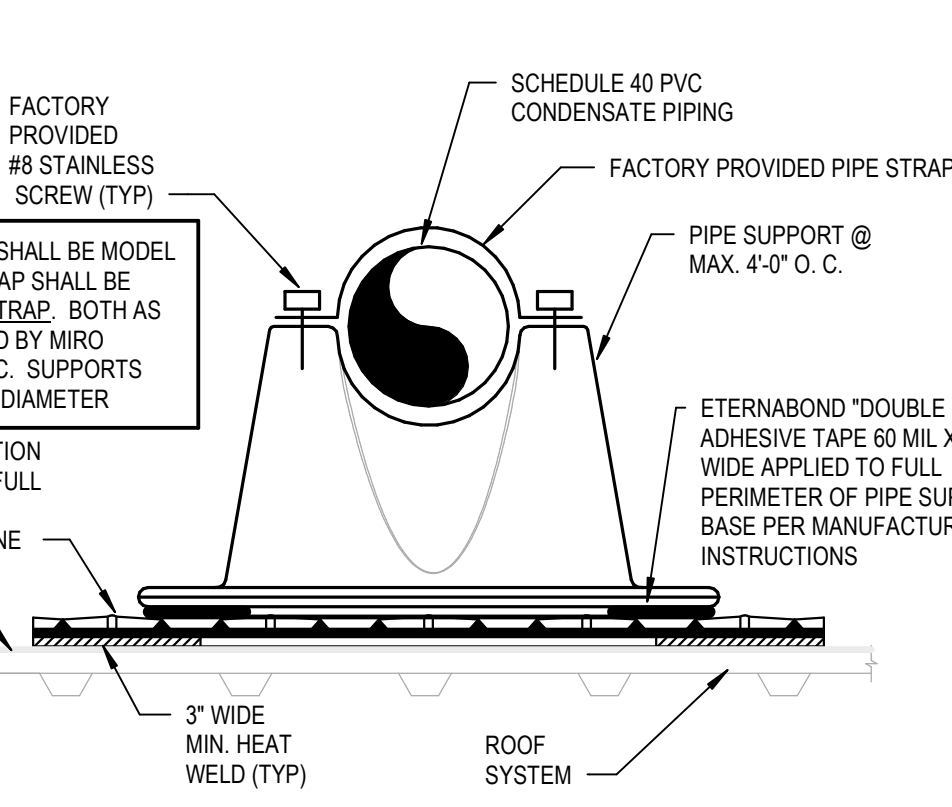

9 CONDENSATE PIPE ROOF SUPPORT DETAIL
M3.0 NOT TO SCALE

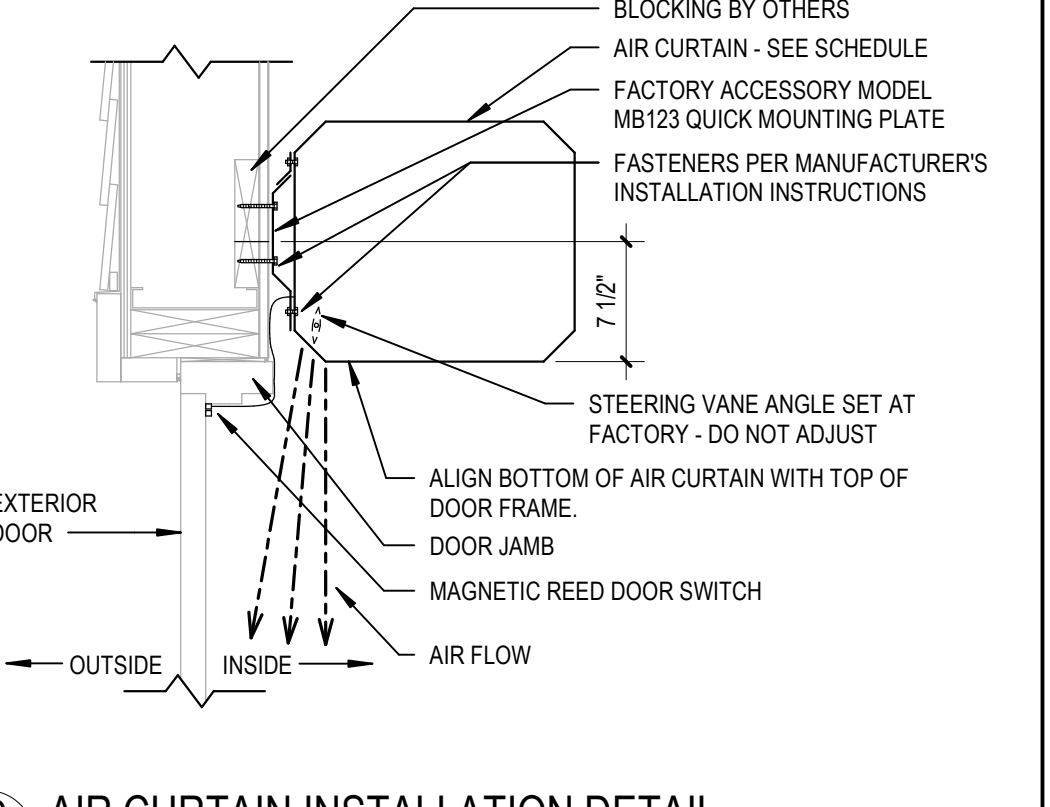

10 AIR CURTAIN INSTALLATION DETAIL
M3.0 NOT TO SCALE

RTU-1, 2, & 3 SEQUENCE OF OPERATION

- SUPPLY AIR BLOWER SPEED UNIT HAS FOLLOWING SUPPLY AIR BLOWER SPEED SETTINGS THAT PERTAIN TO THIS INSTALLATION:
- COOLING AIR BLOWER SPEED
 - HEATING AIR BLOWER SPEED
- COOLING MODE
- Y1 DEMAND: COMPRESSOR 1 OPERATES AND SUPPLY AIR BLOWER OPERATES AT COOLING SPEED.
 - Y2 DEMAND: ALL COMPRESSORS OPERATE AND SUPPLY AIR BLOWER OPERATES AT COOLING SPEED.
- DEHUMIDIFICATION MODE
- IF THE UNIT RECEIVES A CALL FOR DEHUMIDIFICATION, ECONOMIZER FREE COOLING IS LOCKED OUT (ON UNITS EQUIPPED WITH ECONOMIZER).
 - CALL FOR DEHUMIDIFICATION, NO Y1, Y2 DEMAND: 1ST STAGE COMPRESSOR OPERATES, SUPPLY AIR BLOWER OPERATES AT COOLING SPEED, AND THE REHEAT VALVE IS ENERGIZED.
 - Y1 DEMAND WITH A CALL FOR DEHUMIDIFICATION: ALL COMPRESSORS OPERATE, SUPPLY AIR BLOWER OPERATES AT COOLING SPEED AND THE REHEAT VALVE IS ENERGIZED.
 - Y2 DEMAND WITH A CALL FOR DEHUMIDIFICATION: ALL COMPRESSORS OPERATE, SUPPLY AIR BLOWER OPERATES AT COOLING SPEED, AND THE REHEAT VALVE IS DE-ENERGIZED.
- HEATING MODE (ELECTRIC HEAT)
- Y1 DEMAND: 1ST STAGE ELECTRIC HEAT IS ENERGIZED AND THE SUPPLY AIR BLOWER OPERATES AT HEATING SPEED.
 - Y2 DEMAND: 2ND STAGE ELECTRIC HEAT IS ENERGIZED AND THE SUPPLY AIR BLOWER OPERATES AT HEATING SPEED.
- MODULATING OUTDOOR AIR DAMPER
- THE MINIMUM DAMPER POSITION FOR 'OCCUPIED LOW BLOWER' AND 'OCCUPIED HIGH BLOWER' IS ADJUSTED DURING UNIT SETUP TO PROVIDE MINIMUM FRESH AIR REQUIREMENTS PER RTU SCHEDULE AT ALL SUPPLY AIR BLOWER SPEEDS.
 - WHEN SUPPLY AIR BLOWER IS OFF, THE OUTDOOR AIR DAMPER IS CLOSED.
 - WHEN UNIT IS IN OCCUPIED MODE AND SUPPLY AIR BLOWER IS OPERATING BELOW THE 'MIDPOINT' BLOWER SPEED, THE OUTDOOR AIR DAMPER IS AT MINIMUM 'LOW BLOWER' POSITION.
 - WHEN UNIT IS IN OCCUPIED MODE AND SUPPLY AIR BLOWER IS OPERATING AT A SPEED EQUAL TO OR ABOVE THE 'MIDPOINT' BLOWER SPEED, THE OUTDOOR AIR DAMPER IS AT MINIMUM 'HIGH BLOWER' POSITION.
 - NOTE - THE 'MIDPOINT' BLOWER SPEED IS AN AVERAGE OF THE MINIMUM AND MAXIMUM BLOWER SPEED (MINIMUM SPEED + MAXIMUM SPEED DIVIDED BY 2).

HVAC GENERAL NOTES

- ALL MECHANICAL WORK SHALL BE IN STRICT ACCORDANCE WITH THE 7TH EDITION (2020) FLORIDA BUILDING CODE - MECHANICAL, SMACNA, UL LOCAL CODES, MANUFACTURER'S RECOMMENDATIONS, AND ALL AUTHORITIES HAVING JURISDICTION.
- CONTRACTOR TO VISIT SITE AND VERIFY ALL CLEARANCES BEFORE FABRICATION OF DUCTWORK AND PROVIDE ADDITIONAL OFFSET AND/OR CHANGES IN DUCT SIZES TO MEET FIELD CONDITIONS AND COORDINATE WITH ELECTRICAL, PLUMBING AND FIRE PROTECTION SUBCONTRACTOR BEFORE ANY CONSTRUCTION WORK.
- SUPPLY AIR, RETURN AIR, OUTSIDE AIR AND EXHAUST AIR DUCTWORK SHALL BE SHEET METAL CONSTRUCTION. DUCT SHALL BE INSTALLED SECURELY SUPPORTED, HUNG OR SUSPENDED FROM THE STRUCTURE. JOINTS SHALL BE SEALED WITH 3" WIDE GLASS FABRIC TAPE OR FOSTER 3030 MASTIC OR EQUAL. DUCT CONSTRUCTION, SEALING AND INSTALLATION SHALL BE IN STRICT ACCORDANCE WITH THE INTERNATIONAL MECHANICAL CODE-2018 AND THE JURISDICTIONS LATEST CODE ACCEPTED SMACNA STANDARDS.
- OUTSIDE AIR INTAKES (ROOFTOP UNITS, GRAVITY ROOF VENTS, LOUVERS) SHALL MAINTAIN A MINIMUM OF 10'-0" FROM ANY EXHAUST OR SANITARY VENT.
- PROVIDE ALL MECHANICAL EQUIPMENT WITH MANUFACTURER'S RECOMMENDED SERVICE AREA CLEARANCES.
- ALL ROOFTOP UNITS SHALL BE CONSTRUCTED AND INSTALLED TO WITHSTAND LOCAL WIND LOAD DESIGN.
- SMOKE DETECTORS SHALL BE FURNISHED AND INSTALLED IN RTU BY THE UNIT MANUFACTURER. WIRED TO THE KEY SWITCH BY THE MECHANICAL CONTRACTOR, AND WIRED TO THE FIRE ALARM BY THE FIRE ALARM CONTRACTOR. SMOKE DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 72, NATIONAL FIRE ALARM CODE; NFPA 90A, STANDARD FOR INSTALLATION OF AIR-CONDITIONING AND VENTILATING SYSTEMS, THE INTERNATIONAL MECHANICAL CODE-2018, AND THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. PROVIDE A VISIBLE CALLOUT NOTIFICATION PANEL, MAKE-UP SYSTEM SENSOR (SSAS) OR EQUAL, COMPATIBLE WITH BUILDING FIRE ALARM SYSTEM.
- PLANS AND DIAGRAMS ARE SCHEMATIC ONLY AND SHOULD NOT BE SCALED.
- HVAC CONTRACTOR IS RESPONSIBLE FOR ANY ADDED ELECTRICAL COSTS WHICH MAY RESULT FROM SUBSTITUTED EQUIPMENT.
- PROVIDE EXTERNAL DUCT INSULATION FOR SUPPLY, RETURN AND OUTSIDE AIR DUCTWORK. DUCTWORK INSULATION SHALL BE FOIL FACED FIBERGLASS DUCT WRAP WITH A MINIMUM THERMAL RESISTANCE (R) OF 6.0. INSULATION SHALL HAVE VAPOR BARRIER. INSTALL PER MFR. REQUIREMENTS.
- COORDINATE CEILING MOUNTED DIFFUSERS, REGISTERS, AND GRILLES AND OTHER CEILING MOUNTED EQUIPMENT WITH LIGHTING FIXTURES.
- TURNING VANES SHALL BE PROVIDED IN ALL SUPPLY DUCT RECTANGLES WITH ANGLES BETWEEN 15 DEGREES AND LESS THAN 90 DEGREES PER THE SMACNA HVAC DUCT CONSTRUCTION STANDARDS MANUAL.
- DUCT DIMENSIONS SHOWN ON DRAWINGS ARE CLEAR INSIDE DIMENSIONS.
- DUCTWORK, DIFFUSERS, REGISTERS, GRILLES, AND OTHER ITEMS OF THE AIR HANDLING SYSTEM SHALL NOT BE SUPPORTED BY THE CEILING OR CEILING SUSPENSION SYSTEM.
- UNLESS OTHERWISE NOTED, INSTALL DUCTWORK AS HIGH AS POSSIBLE, TIGHT TO BOTTOM OF STRUCTURE. COORDINATE DUCT ELEVATION WITH STORM LEADERS, WATER PIPING, SANITARY DRAINS AND MAJOR ELECTRICAL CONDUITS.
- CONTRACTOR TO PROVIDE ALL SUPPLEMENTARY STEEL REQUIRED TO SUSPEND MECHANICAL EQUIPMENT & MATERIALS. INSTALLATION OF EQUIPMENT SHALL COMPLY WITH MANUFACTURER'S SPECIFICATIONS AND CLEARANCE REQUIREMENTS FOR SERVICING OF EQUIPMENT.
- VERIFY VOLTAGE WITH ELECTRICAL CONTRACTOR BEFORE ORDERING EQUIPMENT.
- PROVIDE A TRAP IN ALL CONDENSATE PIPING SERVING AIR HANDLING UNITS AND ROOFTOP UNITS. SLOPE CONDENSATE LINE 1/8" PER FOOT. CONDENSATE LINES SHALL BE PVC SCH. 40. ALL CONDENSATE DRAIN PIPING SHALL BE PROPERLY SUPPORTED. SEE "CONDENSATE DRAIN TRAP" DETAIL.
- GUARANTEE FOR ONE YEAR AFTER DATE OF ACCEPTANCE BY THE OWNER. ALL EQUIPMENT, MATERIALS AND WORKMANSHIP TO BE FREE FROM DEFECT.
- DO NOT CUT STRUCTURAL MEMBERS WITHOUT PRIOR WRITTEN APPROVAL OF THE STRUCTURAL ENGINEER.
- FLEXIBLE AND RIGID ROUND DUCT TAKE-OFFS FOR DIFFUSERS SHALL BE THE SAME SIZE AS DIFFUSER NECK. MAXIMUM FLEXIBLE DUCT LENGTH SHALL BE 8'-0". FLEXIBLE DUCT SHALL BE THERMAFLEX TYPE MKC OR EQUAL. FLEXIBLE DUCT SHALL BE INSULATED FIBERGLASS, R-6 CLASS 1, UL 181 LISTED AND COMPLY WITH NFPA 90A AND NFPA 90B.
- ALL WALL MOUNTED TEMPERATURE, HUMIDITY, AND CO2 SENSORS SHALL BE INSTALLED AT AN ELEVATION OF 5'4" ABOVE FINISHED FLOOR TO THE TOP UNLESS OTHERWISE NOTED ON DRAWINGS. LOCATION OF THE WALL MOUNTED SENSORS SHALL BE COORDINATED WITH OTHER TRADES FOR A NEAT APPEARANCE. FINAL LOCATION OF SENSORS SHALL BE SUBJECT TO THE APPROVAL OF THE ENGINEER OR THEIR REPRESENTATIVE IN THE FIELD.
- PROVIDE FLEXIBLE NEOPRENE DUCT CONNECTORS ON THE DISCHARGE AND ENTERING SIDES OF PACKAGED ROOFTOP UNITS, FANS, AND OTHER VIBRATING EQUIPMENT TO WHICH DUCTWORK IS ATTACHED.
- THE GENERAL CONTRACTOR IS RESPONSIBLE FOR INSTALLATION SCHEDULES. COORDINATE WORK SCHEDULE WITH GENERAL CONTRACTOR.
- REFER TO ARCHITECTURAL DRAWINGS FOR ALL RELATED CONSTRUCTION DETAILS AS APPLICABLE TO THE HVAC SYSTEM. CHASE AND WALL PENETRATIONS INTENDED FOR DUCTWORK AND PIPING SHALL BE VERIFIED WITH ARCHITECTURAL DRAWINGS PRIOR TO INSTALLATION.
- MECHANICAL EQUIPMENT, DUCTWORK AND PIPING IS SHOWN AT APPROXIMATE LOCATIONS. FIELD MEASURE FINAL DUCTWORK AND PIPING LOCATIONS PRIOR TO FABRICATION AND MAKE ADJUSTMENTS AS REQUIRED TO FIT THE DUCTWORK AND PIPING WITHIN THE AVAILABLE SPACE. FIELD VERIFY FINAL LOCATIONS TO INSTALL EQUIPMENT IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS REGARDING SERVICE CLEARANCE AND PROPER AIRFLOW CLEARANCE AROUND EQUIPMENT.
- WHEN THE INTENT OF THE DRAWINGS AND SPECIFICATIONS IS NOT CLEAR, OR IS CAPABLE OF MORE THAN ONE INTERPRETATION, SUCH MATTERS WILL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER IN WRITING BEFORE THE SUBMISSION OF BIDS. THE ARCHITECT/ENGINEER SHALL MAKE CORRECTION OR EXPLANATION IN WRITING.
- PLANS AND SPECIFICATIONS ARE INTENDED AS A GENERAL DESCRIPTION OF THE WORK TO BE PERFORMED. ALL ITEMS NOT SPECIFICALLY MENTIONED OR SHOWN, BUT NECESSARY FOR THE COMPLETION OF THE INSTALLATION, SHALL BE FURNISHED AND INSTALLED BY THIS CONTRACTOR. THIS CONTRACTOR SHALL THOROUGHLY ACQUAINT HIMSELF WITH THE MECHANICAL, ARCHITECTURAL, STRUCTURAL, AND ELECTRICAL PLANS BEFORE SUBMITTING HIS FINAL BID. NO ADDITIONAL COMPENSATION WILL BE ALLOWED DUE TO THE CONTRACTOR'S FAILURE TO FAMILIARIZE HIMSELF / HERSELF WITH THE PLANS.
- CONTRACTOR TO ALLOW SUFFICIENT TIME (APPROXIMATELY 2 WEEKS) FOR EQUIPMENT REVIEW. CONTRACTOR SHALL SUBMIT THE FOLLOWING EQUIPMENT FOR REVIEW (1 HARD COPY) PRIOR TO ORDERING AND INSTALLATION: ROOFTOP UNITS, AIR HANDLING UNITS AND AIR COOLED CONDENSERS, DIFFUSERS AND REGISTERS, EXHAUST FANS AND MAKE UP AIR FANS, DUCT INSULATION, DUCT CONSTRUCTION STANDARDS.
- AFTER THE HEATING AND AIR CONDITIONING SYSTEM INSTALLATIONS ARE COMPLETE, THE CONTRACTOR SHALL HAVE EACH SYSTEM TESTED, ADJUSTED, AND BALANCED BY AN INDEPENDENT TESTING AND BALANCING CONTRACTOR. SEE SPECIFICATIONS FOR TESTING AND BALANCING CONTRACTOR CERTIFICATIONS AND REQUIREMENTS. UPON COMPLETION OF TEST AND BALANCE OF ALL SYSTEMS, THE CONTRACTOR SHALL PRESENT THE OWNER AND ARCHITECT WITH A WRITTEN TEST AND BALANCE REPORT IN A TIMELY MANNER PER SPECIFICATIONS.

HVAC ROOFTOP UNIT SCHEDULE

MARK	AREA SERVED	NOMINAL TONS	SUPPLY AIR FAN DATA				ELECTRIC HEAT		UNIT POWER		WEIGHT (LBS.)	COOLING CAPACITY			BASIS OF DESIGN		NOTES					
			COOLING CFM	OUTSIDE AIR	E.S.P. (IN.)	HP	KW @ VOLTAGE CONTROL STAGES	VOLTAGE	PHASE	MCA		MOCP	TOTAL COOLING (T)	SENSIBLE COOLING (T)	EER (EER)	MANUFACTURER		MODEL				
RTU-1	CORE	8.5	3400 CFM	500	0.5	3.75	22.5	1	208 V	3	70	1367	98.1	75.4	76.5	63.9	92/75	12.3	LENNOX ENLIGHT	LC1020H4E	1-20	
RTU-2	DELI	10	4000 CFM	475	0.5	3.75	N/A	N/A	208 V	3	54	70	1396	117	91.1	75.2	62.5	92/75	12.2	LENNOX ENLIGHT	LC120H4E	2-20
RTU-3	RETAIL	7.5	3000 CFM	260	0.5	3.75	22.5	1	208 V	3	70	70	1360	91.8	68.7	76.1	63.5	92/75	12.5	LENNOX ENLIGHT	LC1020H4E	2-20

- NOTES:
- NO SUBSTITUTIONS PERMITTED--
 - PROVIDE CO2 SENSOR FOR INTERLUK WITH BUILDING AUTOMATION SYSTEM.
 - PROVIDE LENNOX HUMIDITROL HOT GAS REHEAT OPTION.
 - PROVIDE REMOTE WALL MOUNTED COMBINATION TEMPERATURE/HUMIDITY SENSOR MODEL 21W06
 - REFER TO CONTROL SYSTEM NOTES FOR CONTROL COMPONENTS REQUIREMENTS
 - PROVIDE 5 MINUTE ANTI-SHORT CYCLE TIMER
 - PROVIDE THROUGH THE BASE ELECTRICAL AND SINGLE POINT CONNECTION
 - PROVIDE WITH FACTORY 2" THROW AWAY PLEATED MERV 8 FILTERS.
 - PROVIDE WITH 18" ROOF CURB.
 - PROVIDE FACTORY 15 AMP GFCI SERVICE OUTLET WITH WEATHERPROOF COVER. COORDINATE WITH ELECTRICAL CONTRACTOR TO PROVIDE FIELD WIRING TO RECEPTACLE.
 - PROVIDE WITH FACTORY INSTALLED DISCONNECT.
 - PROVIDE WITH MOTORIZED DAMPER AND OUTSIDE AIR INTAKE HOOD.
 - PROVIDE MANUFACTURER'S MOTOR AND DRIVE PACKAGE AS REQUIRED TO MEET SCHEDULED AIR CAPACITIES AND PRESSURE DROP.
 - PROVIDE FACTORY APPLIED PHENOLIC COATING FOR CORROSION PROTECTION ON CONDENSER AND EVAPORATOR COILS.
 - PROVIDE BUILDING AUTOMATION SYSTEM (BAS) EQUIPMENT - REFER TO BAS SYSTEM MASTER SPEC FOR SYSTEM DETAILS AND EQUIPMENT PART NUMBERS.
 - PROVIDE FACTORY INSTALLED BACNET BAS INTERFACE.
 - PROVIDE LENNOX DIRTY FILTER SWITCH.
 - PROVIDE LENNOX IMC CONTROL BOARD (STANDARD ON L-SERIES UNITS)
 - TEMPERATURE SETPOINT: 74°F COOLING, 80°F HEATING, HUMIDITY SETPOINT: 50% RELATIVE HUMIDITY.
 - PROVIDE WITH FACTORY CONDENSATE PAN/WATER LEAK MONITORING DEVICE FOR COMPLIANCE WITH IBC 2018, MECHANICAL SECTION 307.2.3.
 - PROVIDE WITH FACTORY INSTALLED SUPPLY AND RETURN SMOKE DETECTORS.

AIR BALANCE SCHEDULE

SYSTEM	CFM
RTU-1	+500
RTU-2	+475
RTU-3	+250
EF-1	-325
EF-2	-400
BUILDING POSITIVE PRESSURE	+500

OUTSIDE AIR CALCULATION

AREA SERVED	AREA (SQFT)	PEOPLE / 1000 SQFT	# PEOPLE	CFM PERSON	PEOPLE O.A. REQ'D (CFM)	CFM SOFT	SOFT PRESSURE (CFM)	TOTAL CFM CALCULATED	CFM SUPPLIED
OFFICE	95	5	2	5	10	0.06	6	16	
HALLWAY	86	-	-	-	-	0.06	6	6	
DELIVERY	104	2	1	10	10	0.12	13	23	
RETAIL	1667	15	25	7.5	188	0.12	199	387	
								432	500
									RTU-1
FOOD SVC	421	20	9	7.5	68	0.12	51	119	
BACKROOM	311	20	7	7.5	53	0.12	38	91	
WASHROOM	134	20	3	7.5	23	0.12	17	40	
								250	475
									RTU-2
									RTU-3
								227	250

- NOTES:
- OCCUPANCY LOAD VENTILATION RATES ARE BASED ON NET OCCUPABLE SPACE IN ACCORDANCE WITH THE INTERNATIONAL MECHANICAL CODE-2018, TABLE 403.3.1.1.
 - ANTICIPATED NUMBER OF PEOPLE IS BASED ON AN OCCUPANCY LOAD FACTOR (# PEOPLE/SQ. FT.) (BASED ON THE INTERNATIONAL MECHANICAL CODE-2018, TABLE 403.3.1.1).

LENNOX SETUP PARAMETERS / FLORIDA AND GEORGIA STORES (R2)

- UNIT ID CONFIGURATIONS (MECHANICAL CONTRACTOR TO DEFINE / AS APPLICABLE):
- BACNET CONFIGURATION: GO TO SETTINGS-GENERAL-CONFIGURATION (ID1 POSITION 5 SET TO "B")
 - NETWORK CONFIGURATION: GO TO SETUP-NETWORK INTEGRATION, SET TO BACNET
 - CONTROL MODE: SET CONTROL MODE TO ROOM SENSOR, CO2, TEMP & HUMIDITY (PER UNIT, AS NEEDED).
- INDIVIDUAL PARAMETER CONFIGURATIONS (MECHANICAL CONTRACTOR TO DEFINE / AS APPLICABLE):
- PARAMETER 105 DEHUMID MODE: 7 NO CONDITIONS
 - PARAMETER 106 DEHUMID SETPOINT: 50 THIS IS A CENTERED SET POINT (+/-)
 - PARAMETER 107 DEHUMID DEADBAND 3 (DEFAULT) THIS IS THE ACTUAL +/- VALUE
 - PARAMETER 117 CO2 DAMPER MAX OPEN %: 50
 - PARAMETER 118 CO2 START OPEN PPM: 1200
 - PARAMETER 119 CO2 FULL OPEN PPM: 1500
 - PARAMETER 137 OCCHEAT SET POINT: 59 (BACK UP)
 - PARAMETER 139 OCC COOLING SET POINT: 72 (BACK UP)
 - PARAMETER 154 OCC BLOWER MODE: ON-CONTINUOUS 1
- CFM VALUES / MS4 FAN SPEEDS (AIR BALANCER TO DEFINE / IF APPLICABLE):
- HEAT CFM VALUE: PER THE HVAC SCHEDULE
 - HIGH COOL CFM VALUE: PER THE HVAC SCHEDULE
 - LOW COOL CFM VALUE: MATCH THE HIGH COOL CFM VALUE
 - VENTILATION CFM VALUE: MATCH THE HIGH COOL CFM VALUE

RTU-1, 2, & 3 TEST AND BALANCE NOTES

- TEST AND BALANCE CONTRACTOR TO OBTAIN INITIAL BALANCE OF COOLING CFM FOR RTU USING FAN SPEED ADJUSTMENT TO WITHIN +/- 5% SCHEDULED COOLING CFM. PRODDGY CONTROLLER MAY BE USED FOR FINAL 5% TO OBTAIN COOLING CFM.
- SET MINIMUM OUTSIDE AIR DAMPER POSITION FOR COOLING AND VERIFY OUTSIDE AIR CFM PER RTU SCHEDULE.
- NOT USED
- NOT USED
- USING PRODDGY CONTROLLER, VERIFY HEATING CFM EQUALS COOLING CFM.
- ALL PRODDGY CONTROLLER SETTINGS OTHER THAN THOSE MENTIONED ABOVE SHALL REMAIN AS THEIR DEFAULT VALUE AS SET FROM THE FACTORY.
- VERIFY POSITIVE BUILDING PRESSURE.

HVAC EXHAUST FAN SCHEDULE

MARK	CFM	External Static Pressure	FAN TYPE	DRIVE TYPE	SONES	HP	FAN RPM	VOLTAGE	PHASE	BASIS OF DESIGN		NOTES
										MANUFACTURER	MODEL	
EF-1	325 CFM	0.250 in-wg	DOWNBLAST	DIRECT	7.5	1/10	1576	120 V	1	GREENHECK	G-980	1,2
EF-2	400 CFM	0.250 in-wg	DOWNBLAST	DIRECT	4.8	1/10	1165	120 V	1	GREENHECK	G-990	1,2

- NOTES:
- NO SUBSTITUTIONS PERMITTED--
 - PROVIDE WITH FACTORY DISCONNECT, FACTORY WIRED SOLID STATE SPEED CONTROLLER, 18" HIGH ROOF CURB WITH DAMPER TRAY, BACKDRAFT DAMPER, AND BIRD SCREEN.
 - WIRE FOR CONTINUOUS OPERATION.
 - PROVIDE WITH FACTORY DISCONNECT & FACTORY WIRED SOLID STATE SPEED CONTROLLER. FAN SHALL BE WIRED TO EMERGENCY SHUTOFF SWITCH PROVIDED BY OTHERS. REFERENCE ARCHITECTURAL AND ELECTRICAL DRAWINGS.

HVAC AIR DEVICE SCHEDULE

TYPE	MARK	MANUFACTURER	MODEL	SERVICE	DESCRIPTION	MOUNTING TYPE	MATERIAL	NECK SIZE	FACE SIZE	NOTES
CD-1	PRICE	AMD	SUPPLY	LOUVERED FACE DIRECTIONAL DIFFUSER	LAY-IN	ALUMINUM	18"X18"	24"X24"	1.7	
CD-2	PRICE	AMD	SUPPLY	LOUVERED FACE DIRECTIONAL DIFFUSER	LAY-IN	ALUMINUM	18"X18"	24"X24"	5.7	
CD-3	PRICE	AMD	SUPPLY	LOUVERED FACE DIRECTIONAL DIFFUSER	SURFACE	ALUMINUM	9"X9"	NECK-6"	6.7	
CD-4	PRICE	AMD	SUPPLY	LOUVERED FACE DIRECTIONAL DIFFUSER	SURFACE	ALUMINUM	6"X6"	NECK-6"	6.7	
G-1	PRICE	630FF	RETURN/TRANEXH	LOUVERED FACE FILTER RETURN GRILLE	LAY-IN	ALUMINUM	20"X20"	NECK-3-3/4"	4	
G-2	PRICE	630FF	TRANSFER	LOUVERED FACE FILTER RETURN GRILLE	SURFACE	ALUMINUM	18"X18"	NECK-3-3/4"	4	
G-3	PRICE	630FF	EXHAUST	LOUVERED FACE FILTER RETURN GRILLE	SURFACE	ALUMINUM	8"X8"	NECK-3-3/4"	4	
G-4	PRICE	630FF	EXHAUST	LOUVERED FACE FILTER RETURN GRILLE	SURFACE	ALUMINUM	6"X6"	NECK-3-3/4"	4	
LD-1	PRICE	TBD4	SUPPLY	48" INSULATED PLENUM W/ (4) 1" SLOTS	LAY-IN	ALUMINUM	SEE PLAN	N/A	2.3	

- NOTES:
- NO SUBSTITUTIONS PERMITTED--
 - FOR LAY-IN CEILING PROVIDE WITH 18"X18" FULL FACE APPEARANCE DIFFUSER NECK. PROVIDE WITH FACTORY SQUARE TO ROUND NECK ADAPTER MODEL "SR". ROUND NECK SIZE SHALL BE EQUAL TO FLEX SIZE SERVING DIFFUSER.
 - PROVIDE WITH PLENUM INTERNALLY LINED WITH COATED FIBERBOARD. EXTERNALLY INSULATE PLENUM UPON INSTALLATION WITH DUCT WRAP INSULATION.
 - PROVIDE WITH CENTER NOTCH OPTION (CN) AS REQUIRED WHEN USED IN 24" T-BAR CEILING.
 - "OR" STYLE (1/4 TURN FASTENERS ONLY) - OMIT HINGE. FILTER TYPE RETURN GRILLES PROVIDED SOLELY FOR MAINTENANCE PURPOSES. OMIT FILTER UPON INSTALLATION.
 - PROVIDE WITH TYPE 6 BEVELED SURFACE MOUNT FRAME AND FACTORY SQUARE TO ROUND NECK ADAPTER MODEL "SR".
 - PROVIDE LAY-IN STYLE FACE DIFFUSER AND ALUMINUM PLASTER FRAME MODEL "APP". COORDINATE LOCATION WITH FIELD FRAMING INSTALLER.
 - PROVIDE WITH FACTORY BACK PAN INSULATION.

HVAC AIR CURTAIN SCHEDULE

MARK	AREA SERVED	MANUFACTURER	MODEL	NOZZLE CFM	HP	VOLTAGE	PHASE	MOUNTING HEIGHT	NOTES
AC-1	STAGING	POWERED AIRE	BCE-1-42	2170 CFM	0.5	120 V	1	7'-2"	1-4
AC-2	DELIVERY VESTIBULE	POWERED AIRE	BCE-1-48	2155 CFM	0.5	120 V	1	7'-2"	1-4

- NOTES:
- NO SUBSTITUTIONS PERMITTED--
 - MOUNT INSIDE BUILDING ABOVE DOOR AT 7'-2" A.F.F. MOUNTING HEIGHT IS FROM BOTTOM OF AIR CURTAIN.
 - PROVIDE ALL NECESSARY MOUNTING BRACKETS AND ACCESSORIES.
 - PROVIDE WITH MODEL SM-300 COMMERCIAL MAGNETIC REED DOOR SWITCH.
 - AIR CURTAIN CONTROLLED BY MAGNETIC REED DOOR SWITCH. FAN ON WHEN DOOR IS OPEN.

2610 Highland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 666-1900
F (407) 666-1901
C-d.com

CUHACI PETERSON

Copyright © All rights reserved. Specifications, concepts, lists, fees, data, notes and other documents are instruments of service prepared by CuHaci Peterson, C.E.P. C.E.P. shall retain all copyright and other intellectual property rights, including the copyright therein. Any use or reproduction of this document without written permission from C.E.P. is a violation of Federal copyright laws.

CLIENT NAME
WAWA
260 WEST BALTIMORE PIKE
WAWA, PENNSYLVANIA 19063

PROJECT NAME
WAWA F110 L V2021.1
STORE #6303
4330 NEW JESUP HWY
BRUNSWICK, GA 31520

DATE
02/15/2024

No.	Description	Date
1	PRELIMINARY SET	01/18/2023
2	PRELIMINARY SET	01/18/2023
3	PRELIMINARY SET	11/29/2023
4	CONSTRUCTION SET	02/15/2024

PROJECT NO.
220554
DATE
04-06-2023
DRAWN
JOF
CHECKED
ESD

M3.0

HVAC SCHEDULES, NOTES, AND DETAILS