

NEW WORK KITCHEN NOTES

Kitchen Hood exhaust design is by the Kitchen equipment supplier.

Total Exhausted air 6,300 CFM (total for all four hoods)

Total Supply Air/Make up air from (DOAS unit) RTU-28 4,900 CFM

Total Deficit air to be made up by Building HVAC 1400 CFM


RTU-27: 2120 CFM OA

Total Building HVAC: 2120 CFM OA

Total Exhaust: 500 CFM

Trash Exhaust: 150 CFM

Total Space Pressure: 2120 - 1400 - 650 = +70 CFM OA

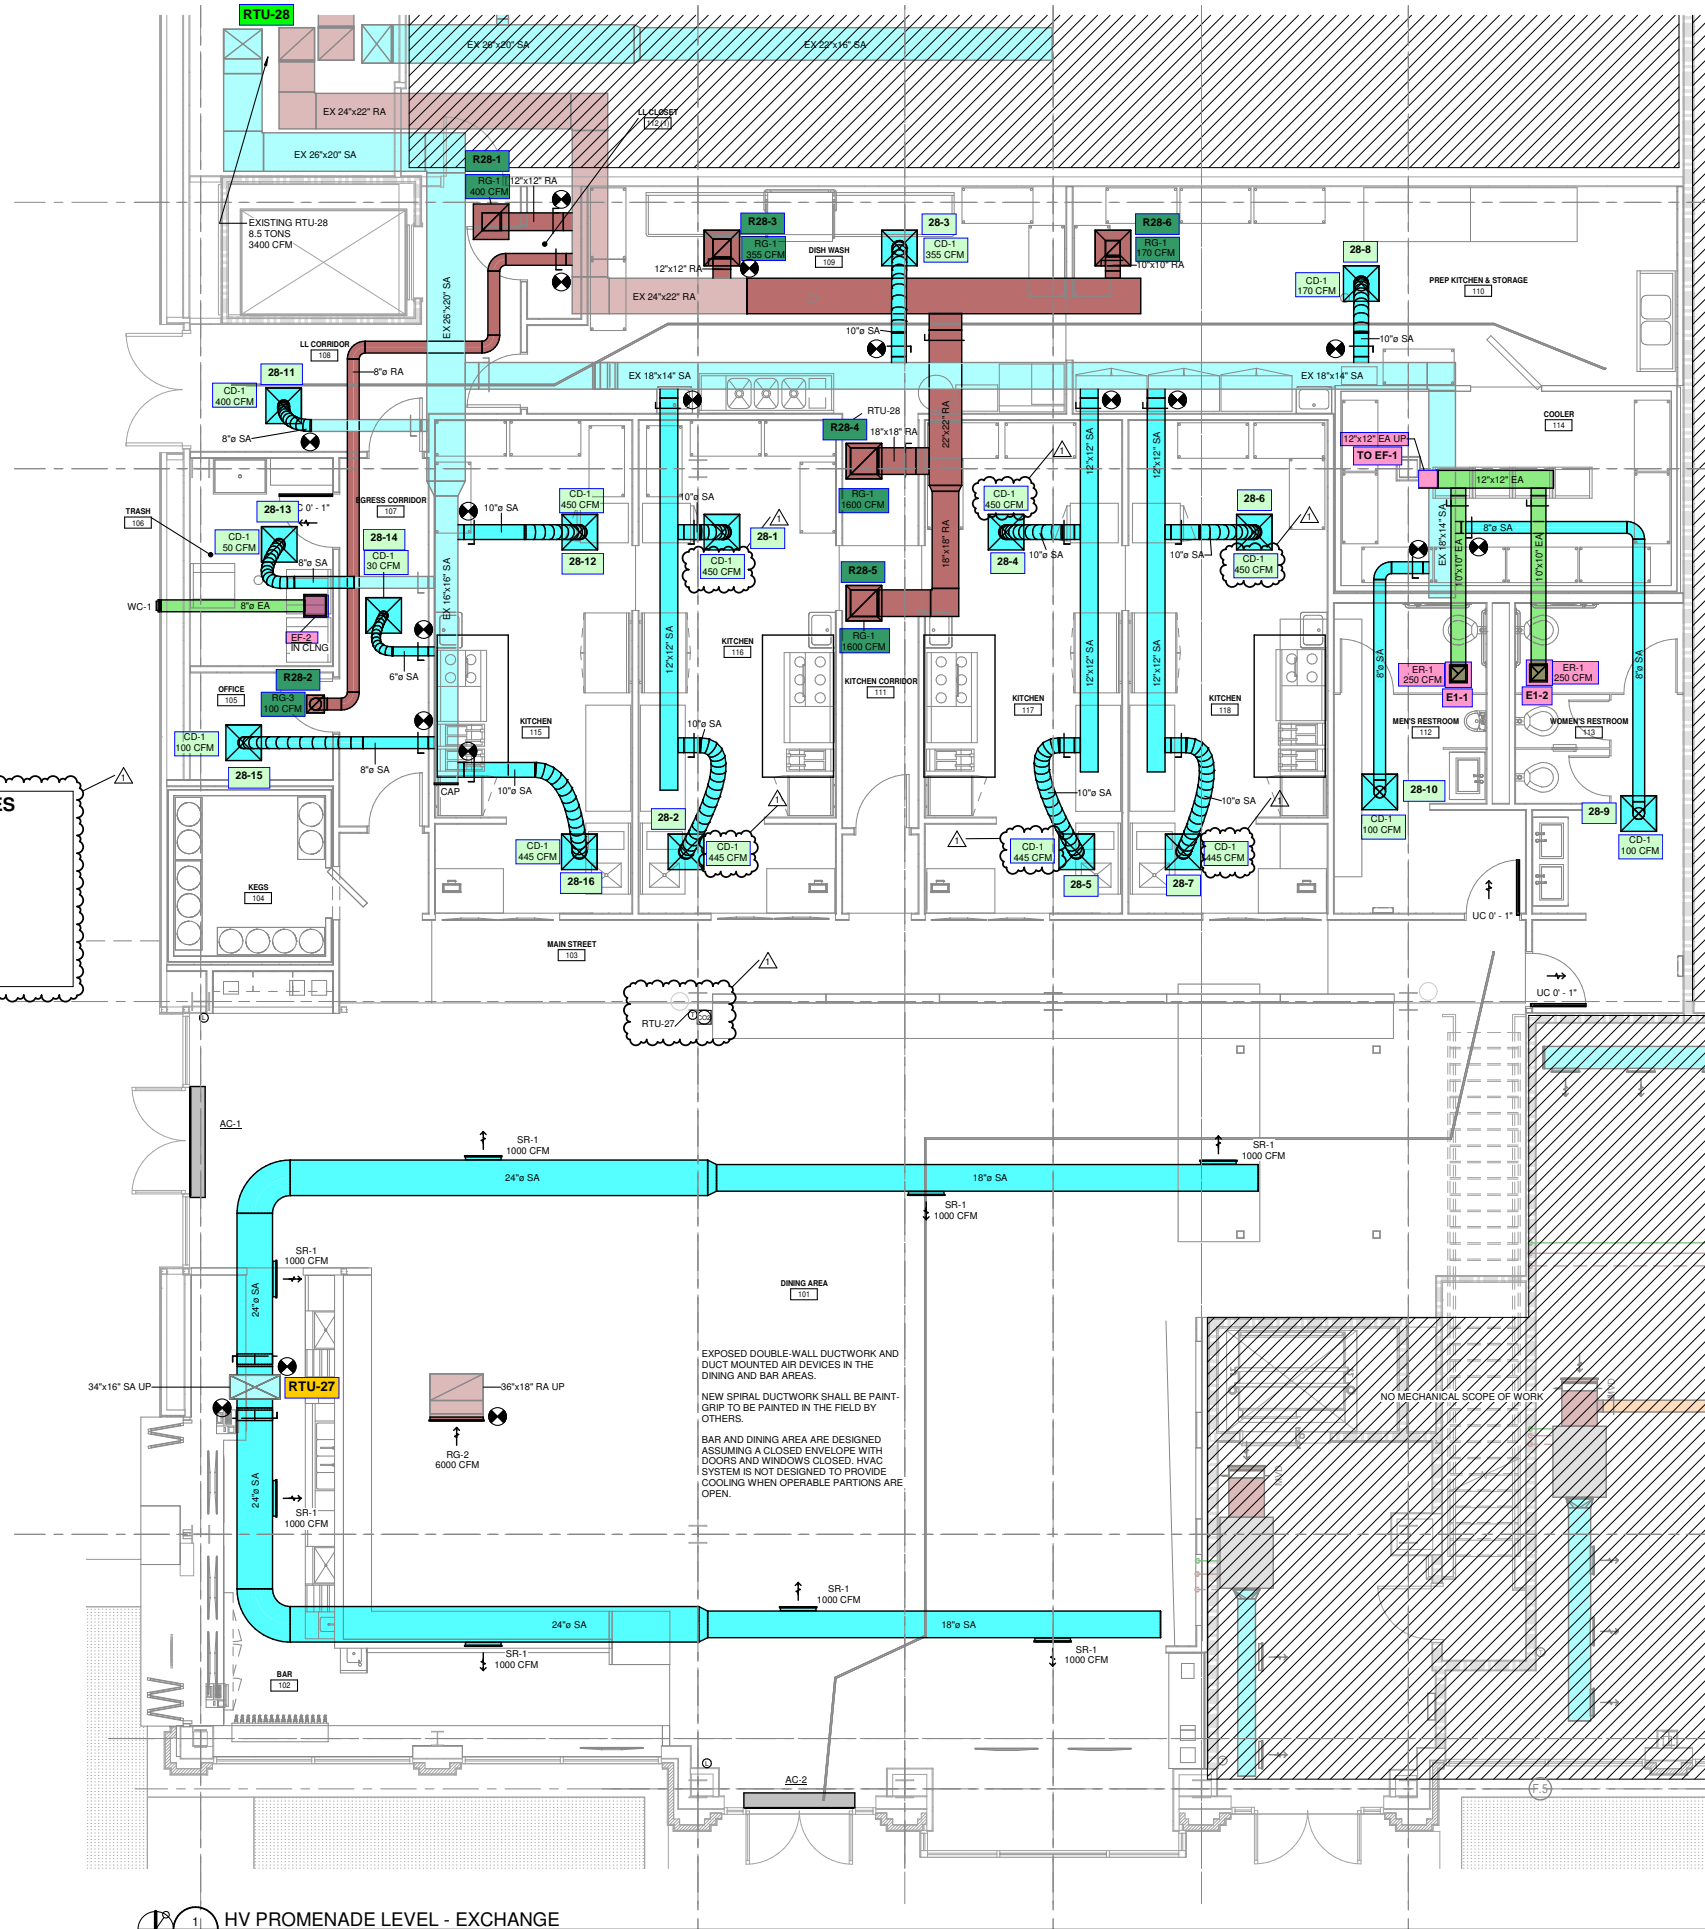

1 HV PROMENADE LEVEL - EXCHANGE

