REGULATORY AGENCIES & UTILITIES

ZONING DEPARTMENT:
LARKSPUR COMMUNITY DEVELOPMENT: PLANNING DIVISION
400 MAGNOLIA AVE.
LARKSPUR, CA 94939
T: (415) 927-5026

BUILDING DEPARTMENT:
LARKSPUR COMMUNITY DEVELOPMENT: BUILDING DIVISION
400 MAGNOLIA AVE.
LARKSPUR, CA 94939
CONTACT: BILL HANSELL
E: BHANSELL@CITYOFLARKSPUR.ORG
T: (415) 927-5031

HEALTH DEPARTMENT:
COUNTY OF MARIN
ENVIRONMENTAL HEALTH SERVICES
3501 CIVIC CENTER DRIVE, ROOM 236
SAN RAFAEL, CA 94903
T: (415) 473-6907

FIRE DEPARTMENT:
CENTRAL MARIN FIRE DEPARTMENT
FIRE CHIEF RUBEN MARTIN
E: RMARTIN@CENTRALMARINEFIRE.ORG
T: (415) 927-5077

SEWER:
ROSS VALLEY SANITARY DISTRICT
1111 ANDERSEN DRIVE
SAN RAFAEL, CA 94901
T:(415) 259-2949 EXT. 201

WATER:
MARIN MUNICIPAL WATER DISTRICT
220 NELLEN AVENUE
CORTE MADERA, CA 94925
T:(415) 945-1455

ELECTRICAL / NATURAL GAS UTILITY:
PACIFIC GAS & ELECTRIC (PG&E)
BUILDING & RENOVATION CENTER
P.O. BOOX 24047
FRESNO, CA 93760
T: (877) 743-7782

TELEPHONE COMPANY:
TBD

SCOPE OF WORK

TENANT IMPROVEMENT OF AN EXISTING LEASED SPACE FOR A FAST CASUAL DINING RESTAURANT

GROUP	TENANT	USE
PREVIOUS USE:	VACANT	M (ASSUMED)
PROPOSED USE:	CHIPOTLE MEXICAL GRILL	A-2 (CHANGE OF USE)

UTILITY COORDINATOR

NOTE to GC:
FOR ALL WATER, SEWER, NATURAL GAS, & ELECTRICITY UTILITIES CONTACT:

GAUCHER & ASSOCIATES INC.
SEASIDE, CA 93955
CONTACT: PAUL GAUCHER
E: PAUL@GAUCHERINC.COM
T: (831) 393-1760
F: (831) 393-2858

SIGN VENDOR

LOREN INDUSTRIES
12226 COAST DR.
WHITTIER, CA 90601
E:DAN.L@LORENINDUSTRIES.COM
T: (562) 328-4800

GRAPHIC SYMBOLS

- EXTERIOR ELEVATION MARKER (1 / A101 / 1)
- INTERIOR ELEVATION MARKER (1 / A101 / 1)
- SECTION MARKER (1 / SIM / A101)
- SECTION / DETAIL (1 / SIM / A101)
- VIEW LABEL — **View Name** (1 / A101, View Scale)
- COLUMN GRID LABEL (0)
- ROOM NAME & NUMBER — **Room name** 101
- NORTH ARROW
- REVISION NUMBER (1)
- DOOR NUMBER (1i)
- MISCELLANEOUS EQUIPMENT NUMBER (XX.X)
- FURNITURE NUMBER (XX.X)
- KITCHEN EQUIPMENT NUMBER (XX.X)
- WASHROOM ACCESSORIES NUMBER (X)
- WALL TAG (W1)
- LEVEL TARGET
- DIMENSION TARGET
- FINISH TAG (P1)

ABBREVIATIONS

℄	CENTER LINE
(E)	EXISTING CONSTRUCTION
(N)	NEW CONSTRUCTION
@	AT
Ø	DIAMETER OR ROUND
AFF	ABOVE FINISH FLOOR
ALUM	ALUMINUM
ARCH	ARCHITECT(URAL)
ASS	ALARM SYSTEM SUPPLIER
BD	BOARD
BLDG	BUILDING
CMU	CONCRETE MASONRY UNIT
CO2	CO2 SUPPLIER
CO2ALAS	CO2 ALARM SUPPLIER
CS	CHEMICAL SUPPLIER
DIM	DIMENSION(S)
EA	EACH
EL	ELEVATION (VERTICAL HEIGHT)
ELEC	ELECTRIC(AL)
ELEV	ELEVATION
EQ	EQUAL
EXT	EXTERIOR
FC	FOR CONSTRUCTION
FRP	FIBERGLASS REINFORCED PANEL
FRT	FIRE RETARDANT-TREATED
GA	GAUGE
GALV	GALVANIZED
GC	GENERAL CONTRACTOR
GYP	GYPSUM
HES	TENANT'S HVAC EQUIPMENT SUPPLIER
HS	HOOD SUPPLIER
HVAC	HEATING AND VENTILATING
ICP	INITIAL COST PROJECTION
IFP	IN FOR PERMIT
INT	INTERIOR
KES	KITCHEN EQUIPMENT SUPPLIER
MAX	MAXIMUM
MECH	MECHANICAL
MFR	MANUFACTURER
MIN	MINIMUM
MISC	MISCELLANEOUS
MSS	MUSIC SYSTEMS SUPPLIER
N.I.C.	NOT IN CONTRACT
NO	NUMBER
OC	ON CENTER
OSB	ORIENTED STRAND BOARD
POS	POINT OF SALE
PREP	PREPARATION
PVC	POLYVINYL CHLORIDE
QT	QUARRY TILE
R	RADIUS
RTU	ROOF TOP UNITS
SIM	SIMILAR
SPS	SODA POP SUPPLIER
SS	SUPPORT SIGNAGE
STR	STRUCTURE
T	TENANT
TAB	TENANT'S TEST & BALANCE VENDOR
TBD	TO BE DETERMINED, SEE FIELD REFERENCE MANUAL
TCC	TENANT'S CABLING CONTRACTOR
TDC	TENANT'S DUCT CLEANER
TEMS	TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER
THS	TENANT'S HARDWARE SUPPLIER
TLS	TENANT'S LIGHT/LAMP SUPPLIER
TMB	TENANT'S MENU BOARD SUPPLIER
TMS	TENANT'S MILLWORK SUPPLIER
TP	TENANT'S PHONE SUPPLIER
TPS	TENANT PANELBOARD SUPPLIER
TRS	TENANT'S RAILING SUPPLIER
TS	TENANT'S SAFE SUPPLIER
TSS	TENANT'S SMART SAFE SUPPLIER
TSV	TENANT'S SIGN VENDOR
TUV	TENANT'S UV SUPPLIER
TYP	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
UPS	UNINTERRUPTED POWER SUPPLY
VAR	VARIES
VIF	VERIFY IN FIELD
W/	WITH
WA	WASHROOM ACCESSORIES
WCS	TENANT'S WALK-IN COOLER SUPPLIER
WHS	WATER HEATER SUPPLIER
WS	TENANT'S WINDOW SHADE SUPPLIER

STORE NUMBER: 04-5647

SIR FRANCIS DRAKE

150 BON AIR CENTER, GREENBRAE, CA 94904

PROJECT DIRECTORY

ARCHITECT OF RECORD:
INTERIOR ARCHITECTS, INC.
A CALIFORNIA CORPORATION
JASON COATS
LICENSE # C-39837
500 SANSOME, 8TH FLOOR
SAN FRANCISCO, CA 94111
T: (415) 434-3305

MEP ENGINEER:
BOWMAN ENGINEERING
4303 E BRIGHTON BLVD #300
DENVER, CO 80216
CONTACT: NICK DONDEY
E: NICK.DONDEY@BOWMAN.COM
T: (720) 853-0205

IA PROJECT CONTACT
INTERIOR ARCHITECTS
MELISSA STONIKINIS
1217 SANSOM STREET, 8TH FLOOR
PHILADELPHIA, PA 19107
E: M.STONIKINIS@INTERIORARCHITECTS.COM
T: (215) 439-4887

STRUCTURAL ENGINEER:
BRITT, PETERS & ASSOCIATES
101 FALLS PARK DR. SUITE 601
GREENVILLE, SC 29601
CONTACT: GARRETT JOHNS
E: GJOHNS@BRITTPETERS.com
T: (864) 271-8869

CLIENT CONTACT:
CHIPOTLE MEXICAN GRILL
PO BOX 182566
COLUMBUS, OH 43218-2566
CONTACT: KIM DE GUZMAN
E: kim.deguzman@chipotle.com
T: (415) 515-7145

CONTRACTOR:
TBD

LANDLORD / OWNER:
KEEGAN & COPPING COMPANY, INC
101 LARKSPUR LANDING CIR.
SUITE 112
LARKSPUR, CA 94939
CONTACT: VESA BECAM
E: VESA@KEEGANCOPPIN.COM
T: (415) 461-1010 EXT. 114

CALIFORNIA GREEN BUILDING REQUIREMENTS

CONSTRUCTION WASTE MANAGEMENT:

1. **RECYCLE AND/OR SALVAGE FOR REUSE A MIN. OF 65% OF THE NONHAZARDOUS CONSTRUCTION AND DEMOLITION WASTE,** OR FOLLOW LOCAL CONSTRUCTION AND DEMOLITION WASTE MANAGEMENT ORDINANCE IF MORE STRINGENT.
2. **SUBMIT A CONSTRUCTION WASTE MANAGEMENT PLAN** TO THE ENFORCING AGENCY COMPLYING WITH ALL LOCAL REQUIREMENTS. AT A MINIMUM THE PLAN MUST MEET THE FOLLOWING:
   - IDENTIFY AND DOCUMENT THE CONSTRUCTION AND DEMOLITION WASTE TO BE DIVERTED FROM DISPOSAL BY EFFICIENT USAGE, RECYCLING, REUSE ON THE PROJECT OR SALVAGE FOR FUTURE USE OR SALE.
   - DOCUMENT IF THE CONSTRUCTION AND DEMOLITION WASTE MATERIALS ARE SORTED ON-SITE (SOURCE SEPARATED) OR BULK MIXED (SINGLE STREAM).
   - DOCUMENT DIVERSION FACILITIES WHERE CONSTRUCTION AND DEMOLITION WASTE MATERIAL COLLECTED WILL BE TAKEN.
   - DOCUMENT THE AMOUNT OF CONSTRUCTION AND DEMOLITION WASTE MATERIALS DIVERTED CALCULATED BY WEIGHT OR VOLUME, BUT NOT BY BOTH. ALL SUCH MATERIALS TO BE TRANSPORTED BY A REGISTERED HAULER TO A REGISTERED FACILITY THAT CAN PROVIDE VERIFIABLE DOCUMENTATION ABOUT PERCENTAGE OF CONSTRUCTION AND DEMOLITION WASTE MATERIAL DIVERTED FROM LANDFILL.
   - THE WASTE MANAGEMENT PLAN SHALL BE UPDATED DURING CONSTRUCTION AND MADE ACCESSIBLE TO THE AUTHORITY HAVING JURISDICTION.
   - REDIRECT CONSTRUCTION, DEMOLITION & PACKAGING DEBRIS TO SOURCES OTHER THAN LANDFILL PROVIDING VERIFIABLE DOCUMENTATION. STRATEGIES MAY INCLUDE:
     - REDIRECT PACKAGING DEBRIS BACK TO THE MANUFACTURER.
     - DONATE SALVAGEABLE MATERIALS TO A RECLAMATION SITE OR NON-PROFIT CHARITY.
     - DESIGNATE RECYCLING AREAS DURING DEMOLITION AND CONSTRUCTION.
     - CONTACT A REGIONAL CARPET RECLAMATION FACILITY FOR SALVAGE OF CARPETING.
     - CONTACT ACOUSTIC CEILING PANEL MANUFACTURER FOR UPCYCLING OPTIONS.
3. **UNIVERSAL WASTE**
   PROVIDE VERIFIABLE DOCUMENTATION TO THE AUTHORITY HAVING JURISDICTION THAT ALL CALIFORNIA PROHIBITED UNIVERSAL WASTE MATERIALS ARE DISPOSED OF PROPERLY AND ARE DIVERTED FROM LANDFILL INCLUDING BUT NOT LIMITED TO.
   - **ELECTRONIC WASTE, CRTS AND CRT GLASS** INCLUDING ANY ELECTRONIC DEVICE THAT IS A HAZARDOUS WASTE AS DEFINED BY THE "DEPARTMENT OF TOXIC SUBSTANCES CONTROL" (DTSC) AS AN "UNIVERSAL WASTE ELECTRONIC DEVICE" (UWED).
   - **BATTERIES**
   - **ELECTRIC LAMPS**: FLUORESCENT TUBES AND BULBS, HIGH INTENSITY DISCHARGE, SODIUM VAPOR, METAL HALIDE, NEON AND ANY OTHER LAMPS THAT CONTAIN MERCURY OR OTHER HAZARDOUS WASTE. (E.G., LEAD).
   - **MERCURY-CONTAINING EQUIPMENT**
   - **NON-EMPTY AEROSOL CANS.**
   - **LEAD CONTAINING ITEMS**
   - **PHOTOVOLTAIC (PV) MODULES**
4. **ADHESIVES, SEALANTS & CAULKS:**
   THE VOC CONTENT OF ADHESIVES, ADHESIVE BONDING PRIMERS, ADHESIVE PRIMERS SEALANTS, SEALANT PRIMERS AND CAULKS USED MUST MEET OR EXCEED THE REQUIREMENTS OF LOCAL OR REGIONAL AIR POLLUTION CONTROL OR AIR QUALITY MANAGEMENT DISTRICT RULES OR SCAQMD RULE 1168 OR BAY AREA AIR QUALITY MANAGEMENT DISTRICT REGULATION 8, RULE 51 AND BE LESS THAN THE CURRENT VOC CONTENT LIMITS OF CALIFORNIA GREEN BUILDING STANDARDS CODE TITLE 24 PART 11 FOR AEROSOL ADHESIVES (CALGREEN 5.504.4.1).
5. **PAINTS AND COATINGS:**
   ARCHITECTURAL PAINTS AND COATINGS TO COMPLY WITH VOC LIMITS OF LOCAL AUTHORITY HAVING LOCAL JURISDICTIONS REQUIREMENTS AND THE IN THE AIR RESOURCE BOARD (ARB) ARCHITECTURAL COATINGS SUGGESTED CONTROL MEASURE AND CALIFORNIA GREEN BUILDING STANDARDS CODE OF REGULATIONS TITLE 24 PART 11 FOR AEROSOL PAINTS 5.504.4.3 PAINTS AND COATINGS.
6. **CARPET AND CARPET CUSHION/PAD:**
   ALL CARPET MUST MEET THE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH STANDARD METHOD FOR THE TESTING AND EVALUATION OF VOLATILE ORGANIC CHEMICAL EMISSIONS FROM INDOOR SOURCES USING ENVIRONMENTAL CHAMBERS VERSION 1.2 (CALIFORNIA SPECIFICATION 01350).
7. **CARPET AND CUSHION/PAD ADHESIVE:**
   MUST MEET CARPET AND RUG INSTITUTE GREEN LABEL PLUS PROGRAM AND NOT EXCEED 50 G/L VOC CONTENT.
8. **COMPOSITE WOOD PRODUCTS:**
   MUST MEET AIR RESOURCE BOARD (ARB) AIR TOXICS CONTROL MEASURE FOR COMPOSITE WOOD (17 CCR 93120 ET SEQ.) INCLUDING THE EMISSIONS LIMITS IN CALGREEN TABLE 5.504.4.5. FOR MAXIMUM FORMALDEHYDE EMISSIONS.
9. **RESILIENT FLOORING SYSTEMS:**
   FOR MIN. 80% OF FLOOR AREA RECEIVING RESILIENT FLOORING, INSTALL RESILIENT FLOORING COMPLYING WITH CALIFORNIA DEPARTMENT OF PUBLIC HEALTH STANDARD METHOD FOR THE TESTING AND EVALUATION OF VOLATILE ORGANIC CHEMICAL EMISSIONS FROM INDOOR SOURCES USING ENVIRONMENTAL CHAMBERS VERSION 1.2 (CALIFORNIA SPECIFICATION 01350).
10. **THERMAL INSULATION:**
    MUST COMPLY WITH THE REQUIREMENTS OF THE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH "STANDARD METHOD FOR TESTING AND EVALUATION OF VOLATILE ORGANIC CHEMICAL EMISSIONS FROM INDOOR SOURCES USING ENVIRONMENTAL CHAMBERS" VERSION 1.2, JANUARY 2017 (EMISSION TESTING METHOD FOR CALIFORNIA SPECIFICATION 01350) (CALGREEN 5.504.4.7) . PROVIDE DOCUMENTATION OF COMPLIANCE DURING SUBMITTAL PROCESS.
11. **ACOUSTICAL CEILING AND WALL PANELS:**
    MUST COMPLY WITH THE REQUIREMENTS OF THE CALIFORNIA DEPARTMENT OF PUBLIC HEALTH "STANDARD METHOD FOR TESTING AND EVALUATION OF VOLATILE ORGANIC CHEMICAL EMISSIONS FROM INDOOR SOURCES USING ENVIRONMENTAL CHAMBERS" VERSION 1.2, JANUARY 2017 (EMISSION TESTING METHOD FOR CALIFORNIA SPECIFICATION 01350) (CALGREEN 5.504.4.8) . PROVIDE DOCUMENTATION OF COMPLIANCE DURING SUBMITTAL PROCESS.

SHEET INDEX

SHEET NO.	SHEET NAME
GENERAL	
G000	COVER SHEET
G001	PROJECT DATA & LIFE SAFETY PLAN
G002	ACCESSIBILITY REQUIREMENTS
G003	ACCESSIBILITY REQUIREMENTS
G004	ENERGY CODE ANALYSIS
G005	CAL GREEN STANDARDS
G006	CAL GREEN STANDARDS
G007	CAL GREEN STANDARDS
G008	CAL GREEN STANDARDS
G010	ARCHITECTURAL SPECIFICATIONS
G011	ARCHITECTURAL SPECIFICATIONS
G012	ARCHITECTURAL SPECIFICATIONS
G013	ARCHITECTURAL SPECIFICATIONS
G014	ARCHITECTURAL SPECIFICATIONS
G015	ARCHITECTURAL SPECIFICATIONS
G016	ARCHITECTURAL SPECIFICATIONS
G017	ARCHITECTURAL SPECIFICATIONS
G018	ARCHITECTURAL SPECIFICATIONS
G019	ARCHITECTURAL SPECIFICATIONS
G020	ARCHITECTURAL SPECIFICATIONS
DEMOLITION	
AD100	DEMOLITION FLOOR PLAN
AD101	DEMOLITION ROOF PLAN
AD103	DEMOLITION EXTERIOR ELEVATIONS
ARCHITECTURAL	
A001	ARCHITECTURAL SITE PLAN
A002	TYP. ARCHITECTURAL SITE DETAILS
A101	SLAB WORK PLAN
A110	ARCHITECTURAL FLOOR PLAN
A111	ARCHITECTURAL FLOOR PLAN DIMENSIONED
A120	FINISH PLAN
A130	FF&E PLAN
A131	EQUIPMENT SCHEDULE
A132	EQUIP. & FURNITURE SCHEDULE
A140	ARCHITECTURAL ROOF PLAN
A141	TYP. ROOF PENETRATION DETAILS
A201	REFLECTED CEILING PLAN
A202	DIMENSIONED REFLECTED CEILING PLAN
A203	REFLECTED CEILING & DUCTWORK PLAN
A210	CEILING DETAILS
A211	LIGHTING DETAILS
A212	TYP. CEILING DETAILS
A220	TYP. MTL. STUD FRAMING DETAILS
A221	TYP. MTL. STUD FRAMING DETAILS
A301	EXTERIOR ELEVATIONS
A401	BUILDING SECTIONS
A402	BUILDING SECTIONS
A406	EXTERIOR DETAILS
A501	ARCHITECTURAL WALL TYPES
A502	INTERIOR SECTIONS
A601	DOOR & HARDWARE SCHEDULE
A602	STOREFRONT DETAILS
A701	ELEVATIONS - INTERIOR DINING
A702	ELEVATIONS - INTERIOR KITCHEN
A710	RESTROOM DETAILS
A801	FINISH DETAILS
A802	TILE DETAILS
A900	INTERIOR PERSPECTIVES
A901	EXTERIOR PERSPECTIVES
STRUCTURAL	
S000	GENERAL NOTES
SD101	DEMO SLAB PLAN
S201	SLAB PLAN
S202	EXISTING ROOF FRAMING PLAN
S301	TYPICAL DETAILS
S302	TYPICAL DETAILS
HVAC	
M010	HVAC SPECIFICATIONS
M011	TITLE 24 FORMS
M012	TITLE 24 FORMS
M100	HVAC PLAN
M600	HVAC SCHEDULES
M700	HVAC DETAILS
M701	HVAC SEISMIC DETAILS
M702	CAPTIVEAIRE SHOP DRAWINGS
M703	CAPTIVEAIRE SHOP DRAWINGS
PLUMBING	
P010	PLUMBING SPECIFICATIONS
P011	TITLE 24 FORMS
P012	TITLE 24 FORMS
P100	PLUMBING PLAN WATER & GAS
P110	PLUMBING PLAN WASTE & VENT
P600	PLUMBING SCHEDULES
P700	PLUMBING DETAILS
ELECTRICAL	
E010	ELECTRICAL SPECIFICATIONS
E011	TITLE 24 FORMS
E012	TITLE 24 FORMS
E100	ELECTRICAL LIGHTING PLAN
E110	ELECTRICAL POWER PLAN
E115	ELECTRICAL SITE POWER PLAN
E600	ELECTRICAL SCHEDULES
E700	ELECTRICAL INTERIOR ELEVATIONS
E705	ELECTRICAL INTERIOR ELEVATIONS
E710	ELECTRICAL DETAILS

CODE REFERENCES

2022 CALIFORNIA BUILDING CODE
2022 CALIFORNIA EXISTING BUILDING CODE
2022 CALIFORNIA MECHANICAL CODE
2022 CALIFORNIA PLUMBING CODE
2022 CALIFORNIA ENERGY CODE
2022 CALIFORNIA GREEN BUILDING STANDARDS CODE
2022 CALIFORNIA ELECTRICAL CODE
2022 CALIFORNIA FIRE CODE
CHAPTER 11B OF 2022 CALIFORNIA BUILDING CODE
2022 CALIFORNIA RETAIL FOOD CODE

GENERAL NOTES

1. CONTRACT DOCUMENTS
   THE CONTRACT DOCUMENTS ARE COMPLEMENTARY AND WHAT IS CALLED FOR BY ANY WILL BE AS BINDING AS IF CALLED FOR BY ALL. THE CONTRACT DOCUMENTS CONVEY THE DESIGN INTENT FOR THE PROJECT. THE CONTRACTOR SHALL CAREFULLY STUDY AND COMPARE THE CONTRACT DOCUMENTS AND SHALL COORDINATE THE WORK OF THE DOCUMENTS WITH THE WORK OF VENDOR PROVIDED INFORMATION ASSOCIATE WITH THE PROJECT. THE CONTRACTOR SHALL DISTRIBUTE COMPLETE CONTRACT DOCUMENTS TO PARTIES RESPONSIBLE FOR PERFORMING THE WORK SO THAT NO PARTY RECEIVES LIMITED INFORMATION.
2. COORDINATION OF THE WORK
   THE CONTRACTOR SHALL ASSUME RESPONSIBILITY FOR REVIEW AND VERIFICATION OF THE CONTRACT DOCUMENTS, FIELD CONDITIONS, VENDOR DESIGN DRAWINGS INCLUDING DELEGATED DESIGN WORK BY OTHERS, AND DIMENSIONS FOR ACCURACY AND FOR CONFIRMING THE WORK IS CONSTRUCTIBLE PRIOR TO PROCEEDING WITH THE WORK. THE CONTRACTOR SHALL COORDINATE THE WORK WITH THE BUILDING OWNER SO AS NOT TO DISTURB OR CAUSE DAMAGE TO OTHER TENANT SPACES OR BUILDING AREAS. THE CONTRACTOR SHALL SECURE A CURRENT COPY OF PUBLISHED CONSTRUCTION/CONTRACTOR BUILDING GUIDELINES AND REGULATIONS FROM THE BUILDING MANAGEMENT AND COMPLY. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT OF RECORD IN WRITING OF CONFLICTS AND OBTAIN A WRITTEN CLARIFICATION FROM THE ARCHITECT OF RECORD PRIOR TO PROCEEDING WITH THE WORK.
3. DIMENSIONS
   DO NOT SCALE DRAWINGS. DIMENSIONS AND WORKPOINTS PROVIDED ARE TO STRUCTURAL GRID OR TO EXPOSED FACE OF A FINISH, UNLESS OTHERWISE NOTED. CONTRACTOR SHALL VERIFY DIMENSIONS WITH CONDITIONS IN THE FIELD AND SHALL SECURE WRITTEN RESOLUTION OF CONFLICTS FROM THE ARCHITECT PRIOR TO INITIATING THE WORK. DO NOT ADJUST DIMENSIONS INDICATED AS "CLEAR" OR "HOLD" WITHOUT WRITTEN DIRECTION FROM ARCHITECT. CONTRACTOR TO NOTIFY ARCHITECT OF ANY DIMENSIONS THAT DIFFER BY MORE THAN "1 INCH", INCLUDING THOSE MARKED "VIF" AND "+/-".
4. DELEGATED DESIGN WORK BY OTHERS
   SYSTEMS INDICATED AS DELEGATED DESIGN SHALL BE ENGINEERED, AND STAMPED BY QUALIFIED PROFESSIONAL ENGINEERS LICENSED IN THE JURISDICTION OF THE WORK. IT IS THE RESPONSIBILITY OF THE ENGINEER OF RECORD FOR THESE SYSTEMS TO SECURE AGENCY APPROVALS, INCLUDING REQUIRED FEES ASSOCIATED WITH PERMIT APPROVAL. THESE SYSTEMS SHALL BE COORDINATED WITH THE CONTRACT DOCUMENTS AND SHALL COMPLY WITH APPLICABLE LEGAL REQUIREMENTS INCLUDING COMPREHENSIVE ENGINEERING ANALYSIS UTILIZING PERFORMANCE AND DESIGN CRITERIA INDICATED IN THE CONTRACT DOCUMENTS.

DEFINITIONS

ALIGN	TO ACCURATELY LOCATE FINISH FACES IN THE SAME PLANE
CLEAR / CLR / HOLD	DIMENSIONS ARE ABSOLUTES, UNOBSTRUCTED FROM FACE OF EXPOSED FINISH SURFACES.
DEMOLISH / DEMO	TO DECONSTRUCT COMPLETE SYSTEM, HAUL, AND DISPOSE OF MATERIAL, INCLUDING APPROPRIATE PULL BACK AND TERMINATION/CAPPING OF RELATED BUILDING SERVICES
SALVAGE	DIS-ASSEMBLE, CONVEY OR STORE MATERIAL PER OWNERS INSTRUCTIONS
REUSE	SALVAGE, STORE ON SITE, RE-INSTALL
INSTALL	ON-SITE OPERATIONS INCLUDING UNLOADING, TEMPORARY STORAGE, UN-PACKING, ASSEMBLY, PLACING, ANCHORING, APPLYING, FINISHING, PROTECTING, AND CLEANING COMPLETE AND OPERATIONAL ELEMENTS, EQUIPMENT, AND SYSTEMS
FURNISH	PROCURE AND STORE ON-SITE MATERIAL FOR INSTALLATION BY OTHERS
PROVIDE	FURNISH AND INSTALL COMPLETE AND OPERATIONAL SYSTEM
NOTIFY	TO INFORM THE STATED PARTIES IN WRITING AND SEEK RESOLUTION PRIOR TO COMENCING WORK

VICINITY MAP

1 / G000 TRUE — **VICINITY MAP** — 12" = 1'-0"

150 BON AIR CENTER, GREENBRAE, CA 94904

KEY PLAN



PLAN NORTH / 2 / G000 TRUE — **KEY SITE PLAN** — 1" = 100'-0"

PROJECT INFORMATION

PARCEL NO.:	022-040-30
PROJECT ADDRESS:	150 BON AIR CENTER, GREENBRAE, CA 94904
ZONE/DISTRICT:	PD - PLANNED DEVELOPMENT DISTRICT
PROJECT DESCRIPTION:	TENANT IMPROVEMENT OF A SINGLE-STORY BUILDING FOR A FAST CASUAL DINING RESTAURANT. EXTERIOR ENVELOPE ALTERATIONS LIMITED TO STOREFRONT ENTRY AND WINDOW SYSTEMS, NEW HOLLOW METAL DOOR, PARAPET EXTENSION, AND MISCELLANEOUS ROOF REPAIRS AND MODIFICATIONS ASSOCIATED WITH ROOF EQUIPMENT. THE SCOPE OF WORK CONSISTS OF NEW NON-STRUCTURAL INTERIOR PARTITIONS, SUSPENDED CEILINGS, FURNITURE, FINISHES, CASE WORK FOOD SERVICE EQUIPMENT WITH RELATED ELECTRICAL, PLUMBING, MECHANICAL WORK.
TYPE OF CONSTRUCTION:	V-B (ASSUMED)
PROPOSED BUILDING OCCUPANCY:	A-2 (CHANGE OF USE)
PROJECT AREA:	30,054 SF APPROX.
BUILDING NO. OF STORIES:	1
SEISMIC DESIGN CATEGORY:	D
BUILDING LIFE SAFETY INFO:	FULLY SPRINKLERED BUILDING
ADDITIONAL REQUIREMENTS:	1. ALL INTERIOR FINISHES SHALL COMPLY WITH THE REFERENCED CODE REQUIREMENTS FOR FLAMMABILITY AND SMOKE DEVELOPED RATINGS AS WELL AS TOXICITY. **WALL AND CEILINGS (PER ASTM E84 OR UL723)** INTERIOR EXIT STAIRWAYS, RAMPS AND EXIT PASSAGEWAYS A-2 OCCUPANCY - CLASS B (SPRINKLERED BUILDING) CORRIDORS AND ENCLOSURE FOR EXIT ACCESS STAIRWAYS AND RAMPS: A-2 OCCUPANCY - CLASS B (SPRINKLERED BUILDING) ROOMS AND ENCLOSED SPACES: A-2 OCCUPANCY - CLASS C (SPRINKLERED BUILDING) **FLOORING (PER ASTM E648 OR NFPA 253): CLASS II** CRITICAL RADIANT FLUX OF NOT LESS THAN 0.22 WATTS PER SQUARE CENTIMETER **FLAME SPREAD AND SMOKE-DEVELOPED INDEX** CLASS A: FLAME SPREAD: 0 - 25; SMOKE-DEVELOPED: 0 - 450 CLASS B: FLAME SPREAD: 26 - 75; SMOKE-DEVELOPED: 0 - 450 CLASS C: FLAME SPREAD: 76 - 200; SMOKE-DEVELOPED: 0 - 450
DEFERRED SUBMITTALS & DELEGATED DESIGN WORK BY OTHERS UNDER SEPARATE PERMIT:	SEPARATE PERMT - EXTERIOR SIGNAGE. DEFERRED SUBMITTAL - SPRINKLER MODIFICATIONS, ANSUL FIRE SUPRESSION SYSTEM, SEISMIC RACKING CALCS (BY VENDOR). DELEGATED DESIGN (AS REQUIRED) - LIGHT GAUGE METAL FRAMING.

HAZARDOUS MATERIAL NOTES

- INTERIOR ARCHITECTS SHALL HAVE NO RESPONSIBILITY FOR THE DISCOVERY, REMOVAL, PRESENCE, HANDLING, DISPOSAL OF, OR EXPOSURE OF PERSONS TO HAZARDOUS SUBSTANCES, MATERIALS, AND WASTES IN ANY FORM AT THE PROJECT SITE, INCLUDING BUT NOT LIMITED TO: ASBESTOS, ASBESTOS PRODUCTS, PCB MOLD, OR OTHER TOXIC OR HARMFUL SUBSTANCES.
- QUESTIONS THAT ARISE RELATED TO HAZARDOUS MATERIALS SHALL BE REFERRED TO THE OWNER FOR RESOLUTION. INTERIOR ARCHITECTS SHALL NOT BE REQUIRED TO DO WORK NOR RENDER OPINIONS RELATED TO HAZARDOUS MATERIALS.
- CONTRACTORS SHALL REPORT THE PRESENCE OF MATERIAL OR ASSEMBLIES SUSPECTED TO CONTAIN HAZARDOUS MATERIALS UPON DISCOVERY TO THE OWNER. WORK SHALL BE HALTED UNTIL WRITTEN CLEARANCE TO CONTINUE HAS BEEN PROVIDED BY THE OWNER'S CERTIFIED HAZARDOUS MATERIALS CONSULTANTS.

FURNITURE, FLOOR CORE & LIGHTING COORDINATION

CONTRACTOR, FURNITURE VENDOR, DESIGN BUILD SUB-CONTRACTORS AND OWNER'S SUBCONTRACTORS ARE ALL REQUIRED TO USE THE ARCHITECTURAL DIMENSION WORK POINTS ESTABLISHED FOR OPEN PLAN PENDANT LIGHTING AND FURNITURE CENTERLINES WHERE APPLICABLE. CONTRACTOR AND VENDOR PREPARED SHOP DRAWINGS SHALL DOCUMENT THE ARCHITECTURAL DIMENSION WORK POINTS FOR THE ARCHITECT'S REVIEW PRIOR TO START OF WORK. FIELD LAYOUT REVIEW REQUESTED OF THE ARCHITECT MUST UTILIZE ON ESTABLISHED WORK POINTS. FLOOR CORE LOCATIONS SERVING FURNITURE ARE THE SOLE RESPONSIBILITY OF THE FURNITURE VENDOR, INCLUDING FIELD VERIFICATION OF LAYOUT CONSISTENT WITH THE FLOOR CORING REQUIREMENTS IDENTIFIED HEREIN.

ENERGY CODE INFORMATION

REFER TO SHEET G004 FOR ADDITIONAL INFORMATION.

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
COVER SHEET

G000

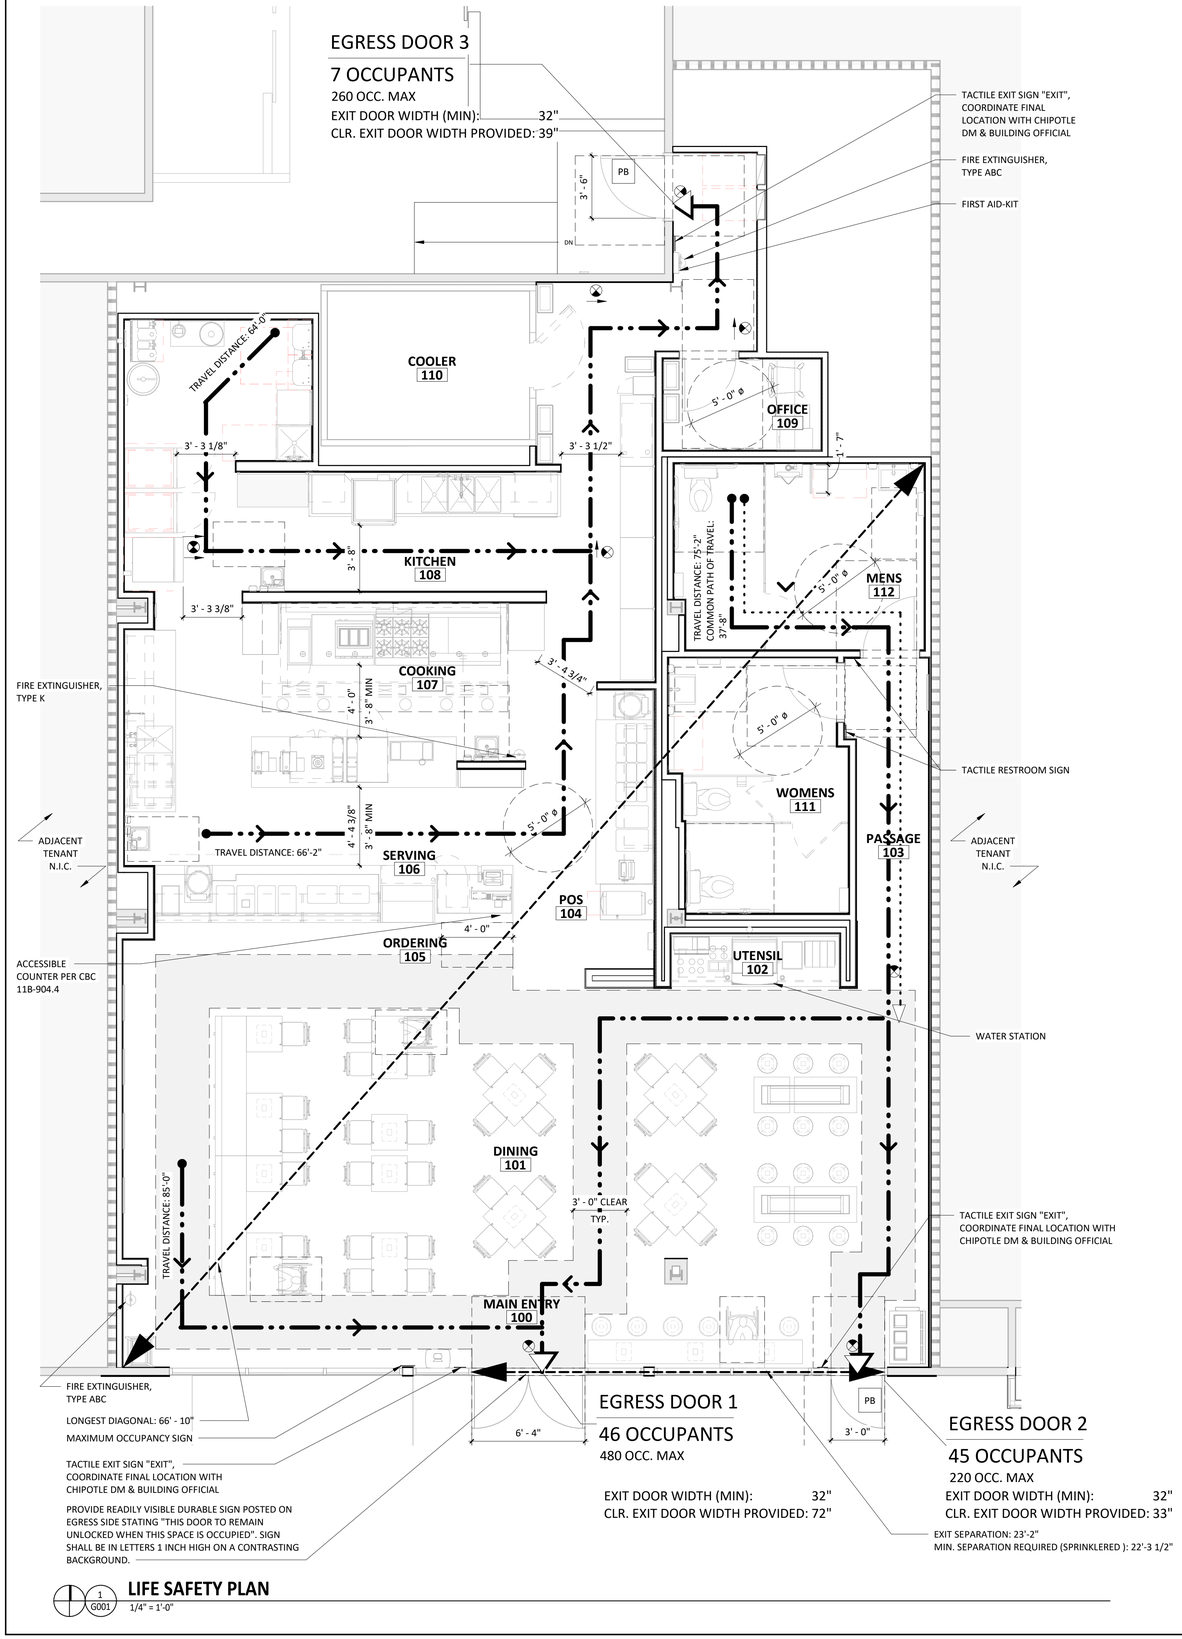

1 G001 **LIFE SAFETY PLAN**
1/4" = 1'-0"

GENERAL LIFE SAFETY NOTES

1. CONTRACTOR SHALL FIELD VERIFY EXISTING FIRE RATED CONTRUCTION ASSEMBLIES DENOTED IN THE DRAWINGS.
   CONTRACTOR SHALL NOTIFY ARCHITECT IN WRITING OF CONFLICTS BETWEEN THE AS-BUILT CONDITION AND THE DRAWINGS. PRIOR TO PROCEEDING WITH THE WORK THE CONTRACTOR SHALL SUBMIT A PROPOSAL FOR THE COST AND SCHEDULE OF UPGRADING EXISTING ASSEMBLIES DENOTED AS FIRE RATED TO A CODE COMPLIANT LEVEL.

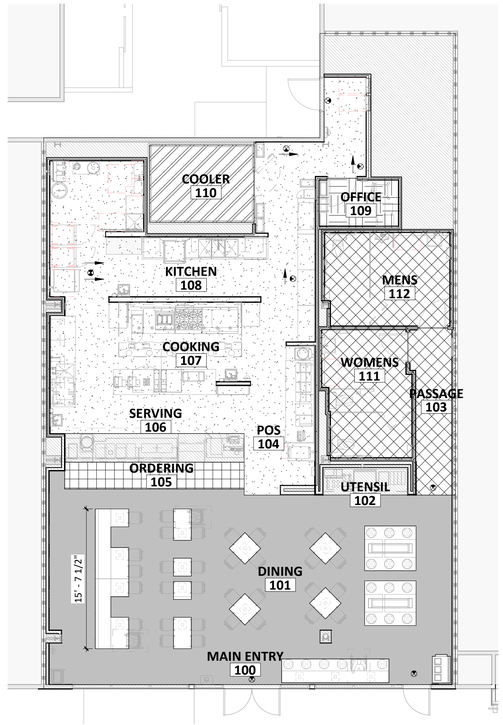

2 G001 **OCCUPANCY DIAGRAM**
1/8" = 1'-0"

SIGNAGE

COMPLETE INTERIOR ACCESSIBLE SIGNAGE SHALL BE PROVIDED AT LOCATIONS INCLUDING BUT NOT LIMITED TO:
- ROOM IDENTIFICATION
- DIRECTIONAL AND INFORMATIONAL
- ACCESSIBLE ENTRANCE AT MAIN ENTRY LOBBY
- ELEVATOR CAB OPERATING PANEL
- ELEVATOR ENTRANCE FLOOR IDENTIFICATION AT JAMB
- RESTROOMS
- ELEVATOR LOBBY EMERGENCY EVACUATION

TACTILE EXIT SIGNS SHALL BE PROVIDED AT LOCATIONS INCLUDING BUT NOT LIMITED TO:
- GRADE LEVEL EXIT DOORS "EXIT"
- EXIT DOORS LEADING TO GRADE LEVEL EXIT DOORS (STAIRWELL DOORS) "EXIT STAIR DOWN"
- EXIT DOORS LEADING TO GRADE LEVEL EXTERIOR EXIT "EXIT"
- EXIT ACCESS DOOR LEADING FROM ROOM OR AREA WITH VISUAL EXIT SIGN; "EXIT ROUTE"

PROVIDE "EMERGENCY EVACUATION MAPS" AND SIGNS WHERE REQUIRED PER LOCAL JURISDICTION.

ACCESSIBLE SIGNAGE SHALL BE PROVIDED AS NON-GLARE OVER CONTRASTING BACKGROUND, 1/32" RAISED CHARACTERS, TEXT HEIGHT 5/8" TO 2" AND PICTOGRAMS SHALL BE 6" HIGH MIN. MOUNTING HEIGHT MIN. 4'-0" ABOVE FINISHED FLOOR TO LOWEST BRAILLE AND MAX. 5'-0" TO BOTTOM OF HIGHEST LINE OF RAISED TEXT. MOUNT SIGNS TO LATCH SIDE OF DOOR. AT DOUBLE DOORS AT THE NEAREST WALL PREFERABLE AT THE RIGHT OF THE OPENING.

SELF ILLUMINATING FLOOR LEVEL EXIT SIGNS SHALL BE PROVIDED AT "I" AND "A" OCCUPANCY. E.G. TRITIUM SELF ILLUMINATING FOR 10 YEARS, GREEN FACE, WHITE HOUSING OR SIMILAR.

BUILDING CODE & ZONING DATA

1. OCCUPANCY GROUP: A-2
   OCCUPANCY SEPARATION REQUIRED: 1 HOUR
   OCCUPANCY SEPARATION PROVIDED: 1 HOUR (EXISTING)
2. TYPE OF CONSTRUCTION: V-B (ASSUMED) SPRINKLERED
3. USE GROUP: A-2
   TENANT LEASE AREA: 2,325 S.F.
4. NO. OF EXISTING STORIES: 1
   PROPOSED NO. OF STORIES: 1 (NO CHANGE)
5. CALCULATED OCCUPANT LOAD

OCCUPANCY FUNCTION	AREA	LOAD FACTOR	OCCUPANT LOAD
INTERIOR			
ASSEMBLY (UNCONCENTRATED)	793.8 SF	15 NET	53 OCCS
ASSEMBLY (STANDING SPACE)	60.2 SF	5 NET	13 OCCS
ASSEMBLY W/FIXED SEATS	191 SF	CBC SECTION 1004.6	25 OCCS
BUSINESS	51.7 SF	150 GROSS	1 OCC
KITCHEN - COMMERCIAL	944.9 SF	200 GROSS	5 OCCS
STORAGE	101.1 SF	300 GROSS	1 OCC
ACCESSORY	390 SF	-	-
NON OCCUPIABLE	497.7 SF	-	-
		INTERIOR TOTAL:	98 OCCS

POSTED OCCUPANT LOAD
TOTAL OCCUPANT LOAD TO BE POSTED: *99 OCC. (MAX OCCUPANCY)*

SEATING:
INTERIOR: 59 SEATS

6. MEANS OF EGRESS REQUIRED: 2
   MEANS OF EGRESS PROVIDED: 3
7. FIRE SPRINKLERS: YES
8. PLUMBING FIXTURES
   PLUMBING FIXTURES REQUIRED (PER 2022 CPC, TABLE 422.1)

	WATER CLOSETS REQ'D	WATER CLOSETS PROV'D	LAVORATORIES REQ'D	LAVORATORIES PROV'D	URINALS REQ'D	URINALS PROV'D
MEN'S:	1	1	1	1	1	1
WOMEN'S:	2	2	1	1	-	-

SERVICE SINK

REQ'D	PROV'D
1	1

EXITING LEGEND

- EXISTING DEMISING WALL - 1HR RATED (ASSUMED)
- EXIT ACCESS = LESS THAN 250' AT A-2 OCCUPANCY IN SPRINKLERED BUILDING
- COMMON PATH OF EGRESS = LESS THAN 75' AT A-2 OCCUPANCY IN SPRINKLERED BUILDING
- EXIT SIGNAGE
- EXIT / ACCESS TO EXIT
- FIRE EXTINGUISHER
- PB — PANIC BAR
- 3' - 0" — HATCH INDICATING CLEAR PATH OF EGRESS PATH - FOR REFERENCE ONLY

CODE AUTHORITIES

BUILDING CODE	2022 CALIFORNIA BUILDING CODE
EXISTING BUILDING CODE	2022 CALIFORNIA ECXISTING BUILDING CODE
MECHANICAL CODE	2022 CALIFORNIA MECHANICAL CODE
PLUMBING CODE	2022 CALIFORNIA PLUMBING CODE
ENERGY CODE	2022 CALIFORNIA ENERGY CODE
SUSTAINABILITY	2022 CALIFORNIA GREEN BUILDING CODE STANDARDS
ELECTRICAL CODE	2022 CALIFORNIA ELECTRICAL CODE
FIRE CODE	2022 CALIFORNIA FIRE CODE
ACCESSIBILITY	CHAPTER 11B OF THE CALIFORNIA BUILDING CODE
FOOD/RESTAURANT CODE	2022 CALIFORNIA RETAIL FOOD CODE

EGRESS SEPARATION NOTE

- OVERALL DISTANCE: **66' - 10"**
- REQUIRED SEPARATION: 22' - 3 1/2"

PER 2022 CALIFORNIA BUILDING CODE, SECTION 1007.1.1, EXCEPTION 2.

- PROVIDED SEPARATION: **23' - 2"**

OCCUPANCY LEGEND

- BUSINESS 1:150 GROSS
- ASSEMBLY (A-2, UNCONCENTRATED - TABLES AND CHAIRS) 1:15 NET
- ASSEMBLY (STANDING SPACE) 1:5 NET
- FIXED SEATING, PER 2022 CBC, SECTION 1004.6
- STORAGE 1:300 GROSS
- KITCHEN, COMMERCIAL 1:200 GROSS
- NON-OCCUPIABLE
- ACCESSORY 'a'

a. AREA UNCLUDING UNOCCUPIED ACCESSORY AREAS SUCH AS CORRIDORS, TOILET ROOMS, MECHANICAL ROOMS AND CLOSETS. INCLUDES WALLS AND FURRED-IN SPACES.

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
PROJECT DATA & LIFE SAFETY PLAN

G001

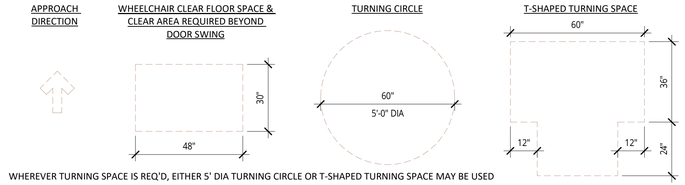

WHEREVER TURNING SPACE IS REQ'D, EITHER 5' DIA TURNING CIRCLE OR T-SHAPED TURNING SPACE MAY BE USED

5 2022 CBC CHAPTER 11B CLEARANCES - TYPICAL SYMBOLS

3/8" = 1'-0"

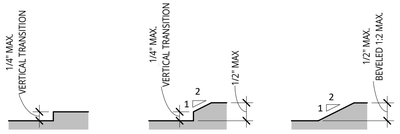

3 2022 CBC CHAPTER 11B CLEARANCES - FLOOR LEVEL TRANSITIONS

3/8" = 1'-0"



LIMITS OF PROTRUDING OBJECTS

OBJECTS IN ANY PATH OF CIRCULATION ARE REQUIRED TO COMPLY WITH LIMITS SHOWN HERE. OBJECTS THAT CANNOT COMPLY, SUCH AS STANDPIPES IN STAIRS AND CONTROL BOXES IN PARKING GARAGE, SHALL HAVE ADDED CANE DETECTION.

4 2022 CBC CHAPTER 11B CLEARANCES - PROTRUDING OBJECTS

3/8" = 1'-0"

SIDE REACH DIAGRAMS

FORWARD REACH DIAGRAMS

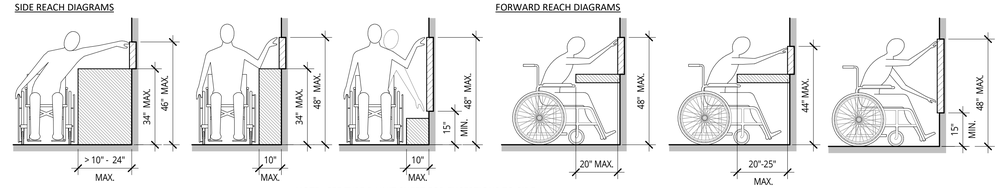

NOTE: SEE TYPE B UNIT SHEET FOR EXCEPTIONS TO SIDE REACH WITHIN TYPE B RESIDENTIAL UNITS

2 2022 CBC CHAPTER 11B CLEARANCES - REACH DIAGRAMS

3/8" = 1'-0"

MANEUVERING CLEARANCE AT MANUAL SWINGING DOORS

NOTE: DOOR MANEUVERING CLEARANCES MEASURED FROM FACE OF WALL BASE TRIM TO NEAREST OBSTRUCTION

PULL SIDE - FRONT APPROACH

PULL SIDE - HINGE APPROACH

PULL SIDE - LATCH APPROACH

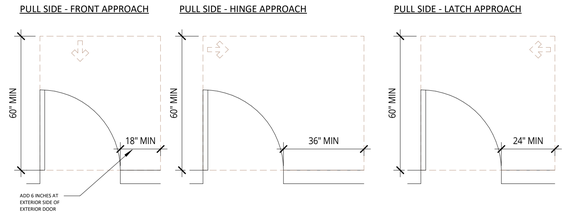

PUSH SIDE - FRONT APPROACH

PUSH SIDE - FRONT APPROACH WITH LATCH & CLOSER

PUSH SIDE - HINGE APPROACH WITHOUT LATCH & CLOSER

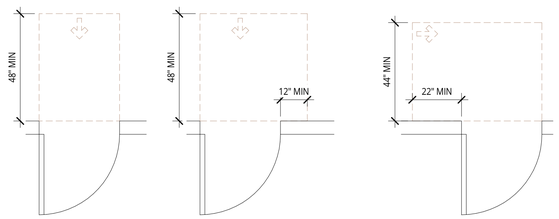

PUSH SIDE - HINGE APPROACH WITH LATCH & CLOSER

PUSH SIDE - LATCH APPROACH

PUSH SIDE - LATCH APPROACH WITH LATCH & CLOSER

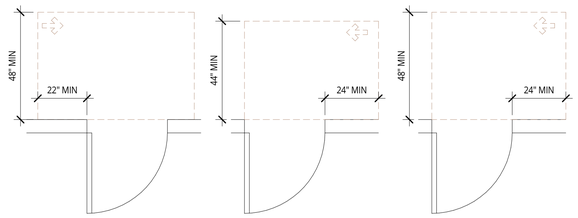

1 2022 CBC CHAPTER 11B CLEARANCES - DOOR MANEUVERING CLEARANCES

3/8" = 1'-0"

MANEUVERING CLEARANCE AT SLIDING DOORS, FOLDING DOORS, AND OPENINGS

FRONT APPROACH

SIDE APPROACH

POCKET OR HINGE APPROACH

STOP OR LATCH APPROACH

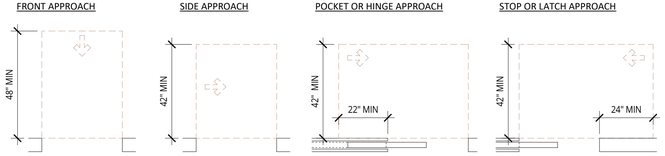

ACCESSIBLE ROUTE WIDTH

DOORS FOR USER PASSAGE AND >24" DEEP CLOSET

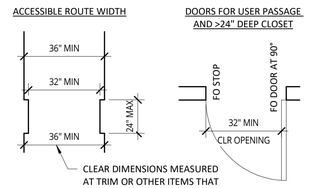

MANEUVERING CLEARANCE AT RECESSED DOORS

RECESSED DOORS - PULL SIDE

RECESSED DOORS - PUSH SIDE

RECESSED DOORS - PUSH SIDE WITH CLOSER AND LATCH

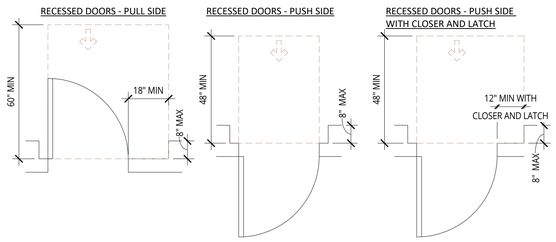

BIFOLD DOORS INTENDED FOR USER PASSAGE AND >24" DEEP CLOSET

SLIDING DOORS INTENDED FOR USER PASSAGE AND >24" DEEP CLOSET



GENERAL NOTES - ACCESSIBILITY SHEETS

A. THESE PICTOGRAPHS DO NOT DESCRIBE ALL CONDITIONS WHICH MAY BE ENCOUNTERED IN THE FIELD. VERIFY QUESTIONS WITH ARCHITECT
B. INFORMATION IN THESE DRAWINGS IS COMPLEMENTARY TO THE PLANS, SECTIONS, ELEVATIONS AND DETAILS, AND SHALL BE USED IN CONJUNCTION WITH THEM
C. PROVIDE WORK SHOWN OR REFERRED TO HEREIN AS THOUGH SHOWN ON ALL OTHER ARCHITECTURAL DRAWINGS
D. INFORMATION REGARDING THE LOCATION OF MECHANICAL, ELECTRICAL AND PLUMBING ITEMS IS PROVIDED AS DESIGN CRITERIA FOR THE CONVENEINCE OF THOSE DESIGNERS OF RECORD WHO SHALL BEAR RESPONSIBLITY FOR COMPLIANCE WITH THE APPLICABLE CODE STANDARDS ILLUSTRATED AND CITED HEREIN
E. PROVIDE GRAB BARS, AS ILLUSTRATED HEREIN, WITHIN PUBLIC SPACES.
F. COMPLY WITH MOUNTING HEIGHTS INDICATED HEREIN FOR WALL-MOUNTED ITEMS. MOUNTING HEIGHTS APPLY TO ALL ITEMS IN ACCESSIBLE AND TYPE A UNITS SAME AS PUBLIC/COMMON AREAS.
G. COMPLY WITH GENERAL BUILDING CLEARANCE REQUIREMENTS AS INDICATED HEREIN.
H. ENCROACHMENT INTO FLOOR CLEARANCE AREAS AT DOORS, CASEWORK, APPLIANCES OR EQUIPMENT IS NOT ALLOWED UNLESS OTHERWISE NOTED.
I. NOTIFY THE ARCHITECT IMMEDIATELY IF CONFLICTS ARE DISCOVERED BETWEEN THE REQUIRMENTS ILLUSTRATED HEREIN AND THOSE ON OTHER DRAWINGS.
J. THE SPACE BETWEEN THE GRAB BAR AND PROJECTING OBJECTS BELOW AND AT THE ENDS OF THE GRAB BAR SHALL BE 1 1/2" MIN. THE SPACE BETWEEN THE GRAB BAR AND PROJECTING OBJECTS ABOVE THE GRAB BAR SHALL BE 12" MIN.
K. OPERABLE PARTS SHALL BE OPERATED WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING OF THE WRIST. THE FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5.0 POUNDS (22.2 N) MAXIMUM.
L. FOR COMPLIANCE WITH EXTERIOR ACCESSIBLE PATH OF TRAVEL REQUIREMENTS PLEASE REFER TO THE LANDLORD'S APPROVED PERMIT DRAWINGS

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ACCESSIBILITY REQUIREMENTS

G002

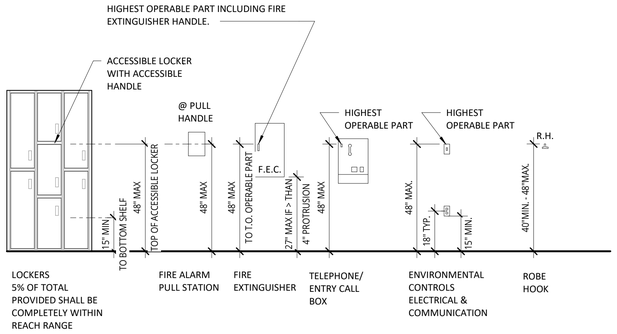

5 G003 **MOUNTING HEIGHTS**
3/8" = 1'-0"

GRAB BARS SHALL EITHER BE CIRCULAR WITH A CROSS SECTION WITH AN OUTSIDE DIAMETER BETWEEN 1 1/4" MIN AND 2" MAXIMUM OR BE NON-CIRCULAR WITH A CROSS SECTION DIMENSION OF 2" MAXIMUM AND A PERIMETER DIMENSION OF 4" MINIMUM AND 4.8" MAXIMUM.

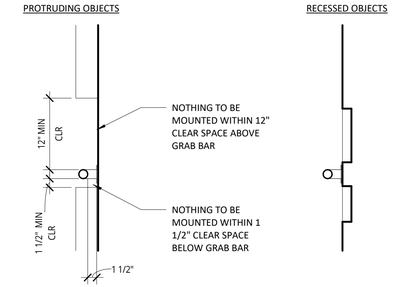

ALL GRAB BARS INSTALLED IN ANY APPLICATION EXCEPT SPACE BETWEEN GRAB BARS AND SHOWER CONTROLS, SHOWER FITTINGS AND OTHER GRAB BARS SHALL BE 1 1/2" MINIMUM.

PER 2022 CBC CHAPTER 11B

FULLY RECESSED DISPENSERS CAN BE LOCATED WITHIN THE 12" ABOVE AND 1 1/2" BELOW THE GRAB BAR.

4 G003 **GRAB BAR SPACING**
1" = 1'-0"

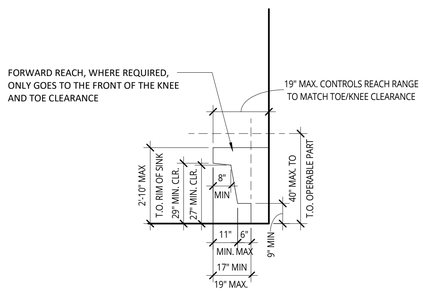

3 G003 **KNEE AND TOE CLEARANCE DIAGRAM**
3/8" = 1'-0"

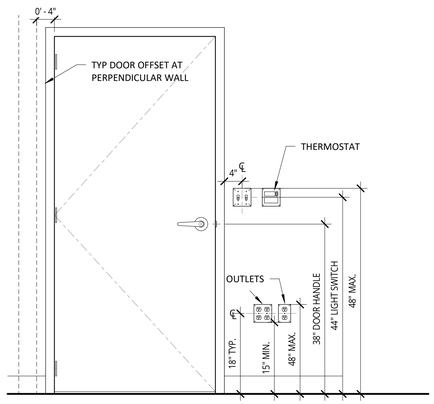

2 G003 **STANDARD MOUNTING HEIGHTS**
3/4" = 1'-0"

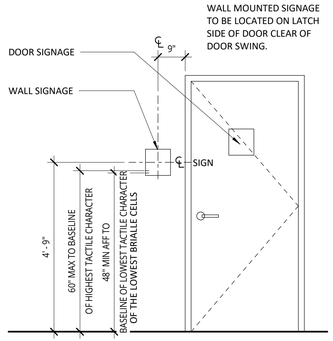

RESTROOM SIGNAGE
FOR LOCATIONS OF SIGNS

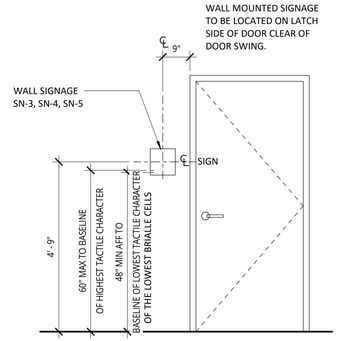

EXIT SIGNAGE

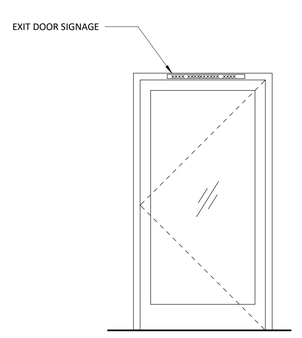

ENTRY DOOR SIGNAGE (INTERIOR SIDE OF DOORS)

SIGN DETAIL 'SN-3'	SIGN DETAIL 'SN-4'	SIGN DETAIL 'SN-5'
6". EMPLOYEES ONLY 6". BRAILLE TEXT	6". EXIT 6". BRAILLE TEXT	6". EXIT ROUTE 6". BRAILLE TEXT

TACTILE EXIT SIGNAGE
1. A TACTILE EXIT SIGN WITH WORDS "EXIT", SHALL IDENTIFY EACH GRADE LEVEL EXTERIOR EXIT DOOR.

2. A TACTILE EXIT SIGN WITH THE WORDS "EXIT ROUTE" SHALL IDENTIFY EACH EXIT ACCESS DOOR FROM AN INTERIOR ROOM OR AREA TO A CORRIDOR OR HALLWAY THAT IS REQUIRED TO HAVE A VISUAL EXIT SIGN.

THIS DOOR TO REMAIN UNLOCKED WHEN BUILDING IS OCCUPIED

SIGN REQUIREMENTS:

READILY VISIBLE AND DURABLE SIGN SHALL BE PLACED ON THE DOOR FRAME AS INDICATED.

HEIGHT OF LETTERS 1" MINIMUM. LETTERS TO CONTRAST WITH STOREFRONT FINISH.

INSTALL SO NOT VISIBLE FROM STORE EXTERIOR.

EXIT DOOR SIGNAGE (INTERIOR SIDE OF DOORS)

1 **ACCESSIBILITY SIGNAGE**
1/2" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ACCESSIBILITY REQUIREMENTS

G003

ENERGY CODE ANALYSIS

CLIMATE ZONE: ZONE 3 - MARIN COUNTY

BUILDING ALTERARIONS TO COMPONENTS EXISTING TO NONRESIDELTAL ALTERARIONS TO COMPLY WITH 2022 CALIFORNIA ENERGY CODE, TITLE 24, PART 6 - SUBCHAPTER 6 "NONRESIDENTIAL AND HOTEL/MOTEL OCCUPANCIES - ADDITIONS, ALTERATIONS AND REPAIRS"

CALIFORNIA ENERGY CODE 2022
FIGURE 100.1-A: CLIMATE ZONE 3 - MARIN COUNTY

ENERGY CODE COMPLIANCE -SUBCHAPTER 6 NONRESIDENTIAL AND HOTEL/MOTEL OCCUPANCIES -ADDITIONS, ALTERATIONS, AND REPAIRS
TITLE 24, PART 6

PRESCRIPTIVE APPROACH. THE ALTERED COMPONENTS OF THE ENVELOPE, OR SPACE CONDITIONING, LIGHTING, ELECTRICAL POWER DISTRIBUTION AND WATER HEATING SYSTEMS, AND ANY NEWLY INSTALLED EQUIPMENT SERVING THE ALTERATION, SHALL MEET THE APPLICABLE REQUIREMENTS OF SECTIONS 110.0 THROUGH 110.9, SECTIONS 120.0 THROUGH 120.6, AND SECTIONS 120.9 THROUGH 130.5.

STOREFRONT WINDOW SYSTEM

REQUIRED: TABLE 141.0-A ALTERED VERTICAL FENESTRATION MAXIMUM U-FACTOR AND MAXIMUM RSHGC

CLIMATE ZONE: 3
MAX U-FACTOR: **0.58**
MAX RSHGC: **0.41**
MIN. VT (PER TABLE 140.3-B) : **0.46**

PROPOSED: 2 X 4 1/2" TRIFAB 451T FRONT SET - ALUMINUM GLAZING SPACER

GLASS U-FACTOR 0.48	OVERALL U- FACTOR 0.56
GLASS SHGC 0.40	OVERALL SHGC 0.37
GLASS VT 0.55	OVERALL VT 0.48

STOREFRONT ENTRY - ENTRY DOORS

REQUIRED: TABLE 140.3 B PRESCRIPTIVE ENVELOPE CRITERIA FOR NONRESIDENTIAL BUILDINGS

CLIMATE ZONE: 3
MAX U-FACTOR: **0.45**
MAX RSHGC: **0.23**
MIN VT: **0.17**

PROPOSED: KAWNEER 350T 1" DOUBLE GLAZED (SINGLE DOOR)

GLASS U-FACTOR 0.10	OVERALL U- FACTOR 0.44
GLASS SHGC 0.35	OVERALL SHGC 0.21
GLASS VT 0.35	OVERALL VT 0.18

EXTERIOR WALLS - WOOD FRAMED AND OTHERS

REQUIRED: TABLE 140.3 B PRESCRIPTIVE ENVELOPE CRITERIA FOR NONRESIDENTIAL BUILDINGS

MAX U-VALUE: **0.110**
MIN R-VALUE: 9

EXTERIOR DOOR - HOLLOW METAL DOOR - U-FACTOR METHOD

REQUIRED: TABLE 140.3 B PRESCRIPTIVE ENVELOPE CRITERIA FOR NONRESIDENTIAL BUILDINGS

CLIMATE ZONE: 3
EXTERIOR DOOR, MAX. U-VALUE: **0.70**
MIN R-VALUE: 1.42

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ENERGY CODE ANALYSIS

G004

AIA California 2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

NONRESIDENTIAL MANDATORY MEASURES, SHEET 1 (July 2024 Supplement)

Y = YES
N/A = NOT APPLICABLE
RESPON. PARTY = RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

Y | N/A | RESPON. PARTY

CHAPTER 3
GREEN BUILDING
SECTION 301 GENERAL

301.1 SCOPE. Buildings shall be designed to include the green building measures specified as mandatory in the application checklists contained in this code. Voluntary green building measures are also included in the application checklists and may be included in the design and construction of structures covered by this code, but are not required unless adopted by a city, county, or city and county as specified in Section 101.7.

301.3 NONRESIDENTIAL ADDITIONS AND ALTERATIONS. [BSC-CG] The provisions of individual sections of Chapter 5 apply to newly constructed buildings, building additions of 1,000 square feet or greater, and/or building alterations with a permit valuation of $200,000 or above (for occupancies within the authority of California Building Standards Commission). Code sections relevant to additions and alterations shall only apply to the portions of the building being added or altered within the scope of the permitted work.

A code section will be designated by a banner to indicate where the code section only applies to newly constructed buildings [N] or to additions and/or alterations [A]. When the code section applies to both, no banner will be used.

301.3.1 Nonresidential additions and alterations that cause updates to plumbing fixtures only:

Note: On and after January 1, 2014, certain commercial real property, as defined in Civil Code Section 1101.3, shall have its noncompliant plumbing fixtures replaced with appropriate water-conserving plumbing fixtures under specific circumstances. See Civil Code Section 1101.1 *et seq.* for definitions, types of commercial real property affected, effective dates, circumstances necessitating replacement of noncompliant plumbing fixtures, and duties and responsibilities for ensuring compliance.

301.3.2 Waste Diversion. The requirements of Section 5.408 shall be required for additions and alterations whenever a permit is required for work.

301.4 PUBLIC SCHOOLS AND COMMUNITY COLLEGES. (see GBSC)
301.5 HEALTH FACILITIES. (see GBSC)

SECTION 302 MIXED OCCUPANCY BUILDINGS

302.1 MIXED OCCUPANCY BUILDINGS. In mixed occupancy buildings, each portion of a building shall comply with the specific green building measures applicable to each specific occupancy.

SECTION 303 PHASED PROJECTS

303.1 PHASED PROJECTS. For shell buildings and others constructed for future tenant improvements, only those code measures relevant to the building components and systems considered to be new construction (or newly constructed) shall apply.

303.1.1 Initial Tenant improvements. The provisions of this code shall apply only to the initial tenant improvements to a project. Subsequent tenant improvements shall comply with the scoping provisions in Section 301.3 non-residential additions and alterations.

ABBREVIATION DEFINITIONS:

HCD	Department of Housing and Community Development
BSC	California Building Standards Commission
DSA-SS	Division of the State Architect, Structural Safety
OSHPD	Office of Statewide Health Planning and Development
LR	Low Rise
HR	High Rise
AA	Additions and Alterations
N	New

CHAPTER 5
NONRESIDENTIAL MANDATORY MEASURES

DIVISION 5.1 PLANNING AND DESIGN

SECTION 5.101 GENERAL

5.101.1 SCOPE
The provisions of this chapter outline planning, design and development methods that include environmentally responsible site selection, building design, building siting and development to protect, restore and enhance the environmental quality of the site and respect the integrity of adjacent properties.

SECTION 5.102 DEFINITIONS

5.102.1 DEFINITIONS
The following terms are defined in Chapter 2 *(and are included here for reference)*

CUTOFF LUMINAIRES. Luminaires whose light distribution is such that the candela per 1000 lamp lumens does not numerically exceed 25 (2.5 percent) at an angle of 90 degrees above nadir, and 100 (10 percent) at a vertical angle of 80 degrees above nadir. This applies to all lateral angles around the luminaire.

ELECTRIC VEHICLE (EV). [BSC-CG, HCD] An automotive-type vehicle for on-road use, such as passenger automobiles, buses, trucks, vans, neighborhood electric vehicles, electric motorcycles and the like, primarily powered by an electric motor that draws current from a rechargeable storage battery, fuel cell, photovoltaic array or other source of electric current. Plug-in hybrid electric vehicles (PHEV) are considered electric vehicles. For purposes of the California Electrical Code, off-road, self-propelled electric vehicles, such as industrial trucks, hoists, lifts, transports, golf carts, airline ground support equipment, tractors, boats and the like, are not included.

ELECTRIC VEHICLE (EV) CAPABLE SPACE. [BSC-CG, DSA-SS and HCD] A vehicle space with electrical panel space and load capacity to support a branch circuit and necessary raceways, both underground and/or surface mounted, to support EV charging.

ELECTRIC VEHICLE (EV) CHARGER. [BSC-CG, HCD] Off-board charging equipment used to charge an electric vehicle.

ELECTRIC VEHICLE CHARGING SPACE (EV SPACE). [HCD] A space intended for future installation of EV charging equipment and charging of electric vehicles.

ELECTRIC VEHICLE CHARGING STATION (EVCS). [BSC-CG, DSA-SS, HCD] One or more electric vehicle charging spaces served by EVSE or receptacle(s).

ELECTRIC VEHICLE (EV) READY SPACE. [HCD] A vehicle space which is provided with a branch circuit; any necessary raceways, both underground and/or surface mounted; to accommodate EV charging, terminating in a receptacle or a charger.

ELECTRIC VEHICLE SUPPLY EQUIPMENT (EVSE).[BSC-CG, DSA-SS and HCD] The conductors, including the ungrounded, grounded and equipment grounding conductors and the electric vehicle connectors, attachment plugs, personnel protection system, and all other fittings, devices, power outlets or apparatus installed specifically for the purpose of transferring energy between the premises wiring and the electric vehicle.

SECTION 5.105 DECONSTRUCTION AND REUSE OF EXISTING STRUCTURES

5.105.1 Scope. [BSC-CG] Effective July 1, 2024, alteration(s) to existing building(s) where the combined altered floor area is 100,000 square feet or greater shall comply with either Section 5.105.2, 5.409.2, or 5.409.3. Addition(s) to existing building(s) where the total floor area combined with the existing building(s) is 100,000 square feet or greater shall comply with either Section 5.105.2, Section 5.409.2, or Section 5.409.3. Effective January 1, 2026, the combined floor area shall be 50,000 square feet or greater.

[DSA-SS] Alteration(s) to existing building(s) where the combined altered floor area is 50,000 square feet or greater shall comply with either Section 5.105.2, 5.409.2, or 5.409.3. Addition(s) to existing building(s) where the total floor area combined with the existing building(s) is 50,000 square feet or greater shall comply with either Section 5.105.2, Section 5.409.2, or Section 5.409.3.

Exception [BSC-CG, DSA-SS]: Combined addition(s) to existing building(s) of two times the area or more of the existing building(s) is not eligible to meet compliance with Section 5.105.2.

☐ X **5.105.2 Reuse of existing building.** An alteration or addition to an existing building shall maintain at a minimum 45 percent combined of the existing building's primary structural elements (foundations; columns, beams, walls, and floors; and lateral elements) and existing building enclosure (roof framing, wall framing and exterior finishes). Window assemblies, insulation, portions of buildings deemed structurally unsound or hazardous, and hazardous materials that are remediated as part of the project shall not be included in the calculation.

5.105.2.1 Verification of compliance. Documentation shall be provided in the construction documents to demonstrate compliance with Section 5.105.2.

Note: Sample Worksheet WS-3 in Chapter 8 may be used to assist in documenting compliance with this section.

5.105.3 Deconstruction (Reserved).

Y | N/A | RESPON. PARTY

☐ X

SECTION 5.106 SITE DEVELOPMENT

5.106.1 STORM WATER POLLUTION PREVENTION FOR PROJECTS THAT DISTURB LESS THAN ONE ACRE OF LAND. Newly constructed projects and additions which disturb less than one acre of land, and are not part of a larger common plan of development or sale, shall prevent the pollution of storm water runoff from the construction activities through one or more of the following measures:

5.106.1.1 Local ordinance. Comply with a lawfully enacted storm water management and/or erosion control ordinance.

5.106.1.2 Best Management Practices (BMPs). Prevent the loss of soil through wind or water erosion by implementing an effective combination of erosion and sediment control and good housekeeping BMPs.

1. Soil loss BMPs that should be considered for implementation as appropriate for each project include, but are not limited to, the following:
   a. Scheduling construction activity during dry weather, when possible.
   b. Preservation of natural features, vegetation, soil, and buffers around surface waters.
   c. Drainage swales or lined ditches to control stormwater flow.
   d. Mulching or hydroseeding to stabilize disturbed soils.
   e. Erosion control to protect slopes.
   f. Protection of storm drain inlets (gravel bags or catch basin inserts).
   g. Perimeter sediment control (perimeter silt fence, fiber rolls).
   h. Sediment trap or sediment basin to retain sediment on site.
   i. Stabilized construction exits.
   j. Wind erosion control.
   k. Other soil loss BMPs acceptable to the enforcing agency.
2. Good housekeeping BMPs to manage construction equipment, materials, non-stormwater discharges and wastes that should be considered for implementation as appropriate for each project include, but are not limited to, the following:
   a. Dewatering activities.
   b. Material handling and waste management.
   c. Building materials stockpile management.
   d. Management of washout areas (concrete, paints, stucco, etc.).
   e. Control of vehicle/equipment fueling to contractor's staging area.
   f. Vehicle and equipment cleaning performed off site.
   g. Spill prevention and control.
   h. Other housekeeping BMPs acceptable to the enforcing agency.

☐ X **5.106.2 STORMWATER POLLUTION PREVENTION FOR PROJECTS THAT DISTURB ONE OR MORE ACRES OF LAND.** Comply with all lawfully enacted stormwater discharge regulations for projects that (1) disturb one acre or more of land, or (2) disturb less than one acre of land but are part of a larger common plan of development sale.

Note: Projects that (1) disturb one acre or more of land, or (2) disturb less than one acre of land but are part of the larger common plan of development or sale must comply with the post-construction requirements detailed in the applicable National Pollutant Discharge Elimination System (NPDES) General permit for Stormwater Discharges Associated with Construction and Land Disturbance Activities issued by the State Water Resources Control Board or the Lahontan Regional Water Quality Control Board (for projects in the Lake Tahoe Hydrologic Unit).

The NPDES permits require postconstruction runoff (post-project hydrology) to match the preconstruction runoff (pre-project hydrology) with the installation of postconstruction stormwater management measures. The NPDES permits emphasize runoff reduction through on-site stormwater use, interception, evapotranspiration, and infiltration through nonstructural controls, such as Low Impact Development (LID) practices, and conversation design measures. Stormwater volume that cannot be addressed using nonstructural practices is required to be captured in structural practices and be approved by the enforcing agency.

Refer to the current applicable permits on the State Water Resources Control Board website at: www.waterboards.ca.gov/constructionstormwater. Consideration to the stormwater runoff management measures should be given during the initial design process for appropriate integration into site development.

5.106.4 BICYCLE PARKING. For buildings within the authority of California Building Standards Commission as specified in Section 103, comply with Section 5.106.4.1. For buildings within the authority of the Division of the State Architect pursuant to Section 105, comply with Section 5.106.4.2

☐ ☐ EXISTING **5.106.4.1 Bicycle parking. [BSC-CG]** Comply with Sections 5.106.4.1.1 and 5.106.4.1.2; or meet the applicable local ordinance, whichever is stricter.

5.106.4.1.1 Short-term bicycle parking. If the new project or an addition or alteration is anticipated to generate visitor traffic, provide permanently anchored bicycle racks within 200 feet of the visitors' entrance, readily visible to passers-by, for 5% of new visitor motorized vehicle parking spaces being added, with a minimum of one two-bike capacity rack.
Exception: Additions or alterations which add nine or less visitor vehicular parking spaces.

5.106.4.1.2 Long-term bicycle parking. For new buildings with tenant spaces that have 10 or more tenant-occupants, provide secure bicycle parking for 5 percent of the tenant-occupant vehicular parking spaces with a minimum of one bicycle parking facility.

5.106.4.1.3 For additions or alterations that add 10 or more tenant-occupant vehicular parking spaces, provide secure bicycle parking for 5 percent of the tenant vehicular parking spaces being added, with a minimum of one bicycle parking facility.

5.106.4.1.4 For new shell buildings in phased projects provide secure bicycle parking for 5 percent of the anticipated tenant-occupant vehicular parking spaces with a minimum of one bicycle parking facility.

5.106.4.1.5 Acceptable bicycle parking facility for Sections 5.106.4.1.2, 5.106.4.1.3, and 5.106.4.1.4 shall be convenient from the street and shall meet one of the following:

1. Covered, lockable enclosures with permanently anchored racks for bicycles;
2. Lockable bicycle rooms with permanently anchored racks; or
3. Lockable, permanently anchored bicycle lockers.

Note: Additional information on recommended bicycle accommodations may be obtained from Sacramento Area Bicycle Advocates.

☐ X **5.106.4.2 Bicycle parking. [DSA-SS]** For public schools and community colleges, comply with Sections 5.106.4.2.1 and 5.106.4.2.2

5.106.4.2.1 Student bicycle parking. Provide permanently anchored bicycle racks conveniently accessed with a minimum of four two-bike capacity racks per new building.
5.106.4.2.2 Staff bicycle parking. Provide permanent, secure bicycle parking conveniently accessed with a minimum of two staff bicycle parking spaces per new building. Acceptable bicycle parking facilities shall be convenient from the street or staff parking area and shall meet one of the following:

1. Covered, lockable enclosures with permanently anchored racks for bicycles;
2. Lockable bicycle rooms with permanently anchored racks; or
3. Lockable, permanently anchored bicycle lockers.

☐ X **5.106.5.3 Electric vehicle (EV) charging. [N] [BSC-CG]** Construction to provide electric vehicle infrastructure and facilitate electric vehicle charging shall comply with Section 5.106.5.3.1 EV capable spaces, Section 5.106.5.3.2 Electric vehicle charging stations and associated Table 5.106.5.3.1, or Section 5.106.5.3.6 Electric vehicle charging stations (EVCS)—Power allocation method and associated Table 5.106.5.3.6 and shall be provided in accordance with regulations in the *California Building Code* and the *California Electrical Code*.

Exceptions:
1. On a case-by-case basis where the local enforcing agency has determined compliance with this section is not feasible based upon one of the following conditions:
   a. Where there is no local utility power supply
   b. Where the local utility is unable to supply adequate power.
   c. Where there is evidence suitable to the local enforcement agency substantiating the local utility infrastructure design requirements, directly related to the implementation of Section 5.106.5.3, may adversely impact the construction cost of the project.
2. Parking spaces accessible only by automated mechanical car parking systems are not required to comply with this code section.

5.106.5.3.1 EV capable spaces. [N] EV capable spaces shall be provided in accordance with Table 5.106.5.3.1 and the following requirements:

1. Raceways complying with the California Electrical Code and no less that 1-inch (25 mm) diameter shall be provided and shall originate at a service panel or a subpanel(s) serving the area, and shall terminate in close proximity to the proposed location of the EV capable and into a suitable listed cabinet, box,enclosure or equivalent. A common raceway may be used to serve multiple EV charging spaces.
2. A service panel or subpanel (s) shall be provided with panel space and electrical load capacity for a dedicated 208/240 volt, 40-ampere minimum branch circuit for each EV capable space, with delivery of 30-ampere minimum to an installed EVSE at each EVCS.
3. The electrical system and any on-site distribution transformers shall have sufficient capacity to supply full rated amperage at each EV capable space.
4. The service panel or subpanel circuit directory shall identify the reserved overcurrent protective devices space(s) as "EV CAPABLE". The raceway termination location shall be permanently and visibly marked as "EV CAPABLE."

Note: A parking space served by electric vehicle supply equipment or designed as a future EV charging space shall count as at least one standard automobile parking space only for the purpose of complying with any applicable minimum parking space requirements established by an enforcement agency. See vehicle Code Section 22511.2 for further details.

Y | N/A | RESPON. PARTY

TABLE 5.106.5.3.1

TOTAL NUMBER OF ACTUAL PARKING SPACES	NUMBER OF REQUIRED EV CAPABLE SPACES	NUMBER OF EVCS (EV CAPABLE SPACES PROVIDED WITH EVSE)[A,2]
0-9	0	0
10-25	2	0
26-50	8	2
51-75	13	3
76-100	17	4
101-150	25	6
151-200	35	9
201 AND OVER	20 percent of actual parking spaces[1]	25 percent of EV capable spaces[1]

1. Calculation for spaces shall be rounded up to the nearest whole number.
2. The number of required EVCS (EV capable spaces provided with EVSE) in column 3 count toward the total number of required EV capable spaces shown in column 2.
3. At least one Level 2 EVSE shall be provided.

5.106.5.3.2 Electric vehicle charging stations (EVCS) EV capable spaces shall be provided with electric vehicle supply equipment (EVSE) to create EVCS in the number indicated in Table 5.106.5.3.1. The EVCS required by Table 5.106.5.3.1 shall be provided with Level 2 EVSE or DCFC as permitted in Section 5.106.5.3.2.1. At least one Level 2 EVSE shall be provided.

One EV charger with multiple connectors capable of charging multiple EVs simultaneously shall be permitted if the electrical load capacity required by Section 5.106.5.3.1 for each EV capable space is accumulatively supplied to the EV charger.

The installation of each DCFC EVSE shall be permitted to reduce the minimum number of required EV capable spaces without EVSE by five and reduce proportionally the required electrical load capacity to the service panel or subpanel.

5.106.5.3.2.1 The installation of each DCFC EVSE shall be permitted to reduce the minimum number of required EV capable spaces without EVSE or EVCS with Level 2 EVSE by five and reduce proportionally the required electrical load capacity to the service panel or subpanel.

5.106.5.3.2.2 The installation of two low power Level 2 EV charging receptacles shall be permitted to reduce the minimum number of required EV capable spaces without EVSE in Table 5.106.5.3.1 by one.

5.106.5.3.3 Use of automatic load management systems (ALMS).
ALMS shall be permitted for EVCS. When ALMS is installed, the required electrical load capacity specified in Section 5.106.5.3.1 for each EVCS may be reduced when serviced by an EVSE controlled by an ALMS. Each EVSE controlled by an ALMS shall deliver a minimum 30 amperes to an EV when charging one vehicle and shall deliver a minimum 3.3 kW while simultaneously charging multiple EVs.

5.106.5.3.4 Accessible EVCS.
When EVSE is installed, accessible EVSC shall be provided in accordance with the *California Building Code*, Chapter 11B, Section 11B-228.3.

Note: For EVCS signs, refer to Caltrans Traffic Operations Policy Directive 13-01 (Zero Emission Vehicle Signs and Pavement Markings) or its successor(s).

5.106.5.3.4 Accessible electric vehicle charging station (EVCS). When EVSE is installed, accessible EVCS shall be provided in accordance with the *California Building Code*, Chapter 11B, Section 11B-228.3.

5.106.5.3.5 Electric vehicle charging station signage. Electric vehicle charging stations shall be identified by signage or pavement markings in compliance with Caltrans Traffic Operations Policy Directive 13-01 (Zero Emission Vehicle Signs and Pavement Markings) or its successor(s).

Power allocation method shall include the following:
1. Use any kVA combination of EV capable spaces, low power Level 2, Level 2 or DCFC EVSEs.
2. At least one Level 2 EVSE shall be provided.

5.106.5.3.6 Electric vehicle charging stations (EVCS)—power allocation method. The power allocation method may be used as an alternative to the requirements in Section 5.106.5.3.1, Section 5.106.5.3.2 and associated Table 5.106.5.3.1. Use Table 5.106.5.3.6 to determine the total power in kVA required based on the total number of actual parking spaces.

TABLE 5.106.5.3.6

TOTAL NUMBER OF ACTUAL PARKING SPACES	MINIMUM TOTAL kVA @ 6.6 kVA	TOTAL kVA REQUIRED IN ANY COMBINATION OF EV CAPABLE,3,4 LOW POWER LEVEL 2, LEVEL 2, 1, 2 OR DCFC
0-9	0	0
10-25	26.4	26.4
26-50	52.8	52.8
51-75	85.8	85.8
76-100	112.2	112.2
101-150	165	165
151-200	231	231
201 AND OVER	20 percent of actual parking spaces x 6.6	Total required kVA = P × 20 × 6.6 Where P = Parking spaces in facility

1. Level 2 EVSE @ 6.6 kVA minimum.
2. At least one Level 2 EVSE shall be provided.
3. Maximum allowed kVA to be utilized for EV capable spaces is 75 percent.
4. If EV capable spaces are utilized, they shall meet the requirements of Section 5.106.5.3.1 EV capable spaces.

☐ X **5.106.5.4 Additions or alterations to existing buildings or parking facilities [A]. [BSC-CG]** Existing buildings or parking facilities being modified by one of the following shall comply with Section 5.106.5.4.1 or 5.106.5.4.2. When EVSE is installed, accessible EVCS shall be provided in accordance with the *California Building Code*, Chapter 11B, Section 11B-228.3.

1. When the scope of construction work includes an increase in power supply to an electric service panel as part of a parking facility addition or alteration.
2. When a new photovoltaic system is installed covering existing parking spaces.
3. When additions or alterations to existing buildings are triggered pursuant to code Section 301.3 and the scope of work includes an increase in power supply to an electric service panel.

Exceptions:
1. On a case-by-case basis where the local enforcing agency has determined compliance with this section is not feasible based upon one of the following conditions:
   a. Where there is no local utility power supply.
   b. Where the local utility is unable to supply adequate power.
   c. Where there is evidence suitable to the local enforcement agency substantiating that additional local utility infrastructure design requirements, directly related to the implementation of Section 5.106.5.3, may adversely impact the construction cost of the project.
   d. Where demonstrated as impracticable excluding local utility service or utility infrastructure issues.
2. Remote parking facilities that do not have access to the building service panel.
3. Parking area lighting upgrades where no trenching is part of the scope of work.
4. Emergency repairs, including but not limited to water line break in parking facilities, natural disaster repairs, etc.

5.106.5.4.1 Existing buildings or parking areas without previously installed EV capable infrastructure [A]. When EV capable infrastructure does not exist at an existing parking facility or building, and the parking facility or building undergoes an addition or alteration listed in Section 5.106.5.4, construction shall include electric vehicle charging in compliance with either Section 5.106.5.3 and associated Table 5.106.5.3.1, or Section 5.106.5.3.6 and associated Table 5.106.5.3.6 for the total number of actual parking spaces being added or altered.

5.106.5.4.2 Existing buildings or parking areas with previously installed EV capable infrastructure [A]. When EV capable infrastructure is available at an existing parking facility or building, and the parking facility or building is undergoing an addition or alteration listed in Section 5.106.5.4, construction shall include electric vehicle charging in compliance with either Section 5.106.5.3 and associated Table 5.106.5.3.1, or Section 5.106.5.3.6 and associated Table 5.106.5.3.6 utilizing the existing EV capable allocated power and infrastructure for the total number of actual parking spaces being added or altered. If the area being added or altered exceeds the existing EV capable capacity, allocated power and infrastructure, provide additional EV charging as needed to comply with this section.

Y | N/A | RESPON. PARTY

☐ X **5.106.5.5 Electric vehicle (EV) charging: medium-duty and heavy-duty. [N] [BSC-CG]** Construction shall comply with Section 5.106.5.5.1 to facilitate future installation of electric vehicle supply equipment (EVSE). Construction for warehouses, grocery stores and retail stores, office buildings, and manufacturing facilities with planned off-street loading spaces shall also comply with Section 5.106.5.5.1 for future installation of medium- and heavy-duty EVSE.

Exceptions:
1. On a case-by-case basis where the local enforcing agency has determined compliance with this section is not feasible based upon one of the following conditions:
   a. Where there is no local utility power supply.
   b. Where the local utility is unable to supply adequate power.
   c. Where there is evidence suitable to the local enforcing agency substantiating that additional local utility infrastructure design requirements, directly related to the implementation of Section 5.106.5.3, may adversely impact the construction cost of the project.

When EVSE(s) is/are installed, it shall be in accordance with the *California Building Code*, the *California Electrical Code* and as follows:

5.106.5.5.1 Electric vehicle charging readiness requirements for warehouses, grocery stores, office buildings, and manufacturing facilities and retail stores with planned off-street loading spaces. [N]

In order to avoid future demolition when adding EV supply and distribution equipment, spare raceway(s) or busway(s) and adequate capacity for transformer(s), service panel(s) or subpanel(s) shall be installed at the time of construction in accordance with the *California Electrical Code*. Construction plans and specifications shall include, but are not limited to, the following:

1. The transformer, main service equipment and subpanels shall meet the minimum power requirement in Table 5.106.5.5.1 to accommodate the dedicated branch circuits for the future installation of EVSE.

2. The construction documents shall indicate one or more location(s) convenient to the planned off-street loading space(s) reserved for medium- and heavy-duty ZEV charging cabinets and charging dispensers, and a pathway reserved for routing of conduit from the termination of the raceway(s) or busway(s) to the charging cabinet(s) and dispenser(s), as shown in Table 5.106.5.5.1.

3. Raceway(s) or busway(s) originating at a main service panel or a subpanel(s) serving the area where potential future medium- and heavy-duty EVSE will be located and shall terminate in close proximity to the potential future location of the charging equipment for medium- and heavy-duty vehicles.

4. The raceway(s) or busway(s) shall be of sufficient size to carry the minimum additional system load to the future location of the charging for medium- and heavy-duty ZEVs as shown in Table 5.106.5.5.1.

TABLE 5.106.5.5.1 RACEWAY CONDUIT AND PANEL POWER REQUIREMENTS FOR MEDIUM- AND HEAVY-DUTY EVSE [N]

BUILDING TYPE	BUILDING SIZE (SQ. FT.)	NUMBER OF OFF-STREET LOADING SPACES	ADDITIONAL CAPACITY REQUIRED (KVA) FOR RACEWAY & BUSWAY AND TRANSFORMER & PANEL
Grocery	10,000 to 90,000	1 or 2	200
		3 or Greater	400
	Greater than 90,000	1 or Greater	400
Manufacturing Facilities	10,000 to 50,000	1 or 2	200
	10,000 to 50,000	3 or Greater	400
	Greater than 50,000	1 or Greater	400
Office Buildings	10,000 to 135,000	1 or 2	200
	10,000 to 135,000	3 or Greater	400
	Greater than 135,000	1 or Greater	400
Retail	10,000 to 135,000	1 or 2	200
		3 or Greater	400
	Greater than 135,000	1 or Greater	400
Warehouse	20,000 to 256,000	1 or 2	200
		3 or Greater	400
	Greater than 256,000	1 or Greater	400

☐ X **5.106.5.6 Electric vehicle (EV) charging at public schools and community colleges. [DSA-SS]** Electric vehicle infrastructure and electric vehicle charging stations shall comply with Section 5.106.5.6 and shall be provided in accordance with regulations in the California Building Code and the California Electrical Code.

Exceptions:
1. On a case-by-case basis where compliance with this section has been demonstrated to be not feasible based upon one of the following conditions,and with concurrence by the Division of the State Architect (DSA), compliance with Section 5.106.5.6 shall not be required.
   a. Where there is no local utility power supply.
   b. Where the local utility is unable to supply adequate power.
   c. The installation of EVCS is impracticable.
2. Parking spaces accessible only by automated mechanical car parking systems are not required to comply with Section 5.106.5.6.

5.106.5.6.1 EV capable spaces. EV capable spaces shall be provided in accordance with Table 5.106.5.6.1 and the following requirements:

1. Raceways complying with the California Electrical Code and no less than 1-inch (25 mm) diameter shall be provided and shall originate at a service panel or a subpanel(s) serving the area and shall terminate in close proximity to the proposed location of the EV capable space and into a suitable listed cabinet, box, enclosure or equivalent. A common raceway may be used to serve multiple EV capable spaces.

2. A service panel or subpanel(s) shall be provided with panel space and electrical load capacity for a dedicated 208/240 volt, 40-ampere minimum branch circuit for each EV capable space, with delivery of 30-ampere minimum to an installed EVSE at each EVCS.

3. The electrical system and any on-site distribution transformers shall have sufficient capacity to supply full rated amperage at each EV capable space.

4. The service panel or subpanel circuit directory shall identify the reserved overcurrent protective device space(s) as "EV CAPABLE." The raceway termination location shall be permanently and visibly marked as "EV CAPABLE."

TABLE 5.106.5.6.1

TOTAL NUMBER OF ACTUAL PARKING SPACES	NUMBER OF REQUIRED EV CAPABLE SPACES	NUMBER OF REQUIRED EVCS[2]
0-9	0	0
10-25	4	1
26-50	8	2
51-75	13	3
76-100	17	4
101-150	25	6
151-200	35	9
201 AND OVER	20 percent of total spaces[1]	25 percent of EV capable spaces[1]

1. Calculation for spaces shall be rounded up to the nearest whole number.
2. Each EVCS shall reduce the number of required EV capable spaces by the same number.

5.106.5.6.2 Electric vehicle charging stations (EVCS). EV capable spaces shall be provided with EVSE to create EVCS in the number indicated in Table 5.106.5.6.1 and shall comply with Section 5.106.5.6.2. EVCS shall be serviced by Level 2 or Direct Current Fast Charging (DCFC) EVSE, or with EVSE in any combination of Level 2 and DCFC. Accessible EVCS shall be provided in accordance with *California Building Code* Chapter 11B.

DISCLAIMER: *THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.*

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
CAL GREEN STANDARDS

G005

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE
NONRESIDENTIAL MANDATORY MEASURES, SHEET 2 (July 2024 Supplement)

Y = YES
N/A = NOT APPLICABLE
RESPON. PARTY = RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

5.106.5.6.2.1 Reduced number of EV capable spaces. The installation of each DCFC EVSE shall be permitted to reduce the minimum number of required EV capable spaces indicated in Table 5.106.5.6.1 by five and reduce proportionally the required electrical load capacity to the service panel or subpanel.

5.106.5.6.2.2 Multiple connectors. EVSE with multiple vehicle connectors capable of charging multiple EVs simultaneously shall be permitted if the electrical load capacity required by Section 5.106.5.6.1 for each EV capable space is accumulatively supplied to the EVSE.

5.106.5.6.2.3 Use of automatic load management systems (ALMS). ALMS shall be permitted for EVCS installed in accordance with Section 5.105.5.6.2. When ALMS is installed, the required electrical load capacity specified in Section 5.106.5.6.1 for each EVCS may be reduced when serviced by an EVSE controlled by an ALMS. Each EVSE controlled by an ALMS shall deliver a minimum 30 amperes to an EV when charging one vehicle and shall deliver a minimum 3.3 kW while simultaneously charging multiple EVs.

5.106.5.6.3 EVCS alternative compliance. In lieu of compliance with Section 5.106.5.6.2, EVCS shall be provided with Level 1, low power Level 2, or Level 2, or any combination of Level 1, low power Level 2 or Level 2 EVSE such that the total power supplied by the combination of EVSE meets the minimum power indicated in Table 5.106.5.6.3, based on the total number of actual parking spaces in each parking facility.

TABLE 5.106.5.6.3

NUMBER OF PARKING SPACES IN A PARKING FACILITY	MINIMUM TOTAL POWER (KVA) REQUIRED FOR EVCS
0-9	0
10-25	7
26-50	14
51-75	20
76-100	27
101-150	40
151-200	60
201 AND OVER	Total required KVA = P × .05 × 6.6 Where P = Parking spaces in facility

5.106.5.6.4 EVCS for alterations of or additions to parking facilities. Alterations of or additions to parking facilities shall provide EVCS in compliance with Section 5.106.5.6.4. The installation of infrastructure for EV capable spaces required to be provided without EVSE shall not be required.

5.106.5.6.4.1 Alterations of and additions to parking facilities. EVCS shall be provided in accordance with the number indicated in Table 5.106.5.6.1 or minimum power indicated in Table 5.106.5.6.3 when the scope of work includes an increase in power supply to an electric panel serving light fixtures illuminating the parking area or when area containing parking spaces is added to a parking facility. The number of required EVCS shall be based on the total number of existing and new parking spaces in the parking facility.

5.106.5.6.4.2 Alterations consisting of the installation of photovoltaic systems. EVCS shall be provided in accordance with the number indicated in Table 5.106.5.6.1 or maximum power indicated in Table 5.106.5.6.3 when a new photovoltaic system is installed in an existing parking facility.

5.106.5.6.5 Requirement to install EVSE. Level 2 EVSE shall be provided in all existing EV capable spaces to create EVCS when a project is required by California Administrative Code Section 4-309 to be submitted for plan approval to the Division of the State Architect. When EVSE is installed in existing EV capable spaces, accessible EVCS shall be provided in accordance with *California Building Code* Chapter 11B.

Exception: Projects in which improvements in parking areas consist only of accessibility improvements are not required to comply with Section 5.106.5.6.5.

☐ X **5.106.8 LIGHT POLLUTION REDUCTION. [N].** I Outdoor lighting systems shall be designed and installed to comply with the following:

1. The minimum requirements in the California Energy Code for Lighting Zones 0-4 as defined in Chapter 10, Section 10-114 of the California Administrative Code; and
2. Backlight (B) ratings as defined in IES TM-15-11 (shown in Table A-1 in Chapter 8);
3. Uplight and Glare ratings as defined in California Energy Code (shown in Tables 130.2-A and 130.2-B in Chapter 8) and
4. Allowable BUG ratings not exceeding those shown in Table 5.106.8, [N] or Comply with a local ordinance lawfully enacted pursuant to Section 101.7, whichever is more stringent.

Exceptions: [N]

1. Luminaires that qualify as exceptions in Sections 130.2 (b) and 140.7 of the California Energy Code.
2. Emergency lighting.
3. Building facade meeting the requirements in Table 140.7-B of the California Energy Code, Part 6.
4. Custom lighting features as allowed by the local enforcing agency, as permitted by Section 101.8 Alternate materials, designs and methods of construction.
5. Luminaires with less than 6,200 initial luminaire lumens.

TABLE 5.106.8 [N] MAXIMUM ALLOWABLE BACKLIGHT, UPLIGHT AND GLARE (BUG) RATINGS 1,2

ALLOWABLE RATING	LIGHTING ZONE LZ0	LIGHTING ZONE LZ1	LIGHTING ZONE LZ2	LIGHTING ZONE LZ3	LIGHTING ZONE LZ4
MAXIMUM ALLOWABLE BACKLIGHT RATING 3					
Luminaire greater than 2 mounting heights (MH) from property line	N/A	No Limit	No Limit	No Limit	No Limit
Luminaire back hemisphere is 1-2 MH from property line	N/A	B2	B3	B4	B4
Luminaire back hemisphere is 0.5-1 MH from property line	N/A	B1	B2	B3	B3
Luminaire back hemisphere is less than 0.5 MH from property line	N/A	B0	B0	B1	B2
MAXIMUM ALLOWABLE UPLIGHT RATING (U)					
For area lighting 3	N/A	U0	U0	U0	U0
For all other outdoor lighting,including decorative luminaires	N/A	U1	U2	U3	UR
MAXIMUM ALLOWABLE GLARE RATING ↓(G)					
MAXIMUM ALLOWABLE GLARE RATING ↓ (G)	N/A	G1	G2	G3	G4
MAXIMUM ALLOWABLE GLARE RATING ↓ (G)	N/A	G0	G1	G1	G2
MAXIMUM ALLOWABLE GLARE RATING ↓ (G)	N/A	G0	G0	G1	G1
MAXIMUM ALLOWABLE GLARE RATING ↓ (G)	N/A	G0	G0	G0	G1

1. IESNA Lighting Zones 0 and 5 are not applicable; refer to Lighting Zones as defined in the *California Energy Code* and Chapter 10 of the *California Administrative Code.*

2. For property lines that abut public walkways, bikeways, plazas and parking lots, the property line may be considered to be 5 feet beyond the actual property line for purpose of determining compliance with this section. For property lines that abut public roadways and public transit corridors, the property line may be considered to be the centerline of the public roadway or public transit corridor for the purpose of determining compliance with this section.

3. General lighting luminaires in areas such as outdoor parking, sales or storage lots shall meet these reduced ratings. Decorative luminaries located in these areas shall meet *U*-value limits for "all other outdoor lighting"

☐ X **5.106.8.1 Facing- Backlight**
Luminaries within 2MH of a property line shall be oriented so that the nearest property line is behind the fixture, and shall comply with the backlight rating specified in Table 5.106.8 based on the lighting zone and distance to the nearest point of that property line.

Exception: Corners. If two property lines (or two segments of the same property line) have equidistant point to the luminaire, then the luminaire may be oriented so that the intersection of the two lines (the corner) is directly behind the luminaire. The luminaire shall still use the distance to the nearest points(s) on the property lines to determine the required backlight rating.

5.106.8.2 Facing-Glare.
For luminaires covered by 5.106.8.1, if a property line also exists within or extends into the front hemisphere within 2MH of the luminaire then the luminaire shall comply with the more stringent glare rating specified in Table 5.106.8 based on the lighting zone and distance to the nearest point on the nearest property line within the front hemisphere.

Note: [N]
1.See also *California Building Code*, Chapter 12, Section 1205.6 for college campus lighting requirements for parking facilities and walkways.
2.Refer to Chapter 8 (Compliance Forms, Worksheets and Reference Material) for IES TM-15-11 Table A-1, *California Energy Code* Tables 130.2-A and 130.2-B.
3. Refer to the *California Building Code* for requirements for additions and alterations.

5.106.10 GRADING AND PAVING. Construction plans shall indicate how site grading or a drainage system will manage all surface water flows to keep water from entering buildings. Examples of methods to manage surface water include, but are not limited to, the following:

1. Swales.
2. Water collection and disposal systems.
3. French drains.
4. Water retention gardens.
5. Other water measures which keep surface water away from buildings and aid in groundwater recharge.

Exception: Additions and alterations not altering the drainage path.

☐ X **5.106.12 SHADE TREES [DSA-SS].** Shade Trees shall be planted to comply with Sections 5.106.12.1, 5.106.12.2, and 5.106.12.3. Percentages shown shall be measured at noon on the summer solstice. Landscape irrigation necessary to establish and maintain tree health shall comply with Section 5.304.6.

5.106.12.1 Surface parking areas. Shade tree plantings, minimum #10 container size or equal, shall be installed to provide shade over 50 percent of the parking area within 15 years.

Exceptions: Surface parking area covered by solar photovoltaic shade structures with roofing materials that comply with Table A5.106.11.2.2 in Appendix A5 shall be permitted in whole or in part in lieu of shade tree planting.

5.106.12.2 Landscape areas. Shade tress plantings, minimum #10 container size or equal shall be installed to provide shade of 20% of the landscape area within 15 years.

Exceptions: Playfields for organized sport activity are not included in the total area calculation.

5.106.12.3. Hardscape areas. Shade tree plantings, minimum #10 container size or equal shall be installed to provide shade over 20 percent of the hardscape area within 15 years.

Exceptions:
1. Walks, hardscape areas covered by solar photovoltaic shade structures or shade structures with roofing materials that comply with Table A5.106.11.2.2 in Appendix A5 shall be permitted in whole or in part in lieu of shade tree planting.
2. Designated and marked play areas of organized sport activity are not included in the total area calculation.

DIVISION 5.2 ENERGY EFFICIENCY

SECTION 5.201 GENERAL

5.201.1 Scope [BSC-CG]. ***California Energy Code [DSA-SS].*** For the purposes of mandatory energy efficiency standards in this code, the California Energy Commission will continue to adopt mandatory building standards.

DIVISION 5.3 WATER EFFICIENCY AND CONSERVATION

SECTION 5.301 GENERAL

5.301.1 Scope. The provisions of this chapter shall establish the means of conserving water use indoors, outdoors and in wastewater conveyance.

SECTION 5.302 DEFINITIONS

5.302.1 Definitions. The following terms are defined in Chapter 2 *(and are included here for reference)*

EVAPOTRANSPIRATION ADJUSTMENT FACTOR (ETAF) [DSA-SS]. An adjustment factor when applied to reference evapotranspiration that adjusts for plant factors and irrigation efficiency, which ae two major influences on the amount of water that needs to be applied to the landscape.

FOOTPRINT AREA [DSA-SS]. The total area of the furthest exterior wall of the structure projected to natural grade, not including exterior areas such as stairs, covered walkways, patios and decks.

METERING FAUCET. A self-closing faucet that dispenses a specific volume of water for each actuation cycle. The volume or cycle duration can be fixed or adjustable.

GRAYWATER. Pursuant to Health and Safety Code Section 17922.12, "graywater" means untreated wastewater that has not been contaminated by any toilet discharge, has not been affected by infectious, contaminated, or unhealthy bodily wastes, and does not present a threat from contamination by unhealthful processing, manufacturing, or washbasins, clothes washing machines and laundry tubs, but does not include waste water from kitchen sinks or dishwashers.

MODEL WATER EFFICIENT LANDSCAPE ORDINANCE (MWELO). The California ordinance regulating landscape design, installation and maintenance practices that will ensure commercial, multifamily and other developer installed landscapes greater than 2500 square feet meet an irrigation water budget developed based on landscaped area and climatological parameters.

MODEL WATER EFFICIENT LANDSCAPE ORDINANCE (MWELO). [HCD] The California model ordinance (California Code of Regulations, Title 23, Division 2, Chapter 2.7), regulating landscape design, installation and maintenance practices. Local agencies are required to adopt the updated MWELO, or adopt a local ordinance at least as effective as the MWELO.

POTABLE WATER. Water that is drinkable and meets the U.S. Environmental Protection Agency (EPA) Drinking Water Standards. See definition in the California Plumbing Code, Part 5.

POTABLE WATER. [HCD] Water that is satisfactory for drinking, culinary, and domestic purposes, and meets the U.S. Environmental Protection Agency (EPA) Drinking Water Standards and the requirements of the Health Authority Having Jurisdiction.

RECYCLED WATER. Water which, as a result of treatment of waste, is suitable for a direct beneficial use or a controlled use that would not otherwise occur [Water Code Section 13050 (n)]. Simply put, recycled water is water treated to remove waste matter attaining a quality that is suitable to use the water again.

SUBMETER. [HCD 1] A secondary device beyond a meter that measures water consumption of an individual rental unit within a multiunit residential structure or mixed-use residential and commercial structure. (See Civic Code Section 1954.202 (g) and Water code Section 517 for additional details.)

WATER BUDGET. Is the estimated total landscape irrigation water use which shall not exceed the maximum applied water allowance calculated in accordance with the Department of Water Resources Model Efficient Landscape Ordinance (MWELO).

SECTION 5.303 INDOOR WATER USE

☐ X **5.303.1 METERS.** Separate submeters or metering devices shall be installed for the uses described in Sections 503.1.1 and 503.1.2.

5.303.1.1 Buildings in excess of 50,000 square feet. Separate submeters shall be installed as follows:

1. For each individual leased, rented or other tenant space within the building projected to consume more than 100 gal/day (380 L/day), including, but not limited to, spaces used for laundry or cleaners, restaurant or food service, medical or dental office, laboratory, or beauty salon or barber shop.
2. Where separate submeters for individual building tenants are unfeasible, for water supplied to the following subsystems:
   a. Makeup water for cooling towers where flow through is greater than 500 gpm (30 L/s).
   b. Makeup water for evaporative coolers greater than 6 gpm (0.04 L/s).
   c. Steam and hot water boilers with energy input more than 500,000 Btu/h (147 kW).

5.303.1.2 Excess consumption. A separate submeter or metering device shall be provided for any tenant within a new building or within an addition that is projected to consume more than 1,000 gal/day.

X ☐ GC **5.303.3 WATER CONSERVING PLUMBING FIXTURES AND FITTINGS.** Plumbing fixtures (water closets and urinals) and fittings (faucets and showerheads) shall comply with the following:

5.303.3.1 Water Closets. The effective flush volume of all water closets shall not exceed 1.28 gallons per flush. Tank-type water closets shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Tank-Type toilets.

Note: The effective flush volume of dual flush toilets is defined as the composite, average flush volume of two reduced flushes and one full flush.

5.303.3.2 Urinals.
5.303.3.2.1 Wall-mounted Urinals. The effective flush volume of wall-mounted urinals shall not exceed 0.125 gallons per flush.

5.303.3.2.2 Floor-mounted Urinals. The effective flush volume of floor-mounted or other urinals shall not exceed 0.5 gallons per flush.

5.303.3.3 Showerheads. [BSC-CG]
5.303.3.3.1 Single showerhead. Showerheads shall have a maximum flow rate of not more than 1.8 gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Showerheads.

5.303.3.3.2 Multiple showerheads serving one shower. When a shower is served by more than one showerhead, the combined flow rate of all the showerheads and/or other shower outlets controlled by a single valve shall not exceed 1.8 gallons per minute at 80 psi, or the shower shall be designed to allow only one shower outlet to be in operation at a time.
Note: A hand-held shower shall be considered a showerhead.

5.303.3.3 Showerheads. [BSC-CG]
5.303.3.3.1 Single showerhead. Showerheads shall have a maximum flow rate of not more than 1.8 gallons per minute at 80 psi. Showerheads shall be certified to the performance criteria of the U.S. EPA WaterSense Specification for Showerheads.

5.303.3.3.2 Multiple showerheads serving one shower. When a shower is served by more than one showerhead, the combined flow rate of all the showerheads and/or other shower outlets controlled by a single valve shall not exceed 1.8 gallons per minute at 80 psi, or the shower shall be designed to allow only one shower outlet to be in operation at a time.
Note: A hand-held shower shall be considered a showerhead.

5.303.3.4 Faucets and fountains.
5.303.3.4.1 Nonresidential Lavatory faucets. Lavatory faucets shall have a maximum flow rate of not more than 0.5 gallons per minute at 60 psi.

5.303.3.4.2 Kitchen faucets. Kitchen faucets shall have a maximum flow rate of not more than 1.8 gallons per minute at 60 psi. Kitchen faucets may temporarily increase the flow above the maximum rate, but not to exceed 2.2 gallons per minute at 60 psi, and must default to a maximum flow rate of 1.8 gallons per minute at 60 psi.

5.303.3.4.3 Wash fountains. Wash fountains shall have a maximum flow rate of not more than1.8 gallons per minute/20 [rim space (inches) at 60 psi].

5.303.3.4.4 Metering faucets. Metering faucets shall not deliver more than 0.20 gallons per cycle.

5.303.3.4.5 Metering faucets for wash fountains. Metering faucets for wash fountains shall have a maximum flow rate of not more than 0.20 gallons per minute/20 [rim space (inches) at 60 psi].

Note: Where complying faucets are unavailable, aerators or other means may be used to achieve reduction.

5.303.3.4.6 Pre-rinse spray value
When installed, shall meet the requirements in the *California Code of Regulations*, Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) Table H-2, Section 1605.3 (h)(4)(A), and Section 1607 (d)(7), and shall be equipped with an integral automatic shutoff.

FOR REFERENCE ONLY: The following table and code section have been reprinted from the *California Code of Regulations*, Title 20 (Appliance Efficiency Regulations), Section 1605.1 (h)(4) and Section 1605.3 (h)(4)(A).

TABLE H-2
STANDARDS FOR COMMERCIAL PRE-RINSE SPRAY VALUES MANUFACTURED ON OR AFTER JANUARY 28, 2019

PRODUCT CLASS [spray force in ounce force (ozf)]	MAXIMUM FLOW RATE (gpm)
Product Class 1 (≤ 5.0 ozf)	1.00
Product Class 2 (> 5.0 ozf and ≤ 8.0 ozf)	1.20
Product Class 3 (> 8.0 ozf)	1.28

X ☐ GC **5.303.4 COMMERCIAL KITCHEN EQUIPMENT.**

5.303.4.1 Food Waste Disposers. Disposers shall either modulate the use of water to no more than 1 gpm when the disposer is not in use (not actively grinding food waste/no-load) or shall automatically shut off after no more than 10 minutes of inactivity. Disposers shall use no more than 8 gpm of water.
Note: This code section does not affect local jurisdiction authority to prohibit or require disposer installation.

5.303.5 AREAS OF ADDITION OR ALTERATION. For those occupancies within the authority of the California Building Standards Commission as specified in Section 103, the provisions of Section 5.303.3 and 5.303.4 shall apply to new fixtures in additions or areas of alteration to the building.

5.303.6 STANDARDS FOR PLUMBING FIXTURES AND FITTINGS. Plumbing fixtures and fittings shall be installed in accordance with the *California Plumbing Code*, and shall meet the applicable standards referenced in Table 1701.1 of the *California Plumbing Code* and in Chapter 6 of this code.

SECTION 5.304 OUTDOOR WATER USE

☐ X **5.304.1 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS.** Nonresidential developments shall comply with a local water efficient landscape ordinance or the current California Department of Water Resources' Model Water Efficient Landscape Ordinance (MWELO), whichever is more stringent.

Notes:
1. The Model Water Efficient Landscape Ordinance (MWELO) is located in the California Code of Regulations, Title 23, Chapter 2.7, Division 2.
2. MWELO and supporting documents, including a water budget calculator, are available at: https://www.water.ca.gov/.

☐ X **5.304.6 OUTDOOR POTABLE WATER USE IN LANDSCAPE AREAS.** For public schools and community colleges, landscape projects as described in Sections 5.304.6.1 and 5.304.6.2 shall comply with the California Department of Water Resources Model Water Efficient Landscape Ordinance (MWELO) commencing with Section 490 of Chapter 2.7, Division 2, Title 23, *California Code of Regulations*; except that the evapotranspiration adjustment factor (ETAF) shall be 0.65 with an additional water allowance for special landscape areas (SLA) of 0.35.

Exception: Any project with an aggregate landscape area of 2,500 square feet or less may comply with the prescriptive measures contained in Appendix D of the MWELO.

5.304.6.1 Newly constructed landscapes. New construction projects with an aggregate landscape area equal to or greater than 500 square feet.

5.304.6.2 Rehabilitated landscapes. Rehabilitated landscape projects with an aggregate landscape area equal to or greater than 1,200 square feet.

DIVISION 5.4 MATERIAL CONSERVATION AND RESOURCE EFFICIENCY

SECTION 5.401 GENERAL

5.401.1 SCOPE. The provisions of this chapter specify the requirements of achieving material conservation, resource efficiency, and greenhouse gas (GHG) emission reduction through protection of buildings from exterior moisture, construction waste diversion, employment of techniques to reduce pollution through recycling of materials, the installation of products with lower GHG emissions and building commissioning or testing and adjusting.

SECTION 5.402 DEFINITIONS

5.402.1 DEFINITIONS. The following terms are defined in Chapter 2 *(and are included here for reference)*

ADJUST. To regulate fluid flow rate and air patterns at the terminal equipment, such as to reduce fan speed or adjust a damper.

BALANCE. To proportion flows within the distribution system, including sub-mains, branches and terminals, according to design quantities.

BUILDING COMMISSIONING. A systematic quality assurance process that spans the entire design and construction process, including verifying and documenting that building systems and components are planned, designed, installed, tested, operated and maintained to meet the owner's project requirements.

BUY CLEAN CALIFORNIA ACT (BCCA). The Buy Clean California Act (BCCA) (Public Contract Code Sections 3500-3505) targets carbon emissions associated with the production of structural steel (hot-rolled sections, hollow structural sections, and plate), concrete reinforcing steel, flat glass, and mineral wool board insulation. The maximum acceptable global warming potential (GWP) limits are established by the Department of General Services (DGS), in consultation with the California Air Resources Board (CARB).

CRADLE-TO-GRAVE. Activities associated with a product or building's life cycle from the extraction stage through disposal stage, and covering modules A1 through C4 in accordance with ISO Standards 14025 and 21930.

ORGANIC WASTE. Food waste, green waste, landscape and pruning wste, nonhazardous wood waste, and food soiled paper waste that is mixed in with food waste.

REFERENCE STUDY PERIOD. The period of use for the building, in years, that will be assumed for life cycle assessment.

TEST. A procedure to determine quantitative performance of a system or equipment

TYPE III ENVIRONMENTAL PRODUCT DECLARATION (EPD). A third-party verified report that summarizes how a product impacts the environment. Type III EPDs can be either product-specific, factory-specific, or industry-wide EPDs. See "Cradle-to-Gate."

FACTORY-SPECIFIC EPD. A product-specific Type III EPD in which the environmental impacts can be attributed to a single manufacturer and manufacturing facility.

INDUSTRY-WIDE EPD (IW-EPD). A Type III EPD in which the environmental impacts are an average of the typical manufacturing impacts for a range of products within the same product category for a group of manufacturers.

PRODUCT-SPECIFIC EPD. A Type III EPD in which the environmental impacts can be attributed to a product design and manufacturer across multiple facilities.

X ☐ GC

SECTION 5.407 WATER RESISTANCE AND MOISTURE MANAGEMENT

5.407.1 WEATHER PROTECTION. Provide a weather-resistant exterior wall and foundation envelope as required by California Building Code Section 1402.2 (Weather Protection), manufacturer's installation instructions or local ordinance, whichever is more stringent.

5.407.2 MOISTURE CONTROL. Employ moisture control measures by the following methods.

5.407.2.1 Sprinklers. Design and maintain landscape irrigation systems to prevent spray on structures.

5.407.2.2 Entries and openings. Design exterior entries and/or openings subject to foot traffic or wind-driven rain to prevent water intrusion into buildings as follows:

5.407.2.2.1 Exterior door protection. Primary exterior entries shall be covered to prevent water intrusion by using nonabsorbent floor and wall finishes within at least 2 feet around and perpendicular to such openings plus at least one of the following:

1. An installed awning at least 4 feet in depth.
2. The door is protected by a roof overhang at least 4 feet in depth.
3. The door is recessed at least 4 feet.
4. Other methods which provide equivalent protection.

5.407.2.2.2 Flashing. Install flashings integrated with a drainage plane.

SECTION 5.408 CONSTRUCTION WASTE REDUCTION, DISPOSAL AND RECYCLING

5.408.1 CONSTRUCTION WASTE MANAGEMENT. Recycle and/or salvage for reuse a minimum of 65% of the non-hazardous construction and demolition waste in accordance with Section 5.408.1.1, 5.408.1.2 or 5.408.1.3; or meet a local construction and demolition waste management ordinance, whichever is more stringent.

5.408.1.1 Construction waste management plan. Where a local jurisdiction does not have a construction and demolition waste management ordinance, submit a construction waste management plan that:

1. Identifies the construction and demolition waste materials to be diverted from disposal by efficient usage, recycling, reuse on the project or salvage for future use or sale.
2. Determines if construction and demolition waste materials will be sorted on-site (source-separated) or bulk mixed (single stream).
3. Identifies diversion facilities where construction and demolition waste material collected will be taken.
4. Specifies that the amount of construction and demolition waste materials diverted shall be calculated by weight or volume, but not by both.

5.408.1.2 Waste Management Company. Utilize a waste management company that can provide verifiable documentation that the percentage of construction and demolition waste material diverted from the landfill complies with this section.

Note: The owner or contractor shall make the determination if the construction and demolition waste material will be diverted by a waste management company.

Exceptions to Sections 5.408.1.1 and 5.408.1.2:

1. Excavated soil and land-clearing debris.
2. Alternate waste reduction methods developed by working with local agencies if diversion or recycle facilities capable of compliance with this item do not exist.
3. Demolition waste meeting local ordinance or calculated in consideration of local recycling facilities and markets.

5.408.1.3 Waste stream reduction alternative. The combined weight of new construction disposal that does not exceed two pounds per square foot of building area may be deemed to meet the 65% minimum requirement as approved by the enforcing agency.

5.408.1.4 Documentation. Documentation shall be provided to the enforcing agency which demonstrates compliance with Sections 5.408.1.1, through 5.408.1.3. The waste management plan shall be updated as necessary and shall be accessible during construction for examination by the enforcing agency.

Notes:

1. Sample forms found in "A Guide to the California Green Building Standards Code (Nonresidential)" located www.dgs.ca.gov/BSC/Resources/Page-Content/Building-Standards-Commission-Resources-List-Folder/CALGreen may be used to assist in documenting compliance with the waste management plan.
2. Mixed construction and demolition debris processors can be located at the California Department of Resources Recycling and Recovery (CalRecycle).

X ☐ GC **5.408.2 UNIVERSAL WASTE. [A]** Additions and alterations to a building or tenant space that meet the scoping provisions in Section 301.3 for nonresidential additions and alterations, shall require verification that Universal Waste items such as fluorescent lamps and ballast and mercury containing thermostats as well as other California prohibited Universal Waste materials are disposed of properly and are diverted from landfills. A list of prohibited Universal Waste materials shall be included in the construction documents.

Note: Refer to the Universal Waste Rule link at: http://www.dtsc.ca.gov/universalwaste/

X ☐ GC **5.408.3 EXCAVATED SOIL AND LAND CLEARING DEBRIS.** 100 percent of trees, stumps, rocks and associated vegetation and soils resulting primarily from land clearing shall be reused or recycled. For a phased project, such material may be stockpiled on site until the storage site is developed.

Exception: Reuse, either on or off-site, of vegetation or soil contaminated by disease or pest infestation.

Notes:

1. If contamination by disease or pest infestation is suspected, contact the County Agricultural Commissioner and follow its direction for recycling or disposal of the material.
2. For a map of know pest and/or disease quarantine zones, consult with the California Department of Food and Agriculture. (www.cdfa.ca.gov)

SECTION 5.409 LIFE CYCLE ASSESSMENT

5.409.1 SCOPE. [BSC-CG] Effective July 1, 2024, projects consisting of newly constructed building(s) with a combined floor area of 100,000 square feet or greater shall comply with either Section 5.409.2 or Section 5.409.3. Alteration(s) to existing building(s) where the combined altered floor area is 100,000 square feet or greater shall comply with either Section 5.105.2, 5.409.2, or 5.409.3. Addition(s) to existing building(s) where the total floor area combined with the existing building(s) is 100,000 square feet or greater shall comply with either Section 5.105.2, Section 5.409.2, or Section 5.409.3. Effective January 1, 2026, the combined floor area shall be 50,000 square feet or greater.

[DSA-SS] Projects consisting of newly constructed building(s) with a combined floor area of 50,000 square feet or greater shall comply with either Section 5.409.2 or Section 5.409.3. Alteration(s) to existing building(s) where the combined altered floor area is 50,000 square feet or greater shall comply with either Section 5.105.2, 5.409.2, or 5.409.3. Addition(s) to existing building(s) where the total floor area combined with the existing building(s) is 50,000 square feet or greater shall comply with either Section 5.105.2, Section 5.409.2, or Section 5.409.3.

DISCLAIMER: *THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.*

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
CAL GREEN STANDARDS

G006

AIA California

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE

NONRESIDENTIAL MANDATORY MEASURES, SHEET 3 (July 2024 Supplement)

Y = YES
N/A = NOT APPLICABLE
RESPON. PARTY = RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

Y	N/A	RESPON. PARTY
☐	X	

5.409.2 Whole building life cycle assessment. Projects shall conduct a cradle-to-grave whole building life cycle assessment performed in accordance with ISO 14040 and ISO 14044, excluding operating energy, and demonstrating a minimum 10-percent reduction in global warming potential (GWP) as compared to a reference baseline building of similar size, function, complexity, type of construction, material specification, and location that meets the requirements of the California Energy Code currently in effect. Software used to conduct the whole building life cycle assessment, including reference baseline building, shall have a data set compliant with ISO 14044, and ISO 21930 or EN 15804, and the software shall conform to ISO 21931 and/or EN 15978. The software tools and data sets shall be the same for evaluation of both the baseline building and the proposed building.

Notes:
1. Software for calculating whole building life cycle assessment is available for free at Athena Sustainable Materials Institute (https://calculatelca.com/software/impact-estimator/) and OneClick LCA-Planetary (www.oneclicklca.com/planetary). Paid versions include, but are not limited to, Sphera GaBi Solutions (gabi.sphera.com), SimaPro (simapro.com), One-Click LCA (www.oneclicklca.com) and Tally for Revit (apps.autodesk.com).

2. ASTM E2921-22 "Standard Practice for Minimum Criteria for Comparing Whole Building Life Cycle Assessments for Use with Building Codes, Standards, and Rating Systems" may be consulted for the assessment.

3. In addition to the required documentation specified in Section 5.409.2.3, Worksheet WS-9 may be required by the enforcing entity to demonstrate compliance with the requirements.

5.409.2.1 Building components. Building enclosure components included in the assessment shall be limited to glazing assemblies, insulation, and exterior finishes. Primary and secondary structural members included in the assessment shall be limited to footings and foundations, and structural columns, beams, walls, roofs, and floors.

5.409.2.2 Reference study period. The reference study period of the proposed building shall be equal to the reference baseline building and shall be 60 years.

5.409.2.3 Verification of compliance. A summary of the GWP analysis produced by the software and Worksheet WS-4 signed by the design professional of record shall be provided in the construction documents as documentation of compliance. A copy of the whole building life cycle assessment which includes the GWP analysis produced by the software, in addition to maintenance and training information, shall be included in the operation and maintenance manual and shall be provided to the owner at the close of construction. The enforcing agency may require inspection and inspection reports in accordance with Sections 702.2 and 703.1 during and at completion of construction to demonstrate substantial conformance. Inspection shall be performed by the design professional of record or third party acceptable to the enforcing agency.

Y	N/A	RESPON. PARTY
☐	X	

5.409.3 Product GWP compliance—prescriptive path. Each product that is permanently installed and listed in Table 5.409.3 shall have a Type III environmental product declaration (EPD), either product-specific or factory-specific.

TABLE 5.409.3
PRODUCT GWP LIMITS

BUY CLEAN CALIFORNIA MATERIALS PRODUCT CATEGORY[1]	MAXIMUM ACCEPTABLE GWP VALUE (unfaciated) ($GWP_{allowed}$)	UNIT OF MEASUREMENT
Hot-rolled structural steel sections	1.77	MT CO_2e/MT
Hollow structural sections	3.00	MT CO_2e/MT
Steel plate	2.61	MT CO_2e/MT
Concrete reinforcing steel	1.56	MT CO_2e/MT
Flat glass	2.50	MT CO_2e/MT [4]
Light-density mineral wool board insulation	5.83	kg CO_2e/MT
Heavy-density mineral wool board insulation	14.28	kg CO_2e/MT
Concrete, Ready-Mixed[2, 3]		
CONCRETE PRODUCT CATEGORY	**MAXIMUM GWP ALLOWED VALUE ($GWP_{allowed}$)**	**UNIT OF MEASUREMENT**
up to 2499 psi	450	kg CO_2e/m^3
2500~3499 psi	489	kg CO_2e/m^3
3500~4499 psi	566	kg CO_2e/m^3
4500~5499 psi	661	kg CO_2e/m^3
5500~6499 psi	701	kg CO_2e/m^3
6500 psi and greater	799	kg CO_2e/m^3
Concrete, Lightweight Ready-Mixed[2]		
CONCRETE PRODUCT CATEGORY	**MAXIMUM GWP ALLOWED VALUE ($GWP_{allowed}$)**	**UNIT OF MEASUREMENT**
up to 2499 psi	875	kg CO_2e/m^3
2500~3499 psi	956	kg CO_2e/m^3
3500~4499 psi	1039	kg CO_2e/m^3

1. The GWP values of the products listed in Table 5.409.3 are based on 175 percent of Buy Clean California Act (BCCA) GWP values, except for concrete products which are not included in the BCCA.
2. For concrete, 175 percent of the National Ready Mixed Concrete Association (NRMCA) 2022 version 3 Pacific Southwest regional benchmark values are used for the GWP allowed, except for High Early Strength.
3. Concrete High Early Strength ready-mixed shall be calculated at 130 percent of the ready-mixed concrete GWP allowed values for each product category.
4. The GWP unit for flat glass has been adjusted to correct an error in the express terms. With the revised unit (MT CO2e/MT), reported GWP values will align with industry data as published in the CLF North American Material Baselines (2023).

5.409.3.1 Products shall not exceed the maximum GWP value specified in Table 5.409.3.

Exception: Concrete may be considered one product category to meet compliance with this section. A weighted average of the maximum GWP for all concrete mixes installed in the project shall be less than the weighted average maximum GWP allowed per Table 5.409.3 using Exception Equation 5.409.3.1. Calculations shall be performed with consistent units of measurement for the material quantity and the GWP value.

For the purposes of this exception, industry-wide EPDs are acceptable.

Exception EQUATION 5.409.3.1

$GWP_p < GWP_{allowed}$
where
$GWP_p = \Sigma\ (GWP_n)(v_n)$
and
$GWP_{allowed} = \Sigma\ (GWP_{allowed})(v_n)$
and
$_n$ = each concrete mix installed in the project
GWP_n = the GWP for concrete mix $_n$ per concrete mix EPD, in kg CO2e/m3
$GWP_{allowed}$ = the GWP potential allowed for concrete mix $_n$ per Table 5.409.3
v_n = the volume of concrete mix $_n$ installed in the project, in m3

Y	N/A	RESPON. PARTY
X	☐	GC

5.409.3.2 Verification of compliance. Calculations to demonstrate compliance, Type III EPDs for products required to comply, if included in the project, and Worksheet WS-5 signed by the design professional of record shall be provided on the construction documents. Updated EPDs for products used in construction shall be provided to the owner at the close of construction and to the enforcement entity upon request. The enforcing agency may require inspection and inspection reports in accordance with Sections 702.2 and 703.1 during and at completion of construction to demonstrate substantial conformance. Inspection shall be performed by the design professional of record or third party acceptable to the enforcing agency.

SECTION 5.410 BUILDING MAINTENANCE AND OPERATIONS

5.410.1 RECYCLING BY OCCUPANTS. Provide readily accessible areas that serve the entire building and are identified for the depositing, storage and collection of non-hazardous materials for recycling, including (at a minimum) paper, corrugated cardboard, glass, plastics, organic waste, and metals or meet a lawfully enacted local recycling ordinance, if more restrictive.

Exception: Rural jurisdictions that meet and apply for the exemption in Public Resources Code 42649.82 (a)(2)(A) et seq. shall also be exempt from the organic waste portion of this section.

5.410.1.1 Additions. All additions conducted within a 12-month period under single or multiple permits, resulting in an increase of 30% or more in floor area, shall provide recycling areas on site.

Exception: Additions within a tenant space resulting in less than a 30% increase in the tenant space floor area.

5.410.1.2 Sample ordinance. Space allocation for recycling areas shall comply with Chapter 18, Part 3, Division 30 of the *Public Resources Code*. Chapter 18 is known as the California Solid Waste Reuse and Recycling Access Act of 1991 (Act).

Note: A sample ordinance for use by local agencies may be found in Appendix A of the document at the CalRecycle's web site.

☐	X	

5.410.2 COMMISSIONING. [N] New buildings 10,000 square feet and over. For new buildings 10,000 square feet and over, building commissioning shall be included in the design and construction processes of the building project to verify that the building systems and components meet the owner's or owner representative's project requirements. Commissioning shall be performed in accordance with this section by trained personnel with experience on projects of comparable size and complexity. For I-occupancies that are not regulated by OSHPD or for I-occupancies and L-occupancies that are not regulated by the California Energy Code Section 100.0 Scope, all requirements in Sections 5.410.2 through 5.410.2.6 shall apply.

Note: For energy-related systems under the scope (Section 100) of the California Energy Code, including heating, ventilation, air conditioning (HVAC) systems and controls, indoor lighting systems and controls, as well as water heating systems and controls, refer to California Energy Code Section 120.8 for commissioning requirements

Commissioning requirements shall include:

1. Owner's or Owner representative's project requirements.
2. Basis of design.
3. Commissioning measures shown in the construction documents.
4. Commissioning plan.
5. Functional performance testing.
6. Documentation and training.
7. Commissioning report.

Exceptions:

1. Unconditioned warehouses of any size.
2. Areas less than 10,000 square feet used for offices or other conditioned accessory spaces within unconditioned warehouses.
3. Tenant improvements less than 10,000 square feet as described in Section 303.1.1.
4. Open parking garages of any size, or open parking garage areas, of any size, within a structure.

Note: For the purposes of this section, unconditioned shall mean a building, area or room which does not provide heating and/or air conditioning.

Informational Notes:

1. . Functional performance testing for heating, ventilation, air conditioning systems and lighting controls must be performed in compliance with the *California Energy Code*.

5.410.2.1 Owner's or Owner Representative's Project Requirements (OPR). [N] The expectations and requirements of the building appropriate to its phase shall be documented before the design phase of the project begins. This documentation shall include the following:

1. Environmental and sustainability goals.
2. Building sustainable goals.
3. Indoor environmental quality requirements.
4. Project program, including facility functions and hours of operation, and need for after hours operation.
5. Equipment and systems expectations.
6. Building occupant and operation and maintenance (O&M) personnel expectations.

5.410.2.2 Basis of Design (BOD). [N] A written explanation of how the design of the building systems meets the OPR shall be completed at the design phase of the building project. The Basis of Design document shall cover the following systems:

1. Renewable energy systems.
2. Landscape irrigation systems.
3. Water reuse system.

5.410.2.3 Commissioning plan. [N] Prior to permit issuance a commissioning plan shall be completed to document how the project will be commissioned. The commissioning plan shall include the following:

1. General project information.
2. Commissioning goals.
3. Systems to be commissioned. Plans to test systems and components shall include:
   a. An explanation of the original design intent.
   b. Equipment and systems to be tested, including the extent of tests.
   c. Functions to be tested.
   d. Conditions under which the test shall be performed.
   e. Measurable criteria for acceptable performance.
4. Commissioning team information.
5. Commissioning process activities, schedules and responsibilities. Plans for the completion of commissioning shall be included.

5.410.2.4 Functional performance testing. [N] Functional performance tests shall demonstrate the correct installation and operation of each component, system and system-to-system interface in accordance with the approved plans and specifications. Functional performance testing reports shall contain information addressing each of the building components tested, the testing methods utilized, and include any readings and adjustments made.

5.410.2.5 Documentation and training. [N] A Systems Manual and Systems Operations Training are required, including Occupational Safety and Health Act (OSHA) requirements in *California Code of Regulations* (CCR), Title 8, Section 5142, and other related regulations.

5.410.2.5.1 Systems manual. [N] Documentation of the operational aspects of the building shall be completed within the systems manual and delivered to the building owner or representative. The systems manual shall include the following:

1. Site information, including facility description, history and current requirements.
2. Site contact information.
3. Basic operations and maintenance, including general site operating procedures, basic troubleshooting, recommended maintenance requirements, site events log.
4. Major systems.
5. Site equipment inventory and maintenance notes.
6. A copy of verifications required by the enforcing agency or this code.
7. Other resources and documentation, if applicable.

5.410.2.5.2 Systems operations training. [N] A program for training of the appropriate maintenance staff for each equipment type and/or system shall be developed and documented in the commissioning report and shall include the following:

1. System/equipment overview (what it is, what it does and with what other systems and/or equipment it interfaces).
2. Review and demonstration of servicing/preventive maintenance.
3. Review of the information in the Systems Manual.
4. Review of the record drawings on the system/equipment.

5.410.2.6 Commissioning report. [N] A report of commissioning process activities undertaken through the design and construction phases of the building project shall be completed and provided to the owner or representative.

☐	X	

5.410.4 TESTING AND ADJUSTING. New buildings less than 10,000 square feet. Testing and adjusting of systems shall be required for new buildings less than 10,000 square feet or new systems to serve an addition or alteration subject to Section 303.1.

Y	N/A	RESPON. PARTY

5.410.4.2 (Reserved)

Note: For energy-related systems under the scope (Section 100) of the California Energy Code, including heating, ventilation, air conditioning (HVAC) systems and controls, indoor lighting system and controls, as well as water heating systems and controls, refer to California Energy Code Section 120.8 for commissioning requirements and Sections 120.5, 120.6, 130.4, and 140.9(b)3 for additional testing requirements of specific systems.

5.410.4.2 Systems. Develop a written plan of procedures for testing and adjusting systems. Systems to be included for testing and adjusting shall include at a minimum, as applicable to the project:

1. Renewable energy systems.
2. Landscape irrigation systems.
3. Water reuse systems.

5.410.4.3 Procedures. Perform testing and adjusting procedures in accordance with manufacturer's specifications and applicable standards on each system.

5.410.4.3.1 HVAC balancing. In addition to testing and adjusting, before a new space-conditioning system serving a building or space is operated for normal use, the system shall be balanced in accordance with the procedures defined by the Testing Adjusting and Balancing Bureau National Standards; the National Environmental Balancing Bureau Procedural Standards; Associated Air Balance Council National Standards or as approved by the enforcing agency.

5.410.4.4 Reporting. After completion of testing, adjusting and balancing, provide a final report of testing signed by the individual responsible for performing these services.

5.410.4.5 Operation and maintenance (O & M) manual. Provide the building owner or representative with detailed operating and maintenance instructions and copies of guaranties/warranties for each system. O & M instructions shall be consistent with OSHA requirements in CCR, Title 8, Section 5142, and other related regulations.

5.410.4.5.1 Inspections and reports. Include a copy of all inspection verifications and reports required by the enforcing agency.

DIVISION 5.5 ENVIRONMENTAL QUALITY

SECTION 5.501 GENERAL

5.501.1 SCOPE. The provisions of this chapter shall outline means of reducing the quantity of air contaminants that are odorous, irritating, and/or harmful to the comfort and well-being of a building's installers, occupants and neighbors.

SECTION 5.502 DEFINITIONS

5.502.1 DEFINITIONS. The following terms are defined in Chapter 2 *(and are included here for reference)*

ARTERIAL HIGHWAY. A general term denoting a highway primarily for through traffic usually on a continuous route.

A-WEIGHTED SOUND LEVEL (dBA). The sound pressure level in decibels as measured on a sound level meter using the internationally standardized A-weighting filter or as computed from sound spectral data to which A-weighting adjustments have been made.

1 BTU/HOUR. British thermal units per hour, also referred to as Btu. The amount of heat required to raise one pound of water one degree Fahrenheit per hour, a common measure of heat transfer rate. A ton of refrigeration is 12,000 Btu, the amount of heat required to melt a ton (2,000 pounds) of ice at 32^{0} Fahrenheit.

COMMUNITY NOISE EQUIVALENT LEVEL (CNEL). A metric similar to the day-night average sound level (Ldn), except that a 5 decibel adjustment is added to the equivalent continuous sound exposure level for evening hours (7pm to 10pm) in addition to the 10 dB nighttime adjustment used in the Ldn.

COMPOSITE WOOD PRODUCTS. Composite wood products include hardwood plywood, particleboard and medium density fiberboard. "Composite wood products" does not include hardboard, structural plywood, structural panels, structural composite lumber, oriented strand board, glued laminated timber, timber, prefabricated wood I–joists or finger–jointed lumber, all as specified in California Code of Regulations (CCR), Title 17, Section 93120.1(a).

Note: See CCR, Title 17, Section 93120.1.

DAY-NIGHT AVERAGE SOUND LEVEL (Ldn). The A-weighted equivalent continuous sound exposure level for a 24-hour period with a 10 dB adjustment added to sound levels occurring during nighttime hours (10p.m. to 7 a.m.).

DECIBEL (db). A measure on a logarithmic scale of the magnitude of a particular quantity (such as sound pressure, sound power, sound intensity) with respect to a reference quantity.

ELECTRIC VEHICLE (EV). An automotive-type vehicle for on-road use, such as passenger automobiles, buses, trucks, vans, neighborhood electric vehicles, electric motorcycles, and the like, primarily powered by an electric motor that draws current from a rechargeable storage battery, fuel cell, photovoltaic array, or other source of electric current. Plug-in hybrid electric vehicles (PHEV) are considered electric vehicles. For purposes of the *California Electrical Code*, off-road, self-propelled electric vehicles, such as industrial trucks, hoists, lifts, transports, golf carts, airline ground support equipment, tractors, boats, and the like, are not included.

ELECTRIC VEHICLE CHARGING STATION(S) (EVCS)). One or more spaces intended for charging electric vehicles.

ELECTRIC VEHICLE SUPPLY EQUIPMENT (EVSE). The conductors, including the ungrounded, grounded, and equipment grounding conductors and the electric vehicle connectors, attachment plugs, and all other fittings, devices, power outlets, or apparatus installed specifically for the purpose of transferring energy between the premises wiring and the electric vehicle.

ENERGY EQUIVALENT (NOISE) LEVEL (Leq). The level of a steady noise which would have the same energy as the fluctuating noise level integrated over the time of period of interest.

EXPRESSWAY. An arterial highway for through traffic which may have partial control of access, but which may or may not be divided or have grade separations at intersections.

FREEWAY. A divided arterial highway with full control of access and with grade separations at intersections.

GLOBAL WARMING POTENTIAL (GWP). The radiative forcing impact of one mass-based unit of a given greenhouse gas relative to an equivalent unit of carbon dioxide over a given period of time. Carbon dioxide is the reference compound with a GWP of one.

GLOBAL WARMING POTENTIAL VALUE (GWP VALUE). A 100-year GWP value published by the Intergovernmental Panel on Climate Change (IPCC) in either its Second Assessment Report (SAR) (IPCC, 1995); or its Fourth Assessment A-3 Report (AR4) (IPCC, 2007). The SAR GWP values are found in column "SAR (100-yr)" of Table 2.14.; the AR4 GWP values are found in column "100 yr" of Table 2.14.

HIGH-GWP REFRIGERANT. A compound used as a heat transfer fluid or gas that is: (a) a chlorofluorocarbon, a hdrochlorofluorocarbon, a hydrofluorocarbon, a perfluorocarbon, or any compound or blend of compounds, with a GWP value equal to or greater than 150, or (B) any ozone depleting substance as defined in Title 40 of the Code of Federal Regulations, Part 82, sec.82.3 (as amended March 10, 2009).

LONG RADIUS ELBOW. Pipe fitting installed between two lengths of pipe or tubing to allow a change of direction, with a radius 1.5 times the pipe diameter.

LOW-GWP REFRIGERANT. A compound used as a heat transfer fluid or gas that: (A) has a GWP value less than 150, and (B) is not an ozone depleting substance as defined in Title 40 of the Code of Federal Regulations, Part 82, sec.82.3 (as amended March 10, 2009).

MERV. Filter minimum efficiency reporting value, based on ASHRAE 52.2–1999.

MAXIMUM INCREMENTAL REACTIVITY (MIR). The maximum change in weight of ozone formed by adding a compound to the "Base REactive Organic Gas (ROG) Mixture" per weight of compound added, expressed to hundreths of a gram (g O^3/g ROC).

PRODUCT-WEIGHTED MIR (PWMIR). The sum of all weighted-MIR for all ingredients in a product subject to this article. The PWMIR is the total product reactivity expressed to hundredths of a gram of ozone formed per gram of product (excluding container and packaging).

PSIG. Pounds per square inch, guage.

REACTIVE ORGANIC COMPOUND (ROC). Any compound that has the potential, once emitted, to contribute to ozone formation in the troposphere.

SCHRADER ACCESS VALVES. Access fittings with a valve core installed.

SHORT RADIUS ELBOW. Pipe fitting installed between two lengths of pipe or tubing to allow a change of direction, with a radius 1.0 times the pipe diameter.

SUPERMARKET. For the purposes of Section 5.508.2, a supermarket is any retail food facility with 8,000 square feet or more conditioned area, and that utilizes either refrigerated display cases, or walk-in coolers or freezers connected to remote compressor units or condensing units.

VOC. A volatile organic compound broadly defined as a chemical compound based on carbon chains or rings with vapor pressures greater than 0.1 millimeters of mercury at room temperature. These compounds typically contain hydrogen and may contain oxygen, nitrogen and other elements. See CCR Title 17, Section 94508(a).

Note: Where specific regulations are cited from different agencies such as SCAQMD, ARB, etc., the VOC definition included in that specific regulation is the one that prevails for the specific measure in question.

Y	N/A	RESPON. PARTY
☐	X	

SECTION 5.503 FIREPLACES

5.503.1 FIREPLACES. Install only a direct-vent sealed-combustion gas or sealed wood-burning fireplace, or a sealed woodstove or pellet stove, and refer to residential requirements in the California Energy Code, Title 24, Part 6, Subchapter 7, Section 150. Woodstoves, pellet stoves and fireplaces shall comply with applicable local ordinances.

5.503.1.1 Woodstoves. Woodstoves and pellet stoves shall comply with U.S. EPA New Source Performance Standards (NSPS) emission limits as applicable, and shall have a permanent label indicating they are certified to meet the emission limits.

SECTION 5.504 POLLUTANT CONTROL

X	☐	GC

5.504.1 TEMPORARY VENTILATION. The permanent HVAC system shall only be used during construction if necessary to condition the building or areas of addition or alteration within the required temperature range for material and equipment installation. If the HVAC system is used during construction, use return air filters with a Minimum Efficiency Reporting Value (MERV) of 8, based on ASHRAE 52.2-1999, or an average efficiency of 30% based on ASHRAE 52.1-1992. Replace all filters immediately prior to occupancy, or, if the building is occupied during alteration, at the conclusion of construction.

X	☐	GC

5.504.3 Covering of duct openings and protection of mechanical equipment during construction. At the time of rough installation and during storage on the construction site until final startup of the heating, cooling and ventilation equipment, all duct and other related air distribution component openings shall be covered with tape, plastic, sheetmetal or other methods acceptable to the enforcing agency to reduce the amount of dust, water and debris which may enter the system.

X	☐	GC

5.504.4 FINISH MATERIAL POLLUTANT CONTROL. Finish materials shall comply with Sections 5.504.4.1 through 5.504.4.6.

5.504.4.1 Adhesives, sealants and caulks. Adhesives, sealants, and caulks used on the project shall meet the requirements of the following standards:

1. Adhesives, adhesive bonding primers, adhesive primers, sealants, sealant primers and caulks shall comply with local or regional air pollution control or air quality management district rules where applicable, or SCAQMD Rule 1168 VOC limits, as shown in Tables 5.504.4.1 and 5.504.4.2. Such prohibition on the use of certain toxic compounds (chloroform, ethylene dichloride, methylene chloride, perchloroethylene and trichloroethylene), except for aerosol products as specified in subsection 2, below.

2. Aerosol adhesives, and smaller unit sizes of adhesives, and sealant or caulking compounds (in units of product, less packaging, which do not weigh more than one pound and do not consist of more than 16 fluid ounces) shall comply with statewide VOC standards and other requirements, including prohibitions on use of certain toxic compounds, of *California Code of Regulations*, Title 17, commencing with Section 94507.

TABLE 5.504.4.1 - ADHESIVE VOC LIMIT[1,2]

Less Water and Less Exempt Compounds in Grams per Liter

ARCHITECTURAL APPLICATIONS	CURRENT VOC LIMIT
INDOOR CARPET ADHESIVES	50
CARPET PAD ADHESIVES	50
OUTDOOR CARPET ADHESIVES	150
WOOD FLOORING ADHESIVES	100
RUBBER FLOOR ADHESIVES	60
SUBFLOOR ADHESIVES	50
CERAMIC TILE ADHESIVES	65
VCT & ASPHALT TILE ADHESIVES	50
DRYWALL & PANEL ADHESIVES	50
COVE BASE ADHESIVES	50
MULTIPURPOSE CONSTRUCTION ADHESIVES	70
STRUCTURAL GLAZING ADHESIVES	100
SINGLE-PLY ROOF MEMBRANE ADHESIVES	250
OTHER ADHESIVES NOT SPECIFICALLY LISTED	50
SPECIALTY APPLICATIONS	
PVC WELDING	510
CPVC WELDING	490
ABS WELDING	325
PLASTIC CEMENT WELDING	250
ADHESIVE PRIMER FOR PLASTIC	550
CONTACT ADHESIVE	80
SPECIAL PURPOSE CONTACT ADHESIVE	250
STRUCTURAL WOOD MEMBER ADHESIVE	140
TOP & TRIM ADHESIVE	250
SUBSTRATE SPECIFIC APPLICATIONS	
METAL TO METAL	30
PLASTIC FOAMS	50
POROUS MATERIAL (EXCEPT WOOD)	50
WOOD	30
FIBERGLASS	80

1. IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER, THE ADHESIVE WITH THE HIGHEST VOC CONTENT SHALL BE ALLOWED.

2. FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THIS TABLE, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1168, www.arb.ca.gov/DRDB/SC/CURHTML/R1168.PDF

TABLE 5.504.4.2 - SEALANT VOC LIMIT

Less Water and Less Exempt Compounds in Grams per Liter

SEALANTS	CURRENT VOC LIMIT
ARCHITECTURAL	250
MARINE DECK	760
NONMEMBRANE ROOF	300
ROADWAY	250
SINGLE-PLY ROOF MEMBRANE	450
OTHER	420
SEALANT PRIMERS	
ARCHITECTURAL	
NONPOROUS	250
POROUS	775
MODIFIED BITUMINOUS	500
MARINE DECK	760
OTHER	750

NOTE: FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THESE TABLES, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 1168.

DISCLAIMER: *THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.*

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
CAL GREEN STANDARDS

G007

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE
NONRESIDENTIAL MANDATORY MEASURES, SHEET 4 (July 2024 Supplement)

Y = YES
N/A = NOT APPLICABLE
RESPON. PARTY = RESPONSIBLE PARTY (ie: ARCHITECT, ENGINEER, OWNER, CONTRACTOR, INSPECTOR ETC.)

5.504.4.3 Paints and coatings. Architectural paints and coatings shall comply with VOC limits in Table 1 of the ARB Architectural Coatings Suggested Control Measure, as shown in Table 5.504.4.3, unless more stringent local limits apply. The VOC content limit for coatings that do not meet the definitions for the specialty coatings categories listed in Table 5.504.4.3 shall be determined by classifying the coating as a Flat, Nonflat or Nonflat-High Gloss coating, based on its gloss, as defined in Subsections 4.21, 4.36 and 4.37 of the 2007 California Air Resources Board Suggested Control Measure, and the corresponding Flat, Nonflat or Nonflat-High Gloss VOC limit in Table 5.504.4.3 shall apply.

5.504.4.3.1 Aerosol Paints and coatings. Aerosol paints and coatings shall meet the PWMIR Limits for ROC in Section 94522(a)(3) and other requirements, including prohibitions on use of certain toxic compounds and ozone depleting substances, in Sections 94522(c)(2) and (d)(2) of California *Code of Regulations*, Title 17, commencing with Section 94520; and in areas under the jurisdiction of the Bay Area Air Quality Management District additionally comply with the percent VOC by weight of product limits of Regulation 8 Rule 49.

TABLE 5.504.4.3 - VOC CONTENT LIMITS FOR ARCHITECTURAL COATINGS[2,3]

GRAMS OF VOC PER LITER OF COATING, LESS WATER & LESS EXEMPT COMPOUNDS

COATING CATEGORY	CURRENT VOC LIMIT
FLAT COATINGS	50
NONFLAT COATINGS	100
NONFLAT HIGH GLOSS COATINGS	150
SPECIALTY COATINGS	
ALUMINUM ROOF COATINGS	400
BASEMENT SPECIALTY COATINGS	400
BITUMINOUS ROOF COATINGS	50
BITUMINOUS ROOF PRIMERS	350
BOND BREAKERS	350
CONCRETE CURING COMPOUNDS	350
CONCRETE/MASONRY SEALERS	100
DRIVEWAY SEALERS	50
DRY FOG COATINGS	150
FAUX FINISHING COATINGS	350
FIRE RESISTIVE COATINGS	350
FLOOR COATINGS	100
FORM-RELEASE COMPOUNDS	250
GRAPHIC ARTS COATINGS (SIGN PAINTS)	500
HIGH-TEMPERATURE COATINGS	420
INDUSTRIAL MAINTENANCE COATINGS	250
LOW SOLIDS COATINGS[1]	120
MAGNESITE CEMENT COATINGS	450
MASTIC TEXTURE COATINGS	100
METALLIC PIGMENTED COATINGS	500
MULTICOLOR COATINGS	250
PRETREATMENT WASH PRIMERS	420
PRIMERS, SEALERS, & UNDERCOATERS	100
REACTIVE PENETRATING SEALERS	350
RECYCLED COATINGS	250
ROOF COATINGS	50
RUST PREVENTATIVE COATINGS	250
SHELLACS:	
CLEAR	730
OPAQUE	550
SPECIALTY PRIMERS, SEALERS & UNDERCOATERS	100
STAINS	250
STONE CONSOLIDANTS	450
SWIMMING POOL COATINGS	340
TRAFFIC MARKING COATINGS	100
TUB & TILE REFINISH COATINGS	420
WATERPROOFING MEMBRANES	250
WOOD COATINGS	275
WOOD PRESERVATIVES	350
ZINC-RICH PRIMERS	340

1. GRAMS OF VOC PER LITER OF COATING, INCLUDING WATER & EXEMPT COMPOUNDS
2. THE SPECIFIED LIMITS REMAIN IN EFFECT UNLESS REVISED LIMITS ARE LISTED IN SUBSEQUENT COLUMNS IN THE TABLE.
3. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, ARCHITECTURAL COATINGS SUGGESTED CONTROL MEASURE, FEB. 1, 2008. MORE INFORMATION IS AVAILABLE FROM THE AIR RESOURCES BOARD.

5.504.4.3.2 Verification. Verification of compliance with this section shall be provided at the request of the enforcing agency. Documentation may include, but is not limited to, the following:
1. Manufacturer's product specification
2. Field verification of on-site product containers

5.504.4.4 Carpet Systems.
All carpet installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers." Version 1.2, January 2017 (Emission testing method for California Specifications 01350).

See California Department of Public Health's website for certification programs and testing labs. https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx#material

5.504.4.4.1 Carpet cushion. All carpet cushion installed in the building interior shall meet the requirements of the California Department of Public Health,"Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers,"Version 1.2, January 2017 (Emission testing method for California Specifications 01350).

See California Department of Public Health's website for certification programs and testing labs. https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx#material

5.504.4.4.2 Carpet adhesive. All carpet adhesive shall meet the requirements of Table 5.504.4.1.

5.504.4.5 Composite wood products. Hardwood plywood, particleboard and medium density fiberboard composite wood products used on the interior or exterior of the buildings shall meet the requirements for formaldehyde as specified in ARB's Air Toxics Control Measure (ATCM) for Composite Wood (17 CCR 93120 et seq.). Those materials not exempted under the ATCM must meet the specified emission limits, as shown in Table 5.504.4.5.

5.504.4.5.3 Documentation. Verification of compliance with this section shall be provided as requested by the enforcing agency. Documentation shall include at least one of the following:
1. Product certifications and specifications.
2. Chain of custody certifications.
3. Product labeled and invoiced as meeting the Composite Wood Products regulation (see CCR, Title 17, Section 93120, et seq.).
4. Exterior grade products marked as meeting the PS-1 or PS-2 standards of the Engineered Wood Association, the Australian AS/NZS 2269 or European 636 3S standards.
5. Other methods acceptable to the enforcing agency.

TABLE 5.504.4.5 - FORMALDEHYDE LIMITS[1]

MAXIMUM FORMALDEHYDE EMISSIONS IN PARTS PER MILLION

PRODUCT	CURRENT LIMIT
HARDWOOD PLYWOOD VENEER CORE	0.05
HARDWOOD PLYWOOD COMPOSITE CORE	0.05
PARTICLE BOARD	0.09
MEDIUM DENSITY FIBERBOARD	0.11
THIN MEDIUM DENSITY FIBERBOARD[2]	0.13

1. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, AIR TOXICS CONTROL MEASURE FOR COMPOSITE WOOD AS TESTED IN ACCORDANCE WITH ASTM E 1333. FOR ADDITIONAL INFORMATION, SEE CALIFORNIA CODE OF REGULATIONS, TITLE 17, SECTIONS 93120 THROUGH 93120.12.
2. THIN MEDIUM DENSITY FIBERBOARD HAS A MAXIMUM THICKNESS OF 5/16 INCHES (8 MM).

5.504.4.6 Resilient flooring systems. Where resilient flooring is installed, at least 80 percent of floor area receiving resilient flooring shall meet the requirements of the California Department of Public Health,"Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350)

See California Department of Public Health's website for certification programs and testing labs. https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx#material

5.504.4.6.1 Verification of compliance. Documentation shall be provided verifying that resilient flooring materials meet the pollutant emission limits.

5.504.4.7 Thermal insulation
Comply with the requirements of the California Department of Public Health, "Standard Method of the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers, "Version 1.2, January 1.2, January 2017 (Emission testing method for California Specification 01350).
See California Department of Public Health's website for certification programs and testing labs.
https://www.cdph.ca.gov/Programs/CCDPHP/DEODC/EHLB/IAQ/Pages/VOC.aspx#material

5.504.4.7.1 Verification of compliance.
Documentation shall be provided verifying that thermal insulation materials meet the pollutant emission limits.

5.504.4.8 Acoustical ceiling and wall panels.
Comply with the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers, " Version 1.2, January 2017 (Emission testing method for California Specification 01350).
See California Department of Public Health's website for certification programs and testing labs.

5.504.4.8.1 Verification of compliance. Documentation shall be provided verifying that acoustical finish materials meet the pollutant emission limits.

5.504.5.3 Filters. In mechanically ventilated buildings, provide regularly occupied areas of the building with air filtration media for outside and return air that provides at least a Minimum Efficiency Reporting Value (MERV) of 13. MERV 13 filters shall be installed prior to occupancy, and recommendations for maintenance with filters of the same value shall be included in the operation and maintenance manual.

Exceptions: Existing mechanical equipment.

5.504.5.3.1 Labeling. Installed filters shall be clearly labeled by the manufacturer indicating the MERV rating.

5.504.7 ENVIRONMENTAL TOBACCO SMOKE (ETS) CONTROL. Where outdoor areas are provided for smoking, prohibit smoking within 25 feet of building entries, outdoor air intakes and operable windows and within the building as already prohibited by other laws or regulations; or as enforced by ordinances, regulations or policies of any city, county, city and county, California Community College, campus of the California State University, or campus of the University of California, whichever are more stringent. When ordinances, regulations or policies are not in place, post signage to inform building occupants of the prohibitions.

SECTION 5.505 INDOOR MOISTURE CONTROL

5.505.1 INDOOR MOISTURE CONTROL. Buildings shall meet or exceed the provisions of California Building Code, CCR, Title 24, Part 2, Sections 1202 (Ventilation) and Chapter 14 (Exterior Walls). For additional measures, see Section 5.407.2 of this code.

SECTION 5.506 INDOOR AIR QUALITY

5.506.1 OUTSIDE AIR DELIVERY . For mechanically or naturally ventilated spaces in buildings, meet the minimum requirements of Section 120.1 (Requirements For Ventilation) of the *California Energy Code*, or the applicable local code, whichever is more stringent, and Division 1, Chapter 4 of CCR, Title 8.

5.506.2 CARBON DIOXIDE (CO_2) MONITORING. For buildings or additions equipped with demand control ventilation, CO_2 sensors and ventilation controls shall be specified and installed in accordance with the requirements of the California Energy Code, Section 120(c)(4).

5.506.3 Carbon dioxide (CO2) monitoring in classrooms.
(DSA-SS) Each public K-12 school classroom, as listed in Table 120.1-A of the *California Energy Code,* shall be equipped with a carbon dioxide monitor or sensor that meets the following requirements:
1. The monitor or sensor shall be permanently affixed in a tamper-proof manner in each classroom between 3 and 6 feet (914 mm and 1829 mm) above the floor and at least 5 feet (1524 mm) away from door and operable windows.
2. When the monitor or sensor is not integral to an Energy Management Control System (EMCS), the monitor or sensor shall display the carbon dioxide readings on the device. When the sensor is integral to an EMCS, the carbon dioxide readings shall be available to and regularly monitored by facility personnel.
3. A monitor shall provide notification though a visual indicator on the monitor when the carbon dioxide levels in the classroom have exceeded 1,100ppm. A sensor integral to an EMCS shall provide notification to facility personnel through a visual and/or audible indicator when the carbon dioxide levels in the classroom have exceeded 1,100ppm.
4. The monitor or sensor shall measure carbon dioxide levels at minimum 15- minute intervals and shall maintain a record of previous carbon dioxide measurements of not less than 30 days duration.
5. The monitor or sensor used to measure carbon dioxide levels shall have the capacity to measure carbon dioxide levels with a range of 400ppm to 2000ppm or greater.
6. The monitor or sensor shall be certified by the manufacturer to be accurate within 75ppm at 1,000ppm carbon dioxide concentration and shall be certified by the manufacturer to require calibration no more frequently than once every 5 years.

SECTION 5.507 ENVIRONMENTAL COMFORT

5.507.4 ACOUSTICAL CONTROL. Employ building assemblies and components with Sound Transmission Class (STC) values determined in accordance with ASTM E 90 and ASTM E 413, or Outdoor-Indoor Sound Transmission Class (OITC) determined in accordance with ASTM E 1332, using either the prescriptive or performance method in Section 5.507.4.1 or 5.507.4.2.

Exception: Buildings with few or no occupants or where occupants are not likely to be affected by exterior noise, as determined by the enforcement authority, such as factories, stadiums, storage, enclosed parking structures and utility buildings.

Exception: [DSA-SS] For public schools and community colleges, the requirements of this section and all subsections apply only to new construction.

5.507.4.1 Exterior noise transmission, prescriptive method. Wall and roof-ceiling assemblies exposed to the noise source making up the building or addition envelope or altered envelope shall meet a composite STC rating of at least 50 or a composite OITC rating of no less than 40, with exterior windows of a minimum STC of 40 or OITC of 30 in the following locations:

1. Within the 65 CNEL noise contour of an airport.

   Exceptions:

   1. L_{dn} or CNEL for military airports shall be determined by the facility Air Installation Compatible Land Use Zone (AICUZ) plan.
   2. L_{dn} or CNEL for other airports and heliports for which a land use plan has not been developed shall be determined by the local general plan noise element.

2. Within the 65 CNEL or L_{dn} noise contour of a freeway or expressway, railroad, industrial source or fixed-guideway source as determined by the Noise Element of the General Plan.

5.507.4.1.1. Noise exposure where noise contours are not readily available. Buildings exposed to a noise level of 65 dB L_{eq} - 1-hr during any hour of operation shall have building, addition or alteration exterior wall and roof-ceiling assemblies exposed to the noise source meeting a composite STC rating of at least 45 (or OITC 35), with exterior windows of a minimum STC of 40 (or OITC 30).

5.507.4.2 Performance Method. For buildings located as defined in Section 5.507.4.1 or 5.507.4.1.1, wall and roof-ceiling assemblies exposed to the noise source making up the building or addition envelope or altered envelope shall be constructed to provide an interior noise environment attributable to exterior sources that does not exceed an hourly equivalent noise level (Leq-1Hr) of 50 dBA in occupied areas during any hour of operation.

5.507.4.2.1 Site Features. Exterior features such as sound walls or earth berms may be utilized as appropriate to the building, addition or alteration project to mitigate sound migration to the interior.

5.507.4.2.2 Documentation of Compliance. An acoustical analysis documenting complying interior sound levels shall be prepared by personnel approved by the architect or engineer of record.

5.507.4.3 Interior sound transmission. Wall and floor-ceiling assemblies separating tenant spaces and tenant spaces and public places shall have an STC of at least 40.

Note: Examples of assemblies and their various STC ratings may be found at the California Office of Noise Control: www.toolbase.org/PDF/CaseStudies/stc_icc_ratings.pdf.

SECTION 5.508 OUTDOOR AIR QUALITY

5.508.1 Ozone depletion and greenhouse gas reductions. Installations of HVAC, refrigeration and fire suppression equipment shall comply with Sections 5.508.1.1 and 5.508.1.2.

5.508.1.1 Chlorofluorocarbons (CFCs). Install HVAC, refrigeration and fire suppression equipment that do not contain CFCs.

5.508.1.2 Halons. Install HVAC, refrigeration and fire suppression equipment that do not contain Halons.

5.508.2 Supermarket refrigerant leak reduction. New commercial refrigeration systems shall comply with the provisions of this section when installed in retail food stores 8,000 square feet or more conditioned area, and that utilize either refrigerated display cases, or walk-in coolers or freezers connected to remote compressor units or condensing units. The leak reduction measures apply to refrigeration systems containing high-global-warming potential (high-GWP) refrigerants with a GWP of 150 or greater. New refrigeration systems include both new facilities and the replacement of existing refrigeration systems in existing facilities.

Exception: Refrigeration systems containing low-global warming potential (low-GWP) refrigerant with a GWP value less than 150 are not subject to this section. Low-GWP refrigerants are nonozone-depleting refrigerants that include ammonia, carbon dioxide (CO_2), and potentially other refrigerants.

5.508.2.1 Refrigerant piping. Piping compliant with the California Mechanical Code shall be installed to be accessible for leak protection and repairs. Piping runs using threaded pipe, copper tubing with an outside diameter (OD) less than 1/4 inch, flared tubing connections and short radius elbows shall not be used in refrigerant systems except as noted below.

5.508.2.1.1 Threaded pipe. Threaded connections are permitted at the compressor rack.

5.508.2.1.2 Copper pipe. Copper tubing with an OD less than 1/4 inch may be used in systems with a refrigerant charge of 5 pounds or less.

5.508.2.1.2.1 Anchorage. One-fouth-inch OD tubing shall be securely clamped to a rigid base to keep vibration levels below 8 mils.

5.508.2.1.3 Flared tubing connections. Double-flared tubing connections may be used for pressure controls, valve pilot lines and oil.

Exception: Single-flared tubing connections may be used with a multiring seal coated with industrial sealant suitable for use with refrigerants and tightened in accordance with manufacturer's recommendations.

5.508.2.1.4 Elbows. Short radius elbows are only permitted where space limitations prohibit use of long radius elbows.

5.508.2.2 Valves. Valves Valves and fittings shall comply with the *California Mechanical Code* and as follows.

5.508.2.2.1 Pressure relief valves. For vessels containing high-GWP refrigerant, a rupture disc shall be installed between the outlet of the vessel and the inlet of the pressure relief valve.

5.508.2.2.1.1 Pressure detection. A pressure gauge, pressure transducer or other device shall be installed in the space between the rupture disc and the relief valve inlet to indicate a disc rupture or discharge of the relief valve.

5.508.2.2.2 Access valves. Only Schrader access valves with a brass or steel body are permitted for use.

5.508.2.2.2.1 Valve caps. For systems with a refrigerant charge of 5 pounds or more, valve caps shall be brass or steel and not plastic.

5.508.2.2.2.2 Seal caps. If designed for it, the cap shall have a neoprene O-ring in place.

5.508.2.2.2.2.1 Chain tethers. Chain tethers to fit ovr the stem are required for valves designed to have seal caps.

Exception: Valves with seal caps that are not removed from the valve during stem operation.

5.508.2.3 Refrigerated service cases. Refrigerated service cases holding food products containing vinegar and salt shall have evaporator coils of corrosion-resistant material, such as stainless steel; or be coated to prevent corrosion from these substances.

5.508.2.3.1 Coil coating. Consideration shall be given to the heat transfer efficiency of coil coating to maximize energy efficiency.

5.508.2.4 Refrigerant receivers. Refrigerant receivers with capacities greater than 200 pounds shall be fitted with a device tha indicates the level of refrigerant in the receiver.

5.508.2.5 Pressure testing. The system shall be pressure tested during installation prior to evacuation and charging.

5.508.2.5.1 Minimum pressure. The system shall be charged with regulated dry nitrogen and appropriate tracer gas to bring system pressure up to 300 psig minimum.

5.508.2.5.2 Leaks. Check the system for leaks, repair any leaks, and retest for pressure using the same gauge.

5.508.2.5.3 Allowable pressure change. The system shall stand, unaltered, for 24 hours with no more than a +/- one pound pressure change from 300 psig, measured with the same gauge.

5.508.2.6 Evacuation. The system shall be evacuated after pressure testing and prior to charging.

5.508.2.6.1 First vacuum. Pull a system vacuum down to at least 1000 microns (+/- 50 microns), and hold for 30 minutes.

5.508.2.6.2 Second vacuum. Pull a second system vacuum to a minimum of 500 microns and hold for 30 minutes.

5.508.2.6.3 Third vacuum. Pull a third vacuum down to a minimum of 300 microns, and hold for 24 hours with a maximum drift of 100 microns over a 24-hour period.

CHAPTER 7
INSTALLER & SPECIAL INSPECTOR QUALIFICATIONS

702 QUALIFICATIONS

702.1 INSTALLER TRAINING. HVAC system installers shall be trained and certified in the proper installation of HVAC systems including ducts and equipment by a nationally or regionally recognized training or certification program. Uncertified persons may perform HVAC installations when under the direct supervision and responsibility of a person trained and certified to install HVAC systems or contractor licensed to install HVAC systems. Examples of acceptable HVAC training and certification programs include but are not limited to the following:

1. State certified apprenticeship programs.
2. Public utility training programs.
3. Training programs sponsored by trade, labor or statewide energy consulting or verification organizations.
4. Programs sponsored by manufacturing organizations.
5. Other programs acceptable to the enforcing agency.

702.2 SPECIAL INSPECTION [HCD]. When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition to other certifications or qualifications acceptable to the enforcing agency, the following certifications or education may be considered by the enforcing agency when evaluating the qualifications of a special inspector:

1. Certification by a national or regional green building program or standard publisher.
2. Certification by a statewide energy consulting or verification organization, such as HERS raters, building performance contractors, and home energy auditors.
3. Successful completion of a third party apprentice training program in the appropriate trade.
4. Other programs acceptable to the enforcing agency.

Notes:

1. Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.
2. HERS raters are special inspectors certified by the California Energy Commission (CEC) to rate homes in California according to the Home Energy Rating System (HERS).

[BSC-CG] When required by the enforcing agency, the owner or the responsible entity acting as the owner's agent shall employ one or more special inspectors to provide inspection or other duties necessary to substantiate compliance with this code. Special inspectors shall demonstrate competence to the satisfaction of the enforcing agency for the particular type of inspection or task to be performed. In addition, the special inspector shall have a certification from a recognized state, national or international association, as determined by the local agency. The area of certification shall be closely related to the primary job function, as determined by the local agency.

Note: Special inspectors shall be independent entities with no financial interest in the materials or the project they are inspecting for compliance with this code.

703 VERIFICATIONS

703.1 DOCUMENTATION. Documentation used to show compliance with this code shall include but is not limited to, construction documents, plans, specifications, builder or installer certification, inspection reports, or other methods acceptable to the enforcing agency which demonstrate substantial conformance. When specific documentation or special inspection is necessary to verify compliance, that method of compliance will be specified in the appropriate section or identified applicable checklist.

DISCLAIMER: *THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN) CODE. DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.*

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
CAL GREEN STANDARDS

G008

DIVISION 1 - GENERAL REQUIREMENTS

SECTION 01100 - SUMMARY

1.1 Contract Documents:

A. Contractor shall use the following Tenant provided documents in the negotiation and execution of the Work. Contact Tenant's office for copies of these documents:
   1. Chipotle Instructions to Bidders.
   2. Construction Contract for Chipotle Mexican Grill.

B. Definitions:
   1. The term "Owner" used in these documents refers to the building Owner/Landlord.
   2. The term "Tenant" used in these documents refer to the restaurant Tenant, Chipotle Mexican Grill, Inc.
   3. The term "Contractor" used in these documents refers to the entity responsible for performing the Work under Construction Contract for Chipotle Mexican Grill.

1.2 Scope of Work:

A. The Work shall include construction of the site and building facilities as shown and specified in these Specifications and Drawings.

B. When required and necessary, the Tenant will provide a subsurface exploration report as an attachment the bidding documents.

SECTION 01300 - ADMINISTRATIVE REQUIREMENTS

1.1 Coordination:

A. Immediately inform the Architect of discrepancies between the information indicated in the Contract Documents and existing project conditions, and of discrepancies between information indicated on the architectural, structural, mechanical, plumbing and electrical documents.

B. Prior to fabrication and installation of new components, field verify all existing and new dimensions and installation conditions that may affect the Work. Do not scale the drawings to establish locations of items that are not located using dimensions.
   1. All dimensions are to rough face of stud or centerline of structure, unless otherwise indicated.
   2. Verify that all Subcontractors have reviewed and coordinated locations of their equipment and furnishings exposed to view with the architectural drawings. Review questions with the Architect.

C. Coordinate new work indicated on the Contract Documents with new work that may be provided by the Owner and Tenant under separate contracts.

D. Coordinate the work of Vendors, Contractors and Subcontractors providing fixtures, furniture and equipment identified as "by Tenant" in these drawings and specifications.
   1. Notify the Tenant in timely fashion if any problems develop with the performance of these Vendors, Contractors or Subcontractors.

E. Coordinate the scheduling, sequencing, and the work of all trades and Subcontractors to assure efficient and orderly sequences of installation of interdependent construction elements.

F. Verify that the utility requirement characteristics of operating equipment are compatible with the building utility services. Coordinate work of the various specification sections having interdependent responsibilities for installing, connecting to, and placing in service such equipment.

G. Coordinate the installation and physical space requirements of plumbing, mechanical and electrical work that are indicated diagrammatically on the drawings. Follow routing shown for piping, ducts and conduit as closely as practical. Install runs parallel with and perpendicular to the line of the building. Utilize spaces as efficiently as possible to maximize accessibility for other work installation and for maintenance and for repair.
   1. Conceal piping, ducts and conduit within the construction, except as otherwise indicated.
   2. Coordinate locations of registers, fixtures and outlets with finish elements.

H. Coordinate completion and cleanup work of all trades and Subcontractors in preparation for Substantial Completion.

I. To minimize disruption of Tenant's activities after Tenant occupancy of the property, coordinate access to the property with the Tenant's Construction Manager for correction of defective work and work not in accordance with the Contract Documents.

1.2 Submittals:

A. Only when indicated in the specifications or drawings submit shop drawings, product data, and/or samples to the Architect, Design Manager, and Development Analyst for review. All submittals shall be made directly to the Architect by the general contractor. Only submittals for specified products will be accepted unless prior approval has been obtained for a substitution (refer to Section 01630).

Shop drawings: Submit electronic copies of each sheet of drawings. Shop drawings are original drawings prepared by the subcontractor or vendor for the purpose of conveying information to the Architect and/or Engineer on how a building element or product will be constructed in sufficient detail for the Architect and/or Engineer to determine compliance with the design intent.

In all cases one copy of the submittal shall be returned to the General Contractor. Electronic submittals for shop drawing or product data in either PDF or DWF format are acceptable for review. All submittals, regardless of format, must bear the General Contractor's stamp indicating the submittal has been reviewed and approved. Any submittal not meeting the requirements set forth will be rejected by the Architect.

Submittals shall be made with respect to the construction schedule to allow for adequate review time: allow (5) business days for review of submittals for any structural steel, canopies and trusses and allow (3) business days for review of submittals in all other divisions. Review timeline will commence from the time the submittal with General Contractor's approval stamp is received by the Architect, Design Manager, and Development Analyst.

1.3 Requests For Information

A. In the event that the general contractor, or a subcontractor, at any tier, determines that some portion of the drawings, specifications, or other contract documents requires a clarification or interpretation by the architect, the general contractor shall submit a Request For Information in writing to the architect in an electronic copy.

Requests for Information may only be submitted by the general contractor and may only be submitted to the architect. The general contractor shall clearly and concisely set forth the issue for which clarification or interpretation is sought and why a response is needed from the architect or the architect's consultants. In the Request for Information, the general contractor shall set forth an interpretation or understanding of the requirement along with an explanation of why such an understanding was reached.

B. The architect will review all Requests for Information to determine whether they are Requests for Information within the meaning of this term. If the architect determines that the document is not a request for information, it will be returned to the general contractor, un-reviewed as to content, for re-submittal in the proper form and in the proper manner.

Responses to Requests for Information shall be issued upon receipt, but no later that five (5) working days of receipt of the Request from the general contractor; unless the architect determines that a longer amount of time is necessary to provide an adequate response. If a longer amount of time is determined necessary by the architect, the architect will, within five (5) working days of receipt of the Request, notify the general contractor of the anticipated response time. If the general contractor submits a Request for Information on an activity with five (5) working days or less of float on the current project schedule the general contractor shall not be entitled to any time extension due to the time it takes the architect to respond to the Request provided that the architect responds within the parameters set forth above.

C. Responses to Requests for Information from the architect will not change any requirements of the contract documents. In the event that the general contractor believes that a response to a Request For Information will cause a change to the requirements of the contract documents, the general contractor shall immediately give written notice to the architect and the tenant stating that the general contractor considers the response to be a Change Order. Failure to give such written notice immediately shall waive the general contractor's (or any subcontractor's) right to seek additional time or cost under the Administrative Requirements of these contract documents.

SECTION 01400 - QUALITY REQUIREMENTS

1.1 Regulatory Requirements:

A. Perform all work in accordance with applicable local, state, and federal building codes, plumbing codes, mechanical codes, electrical codes, ordinances and rules and regulations governing food service establishments.

B. Comply with local, state and federal requirements governing accessibility.

C. Obtain all required demolition and erosion control permits required by authorities having jurisdiction.

1.2 Quality Control:

A. Maintain quality control over manufacturers, suppliers, products, services, site conditions and workmanship, to produce work of specified quality.

B. Comply with manufacturer's instructions and applicable trade standards.

C. Handle, install, connect, clean, condition and adjust products in strict accordance with manufacturer's instructions and complying with specified requirements.
   1. Request clarification from the Architect before proceeding, where manufacturer's instructions conflict with the Contract Documents.

D. Comply with specified standards as a minimum quality for the Work, except when more stringent tolerances, codes or specified requirements indicate higher standards or more precise workmanship.

E. Perform work by persons qualified to produce workmanship of the specified quality. Secure products in place with positive anchorage devices designed, sized and installed to withstand stress, vibration, physical distortion or disfigurement.

F. All dimensions shall be considered "hold-to" dimensions unless indicated otherwise (e.g. minimum or maximum dimensions.)

1.3 Testing:

A. Employ and pay for the services of an independent testing laboratory to perform inspections, tests and other services when required.

B. Include inspection and tests as indicated in the specification sections, drawings, and as required by authorities having jurisdiction.
   1. Test concrete in accordance with Section 03300 and drawing requirements.
   2. Test structural steel in accordance with Section 05110 and drawing requirements.

SECTION 01500 - TEMPORARY FACILITIES AND CONTROLS

1.1 Provide temporary facilities and controls as shown and specified:

A. Codes and Standards: Provide temporary construction facilities and controls complying with all applicable local, State and Federal local laws, regulations and codes and utility company requirements.

B. Temporary Heating, Ventilating and Cooling:
   1. Provide, pay for and maintain all temporary heating, ventilating and cooling equipment and facilities required during the progress of the work to protect materials, finished work, and equipment against damage from low and high temperatures and humidity.
   2. Provide temporary heating, ventilating and cooling when the outside temperature and humidity is low/high enough to damage or affect in any way the performance or quality of material and product stored in the building, in any temporary storage area, or any material or product incorporated into the work.
   3. Provide temporary heating, ventilating and cooling when the outside temperature and humidity is low/high enough to significantly slow or hamper effectiveness of workers and to provide suitable working conditions.

C. Temporary Electrical Lighting and Power:
   1. Provide, pay for and maintain all temporary electrical service for lighting and power required during the progress of the work. Include all necessary wiring, fuses, disconnect switches, safety devices, junction boxes, panels, ground fault protections, and transformer if required. Include cost for providing temporary electric generators in the Contract Sum, if temporary electric service is not available for use during progress of the work.
   2. Temporary service and lighting and power items and installations shall conform to the requirements of the NFPA National Electric Code and OSHA Occupational Safety and Health Act of 1970.

D. Water: Provide, pay for and maintain all temporary water required during the progress of the work. Include all necessary storage tanks, piping, valves, fittings, hose and hose connections during construction and testing.

E. Temporary Toilets: Provide, pay for and maintain temporary toilet facilities for use by the Contractor, Contractor's employees and all Subcontractors and Subcontractors' employees. Comply with all local requirements for installation, use and maintenance of temporary toilet facilities.

F. Barriers and Enclosures:
   1. Provide temporary construction barriers in accordance with project requirements. Exercise all necessary precautions to protect adjacent properties, outside project contact limits, during progress of the work. Take special precautions to avoid damage to existing overhead and underground utilities and services owned or operated by the Owner or by public or private utility companies.
   2. Provide temporary weather-tight enclosures at exterior openings to provide acceptable working conditions and protection of materials and to allow for temporary heating, ventilating and cooling.

G. Field Office, Telephone and Email:
   1. Provide and maintain a temporary field office at the project site during progress of the work. A designated area within the existing building will be available for use as a temporary field office. Verify area size and location with the Tenant.
   2. Maintain copies of permits, approved shop drawings, specifications, addenda and record documents at field office.
   3. Provide temporary telephone service and internet service with email and photo capabilities to field office throughout progress of the work.
   4. Provide weekly photographic documentation of project progression to Tenant.

H. Safety and Security
   1. Provide and maintain all necessary safety provisions for protection and safety of the project work, workers and general public.
   2. Provide and maintain operable fire extinguishing devices in well-marked, accessible locations throughout the project. Provide types, quantities and locations in compliance with governing codes and ordinances.
   3. Provide all necessary security barriers and enclosures to protect the work and Tenant's operations from unauthorized entry of persons, vandalism and theft. Provide doors, when required, with self-closing hardware and locks.

I. Cleaning
   1. During Construction: Provide an approved on-site container for the use of all Contractors and Subcontractors for the collection of waste materials, debris and rubbish. Execute periodic cleaning to keep the work, the site and adjacent properties free from accumulations of waste materials, rubbish and windblown debris, resulting from construction operations. Remove crates and cartons in which materials, equipment, or fixtures are received to on-site containers daily.
      a. Maintain the property in a clean and orderly condition. Remove waste materials, debris and rubbish from the site on a daily basis and dispose of at legal disposal areas away from the site.
   2. Dust Control:
      a. Remove debris and rubbish from pipe chases, plenums and other similar closed or remote spaces prior to covering or enclosing the space.
      b. Sweep and vacuum clean interior surfaces before start of surface finishing and painting. Continue cleaning on an as-needed basis until finishing and painting is completed.
      c. Cleaning operations shall be acceptable to the Tenant's Construction Manager.

SECTION 01630 - SUBSTITUTIONS

1.1 General:

A. Products, including materials, equipment and systems described in the Contract Documents establish the standards of required function, dimension, appearance, quality and performance of the Work. Base all bids on the "Standards" indicated.

B. Requests by the Contractor for changes in products, manufacturers, fabricators, suppliers, installers, and methods of construction required by the Contract Documents are considered requests for "substitutions:" Substitutions will be considered only under the following conditions:
   1. The indicated "Standard" cannot be provided within the Contract Time
   2. The indicated "Standard" cannot receive necessary approval by the governing authority.
   3. A substantial advantage is offered the Owner, in terms of cost, time, energy conservation or other considerations of merit as determined by the Architect.

C. Submit each request for substitution to the Architect. Identify the product, manufacturer, fabricator, supplier, installer or the fabrication or installation method to be replaced in each request. Identify related Specification Section and Drawing numbers. Provide documentation as directed by the Architect.

D. Substitutions will not be considered when indicated on shop drawings or product data submittals without separate written request, when requested directly by subcontractor, manufacturer, fabricator, or supplier, or when acceptance will require substantial revision of the Contract Documents.

E. Substitute products, manufacturers, fabricators, suppliers, and installers shall not be used for the Project without Tenant and Architect's written acceptance.

SECTION 01700 - EXECUTION REQUIREMENTS

1.1 Preparation:

A. Protection of existing construction: Use all necessary care and appropriate means and methods to protect and prevent damage to existing construction and property not part of the Contract Work. Repair and refinish or replace construction an property damaged during construction work, at Contractor's expense.

1.2 Selective Demolition: Provide selective demolition as shown and specified.

A. Preparation:
   1. Coordinate work of this Section with work of various Contractors and Tenant's staff.
   2. Maintain protected access at all times.
   3. Erect and maintain weatherproof closures at exterior openings.
   4. Erect and maintain dust-proof interior partitions to prevent spread of dust or fumes.
   5. Erect and maintain barricades, enclosures, bracing, shoring, lights, warning signs and guards necessary for worker and public safety and protection of property.
   6. Disconnect, remove and cap designated utility services. Identify and mark locations of disconnected and capped utilities at the project site and on Project Record Documents.
   7. Notify and coordinate with the Tenant's Construction Manager and the building Owner for any demolition occurring outside the lease limit.
   8. Coordinate hours of operation and construction access with the Tenant's Construction Manager and the building Owner.

B. Selective Demolition
   1. Remove existing construction to accommodate new construction as indicated.
   2. Perform selective demolition in an orderly, systematic and careful manner with least possible disturbance to public and adjacent property. Use of explosives is prohibited.
   3. Immediately remove from the site and legally dispose of demolished materials, except as indicated otherwise. Do not burn or bury materials on the project site.

1.3 Cleaning

A. Final Cleaning: Perform final cleaning upon completion of project work.
   1. Remove waste and surplus materials, rubbish, tools, equipment and temporary construction facilities from the site.
   2. Clean exterior grounds; remove stains, spills and foreign materials from paved areas, power wash and sweep clean. Rake clean landscaped surfaces of the grounds.
   3. Remove temporary protection and labels not required to remain.
   4. Clean all finished surfaces. Remove grease, mastic, adhesives, dust, dirt, stains, fingerprints, labels and other foreign materials from exposed interior and exterior surfaces.
      a. Clean all plumbing, fire protection and electrical fixtures and equipment including ceiling area elevated ductwork and lighting fixtures.
      b. Clean permanent equipment filters and replace temporary disposable filters in mechanical units used during construction.
      c. Clean ducts, blowers and coils if mechanical units were operated without filters during construction.
   5. Clean interior and exterior glazing and mirrors, polish transparent and glossy surfaces and clean floors with appropriate materials and equipment.
   6. Remove waste, foreign material and debris from roofs, areaways and drainage systems.
   7. Before Tenant occupancy, conduct an inspection, with the Tenant, of exposed interior and exterior surfaces at all work areas, to verify that the entire work is clean.

1.4 Starting and Adjusting:

A. Prior to Substantial Completion, coordinate the start-up, test and balance, placement in operation and adjustment all systems, controls and equipment to verify proper operation. All systems shall be complete and operating prior to final inspection.

1.5 Contract Closeout:

A. Operation and Maintenance Data: Submit one operation and maintenance manual, bound in 8-1/2" x 11" text pages, three D side ring capacity expansion binders with durable plastic covers.
   1. Subdivide the binder contents internally with permanent dividers logically organized as described below. Provide tab titles clearly printed under reinforced laminated plastic tabs.
   2. Provide a table of contents with each product or system description identified.
   3. Provide a directory listing names, addresses, and telephone numbers of the project Architect/Engineer, Contractor, Subcontractors and major equipment suppliers.
   4. Prepare operations and maintenance instructions arranged by system and subdivided by specification section. Identify names, addresses, and telephone numbers of project Subcontractors and suppliers. For each category, identify the following:
      a. Significant design criteria.
      b. List of equipment.
      c. Parts list for each component.
      d. Operating instructions.
      e. Maintenance instructions for each equipment item and systems.
      f. Maintenance instructions for special finishes, including recommended cleaning methods and materials and special precautions for identifying detrimental agents.
   5. Submit operations and maintenance data to the Tenant with final application for payment in accordance with Exhibit C of the Construction Contract.

B. Record/As Built Documents:
   1. Prepare and maintain on site one set of the following record/as built documents:
      a. Contract Documents.
      b. Construction Documents.
      c. Change orders and other modifications to the Contract.
      d. Shop drawings, product data, and samples.
      e. Construction schedule.
   2. Store record/as built documents separate from documents used for construction.
   3. Record actual revisions to the Work, concurrently with construction progress.
   4. Legibly mark and record a description of actual products installed at each specification section, including the following:
      a. Manufacturer's name and product model and number.
      b. Approved product substitutions or alternates utilized.
      c. Changes made by addenda, change orders, and other modifications.
   5. Legibly mark each item to record actual construction, including the following:
      a. Measured depths of foundations in relation to finish first main floor datum.
      b. Measured horizontal and vertical locations of underground utilities and appurtenances, referenced to permanent surface improvements.
      c. Measured locations of internal utilities and appurtenances concealed in construction, referenced to visible and accessible features of the work.
      d. Field changes of dimension and detail.
      e. Details not on original Contract Document drawings.
   6. Submit record/as built documents to the Tenant with final application for payment in accordance with Exhibit C of the Construction Contract.

C. Warranties and Bonds:
   1. Compile warranties and bonds required by the Contract Documents.
   2. Submit duplicate copies of warranties and bonds to the Tenant with final application for payment in accordance with Exhibit C of the Construction Contract.

D. Maintenance Materials and Spare Parts:
   1. Provide extra maintenance materials and spare parts in quantities indicated in the specification sections.
   2. Place in location as directed by the Tenant's Construction Manager.

DIVISION 2 - SITE CONSTRUCTION

1.1 General: Provide site construction work, including services, utilities, earthwork, paving and landscaping in accordance with the site construction work drawings and details.

2.1 Materials:

A. Stencils for pavement markings: Pavement Stencil Comapny, P: (800) 250-5547, stencils@pavementstencil.com

DIVISION 3 - CONCRETE

SECTION 03300 - CAST-IN-PLACE CONCRETE

1.1 General: Provide cast-in-place concrete work in accordance with the General Structural Notes, structural drawing and details. Follow shell building documents for specifications, joints and geotech.

A. Standards: Materials and construction shall conform to the following:
   1. ACI 117 "Standard Tolerances for Concrete Construction and Materials."
   2. ACI 301 "Structural Concrete for Buildings."
   3. ACI 305R "Recommended Practice for Hot Weather Concreting."
   4. ACI 306R "Recommended Practice for Cold Weather Concreting."
   5. ACI 315 "Details and Detailing of Concrete Reinforcement."
   6. ACI 318 "Building Code Requirements for Reinforced Concrete."

2.1 Materials:

A. Under Slab Vapor Retarder: Stego Industries LLC, 877-464-7834, internet www.stegoindustries.com high density polyethylene Stego Wrap (10 mil) Vapor Barrier meeting or exceeding ASTM E1745 performance criteria for Class C vapor retarders.
   1. Seam Tape: High density polyethylene tape with pressure sensitive adhesive.
   2. Pipe boots: Shop or site fabricated from vapor retarder material and seam tape.

B. Concrete:
   1. Portland Cement: ASTM C150, Type I
   2. Aggregate: ASTM C33.
   3. Water: Clean and potable.
   4. Reinforcement: When required, comply with drawings reinforcement requirements.
   5. Compressive Strength: Minimum 3000 psi at 28 days.
   6. Admixtures: All admixtures shall be approved by the Tenant's Construction Manager prior to placement in the concrete mix.

C. Topping Concrete: When required to suit installation conditions, Ardex Diama-Top of Ardex Engineered Cements (888) 512-7339, internet www.ardex.com
   1. ULTRAFLOR ARDEX DIAMA-TOP, self-leveling concrete repair material.
   2. Any pinholes that need to be filled shall be filled with ARDEX DIAMA-FILL filling compound for polished concrete, concrete terrazzo and other cementitious wear surfaces applied at the appropriate time during the polishing process.
   3. The primer for areas to receive ARDEX DIAMA-TOP will be ARDEX EP 2000 Substrate Preparation Epoxy.
   4. Installation shall be performed by factory-trained professional applicators in strict accordance with manufacturer's installation instructions.

3.1 Installation

A. Vapor Retarder: Place, protect and repair vapor retarder sheets in accordance with ASTM E1643 and manufacturer's installation instructions.
   1. Provide a single layer of vapor retarder material over level compacted slab base.
   2. Lap joints and seams 6 inches and seal with seam tape.
   3. Seal all penetrations and repair damaged areas before concrete placement.

B. Reinforcement Place and inspect all reinforcing steel before concrete is placed.

C. Concrete Placement:
   1. Place cast-in-place concrete in accordance with ACI 301 and ACI 305R and 306R recommended practices for hot weather and cold weather concreting. Do not place concrete when temperature is below 40 degrees F.
   2. Wet cure concrete in accordance with ACI 301, using moist curing or moisture-retaining covers

D. Finish: Except where additional floor finish is scheduled, provide a smooth steel trowel finish.
   1. Exposed concrete used as a finish floor surface shall have a smooth finished surface, uniform in texture and appearance and free of trowel marks and other defects affecting ease of maintenance.
   2. Grind smooth surface defects as directed by the Tenant's Construction Manager.

E. Testing: When required, comply with drawings and specification sections testing requirements.

F. Topping Concrete: Prepare concrete floor slab substrate surfaces, prime substrate surfaces, mix, install and finish topping concrete in accordance with manufacturer's application instructions.

SECTION 033600 - RESINOUS FLOORING

1.1 General: Section includes: Decorative resinous flooring systems.

1.2 System Description:

A. Performance Requirements: Provide resinous flooring that has been manufactured and installed to maintain performance criteria stated by manufacturer without defects, damage or failure.
B. Alternate Flooring Options as approved by CMG DM: AlFlooring TerraQuartz (color: salt & pepper) -or- AlFlooring TerraSeal (color: medium grey)

1.3 Quality Assurance:

A. Qualifications:
   1. Installer Qualifications: Installer experienced in performing work of this section who has specialized in installation of work similar to that required for this project.
      a. Installer shall be an established company with at least 3 years experience in the installation of polymer floors.
      b. Contractor shall demonstrate the ability to undertake and complete the required work and furnish documentation regarding the successful completion of projects of similar size and complexity.
   2. Manufacturer Qualifications: Manufacturer shall be capable of providing technical support, qualified applicators, and approval of application methods.

B. Pre-installation Meetings: Conduct a pre-installation meeting to verify flooring system specifications (color, texture, etc.), substrate analysis, and manufacturer's installation instructions.

C. Pre-installation Testing: Conduct pre-installation testing as follows:
   1. Water Vapor Transmission: Calcium Chloride tests should be conducted to determine the amount of water vapor coming through the slab. The results should be compared to limitations set forth by the manufacturer.
   2. Core Sample Testing: (optional) Core samples should be taken and analyzed if the installer believes there to be a problem with the integrity of the substrate that may affect flooring system performance.

1.4 Delivery, Storage & Handling:

A. Ordering: Comply with manufacturer's ordering procedures and allow for enough lead-time for custom blends so as not to interfere with construction schedules.

B. Delivery: Deliver materials in manufacturer's original, unopened, undamaged containers with identification labels intact.

C. Storage and Protection: Store materials where they are protected from direct sunlight and harmful weather conditions. Meet manufacturer's condition for temperature, humidity, etc.

1.5 Project Conditions:

A. Environmental Requirements/Conditions: Substrate and ambient air temperatures shall be in accordance with manufacturer's requirements.

B. Temperature Requirements: Maintain air temperature in spaces where products will be installed for time period before, during and after installation as recommended by manufacturer.

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:

ARCHITECTURAL SPECIFICATIONS

G010

2.1 Materials:

A. Resinous Flooring: Manufacturer: aiflooring
   1. Contact: 1218 West 41st Street, Suite B, Tulsa, Oklahoma 74107. Phone: 918-445-0627

2.1 Flooring System:

A. System Description: Clear, thin film system 18-22 mils thick with texture agent added for slip resistance.
   1. TerraPrime: A 2 component, 100% solids clear polyamide-cured epoxy coating.
   2. TerraThane Satin: A 2 component, 90% solids polyurea clear finish coat.
   3. TerraGrip: A graded, plastic aggregate added to finish coat for slip resistance.

2.3 Product Substitutions:

A. Substitutions: No substitutions permitted.

2.4 Source Quality:

A. Source Quality: Obtain resinous materials, including patching and leveling materials from a single manufacturer.

3.1 Manufacturer's Instructions:

A. Compliance: Comply with manufacturer's product data, including product technical data sheets and application instructions.

3.2 Examination:

A. Site Verifications of Conditions: Verify substrate conditions, which have been previously installed under other sections, are acceptable for product installation in accordance with manufacturer's instructions.
   1. Before applying materials, inspect surfaces to receive new materials and report any unsatisfactory conditions. Absence of any such report shall constitute installer's acceptance of surfaces as satisfactory for installing materials.

3.3. Preparation:

A. Adjacent Surfaces Protection: Protect adjacent work areas and finish surfaces from damage during product installation.

B. Surface Preparation:
   1. Mechanical Cleaning: Concrete floor surfaces receiving polymer flooring systems shall be thoroughly cleaned and prepared by shotblasting and/or diamond grinding.
   2. Patching Damaged Substrate: Holes, voids, static cracks, and other substrate surface defects should be patched and repaired according to manufacturer's recommendations.
   3. Prepare and clean control joints well and fill with an appropriate elastomeric.

3.4 Installation:

A. Resinous Flooring Installation: The following are abbreviated guidelines that should provide for basic application steps for the installation of the systems. Detailed instructions should be obtained from the manufacturer.
   1. Patching: After substrate preparation, surface defects shall be patched according to manufacturer's recommendations.
   2. Priming: Apply aiflooring TerraPrime, 100% solids epoxy primer, at a rate of 125-150 square feet per gallon. Allow 6-12 hours (depending on temperatures) of cure before applying finish coat. Finish coat must be applied within 24 hours of TerraPrime application.
   3. Finish Coat: Apply aiflooring TerraThane Satin, 90% solids polyurea topcoat, at a rate of 200 square feet per gallon. TerraGrip should be added to the TerraThane mix at a rate of 1 pint per 3 gallon kit for slip resistance. Note that TerraThane Satin must be metered out by notched squeegee prior to rolling.

B. Cleaning: Remove temporary coverings and protection of adjacent work areas. Repair or replace damaged installed products. Clean installed products in accordance with manufacturer's instructions prior to Owner's acceptance. Remove construction debris from project site and legally dispose of debris.

3.5 Protection:

A. Protection: Protect installed product and finish surfaces from damage during construction.

SECTION 03395 - CONCRETE SEALING AND POLISHING

1.1 General: Provide a sealed and polished concrete floor finish as shown and specified.

A. Standards
   1. American Society for Testing and Materials:
      a. ASTM-C779, Standard Test Method for Abrasion Resistance of Horizontal Concrete Surfaces.
      b. ASTM G23-81, Ultraviolet Light & Water Spray
      c. ASTMC805, Impact Strength
   2. American Concrete Institute
      a. ACI 302. 1R-89, Guide for Concrete Floor and Slab Construction

B. Submittals: Provide the following:
   1. Manufacturer's product data, specifications and installation instructions. Include Material Safety Data Sheets (MSDS) and identify application requirements, curing time and safety requirements.
   2. Certified test reports, prepared by an independent testing laboratory, confirming compliance with performance criteria.
   3. Manufacturer's certification that installer is a certified applicator of special concrete floor finishes, and familiar with manufacturer's installation procedures and requirements for the specified sealed and polished concrete floor finish.
   4. Manufacturer's and installer's written acceptance of substrate surface and installation conditions.

C. Quality Assurance:
   1. Installer Qualifications:
      a. Use a certified installer and adequate number of skilled workmen who are thoroughly trained and experienced in the necessary craft.
      b. The special concrete finish manufacturer shall certify the applicator.
      c. Applicator shall be familiar with the specified requirements and the methods needed for proper performance of work of this section. Applicator shall have not less than three years successful experience installing sealed and polished floor finishes similar to those required for this project.
      d. Provide a letter of certification from special concrete finish manufacturer stating that installer is a certified applicator and is familiar with proper procedures and installation requirements required by the manufacturer.
   2. Protection: Contractor shall provide all necessary materials, means, methods and procedures acceptable to the floor finish manufacturer and required to protect the concrete floor surface and provide a suitable substrate for the installation of the specified sealed and polished concrete floor finish.

D. Project Conditions:
   1. Comply with the floor finish manufacturer's environmental limitations for substrate temperature and moisture content, ambient temperature, and humidity, ventilation and other conditions affecting the special floor finish performance.
      a. Concrete must have an average Floor Flatness rating of at least 40.
      b. Concrete must have an average Floor Levelness rating of at least 40.
      c. Concrete must be cured a minimum of 28 days or as directed by the manufacturer before application of RetroPlate can begin. Wet cure of the concrete is preferred. No concrete sealer is necessary.
      d. Application of RetroPlate shall take place prior to installation of equipment, thus providing a complete, uninhibited concrete slab for application.
   2. Before general sealer/hardener application, prepare and coat a jobsite test area of size acceptable to the Architect, to verify and approve proper surface preparation, application techniques and coverage rate.
   3. Close finished floor areas to traffic during floor finish application and after application for time period directed by the floor finish manufacturer.
   4. The completed RetroPlated slab will be covered to prevent damage by the other trades during store completion.

2.1 Materials

A. Hardening/ Sealing Agent
   1. RetroPlate 99 manufactured by Advanced Floor Products Inc. (801) 812-3420 www.retroplatesystem.com
   2. RetroGuard Stain Inhibitor
   3. Joint Filler: CreteFill Pro 75. Two component 100% solids non-staining Polyurea Elastomer.
   4. Spall Repair: Multiple minor surface defects and irregularities: Crete Fill Spall Repair: High Strength hybrid urethane, two part 100% solids.
   5. Coefficient of friction for Retroguard finish shall not be lower than .40.
   6. Manufacturer's Representative: Contact Scott Maxfield at RetroPlate for a list of Certified Applicators (888)942-3144 scott.maxfield@retroplatesystem.com

3.1 Installation

A. Surface Conditions
   1. Examine substrate, with installer present, for conditions affecting performance of finish. Correct conditions detrimental to timely and proper work. Do not proceed until unsatisfactory conditions are corrected.
   2. Verify that base slab meets finish and surface profile requirements in Division 3 Section "Cast-In-Place Concrete," and Project Conditions above.
   3. Prior to application, verify that floor surfaces are free of construction latents.

B. Application
The following RetroPlate process will be followed as listed below:
A concrete grinding machine must be used. Please proceed accordingly. The process is as follows:
   1. Floors should be started using 50, 80 or 100 grit diamond pucks depending on the condition of the slab.
   2. Clean the floor using automatic scrubber or comparable.
   3. Grind floor using 200 grit resin diamonds.
   4. Clean the floor using automatic scrubber or comparable.
   5. Apply RetroPlate 99 to floor at 200 sq. ft. per gallon, scrubbing product into the floor and allowing product to soak until turning slick. If it becomes sticky, apply water to the surface as necessary, leaving the product on the floor for at least 60 minutes.
   6. Grind floor using 400 grit resin diamonds.
   7. Clean the floor using automatic scrubber or comparable.
   8. Clean and remove any excess RetroPlate. Let the floor dry overnight.
   9. Continue the polishing process using 800 grit resin diamonds.
   10. Clean the floor using automatic scrubber or comparable.
   11. Alternately, depending on slab condition, grind floor using 1200-1500 grit resin diamonds.
   12. Clean the floor using automatic scrubber or comparable.
   13. The same process will be used for new floors as well as rehab floors. Floor prep for the rehab floors will be separate.
   14. Apply an even coat of RetroGuard Sealer with a brush, roller, or low-pressure sprayer, and when surface is dry, burnish the floor with a black burnishing pad. Apply a second coat of RetroGuard one hour after the initial application, and again burnish the floor with a black burnishing pad.
   15. Do not walk on surface for 12 hours, and do not introduce any water or moisture for at least 48 hours, allowing for proper drying and setting of RetroPlate and RetroGuard. Water will minimize the sealing properties of RetroPlate and RetroGuard.

C. Start any of the floor finish applications in presence of manufacturer's technical representative.

D. Sealing, Hardening and Polishing of Concrete Surface
   1. Concrete must be in place a minimum of 28 days or as directed by the manufacturer before application can begin.
   2. Application is to take place at least 10 days to the prior to racking and other in-store accessory installation, thus providing a complete, uninhibited concrete slab for application.
   3. Only a certified applicator shall apply RetroPlate 99. Procedures must be followed as recommended by the product manufacturer and as required to match approved test sample.
   4. Achieve waterproofing, hardening, dust-proofing, and abrasion resistance of the surface without changing the natural appearance of the concrete, except for the sheen.
   5. Polish to a level 2 shine.

E. Workmanship and Cleaning
   1. The premises shall be kept clean and free of debris at all times.
   2. Remove spatter from adjoining surfaces, as necessary.
   3. Repair damages to surface caused by cleaning operations.
   4. Remove debris from jobsite
      a. Dispose of materials in separate, closed containers in accordance with local regulations.

DIVISION 4 - MASONRY

SECTION 04810 - UNIT MASONRY ASSEMBLIES

1.1 General: Provide unit masonry assemblies as shown and specified.

A. Standards: Materials and construction shall conform to the following:
   1. ACI 530.1-02/ASCE 6-02/TMS 602-02 "Specifications for Masonry Structures."
   2. NCMA "TEK Bulletins."
   3. BIA "Technical Notes on Brick Construction."

2.1 Materials:

A. Concrete Masonry Units (CMU): Size and thickness as shown on drawings.
   1. ASTM C 90, load-bearing, normal weight, natural color CMU, properly cured at time of delivery, linear shrinkage not to exceed 0.065%.
   2. Provide special shapes where required.
   3. Provide exterior wall CMU containing an integral polymeric water-repellent admixture.
      a. Manufacturer: W. R. Grace "Dry-Block® System Block Admix ".

B. Face Brick:
   1. Manufacturer:
      a. Endicott, (402) 729-3315, www.endicott.com (Iron Spot Brick), or as approved by architect
      b. Belden Brick Company, (330) 451-2031, www.beldenbrick.com (White Brick), or as approved by architect
   2. Type: "Face Brick C216" complying with ASTM C216, Grade SW, Type FBS. No efflorescence when tested in accordance with ASTM C67.
   3. Size: Modular size, laying three courses to 8" vertically.
   4. Color: "Alaska White Velour" or "Manganese Ironspot, Velour" as noted on Exterior Elevations
   5. Provide special shapes where required.

C. Mortar Materials:
   1. Portland cement: ASTM C150, Type I or III, natural color.
   2. Masonry cement: ASTM C91, Type indicated, natural color.
   3. Aggregate: ASTM C144, clean masonry sand.
   4. Water: Clean, fresh and potable.
   5. Provide all exterior wall masonry mortar containing an integral polymeric water-repellent admixture.
      a. Manufacturer W. R. Grace, "Dry-Block® Brand Water-Repellent Mortar Admixture".

D. Unit Masonry Mortar Mixes: ASTM C270 proportion by volume.
   1. Face brick: Type N mortar.
   2. Dye:
      a. SGS #60A "White" by Solomon Grind Services (White)
      b. SM #750 "Silverstone" by Spec Mix (Iron Spot)

E. Reinforced Unit Masonry Grout Mixes
   1. Concrete fill: ASTM C94 3,000 psi concrete.

F. Joint Reinforcement, Wall Ties And Anchors: Finish, ASTM A-153 hot-dip galvanized
   1. Manufacturer: Hohman & Barnard, INC.
   2. Horizontal joint reinforcement: Welded ladder type with matching corners and Tee units.
      a. Single Wythe masonry: Standard single 9 gage side and cross rods. H&B - #220 Ladder-Mesh.
   3. Anchoring devices: Provide strap anchors, inserts, bolts and rods of type and size indicated.
      a. CMU to CMU: Strap anchors 1/4" x 1-1/4" x 24" steel with bent ends.
      b. CMU to structural steel: H&B - VBT - Vee Byne-Tie With Plain Steel (Tie) Used In Conjunction With H&B #359 Weld-on Ties (Anchor Rods).
   4. Masonry Veneer To Woof Framing: H&B - DW-10HS Veneer Anchor, With Adjustable 3/16" Cold-Drawn Steel Wire Tie Sections and 14 GA. Screw-On Attachment Plate.
      a. Fasteners: Self-Drilling, Self-Tapping Screws, 1-1/4" X #10, Corrosion-Resistant Coated. Provide Two (2) Screw Fasteners for each Attachment Plate.
   5. Seismic Masonry Veneer to Wood Framing: (When Required) H&B Seismic Plate Pintle HB-213S with HB-213 (T-Lok Tie)
      a. Fasteners: Seld-Drilling, Self-Tapping Screws, 1-1/4" X #10, Corrosion-Resistant Coated. Provide Two (2) Screw Fasteners For Each Attachment Plate.

G. Concealed Masonry Through-Wall Flashing: W. R. Grace "Perm-A-Barrier" self-adhering modified bituminous sheet, 40 mils thick.
   1. Termination Mastic: W.R. Grace "Bituthene Mastic."
   2. Primer: W.R. Grace "Bituthene P-300 Primer."
   3. Termination bars: Extruded aluminum or stainless steel, 1" wide and .098" thick pre-punched at 6" on center, secured with stainless steel drive pins.

H. Accessories
   1. Reinforcing bars: ASTM A615, Grade 60, deformed billet steel bars of sizes indicated.
   2. Wall weeps: Dur-O-Wal D/A 1006 "Cell Vent", clear flexible polypropylene co-polymer.
   3. Compressible joint material: Dur-O-Wal "Rapid Soft-Joint" D/A 2010.
   4. Bond breaker strips: ASTM D226 No. 15 asphalt saturated roofing felt.
   5. Cleaning agents:
      a. Face Brick and CMU: ProSoCo, Inc., "Sure Klean New Masonry Cleaners."
      b. ACMU: ProSoCo, Inc., "Sure Klean Burnished Custom Masonry Cleaner."
   6. Expansion/Control joint sealants: Polyurethane-based, elastomeric joint sealant complying with ASTM C920 and Section 07900 requirements. Color matched to adjacent surfaces.

3.1 Installation

A. Preparation
   1. Wet absorbent face brick masonry units requiring wetting, in accordance with BIA recommendations.
   2. Lay concrete masonry units dry.
   3. Establish, lines, levels and coursing. Ensure ties, anchors and flashing are correctly installed
   4. Mix mortar cementitious materials and aggregate in a mechanical mixer. Add water in amount to provide satisfactory workable consistency of mortar. Retemper mortar as required within two hours of mixing to replace water lost be evaporation. Discard mortar after two and one-half hours of initial mixing. Do not use mortar after it has started to set.

B. Installation - General:
   1. Build walls and other masonry construction to the full thickness shown. Build single wythe walls to the actual thickness of the masonry units, using units of nominal thickness shown.
   2. Cut masonry units using motor-driven masonry saws to provide clean, sharp edges. Cut units to fit adjoining work neatly. Provide 100% solid units where cores would be exposed.
   3. Cold weather construction, hot weather construction, and masonry corbeling tolerances: Comply with unit masonry standard ACI 530.1/ASCE 6/TMS 602 requirements.

C. Laying Masonry
   1. Layout walls in advance to ensure accurate spacing of surface bond patterns, with uniform joint widths, and to properly locate openings, movement type joints, returns and offsets. Do not use less than half-size units at corners, jambs and other locations.
   2. Lay up walls plumb and true to comply with ACI 530.1 tolerances. Provide square corners and angles, except as otherwise indicated, with courses level, accurately spaced and coordinated with other work.
   3. Pattern bond: Running bond. Do not use units with less than 4" of horizontal face dimensions at corners or jambs.
   4. Lay hollow CMU/ACMU with full mortar coverage on horizontal and vertical face shells. Bed CMU webs in mortar in starting courses. Maintain uniform 3/8" joint widths.
   5. Lay face brick and solid CMU/ACMU with completely filled bed and head joints. Do not slush head joints. Maintain uniform 3/8" joint widths.
   6. Compress and cut joints flush for masonry walls below grade or covered by other materials.
   7. Tool joints in all exposed masonry work to a concave joint.
   8. Provide interlocking masonry bond in each course at corners and intersecting walls.
   9. As the work progresses, build in masonry accessories and related items. Fill in solidly with masonry around built-in items.
      a. Bed hollow metal frame anchors in mortar and fill space between hollow metal frames and masonry solid with fine mortar grout.
      b. Provide solid masonry bearing for all lintels, beams, joists, plates and load-bearing members.
      c. Take particular care to embed all conduits and pipes within concrete masonry without fracturing exposed shells and to fit units around switch, receptacle and other boxes set in walls. Where electric conduit, outlets, switch boxes and similar items occur, grind and cut units before building in services.
      d. Install anchors, plates and related work built into masonry work.
      e. Install reinforcing steel and concrete fill where indicated. Comply with drawing details.
   10. Horizontal joint reinforcing: Provide continuous joint reinforcing at all concrete masonry walls as follows:
      a. In every second block course, 16" on center vertically, full height of wall and every block course where shown on the drawings.
      b. Lap reinforcement a full width at the corners and at intersections or use special fabricated sections.
      c. Fully embed side rods in mortar.
   11. Anchoring masonry work: Provide anchoring devices of the type indicated or required.
   12. Provide vertical expansion, control and isolation joints in masonry where indicated.
      a. When not indicated, at maximum 30'-0" on center.
      b. Locate control joints at points of natural weakness in masonry and acceptable to Architect.
      c. Joint sealant color shall match masonry materials sealed.
   13. Lintels: Install loose steel lintels furnished under structural steel work where shown. Set lintels in full bed of mortar.
   14. Flashing and weeps:
      a. Install concealed through wall masonry flashing at all wall sills, masonry openings in exterior walls with masonry above head, over all horizontal steel members built into masonry and elsewhere as indicated. Provide "drainage wall system" masonry construction.
      b. Provide end dams and positive slope to drain. Extend flashing vertically at least 8" and built into or anchor to back-up with a termination bar for a complete watertight installation.
      c. Flexible Membrane Flashing:
         1.) Install membrane flashing in accordance with manufacturer's installation instructions.
         2.) Fully adhere flashing to substrate.
         3.) Lap flashing joints a minimum of 6", seal and roll with a hand roller.
         4.) Trim bottom edge 1/4" back from exposed face of masonry.
         5.) Seal edges, seams, cuts and penetrations with manufacturer's recommended mastic.
   15. Install weeps in head joints of final course of exterior masonry wythe above flashing. Space weeps maximum of 24" on center horizontally and located to avoid door openings. Install weeps at head joints with outside face of weep material held 1/8" from the finish face of masonry unit.
   16. Install compressible joint material at lintels and horizontal steel members. Build in joint fillers and seal with elastomeric joint sealant.

D. Masonry Veneer Walls:
   1. Metal framed walls: Tie exterior masonry veneer wythe to back-up wall with individual metal ties screwed to metal stud framing.
   2. Space ties 16" on center vertically and horizontally.
   3. Maintain veneer wall cavity free of mortar droppings during masonry installation.

E. Parging:
   1. Dampen masonry walls prior to parging.
   2. Scarify each parging coat to ensure full bond to subsequent coat.
   3. Parge masonry walls in two uniform coats of mortar to a total thickness of 3/4 inch (19mm).
   4. Steel trowel surface smooth abs flat with a maximum surface variation of 1/8 inch per foot (1mm/meter).

F. Architectural Concrete Masonry Units: Install ACMU in accordance with the manufacturer's installation instructions and the following:
   1. Draw ACMU from more than one pallet at a time during installation.

G. Reinforced Concrete Masonry
   1. Reinforce and fill CMU/ACMU wall and column masonry where indicated. Fill all cores solid with concrete fill. Comply with NCMA TEK Bulletins 3-2, 3-3A and 14-2 recommendations.
      a. Comply with drawing details for reinforcing steel size and spacing.
   2. Install bond beams where indicated. Reinforce and fill bond beams with concrete fill. Comply with drawing details for reinforcing steel size and spacing.

H. Repair, Pointing and Cleaning
   1. In process cleaning: Wipe off excess mortar as the work progresses. Dry brush with bristle brushes exposed masonry at the end of each day's work. Remove mortar spatters and joint ridges.
   2. Clean all exposed masonry. Cleaning agents subject to Architect's approval. Before applying any cleaning agent to the entire wall, clean a sample wall area of approximately 20 square feet in a location acceptable to the Architect. Do not proceed with final cleaning until the sample area has been allowed to dry a minimum of 3 days and the test area cleaning approved. Protect all windows, doors, louvers, metal lintels and other corrodible parts. Damaged materials and work replaced at Contractor's expense.
   3. Dry clean exposed surfaces to remove large particles of mortar using hardwood wood paddles and scrapers. Metal tools not acceptable.
   4. Presoak exposed masonry surfaces by saturating with water and flush off loose mortar and dirt.
   5. Apply cleaning solutions and clean masonry in accordance with the cleaning material manufacturer's cleaning instructions.
   6. Muriatic acid cleaning of masonry not permitted.

I. Architectural Concrete Masonry:
   1. Keep ACMU walls clean during installation. Remove excess mortar on daily basis using brushes, rags or burlap squares.
   2. Clean completed walls with detergent masonry cleaner recommended by the ACMU manufacturer. Acid cleaning agents, abrasive cleaners, tools or powders and metal cleaning tools and brushes are not permitted.
   3. After final clean down and when walls are dry, apply ACMU acrylic finish coating in accordance with ACMU manufacturer's application instructions.

NOT USED

NOT USED

NOT USED

DIVISION 5 - METALS

SECTION 05120 - STRUCTURAL STEEL

1.1 General: Provide structural steel in accordance with the General Structural Notes and structural drawings and details.

A. Standards: Materials and construction shall conform to following:
   1. AISC "Specification for the Design, Fabrication, and Erection of Structural Steel for Buildings."
   2. AISC "Code of Standard Practice."
   3. AWS "Structural Welding Code, D1.1-Steel."

2.1 Materials:

A. Materials compliance: When requested, submit acceptable data documenting materials compliance for each type of material required.

B. Structural Shapes: ASTM A36/A36M, 36 ksi steel.

C. Tubular Steel: ASTM A500, 46 ksi yield strength steel, cold-formed welded and seamless.

D. Structural pipe: ASTM A53, type and grade selected by the fabricator as required for design loading, standard finish, standard weight (Schedule 40) except as otherwise indicated.

E. Grout: ASTM C1107, pre-mixed, shrinkage resistant, non-metallic, non-corrosive, non-staining grout.

F. Shop paint primer: Refer to Section 09900 - Paints and Coatings.

G. Fabrication: Fabricate structural steel in accordance with AISC "Specification - Structural Steel for Buildings" and "Code of Standard Practice." Provide welded or bolted connections in accordance with the Structural Drawings connection requirements.
   1. Welding: Conform to AWS welding standards. Provide only continuous welds, spot welding is not acceptable. Grind all exposed welds smooth.
   2. Splicing: Material, if spliced, shall have maximum one splice per structural member. Perform splicing by full penetration butt-welding using AWS qualified welders and welding methods.
   3. Shop painting: Shop paint structural metal members, except members or portions of members to be embedded in concrete or masonry, surfaces and edges to be field welded and galvanized surfaces. Refer to Section 09900 - Paints and Coatings.

3.1 Installation:

A. Erection: Erect structural steel in accordance with AISC "Specification - Structural Steel for Buildings" and "Code of Standard Practice".
   1. Plumb, level and align base plates for structural members with steel shims.
   2. Grout structural steel base plates solid that bear on concrete or masonry surfaces.

B. Testing: When required, comply with drawings testing requirements.

SECTION 05400 - COLD-FORMED METAL FRAMING

1.1 General: Provide cold-formed metal framing in accordance with the General Structural Notes and structural drawings and details.

A. Standards: Materials and construction shall conform to following:
   1. AISI SG02.2-01 "Design of Cold-Formed Steel Structural Members."
   2. AWS "Structural Welding Codes, D1.3-Sheet Steel."

2.1 Materials:

A. Materials compliance: When requested, submit acceptable data documenting materials compliance for each type of material required.

B. Load-Bearing Cold-Formed Metal Framing: ASTM A1003, Gage, Grade and Type indicated.
   1. Components: Provide sizes and shapes indicated.
   2. Finish: Galvanized complying with ASTM A653, minimum G60 coating.

C. Fabrication:
   1. Cold-formed metal framing may be prefabricated into panels before erection. Fabricate panels plumb, square, true to line and braced against racking with joints welded.
      a. Provide one-piece full-length cold-formed metal framing members. Splicing not permitted.
   2. Attach and join other components by welding or screw fasteners, as indicated. Wire tying of framing components is not permitted.
   3. Cut framing to fit squarely for attachment to perpendicular members or as required for angular fit against abutting members. Hold members securely in position until properly fastened.
   4. Saw cut field cut framing. Torch cutting not acceptable.

3.1. Installation:

A. Erection: Erect cold-formed metal framing members of gage and at spacing indicated on the Structural Drawings. Align and secure studs to top and bottom runner tracks by welding or screw fasteners at both inside and outside flanges.

B. Tolerance Acceptance: Install cold-formed metal framing member as indicated on the plans. Install to 1/16" tolerance.

SECTION 05500 - METAL FABRICATIONS

1.1 General: Provide metal fabrications as shown and specified.

A. Submit shop drawings for the following:
   1. Patio Rail systems.
      a. Show thickness, size, construction and manner of assembling various members, joint locations and railing layout.
      b. Show true profiles, connections and relationship to adjoining work and methods of anchoring.

2.1 Materials

A. Materials compliance: When requested, submit acceptable data documenting materials compliance.

B. Steel Shapes: ASTM A36/A36M, 36 ksi steel.

C. Stainless Steel:
   1. Wall: 18 gage, ASTM A167, AISI Type 304 stainless steel, No. 4 finish.

D. Diamond Plate: Nominal 1/8" thick ASTM B209, Alloy 6061-T6, Aluminum Diamond Tread Plate.
   1. Wall: Bright reflective finish.
   2. Floor: Mil finish.

E. Patio Railing System
   1. Submit shop drawings including the following:
      a. Show thickness, size, construction and method of assembly as well as assembly drawings.
      b. Show true profiles, connections of all railing configurations
      c. Show installation (fastening) and provisions for cut-out (non-gypsum base)
      d. Show gate detail and gate hardware manufacturer and model number
      e. Patio railing plan, with dimensions and panel assembly locations.
   2. Fabrication
      a. Patio rails and gate shall be fabricated from steel flat bar, 3/8" x 2 1/2", grade A36.
      b. Corner connector angles shall be 2 1/2" x 2 1/2" x 1/4" steel L angle.
      c. Gate hinges shall be a self-closing, adjustable tension type. Hinge installation shall be drilled and tapped. Permanently welded are unacceptable.
      d. Gate stop shall have a rubber cushion stop and be affixed to the active gate.
      e. All corners and joints shall be seal welded and outside joints ground smooth.
      f. All welding spatter shall be removed before sand blasting.
   3. Finish
      a. Patio railing shall be painted PPG Durethane, color 518-6 Knight's Armor. Refer to Section 09900 - Paints and Coatings for preparation.

F. Exposed Fasteners:
   1. Diamond Plate: #8 x 1" bevel headed stainless steel screw.
   2. Patio Railing:
      a. All fasteners shall be stainless steel.
      b. Spacer washers separating railing sections shall be 1 1/2" diameter and 1/2" thick they shall be one piece thick washers and not comprised of stacking washers
      c. Spacer washers shall be used on all straight sections and when railing panels join at 90 degree corner angles.

G. Shop paint primer: Refer to Section 09900 - Paints and Coatings

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ARCHITECTURAL SPECIFICATIONS

G011

3.1 Installation: Comply with the Architectural Drawing details and the following:

A. Exposed Fasteners:
1. Flat Metal Panels: Provide 18" vertical and horizontal pattern or spaced equally if 18" pattern does not finish evenly. Exposed fasteners shall remain unpainted in natural factory supplied finish.
2. Diamond Plate: Provide counter sunk fasteners at perimeter of panels at 2'-0" on center maximum as well as fully adhering to surface.

B. Stainless Steel:
1. Wall:
a. Clean stainless steel panel with mineral spirits.
b. Install stainless steel panels with Henry 117 adhesive applied to wall with 1/8" notch tooth trowel.
c. Trim seams as indicated on the Drawings. Use concealed fasteners.

C. Diamond Plate:
1. Wall: Mount over plywood substrate with exposed fasteners.
2. Floor: Provide continuous bead of silicone sealant to back side perimeter of plate prior to installation.
3. Mount with exposed fasteners. Provide continuous bead of silicone sealant to perimeter of plate after installation.

D. Patio Railing System:
1. Railing posts shall be set 6" deep into a core drilled hole, 4"-6" diameter
2. Railing posts shall be grouted in using non gypsum quick set grout.
3. Railing posts shall be set in grout plumb and level, with a tolerance of 1/8" in 4 feet.

E. Hand-inspect all joints and edges of installed metal materials. Unless otherwise indicated, fit exposed connections accurately together to form tight hairline joints. Grind and ease exposed joints, and edges smooth and free of burrs.

NOT USED

DIVISION 6 - WOOD AND PLASTICS

SECTION 06100 - ROUGH CARPENTRY

1.1 General: Provide rough carpentry work as shown and specified.

A. Standards: Materials and construction shall conform to following:
1. NIST PS-1-95 "Construction and Industrial Plywood."
2. NIST PS-2-95 "Performance Standards for Wood-Based Structural-Use Panels."
3. NIST PS-20-99 "American Softwood Lumber Standard."
4. NF&PA NDS-97 "Wood Construction and Supplement."
5. AWPA "Wood Treatment Standards."

2.1 Materials:

A. Lumber: Factory grade-marked, dressed, seasoned dimension lumber, S4S, air-dried, maximum 19% moisture content complying with PS-20, dimensions indicated.
1. Blocking, nailers and similar members: Standard Grade Western Dimension Lumber or Southern Pine species.
a. Provide preservative treated lumber, where indicated.

B. Plywood: Factory grade-marked, complying with PS-1, square edge, 5/8" thick.
1. APA-RATED SHEATHING EXP1.
a. Provide Exterior Grade (EXT) plywood, where indicated.
b. Provide fire-retardant treated plywood, where required by Building Code.

C. Oriented Strand Board (OSB): Factory grade-marked, complying with PS-2, square edge, 5/8" thick

2.2 Wood Treatment:

A. Preservative Treatment: Comply with applicable requirements of AWPA Standards C2 (Lumber).
1. Pressure preservative treat lumber with water-borne preservatives, acceptable to authorities having jurisdiction, to a minimum retention of 0.25 pcf.
2. Treat wood blocking, nailers and similar members in connection with roofing and flashing.
3. Treat wood plates, blocking, furring and similar concealed members in contact with masonry or concrete.

B. Fire-Retardant Treatment: Comply with applicable requirements of AWPA Standards C27 (Plywood). Identify "fire-retardant-treated plywood" with appropriate UL classification marking.
1. Treated materials shall meet "Interior Type A" FR-S ratings of not more than 25 for flame spread, smoke developed and fuel contributed when tested in accordance with UL 723 or ASTM E84, with no increase in flame spread and evidence of significant progressive combustion upon continuation of test for additional 30 minutes.

C. Kiln-dry all treated lumber and plywood materials after treatment to maximum 15% moisture content.

3.1 Installation:

A. Lumber: Provide wood blocking, nailers and similar members where shown and where required for attachment of other work and surface applied items. Attach to substrate as required to support applied loading.
1. Use only sound, seasoned materials of longest practical lengths and sizes to minimize joints.
2. Use materials free of warp. Make tight connections between members.

SECTION 06210 - FINISH CARPENTRY AND MILLWORK

1.1 General: Provide finish carpentry and millwork as shown and specified.

A. Standards: Materials and construction shall conform to the following:
1. AWI "Architectural Woodwork Quality Standards - 1999."

B. Doors and door hardware: Install all door hardware furnished under Division 8 specification Sections.

C. Submit shop drawings for designated millwork.
1. Include complete details, materials lists and drawings showing fabrication of typical units, unit assemblies, locations and installation details.
2. List proposed cabinet hardware to suit indicated unit use or function.
3. Identify materials required to complete work ready for installation.
4. Obtain shop drawing approval before starting fabrication.

2.1 Materials:

A. Plywood: AWI Section 200
1. Concealed use substrates: CDX, D-3 Paint Grade hardwood plywood, with aspen veneer core, 5/8" thick. (OSB is an alternative as allowed by Chipotle CM)
2. Exposed to view finishes:
Random plank matched or slip and swing matched spalted maple veneer on 3/4" baltic birch core, with mill option sound grade hardwood backer. Spalted maple grain to run horizontally .5 sheen matte clear waterborne finish. Panels to be provided at 47" height, with widths varying from 24" to 95".

B. Millwork: Materials and construction as detailed on the Drawings.

C. Fabrication:
1. Millwork design and fabrication details shown on the drawings indicate design intent. Unless otherwise indicated, provide manufacturer's standard fabrication methods. Indicate all proposed variations from the drawing design and fabrication details on shop drawings.
2. Fabricate millwork in accordance with AWI "Custom Grade" requirements. Where details are not shown, comply with applicable Quality Standards or with alternate details acceptable to Architect as fabricator's option.
3. Fabricate finished work properly framed, closely fit and accurately set to required lines and levels and rigidly secured in place.
4. Fabricate work straight, plumb, level and in true alignment; neatly and accurately fit, scribed and thoroughly secured. Plane and sand miters and other joints. Ease all square edges. Provide millwork clean and free from warp, twist, open joints and other defects.
5. Provide finished woodwork dressed and sanded free from machine and tool marks, abrasions, raised grain or other defects on surfaces exposed to view in finished work.

D. Finish:
Sayerlack Hydroplus Waterborne Clear, 5 sheen for spalted veneer

3.1 Installation

A. Install finish carpentry and millwork products plumb, level, true and straight with no distortion. Shim as required using concealed shims. Install to a tolerance of 1/8" in 8'-0" for plumb and level (including countertops) and with 1/16" maximum offset in flush adjoining surfaces, 1/8" maximum offsets in revealed adjoining surfaces.
1. Scribe and cut finish carpentry and millwork products to fit adjoining work.
2. Anchor finish carpentry and millwork items to built-in place blocking, furnished under Section 06100, or directly attach to substrate framing. Secure to grounds, blocking and nailers with countersunk, concealed fasteners and blind nailing as required for a complete installation.
3. For installation of prefinished millwork wall panels, use finish nails for exposed nailing, installed with pneumatic nailer as per the following guidelines:
a. Nailer to be set for countersunk head approximately 1/8" on the face.
b. Use 16 ga straight finish nails in 2" length
c. Provide "dab" of construction adhesive on backside of panels at regular intervals.
d. Random placement preferred, do NOT group nails together.
e. No nails closer than 2" from any edge.
f. All nails to be no greater than 16-18" apart in any direction.
4. Touch-up shop finished materials marred or damaged during delivery, storage and installation with custom blended polyurethane to equal Minwax "Wipe on Poly".

B. Install casework without distortion so that doors and drawers will fit openings properly and be accurately aligned. Adjust hardware to center doors and drawers in openings and to provide unencumbered operation.

C. Install plastic laminate countertops, shelving and trim. Provide work level, true to alignment, accurately fit to wall conditions and securely fastened to base units and other support systems as indicated.

SECTION 06605 - FIBERGLASS REINFORCED PLASTIC PANELS

1.1 General: Provide fiberglass reinforced plastic panels as shown and specified.

2.1 Materials:

A. Manufacturer: Marlite, (330) 343-6621, internet www.marlite.com, Email: info@marlite.com

B. Panel System: 'P6' Per Finish Schedule, Series: Standard FRP - "Marlite Class 1/A" Fiberglass Reinforced Polyester (FRP) Panels, 3/32" thick, 48" wide x full height required. Color: P100 White, Class A, pebbled matte surface texture. USDA approved for incidental food contact.
1. Panel trim: Extruded PVC, color matching panel color. Provide 1/2" x 1/2" inside corners, edge trim, and division moldings as required to complete the installation.
a. Inside Corner - M350
b. Outside Corner - M360
c. Division - M365
d. Edge - M370
2. Panel trim: Stainless Steel, color matching panel color. Provide 1-1/2" x 1-1/2" outside corners as required to complete the installation.
3. Sealant: Marlite "Silicone Sealant", white gunnable silicone sealant.
4. Panel adhesive: Marlite "C-551" water-based construction adhesive for panel application over porous surfaces.

C. Panel System: 'P2' Per Finish Schedule, Series: Standard FRP - "Marlite Class 1/A" Fiberglass Reinforced Polyester (FRP) Panels, 3/32" thick, 48" wide x full height required. Color: S100G White, smooth matte surface texture. USDA approved for incidental food contact.
1. Panel trim: Extruded PVC, color matching panel color. Provide division moldings as required to complete the installation.
a. Edge - M370
2. Sealant: Marlite "Silicone Sealant", white gunnable silicone sealant.
3. Panel adhesive: Marlite "C-551" water-based construction adhesive for panel application over porous surfaces.

D. Alternate panel spec: Color: S100 S/2/S White, smooth matte surface texture

3.1 Installation

A. Install the FRP system products using panel adhesive in accordance with the manufacturer's instructions and layout as shown in drawings.
1. Install panels plumb, level, true and straight with no distortion; providing a continuous bead of silicone sealant in each joint and trim groove and between trim and adjacent construction.
2. Provide corner trim, closure trim at intersections of dissimilar materials and moldings at abutting panels.

SECTION 07240 -EXTERIOR INSULATION AND FINISH SYSTEM (PB)

1.1 General: Provide the exterior insulation and finish system (EIFS) as shown and specified.

A. Standards: Materials and construction shall conform to the following:
1. EIMA (EIFS Industry Members Association) Standards and Publications.
a. 101.01, 101.02, 101.03, 101.86, 105.01, and 201.02.
b. EIMA "Guideline Specification for Exterior Expanded Polystyrene (EPS) Insulation board."
B. Quality Assurance:
1. System components:
a. Produced by a single manufacturer or by manufacturers approved by the EIFS system manufacturer.
b. Fire performance: Flame spread of 25 or less, smoke developed of 450 or less when tested in accordance with ASTM E84.

NOT USED

2. Installer Qualifications: Performed by the system manufacturer or an applicator trained and approved by the system manufacturer. During application, the work shall be inspected by system manufacturer's representative.

C. Environmental conditions: Comply with manufacturer's requirements. Do not install materials during wet or freezing weather.

2.1 Materials

A. Manufacturer: STO Corp., P: (800) 221-2397, internet www.stocorp.com
Strategic Accounts Manager: Ray Redmond, P: (616) 437-2230, rredmond@stocorp.com

B. Exterior insulation and finish system: Sto Class PB "StoTherm ci" EIFS.
1. Air/Moisture barrier: Sto Guard system.
a. Sto RapidGuard for rough opening protection, sheathing joints and inside and outside corners.
b. Sto Guard Mesh: Coated glass fiber fabric reinforcing mesh.
c. Sto Gold Coat: Waterproof Fluid Applied Air/Moisture Barrier
2. Primer/adhesive and base coat: Sto Primer/Adhesive-B, one-component, polymer modified, cement -based factory blended primer/adhesive used to attach insulation board to prepared sheathing substrates and as a base coat in Essence claddings.
3. Insulation board: ASTM C578 Type 1, nominal 1.0 lb/ft³ expanded polystyrene meeting EIMA Guideline specifications for EPS insulation board.
4. Finish coating: Sto Essence DPR, ready-mixed 100% acrylic-based, textured wall coating.
a. Medium/Fine Sand Finish.
b. Color as indicated on the Architectural drawings from manufacturer's full color range or match custom color.
5. System warranty: 10 year labor and material.

C. Portland cement: ASTM C150, Type I or II, white or gray in color.

D. Water: Clean, potable and free of foreign matter.

E. Reinforcing mesh: Sto open-weave glass fiber fabric with alkaline resistant coating.
1. Standard mesh: Sto Mesh, nominal 4.5 oz/yd² fabric.
2. Ultra-High impact mesh: Sto Armor Mat, nominal 15 oz/yd² ultra-high impact fabric.
3. Specialty mesh:
a. Sto Detail Mesh, nominal 4.2 oz/yd² flexible, symmetrically balanced glass fiber fabric.
b. Sto Corner Mat, nominal 7.8 oz/yd² pre-creased, heavy duty glass fiber fabric.

F. Joint sealants: StoSeal STPE Sealant complying with ASTM C920 and Section 07900 requirements.
1. Adhesion: Evaluated in accordance with ASTM C1394.
2. Color: Matching EIFS finish coating color, and visually acceptable to the Architect.

G. Accessories: Provide plastic stops and trim where indicated. Materials shall be compatible with EIFS materials and acceptable to EIFS manufacturer.
1. Starter Track: Rigid PVC plastic track with weepholes and drip edge.

NOT USED

3.1 Mixing

A. Mix materials in accordance with manufacturer's published instructions.
1. Mix with a clean, rust-free high speed mixer to a uniform consistency.
2. No rapid binder, anti-freeze or accelerator additives permitted.

4.1 Installation

A. Preparation:
1. Coordinate installation of roofing membrane, windows, doors and other wall penetrations to provide a continuous exterior wall air/moisture barrier.
2. Coordinate installation of windows, doors and window and door flashing to provide continuous exterior wall air/moisture barrier.
3. Install copings and joint sealants immediately after installation of the EIFS, when EIFS coatings are dry.

B. Installation: Install Sto Guard air/moisture barrier system and exterior insulation and finish system (EIFS) in strict accordance with manufacturer's installation instructions, complying with governing regulations and industry standards applicable to the work.
1. Back wrap exposed board edges with mesh.
2. Provide double wrap or corner mat reinforcing at all inside and outside corners.
3. Provide expansion joints in accordance with manufacturer's recommendations for type of substrates and systems required, and visually acceptable to the Architect.
4. Provide drainable starter track horizontal edge trim as base of wall, above windows and doors openings and beneath windows with concealed flashing.

C. Insulation and adhesive application:
1. Install insulation board with long edge horizontal using running bond pattern. Off set insulation joints with substrate joints. Stagger joints and interlock joints at corners.
2. Apply adhesive to insulation board with a stainless steel trowel notched trowel, providing vertical uniform ribbons of adhesive when board is installed. Mount insulation board on substrate. Level, align and tamp insulation in place. Provide uniform contact and bond with joints tightly butted. Rasp edges and high areas as required to produce a level, plane surface.

D. Base coat and reinforcing mesh application:
1. Apply detail mesh at corners of windows, doors, and at penetrations through the EIFS.
2. Standard mesh: Apply base coat over insulation board to a uniform 1/8 inch thickness, including high impact mesh where indicated. Embed standard reinforcing mesh into adhesive, lap edges at seams. Smooth surface until mesh is not visible. Allow to base coat to dry.
3. Ultra-High impact mesh: Apply base coat over insulation board to a uniform 1/8 inch thickness. Fully embed ultra-high impact reinforcing mesh into wet adhesive, lap edges at seams. Smooth surface until mesh is not visible. Allow to base coat to dry. Locate at 4'-0" wide perimeter at each rear service door to 6'-0" above grade and as indicated on Architectural drawings.

E. Apply finish coating continuously in one operation to the entire wall surface Provide a uniform finished appearance. Level and texture to the specified finish texture.

F. Install joint sealants at perimeter joints and joints within the system using elastomeric joint sealants, in accordance with drawing details and sealant manufacturer's recommendations.

SECTION 07250 - WEATHER BARRIERS

1.1 Section Includes

A. Weather barrier membrane
B. Seam Tape
C. Flashing
D. Fasteners

1.2 References

A. ASTM International
1. ASTM C920; Standard Specification for Elastomeric Joint Sealants
2. ASTM C1193; Standard Guide for Use of Joint Sealants
3. ASTM D882; Test Method for Tensile Properties of Thin Plastic Sheeting
4. ASTM D1117; Standard Guide for Evaluating Non-woven Fabrics
5. ASTM E84; Test Method for Surface Burning Characteristics of Building Materials
6. ASTM E96; Test Method for Water Vapor Transmission of Materials
7. ASTM E1677; Specification for Air Retarder Material or System for Framed Building Walls.
8. ASTM E2178; Test Method for Air Permeance of Building Materials

B. AATCC - American Association of Textile Chemists and Colorists
1. Test Method 127 Water Resistance: Hydrostatic Pressure Test

C. TAPPI
1. Test Method T-410; Grams or Paper and Paperboard (Weight per Unit Area)
2. Test Method T-460; Air Resistance (Gurley Hill Method)

1.3 Quality Assurance

A. Qualifications
1. Installer shall have experience with installation of commercial weather barrier assemblies under similar conditions.
2. Installation shall be in accordance with weather barrier manufacturer's installation guidelines and recommendations.
3. Source Limitations: Provide commercial weather barrier and accessory materials produced by single manufacturer.

1.4 Delivery, Storage and Handling

A. Refer to Section 01400 Quality Requirements.
B. Deliver weather barrier materials and components in manufacturer's original, unopened, undamaged containers with identification labels intact.

C. Store weather barrier materials as recommended by weather barrier manufacturer.

1.5 Scheduling

A. Review requirements for sequencing of installation of weather barrier assembly with installation of windows, doors, louvers and flashings to provide a weather-tight barrier assembly.
B. Schedule installation of weather barrier materials and exterior cladding within 9 months of weather barrier assembly installation.

2.1 Manufacturer

A. DuPont Building Innovations; 4417 Lancaster Pike, Chestnut Run Plaza 721, Wilmington, D19805;
1.800.44TYVEK (8-9835); http://constructiontyvek.com
Alternate: STO Corp., P: (800) 221-2397, internet www.stocorp.com

2.2 Materials

A. Basis of Design: Hi-performance, spunbonded polyolefin, non-woven, non perforated, weather barrier is based upon DuPont Tyvek CommercialWrap and related assembly components.
Alternate: StoGuard System, See Section 07240

B. Performance Characteristics:
1. Air Penetration: 0.001 CFM/feet squared at 75 Pa, when tested in accordance with ASTM E2178. Type I per ASTM E1677.
2. Water Vapor Transmission: 28 perms, when tested in accordance with ASTM E96 Method B.
3. Water Penetration Resistance: 280 cm when tested in accordance with AATCC Test Method 127.
4. Basis Weight: 2.7 oz/yard squared, when tested in accordance with TAPPI Test Method T-410.
5. Air Resistance: Air infiltration at >1500 seconds, when tested in accordance with TAPPI Test Method T-460.
6. Tensile Strength: 38/35 lbs/inch, when tested in accordance with ASTM D882, Method A.
7. Tear Resistance: 12/10 lbs., when tested in accordance with ASTM D1117.
8. Surface Burning Characteristics: Class A, when tested in accordance with ASTM E 84. Flame Spread: 10, Smoke Developed: 10.

2.3 Accessories

A. Seam Tape: 3 inch wide, DuPont Tyvek Tape for commercial applications.

B. Fasteners:
1. For steel frame construction - DuPont Tyvek Wrap Cap Screws, as manufactured by DuPont Building Innovations: 1-5/8" rust resistant screw with 2-inch diameter plastic cap or manufacturer approved 1-1/4" or 2" metal gasketed washer.
2. For wood frame construction - Tyvek Wrap Caps, as manufactured by DuPont Building Innovations: #4 nails with large 1-inch plastic cap fasteners.
3. For masonry construction - masonry tap-con fasteners with Tyvek Wrap Caps as manufactured by DuPont Building Innovations: 2 inch diameter plastic cap fasteners.

C. Adhesives:
1. Provide adhesive recommended by weather barrier manufacturer.
2. Products:
a. Liquid Nails LN-109
b. Polyglaze SM 5700
c. Denso Butyl Liquid
d. 3M High Strength 90
e. SIA 665
f. Adhesives recommended by the weather barrier manufacturer.

D. Primers:
1. Provide flashing manufacturer recommended primer to assist in adhesion between substrate and flashing.
2. Product:
a. 3M High Strength 90
b. Denso Butyl Spray
c. SIA 655
d. Permagrip 105
e. ITW TACC Sta' Put SPH
f. Primers recommended by the flashing manufacturer.

E. Flashing:
1. DuPont FlexWrap, as manufactured by DuPont Building Innovations: flexible membrane flashing materials for window openings and penetrations.
2. DuPont Straightflash, as manufactured by DuPont Building Innovations: straight flashing membrane materials for flashing windows and doors and sealing penetrations such as masonry ties, etc.
3. DuPont Straightflash VF, as manufactured by DuPont Building Innovations: dual-sided straight flashing membrane materials for brick mold and non-flanged windows and doors.

3.1 Examination
A. Verify substrate and surface conditions are in accordance with weather barrier manufacturer recommended tolerances prior to installation of weather barrier and accessories.

3.2 Installation - Weather Barrier
A. Install weather barrier per regional requirements in accordance with manufacturer recommendations.
B Install weather barrier prior to installation of windows and doors.
C. Start weather barrier installation at a building corner, leaving 6-12 inches of weather barrier extended beyond corner to overlap.
D. Install weather barrier in a horizontal manner starting at the lower portion of the wall surface with subsequent layers installed in a shingling manner to overlap lower layers. Maintain weather barrier plumb and level.
E. Sill Plate Interface: Extend lower edge of weather barrier over sill plate interface 3-6 inches. Secure to foundation with elastomeric sealant as recommended by weather barrier manufacturer.
F. Window and Door Openings: Extend weather barrier completely over openings.
G. Overlap weather barrier
1. Exterior corners: minimum 12 inches.
2. Seams: minimum 6 inches.
H. Weather barrier Attachment:
1. For steel or wood frame construction - Attach weather barrier to studs through exterior sheathing. Secure using weather barrier manufacturer recommended fasteners, space 12-18 inches vertically on center along stud line, and 24 inch on center, maximum horizontally.
2. For masonry construction - Attach weather barrier to masonry. Secure using weather barrier mfr recommended fasteners, spaced 12-18 inches vertically on center and 24 inches maximum horizontally. Weather barrier may be temporarily attached to masonry using recommended adhesive, placed in vertical strips spaced 24 inches o.c., when coordinated on the project site.
I. Apply 4 inch by 7 inch piece of DuPont StraightFlash to weather barrier membrane prior to the installation cladding anchors.

3.3 Seaming

A. Seal seams of weather barrier with seam tape at all vertical and horizontal overlapping seams.
B. Seal any tears or cuts as recommended by weather barrier manufacturer.

3.4 Opening Preparation (for use with non-flanged windows - all cladding types)

A. Flush cut weather barrier at edge of sheathing around full perimeter of opening.
B. Cut a head flap at 45-degree angle in the weather barrier at window head to expose 8 inches of sheathing. Temporarily secure weather barrier flap away from sheathing with tape.

3.5 Flashing (for use with non-flanged windows - all cladding types)

A. Cut 9-inch wide DuPont FlexWrap a min of 12 inches longer than width of sill rough opening. Apply primer as required by mfr.
B. Cover horizontal sill by aligning DuPont FlexWrap edge within side edge of sill. Adhere to rough opening across sill and up jambs a minimum of 6 inches. Secure flashing tightly into corners by working in along the sill before a adhering up the jambs.
C. Fan DuPont FlexWrap at bottom corners onto face of wall. Firmly press into place. Mechanically fasten fanned edges.
D. Apply 9-inch wide strips of DuPont StraightFlash at jambs. Align flashing with interior edge of jamb framing. Start DuPont StraightFlash at head of opening and lap sill flashing down to the sill. Spray-apply primer to top 6 inches of jambs and exposed sheathing.
E. Install DuPont FlexWrap at opening head using same installation procedures used at sill. Overlap jamb flashing min 2 inches.
F. Coordinate flashing with window installation.
G. On exterior, install backer-rod in joint between window frame and flashed rough framing. Apply sealant at jambs and head. leaving sill unsealed. Apply sealants in accordance with sealant manufacturer's instructions and ASTM C 1193.
H. Position weather barrier head flap across head flashing. Adhere using 4-inch wide DuPont StraightFlash over the 45-degree seams.
I. Tape top of window in accordance with manufacturer recommendations.
J. On interior, install backer rod in joint between frame of window and flashed rough framing. Apply sealant around entire window to create air seal. Apply sealant in accordance with sealant manufacturer's instructions and ASTM C 1193.

3.6 Protection
A. Protect installed weather barrier from damage.

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ARCHITECTURAL SPECIFICATIONS

G012

SECTION 07540 - THERMOPLASTIC MEMBRANE (PVC) ROOFING

1.1 General: Provide the thermoplastic membrane (PVC) roofing system as shown and specified.

A. Standards: Materials and construction shall conform to following:
1. ASTM D5036 "Application of Adhered Poly(Vinyl Chloride) Sheet Roofing."
2. FM 1-29 Loss Prevention Data Adhered or Mechanically Attached Single Ply Membrane Roof Systems."
3. NRCA "Single-Ply Roofing Membrane."
4. UL "790 - Tests for Fire Resistance of Roof Covering Materials."

B. Installer Qualifications: An experienced roofing installer approved by roofing system manufacturer and with not less than five years of successful experience installing membrane roofing systems similar to those required for this project.

C. Deliver, store and handle roof system materials in accordance with manufacturer's recommendations to avoid damage and deterioration.
1. Comply with manufacturer's recommendations for handling and protection during installation.

D. Install roofing work only when weather conditions are in compliance with manufacturer's specific environmental requirements and conditions will permit work to be performed in accordance with manufacturer's recommendations and warranty requirements.
1. Protect adjacent materials and surfaces from damage and soiling during roofing system installation.
2. Provide special protection on completed roofing work.
3. Protect paving and structure walls adjacent to hoists before starting work.
4. Do not overload the building structure with storage of materials or installation equipment on the substrate decking.

E. Warranty
1. Contractor and roof system installer shall jointly warrant roofing materials and installation for a period of two years from the date of Substantial Completion. Warranty shall include roofing membrane, flashing, roof insulation, roofing accessories and sheet metal work provided under Section 07600.
2. Manufacturer's warranty: Submit executed copy of roofing system manufacturer's 15 year total system warranty, including labor and materials for the entire roof system. Including perimeter edge metal, Section 07600 Flashing & Sheet Metal

2.1 Materials

A. Manufacturer: Duro-Last Roofing, Inc, (800)248-0280, Austin Russell, austin.russell@holcim.com, www.duro-last.com
1. Basis of Design Product Roofing System
   a. Thermoplastic single ply membrane roofing system: Polyvinyl Chloride membrane (PVC) fully adhered, smooth surface, UL Class A fire-rated single ply membrane roofing system.
   b. Thermoplastic fiber reinforced PVC membrane, not less than 40 mils (.040), complying with ASTM D4434 and membrane manufacturer's published physical properties.

B. Comparable Alternate Roof Manufacturers:
1. Versico Roofing Systems, (480) 528-6923, Jeff Kelly, jeff.kelly@versico.com
   a. VersiFlex PVC Adhered System
2. Other comparable alternates can be considered when approved by Arch PM and Chipotle DM/CM.

C. The roof covering design must resist a wind load of 100 mph, Exposure C and shall resist impact damage based on results of tests based on the results of tests conducted in accordance with ASTM D 3746, ASTM D 4272, CGSB 37-GP-52M or FM 4470
1. Insulation cover board: Georgia-Pacific Corp. (800) 284-5347, internet www.gp.com, "Dens-Deck" nonstructural fiberglass- faced, silicone-treated gypsum core panels, 1/2"" thickness.
2. Roof insulation: Rigid closed cell polyisocyanurate boards approved by the membrane manufacturer; complying with ASTM C1289, Type II, minimum 20 psi compressive strength, aged R-value equal 5.6 per inch of thickness.
   a. Provide a double layer installation. Minimum total R-value as indicated on plans.
   b. Specified perimeter edge metal shall be compliant with International Building Code ANSI / SPRI ES-1, ER2 testing requirements.
3. Flashing: Roof system manufacturer's standard sheet flashing of same material, type, and color as sheet membrane. Specified perimeter edge metal will be compliant with International Building Code ANSI / SPRI ES-1, RE2 testing requirements.
4. Membrane Bonding Adhesive: Roof system manufacturer's standard membrane bonding adhesive.
5. Insulation and Cover Board Adhesive: Dow Chemical Company, (888) 868-1183, internet www.flexibeproducts.com, "INSTA-STIK Professional Roof Insulation Adhesive", a single component, moisture cured polyurethane adhesive.
6. Fasteners: Roof system manufacturer's standard fasteners for project conditions indicated.
7. Accessories: Roof system manufacturer's recommended pourable sealers, preformed penetration flashing, preformed corner flashing, seam caulk, termination bars and other accessories required for substrate surfaces and installation conditions indicated.
8. Traffic walkways: Duro-Last Roof Track II walkway pads.3.1 Installation

3.1 Installation

A. Preparation:
1. Clean substrate surfaces of debris and other substances detrimental to roofing installation.
2. Correct unsatisfactory conditions before starting roofing. Roof deck surface conditions shall comply with manufacturer's requirements and be acceptable to the roofing system installer.

B. Installation:
1. General: Provide roofing system materials and installation complying with roofing system manufacturer's instructions and governing codes and regulations.
   a. Mix and apply roof insulation and cover board adhesive in strict accordance with the adhesive manufacturer's installation instructions. Dispense adhesive at manufacturer's recommended application rate using approved dispensing equipment.
2. Roof insulation.
   a. Extend insulation full thickness over entire surface to be insulated. Cut and fit around obstructions; fill all voids with insulation. Provide saddles and tapered edges as required to provide positive proper drainage.
   b. Install and secure in place with insulation adhesive, a double layer of insulation units of the required thickness. Run long joints of insulation in continuous straight lines, perpendicular to roof slope, with end joints staggered between rows. Stagger joints of each layer of insulation. Butt edges to moderate contact. Limit joints between adjacent units to maximum 1/4".
3. Insulation cover board: Install and secure in place with insulation adhesive a single layer of insulation cover board on installed roof insulation. Secure cover board in accordance with membrane manufacturer's recommendations. Stagger joints with joints of roof insulation.
4. Thermoplastic membrane: Comply with membrane manufacturer's instructions and recommendations for handling and installing single ply membrane roofing.
   a. Unroll and position roofing sheet membrane without stretching. Align top sheet with pr-marked lines on bottom sheet. Allow membrane to "relax" for at least 30 minutes before adhering, splicing and flashing.
   b. Adhere membrane to insulation cover board with bonding adhesive. Broom bonded membrane to achieve maximum contact.
   c. Join membrane seams using approved heat welding equipment. Check all splices for voids and repair voids with heat gun and roller.
   d. When required, mechanically fasten membrane at roof perimeter, curb flashing and similar penetrations in accordance with manufacturer's installation instructions.
   e. Flash and make weathertight all equipment curbs, pipes, conduits, drains and other penetrations or projections through sheet roofing using roofing system manufacturer's recommended flashing materials, accessories and procedures.
5. Install roof accessories and traffic walkways in accordance with manufacturer's instructions.
6. Install sheet metal work furnished under section 07600.

NOT USED

SECTION 07600 - FLASHING AND SHEET METAL

General:

A. Standards: Materials and construction shall conform to following:
1. SMACNA "Architectural sheet Metal Manual- 1993."
B. Installation: Performed under Section 07540 work.

1.1 Pre-manufactured perimeter edge metal and accessories

Manufacturer: Duro-Last Roofing / Exceptional Metals, Inc, (800) 248-0280, Jason Dark, www.Duro-Last.com

A. Duro-Last / Exceptional Metals Snap Coping made of 24-gauge galvalume, cover provided with Kynar architectural finish providing a 35 year finish warranty. Meets ANSI/SPRI ES-1 2003 method RE-2 testing requirements. (Color - Refer to Exterior Elevations)
B. Duro-Last / Exceptional Metals Vinyl backed scupper. Scupper profile & size indicated Fig 1-20.

1.2 General: Miscellaneous sheet metal

A. Standards: Materials and construction shall conform to following:
1. SMACNA "Architectural sheet Metal Manual- 1993."
B. Installation: Performed under Section 07540 work.

2.1 Materials:

A. Galvanized steel: ASTM A653 commercial quality sheet steel with 0.2% copper, G90 hot-dip galvanized. Gage indicated.
1. Scuppers: Minimum 16 gage.
2. Coping/Wall caps: Minimum 18 gage.
B. Aluminum sheet: ASTM B209 alloy 3003, temper as required for forming and performance. Thickness indicated.
1. Conductor Boxes: Minimum 0.040"thickness.
2. Downspouts: Minimum 0.025"thickness.
C. Joint sealers: One-component silicone elastomeric joint sealant complying with ASTM C920. Color matched to sheet metal finish.
D. Metal accessories: Provide sheet metal fasteners, clips, straps, anchoring devices and similar accessory units as required for installation of work, matching or compatible with material installed, non-corrosive, size and gage as required for performance and acceptable to the Architect.
E. Fabrication: Shop fabricate sheet metal work to comply with profiles and sizes indicated and to comply with standard industry standards as shown by SMACNA in the "Architectural Sheet Metal Manual."
1. Conductor boxes: SMACNA Chapter 1 - Roof Drainage Systems. Profile and size indicated Fig 1-25.
2. Scuppers: SMACNA Chapter 1 - Roof Drainage Systems. Profile and size indicated Fig 1-20.
3. Downspouts: SMACNA Chapter 1 - Roof Drainage Systems. Profile and size indicated. Installation Fig. 1-31 with strap hanger Fig. 1-35.
4. Formed coping/wall caps: SMACNA Chapter 3 - Copings. Design Fig 3-1. Profile and size indicated with Fig. 3-3 butt joints and concealed back-up plates. Install formed copings with continuous cleat fasteners similar to Fig 3-1 at exposed face and screw fasteners with washers space maximum 24" on center at roof side.

3.1 Installation:

A. Preparation: Coordinate sheet metal work with other work for the correct sequencing of items which make up the entire roof system of weatherproofing and rain drainage:
B. Installation: Comply with SMACNA "Architectural Sheet Metal Manual" recommendations, drawing details and approved shop drawings for installation of the work.
1. Anchor sheet metal items securely in place by methods indicated, providing for thermal expansion. Conceal fasteners and expansion provisions whenever possible. Install joint sealants where required.
2. Set units true to lines and levels indicated. Install work with sealed laps, joints and seams that will be permanently watertight and weatherproof. Bed flanges of sheet metal work in thick coat of roofing cement or sealant compatible with roofing membrane.
3. Separate sheet metal work from dissimilar metals and treated wood materials. Provide rosin-sized paper slipsheet over treated wood.
4. Fabricate, support and anchor conductor boxes and downspouts to withstand thermal expansion, stresses and full loading by ice or water without damage, deterioration or leakage.

SECTION 076113 - SHEET METAL WALL PANELS

1.1 General:

A. Standards:
1. Furnish all labor, material, tools, equipment and services for all preformed fascia and wall panels as indicated, in accord with provisions of Contract Documents.
2. Completely coordinate with work of all other trades.
3. Although such work is not specifically indicated, furnish and install all supplementary or miscellaneous items, appurtenances and devices incidental to or necessary for a sound, secure and complete installation.

B. Related work specified elsewhere:

1. Structural steel: Section 05100
2. Steel joists: Section 05200 or 05400
3. Flashing and sheet metal: Section 07600

1.2 Quality Assurance:

A. Applicable standards:
1. SMACNA: "Architectural Sheet Metal Manual" Sheet Metal and Air Conditioning Contractors National Association, Inc.
2. AISC:"Steel Construction Manual" American Institute of Steel Construction.
3. AISI: "Cold Form Steel Design Manual: American Iron and Steel Institute.
4. ASTM A792-83-AZ50: Specifications for steel sheet, aluminum-zinc alloy coated (galvanized) by the hot dip process, general requirements (Galvalume).

B. Manufacturer's qualifications:
1. Manufacturer has a minimum of three years experience in manufacturing metal wall systems of this nature. Panels specified in this section shall be produced in a factory environment (not job site roll formed) with fixed base roll forming equipment, to the highest level of quality control. A letter from the manufacturer certifying compliance of company the product material submittals.

1.3 Product Delivery, Storage and Handling

A. Delivery: Deliver metal wall system to site properly packaged to provide protection against transportation damage.
B. Handling: Exercise extreme care in unloading, storing and erecting metal wall system to prevent bending, warping, twisting and surface damage.
C. Storage: Store all materials and accessories above ground on well skidded platforms. Store under waterproof covering. Provide proper ventilation of metal wall system to prevent condensation build up between each panel or trim/ flashing component.

2.1 Materials

A. Metal wall system profile:
1. Shadow Rib: 3 inch deep x 16 inch width with 1 1/2 inch deep x 5 1/4 inch wide fluting
B. Metal wall system style:
1. Fluted face
2. Concealed fasteners
C. Gauge: 24 gauge
D. Substrate: Per Plans
E. Texture: Smooth
F. Finish: Premium thermoset silicone polyester (20 year warranty)
G. Color: Polar White, to be painted per Exterior Elevations
H. Acceptable Manufacturer: MBCI Houston, Texas (281) 445-8555.

NOT USED

3.1 Surface Conditions

A. Examination:
1. Inspect installed work of other trades and verify that such work is complete to a point where this work may continue.
2. Verify that installation may be made in accordance with approved shop drawings and manufacturer's instructions.

3.2 Installation

A. Install metal wall system system so that it is weathertight, free of waves, warps, buckles, fastening stresses or distortion.
B. Install metal wall system in accordance with manufacturer's instructions and shop drawings.
C. Provide concealed anchors at all panel attachment locations.
D. Install panels plumb, level and straight with true lines and parallel, conforming to design as indicated.

3.3 Cleaning, Protection

A. Dispose of excess materials and remove debris from site.
B. Clean work in accordance with manufacturer's recommendations.
C. Protect work against damage until final acceptance. Replace or repair to the satisfaction of the architect and work that becomes damaged prior to final acceptance.
D. Touch up minor scratches and abrasions.

3.4 Field Painting

A. Refer to section 09900 on G017
B. Follow manufacturer's technical bulletin for Precoated Signature 200 MBCI wall panels.

Section 07900 – JOINT SEALERS

1.1 General: Provide joint sealers as shown and specified.

A. Standards:Comply with ASTM C 920 requirements.

B. Application: Performed by skilled, experienced joint sealer applicators.

2.1 Materials:

A. Poly urethane sealants:
1. Tremco Commercial Sealants (800) 321-7906, internet www.tremcosealants.com,
   a. "Dymonic FC" One component, fast skinning, Low Modulus Polyurethane.
   b. "Dymeric 240 FC" Multi Component, gun grade, chemically curing, tintable fast setting polyurethane sealant.
2. Sonneborn, (724) 756-9582, internet www.sonneborn.com
   a. Color pack for polyurethane multi component, gun grade chemically curing sealant.

B. Silicone Sealants:
1. General Electric Silicones, (800) 295-2392, internet www.gesilicones.com
   a. "SCS1700 Sanitary – Mold/Mildew Resistant Silicone", one component 100% silicone, fungicidal based sealant.
   b. "SCS2700 Silpruf Silicone" one component medium modulus, natural cure silicone all purpose sealant.
   c. "Silglaze II SCS2800- Glazing Sealant" one component, 100% silicone based sealer.
   d. "GE Paintable Silicone" one component paintable silicone.
   e. "SCS1009 Silicone Sealant" one-component acetoxy silicone for general purpose sealing and bonding
2. Dow Corning Silicones, (989)496-4000, www.dowcorning.com
   a. "Dow 795" – one component, medium modulus, natural cure silicone.

C. Firestopping Sealants: 3M Fire Protection Products, (800) 328-1687, internet www.3M.com/firstop
1. "3M Fire Barrier CP 25WB+ Caulk" or approved equal

D. Joint backing: Non-absorptive, non-staining compressible, non-gassing, polyethylene foam backer rod compatible with joint sealants.

3.1 Installation:

A. Preparation: Clean and prepare joints prior to installing sealers:
1. Wipe shipping oils from surfaces to be sealed. Remove protective films and/or install joint backer rod if joint is larger than ¼" in width.

B. Installation: Install joint sealant materials in strict accordance with manufacturer's installation instructions.
1. Apply sealants in a uniform, continuous bead without gaps or air pockets. Hand tool and finish all joints so that a smooth, small, lip free uniform line is created along the substrate being shot. Remove any excess materials from tooled edges and ends of joint.
2. Install joint sealants to a depth no more than ½ the width of the joint.
3. Install sealants by proven techniques that result in sealants directly contacting and fully wetting joint substrates, completely filling recesses provided for each joint configuration, and providing uniform, cross-sectional shapes and depths relative to joint widths which allow optimum sealant movement capability.
4. Immediately, after sealant application, and prior to time skinning or curing begins, tool sealants to form smooth, uniform beads of configuration indicated to eliminate air pockets, and to ensure contact and adhesion of sealant with sides of joint. Remove excess sealants from surfaces adjacent to joint. Do not use tooling agents which discolor sealants or adjacent surfaces or are not approved by sealant manufacturer.
5. Clean off excess sealants or sealant smears adjacent to joints as work progresses by methods and with cleaning materials approved by manufacturers of joint sealers and of products in which joints occur.

4.1 Sealant Schedule:

A. Kitchen Area:
- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Ceiling grid to FRP wall panels
2. Base of FRP wall panels to T.O. specified base material.
3. Walk in cooler walls to FRP wall panels.
4. Stainless closure pieces at cooler walls to FRP wall panels.
5. FRP/stainless corner guards to FRP wall panels.
6. Ceiling tile pipe penetrations.
7. Wall pipe penetrations and/or escutcheons perimeters. (water & gas lines).
8. Mop sink stainless surround perimeter to walls.
9. FRP closure panel, at top of cooler, to cooler walls.
10. FRP wall panels to hollow metal door frames.
11. Coke line bundle to PVC cap.
12. FRP inside corner pieces to FRP wall panels. Both sides of corner piece.
13. Battery backup cover panel to FRP.
14. Faucet's to FRP wall panels.
15. FRP wall panels to quarry tile cove base.
16. FRP to aluminum plate at walk thru.
17. Menu board light bracket to ceiling.
18. Mop sink base at quarry tile.
19. All sinks (multi-compartment, hand, mop and prep) to FRP/tile walls.
20. Paper towel dispensers & soap dispensers to FRP/tile walls.

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
1. Stainless closer pieces, at sides of cooler walls - to cooler walls.
2. Stainless or aluminum plate closure pieces to diamond plate at cooler walls.
3. Diamond plate panel seam joints.
4. Diamond plate perimeter to cooler walls.
5. Base of diamond plate to quarry tile cove base.
6. Stainless closure panel, at top of cooler walls, to cooler walls.
7. Top of quarry tile cove base to cooler walls at inside of cooler.
8. Cooler wall/diamond plate penetrations.
9. Cooler door hinges and handles to diamond plate. DO NOT caulk door locking unit.
10. Stainless wrap at hollow metal door frame.
11. Stainless mop surround to stainless corners on mop sink.
12. Base of stainless corner pieces to schlutter strip at base.
13. Exit door threshold perimeters. To frame and floor, interior and exterior.

- Provide a continuous bead of dark gray GE SCS2000 silicone at the following locations:
1. Base of hollow metal door jambs to quarry tile floor.

B. Managers Office:
- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Ceiling grid to FRP wall panels.
2. Perimeter of manager's desk to FRP wall panels.
3. Hollow metal door frame to FRP wall panels.
4. Top and ends of coat hanger bracket to FRP walls.
5. Base of FRP wall panels to quarry tile base.
6. Ceiling tile wire/pipe penetrations.
7. FRP inside corners to FRP wall panels. Both sides of corner piece.
8. Base of FRP wall panels to quarry tile.

- Provide a continuous bead of black or light bronze (use color of safe) GE SCS2000 silicone at the following locations:
1. Base of safe to floor.

C. Cooking Area:
- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Top of wall tile to sheetrock ceiling.
2. Ceiling diffusers perimeters to sheetrock ceiling.
3. Ceiling pipe penetrations.
4. Wall tile to aluminum walk thru surround.
5. Tile wall penetrations/escutcheons perimeters.
6. FRP wall panels to sheetrock ceilings.
7. FRP wall panels to aluminum end wall plates.
8. FRP inside corners to FRP wall panels. Both sides of corner piece.
9. Sink to white wall tile.
10. Paper towel dispenser/soap dispenser to white tile.
11. POS/Serving counter to wall tile.
12. Stainless shelf behind grill to wall tile.
13. Faucets to ceramic wall tile.

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
1. Joint between hood and closure skirt.
2. Joint between hood support and hood. Both sides.
3. Connection joint between stainless shelf behind grill.
4. Hood to tile walls & sheetrock ceiling.
5. Hood gusset to wall tile on both sides.
6. Sink to bronze wall tile.
7. Paper towl dispenser/soap dispenser to bronze tile.
8. DML counter to bronze tile.

- Provide a continuous bead of dark gray GE SCS2000 at the following locations:
1. Base of equipment to concrete curbs/quarry tile.

- Provide a continuous bead of bronze GE SCS2097 at the following locations:
1. Ceramic tile inside corners.
2. Ceramic tile to aluminum end wall plates.

D. Restrooms:
- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Top of FRP to sheetrock ceiling or top of FRP trim to sheetrock wall.
2. Perimeter of toilets/urinals to floor or FRP.
3. Perimeter of mirror to FRP.
4. Sink to wall.
5. Perimeter of paper towel/garbage unit to wall.
6. Toilet paper/napkin disposals units to walls.
7. Stainless shelf to wall.
8. Wall penetrations under sink and or escutcheons to perimeters.
9. Hollow metal door frames to FRP.
10. Base of FRP wall panels to top of wall base.
11. FRP inside corners to FRP wall panels.

- Provide a continuous bead of black GE SCS2000 silicone at the following locations:
1. Base of black rubber wall base to floor.

- Provide a continuous bead of dark gray GE SCS2000 silicone at the following locations:
1. Base of hollow metal door frames to floor.

E. Dining area:
- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Wall tile to sheetrock walls.
2. Perimeter of aluminum storefront/windows/entrances to sheetrock walls.
3. Wainscot wall panels (Stonewood or other) to painted walls.
4. Diffuser/louvers perimeters to sheetrock walls.
5. Hollow metal door frames to painted walls - if needed.
6. Frame of service line counter to tile (joint to be caulked behind front face panels of counter).
7. Wall tile at serving line wall to POS counter.

- Provide a continuous bead of black GE SCS2000 silicone at the following locations:
1. Base of black rubber to floor (concrete or quarry tile) and gyp. bd. wall.
2. Wainscot (Stonewood or other) wall panels to sill of aluminum storefront/ windows.
3. Vertical joints of wainscot (Stonewood or other) wall panels to frames/painted walls/tile (ONLY if joint is uneven or plywood is showing).
4. Stonewood panels at serve line.

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
1. Base of garbage surround to floor.

- Provide a continuous bead of Dow 795 silicone at the following locations:
1. Sill of aluminum storefronts to concrete or tile floor. Color to be determined per store to match storefront (Charcoal/Anodized Aluminum/Dark Bronze).

F. Utensil Counter:
- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
1. Stainless countertop to backsplash. Horizontal & vertical joints.
2. Base of Coke machine to countertop.
3. Perimeter of tea drain tray to countertop.
4. Stainless backsplash to white tile walls/painted walls.

- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Coke line bundle to PVC cap.

G. Fire Rated Walls:
- Provide a continuous bead of 3M 25WB+ at the following locations:
1. Wall/ceiling penetrations in rated walls.

H. Exterior Joints:
- Provide a continuous bead of Tremco Dymeric limestone urethane sealant at the following locations:
1. Sidewalk/concrete expansion joints.

- Provide a continuous bead of Dow 795 silicone or Tremco Dymeric 240 FC at the following locations:
1. Hollow metal door frames.
2. EIFS to abutting services.
3. Penetrations in EIFS.
4. Face brick or block control joints.
5. Perimeter of Aluminum Storefronts.

*Colors to be determined per store to match adjacent material colors. Verify with Chipotle Construction Manager and Architect.
- For "Fog" EIFS use Tremco - "Natural White"
- For "Knight's Armor" EIFS use Sonneborn - "Charcoal Gray" #276-U
- For white brick use Tremco - "China White"

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following location:
1. CO2 fill port stainless box.
2. Faucet for hose. (Please note: color to be determined per store. Verify with Chipotle Construction Manager and Architect).

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

ARCHITECTURAL SPECIFICATIONS

G013

DIVISION 8 - DOORS AND WINDOWS

SECTION 08110 - STEEL DOORS AND FRAMES

1.1 General: Tenant to provide steel doors and frames as shown and specified.

A. Standards: Materials and construction shall conform to the following:
1. ANSI A250.8-2009 "Specifications for Standard Steel Doors and Frames."
2. ANSI A250.11-01 "Erection Instructions for Steel Frames."
3. SDI 122-99 " Installation for Standard Steel doors and Frames.

B. Manufacturer: A member of the Steel Door Institute (SDI).

2.1 Materials:

A. Steel Doors:
1. Interior: Heavy-duty Level 2, physical performance B, Model 2 seamless construction, ASTM A1008, 18 gage cold-rolled steel face sheets, manufacturer's standard core.

2. Exterior: Extra heavy-duty Level 3, physical performance A, Model 2 seamless construction, ASTM A1008, 16 gage cold-rolled steel face sheets; tops and bottoms closed with flush galvanized steel caps, manufacturer's standard plastic foam insulating core.

B. Steel Frames: ASTM A1008, 16 gage cold-rolled steel.
1. Provide combination buck, jamb and trim type frames for 1-3/4" thick doors, unless otherwise indicated.
2. Interior and exterior frames: Set-up welded type with mitered corners, reinforced, fully seam welded with exposed welds ground smooth.

C. Door and frame fabrication:
1. Provide cutouts for mortised hardware, accurately located and made to fit hardware. Provide closer reinforcement for all doors with surface mounted door closers.
2. Punch frames and factory install rubber door silencers.
3. Provide minimum three anchors of suitable design for each jamb.
4. Provide floor clip on bottom of each jamb. Provide angle spreaders at bottom of each set-up frame.

D. Shop painting: Clean and paint exposed surfaces of steel door and frame units. Apply one baked-on shop coat of rust-inhibitive prime paint in accordance with ANSI A250.10, unless doors and frames are used at the restrooms or as indicated on door hardware and finish schedule. Provide a uniformly finished surface ready to receive finish paint.

3.1 Installation:

A. Install frames plumb, level, rigid, and in true alignment as recommended in ANSI A250.11.

B. Install doors plumb and in true alignment and fastened to achieve the maximum operational effectiveness and appearance as recommended in SDI 122.

SECTION 084113 - ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS

1.1 General: Provide aluminum entrances and storefronts as shown and specified.

1.2 Related Documents:

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this section.

B. Standards: Materials and construction shall conform to the following:
1. AAMA SFM-1-87 "Aluminum Storefront and Entrance Manual."

1.3 Summary:

A. Section Includes:
1. Kawneer Architectural Aluminum Storefront Systems, including perimeter trims, stools, accessories, shims and anchors, and perimeter sealing of storefront units.
a. Types of Kawneer Aluminum Storefront include:
(1.) Trifab VG 451T Storefront System - 2" x 4-1/2" nominal dimension; Thermal; Front-Set

2. Kawneer Aluminum Entrances, glass and glazing, and components
a. Types of Kawneer Aluminum Entrances include:
(1.) 350T Swing Door; Medium stile, 3" vertical face dimension, 1-3/4" depth, high traffic applications or as indicated on Drawings.

3. Kawneer Tube for Feature Exterior Slat Wall

4. Alternate Storefront Systems only when approved by Arch PM and Chipotle DM.
a. YKK
(1.) YES 45 TU Storefront System - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
b. Oldcastle
(1.) Series 3000 Thermal MultiPlane Storefront System - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
c. US Aluminum
(1.) Series FT451 - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
d. EFCO
(1.) Series 403 (T) Storefront System - 2" x 4-1/2" nominal dimension; Thermal
e. Wausau
(1.) TU24000 Storefront System - 2" x 4-1/2" nominal dimension; Thermal

1.4 Performance Requirements:

A. General Performance: Aluminum-framed storefront system shall withstand the effects of the following performance requirements without exceeding performance criteria or failure due to defective manufacture, fabrication, installation, or other defects in construction;
1. Design Wind Loads: Determine design wind loads applicable to the Project from basic wind speed indicated in miles per hour, according to ASCE 7, Section 6.5, "Method 2-Analytical Procedure," based on mean roof heights above grade indicated on Drawings.
a. Basic Wind Speed (MPH): Determine to meet local codes listed on A000
b. Importance Factor: (1.00)
c. Exposure Category (A, B, C, D): Determine to meet local codes listed on A000

B. Storefront System Performance Requirements:
1. Wind loads: Provide storefront system; include anchorage, capable of withstanding inward and outward wind load design pressures meeting local codes listed on sheet A000.
2. Air Infiltration:
a. Air Infiltration for storefront frame system: The test specimen shall be tested in accordance with ASTM E 283. Air infiltration rate shall not exceed 0.06 cfm/ft. sq. at a static air pressure differential of 6.24 psf.
b. Air Infiltration for storefront entrances: For single acting offset pivot or butt hung entrances in the closed and locked position, the test specimen shall be tested in accordance with ASTM E 283 at a pressure differential of 6.24 psf (300 Pa) for single doors and 1.567 psf (75 PA) for pairs of doors. A single 3'0" x 7'0" entrance door and frame shall not exceed 0.50 cfm per square foot. A pair of 6'0" x 7'0" entrance doors and frame shall not exceed 1.0 cfm per square foot.
3. Water Resistance: The test specimen shall be tested in accordance with ASTM E 331. There shall be no leakage at a minimum static air pressure differential of 8 psf as defined in AAMA 501.
4. Uniform Load: A static air design load of 20 psf shall be applied in the positive and negative direction in accordance with ASTM E 330. There shall be no defection in excess of L/175 of the span of any framing member. At a structural test load equal to 1.5 times the specified design load, no glass breakage or permanent set in the framing members in excess of 0.2% of their clear spans shall occur.
5. Thermal Transmittance (U-factor): When tested to AAMA Specification 1503, the thermal transmittance (U-factor) shall be not more than:
a. Glass to Exterior - 0.47 (low-e)
6. Condensation Resistance (CRF): When tested to AAMA Specification 1503, the condensation resistance factor shall not be less than:
a. Glass to Exterior - 70 frame and 69 glass (low-e)
7. Sound Transmission Class (STC) and Outdoor-Indoor Transmission Class (OITC): When tested to AAMA Specification 1801 and in accordance with ASTM E1425 and ASTM E90, the STC and OITC Rating shall not be less than:
a. Glass to Exterior - 38 (STC) and 31 (OITC)

1.5 Submittals:

A. Product Data: Include construction details, material descriptions, dimensions of individual components and profiles, hardware, finishes, and installation instructions for each type of aluminum frame storefront system and storefront entrance doors indicated.

B. Shop Drawings: Include plans, elevations, sections, details, hardware, and attachments to work, operational clearances and installation details.

C. Samples for Initial Selection: For units with factory-applied color finishes including samples of hardware and accessories involving color section.

1.6 Quality Assurance

A. Installer Qualifications: An installer which has had successful experience with installation of the same or similar units required for the project and other projects of similar size and scope

B. Manufacturer Qualifications: A manufacturer capable of providing aluminum framed storefront system that meet or exceed performance requirements indicated and of documenting this performance by inclusion of rest reports, and calculations.

C. Source Limitations: Obtain aluminum framed storefront system and storefront entrance doors through one source from a single manufacturer.

D. Product Options: Drawings indicate size, profiles, and dimensional requirements of aluminum framed storefront system and are based on the specific system indicated. Do not modify size and dimensional requirements.
1. Do not modify intended aesthetic effects, as judged solely by Architect, except with Architect's approval. If modifications are proposed, submit comprehensive explanatory data to Architect for review.

1.7 Project Conditions:

A. Field Measurements: Verify actual dimensions of a aluminum framed storefront openings by field measurements before fabrication and indicate field measurements on Shop Drawings.

1.8 Warranty

A. Manufactures Warranty: Submit, for Owner's acceptance, manufacturer's standard warranty.
1. Warranty Period: Two (2) years from Date of Substantial Completion of the project provided however that the Limited Warranty shall begin in no event later than six months from date of shipment by manufacturer.

2.1 Manufacturers:

A. Manufacturer: Kawneer Company Inc., Contact: Doug Hess, Phone: 317-771-9265; email:doug.hess@arconic.com

1. Basis-of-Design Product Storefront Framing:
a. Trifab 451T (thermal) Storefront System
i. 2" x 4-1/2" System Dimensions
ii. Glass: Exterior (Front-Set)

2. Basis-of-Design Product Storefront Entrances:
a. The door stile and rail face dimensions of the 350T-Wide Stile entrance door will be as follows or as indicated on Drawings. Door: 350 I, Vertical Stile: 5" , Top Rail: 3 1/2"; Bottom Rail: 10"
b. Major portions of the door members to be 0.125" nominal in thickness and glazing molding to be 0.05" thick.
c. Glazing gaskets shall be either EPDM elastometric extrusions or a thermoplastic elastomer.
d. Provide adjustable glass jacks to help center the glass in the door opening.

B. Alternate Storefront Systems only when approved by Arch PM and Chipotle DM.
1. YKK
a. YES 45 TU Storefront System - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
2.. Oldcastle
a. Series 3000 Thermal MultiPlane Storefront System - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
3.. US Aluminum
a. Series FT451 - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
4. EFCO
a. Series 403 (T) Storefront System - 2" x 4-1/2" nominal dimension; Thermal
5. Wausau
a. TU24000 Storefront System - 2" x 4-1/2" nominal dimension; Thermal

2.2 Materials:

A. Provide aluminum entrances and storefront matching the existing building aluminum entrances and storefronts, unless otherwise indicated.

B. Aluminum Frame Extrusions: Alloy and temper recommended by aluminum storefront manufacturer for strength, corrosion resistance, and application of required finish and not less than 0.070" wall thickness at any location for the main frame and complying with ASTM B 221: 6063-T6 alloy and temper.

C. Aluminum Storefront Entrance Extrusions:Alloy and temper recommended by aluminum-framed glass door manufacturer for strength, corrosion resistance, and application of required finish and not less than 0.090" wall thickness at any location for the main frame and sash members.

D. Fasteners: Aluminum, nonmagnetic stainless steel or other materials to be non-corrosive and compatible with aluminum window and door members, trim hardware, anchors, and other components.

E. Anchors, Clips, and Accessories: Aluminum, nonmagnetic stainless steel, or zinc-coated steel or iron complying with ASTM B 633 for SC 3 severe service conditions, or other suitable zinc coating; provide sufficient strength to withstand design pressure indicated.

F. Reinforcing Members: Aluminum, nonmagnetic stainless steel, or nickel/chrome-plated steel complying with ASTM B 456 for Type SC 3 severe service conditions, or zinc-coated steel or iron complying with ASTM B 633 for SC 3 severe service conditions or other suitable zinc coating; provide sufficient strength to withstand design pressure indicated.

G. Sealant: For sealants required within fabricated storefront system, provide permanently elastic, non-shrinking, and non-migrating type recommended by sealant manufacturer for joint size and movement.

H. Tolerances: Reference to tolerances for wall thickness and other cross-section dimensions of storefront members are nominal and in compliance with AA Aluminum Standard Data.

2.3 Storefront Framing System:

A. Thermal Barrier: Thermal Break shall be designed in accordance with AAMA TIR-A8 and tested in accordance with AAMA 505.
1. Kawneer IsoLock Thermal Break with a 1/4" separation consisting of a two-part chemically curing, high-density polyurethane, which is mechanically and adhesively joined to aluminum storefront sections.

B. Brackets and Reinforcements: Manufacturer's standard high-strength aluminum with non-staining, nonferrous shims for aligning system components.

C. Fasteners and Accessories: Manufacturer's standard corrosion-resistant, non-staining, non-bearing fasteners and accessories compatible with adjacent materials. Where exposed shall be stainless steel.

D. Perimeter Anchors: When steel anchors are used, provide insulation between steel material and aluminum material to prevent galvanic action.

E. Packing, Shipping, Handling and Unloading: Deliver materials in manufacturer's original, unopened, undamaged containers with identification labels intact.

F. Storage and Protection: Store materials protected from exposure to harmful weather conditions. Handle storefront material and components to avoid damage. Protect storefront material against damage from elements, construction activities, and other hazards before, during and after storefront installation.

2.4 Glazing Systems:

A. Glazing: As specified in Section 08800 - Glazing.

B. Glazing Gaskets: Manufacturer's standard compression types; replaceable, extruded EPDM rubber.

C. Spacers and Setting Blocks: Manufacturer's standard elastomeric type.

D. Bond-Breaker Tape: Manufacturer's standard TFE-fluorocarbon or polyethylene material to which sealants will not develop adhesion.

E. Glazing Sealants: For structural-sealant-glazed systems, as recommended by manufacturer for joint type, and as follows:
1. Structural Sealant: ASTM C 1184, single-component neutral-curing silicone formulation that is compatible with system components with which it comes in contact, specifically formulated and tested for use as structural sealant and approved by a structural-sealant manufacturer for use in aluminum-framed systems indicated.
a. Color: Black
2. Weatherseal Sealant: ASTM C 920 for Type S, Grade NS, Class 25, Uses NT, G, A, and O; single-component neutral-curing formulation that is compatible with structural sealant and other system components with which it comes in contact; recommended by structural-sealant, weatherseal-sealant, and aluminum-framed-system manufacturers for this use.
a. Color: Matching structural sealant.

2.5 Entrance Door Systems:

A. Entrance Door Hardware: As specified in Section 08710 Door Hardware.

2.6 Accessory Materials:

A. Joint Sealants: For installation at perimeter of aluminum-framed systems, as specified in section 07900 - Joint Sealers

2.7 Storefront Framing Fabrication:

A. Framing Members, General: Fabricate components that, when assembled, have the following characteristics:
1. Profiles that are sharp, straight, and free of defects or deformations.
2. Accurately fit joints; make joints flush, hairline and weatherproof.
3. Means to drain water passing joints, condensation within framing members, and moisture migrating within the system to exterior.
4. Physical and thermal isolation of glazing from framing members.
5. Accommodations for thermal and mechanical movements of glazing and framing to maintain required glazing edge clearances.
6. Provisions for field replacement of glazing.
7. Fasteners, anchors, and connection devices that are concealed from view to greatest extent possible.

B. Mechanically Glazed Framing Members: Fabricate for flush glazing without projecting stops.

C. Structural-Sealant-Glazed Framing Members: Include accommodations for using temporary support device to retain glazing in place while structural sealant cures.

D. Storefront Framing: Fabricate components for assembly using manufacturers standard installation instructions.

E. After fabrication, clearly mark components to identify their locations in Project according to Shop Drawings.

2.8 Storefront Entrance Door Fabrication:

A. Fabricate aluminum-framed glass entrance doors in sizes indicated. Include a complete system for assembling components and anchoring doors.

B. Fabricate aluminum-framed glass doors that are reglazable without dismantling perimeter framing.
1. Door corner construction shall consist of mechanical clip fastening, SIGMA deep penetration plug welds and 1-1/8" long fillet welds inside and outside of all four corners. Glazing stops shall be hook-in type with EPDM glazing gaskets reinforced with non-stretchable cord.
2. Accurately fit and secure joints and corners. Make joints hairline in appearance.
3. Prepare components with internal reinforcement for door hardware.
4. Arrange fasteners and attachments to conceal from view.

C. Weather Stripping: Provide weather stripping locked into extruded grooves in door panels or frames as indicated on manufactures drawings and details.

2.9 Aluminum Finishes:

A. Finish designations prefixed by AA comply with the system established by the Aluminum Association for designating aluminum finishes.

B. Factory Finishing:
1. Kawneer Permafluor (70% PVDF), AAMA 2605, Fluoropolymer Coating (Color: Charcoal or as noted on Drawings)
2. Finishing for alternate storefront specifications to be verified by Arch PM and Chipotle DM
a. YKK "Charcoal" UC99477, Superior Painted Finishes
b. All others to be verified with samples and submittals to Arch PM

2.10 Brake Metal Trim:

A. Shop Drawings: Show layout and elevations, dimensions and thickness of panels, connections, details and location of joints, sealants and gaskets, method of anchorage, number of anchors, supports, reinforcement, trim, flashings, and accessories.
1. Show actual field measurements on shop drawings.
2. Differentiate between shop and field fabrication.
3. Indicate substrates and adjacent work with which the fabrications must be coordinated.
4. Include large-scale details of anchorages and connecting elements.
5. Include large-scale or schematic exploded or isometric diagrams to fully explain flashing at a scale of not less than 1-1/2 inches per 12 inches (1:10)

2.11 Formed Metal Fabrications - General:

A. Shop assembly: Preassemble items to greatest extent possible. Minimize field splices and field assembly. Disassemble only as necessary for transportation and handling. Mark items clearly for assembly and installation.

B. Coordinaton: Match dimensions and attachement of formed metal items to adjacent construction. Produce integrated assembles. Closely fit joints; align edges and flat surfaces unless indicated otherwise.

C. Forming: Profiles indicated. Maximize lenghts. Fold exposed edges to form hem indicated or ease edges to radius indicated with cocealed stiffener. Provide flat, flush surfaces without cracking or grain seperation at bends.

D. Reinforcement: Increase metal thickness; use concealed stiffeners, backing materials or both. Provide stretcher leveled standard of flatness and stiffness required to maintain flatness and hold adjacent items in flush alignment.

E. Anchors: Straps, plates and anchors as required to support and anchor items to adjacent construction.

F. Supports: Miscellaneous framing, mounting, clips, sleeves, fasteners and accessories required for installation.

G. Welding and brazing: Weld or braze joints continuously. Grind smooth, fill or dress to produce smooth, flush, exposed surfaces. Do not discolor metal. Grind Smooth, polish, and restore damaged finishes to required condition.
1. Ease exposed edges to small uniform radius.
2. Welded joints.
a. Carbon Steel: Perform welding in accordance with AWS D1.1/D1.1M.
b. Stainless Steel: Perform welding in accordance with AWS D1.6/D1.6M
3. Brass/Bronze Brazed Joints:
a. Perform torch brazing in accordance with AWS C3.4M/C3.4
b. Perform induction brazing in accordance with AWS C3.5M/C3.5
c. Perform resistance brazing in accordance with AWS C3.9M/C3.9

H. Performance requirements;
1. Thermal Movements:
a. Allow for thermal movements in exterior metal fabrications due to temperature changes. Prevent buckling, opening of joints, overstressing of components, failure of connections, and other detrimental effects.
b. Temperature Change Range: 120 degrees F (67 degrees C), ambient; 180 degrees F (100 degrees C), on material surfaces.
2. Corrosion: Prevent galvanic action and other forms of corrosion by isolating metals and other materials from direct contact with incompatible materials.

2.12 Formed Metal Fabrications - Sheet Metal

A. Closures, Trim, and Fill Panels:
1. Form Closures from type and thickness of metal indicated.
2. Conceal fasteners when possible.
3. Drill and tap holes for securing to other surfaces.
4. Provide gaskets where indicated or needed for continuous seal at adjacent surfaces.
5. Miter or cope at corners and reinforce with bent metal plate. Form tigh joints.

2.13 Materials

A. Genaral: Provide sheet metal without pitting, seam marks, roller marks, stains, discolorations, or other imperfections exposed to view on finished units.
B. Galvanized Steel Sheet: ASTM A653/A653M, G90 (Z275) coating. 14 gauge min. thick base material.
C. Anchors, Clips, and Accessories: Use one of the following:
1. Stainless steel complying with ASTM A276/A276M, ASTM A480/A480M, or ASTM A666.
2. Steel complying with ASTM A36/A36M and hot-dipped galvanized to ASTM A153/A153M.
3. Steel complying with ASTM A36/A36M and hot-dipped galvenized to ASTM A123/A123M Coating Grade 35
4. Interior locations: Carbon steel; zinc coated in accordance with ASTM B633 or ASTM F1941/F1941M, Class Fe/Zn 5.
5. Exterior Locations or in contact with Stainless Steel:
a. Bolts: Stainless steel; ASTM F593, Group 1 (A1)
b. Nuts: Stainless steel; ASTM F594.
6. Structural Anchors: Provide anchors where work is indicated to comply with design loads.
a. Type: Provide chemical or torque controled expansion anchors.
b. Capacity: When tested according to ASTM E488/E488M; four times the load imposed when installed in concrete.
7. Nonstructural Anchors: Provide powder-actuated fasteners where work is not indicated to comply wit design loads. Provide size and number required for load, installation, and as recommended by manufacturer, unless indicated otherwise.
D. Fasteners, General: Same basic metal and alloy as formed metal sheet unless indicated otherwise. Do not use metals incompatible with the materials joined.
E. Gaskets: As required to seal joints in decorative formed metal and remain airtight; as recommended in writing by decorative formed metal manufacturer.

2.14 Finishes

A. Finishes, General: Comply with NAAMM AMP 500-06
1. Complete mechanical finishes befor fabrication. After fabrication, finish joints, bends, abrasions and surface blemishes to match sheet.
2. Protect mechanical finishes on exposed surfaces from damage.
3. Apply organic and anodic finishes to formed metal after fabrication unless indicated otherwise.
4. Appearance: Limit variations in appearance of adjacent to one-half the range represented in approved samples. noticeable variations in the same piece are not acceptable. Install components in the range of approved samples to minimize contrast.
B. Galvanized Steel Finishes:
1. Repair Galvanized Surfaces: Clean welds and abraded areas and repair galvanizing to comply with ASTM A780/A780M
2. Color: As shown on the drawings.
3. Factory Prime: Apply shop primer to pepared surfaces of items where field painting after installation indicated, unless indicated otherwise. Comply with requirements in SSPC-PA1
4. High Performance Organic Coatings: AAMA 2604; multiple coats, thermally cured fluoropolymer system.

3.1 Examination:

A. Examine openings, substrates, structural support, anchorage, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of work. Verify rough opening dimensions, levelness of sill plate and operational clearances. Examine wall flashings, vapor retarders, water and weather barriers, and other built-in components to ensure a coordinated, weather tight framed aluminum storefront system installation.
1. Masonry Surfaces: Visibly dry and free of excess mortar, sand, and other construction debris.
2. Wood Frame Walls: Dry, clean, sound, well nailed, free of voids, and without offsets at joints. Ensure that nail heads are driven flush with surfaces in opening and within 3 inches of opening.
3. Metal Surfaces: Dry; clean; free of grease, oil, dirt, rust, corrosion, and welding slag; without sharp edges or offsets at joints.
4. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 Installation:

A. Comply with Drawings, Shop Drawings, and manufacturer's written instructions for installing aluminum framed storefront system, aluminum swing storefront entrance doors, accessories, and other components.

B. Install aluminum framed storefront system and storefront doors level, plumb, square, true to line, without distortion or impeding thermal movement, anchored securely in place to structural support, and in proper relation to wall flashing and other adjacent construction.

C. Set sill members and door threshold in bed of sealant or with gaskets, as indicated, for weather tight construction.

D. Install aluminum framed storefront system and components to drain condensation, water penetrating joints, and moisture migrating within sliding door to the exterior. Refer to section 07900 - Joint Sealers.

E. Separate aluminum and other corrodible surfaces from sources of corrosion or electrolytic action at points of contact with other materials.

F. Install aluminum storefront framing system glass and glazing, in accordance with section 08800 and the manufacturer's requirements.

3.3 Adjusting, Cleaning, and Protection:

A. Clean aluminum surfaces immediately after installing aluminum framed storefronts. Avoid damaging protective coatings and finishes. Remove excess sealants, glazing materials, dirt, and other substances.

B. Clean glass immediately after installation. Comply with glass manufacturer's written recommendations for final cleaning and maintenance. Remove nonpermanent labels, and clean surfaces.

C. Remove and replace glass that has been broken, chipped, cracked, abraded, or damaged during construction period.

SECTION 085619 - PASS-THRU WINDOW

1.1 General: Provide door hardware as shown and specified.

A. Standards: Materials and installation shall conform to the following:
1. ASTM A240 - Heat-Resisting Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels.
2. ASTM A653 - Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
3. ASTM B209 - Aluminum and Aluminum-Alloy Sheet and Plate.
4. ASTM B221 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
5. ASTM B580 - Standard Specification for Anodic Oxide Coatings on Aluminum.
6. ASTM B680 - Standard Test Method for Seal Quality of Anodic Coatings on Aluminum by Acid Dissolution.
7. ASTM C1048 - Heat-Treated Flat Glass--Kind HS, Kind FT Coated and Uncoated Glass.
8. ASTM C1172 - Standard Specification for Laminated Architectural Flat Glass.
9. ASTM E774 - Standard Specification for Sealed Insulating Glass Units.
10. Aluminum Association AA DAF-45 - Designation System for Aluminum Finishes.

B. Quality Assurance:
1. Manufacturer Qualifications: Minimum of 25 years successful experience continuously manufacturing pass-thru windows.
2. Installer Qualifications: Installer shall have five years experience manufacturing and fabricating windows of similar type and scope as those specified in this section.

2.1 Materials:

A. Acceptable Manufacturers. Arch PM to verify required manufacturer per Tenant's assignment.
1. Quikserv; Toll Free: 1.800.388.8307; Email: sales@quikserv.com; Web: https://www.quikserv.com/
2. ReadyAccess; Toll Free: 1.800.621.5045; Email: ready@ready-access.com; Web: https://www.ready-access.com

B. No substitutions allowed. Requirements for manufacturer, design, grade, function, finish, size and other distinctive qualities of each type of door hardware are indicated on the drawings.

NOT USED

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

ARCHITECTURAL SPECIFICATIONS

G014

2.2 In-Line Side Sliding Automatic Window and Air Curtain

A. Standard Custom Side Sliding Windows – Arch PM to verify manufacturer with Tenant.
   a. GC to use specification called out on storefront details sheet and/or as directed by Tenant Arch PM.

   • Quikserv Custom Automatic Side Sliding Window (Model: SST-4035E-CHIPOTLE): 45 -1/2"W x 41-3/4"H window with 17-3/4" tall transom and (2) sidelights at 29 1/4"W x 41-3/4"H; Complete Unit Size 104"W x 59-1/2"H

   1. Service Opening: 19"W x 29-3/4"H
   2. Finish: Dark Bronze Anodized
   3. Glass: 1" Clear Tempered unit + Low E (Solarban 60e) for fixed and moving panel, sidelights and transom
   4. 'CHIPOTLE' package includes pre-wired air curtain with relay to sync operation with window.
      a. Arch PM to verify if heated or ambient air curtain is required per Tenant assignment. Air Curtain mounts to transom.
         i. Heated Air Curtain: Model: QSV1025EJ-040-BK
         ii. Ambient Air Curtain: Model: QSK1025AA-BK
   5. Refer to interior elevations (A700s) for direction of opening for ordering.

   • ReadyAccess Automatic Side Sliding Window: 47 -1/2"W x 35-1/2"H window with 16" tall transom and (2) sidelights at 28 1/4"W x 59-1/2"H; Complete Unit Size 104"W x 59-1/2"H

   1. Service Opening: 19"W x 35"H
   2. Finish: Dark Bronze Anodized
   3. Glass: 3/4" Clear Tempered unit + Low E (Solarban 70XL) for fixed & moving panel, sidelights and transom
   4. Arch PM to verify if heated or ambient air curtain is required per Tenant assignment.
      a. Heated Air Curtain: Model: AA300 (replaces transom)
      b. Ambient Air Curtain: Model: AA100 (split transom)
   5. Refer to exterior elevations (A300s) for direction of opening for ordering.

B. Alternate California Code Option

   1. ReadyAccess: Window 47-1/2" W x 35-3/4"H with double-split transom for air curtain and 10" and (2) sidelights at 28-1/4"W x 59-1/2"H; Complete Unit Size 104"W x 59-1/2"H
      a. Service Opening:15-1/4"W x 28"H, limited to meet CA code.
      b. Ambient Air Curtain, AA100, and relay switch kit included with the West Coast Window package.

   2. Quikserv Model: SS-4035-E-CHIPOTLE-CALI, same as above except as noted.
      a. Service Opening: 28"W x 15-3/8"H, limited to meet CA code.
      b. 'CHIPOTLE' package includes pre-wired ambient air curtain with relay to sync operation with window Model: QSK1025AA-BK. Air curtain mounts to transom.

C. Alternate Impact-Resistant and Florida Product Approved Option, Miami Dade Horizontal Bi-Parting Impact Slider

   1. Quikserv Model: BP-7241E-IP-CHIPOTLE, Complete Unit Size: 72"W x 41"H.
      a. Service Opening: 29-1/2"W x 27"H
      b. Rough Opening: 72-1/2"W x 41-1/2"H
      c. Glass: Impact Resistant Glass
      d. 'CHIPOTLE' package includes ambient air curtain
         i. Ambient Air Curtain: Model: QSK1025AA-BK, Part Number: 9345.
         ii. Do not mount directly to window, mount on wall above.
      e. Miami-Dade NOA #18-0814.02

2.3 Electrical Requirements

A. Quikserv Electrical Windows: 120V / 60 Hz, 20-amp branch circuit, single phase. Power supplied through base of window. Conforms to UL Standard 325 – Certified to CAN/CSA C22.2 NO. 247. Confirm with Electrical Drawings.

   1. Heated Air Curtain for Custom Side Sliding Window (Model: SS-4035-E-CHIPOTLE)
      a. Separate 208V circuit and Power Supply required for heated air curtain. Air curtain pre-wired through window frame with power supply routed to base of window. Confirm with Electrical Drawings.
   2. Ambient Air Curtain for Custom Side Sliding Window (Model: SS-4035-E-CHIPOTLE) and Alternate California Code Option: Model: SS-4035-E-CHIPOTLE-CALI
      a. Separate circuit not required. Window pre-wired to power relay to sync operation with air curtain.
   3. Ambient Air Curtain for Alternate Impact-Resistant and Florida Product Approved Option (Model: BP-7241E-IP-CHIPOTLE):
      a. Connect to main control board on window to power relay to synchronize operation with opening and closing of window.

B. ReadyAccess Electrical Windows: 115V / 60 Hz, 15-amp dedicated circuit required. Run power to header on fixed panel side.

   1. AA300 Heated Air Curtain
      a. Separate 208V /60 hz /40-amp single phase circuit required.
   2. AA100 Ambient Air Curtain (Standard and CA window)
      a. Separate 120V / 60hz / 15-amp single phase circuit required. Run power to center of window above header.

3.1 Installation

A. Install in accordance with manufacturer's instructions.
B. Install pass-thru windows plumb, level, square, true to line, and without warp or rack. Maintain dimensional tolerances and alignment with adjacent Work.
C. Install thermal isolation where components penetrate or disrupt building insulation. Pack fibrous insulation in shim spaces at perimeter of assembly to maintain continuity of thermal barrier.
D. Install pass-thru window components weathertight.
E. Anchor pass-thru windows securely in place to supports. Use attachment methods permitting adjustment for construction tolerances, irregularities, alignment, and expansion and contraction.
F. Separate aluminum from other metal surfaces with bituminous coatings or other means approved by Architect.
G. Coordinate installation of related sheet metal flashing as specified in Section 07 62 00 - Sheet Metal Flashing and Trim.
H. Install perimeter joint sealants as specified in Section 07 91 23 - Backer Rods.

NOT USED

SECTION 08710 - DOOR HARDWARE

1.1 General: Provide door hardware as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. ANSI A117.1-2009 Accessible and Usable Buildings and Facilities.
   2. ANSI/BHMA A156 Series Builders Hardware

B. Quality Assurance:
   1. Codes and standards: Provide hardware complying with local Building Code requirements and the Tenant's standards for keying and security systems.
   2. Project scheduling: Performed by an Architectural Hardware Consultant (AHC).
   3. Package each item of hardware and each lockset, complete with all screws, anchors, installation instructions and templates. Identify package indexing with corresponding item number of the hardware schedule.
   4. After hardware schedule acceptance, provide necessary templates or physical hardware to required trades for cutting, reinforcing, or preparing their products to receive hardware. Furnish templates to metal door manufacturer's.

2.1 Materials:

A. No substitutions allowed. Requirements for manufacturer, design, grade, function, finish, size and other distinctive qualities of each type of door hardware are indicated on the drawings.

B. Review the keying system with the Tenant and provide the type required.

3.1 Installation

A. Install each hardware item in strict accordance with manufacturer's installation instructions and recommendations. Securely fasten all attached parts. Fit faces of mortised parts snug and flush. Verify operating parts move freely and smoothly without binding or sticking, without excessive clearance.

B. Set units level, plumb and true to line and location. Adjust and reinforce attachment substrate as required for proper installation and operation. Drill and countersink units that are not factory prepared for anchorage fasteners. Space fasteners and anchors in accordance with industry standards.

C. Mount hardware units at heights indicated in DHI "Recommended Locations for Builders Hardware", unless otherwise required to comply with requirements of governing codes and regulations. Conform to ANSI A117.1 and ADAGG guidelines for accessibility.
   1. Top Butts: 5 inches; top of butt from head of frame.
   2. Middle Butts: 3'-2", centerline from finish floor.
   3. Bottom Butts: 5 inches; finish floor to bottom of butt.
   4. Locks: centerline from finish floor per hardware schedule.
   5. Knobs: 3'-2", centerline from finish floor.
   6. Pulls: centerline from finish floor per hardware schedule.
   7. Pushes: centerline from finish floor per hardware schedule.

SECTION 08800 - GLAZING

1.1 General: Provide glass and glazing as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. CPSC 16 CFR Part 1201 (1-91)"Safety Standard for Architectural Glazing Materials."
   2. GANA "Glazing Manual - 1990."

B. Quality Assurance:
   1. Codes and standards: Provide type of glass and glazing products that comply with ANSI Z97.1 and testing requirements of 16 CFR Part 1201 for category II materials. Comply with all applicable codes, standards and regulations that control safety glazing materials and installation.
   2. System Performance: Provide glass and glazing that has been produced, fabricated and installed to withstand normal thermal movement, wind loading and, where applicable, impact loading, without failure including loss or breakage of glass, failure of glazing sealants or gaskets to remain watertight and airtight, deterioration of glass and glazing materials and other defects in the work.
   3. Installation: Performed only by experienced glaziers.

C. Warranty:
   1. Insulating glass: Five years from date of installation against defects that materially obstruct vision through the glass or affect thermal and physical integrity.

2.1 Materials:

A. Glass:
   1. Float Glass (FG): 1/4" thick clear float glass.
   2. Tempered Glass (TG): 1/4" and 1/2" thick clear, tempered safety glass, free-of-tong marks.
   3. Insulating Glass (IGL): 1" thick clear, low-e tempered sealed glass; 1/4" thick interior and exterior glass lites with 1/2" aluminum desiccated dual sealed air space; with the following characteristics:
      a. Low-emissivity coating on #2 surface.
      b. Visible Light Transmittance - See sheet G004
      c. Visible Light Reflectance - Outdoors: 9%-11%
      d. Solar Energy Transmittance: 32%-34%
      e. Solar Energy Reflactance-Outdoors: 30%-34%
      f. U-Value - See sheet G004
      g. Solar Heat gain Coefficient: See sheet G004
      h. Shading Coefficient: 0.43-0.45
      i. Manufacturers/Products:
         i. AGC/Comfort Ti-AC40, or similar to meet code
         ii. Sun Guard/SN-68, or similar to meet code
         iii. PPG/Solarban 60, or similar to meet code
         iv. Viracon/VE1-2M, or similar to meet code
   4. Spandrel Glass (SG) 1/4" thick, Spandrel Ceramic Glass, (Color: GrayBlack or as noted on drawings) by Old Castle Building Envelope (419) 666-2000, Contact: Doug Dewar
   5. Frosted Window Film, 3M Dusted Crystal Translucent Window Film. Apply on the interior side of glazing.

B. Glazing Materials:
   1. Glazing Sealants: Provide elastomeric glazing sealants suitable for applications indicated; compatible with one another and with other materials they will contact, complying with ASTM C920.
   2. Glazing Tape: Provide preformed, non-staining and non-migrating elastomeric tape, as recommended by tape and glass manufacturers for application indicated, complying with ASTM C 1281.
   3. Glazing gaskets: Provide manufacturer's standard snap-on aluminum stops and neoprene, vinyl or EPDM glazing gaskets.
   4. Provide setting blocks, spacers and edge blocks of material, size, and shape complying with referenced glazing standard, and compatible with surfaces contacted in installation.

C. Fabrication: Factory fabricate and size all glass.

3.1 Installation

A. Preparation:
   1. Field verify measurements and conditions of installation.
   2. Examine all details. Provide proper fitting to details indicated.
   3. Glazing channel dimensions shown are intended to provide for necessary bite on glass, minimum edge clearance and adequate glazing materials thickness, with reasonable tolerances. Adjust as required by job conditions at time of installation.

B. Install glass and glazing in accordance with the GANA "Glazing Manual" and glass manufacturer's recommendations.
   1. Install insulating glass units to comply with recommendations by Sealed Insulating Glass Manufacturers Association (SIGMA).

C. Install setting blocks of proper size at quarter points of sill rabbet. Provide spacers as required.

D. Install glazing sealants, tapes and gaskets in accordance with manufacturer's recommendations. Set glass without springing and install securely to prevent rattling or breakage.

E. Protect glass from breakage during remaining construction. Do not remove non-permanent labels until final acceptance.

DIVISION 9 -- FINISHES

SECTION 09260 - GYPSUM BOARD SYSTEMS

1.1 General: Provide gypsum board systems as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. GA 214-90 "Levels of Gypsum Board Finish."
   2. GA-216 "Specifications for Application and Finishing of Gypsum Board."
   3. USG "SA923 Drywall/Steel Framed Systems."

2.1 Materials:

A. Manufacturer: United States Gypsum Co. (USG), (800) 874-4968, internet www.usg.com.

B. Metal framing: Comply with ASTM C 754 and ASTM C 645 for materials and sizes.
   1. Partition metal framing:
      a. Studs: Galvanized steel, C-shaped, sizes indicated, 20 gage "ST20"
      b. Runners: Match studs, type recommended by stud manufacturer for floor and ceiling support of studs. Provide flexible ceiling runners for full height metal stud framed partitions continuous from floor to underside of structural members or deck above.

C. Ceiling and Soffit metal framing/suspension systems:
   1. Small areas: Metal stud framing of appropriate size and gage for spans indicated.
   2. Large areas: Furring channel "Grillage" or "Direct Suspension System" designed for concealed support of gypsum board ceilings, of proper type for use indicated.
   3. Furring members: 20 gage, galvanized steel screw type, hat-shaped furring.

D. Gypsum board panels: USG "Sheetrock" complying with ASTM C1396, tapered edge face panels, 48" wide, in maximum lengths available to minimize end joint conditions, 5/8" thick.
   1. General use panels: Sheetrock Regular panels.
   2. Fire rated panels: Sheetrock Firecode Core panels.
   3. Water-resistant: panels: Sheetrock HUMITEK panels.

E. Cement board: USG DUROCK Cement Board, 5/8" thick x manufacturer's standard width, complying with ANSI A118.9, and in maximum lengths available to minimize end-to-end butt joints.

F. Fasteners: USG Type "S" bugle head screws for metal framing, USG Type "W" bugle head screws for wood framing, manufacturer's recommended length for panel thickness indicated.

G. Trim: Galvanized steel with knurled and perforated flanges. USG Dur-A-Bead corner bead, No. 200B casing bead metal trim, No. 093 Control Joint.

H. Joint treatment: USG Joint Treatment System, utilizing "Sheetrock Brand Joint Tape", and "Sheetrock Brand Setting-Type (DURABOND)" compound for tape bedding and topping.

I. Adhesives: USG "Sheetrock Brand Setting-Type (DURABOND) 210 or 90" compound for tape bedding and topping.

J. Acoustical sealant: USG Sheetrock Acoustical Sealant, water-base type, gunnable sealant for sealing sound-rated gypsum board systems.

K. Sound attenuation insulation: USG Thermafiber unfaced 3-1/2" thick, mineral fiber insulating batts/blankets; standard lengths and widths required to coordinate with spaces insulated.

3.1 Installation

A. Install metal wall and partition framing and ceiling suspension/ support systems in accordance with USG Bulletin SA 923 and complying with ASTM C754.
   1. Ceiling suspension/ support systems: Metal furring system/direct suspension or steel stud framing system.
   2. Wall and partition framing:
      a. Install steel studs per schedule or at spacing indicated with bottom and top runner tracks anchored to substrates. Provide flexible ceiling runner tracks at full height partitions.
      b. Terminate partition stud system 4" above ceilings, except where indicated to be extended to structural support or roof deck above. Brace tops of partition framing to structure or roof deck at maximum 4'-0" on center spacing.
      c. Frame openings more than 2'-0" wide with two 20 gage studs at each jamb.
      d. Coordinate the installation of supplementary blocking and nailers, provided under Section 06100 work, to support shelving, millwork, toilet accessories, and similar work that cannot be adequately supported by gypsum board alone.

B. Application and Finishing: Install and finish gypsum board to comply with ASTM C 840 and Gypsum Association GA 216 "Recommended Specifications for the Application and Finishing of Gypsum Board."
   1. Screw fasten all gypsum board panels.
   2. Metal Trim: Install metal corner beads at external corners of gypsum board work and metal trim wherever edge of gypsum board would be exposed. Use longest practical lengths.
   3. Control Joints: Locate and install control joints in accordance with USG Bulletin SA923 "Good Design Practice" recommendations.

C. Acoustical Treatment:
   1. Where sound-attenuation insulation is indicated, seal gypsum board construction at perimeters, control joints, junction boxes, openings and penetrations with a continuous bead of acoustical sealant including a bead at both faces of partitions.
   2. Install sound attenuation insulation at scheduled partitions and ceilings. Install insulation in single layer of required thickness. Extend full thickness over entire area to be insulated. Cut and fit tight around obstructions. Fill all voids.
   3. At openings and cutouts, fill open spaces between edges of gypsum board and fixtures, cabinets, ducts, and other flush or penetrating items, with continuous bead of acoustical sealant.
   4. Seal sides and backs of electrical boxes to completely close up openings and joints with a bead of acoustical treatment.

D. Finishing:
   1. Comply with manufacturer's instructions for mixing, handling, and application of materials. Apply treatment at joints both directions, at flanges of trim accessories, penetrations of gypsum board (electrical boxes, piping, and similar work), fastener heads, surface defects, and elsewhere as indicated. Apply in manner that will result in each of these items being concealed when applied decoration has been completed.
   2. Apply joint tape at joints between gypsum boards, except where trim accessories are indicated.
   3. Interior Exposed Gypsum Board Finish: Level 5 Finish.
      a. Locations: Typical for all walls and ceilings, unless otherwise indicated
      b. Finish interior gypsum board by applying the following joint compounds in four coats (not including prefill of openings in base), and sand between coats and after last coat:
      c. Embedding and First Coat: Setting-type joint or taping compound.
      d. Fill (Second) Coat: Setting-type topping compound.
      e. Fill (Third) Coat: Setting-type topping compound.
      f. Finish (Fourth) Coat: Skim coat entire surface.

   4. Interior Concealed Gypsum Board: Level 3 Partial Finishing.
      a. Finish concealed gypsum board construction that requires finishing same as exposed gypsum board construction, except the third coat and sanding can be omitted.

E. Cement Board: Install cement board as a 16" high base at all kitchen and kitchen cook line wall types as indicated on drawings.

SECTION 092816 - GLASS-MAT FACED GYPSUM BACKING BOARDS

1.1 General: Provide Fiberglass-mat faced, moisture resistant gypsum backer board as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. ASTM C840 Standard Specification for Application and Finishing of Gypsum Board.
   2. ASTM C1002 Standard Specifiation for Steel Self Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs
   3. ASTM C1178 Standard Specification for Glass Mat Water-Resistant Gypsum Backing Panel
   4. ASTM D3273 Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber
   5. ASTM D6329 Standard Guide for Developing Methodology for Evaluating the Ability of Indoor Materials to Support Microbial Growth Using Static Environmental Chambers.
   6. ASTM E96 Standard Test Methods for Water Vapor Transmision of Materials
   7. Tile Council of North America, Inc. (TCNA): TCA Handbook for Ceramic Tile Installation, Current Edition.

2.1 Materials:

A. Manufacturer: Georgia-Pacific Gypsum LLC, (800) 225-6119, internet: www.buildgp.com

B. Fiberglass-Mat Faced Gypsum Backing Board: DensShield Fireguard Tile Backing Board complying with ASTM C1178, Type X, Square edges, 4' wide in maximum lengths available to minimize end joint conditions, 5/8" thick. Surfacing: Coated fiberglass mat on face, back and long edges.
   1. General use panels: 5/8" DensShield Fireguard Tile Backer, Georgia-Pacific Gypsum.

C. Fasteners: Screws meeting ASTM C1002, with corrosion resistant treatment. Size and type per manufactuer's recommendations:
   1. Walls (Steel Frame): Bungle head, fine thread, sharp point rust resistant drywall screw
   2. Walls (Walls Frame): Bungle head, coarse thread, sharp point rust resistant screw

D. Metal Framing, Trim, joint treatment, adhesives, acoustical sealant, and sound attenuation insulation: Refer to Section 09260 Gypsum Board Systems

3.1 Installation

A. Install DenShield at all tile walls excluding hood area as indicated on drawings.

B. General: Install in accordance with ASTM C840, manufacturer's recommendations and TCA Handbook for Ceramic Tile Installation.
   1. Manufacturers Recommendations: refer to Current "Product Catalog", Georgia Pacific Gypsum.
      a. Attach DensShield Tile Backer with grey side facing the interior. Tile should be applied on the grey coated side of DensShield Tile Backer. Cut panel to required size and make cutouts. Fit ends and dges closely. Do not leave gaps between panels.
      b. DensShield Tile Backer may be cut by using a utility knife to score, then snap, working from the grey face side.
      c. For walls, when used as a tile substrate a minimum 20-gauge steel or wood framing should be spaced no greater than 24" o.c. for 5/8" DensShield Tile Backer. Board can be applied horizontally or vertically.
      d. Fasteners shall be spaced 6" o.c. for walls for wood and steel framing. Do not countersink. Drive fasteners flush with grey coated surface. See manufacturer installation Fastener Guide for proper selection.
      e. In all corners, imbed with a bead of flexible sealant when installing panels into corner. Apply self-adhesive 2" wide fiberglass mesh tape and bed tape on all joints and corners with material used to set tiles.
      f. Caulk or seal fixture/plumbing penetrations and abutments to dissimilar materials.
      g. Do not use all purpose joint compound or tape in wet areas.
      h. Do not apply DensShield Tile Backer directly to concrete or masonry block. Framing or furring of the walls is necessary.
      i. DensShield Tile Backer should not be used for exterior installations.
      j. DensShield Tile Backer panels should not be used as a base for nailing and mechanical fastening.
      k. DensShield Tile Backer has a built in moisture barrier. Never install vapor retarders directly behind DensShield Tile Backer panels. In retrofit applications, some paints or other wall coverings may constitute a vapor barrier; remove or effectively penetrate these coverings prior to installing DensShield Tile Backer panels.

C. Refer to Section 09260 Gypsum Board Systems for additional installation and sound treatment instructions

SECTION 09330 - QUARRY TILE

1.1 General: Provide quarry tile flooring and base as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. ANSI A137.1 "Ceramic Tile."
   2. TCA "Handbook for Ceramic Tile Installation."

2.1 Materials:

A. Manufacturers:
   1. Quarry Tile: Daltile, (877) 556-5728, internet: http://daltile.com
      a. For ordering purposes, email all orders to chipotle@daltile.com
   2. Waterproofing, Setting and Grouting Materials:
      a. Setting and Grouting Materials and Tile Base Membrane: Mapei
         i. For ordering purposes, email all orders to chipotle@daltile.com
         ii. For technical questions, contact Mapei, (800) 992-6273, internet: www.mapei.com

B. Quarry Tile: Daltile 6" x 6" x 1/2" Quarry Textures with 5" base as scheduled on finish plan and appropriate trim; Color: "Ashen Gray" 0T03
   1. Entire Kitchen Area: Provide non-abrasive finish quarry tile.
   2. Rest Rooms: Provide non-abrasive finish quarry tile.
   3. Outside Corner Cove Base (Kitchen): #QC-(L or R)-3565 5" x 6"
   4. Inside Corner Cove Base: #QB-3565 1" x 5"
   5. Bullnose Coveless Base: #Q-1665, 6" x 6"
   6. Bullnose Corner Coveless Base: #QCRL-1665, 6" x 6"

C. Waterproofing for elevated floor slabs: Mapei, Mapelastic AquaDefense, Premium Waterproofing and Crack Isolation Membrane
D. Setting Adhesive: Mapei, Ultraflex 3, Color: Gray
E. Grout: Mapei, Kerapoxy IEG CQ, Color: #9, "Gray", 1/4" grout joints.
F. Quarry Tile Base Membrane: Mapei, Mapelastic AquaDefense, Premium Waterproofing and Crack Isolation Membrane

3.1 Installation

A. Preparation: Clean substrate surfaces, scheduled to receive quarry tile, thoroughly and remove all coatings that may impair bond.
   1. Center tile fields both directions in each floor area. Adjust layout to minimize tile cutting. Avoid tile less than one-half size. Locate cuts to be least conspicuous.
   2. Maintain units uniformly "in plane." Provide straight, uniform joint widths and grout lines.

B. Elevated Floor Slabs: Install waterproofing membrane at elevated floor slab surfaces scheduled to receive quarry tile floor finish. Install membrane materials in accordance with manufacturer's installation instructions to produce a waterproof membrane of uniform minimum 30 mil thickness bonded securely to substrate.
   1. Extend waterproofing up vertical wall surfaces minimum 10" high.
   2. Extend membrane down into floor drain flanges to assure continuous waterproofing at drainage points.

C. Wet Areas: Install waterproofing membrane at all quarry tile wall base. Install membrane materials in accordance with manufacturer's installation instructions to produce a waterproof membrane of uniform minimum 30 mil thickness bonded securely to substrate.
   1. Extend waterproofing up all vertical wall surfaces receiving quarry tile base minimum 10" high. Extend waterproofing membrane 10" minimum horizontally from all vertical wall surfaces receiving quarry tile base.

D. Installation: Install, grout and clean ceramic tile in accordance with referenced TCA installation details and ANSI standard specifications for setting methods scheduled.
   1. Floors: Latex-portland cement mortar on concrete; TCA detail F113 and ANSI A108.5, grout ANSI A108.10.
   2. Base: Latex-portland cement mortar on cement board.

SECTION 09340 - CERAMIC TILE

1.1 General: Provide ceramic wall tile as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. ANSI A137.1 "Ceramic Tile."
   2. TCA "Handbook for Ceramic Tile Installation."

2.1 Materials:

A. Manufacturers:
   1. Ceramic Tile and Accent Tile: Daltile, P: (877) 556-5728, internet: http://daltile.com
      a. For ordering purposes, email all orders to chipotle@daltile.com

B. Ceramic Tile:
   1. Kitchen Tile, or as noted in plans, Series - Finish Line Glazed Ceramic Tile:
      a. Color - White FL90, Semi-Gloss, Size - 4 x 16, Pattern - Stacked Bond
   2. Accent Tile, Series - Color Wheel Glazed Ceramic
      a. Alternate Accent Tile only when approved by Arch PM and Chipotle DM
         i. Series - Remedy, Color - Alchemy RD25, Size - 2 x 9, Pattern - Stacked Bond
         ii. Series - Marrazzi, Color - Artesen AT25, Size - 2 x 4, Pattern - Brickjoint Mosaic

C. Setting Adhesive: Thinset Mortar, Mapei, Ultraflex LFT - Gray

D. Grout:
   1. Kitchen Tile or as noted in plans
      a. Mapei, Series - Flexcolor CQ - Gray #5009, 1/8" grout joints.
   2. Accent Tile
      a. Mapei, Series - Flexcolor CQ - Chocolate #5007, 1/8" grout joints.

3.1 Installation

A. Preparation: Clean substrate surfaces scheduled to receive ceramic tile thoroughly and remove all coatings that may impair bond.
   1. Protect surrounding work from damage.
   2. Remove any curing compounds or other contaminates.
   3. Vacuum clean surfaces and damp clean.
   4. Install cementitious backer board or glass-mat faced gypsum backing board as indicated in drawings in accordance with ANSI A108.11 and board manufacturer's instructions. Tape joints and corners, cover with skim coat of dry-set mortar to a feather edge.
   5. Prepare substrate surfaces for adhesive installation in accordance with adhesive manufacturer's instructions.

B. Kitchen:
   1. Install, grout and clean ceramic tile in accordance with referenced TCA installation details and ANSI standard specifications for setting methods scheduled.
   2. Lay tile in horizontal stack bond, following detail drawings for layout considerations. Horizontal rows of tile shall be full-height courses, unless noted otherwise.
   3. Arrange pattern so that a full tile or joint is centered on each wall horizontally and that no tile less than 1/2 width is used at the ends of the wall. Exception: when one end of the wall is a tile-to-gypsum board transition. Do not interrupt tile pattern through openings.
   4. Use specified stainless steel corner guards at tile-to-tile and tile-to-FRP outside corners.
   5. Use corner bead of 100% silicone sealant, color to match grout, at inside corners where tile meets tile.
   6. Use corner bead of 100% silicone sealant, white, at inside corners where tile meets paint gyp. board, tile meets FRP or tile meets aluminum.
   7. Cut and fit tile to penetrations through tile, leaving sealant joint space. Place tile joints uniform in width, subject to variance in tolerance allowed in tile size. Make joints watertight, without voids, cracks, escess mortar, or excess grout.
   8. Sound tile after setting. Replace hollow sounding units.
   9. Keep expansion joints free of adhesive or grout. Allow tile to set for a minimum of 48 hours prior to grouting. Apply sealant to junction of tile and dissimilar materials and junction of dissimilar planes. Refer to section 07900 Joint Sealers.
   10. Clean tile and grout surfaces.

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

ARCHITECTURAL SPECIFICATIONS

G015

SECTION 09510 - SUSPENDED CEILING SYSTEMS

1.1 General: Provide acoustical ceiling systems as shown and specified.

A. Standards: Materials and installation shall conform to the following:
1. CISCA "Acoustical Ceilings - Use and Practice."
2. ASTM C635.
3. ASTM C636.

B. Related Sections:
1. 09515 Cementitious Wood Fiber Acoustical Panels: Suspension system.

2.1 Materials:

A. Manufacturer:
1. USG Interiors, Inc., (800) 950-3839, www.usg.com
2. Pittcon Industries, (800) 637-7638, www.pittconindustries.com

B. Ceiling Panels: USG "Sheetrock Lay-In ClimaPlus No. 3270" ceiling panels with white, stipple texture, vinyl facing, 24" x 48" x 1/2".

C. Light Pocket: Pittcon "LP-700-800", White, Height of cove should be field verified by GC to end on a full tile height.
1. Light pocket can have up to 6 week lead time and should be ordered as soon as possible.
2. Light pocket endcap should only be installed when the end of the cove is not against a wall.

D. Suspension System: Provide intermediate duty, structural class, direct hung systems adequate to support light fixtures, ceiling diffusers and other normal accessories.
1. Exposed "Tee" Grid System for use with Lay-In Ceiling panels: USG "Donn DX System" non-fire rated with 15/16" exposed face, cold-rolled galvanized steel with aluminum face cap, white paint finish on exposed surfaces. Provide hemmed edge aluminum wall angles, 15/16" exposed leg, white paint finish matching exposed grid.
2. Concealed "Tee" Grid System for use with Painted Gypsum Board Ceilings & Soffits or with Cementitious Wood Fiber Acoustical Panels (Tectum): USG "DGLW" Heavy Duty Drywall Suspension System with 1 5/8" deep by 1 1/2" wide main tees and 1 1/2" deep by 1 1/2" wide cross tees.
3. Hanger Wire: No. 12 SWG galvanized steel wire.
4. Heavy Duty "Tee" Grid System for use with Felt Baffle Ceiling System: USG Donn Brand DX/DXL with 15/16" wide face tees, color: black

3.1 Installation

A. Install acoustical ceiling materials and suspension systems in strict accordance with manufacturer's recommendations, complying with governing regulations and industry standards applicable to the work.

B. Suspension system installation shall be laser leveled with a maximum surface leveling tolerance of 1/8" in 12'-0".

C. Install exposed Tee suspension systems with main tees nominally 12 ft long spaced 48 in O.C. and cross tees nominally 4 feet long spaced 24 in O.C.

D. Install concealed Tee suspension systems with main tees nominally 12 ft long spaced 24 inches O.C. and cross tees nominally 2 ft long spaced 48 in O.C.

E. Hanger wire shall be spaced 48" O.C. along main tees, at all four corners of light fixtures (where applicable), at midpoint of cross tees adjacent to light fixtures and duct outlets, and adjacent to main tee splices.

F. Secure wire hangers by looping and wire-tying either directly to building structure or to hangers that are secure and appropriate for substrate.

G. Provide edge trim molding at perimeter of acoustical ceiling installation and intermediate vertical surfaces. Use maximum lengths. Miter trim corners to Provide tight, accurate joints. Connect moldings securely to substrate surfaces.

SECTION 09653 - RUBBER WALL BASE

1.1 General: Provide resilient rubber wall base as shown and specified.

A. Standards: Materials and installation shall conform to the following:
1. ASTM D 2240 Rubber - 85 Shore A

2.1 Materials:

A. Manufacturer: Johnsonite, Inc., (800) 899-8916, internet: www.johnsonite.com
1. Basis-of-Design Product Rubber Wall Base:
a. Resilient Rubber:
1. .125" (3.17 mm) Thickness
2. "Black" color
3. Straight (toeless) or coved as specified on finish plan
4. Inside and outside corners with 4" returns.

B. Alternate Wall Base only when approved by Arch PM and Chipotle DM.
1. Vinyl Wall Base
a. .125" (3.17 mm) Thickness
b. "Black" color
c. Straight (toeless) or coved as specified on finish plan
d. Inside and outside corners with 4" returns.

C. Setting Adhesive
1. For porous surface applications: Johnsonite 960 Acrylic Cove Base Adhesive
2. For non-porous surface applications: Johnsonite 946 Contact Bond Adhesive or polymer based alternative

3.1 Installation:

A. Preparation: Clean substrate surfaces scheduled to receive resilient rubber and vinyl wall base thoroughly and remove all coatings that may impair bond. A uniform temperature of at least 65 degrees Fahrenheit shall be maintained for 24 hours before, during and after the installation is completed. The wall base and adhesives shall be conditioned in the same manner. Coiled wall base shall be uncoiled and lay flat for at least 24 hours at 65 degrees Fahrenheit prior to installation. Floor and walls shall be clean, dry, and free of dust, all paints, wallpaper, and all other foreign material, which may affect proper adhesive bonding. Wall base may be installed on interior plaster, gypsum wall board, concrete, masonry, mineral-reinforced cement board or similar porous surfaces. Wall base shall not be installed on surfaces that will be exposed to drastic temperature changes or moisture.

B. Application: Use a 1/8" square notch trowel to apply adhesive. Allow adhesive to set up and then apply wall base in accordance with manufacturer's instructions.

SECTION 09770 - SPECIAL WALL SURFACING - PHENOLIC INTERIOR WALL PANELS

1.1 General: Provide Stonewood solid phenolic panels and accessories for interior walls and millwork as shown and specified.

1.2 Related Sections:

A. Section 05400 - Cold Formed Metal Framing

B. Section 06210 - Finish Carpentry and Millwork

C. Section 07900 - Joint Sealers

D. Section 09260 - Gypsum Board Systems

1.3 Standards: Materials and construction shall conform to the following:

A. ASTM D638 - 10 Standard Test Method for Tensile Properties of Plastics.

B. ASTM D790 - 10 Standard Test Methods for Flexural Properties of Unreinforced and Reinforced Plastics and Electrical Insulating Materials.

C. ASTM E84 - 12 Standard Test Method for Surface Burning Characteristics of Building Materials.

D. NEMA Standards Publication LD3-2005. High pressure decorative laminates.

1.4 Design/Performance Requirements:

A. Design and size of wall panel assemblies including wall panels, mounting system to support weight of panels.

B. Allow for thermal movements from ambient and surface temperature changes by preventing buckling, opening of joints, overstressing of components, failure of joint sealants, failure of connections, and other detrimental effects. Base calculations on expected movement of material as defined in fabrication guidelines.

1.5 Quality Assurance:

A. Manufacturer's Qualifications:
1. Sufficient plant facilities to provide quality and quantity of materials as required without delaying progress of work.
2. Minimum of 40 years of experience in paper saturation of phenolic resin, and producing phenolic paper laminate.

B. Fabricator:
1. Fabricated by the manufacturer, and/or;
2. Contracted by the customer, minimum 5 years' experience in fabrication work for the size and complexity of the projects.

C. Installer
1. Proven professional installer with a minimum of 5 years of documented experience.
2. Approved by the manufacturer.

1.6 Delivery, Storage and Handling:

A. Refer to Section 01400 Quality Requirements.

B. Delivery: Deliver materials in manufacturer's original unopened containers/packages, with labels clearly identifying product name, manufacturer, color/texture and weight.

C. Storage:
1. Keep panels dry and stored indoors in original packaging until installation.
2. Store Stonewood panels on a smooth, dry, flat surface, making sure there are no bends or bowing in the load.
3. Do not store directly on cold concrete floors as moisture may migrate.
4. Do not store under heating units or air conditioning units.
5. Keep load stored within outer wrap until use. Remove pallet straps once load is moved to storage area.
6. Reseal plastic wrap if partial load is used.
7. Keep foam dividers in place.

D. Handling:
1. Handle materials in accordance with manufacturer's instructions.
2. Protect materials during handling to prevent damage.
3. When moving sheets, lift evenly to avoid dragging panels across each other and scratching the surface. PLEASE TAKE CARE NOT TO SCRATCH THE SURFACE OF THE PANEL DURING HANDLING, MACHINING AND INSTALLATION.

1.7 Warranty:

A. Limited Warranty: Fibbers warrants Stonewood for a period of 10 years. Refer to www.stonewoodpanels.com for details.

1.8 Project Conditions:

A. Environmental Limitations: Buildings are to be fully enclosed prior to installation with sufficient heat (70 degrees) and ventilation consistent with good working conditions for finish work.

B. Maintain environmental conditions (temperature, humidity, and ventilation) within limits recommended by manufacturer for optimum results. Do not install products under environmental conditions outside manufacturer's absolute limits.

C. Field Measurements: Verify locations of structural members and wall opening dimensions by field measurements before composite wall panel fabrication and indicate field measurements on Shop Drawings.

2.1 Manufacturer:

A. Fiberesin Industries, Inc. PO Box 808, Oconomowoc, WI 53066. Phone: (262) 567-4427, Fax: (262) 567-4814, Web Site: www.stonewoodpanels.com Email: info@fiberesin.com

B. Made in the United States from materials sourced in the USA.

2.2 Application:

A. Apply Solid Phenolic Laminate Wall Panels at walls and other surfaces as indicated on the Drawings. Phenolic Wall Panels are architectural wall panels applied over a sheathed stud wall or other solid blocking per Drawings.

2.3 Interior Stonewood:

A. Material: Solid phenolic laminate panel w/o overlay.
B. Color: Black ND
C. Finish: Matte
D. Standard Size: 48"x96", fabricator to trim height to 47"
E. Panel Thickness: 5/16", 1/2"
F. Panel Core: HR Black

2.4 Minimum Material Properties

A. NEMA Requirements:

Description	NEMA Requirements	
Dimensional Change:	3.11	
Length (Machine Direction)	0.3% Maximum	0.25%
Width (Cross Direction)	0.7% Maximum	0.50%
Density (PCF)	82	

B. Mechanical Properties:

Property	NEMA Requirements	
Flexural Strength ASTM D-790		
MD (psi)	18,000	20,000
CD (psi)	12,000	16,000
Flexural Modulus ASTM D-790		
MD (psi)	1.6x10^6	2.0 x10^6
CD (psi)	1.4x10^6	1.5x10^6
Tensile Modulus ASTM D-638		
MD (psi)	18,000	18,000
CD (psi)	12,000	13,000

C. Fire Resistance:

	Class A (0.250")	Class B (0.250")
Flame Spread Index - ASTM E-84 (BLDG):	5	30
Smoke Developed Values - ASTM E-84 (BLDG):	5	105
Fire Rating (Standard Product is Class B):	A	B

D. Manufacturing Tolerance:

Thickness (.156 to .375)	+/- .020
Thickness (above .375 to 1.000)	+/- .030
CNC Shaped Size (Length - Width)	+/- .020
Drill Diameter	+/- .003
Drill Depth	+/- .020
CNC Hole to Hole	+/- .020
CNC Hole to Edge (1 Oper)	+/- .020
CNC Hole to Edge (2 Oper)	+/- .030
Routing - (Slots Width and Length)	+/- .015
Routing - (Slots Depth)	+/- .020

2.5 Accessories (Fasteners):

A. Panel Fasteners: #10 x 1-1/4" flat phillips head black oxide wood screws to be used with wood blocking and #10 x 1-1/4" flat phillips head black oxide sheet metal screws to be used with sheet metal blocking as recommended by the manufacturer.
B. Provide exposed fasteners with heads matching color of composite wall panels by means of factory-applied coating.
C. Fasteners shall by designed to withstand effects of dead load and accommodate hydrothermal expansion/contraction of panel.
D. Wall Panel Accessories: Provide components required for a complete composite wall panel assembly including trim, flashings, sealants, gaskets, fillers, closure strips, and similar items. Match material and finish of composite wall panels unless otherwise indicated.

3.1 Manufacturer's Execution Instructions:

A. Compliance: Comply with manufacturer's/fabricator's/supplier's product data, handling and installation instruction/manual, shop drawings, shipping container/package ticket identification, etc.

3.2 Examination:

A. Verify correct panels received including dimension, tolerance, color/texture.
B. Verify correct attachment system received for the specific project/job.
C. Verify all the documents including shop drawing and installation guidelines.
D. Verify installation conditions are satisfactory to receive work of this section before the commencement
E. Verify substrate installation is complete, flat, and true to plane.
F. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.3 Preparation:

A. Field Measurements: Verify prior to fabrication and installation of the cladding panel.
B. Protect surrounding areas and surfaces to preclude damage during work of this section.
C. Lay out work before beginning installation as necessary for true, plumb and aligned panel installations.
D. Verify locations of joints and panel lengths.

3.4 Installation:

A. Conform to manufacturer's instructions and provisions of shop drawings.
B. Install to allow hydro-thermal expansion/contraction.
C. Use appropriate techniques/tools to work with the panel.
D. Do not force to fit, do not bend, stretch/compress.
E. Make cutting and fitting neat, square, and true. Where required cut, de-burr edges, and clean filings from adjacent surfaces.
F. Do not install damaged or questionable panels.
G. Install solid phenolic wall panels plumb and level and accurately spaced.
H. Anchor panels and other components of the work securely in place, with provisions for thermal and structural movement.
I. Shim or otherwise plumb substrates receiving composite wall panels.
J. Do not use construction adhesives to apply wall panels directly to substrates or wall board. Use mechanical fasteners only.

3.5 Erection Tolerances:

A. Shim and align composite wall panel units within installed tolerance of 1/4 inch in 20 feet, non-accumulative, on level, plumb, and location lines as indicated and within 1/8 inch offset of adjoining faces and of alignment of matching profiles.

3.6 Field Quality Control:

A. Manufacturer's Field Service: Provide field services to ensure product installation is in accordance with manufacturer's/fabricator's /supplier's instructions and installation manual, shop drawings etc.

3.7 Adjusting:

A. Correct identified defects and irregularities.
B. Replace damaged soiled, and discolored work.

3.8 Cleaning:

A. Leave installation clean and free from residue and debris from work of this Section.
B. Panels best cleaned with warm soapy water and rinsed with clear water; allowed to dry fully.

SECTION 09900 - PAINTS AND COATINGS

1.1 General: Provide paints and coatings as shown and specified.

A. Provide surface preparation, prime, intermediate and finish coatings for interior and exterior and existing scheduled surfaces and items.

B. Provide Tenant-selected finishes and colors for all exposed surfaces, unless otherwise indicated.

1.2 Related Documents:

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this section.

1.3 Summary:

A. This section includes surface preparation and field painting of the following:
1. Exposed exterior items and surfaces.
2. Exposed interior items and surfaces.
3. Surface preparation, priming, and finish coats specified in this Section are in addition to shop priming and surface treatment specified in other Sections.

1.4 Quality Assurance:

A. Applicator Qualifications: Engage an experienced applicator that has completed painting system applications similar in material and extent to that indicated for this Project with a record of successful in-service performance.

B. Source Limitations: Obtain block fillers, primers and undercoat materials for each coating system from the same manufacturer as the finish coats.

C. Provide lead free prime and finish coatings. All top coatings shall be mold and mildew resistant.

1.5 Delivery, Storage and Handling:

A. Deliver materials to the Project Site in manufacturer's original, unopened packages and containers bearing manufacturer's name and label, and the following information:
1. Product name or tile of material.
2. Product description (generic classification or binder type).
3. Manufacturer's stock number and date of manufacture.
4. Contents by volume, for pigment and vehicle constituents.
5. Thinning instructions.
6. Application instructions.
7. Color name and number.
8. VOC content

B. Store materials not in use in tightly covered containers in a well-ventilated area at a minimum ambient temperature of 45 degrees F (7 degrees C). Maintain containers used in storage in a clean condition, free of foreign materials and residue.
1. Protect from freezing. Keep storage area neat and orderly. Remove oily rags and waste daily. Take necessary measures to ensure that workers and work areas are protected from fire and health hazards resulting from handling, mixing and application.

1.6 Project Conditions

A. Apply water-based paints only when the temperatures of surfaces to be painted and surrounding air temperatures are between 50 and 90 degrees F (10 and 32 degrees C) unless otherwise stated on the technical data bulletin.

B. Apply solvent-thinned paints only when the temperature of surfaces to be painted and surrounding air temperatures are between 45 and 95 degrees F (7.2 and 35 degrees C).

C. Do not apply paint in snow, rain, fog, or mist, or when the relative humidity exceeds 85 percent, or at temperatures less than 5 degrees F (3 degrees C) above the dew point, or to damp or wet surfaces.
1. Painting may continue during inclement weather if surfaces and areas to be painted are enclosed and heated within temperature limits specified by manufacturer during application and drying periods.

2.1 Manufacturers:

A. Products: Subject to compliance with requirements, provide one of the products in the paint schedules.

B. Manufacturers Names: The following manufacturer is referred to in the paint schedule by use of shortened versions of the name, which is shown below:
1. PPG Industries, Inc.
2. Materials - No substitutions allowed.

2.2 Paint Materials, General

A. Material Compatibility: Provide block fillers, primers, undercoats, and finish-coat materials that are compatible with one another and the substrates indicated under conditions of service and application, as demonstrated by manufacturer based on testing and field experience.

B. Material Quality: Provide manufacturer's best-quality "professional" paint material of the various coating types specified. Paint-material containers not displaying manufacturer's product identification will not be acceptable.

Colors: Color guided selected by owner and will be strictly adhered too, unless otherwise noted.

C. Exterior Coatings:

Exterior Ferrous Metals:

Preparation: Remove all visible oil, grease, soil, rust and all other soluble contaminates from steel surface. Uniformly roughen surface with 150-grit paper. Remove all dust before solvent cleaning by the use of stiff bristle brush.
Prime: (1) coat PPG; 4020PF Series Pitt-Tech Plus Int/Ext DTM Acrylic Industrial Primer (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.
Finish: (2) coats PPG; 4216 Plus HP Series Pitt-Tech Plus Semi-Gloss DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.
Application: Conventional or HVLP (high volume low pressure)

Exterior and Interior Gas Piping:

Preparation: Remove all visible oil, grease, soil, rust and all other soluble contaminates from pipe surface. Remove all dust before solvent cleaning by the use of stiff bristle brush.
Prime: (1) Coat PPG; 4020PF Series Pitt-Tech Plus Int/Ext DTM Acrylic Industrial Primer (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.
Finish: (2) Coats PPG; 4216 Plus HP Series Pitt-Tech Plus Semi-Gloss DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils
Application: Conventional or HVLP (high volume low pressure)

Exterior Patio Railing:

Preparation: Remove all visible oil, grease, soil, loose paint, rust and all other soluble contaminates from steel surface. Remove all dust before solvent cleaning SSPC-SP1 by the use of stiff bristle brush. SSPC-SP3 may be required as a more aggressive preparation to remove loose mill scale, loose rust, loose paint and other loose detrimental foreign matter from the surface. Performance is better with more aggressive preparation.
Prime: (1) coat PPG; 95-3300 Durathane DTM Urethane Mastic (250 g/L VOC): Applied at a dry film thickness of not less than 3.0 to 5.0 mils.
Finish: (1) coat PPG; 95-3300 Durathane DTM Urethane Mastic (250 g/L VOC): Applied at a dry film thickness of not less than 3.0 to 5.0 mils.
Application: Conventional or HVLP (high volume low pressure) be done with conventional spray or airless equipment or brush or roller.

Exterior Prefinished Metal Wall Panels:

Preparation: Before applying primer or other surface treatments, clean galvanized metal surface to SSPC-SP1 that could impair bond of the various coatings. Remove oil, grease and soap film before priming use of Krud Kutter Metal Clean & Etch may be required on bare or new galvanized. Surface must be clean, dry and free of contaminants, including salt deposits. Additional prep may be needed to SSPC-SP2. Schedule cleaning and painting so dust and other contaminants from the cleaning process will not fall on wet, newly painted surfaces.

Note: Some selected areas of bare concrete surfaces will require (1) coat of Perma Crete 4-603XI Alkali Resistant Concrete Primer before steel installation over all concrete surfaces.

Owner Option 1:
Prime: (1) coat XIM Primer Bond - Applied at a dry film thickness of not less than 1.5 to 2.0 mils.
Finish: (2) coats PPG; 90-1110 Series Pitt-Tech Satin DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 2:
Prime: (1) coat PPG; 97-245 Pitt-Guard DTR Epoxy Mastic Primer (263 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 7.0 mils.
Finish: (2) coats PPG; 95-3300 Durathane Urethane Mastic (240 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 3 (Low VOC):
Prime: (1) coat PPG; Amerlock 2 Fast Dry VOC Compliant Epoxy (84 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 6.0 mils.
Finish: (2) coats PPG; Amershield VOC Aliphatic Urethane (84 g/L VOC): Applied at a dry film thickness of not less than 5.0 to 8.0 mils.

Application: Conventional or HVLP (high volume low pressure) be done with conventional spray or airless equipment or brush or roller.

Exterior Galvanized Metal:

Preparation: Before applying primer or other surface treatments, clean galvanized metal surface to SSPC-SP1 that could impair bond of the various coatings. Remove oil, grease and soap film before priming use of Krud Kutter Metal Clean & Etch may be required on bare or new galvanized. Surface must be clean, dry and free of contaminants, including salt deposits. Additional prep may be needed to SSPC-SP2. Schedule cleaning and painting so dust and other contaminants from the cleaning process will not fall on wet, newly painted surfaces.

Note: Some selected areas of bare concrete surfaces will require (1) coat of Perma Crete 4-503 Concrete Primer before steel installation over all concrete surfaces.

Owner Option 1:
Prime: (1) coat PPG; 6-209 SpeedHide Galvanized Metal Primer (400 g/L VOC): Applied at a dry film thickness of not less than 3.0 to 5.0 mils.
Finish: (2) coats PPG; 4216 Plus HP Series Pitt-Tech Plus Semi-Gloss DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 2:
Prime: (1) coat PPG; 97-245 Pitt-Guard DTR Epoxy Mastic Primer (263 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 7.0 mils.
Finish: (2) coats PPG; 95-3300 Durathane Urethane Mastic (240 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 3 (Low VOC):
Prime: (1) coat PPG; Amerlock 2 Fast Dry VOC Compliant Epoxy (84 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 6.0 mils.
Finish: (2) coats PPG; Amershield VOC Aliphatic Urethane (84 g/L VOC): Applied at a dry film thickness of not less than 5.0 to 8.0 mils.

Application: Conventional or HVLP (high volume low pressure) be done with conventional spray or airless equipment or brush or roller.

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ARCHITECTURAL SPECIFICATIONS

G016

Exterior CMU Primer:

CMU Preparation: Mortar should cure for at least 30 days and preferably 90 days prior to priming. Fill block with an appropriate block filler. Surfaces previously coated with water thinned cement-based paint must be prepared with extra care. If the material appears to be adhering tightly, a masonry sealer may be applied to seal the surface. Check adhesion by applying a piece of masking tape. If the sealer peels off and has loose particles, remove all chalking or crumbling material, re-seal and re-check adhesion.

Field Preparation: Surfaces to be coated must be dry, clean, sound, and free from all contamination including loose and peeling paint, dirt, grease, oil, wax, concrete curing agents and bond breakers, chalk, efflorescence, mildew, rust, product fines, and dust. Remove loose paint, chalk, and efflorescence by wire brushing, scraping, sanding, and/or pressure washing. Putty all nail holes and caulk all cracks and open seams. Sand all glossy, rough, and patched surfaces. Feather back all rough edges to sound surface by sanding.

Prime: (2) Coats PPG; Speedhide Interior/Exterior Masonry Hi Fill Latex Block Filler

Application: Brush, Roll or Spray

Exterior Stucco/EIFS Surfaces (including wet areas):

Preparation: Remove all visible oil, grease, soil and all other foreign substances with cleaning solutions and/or scrapers. Allow to dry and sand all areas that need smoothing and dust off.
Prime: (1) coat PPG; 4-603 Perma-Crete Alkali Resistant Primer (100 g/L VOC): Applied at a dry film thickness of not less than 1.2 to 1.9 mils.
Finish: (2) coats PPG; 4-22 Perma-Crete Hi-Build Acrylic (100 g/L VOC): Applied at a dry film thickness of not less than 3.2 to 5.8 mils.
Application: Airless spray with back roll using 3/4" nap roller.

Exterior Wood:

Preparation: Remove all visible oil, grease, soil and all other foreign substances with cleaning solutions and or scrapers. Allow to dry and sand all areas that need smoothing and dust off.
Prime: (1) coat PPG; 17-921 Seal Grip Primer Sealer (100 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.
Finish: (2) coats PPG; 70-501 Manor Hall Exterior Semi-Gloss or PPG Acri-Shield Semi-Gloss PP649 (50 g/L VOC): Applied at a dry film thickness of not less than 1.5 to 3.0 mils.
Application: Brush, Roll or Spray

D. Interior Coatings:

Interior Metals: (Doors, door frames, where indicated)
Preparation: Remove all visible rust, oil, grease, soil and all other foreign substances with cleaning solutions and/or scrapers. Allow to dry and sand all areas that need smoothing and dust off.
Prime: (1) coat PPG; 4020PF Series Pitt-Tech Plus Int/Ext DTM Acrylic Industrial Primer (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils. (Repaints only require spot prime on bare metal surfaces.)
Finish: (2) coats PPG; V-50-410 Breakthrough Semi-gloss Sheen Acrylic (250 g/L VOC): Applied at a dry film thickness of not less than 1.4 to 2.0 mils.
Application: Conventional spray, HVLP or Airless spray. Touch-ups shall be done with conventional spray or airless equipment or brush or roller.

Interior Metals: (Metal Deck if indicated on Finish Plan)
Preparation: Remove all visible rust, oil, grease, soil and all other foreign substances with cleaning solutions and allow to dry before priming.
Prime: (1) coat PPG; 4020PF Series Pitt-Tech Plus Int/Ext DTM Acrylic Industrial Primer (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils. (Primer only required on unpainted decking or to spot prime bare areas in decking.)
Finish: (2) coats PPG; 90-1110 Pitt-Tech Plus Satin Acrylic (100 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.
Application: Conventional spray, HVLP or Airless spray. Touch-ups shall be done with conventional spray or airless equipment or brush or roller.

Interior Gyp. Bd.:
Preparation: Remove all visible oil, grease, soil and all other foreign substances with cleaning solutions. Fill hairline cracks, holes and other defects with filler compatible with finish coats. Sand smooth all areas filled and/or areas to make a smooth overall finish.
Prime: (1) coat PPG; 9-900 Pure Performance Acrylic Primer (0 g/L VOC): Applied at a dry film thickness of not less than 1.4 to 2.0 mils. (Spot prime required only on repaint projects.)
Finish: (2) coats PPG; Pure Performance Zero VOC Eggshell 9-500 Series, sheen as shown on finish plan: Applied at a dry film thickness of not less than 1.5 to 2.0 mils.
Application: Conventional spray, HVLP or Airless spray. Touch-ups shall be done with conventional spray or airless equipment or brush or roller.

Interior Wood Trim and Plywood - Clear Polyurethane Finish:
(Plywood finishes shall be shop applied in a controlled environment)

Shop Preparation: Scuff sand between coats.

Shop Finish: (2) coat, ML Campbell Krystal conversion varnish, Clear Dull Sheen
Application: Spray

Field Preparation: All cuts in field are to be sanded smooth. Scuff sand between coats.

Field Finish: (2) coat, ML Campbell High Performance Pre-Cat Lacquer, Clear Dull Sheen
Application: Wipe on with t-shirt rag.

Exterior Traffic Safety Marking.:
Preparation: All surfaces must be clean, dry and free from oil, grease, antifreeze, loose sand, aggregate and chipping/peeling existing striping. Any curing compounds used on new concrete must be mechanically abraded off prior to striping. When striping on freshly sealed surfaces use caution as some sealers can affect the curing and adhesion of traffic paint. When in doubt, always test adhesion.

For complete drying and minimum dirt retention when striping parking lots, the lots should be closed to traffic for two hours minimum after painting. New asphalt and concrete should be allowed to cure for a minimum of 14 days to maximize adhesion and durability.

Owner Option 1:
Finish: (1) coat PPG; A-2886B Type II, White Zone Marking - Applied at a dry film thickness of not less than 8.6 mils.

Owner Option 2:
Finish: (1) coat PPG; A-2886B Type II, Yellow Zone Marking - Applied at a dry film thickness of not less than 8.6 mils

Application: Applying a test strip to determine dry to no- pickup time when the humidity is higher than 65%. Cone whenever necessary.
• Do not heat paint in striping system above 60 C.
• Do not apply when temperatures are below 3 C.
• Do not apply when rain is forecast.
• Do not apply when temperatures are near or below the dew point or rain is forecast within 1 hour.
• Do not thin more than 5% with acetone and then use immediately.
• Do not apply if temperature is expected to fall below freezing for 6 hours after application of paint.
Application Equipment: Apply with a high quality brush, roller, or by airless spray equipment.

Airless Spray: Pressure 2000 psi, tip 0.015" - 0.021"Spray equipment must be handled with due care and in accordance with manufacturer's recommendation. High-pressure injection of coating s into the skin by airless equipment may cause serious injury.
Brush: Polyester/Nylon Brush
Roller: All-purpose nap roller cover.

E. Color Guide: Refer to Finish Plan and drawings for exact location of all colors.

WHERE	WHAT	COLOR	SHEEN	FINISH TAG
Exterior Traffic Safety Marking	PPG A-2886B Type II, Low VOC Acrylic Fast Dry Solvent	PPG White Zone Marking	Satin	N/A
Exterior Traffic Safety Marking	PPG A-2886B Type II, Low VOC Acrylic Fast Dry Solvent	PPG Yellow Zone Marking	Satin	N/A
Exterior Galvanized Metal, Flashing and Prefinished Metal Wall Panels	PPG Pitt-Tech Plus Satin Acrylic Finish 90-1110 Series	PPG 1001-6 "Knight's Armor"	Satin	N/A
Exterior (Roof Mounted) Gas Piping	PPG Pitt-Tech Plus Semi-Gloss Acrylic Finish 4216 Plus HP Series	Yellow	Semi-Gloss	N/A
Exterior and Interior Gas Piping, Where Exposed	PPG Pitt-Tech Plus Semi-Gloss Acrylic Finish 4216 Plus HP Series	Match surrounding finishes/verify with architect	Semi-Gloss	N/A
Exterior CMU Primer	PPG Speedhide Interior/Exterior Masonry Hi Fill Latex Block Filler	White	Flat	N/A
Exterior CMU	PPG Pitt-Tech Plus Semi-Gloss Acrylic Finish 4216 Plus HP Series	PPG 1001-6 "Knight's Armor"	Semi-Gloss	N/A
Exterior Ferrous Metals	PPG Pitt-Tech Plus Semi-Gloss Acrylic Finish 4216 Plus HP Series	PPG 1001-6 "Knight's Armor"	Semi-Gloss	N/A
Exterior Wood	PPG Manor Hall Acrylic Semi-Gloss 70-501 Series or PPG Acri-Shield Acrylic Semi-Gloss PP649 Series	PPG 1001-6 "Knight's Armor"	Semi-Gloss	N/A
Exterior Stucco and EIFS Patio and Wet Areas	PPG Perma-Crete High Build Acrylic Topcoat 4-22 Series	PPG 1001-6 "Knight's Armor"	Flat	N/A
Exterior Stucco and EIFS Patio and Wet Areas	PPG Perma-Crete High Build Acrylic Topcoat 4-22 Series	PPG 1010-2 "Fog"	Flat	N/A
Exterior Stucco and EIFS Patio and Wet Areas	PPG Perma-Crete High Build Acrylic Topcoat 4-22 Series	PPG 1058-7 "Autumn Ridge"	Flat	N/A
Interior Doors, Door Frames, Rails and Rail Frames, Where Specified	PPG Breakthrough 50 Acrylic Satin	PPG V52-90 Black	Satin	D1
Interior Ferrous Metals, Where Specified	PPG Breakthrough 250 Acrylic Eggshell V50-410 Series	PPG 1013-5 "Victorian Pewter"	Eggshell	N/A
Dining Room and Hallway Gyp. Bd.	PPG Pure Performance Zero VOC Semi-Gloss 9-500 as indicated on finish plan	PPG 1001-3 "Thin Ice"	Semi-Gloss	P4
Dining Room and Hallway Gyp. Bd.	PPG Pure Performance Zero VOC Eggshell 9-310 as indicated on finish plan	PPG 1001-3 "Thin Ice"	Eggshell	P3
Dining Room and Hallway Gyp. Bd. Ceiling	PPG Pure Performance Zero VOC Flat 9-100 Series or PPG Speedhide 6-4110XI Flat	PPG 1041-1 "Moonlit Snow"	Flat	C3
Restroom, Cooking, Kitchen and Serving Area Soffit Gyp. Bd.	PPG Pure Performance Zero VOC Eggshell 9-500 Series	PPG 1041-1 "Moonlit Snow"	Eggshell	C3
Interior Metal Roof Deck and Metal Columns	PPG Pitt-Tech Plus Satin Acrylic Finish 90-1110 Series	PPG 1013-5 "Victorian Pewter"	Satin	C1
Patio Railing	Durethane DTM Urethane 95-3300 Series	PPG 1001-6 "Knight's Armor"	Gloss	N/A

3.1 Installation:

A. Examination:
1. Verify that site environmental conditions are appropriate for application of coatings specified.
2. Immediately prior to coating application, ensure that surfaces to receive coatings are dry.
3. Ensure that moisture-retaining substrates to receive coatings have moisture content within tolerances allowed by coating manufacturer, using moisture measurement techniques recommended by coating manufacturer.
4. Immediately prior to coating application, examine surfaces to receive coatings for surface imperfections and for contaminants which could impair performance or appearance of coatings, including but not limited to, loose primer, rust, scale, oil, grease, mildew, algae, or fungus, stains or marks, cracks, indentations, or abrasions.
5. Correct the above conditions and any other conditions which could impair performance or appearance of coatings in accordance with specified surface preparation procedures before proceeding with coating application.

B. Preparation:
1. Do not start work until surfaces to be finished are in proper condition to produce finished surfaces of uniform, satisfactory appearance.
2. Stains and Marks: Remove completely, if possible, using materials and methods recommended by coating manufacturer; seal with shellac or other coating acceptable to paint manufacturer stains and marks that might bleed through paint finishes which cannot be completely removed.
3. Remove or protect hardware, electrical plates, mechanical grilles and louvers, lighting fixture trim, and other items not indicated to receive coatings which are adjacent to surfaces to receive coatings.
4. Remove mildew from impervious surfaces by scrubbing with solution of disodium phosphate and bleach. Rinse with clean water and allow substrate to thoroughly dry.
5. For specific substrate preparation, see individual specifications.
6. Provide necessary staging, ladders, shield, protective coverings and drop cloths. Protect floors, walls and adjacent work and materials. Remove and properly replace temporary protection and coverings removed from any part of the work or finish. Repair damage at Contractor's expense.

C. Application:
1. General: Mix, prepare and apply paint according to manufacturer's written instructions.
   a. Use applicators and techniques best suited for substrate and type of material being applied.
   b. Do not apply high-performance coatings over dirt, rust, scale, grease, moisture, scuffed surfaces, or conditions detrimental to forming a durable coating film.
   c. Coating surface treatments, and finishes are indicated in the coating system descriptions.
   d. Provide finish coats compatible with primers used.
   e. The term "exposed surfaces" includes areas visible when permanent or built-in fixtures, convector covers, grilles, covers for finned-tube radiation, and similar components are in place. Extend coatings in these areas, as required, to maintain system integrity and provide desired protection.
2. Application Procedures: Apply coatings by brush, roller, spray, or other applicators according to manufacturer's written instructions.
   a. The number of coats and film thickness required is the same regardless of application method.
   b. Completed Work: Match approved Samples for color, texture, and coverage. Remove, refinish, or recoat work that does not comply with specified requirements as directed by Tenant. Paints and coatings work is subject to acceptance by the Tenant.
   c. Keep brushes and rollers clean, free from contamination and suitable for the finish required.
   d. Unless otherwise indicated, allow exterior paints to dry for 48 hours and interior paints to dry for 24 hours between coats.
   e. Sand lightly and remove dust between coats to achieve required finish.
   f. Finished surfaces shall be uniform in finish and color and free of brush marks, sagging, holidays, corduroy and other imperfections. Coverage and hide shall be complete.
   g. Edges of paint or finish adjoining other materials or colors shall be sharp and clean without overlapping. Cut paint in neatly around glass or other edges.
   h. Paints and coatings work is subject to acceptance by the Tenant. Correct unsatisfactory work not complying with these specifications as directed by the Tenant.

D. Cleaning:
1. After completing painting, clean glass and paint spattered surfaces. Remove spattered paint by washing and scraping without scratching or damaging adjacent finished surfaces.

E. Protection:
1. Protect work of other trades, whether being painted or not, against damage from painting. Correct damage by cleaning, repairing or replacing, and repainting, as approved by Architect / Tenant.

2. Provide "Wet Paint" signs to protect newly painted finishes. After completing painting operations, remove temporary protective wrappings provided by others to protect their work.

3. After work of other trades is complete, touch up and restore damaged or defaced painted surfaces.

F. Maintenance: Furnish extra paint materials from the same production run as the materials applied in the quantities described below. Package paint materials in unopened, factory-sealed containers for storage and identify with labels describing contents. Deliver extra materials to the Tenant.
1. Provide one gallon of paint and wood stain of each type and color required for maintenance purposes. Provide original, unopened, labeled containers with color samples and a list of project use.

DIVISION 10 - SPECIALTIES

SECTION 10522 - PORTABLE FIRE EXTINGUISHES

1.1 General: Provide portable fire extinguishers as shown and specified.

A. Standards: Materials and installation shall conform to the following:
1. NFPA 10 "Standard for Portable Fire Extinguishers.

2.1 Materials:

A. Provide minimum 10 lb. capacity fire extinguishers in quantity and type complying with local code and fire regulations requirements.
1. Provide new fire extinguishers fully loaded, tested, UL and FM labeled and listed and ready for use.
2. Provide manufacturer's recommended mounting brackets and hardware.

3.1 Installation:

A. Install fire extinguishers in accordance with manufacturer's installation instructions, at heights and locations acceptable to the local fire regulations enforcement authority

SECTION 10700 - EXTRUDED ALUMINUM CANOPY

1.1 General: Provide canopies as shown and specified.

A. Standards: Materials and installation shall conform to the following:
1. AWS, D1.1 - Structural Welding Code - Steel
2. AMMA, Aluminum Finishes AAMA 2604 (FGIA 2604) - Powder Coat

B. Quality Assurance
1. Shop Drawings: To be created under the guidance of a professional engineer. Site Specific stamped drawing may be required by the manufacturer based on location. Drawings must indicate size, material and finish. Include plan, elevations and sections to clearly outline the canopy locations. Include installation procedures, details of joints, attachments and clearances.
   a. Submit within 15 days after contract award.
2. Color charts showing manufacturer's full range of colors from standard line including Chipotle's custom "charcoal" color match to prototypical window mullion system.

2.1 Manufacturers:

A. Architectural Fabrication, Inc. -- Manufacturer is located at 2100 Circle Forty Road, Suite 100, Fort Worth, TX 76104. P: (800) 962-8027. E: chipotle@arch-fab.com, W: www.arch-fab.com
B. Substitutions are acceptable assuming they comply with the following specification, are submitted based on Quality Assurance and Division1 - Section 01100 requirements and have minimum 10 years experience, and only when approved by Arch PM and Chipotle DM.
1. Awnex, Contact: Katie Dicks, P: 770-704-7140 x 1, E: katie@awnexinc.com
2. Uni-Structures, Contact: Dana Fredericks, P: [illegible]74-1773
3. API, Contact: Jade Moore-Esposito, P: [illegible]84, E: jesposito@americanproducts.com

2.2 Materials:

A. Specifications are based on Architectural Fabrication, Inc. - Helios Canopy Patent #9,976,310
1. Framing: Gutter fascia, tube, angles: 6063-T6 alloy extruded aluminum. Gutter to be notched in the back to allow steel support arms to pass through.
2. Decking: Extruded aluminum 8" wide deck pan in 6063-T6 or 6063-T5 alloy (Roll form is not acceptable)
3. Steel Support Arms: 3" x 3" x .250" Steel tube support arms w/ 8" w x 5"h x 1/2" thick steel plate welded to the back. Must manufacture steel arm in manner to leave room for LED enclosure at back of canopy.
4. Hardware and Fasteners: Nuts, bolts, washers, clevis pins, screws, anchors and pipe spacers to be zinc plated or galvanized steel required to suit application and per pre-engineered canopy load requirements. Typical wall anchors are minimum ½" diameter. Touch up paint must be provided for each canopy to allow for potential repairs in the field.
5. Flashing: Shall be minimum 0.040-inch aluminum, fabricated to prevent leakage and sealed with Novaflex metal roof sealant in custom color match. Another equivalent sealant is acceptable.
6. LED Enclosure: Each canopy is to have a preformed aluminum LED enclosure along the back edge of the canopy finished in the same powder coat as the canopy. 1" nominal inside width, and a minimum aluminum sheet thickness of .063".
7. Scuppers: Drainage for canopy is (2) aluminum scuppers located at the front of the canopy per drawings. See finish below for details.
8. Finish: All aluminum shall be powder coat finish per FGIA 2604 (aka AAMA 2604). Steel shall be commercially blasted, then coated with a zinc rich primer, and finally the top coat of super polyester powder (2604 compliant) applied.

3.1 Installation:

1. Install canopies per manufacturer's written instructions and videos, and as indicated on architectural drawings
2. Locate and place canopies level, plumb and at indicated alignment with adjacent work.
3. Use concealed anchors where possible.
4. Repair damaged finishes so no evidence remains of corrective work. Return items to the factory that cannot be refinished in the field. Make required alterations and refinish entire unit or provide new units.
5. Protect galvanized and nonferrous-metal surfaces from corrosion or galvanic action by applying a coating of bituminous paint or elastomeric coating on surfaces that will be in contact with concrete, masonry or dissimilar metals.

DIVISION 11- NOT APPLICABLE

DIVISION 12- FURNISHINGS

SECTION 12495 - WINDOW SHADES

1.1 General: Provide window shades as shown and specified.

A. Standards: Shade fabric material shall meet the requirements of the following:
1. NFPA 701 Flame Test and California US Title 19 for flame retardant materials.

B. Field measure window openings and verify installation conditions prior to window shade fabrication

C. Warranty:
1. 5 years against defects in materials and workmanship.
2. 1 year for service call repairs and adjustments.

2.1 Materials:

A. Manufacturer: Insolroll Window Shading Systems, Inc. (800) 447-5534, internet www.insolroll.com

B. Window Shades: Insolroll 2000 Solar Screen Shades, manual operation.
1. Solar Screen Shade Fabric: Insolroll woven fiberglass yarn, 5% openness, Charcoal/Bronze color.
2. Provide manufacturer's recommended mounting brackets and hardware.

C. Fabrication: Unless otherwise indicated, fabricate window shade units to completely fill existing window openings from jamb to jamb and from head to 42" AFF or the nearest horizontal mullion from 40"-44" AFF.
1. Adjustment system controlled by plastic bead chain on polyester cord. Multi-banded steel spring clutches keep shade in desired position.
2. Roller tube 2" extruded aluminum, sized to minimize deflection.
3. Fabric attached to roller tube using two-sided adhesive tape.
4. Fabric bottom hem RF heat sealed pocket with enclosed hem bar.

3.1 Installation:

A. Install window shades level and plumb in accordance with manufacturer's installation instructions and drawing details. Provide units securely anchored in place with recommended hardware and accessories to provide smooth operation without binding.

DIVISIONS 13 - 14 - NOT APPLICABLE

NOT USED

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ARCHITECTURAL SPECIFICATIONS

G017

SECTION 01 74 19 - CONSTRUCTION WASTE MANAGEMENT AND DISPOSAL

1.1 Related Documents

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 Summary

A. Section includes administrative and procedural requirements for the following:
   1. Salvaging nonhazardous waste.
   2. Recycling nonhazardous waste.
   3. Disposing of nonhazardous waste.

1.3 Definitions

A. Construction Waste: Building, structure, and site improvement materials and other solid waste resulting from construction, remodeling, renovation, or repair operations. Construction waste includes packaging.

B. Demolition Waste: Building, structure, and site improvement materials resulting from demolition operations.

C. Disposal: Removal of demolition or construction waste and subsequent salvage, sale, recycling, or deposit in landfill, incinerator acceptable to authorities having jurisdiction, or designated spoil areas on Owner's property.

D. Recycle: Recovery of demolition or construction waste for subsequent processing in preparation for reuse.

E. Salvage: Recovery of demolition or construction waste and subsequent sale or reuse in another facility.

F. Salvage and Reuse: Recovery of demolition or construction waste and subsequent incorporation into the Work.

1.4 Materials Ownership

A. Unless otherwise indicated, demolition and construction waste becomes property of Contractor.

B. Historic items, relics, antiques, and similar objects including, but not limited to, cornerstones and their contents, commemorative plaques and tablets, and other items of interest or value to Owner that may be uncovered during demolition remain the property of Owner.
   1. Carefully salvage in a manner to prevent damage and promptly return to Owner.

1.5 Action Submittals

A. Waste Management Plan: Submit plan within 30 days of date established for the Notice to Proceed.

1.6 Informational Submittals

A. Waste Reduction Progress Reports: Concurrent with each Application for Payment, submit report. Use Forms approved by Architect. Include the following information:
   1. Material category.
   2. Generation point of waste.
   3. Total quantity of waste in tons (tonnes).
   4. Quantity of waste salvaged, both estimated and actual in tons (tonnes).
   5. Quantity of waste recycled, both estimated and actual in tons (tonnes).
   6. Total quantity of waste recovered (salvaged plus recycled) in tons (tonnes).
   7. Total quantity of waste recovered (salvaged plus recycled) as a percentage of total waste.

B. Waste Reduction Calculations: Before request for Substantial Completion, submit calculated end-of-Project rates for salvage, recycling, and disposal as a percentage of total waste generated by the Work.

C. Records of Donations: Indicate receipt and acceptance of salvageable waste donated to individuals and organizations. Indicate whether organization is tax exempt.

D. Records of Sales: Indicate receipt and acceptance of salvageable waste sold to individuals and organizations. Indicate whether organization is tax exempt.

E. Recycling and Processing Facility Records: Indicate receipt and acceptance of recyclable waste by recycling and processing facilities licensed to accept them. Include manifests, weight tickets, receipts, and invoices.

F. Landfill and Incinerator Disposal Records: Indicate receipt and acceptance of waste by landfills and incinerator facilities licensed to accept them. Include manifests, weight tickets, receipts, and invoices.

G. Qualification Data: For waste management coordinator and refrigerant recovery technician.

H. Statement of Refrigerant Recovery: Signed by refrigerant recovery technician responsible for recovering refrigerant, stating that all refrigerant that was present was recovered and that recovery was performed according to EPA regulations. Include name and address of technician and date refrigerant was recovered.

I. Refrigerant Recovery: Comply with requirements in Section 02 41 19 - Selective Demolition for refrigerant recovery submittals.

1.7 Quality Assurance

A. Waste Management Coordinator Qualifications: Experienced firm, or individual employed and assigned by General Contractor, with a record of successful waste management coordination of projects with similar requirements. Superintendent may serve as Waste Management Coordinator.

B. Refrigerant Recovery Technician Qualifications: Comply with requirements in Section 02 41 19 - Selective Demolition.

C. Regulatory Requirements: Comply with transportation and disposal regulations of authorities having jurisdiction.

D. Waste Management Conference(s): Conduct conference(s) at Project site to comply with requirements in Section 01 31 00 - Project Management and Coordination. Review methods and procedures related to waste management including, but not limited to, the following:
   1. Review and discuss waste management plan including responsibilities of each contractor and waste management coordinator.
   2. Review requirements for documenting quantities of each type of waste and its disposition.
   3. Review and finalize procedures for materials separation and verify availability of containers and bins needed to avoid delays.
   4. Review procedures for periodic waste collection and transportation to recycling and disposal facilities.
   5. Review waste management requirements for each trade.

1.8 Waste Management Plan

A. General: Develop a waste management plan according to requirements in this Section. Plan shall consist of waste identification, waste reduction work plan, and cost/revenue analysis. Distinguish between demolition and construction waste. Indicate quantities by weight or volume, but use same units of measure throughout waste management plan.

B. Waste Identification: Indicate anticipated types and quantities of demolition and construction waste generated by the Work. Use Forms approved by Architect. Include estimated quantities and assumptions for estimates.

C. Waste Reduction Work Plan: List each type of waste and whether it will be salvaged, recycled, or disposed of in landfill or incinerator. Use Forms approved by Architect. Include points of waste generation, total quantity of each type of waste, quantity for each means of recovery, and handling and transportation procedures.
   1. Salvaged Materials for Reuse: For materials that will be salvaged and reused in this Project, describe methods for preparing salvaged materials before incorporation into the Work in compliance with Section 02 41 19 - Selective Demolition.
   2. Salvaged Materials for Sale: For materials that will be sold to individuals and organizations, include list of their names, addresses, and telephone numbers.
   3. Salvaged Materials for Donation: For materials that will be donated to individuals and organizations, include list of their names, addresses, and telephone numbers.
   4. Recycled Materials: Include list of local receivers and processors and type of recycled materials each will accept. Include names, addresses, and telephone numbers.
   5. Disposed Materials: Indicate how and where materials will be disposed of. Include name, address, and telephone number of each landfill and incinerator facility.
   6. Handling and Transportation Procedures: Include method that will be used for separating recyclable waste including sizes of containers, container labeling, and designated location where materials separation will be performed.

D. Cost/Revenue Analysis: Indicate total cost of waste disposal as if there were no waste management plan and net additional cost or net savings resulting from implementing waste management plan. Use Forms approved by Architect. Include the following:
   1. Total quantity of waste.
   2. Estimated cost of disposal (cost per unit). Include transportation and tipping fees and cost of collection containers and handling for each type of waste.
   3. Total cost of disposal (with no waste management).
   4. Revenue from salvaged materials.
   5. Revenue from recycled materials.
   6. Savings in transportation and tipping fees by donating materials.
   7. Savings in transportation and tipping fees that are avoided.
   8. Handling and transportation costs. Include cost of collection containers for each type of waste.
   9. Net additional cost or net savings from waste management plan.

2.1 Performance Requirements

A. General: Achieve end-of-Project rates for salvage/recycling of 50 percent by weight of total nonhazardous solid waste generated by the Work. Practice efficient waste management in the use of materials in the course of the Work. Use all reasonable means to divert construction and demolition waste from landfills and incinerators. Facilitate recycling and salvage of materials, including the following:
   1. Demolition Waste:
      a. Asphalt paving.
      b. Concrete.
      c. Concrete reinforcing steel.
      d. Brick.
      e. Concrete masonry units.
      f. Wood studs.
      g. Wood joists.
      h. Plywood and oriented strand board.
      i. Wood paneling.
      j. Wood trim.
      k. Structural and miscellaneous steel.
      l. Rough hardware.
      m. Roofing.
      n. Insulation.
      o. Doors and frames.
      p. Door hardware.
      q. Windows.
      r. Glazing.
      s. Metal studs.
      t. Gypsum board.
      u. Acoustical tile and panels.
      v. Carpet.
      w. Carpet pad.
      x. Demountable partitions.
      y. Equipment.
      z. Cabinets.
      aa. Plumbing fixtures.
      bb. Piping.
      cc. Supports and hangers.
      dd. Valves.
      ee. Sprinklers.
      ff. Mechanical equipment.
      gg. Refrigerants.
      hh. Electrical conduit.
      ii. Copper wiring.
      jj. Lighting fixtures.
      kk. Lamps.
      ll. Ballasts.
      mm. Electrical devices.
      nn. Switchgear and panelboards.
      oo. Transformers.
   2. Construction Waste:
      a. Masonry and CMU.
      b. Lumber.
      c. Wood sheet materials.
      d. Wood trim.
      e. Metals.
      f. Roofing.
      g. Insulation.
      h. Carpet and pad.
      i. Gypsum board.
      j. Piping.
      k. Electrical conduit.
      l. Packaging: Regardless of salvage/recycle goal indicated in "General" Paragraph above, salvage or recycle 100 percent of the following uncontaminated packaging materials:
         (1) Paper.
         (2) Cardboard.
         (3) Boxes.
         (4) Plastic sheet and film.
         (5) Polystyrene packaging.
         (6) Wood crates.
         (7) Wood pallets.
         (8) Plastic pails.
      m. Construction Office Waste: Regardless of salvage/recycle goal indicated in "General" Paragraph above, salvage or recycle 100 percent of the following construction office waste materials:
         (1) Paper.
         (2) Aluminum cans.
         (3) Glass containers.

3.1 Plan Implementation

A. General: Implement approved waste management plan. Provide handling, containers, storage, signage, transportation, and other items as required to implement waste management plan during the entire duration of the Contract.
   1. Comply with operation, termination, and removal requirements in Section 01 50 00 - Temporary Facilities and Controls.

B. Waste Management Coordinator: Engage a waste management coordinator to be responsible for implementing, monitoring, and reporting status of waste management work plan.

C. Training: Train workers, subcontractors, and suppliers on proper waste management procedures, as appropriate for the Work.
   1. Distribute waste management plan to everyone concerned within three days of submittal return.
   2. Distribute waste management plan to entities when they first begin work on-site. Review plan procedures and locations established for salvage, recycling, and disposal.

D. Site Access and Temporary Controls: Conduct waste management operations to ensure minimum interference with roads, streets, walks, walkways, and other adjacent occupied and used facilities.
   1. Designate and label specific areas on Project site necessary for separating materials that are to be salvaged and recycled.
   2. Comply with Section 01 50 00 - Temporary Facilities and Controls for controlling dust and dirt, environmental protection, and noise control.

E. Waste Management in Historic Zones or Areas: Transportation equipment and other materials shall be of sizes that clear surfaces within historic spaces, areas, rooms, and openings, by 12 inches (300 mm) or more.

3.2 Salvaging Demolition Waste

A. Comply with requirements in Section 02 41 19 - Selective Demolition for salvaging demolition waste.

B. Salvaged Items for Reuse in the Work: Salvage items for reuse and handle as follows:
   1. Clean salvaged items.
   2. Pack or crate items after cleaning. Identify contents of containers with label indicating elements, date of removal, quantity, and location where removed.
   3. Store items in a secure area until installation.
   4. Protect items from damage during transport and storage.
   5. Install salvaged items to comply with installation requirements for new materials and equipment. Provide connections, supports, and miscellaneous materials necessary to make items functional for use indicated.

C. Salvaged Items for Sale and Donation :Not permitted on Project site.

D. Salvaged Items for Owner's Use: Salvage items for Owner's use and handle as follows:
   1. Clean salvaged items.
   2. Pack or crate items after cleaning. Identify contents of containers with label indicating elements, date of removal, quantity, and location where removed.
   3. Store items in a secure area until delivery to Owner.
   4. Transport items to Owner's storage area designated by Owner.
   5. Protect items from damage during transport and storage.

E. Doors and Hardware: Brace open end of door frames. Except for removing door closers, leave door hardware attached to doors.

F. Equipment: Drain tanks, piping, and fixtures. Seal openings with caps or plugs. Protect equipment from exposure to weather.

G. Plumbing Fixtures: Separate by type and size.

H. Lighting Fixtures: Separate lamps by type and protect from breakage.

I. Electrical Devices: Separate switches, receptacles, switchgear, transformers, meters, panelboards, circuit breakers, and other devices by type.

3.3 Recycling Demolition and Construction Waste, General

A. General: Recycle paper and beverage containers used by on-site workers.

B. Recycling Incentives: Revenues, savings, rebates, tax credits, and other incentives received for recycling waste materials shall accrue to Owner.

C. Preparation of Waste: Prepare and maintain recyclable waste materials according to recycling or reuse facility requirements. Maintain materials free of dirt, adhesives, solvents, petroleum contamination, and other substances deleterious to the recycling process.

D. Procedures: Separate recyclable waste from other waste materials, trash, and debris. Separate recyclable waste by type at Project site to the maximum extent practical according to approved construction waste management plan.
   1. Provide appropriately marked containers or bins for controlling recyclable waste until removed from Project site. Include list of acceptable and unacceptable materials at each container and bin.
      a. Inspect containers and bins for contamination and remove contaminated materials if found.
   2. Stockpile processed materials on-site without intermixing with other materials. Place, grade, and shape stockpiles to drain surface water. Cover to prevent windblown dust.
   3. Stockpile materials away from construction area. Do not store within drip line of remaining trees.
   4. Store components off the ground and protect from the weather.
   5. Remove recyclable waste from Owner's property and transport to recycling receiver or processor as often as required to prevent overfilling bins.

3.4 Recycling Demolition Waste

A. Asphalt Paving: Break up and transport paving to asphalt-recycling facility.

B. Concrete: Remove reinforcement and other metals from concrete and sort with other metals.

C. Masonry: Remove metal reinforcement, anchors, and ties from masonry and sort with other metals.
   1. Clean and stack undamaged, whole masonry units on wood pallets.

D. Wood Materials: Sort and stack members according to size, type, and length. Separate lumber, engineered wood products, panel products, and treated wood materials.

E. Metals: Separate metals by type.
   1. Structural Steel: Stack members according to size, type of member, and length.
   2. Remove and dispose of bolts, nuts, washers, and other rough hardware.

F. Gypsum Board: Stack large clean pieces on wood pallets or in container and store in a dry location. Remove edge trim and sort with other metals. Remove and dispose of fasteners.

G. Acoustical Ceiling Panels and Tile: Stack large clean pieces on wood pallets and store in a dry location.

H. Metal Suspension System: Separate metal members, including trim and other metals from acoustical panels and tile, and sort with other metals.

I. Piping: Reduce piping to straight lengths and store by material and size. Separate supports, hangers, valves, sprinklers, and other components by material and size.

J. Conduit: Reduce conduit to straight lengths and store by material and size.

K. Lamps: Separate lamps by type and store according to requirements in 40 CFR 273.

3.5 Recycling Construction Waste

A. Packaging:
   1. Cardboard and Boxes: Break down packaging into flat sheets. Bundle and store in a dry location.
   2. Polystyrene Packaging: Separate and bag materials.
   3. Pallets: As much as possible, require deliveries using pallets to remove pallets from Project site. For pallets that remain on-site, break down pallets into component wood pieces and comply with requirements for recycling wood.
   4. Crates: Break down crates into component wood pieces and comply with requirements for recycling wood.

B. Wood Materials:
   1. Clean Cut-Offs of Lumber: Grind or chip into small pieces.
   2. Clean Sawdust: Bag sawdust that does not contain painted or treated wood.

C. Gypsum Board: Stack large clean pieces on wood pallets or in container and store in a dry location.
   1. Clean Gypsum Board: Grind scraps of clean gypsum board using small mobile chipper or hammer mill. Screen out paper after grinding.

D. Paint: Seal containers and store by type.

3.6 Disposal of Waste

A. General: Except for items or materials to be salvaged or recycled, remove waste materials from Project site and legally dispose of them in a landfill or incinerator acceptable to authorities having jurisdiction.
   1. Except as otherwise specified, do not allow waste materials that are to be disposed of accumulate on-site.
   2. Remove and transport debris in a manner that will prevent spillage on adjacent surfaces and areas.

B. General: Except for items or materials to be salvaged or recycled, remove waste materials and legally dispose of at designated spoil areas on Owner's property.

C. Burning: Do not burn waste materials.

SECTION 01 81 13.71 - CALGREEN DESIGN REQUIREMENTS

1.1 Summary

A. Section Includes: General requirements and procedures for compliance with and certification from 24 CCR 11 (hereafter, "CALGreen").
   1. Some CALGreen requirements depend on product selections and may not be specifically identified as CALGreen requirements. Compliance with CALGreen requirements may be used as one criterion to evaluate substitution requests and comparable product requests.
   2. Copies of CALGreen project checklists are included in the drawings.
      a. Some CALGreen requirements depend on Architect's design and other aspects of Project that are not part of the Work of the Contract.

1.2 Preinstallation Meetings

A. Preinstallation Conference: Conduct conference at Project site. Review CALGreen requirements and action plans for compliance with requirements. Also, reference Section 01 31 00 - Project Management and Coordination for further information.

1.3 Administrative Requirements

A. Submit documentation to enforcing agency for credits that are the responsibility of Contractor, that depend on product selection or product qualities, or that depend on Contractor's procedures until enforcing agency has made its determination on Project's CALGreen certification application.
   1. Document correspondence with review team, as assigned by the enforcing agency, as informational submittals.

B. Environmental Management System: Document the following:
   1. Environmental policy.
   2. Regulatory compliance and training.
   3. Environmental risk assessment that shows sensitive environmental areas and ranks potential risks that may arise from the construction.
   4. Environmental risk management strategies.
   5. Environmental management roles, responsibilities, and reporting structure for the construction phase.
   6. Site and work instructions for site personnel, outlining environmental procedures during construction.
   7. Environmental inspection checklists.
   8. Records of compliance.

1.4 Action Submittals

A. General: Submit additional sustainable design submittals required by other Specification Sections.

B. Sustainable design submittals are in addition to other submittals.

C. Sustainable Design Documentation Submittals:
   1. Stormwater pollution prevention plan.
   2. Product data for irrigation system components, including, but not limited to, the following:
      a. Sprinkler Heads: Indicate degree of head rotation and spray characteristics/pattern.
      b. Controllers and sensors.
   3. Product data and schedules for plumbing fixtures and fittings. Include rated capacities and WaterSense certification where applicable.
   4. Product data for residential appliances, indicating that products are Energy Star rated.
   5. Environmental management system documents.
   6. Lighting controls.
   7. Environmental product declarations.
   8. Third-party certifications based on multiple-attribute standards.
   9. Third-party-certified life-cycle product assessments.
   10. Product data, manufacturer's certifications, chain-of-custody certification, or other documentation acceptable to authorities having jurisdiction; for products containing composite wood, agrifiber products, or wood glues, indicate compliance with California Air Resource Board's "Airborne Toxic Control Measure to Reduce Formaldehyde Missions from Composite Wood."
   11. Construction waste management plan complying with Section 01 74 19 - Construction Waste Management and Disposal.
   12. Product data and laboratory test reports for adhesives and sealants indicating VOC content and compliance with requirements for low-emitting materials.
   13. Certificates for carpet and undercarpet adhesives indicating compliance with Carpet and Rug Institute's Green Label Plus testing program.
   14. Product data and laboratory test reports for paints and coatings indicating VOC content and compliance with requirements for low-emitting materials.
   15. Laboratory test reports for hard flooring, insulation, acoustical ceilings, and wall coverings, indicating compliance with requirements for low-emitting materials, as defined in "Low-Emitting Materials" Article.
   16. IAQ testing report from testing and inspecting agency indicating results of IAQ testing and documentation that show compliance with IAQ testing procedures and requirements.

1.5 Informational Submittals

A. Project Materials Cost Data: Submit statement indicating total cost for materials used for the Work. Costs exclude labor, overhead, and profit. Include breakout of costs for the following categories of items:
   1. Plumbing.
   2. Mechanical.
   3. Electrical.
   4. Specialty items, such as elevators and equipment.
   5. Wood-based construction materials.

B. Sustainable Design Progress Reports: Concurrent with each Application for Payment, submit reports comparing actual construction and purchasing activities with sustainable design action plans.

2.1 Materials

A. Provide products and procedures necessary to comply with CALGreen requirements referenced in the Evaluations. Although other Sections may specify some requirements that contribute to referenced CALGreen requirements, determine additional materials and procedures necessary to comply with CALGreen requirements indicated.

2.2 Low-Emitting Materials

A. Adhesives and Sealants:
   1. For field applications inside the building, adhesives and sealants shall comply with the following VOC content limits:
      a. Wood Glues: 30 g/L.
      b. Metal-to-Metal Adhesives: 30 g/L.
      c. Adhesives for Porous Materials (except Wood): 50 g/L.
      d. Subfloor Adhesives: 50 g/L.
      e. Plastic Foam Adhesives: 50 g/L.
      f. Carpet Adhesives: 50 g/L.
      g. Carpet Pad Adhesives: 50 g/L.
      h. VCT and Asphalt Tile Adhesives: 50 g/L.
      i. Cove Base Adhesives: 50 g/L.
      j. Gypsum Board and Panel Adhesives: 50 g/L.
      k. Rubber Floor Adhesives: 60 g/L.
      l. Ceramic Tile Adhesives: 65 g/L.
      m. Multipurpose Construction Adhesives: 70 g/L.
      n. Fiberglass Adhesives: 80 g/L.
      o. Contact Adhesive: 80 g/L.
      p. Structural Glazing Adhesives: 100 g/L.
      q. Wood Flooring Adhesive: 100 g/L.
      r. Single-Ply Roof Membrane Adhesive: 250 g/L.
      s. Special-Purpose Contact Adhesive (Contact Adhesive That Is Used to Bond Melamine Covered Board, Metal, Unsupported Vinyl, Rubber, or Wood Veneer 1/16 Inch or Less in Thickness to Any Surface): 250 g/L.
      t. Plastic Cement Welding Compounds: 250 g/L.
      u. ABS Welding Compounds: 325 g/L.
      v. CPVC Welding Compounds: 490 g/L.
      w. PVC Welding Compounds: 510 g/L.
      x. Adhesive Primer for Plastic: 550 g/L.
      y. Architectural Sealants: 250 g/L.
      z. Nonmembrane Roof Sealants: 300 g/L.
      aa. Single-Ply Roof Membrane Sealants: 450 g/L.
      bb. Other Sealants: 420 g/L.
   2. For field applications inside the building, adhesives and sealants must comply with the requirements of SCAQMD Rule 1168 or local code when tested in accordance with the California Department of Public Health's "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."

B. Carpet, cushion, and undercarpet adhesives will comply with CRI's Green Label Plus testing program.

C. Paints: For field applications inside the building, wall paints must comply with local code requirements when tested in accordance with the California Department of Public Health's "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."

D. Resilient Flooring: Flooring must be certified by the Resilient Floor Covering Institute and/or be compliant when tested in accordance with the California Department of Public Health's "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers." Flooring must also comply with the Collaborative for High Performance Schools (CHPS) requirements.

E. Thermal Insulation: Provide insulation complying with CALGreen Tier 1 or 2 requirements.

F. Ceiling and Wall Panels: Acoustical ceiling and wall-cladding products must comply with the VOC emissions limits defined in the CHPS criteria and be listed in the CHPS Pre-Approved Products database or have a Greenguard Certification Program.

3.1 Construction Waste Management

A. CALGreen requires use of a construction waste management plan outlining how waste will be divided on the construction site, as well as how often it will be hauled to a landfill or recycling center and by whom.

B. Comply with Section 01 74 19 - Construction Waste Management and Disposal.

SECTION 02 41 19 - SELECTIVE DEMOLITION

1.1 Related Documents

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 Summary

A. Section Includes:
   1. Demolition and removal of selected portions of building or structure.
   2. Demolition and removal of selected site elements.
   3. Salvage of existing items to be reused or recycled.

1.3 Definitions

A. Remove: Detach items from existing construction and dispose of them off-site unless indicated to be salvaged or reinstalled.

B. Remove and Salvage: Detach items from existing construction, in a manner to prevent damage, and deliver to Owner ready for reuse.

C. Remove and Reinstall: Detach items from existing construction, in a manner to prevent damage, prepare for reuse, and reinstall where indicated.

D. Existing to Remain: Leave existing items that are not to be removed and that are not otherwise indicated to be salvaged or reinstalled.

E. Dismantle: To remove by disassembling or detaching an item from a surface, using gentle methods and equipment to prevent damage to the item and surfaces; disposing of items unless indicated to be salvaged or reinstalled.

1.4 Materials Ownership

A. Unless otherwise indicated, demolition waste becomes property of Contractor.

B. Historic items, relics, antiques, and similar objects including, but not limited to, cornerstones and their contents, commemorative plaques and tablets, and other items of interest or value to Owner that may be uncovered during demolition remain the property of Owner.
   1. Carefully salvage in a manner to prevent damage and promptly return to Owner.

1.5 Preinstallations Meetings

A. Predemolition Conference: Conduct conference at Project site.
   1. Inspect and discuss condition of construction to be selectively demolished.
   2. Review structural load limitations of existing structure.
   3. Review and finalize selective demolition schedule and verify availability of materials, demolition personnel, equipment, and facilities needed to make progress and avoid delays.
   4. Review requirements of work performed by other trades that rely on substrates exposed by selective demolition operations.
   5. Review areas where existing construction is to remain and requires protection.

1.6 Informational Submittals

A. Qualification Data: For refrigerant recovery technician.

B. Proposed Protection Measures: Submit report, including Drawings, that indicates the measures proposed for protecting individuals and property , for environmental protection. Indicate proposed locations and construction of barriers.

C. Schedule of Selective Demolition Activities: Indicate the following:
   1. Detailed sequence of selective demolition and removal work, with starting and ending dates for each activity. Ensure Owner's building manager's on-site operations are uninterrupted.
   2. Interruption of utility services. Indicate how long utility services will be interrupted.
   3. Coordination for shutoff, capping, and continuation of utility services.
   4. Use of elevator and stairs.
   5. Coordination of Owner's continuing occupancy of portions of existing building and of Owner's partial occupancy of completed Work.

D. Predemolition Photographs or Video: Show existing conditions of adjoining construction, including finish surfaces, that might be misconstrued as damage caused by demolition operations. Submit before Work begins.

E. Statement of Refrigerant Recovery: Signed by refrigerant recovery technician responsible for recovering refrigerant, stating that all refrigerant that was present was recovered and that recovery was performed according to EPA regulations. Include name and address of technician and date refrigerant was recovered.

F. Warranties: Documentation indicating that existing warranties are still in effect after completion of selective demolition.

1.7 Closeout Submittals

A. Inventory: Submit a list of items that have been removed and salvaged.

1.8 Quality Assurance

A. Refrigerant Recovery Technician Qualifications: Certified by an EPA-approved certification program.

1.9 Field Conditions

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ARCHITECTURAL SPECIFICATIONS

G018

A. General: Provide site construction work, including services, utilities, earthwork, paving and landscaping in accordance with the site construction work drawings and details.

B. Owner will occupy portions of building immediately adjacent to selective demolition area. Conduct selective demolition so Owner's operations will not be disrupted.

C. Conditions existing at time of inspection for bidding purpose will be maintained by Owner as far as practical.

D. Notify Architect of discrepancies between existing conditions and Drawings before proceeding with selective demolition.

E. Hazardous Materials: It is not expected that hazardous materials will be encountered in the Work.
1. Hazardous materials will be removed by Owner before start of the Work.
2. If suspected hazardous materials are encountered, do not disturb; immediately notify Architect and Owner. Hazardous materials will be removed by Owner under a separate contract.

F. Do not disturb hazardous materials or items suspected of containing hazardous materials except under procedures specified elsewhere in the Contract Documents.

G. Historic Areas: Demolition and hauling equipment and other materials shall be of sizes that clear surfaces within historic spaces, areas, rooms, and openings, including temporary protection, by 12 inches or more.

H. Storage or sale of removed items or materials on-site is not permitted.

I. Utility Service: Maintain existing utilities indicated to remain in service and protect them against damage during selective demolition operations.
1. Maintain fire-protection facilities in service during selective demolition operations.

1.10 Warranty

A. Existing Warranties: Remove, replace, patch, and repair materials and surfaces cut or damaged during selective demolition, by methods and with materials and using approved contractors so as not to void existing warranties. Notify warrantor before proceeding.

B. Notify warrantor on completion of selective demolition, and obtain documentation verifying that existing system has been inspected and warranty remains in effect. Submit documentation at Project closeout.

1.11 Coordination

A. Arrange selective demolition schedule so as not to interfere with Owner's operations.

2.1 Performance Requiremensts

A. Regulatory Requirements: Comply with governing EPA notification regulations before beginning selective demolition. Comply with hauling and disposal regulations of authorities having jurisdiction.

B. Standards: Comply with ANSI A10.6 and NFPA 241.

2.2 Materials

A. Stencils for pavement markings: Pavement Stencil Company. Telephone: (800) 250-5547. Email: stencils@pavementstencil.com.

3.1 Examination

A. Verify that utilities have been disconnected and capped before starting selective demolition operations.

B. Review Project Record Documents of existing construction or other existing condition and hazardous material information provided by Owner. Owner does not guarantee that existing conditions are same as those indicated in Project Record Documents.

C. Perform an engineering survey of condition of building to determine whether removing any element might result in structural deficiency or unplanned collapse of any portion of structure or adjacent structures during selective building demolition operations.
1. Perform surveys as the Work progresses to detect hazards resulting from selective demolition activities.

D. Steel Tendons: Locate tensioned steel tendons and include recommendations for de-tensioning.

E. Verify that hazardous materials have been remediated before proceeding with building demolition operations.

F. Survey of Existing Conditions: Record existing conditions by use of measured drawings.
1. Inventory and record the condition of items to be removed and salvaged. Provide photographs or video of conditions that might be misconstrued as damage caused by salvage operations.
2. Before selective demolition or removal of existing building elements that will be reproduced or duplicated in final Work, make permanent record of measurements, materials, and construction details required to make exact reproduction.

3.2 Preparation

A. Refrigerant: Before starting demolition, remove refrigerant from mechanical equipment according to 40 CFR 81-84 and regulations of authorities having jurisdiction.

3.3 Utility Services and Mechanical/Electrical Systems

A. Existing Services/Systems to Remain: Maintain services/systems indicated to remain and protect them against damage.

B. Existing Services/Systems to Be Removed, Relocated, or Abandoned: Locate, identify, disconnect, and seal or cap off utility services and mechanical/electrical systems serving areas to be selectively demolished.
1. Owner will arrange to shut off indicated services/systems when requested by Contractor.
2. Arrange to shut off utilities with utility companies.
3. If services/systems are required to be removed, relocated, or abandoned, provide temporary services/systems that bypass area of selective demolition and that maintain continuity of services/systems to other parts of building.
4. Disconnect, demolish, and remove fire-suppression systems, plumbing, and HVAC systems, equipment, and components indicated on Drawings to be removed.
   a. Piping to Be Removed: Remove portion of piping indicated to be removed and cap or plug remaining piping with same or compatible piping material.
   b. Piping to Be Abandoned in Place: Drain piping and cap or plug piping with same or compatible piping material and leave in place.
   c. Equipment to Be Removed: Disconnect and cap services and remove equipment.
   d. Equipment to Be Removed and Reinstalled: Disconnect and cap services and remove, clean, and store equipment; when appropriate, reinstall, reconnect, and make equipment operational.
   e. Equipment to Be Removed and Salvaged: Disconnect and cap services and remove equipment and deliver to Owner.
   f. Ducts to Be Removed: Remove portion of ducts indicated to be removed and plug remaining ducts with same or compatible ductwork material.
   g. Ducts to Be Abandoned in Place: Cap or plug ducts with same or compatible ductwork material and leave in place.

3.4 Protection

A. Temporary Protection: Provide temporary barricades and other protection required to prevent injury to people and damage to adjacent buildings and facilities to remain.
1. Provide protection to ensure safe passage of people around selective demolition area and to and from occupied portions of building.
2. Provide temporary weather protection, during interval between selective demolition of existing construction on exterior surfaces and new construction, to prevent water leakage and damage to structure and interior areas.
3. Protect walls, ceilings, floors, and other existing finish work that are to remain or that are exposed during selective demolition operations.
4. Cover and protect furniture, furnishings, and equipment that have not been removed.
5. Comply with requirements for temporary enclosures, dust control, heating, and cooling specified.

B. Temporary Shoring: Design, provide, and maintain shoring, bracing, and structural supports as required to preserve stability and prevent movement, settlement, or collapse of construction and finishes to remain, and to prevent unexpected or uncontrolled movement or collapse of construction being demolished.
1. Strengthen or add new supports when required during progress of selective demolition.

C. Remove temporary barricades and protections where hazards no longer exist.

3.5 Selective Demolition, General

A. General: Demolish and remove existing construction only to the extent required by new construction and as indicated. Use methods required to complete the Work within limitations of governing regulations and as follows:
1. Proceed with selective demolition systematically, from higher to lower level. Complete selective demolition operations above each floor or tier before disturbing supporting members on the next lower level.
2. Neatly cut openings and holes plumb, square, and true to dimensions required. Use cutting methods least likely to damage construction to remain or adjoining construction. Use hand tools or small power tools designed for sawing or grinding, not hammering and chopping. Temporarily cover openings to remain.
3. Cut or drill from the exposed or finished side into concealed surfaces to avoid marring existing finished surfaces.
4. Do not use cutting torches until work area is cleared of flammable materials. At concealed spaces, such as duct and pipe interiors, verify condition and contents of hidden space before starting flame-cutting operations. Maintain portable fire-suppression devices during flame-cutting operations.
5. Maintain fire watch during as required by AHJ after flame-cutting operations.
6. Maintain adequate ventilation when using cutting torches.
7. Remove decayed, vermin-infested, or otherwise dangerous or unsuitable materials and promptly dispose of off-site.
8. Remove structural framing members and lower to ground by method suitable to avoid free fall and to prevent ground impact or dust generation.
9. Locate selective demolition equipment and remove debris and materials so as not to impose excessive loads on supporting walls, floors, or framing.
10. Dispose of demolished items and materials promptly.

B. Site Access and Temporary Controls: Conduct selective demolition and debris-removal operations to ensure minimum interference with roads, streets, walks, walkways, and other adjacent occupied and used facilities.

C. Work in Historic Areas: Selective demolition may be performed only in areas of Project that are not designated as historic. In historic spaces, areas, and rooms, or on historic surfaces, the terms "demolish" or "remove" shall mean historic "removal" or "dismantling" as specified in Section 024296 "Historic Removal and Dismantling."

D. Removed and Salvaged Items:
1. Clean salvaged items.
2. Pack or crate items after cleaning. Identify contents of containers.
3. Store items in a secure area until delivery to Owner.
4. Transport items to Owner's storage area on-site.
5. Protect items from damage during transport and storage.

E. Removed and Reinstalled Items:
1. Clean and repair items to functional condition adequate for intended reuse.
2. Pack or crate items after cleaning and repairing. Identify contents of containers.
3. Protect items from damage during transport and storage.
4. Reinstall items in locations indicated. Comply with installation requirements for new materials and equipment. Provide connections, supports, and miscellaneous materials necessary to make item functional for use indicated.

F. Existing Items to Remain: Protect construction indicated to remain against damage and soiling during selective demolition. When permitted by Architect, items may be removed to a suitable, protected storage location during selective demolition and cleaned and reinstalled in their original locations after selective demolition operations are complete.

3.6 Selective Demolition Procedures for Specific Materials

A. Concrete: Demolish in small sections. Using power-driven saw, cut concrete to a depth of at least 3/4 inch at junctures with construction to remain. Dislodge concrete from reinforcement at perimeter of areas being demolished, cut reinforcement, and then remove remainder of concrete. Neatly trim openings to dimensions indicated.

B. Concrete: Demolish in sections. Cut concrete full depth at junctures with construction to remain and at regular intervals using power-driven saw, and then remove concrete between saw cuts.

C. Masonry: Demolish in small sections. Cut masonry at junctures with construction to remain, using power-driven saw, and then remove masonry between saw cuts.

D. Concrete Slabs-on-Grade: Saw-cut perimeter of area to be demolished, and then break up and remove.

E. Resilient Floor Coverings: Remove floor coverings and adhesive according to recommendations in RFCI's "Recommended Work Practices for the Removal of Resilient Floor Coverings." Do not use methods requiring solvent-based adhesive strippers.

F. Roofing: Remove no more existing roofing than what can be covered in one day by new roofing and so that building interior remains watertight and weathertight.
1. Remove existing roof membrane, flashings, copings, and roof accessories.
2. Remove existing roofing system down to substrate.

3.7 Disposal of Demolished Materials

A. Remove demolition waste materials from Project site and dispose of them in an EPA-approved construction and demolition waste landfill acceptable to authorities having jurisdiction.
1. Do not allow demolished materials to accumulate on-site.
2. Remove and transport debris in a manner that will prevent spillage on adjacent surfaces and areas.
3. Remove debris from elevated portions of building by chute, hoist, or other device that will convey debris to grade level in a controlled descent.
4. Comply with requirements specified in Section 01 74 19 - Construction Waste Management and Disposal

B. Burning: Do not burn demolished materials.

3.8 Cleaning

A. Clean adjacent structures and improvements of dust, dirt, and debris caused by selective demolition operations. Return adjacent areas to condition existing before selective demolition operations began.

3.9 Selective Demolition Schedule (Refer to Drawings)

SECTION 07 01 53 - ROOF MODIFICATIONS

1.1 Related Documents

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 Summary

A. Section Includes the following:
1. Cutting in of new penetrations through existing roof system, and flashing with new materials into existing roofing system.
2. Protection of existing roofing system that is not to be modified or disturbed.
3. New prefabricated roof curb and mounting substrates.
4. New vent pipe boot.
5. New roof pipe support system.

1.3 Materials Ownership

A. Except for items or materials indicated to be reused, reinstalled, or otherwise indicated to remain Owner's property, demolished materials shall become Contractor's property and shall be removed from Project site.

1.4 Definition

A. SBS: Styrene-Butadiene-Styrene Modificed Bituminous Membrane Roofing

B. Roofing Terminology: Refer to ASTM D1079 and glossary in NRCA's "The NRCA Roofing and Waterproofing Manual" for definition of terms related to roofing work in this Section.

C. Existing Membrane Roofing System: Roofing membrane, surfacing, and components and accessories between deck and roofing membrane.

D. Remove: Detach items from existing construction and legally dispose of them off-site unless indicated to be removed and reinstalled.

E. Existing to Remain: Existing items of construction that are not indicated to be removed.

1.5 System Description

A. Provide products required by manufacturers to be fully compatible with each other and with indicated substrates, or provide separation materials as required to eliminate contact between incompatible materials.

B. Provide new roof membrane, insulation, and flashing to accommodate penetrations.

C. Performance Requirements: Prevent water infiltration through roof membrane penetrations or modifications resulting from work described in Contract Documents.

D. Industry Standards: Conform to NRCA - Roofing and Waterproofing Manual, except where more stringent requirements are indicated.

1.6 Action Submittals

A. Product Data: For each type of product specified.
1. Include list of materials and data sheets describing physical characteristics and performance criteria for materials proposed for use as well as applicable standards met by each product.

B. Shop Drawings: Submit details for this specific project indicating construction at penetrations, terminations, flashings, drains, and tie-in to existing roof.
1. For sheet metal flashing and trim:
   a. Include plans, elevations, sections, and attachment details.
   b. Detail fabrication and installation layouts, expansion-joint locations, and keyed details. Distinguish between shop- and field-assembled Work.
   c. Include identification of material, thickness, weight, and finish for each item and location in Project.
   d. Include details for forming, including profiles, shapes, seams, and dimensions.
   e. Include details for joining, supporting, and securing, including layout and spacing of fasteners, cleats, clips, and other attachments. Include pattern of seams.
   f. Include details of termination points and assemblies.
   g. Include details of roof-penetration flashing.
   h. Include details of special conditions.
   i. Include details of connections to adjoining work.
   j. Detail formed flashing and trim at scale of not less than 1-1/2 inches per 12 inches (1:10).

1.7 Informational Submittals

A. Photographs or Video: Show existing conditions of adjoining construction including exterior and interior finish surfaces, that might be misconstrued as having been damaged by roofing modification operations. Submit before Work begins.

B. Certifications specified in Quality Assurance article.

C. Qualification Data: For Installer, including certificate that Installer is approved by warrantor of existing roofing system.

D. Manufacturer's Installation Instructions: Submit manufacturer's printed installation instructions for each product.

1.8 Closet Submittals

A. Inspection Report: Copy of roofing system manufacturer's inspection report of completed roof installation.

B. Warranty: Submit specified warranty in accordance with Division 01.

1.9 Quality Assurance

A. Applicator Qualifications: Approved by manufacturer for making modifications and repairs to existing warranted roofing prior to execution of this Contract.
1. Minimum of 5 years documented experience in roofing repairs of this type of roof.
2. Include list of completed projects having similar scope of work identified by name, location, date, reference name, and phone number.

B. Materials Removal Firm: Company specializing in performing the work of this Section with minimum 5 years documented experience.

C. Certifications:
1. Submit manufacturer's certification stating materials ordered and supplied are compatible with existing roofing system and will not void existing warranty.
2. Submit manufacturer's project registration form indicating that manufacturer has reviewed Project and will issue or extend existing warranty to cover repairs warranty upon successful completion of installation.
3. Submit manufacturer's approval of applicator.
4. Certify materials shipped to Project site meet roof manufacturer's published performance standards and requirements of this Specification.
5. State that membrane manufacturer approves of insulation type and method of installation.

D. Regulatory Requirements: Comply with governing EPA notification regulations before beginning membrane roofing removal. Comply with hauling and disposal regulations of authorities having jurisdiction.

1.10 Project Conditions

A. Owner will occupy portions of building immediately below roofing modification area. Conduct roof modifications so Owner's operations will not be disrupted. Provide Owner with not less than 2 weeks notice of activities that may affect Owner's operations.
1. Coordinate work activities daily with Owner so Owner can place protective dust or water leakage covers over sensitive equipment or furnishings, shut down HVAC and fire-alarm or -detection equipment if needed, and evacuate occupants from below the work area if desired.
2. Before working over structurally impaired areas of deck, notify Owner to evacuate occupants from below the affected area. Verify that occupants below the work area have been evacuated prior to proceeding with work over the impaired deck area.

B. Protect building where roofing is scheduled to be modified, adjacent buildings, walkways, site improvements, exterior plantings, and landscaping from damage or soiling from modification operations.

C. Maintain access to existing walkways, corridors, and other adjacent occupied or used facilities.

D. Owner assumes no responsibility for condition of areas to be modified.
1. Conditions existing at time of inspection for bidding will be maintained by Owner as far as practical.

E. Handle and store roofing materials and place equipment in a manner to avoid significant or permanent damage to deck or structural supporting members.

F. Weather Limitations: Proceed with roofing modification work only when existing and forecasted weather conditions permit Work to proceed without water entering into existing roofing system or building.
1. Emergency Equipment: Maintain on-site equipment necessary to apply emergency temporary edge seal in the event of sudden storms or inclement weather.
2. Maintain continuous temporary protection prior to and during installation of new roofing system.

G. Hazardous Materials: It is not expected that hazardous materials such as asbestos-containing materials will be encountered in the Work.
1. If materials suspected of containing hazardous materials are encountered, do not disturb; immediately notify Architect and Owner. Hazardous materials will be removed by Owner under a separate contract.

1.11 Sequencing and Scheduling

A. Remove only existing roofing materials that can be replaced with new materials the same day.

B. Coordinate the work with other affected mechanical and electrical work associated with roof penetrations.

C. Coordination: Before starting work, verify with the Tenant's Construction Manager and Owner the following:
1. Existing roof system materials and installation methods.
2. Repair work responsibilities and warranty requirements. To maintain original warranty, where provided use original roof contractor.

1.12 Warranty

A. Existing Warranties: Remove, replace, patch, and repair materials and surfaces cut or damaged during roof modification work, by methods and with materials so as not to void existing roofing system warranty. Notify warrantor before proceeding.
1. Notify warrantor of existing roofing system on completion of roofing modifications, and obtain documentation verifying that existing roofing system has been inspected and warranty remains in effect. Submit documentation at Project closeout.

2.1 Performance Requirements

A. General: Sheet metal flashing and trim assemblies, including cleats, anchors, and fasteners, shall withstand wind loads, structural movement, thermally induced movement, and exposure to weather without failure due to defective manufacture, fabrication, installation, or other defects in construction. Completed sheet metal flashing and trim shall not rattle, leak, or loosen, and shall remain watertight.

B. Sheet Metal Standard for Flashing and Trim: Comply with NRCA's "The NRCA Roofing Manual: Architectural Metal Flashing, Condensation and Air Leakage Control, and Reroofing" and SMACNA's "Architectural Sheet Metal Manual" requirements for dimensions and profiles shown unless more stringent requirements are indicated.

C. Thermal Movements: Allow for thermal movements from ambient and surface temperature changes to prevent buckling, opening of joints, overstressing of components, failure of joint sealants, failure of connections, and other detrimental effects. Base calculations on surface temperatures of materials due to both solar heat gain and nighttime-sky heat loss.
1. Temperature Change: 120 deg F (67 deg C), ambient; 180 deg F (100 deg C), material surfaces.

2.2 Infill and Patching Materials

A. Use infill and patching materials, including sheet and adhesive materials, flashings, roof surfacing, fasteners, adhesives, and accessories, matching existing membrane roofing system materials, unless otherwise indicated.

2.3 Temporary Roofing Materials

A. Selection of materials and design of temporary roofing is responsibility of Contractor. Select only materials that are compatible with existing roofing system. For pipe penetrations, use flashing materials and techniques as recommended by NRCA, utilizing portals mounted to curbs.

B. Provide and install only materials approved and recommended by the roofing manufacturer for repairing the existing roofing system.

2.4 Auxiliary Materials

A. General: Auxiliary preparation materials recommended by roofing system manufacturer for intended use and compatible with components of existing membrane roofing system

B. Insulation: Type used in original roof construction in thickness necessary to achieve satisfactory repair of membrane with no ponded water.

C. Wood Blocking and Nailers: As specified in Division 06.

D. Mechanical Fasteners and Disks: Appropriate for purpose intended and approved by UL or FM; length required for thickness of materials, fluoropolymer finish complete with disks; manufacturer as required by membrane manufacturer.

2.5 Sheet Metal Flashing and Trim

A. Metallic-Coated Steel Sheet: Provide zinc-coated (galvanized) steel sheet in accordance with ASTM A653/A653M, G90 (Z275) coating designation or aluminum-zinc alloy-coated steel sheet in accordance with ASTM A792/A792M, Class AZ50 (Class AZM150) coating designation, Grade 40 (Grade 275); prepainted by coil-coating process to comply with ASTM A755/A755M.
1. Surface: Smooth, flat.
2. Exposed Coil-Coated Finish:
   a. Two-Coat Fluoropolymer: AAMA 621. Fluoropolymer finish containing not less than 70 percent polyvinylidene fluoride (PVDF) resin by weight in color coat. Prepare, pretreat, and apply coating to exposed metal surfaces to comply with coating and resin manufacturers' written instructions.
   b. Color: As selected by Architect from manufacturer's full range.
3. Concealed Finish: Pretreat with manufacturer's standard white or light-colored acrylic or polyester backer finish, consisting of prime coat and wash coat with minimum total dry film thickness of 0.5 mil (0.013 mm)

2.6 Prefabricated Curb

A. Roof curb mounting assemblies: Factory fabricated hollow sheet metal construction, internally reinforced, and capable of supporting superimposed live and dead loads and designated equipment load with fully mitered and sealed corner joints welded or mechanically fastened, and integral counterflashing with top and edges formed to shed water.
1. Sheet material: Provide zinc-coated (galvanized) steel sheet in accordance with ASTM A653/A653M, SS Grade 33 ; G60 coating designation;18 gauge, 0.048 inch thick, with welded corners and seams joined by continuous water- and air-tight welds.
2. Roofing cants: Provide integral sheet metal roofing cants dimensioned to begin slope at top of roofing system at 1:1 slope; minimum cant height 4 inches.
3. Fabricate curb bottom and mounting flanges for installation directly on existing roof system to match slope and configuration of system.

2.7 Vent Pipe Boot (Retrofit)

A. One-piece vent pipe boot with pre-formed flange to fit circular roof penetration

2.8 Roof Pipe Support System

A. Non-Penetrating Rooftop Support/Assemblies: Manufacturer-engineered and factory-fabricated, with pedestal bases that rest on top of roofing membrane, and not requiring any attachment to roof structure and not penetrating roofing assembly.
1. Design Loadings and Configurations: As required by applicable codes.
2. Support Spacing and Base Sizes: As required to distribute load sufficiently to prevent indentation of roofing assembly.
3. Steel Components: Stainless steel, or carbon steel hot-dip galvanized after fabrication in accordance with ASTM A653/A653M.
4. Hardware, Bolts, Nuts, and Washers: Stainless steel, or carbon steel hot-dip galvanized after fabrication in accordance with ASTM A153/A153M.

B. Pipe Supports: Provide attachment fixtures complying with MSS SP-58 and as indicated.
1. Attachment/Support Fixtures: As recommended by manufacturer, same type as indicated for equivalent indoor hangers and supports; corrosion resistant material.
2. See relevant piping system specification section for additional requirements.

2.9 Fabrication, General

A. Custom fabricate sheet metal flashing and trim to comply with details indicated and recommendations in cited sheet metal standard that apply to design, dimensions, geometry, metal thickness, and other characteristics of item required.
1. Fabricate sheet metal flashing and trim in shop to greatest extent possible.
2. Fabricate sheet metal flashing and trim in thickness or weight needed to comply with performance requirements, but not less than that specified for each application and metal.
3. Verify shapes and dimensions of surfaces to be covered and obtain field measurements for accurate fit before shop fabrication.
4. Form sheet metal flashing and trim to fit substrates without excessive oil-canning, buckling, and tool marks; true to line, levels, and slopes; and with exposed edges folded back to form hems.
5. Conceal fasteners and expansion provisions where possible. Do not use exposed fasteners on faces exposed to view.

B. Sealant Joints: Where movable, nonexpansion-type joints are required, form metal in accordance with cited sheet metal standard to provide for proper installation of elastomeric sealant.

C. Fabricate cleats and attachment devices from same material as accessory being anchored or from compatible, noncorrosive metal.

D. Fabricate cleats and attachment devices of sizes as recommended by cited sheet metal standard and by FM Global Property Loss Prevention Data Sheet 1-49 for application, but not less than thickness of metal being secured.

E. Seams:
1. Fabricate nonmoving seams with flat-lock seams. Form seams and seal with elastomeric sealant unless otherwise recommended by sealant manufacturer for intended use.

F. Do not use graphite pencils to mark metal surfaces.

G. Base Flashing: Shop fabricate interior and exterior corners. Fabricate from the following materials:
1. Galvanized Steel: 0.028 inch (0.71 mm) thick.

H. Counterflashing: Shop fabricate interior and exterior corners. Fabricate from the following materials:
1. Galvanized Steel: 0.022 inch (0.56 mm) thick.

I. Flashing Receivers: Fabricate from the following materials:
1. Galvanized Steel: 0.022 inch (0.56 mm) thick.

J. Roof-Penetration Flashing: Fabricate from the following materials:
1. Stainless Steel Sheet: 0.019 inch (0.48 mm) thick. ASTM A240/A240M, Type 304, dead soft, fully annealed; with smooth, flat surface.

3.1 Examination

A. Examine substrates, areas, and conditions under which roofing modifications will be performed with Installer present for compliance with requirements.

B. Verify that roof openings and penetrations are in place and set and braced and that roof drains are properly clamped into position.

C. Verify that wood blocking, curbs, and nailers are securely anchored to roof deck at roof penetrations and terminations and match the thicknesses of insulation required.

D. Do not proceed with installation until unsatisfactory conditions have been corrected.

E. Do not apply roofing materials to damp, frozen, dirty, dusty or other surface conditions which are unacceptable to manufacturer or applicator.

3.2 Preparation

A. Clean substrate of dust, debris, and other substances detrimental to roofing installation according to roofing system manufacturer's written instructions. Remove sharp projections.

B. Prepare roof surfaces as recommended by manufacturer of original installation.

C. Protect existing membrane roofing system that is indicated not to be modified.
1. Limit traffic and material storage to areas of existing roofing membrane that have been protected.

D. Coordinate with Owner to shut down air intake equipment in the vicinity of the Work. Cover air intake louvers before proceeding with roof modification work that could affect indoor air quality or activate smoke detectors in the ductwork.

E. During removal operations, have sufficient and suitable materials on-site to facilitate rapid installation of temporary protection in the event of unexpected rain.

F. Maintain roof drains in functioning condition to ensure roof drainage at end of each workday. Prevent debris from entering or blocking roof drains and conductors. Use roof-drain plugs specifically designed for this purpose. Remove roof-drain plugs at end of each workday, when no work is taking place, or when rain is forecast.
1. If roof drains will be temporarily blocked or unserviceable due to roofing system removal or partial installation of new membrane roofing system, provide alternative drainage method to remove water and eliminate ponding. Do not permit water to enter into or under existing membrane roofing system components that are to remain.

G. Verify that rooftop utilities and service piping have been shut off before commencing Work.

H. Make necessary repairs. Match exiting roof slop, insulation materials and roofing membrane materials, except as otherwise approved by the existing roofing system manufacturer to accommodate new construction and repair work.

3.3 Protection

A. Protect existing building surfaces against damage from roofing installation.

B. Provide temporary seals to prevent water from entering completed sections of the roofing system at the end of the workday or when rain is forecast. Remove and discard temporary seals before beginning work on adjoining roofing.

3.4 Partial Roof Removal

A. Partial Roof Tear-Off: Where indicated, remove existing roofing membrane and other membrane roofing system components down to the deck and as required to allow for proper patching of existing roof, and tie-in to new roofing system.
1. Remove cover boards, roof insulation, and substrate boards.
2. Remove fasteners from deck or cut fasteners off slightly above deck surface.

3.5 Deck Preparation

A. Inspect deck after partial tear-off of membrane roofing system.

B. Steel Decks:
1. Verify that deck is securely fastened with no projecting fasteners and with no adjacent units in excess of 1/16 inch out of plane relative to adjoining deck.
2. If broken or loose fasteners that secure deck panels to one another or to structure are observed, or if deck appears or feels inadequately attached, immediately notify Architect. Do not proceed with installation until directed by Architect.

3.6 Installation

A. Sheet Metal Flashing Installation: Install sheet metal flashing and trim to comply with details indicated and recommendations of cited sheet metal standard that apply to installation characteristics required unless otherwise indicated on Drawings.

B. Roof accessories: Install in accordance with manufacturer's instructions, in manner that maintains roofing system weather-tight integrity.

3.7 Flashing and Repair Work

A. General: Perform work in accordance with instructions and recommendations of manufacturer of original installation materials.

B. Clean substrate of contaminants such as dirt, debris, oil, and grease that can affect adhesion of roof patching materials.

C. Cut holes for penetrations neatly and in accordance with Section 01 73 00 Execution.

D. Where continuity of existing fastener pattern has been interrupted by cutting and patching work, provide additional uplift securement for existing roofing system with new screws and plates applied to each roof zone to comply with same wind uplift requirements as specified for new roofing work.

E. Lay base flashing and seal down to membrane and penetration.

F. Counterflash as required.

G. Install curb flashing for new roof top equipment.

H. Make watertight.

I. Do not damage metal counterflashings that are to remain. Replace metal counterflashings damaged during removal with counterflashings of same metal, weight or thickness, and finish.

3.8 Field Quality Control

A. Final Roof Inspection: Arrange for roofing system manufacturer's technical personnel to inspect roofing installation on completion and submit report to Architect.
1. Notify Architect and Owner 48 hours in advance of the date and time of inspection.

B. Repair or remove and replace components of roofing system where test results or inspections indicate that they do not comply with specified requirements.

3.9 Disposal

A. Collect and place demolished materials in containers. Promptly dispose of demolished materials. Do not allow demolished materials to accumulate on-site.

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

ARCHITECTURAL SPECIFICATIONS

G019

1. Storage or sale of demolished items or materials on-site will not be permitted.

B. Transport demolished materials off Owner's property and legally dispose of them.

SECTION 07 21 00 - THERMAL INSULATION

1.1 Related Documents

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 Summary

A. Section Includes:
1. Extruded polystyrene foam-plastic board insulation.
2. Polyisocyanurate foam-plastic board insulation.
3. Glass-fiber blanket insulation.
4. Glass-fiber board insulation.
5. Mineral-wool blanket insulation.
6. Vapor barrier.

B. Related Requirements:
1. Section 06 10 00 - Rough Carpentry for foam-plastic board sheathing installed directly over wood or steel framing.
2. Section 07 01 53 - Roof Modifications

1.3 Action Submittals

A. Product Data: For the following:
1. Extruded polystyrene foam-plastic board insulation.
2. Polyisocyanurate foam-plastic board insulation.
3. Glass-fiber blanket insulation.
4. Glass-fiber board insulation.
5. Mineral-wool blanket insulation.
6. Vapor Barrier.

1.4 Informational Submittals

A. Installer's Certification: Listing type, manufacturer, and R-value of insulation installed in each element of the building thermal envelope.
1. For blown-in or sprayed fiberglass and cellulosic-fiber loose-fill insulation, indicate initial installed thickness, settled thickness, settled R-value, installed density, coverage area, and number of bags installed.
2. Sign, date, and post the certification in a conspicuous location on Project site.

B. Product Test Reports: For each product, for tests performed by a qualified testing agency.

C. Research Reports: For foam-plastic insulation, from ICC-ES.

1.5 Delivery, Storage, and Handling

A. Protect insulation materials from physical damage and from deterioration due to moisture, soiling, and other sources. Store inside and in a dry location. Comply with manufacturer's written instructions for handling, storing, and protecting during installation.

B. Protect foam-plastic board insulation as follows:
1. Do not expose to sunlight except to necessary extent for period of installation and concealment.
2. Protect against ignition at all times. Do not deliver foam-plastic board materials to Project site until just before installation time.
3. Quickly complete installation and concealment of foam-plastic board insulation in each area of construction.

2.1 Extruded Polystyrene Foam-Plastic Board Insulation

A. Extruded Polystyrene Board Insulation, Type IV : ASTM C578, Type IV, 25 psi minimum compressive strength; unfaced.
1. Extruded polystyrene foam rigid board insulation: Dow Chemical Co., 866-583-2583, internet www.dowbuildingmaterials.com
a. Type: Dow "Styrofoam" Type IV, 1.6 pcf minimum density, 25 psi compressive strength complying with ASTM C 578, R-value equal 5 per inch of thickness. Provide lengths and widths as required to coordinate with space insulated.
b. Perimeter foundation walls: Styrofoam SE, R-value R-49.
2. Flame-Spread Index: Not more than 25 when tested in accordance with ASTM E84.
3. Smoke-Developed Index: Not more than 450 when tested in accordance with ASTM E84.
4. Fire Propagation Characteristics: Passes NFPA 285 testing as part of an approved assembly.
5. Labeling: Provide identification of mark indicating R-value of each piece of insulation 12 inches and wider in width.

2.2 Polyisocyanurate Foam-Plastic Board Insulation

A. Polyisocyanurate Board Insulation, Foil Faced :ASTM C1289, foil faced, Type I, Class 1.
1. Fire Propagation Characteristics: Passes NFPA 285 testing as part of an approved assembly.
2. Labeling: Provide identification of mark indicating R-value of each piece of insulation 12 inches and wider in width.
3. Long-Term Thermal Resistance: R-49.

B. Polyisocyanurate Board Insulation, Glass-Fiber-Mat Faced : ASTM C1289, glass-fiber-mat faced, Type II, Class 1.
1. Fire Propagation Characteristics: Passes NFPA 285 testing as part of an approved assembly.
2. Labeling: Provide identification of mark indicating R-value of each piece of insulation 12 inches and wider in width.
3. Long-Term Thermal Resistane: R-49.

2.3 Glass-Fiber Blanket Insulation

A. Glass-Fiber Blanket Insulation, Unfaced : ASTM C665, Type I, Class II; passing ASTM E136 for combustion characteristics.
1. Glass fiber batt/blanket insulation: Owens Corning Corp., (800) 438-7465, internet www.owenscorning.com.
a. Type: Owens Corning " Thermal Batt" Type I unfaced glass fibers and binders formed into flexible blankets or batts complying with ASTM C665,. Provide lengths and widths required to coordinate with spaces insulated.
(1) Cavity Insulation: Class II, R-20
(2) Below Deck Insulation: Class ii, R-38. Batts supported with Scrim attached to bottom of trusses. If scrim is exposed, paint to match. Refer to Drawings.
b. Exterior Long-Term Thermal Resistance: Unfaced, R-value/thickness as indicated in Drawings.
2. Flame-Spread Index: Not more than 25 when tested in accordance with ASTM E84.
3. Smoke-Developed Index: Not more than 50 when tested in accordance with ASTM E84.
4. Labeling: Provide identification of mark indicating R-value of each piece of insulation 12 inches and wider in width.

B. Glass-Fiber Blanket Insulation, Foil-Faced : ASTM C665, Type I , Class 1 ; Category 1 (membrane is a vapor barrier).
1. Labeling: Provide identification of mark indicating R-value of each piece of insulation 12 inches and wider in width.

2.4 Glass-Fiber Board Insulation

A. Glass-Fiber Board Insulation, Unfaced : ASTM C612, Class 1; unfaced, passing ASTM E136 for combustion characteristics.
1. Flame-Spread Index: Not more than 25 when tested in accordance with ASTM E84.
2. Smoke-Developed Index: Not more than 50 when tested in accordance with ASTM E84.
3. Nominal Density: 2.25 lb/cu. ft..
4. Thermal Resistivity: 4.3 deg F x h x sq. ft./Btu x in. at 75 deg F.
5. Exterior Long-Term Thermal Resistance: R-49.
6. Labeling: Provide identification of mark indicating R-value of each piece of insulation 12 inches and wider in width.

B. Glass-Fiber Board Insulation, Faced : ASTM C612, Class 1; faced on one side with foil-scrim-kraft or foil-scrim-polyethylene vapor retarder.
1. Flame-Spread Index: Not more than 25 when tested in accordance with ASTM E84.
2. Smoke-Developed Index: Not more than 50 when tested in accordance with ASTM E84.
3. Nominal Density: 2.25 lb/cu. ft..
4. Thermal Resistivity: 4.3 deg F x h x sq. ft./Btu x in. at 75 deg F.
5. Exterior Long-Term Thermal Resistance: R-49.
6. Labeling: Provide identification of mark indicating R-value of each piece of insulation 12 inches and wider in width.

2.5 Mineral-Wool Blanket Insulation

A. Mineral-Wool Blanket Insulation, Unfaced : ASTM C665, Type I (blankets without membrane facing); consisting of fibers; passing ASTM E136 for combustion characteristics.
1. Flame-Spread Index: Not more than 25 when tested in accordance with ASTM E84.
2. Smoke-Developed Index: Not more than 50 when tested in accordance with ASTM E84.
3. Labeling: Provide identification of mark indicating R-value of each piece of insulation 12 inches and wider in width.

2.6 Vapor Barrier Membrane

A. Polyethylene, minimum 6 mils thick, complying with ASTM D 4397, maximum permeance rating of 0.13 perm.
1. Joint tape: Pressure sensitive tape designed for sealing joints and penetrations of above and below grade vapor barrier sheets.
2. Mounting tape: Double-faced pressure sensitive tape suitable for mounting vapor barriers to steel framing.

2.7 Insulation Fasteners

A. Adhesively Attached, Spindle-Type Anchors: Plate welded to projecting spindle; capable of holding insulation of specified thickness securely in position with self-locking washer in place.
1. Plate: Perforated, galvanized carbon-steel sheet, 0.030 inch thick by 2 inches square.
2. Spindle: Copper-coated, low-carbon steel; fully annealed; 0.105 inch in diameter; length to suit depth of insulation.

B. Adhesively Attached, Angle-Shaped, Spindle-Type Anchors: Angle welded to projecting spindle; capable of holding insulation of specified thickness securely in position with self-locking washer in place.
1. Angle: Formed from 0.030 inch- thick, perforated, galvanized carbon-steel sheet with each leg 2 inches square.
2. Spindle: Copper-coated, low-carbon steel; fully annealed; 0.105 inch in diameter; length to suit depth of insulation.

C. Insulation-Retaining Washers: Self-locking washers formed from 0.016 inch- thick galvanized-steel sheet, with beveled edge for increased stiffness, sized as required to hold insulation securely in place, but not less than 1-1/2 inches square or in diameter.
1. Protect ends with capped self-locking washers incorporating a spring steel insert to ensure permanent retention of cap in the following locations:
a. Ceiling plenums.
b. Attic spaces.

D. Insulation Standoff: Spacer fabricated from galvanized mild-steel sheet for fitting over spindle of insulation anchor to maintain air space of 1 inch between face of insulation and substrate to which anchor is attached.

E. Anchor Adhesive: Product with demonstrated capability to bond insulation anchors securely to substrates without damaging insulation, fasteners, or substrates.

2.8 Accessories

A. Insulation for Miscellaneous Voids:
1. Glass-Fiber Insulation: ASTM C764, Type II, loose fill; with maximum flame-spread and smoke-developed indexes of 5, per ASTM E84.
2. Spray Polyurethane Foam Insulation: ASTM C1029, Type II, closed cell, with maximum flame-spread and smoke-developed indexes of 75 and 450, respectively, per ASTM E84.

B. Adhesive for Bonding Insulation: Product compatible with insulation and air and water barrier materials, and with demonstrated capability to bond insulation securely to substrates without damaging insulation and substrates.

3.1 Preparation

A. Clean substrates of substances that are harmful to insulation, including removing projections capable of puncturing insulation or vapor retarders, or that interfere with insulation attachment.

3.2 Installation, General

A. Comply with insulation manufacturer's written instructions applicable to products and applications.

B. Install insulation that is undamaged, dry, and unsoiled and that has not been left exposed to ice, rain, or snow at any time.

C. Install insulation in single layer of required thickness over entire area to be insulated.

D. Install insulation with manufacturer's R-value label exposed after insulation is installed.

E. Install exterior wall and ceilining insulation continuous behind electrical boxes, conduit, piping and ductwork.

F. Extend insulation to envelop entire area to be insulated. Fit tightly around obstructions and fill voids with insulation. Remove projections that interfere with placement.

G. Provide sizes to fit applications and selected from manufacturer's standard thicknesses, widths, and lengths. Apply single layer of insulation units unless multiple layers are otherwise shown or required to make up total thickness or to achieve R-value.

3.3 Installation of Slab Insulation

A. On vertical slab edge and foundation surfaces, set insulation units using manufacturer's recommended adhesive according to manufacturer's written instructions.
1. If not otherwise indicated, extend insulation a minimum of 36 inches below exterior grade line.

B. On horizontal surfaces, loosely lay insulation units according to manufacturer's written instructions. Stagger end joints and tightly abut insulation units.
1. If not otherwise indicated, extend insulation a minimum of 36 inches in from exterior walls.

C. Install rigid foam insulation vertically from top of slab to frost line or horizontally under slabs, extending a minimum of 36 inches in from exterior walls.

D. Protoect insulation from displacement and damage during backfilling and slab replacement.

3.4 Installation of Foundation Wall Insulation

A. Install rigid foam insulation vertically from top of slab to frost line or horizontally under slabs, extending a minimum 36 inches in from exterior walls.

B. Protect insulation from displacement and damage during backfilling and slab placement.

C. Butt panels together for tight fit.

D. Anchor Installation: Install board insulation on concrete substrates by adhesively attached, spindle-type insulation anchors as follows:
1. Fasten insulation anchors to concrete substrates with insulation anchor adhesive according to anchor manufacturer's written instructions.
2. Space anchors according to insulation manufacturer's written instructions for insulation type, thickness, and application.
3. Apply insulation standoffs to each spindle to create cavity width indicated on Drawings between concrete substrate and insulation.
4. After adhesive has dried, install board insulation by pressing insulation into position over spindles and securing it tightly in place with insulation-retaining washers, taking care not to compress insulation.
5. Where insulation will not be covered by other building materials, apply capped washers to tips of spindles.

E. Adhesive Installation: Install with adhesive or press into tacky waterproofing or dampproofing according to manufacturer's written instructions.

3.5 Installation of Cavity-Wall Insulation

A. Foam-Plastic Board Insulation: Install pads of adhesive spaced approximately 24 inches o.c. both ways on inside face and as recommended by manufacturer.
1. Fit courses of insulation between wall ties and other obstructions, with edges butted tightly in both directions, and with faces flush.
2. Press units firmly against inside substrates.
3. Supplement adhesive attachment of insulation by securing boards with two-piece wall ties designed for this purpose and specified in Section 042000 "Unit Masonry."

3.6 Installation of Insulation in Framed Construction

A. Blanket Insulation: Install in cavities formed by framing members according to the following requirements:
1. Use insulation widths and lengths that fill the cavities formed by framing members. If more than one length is required to fill the cavities, provide lengths that will produce a snug fit between ends.
2. Place insulation in cavities formed by framing members to produce a friction fit between edges of insulation and adjoining framing members.
3. Maintain 3 inch clearance of insulation around recessed lighting fixtures not rated for or protected from contact with insulation.
4. Attics: Install eave ventilation troughs between roof framing members in insulated attic spaces at vented eaves.
5. Provide galvanized wire mesh or metal strapping to provide supplementary support when required to maintain insulation in permanent proper location.
6. Install batt/blanket insulation full height at exterior wall framing.
7. For metal-framed wall cavities where cavity heights exceed 96 inches, support unfaced blankets mechanically and support faced blankets by taping flanges of insulation to flanges of metal studs.
8. For wood-framed construction, install blankets according to ASTM C1320 and as follows:
a. With faced blankets having stapling flanges, lap blanket flange over flange of adjacent blanket to maintain continuity of vapor retarder once finish material is installed over it.
9. Vapor-Retarder-Faced Blankets: Tape joints and ruptures in vapor-retarder facings, and seal each continuous area of insulation to ensure airtight installation.
a. Exterior Walls: Set units with facing placed toward interior of construction.
b. Interior Walls: Set units with facing placed as indicated on Drawings.

B. Miscellaneous Voids: Install insulation in miscellaneous voids and cavity spaces where required to prevent gaps in insulation using the following materials:
1. Glass-Fiber Insulation: Compact to approximately 40 percent of normal maximum volume equaling a density of approximately 2.5 lb/cu. ft..
2. Spray Polyurethane Insulation: Apply according to manufacturer's written instructions.

3.7 Installation of Vapor Barriers

A. Install a single layer of vapor barrier membrane over the interior of exterior metal wall framing after installation of insulation. Secure with double faced tape at wall framing.

B. Provide single unspliced material height. Horizontal joints not acceptable. Minimize vertical joints. Lap vertical joints and secure in place with joints taped. Provide tape sealed contact with door frames, window frames, piping, conduit, ductwork, registers and the vapor barrier.

C. Seal all cuts and penetrations of vapor barrier membrane with tape before installing surface finishes.

3.8 Protection

A. Protect installed insulation from damage due to harmful weather exposures, physical abuse, and other causes.

B. Provide temporary coverings or enclosures where insulation is subject to abuse and cannot be concealed and protected by permanent construction immediately after installation.

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ARCHITECTURAL SPECIFICATIONS

G020

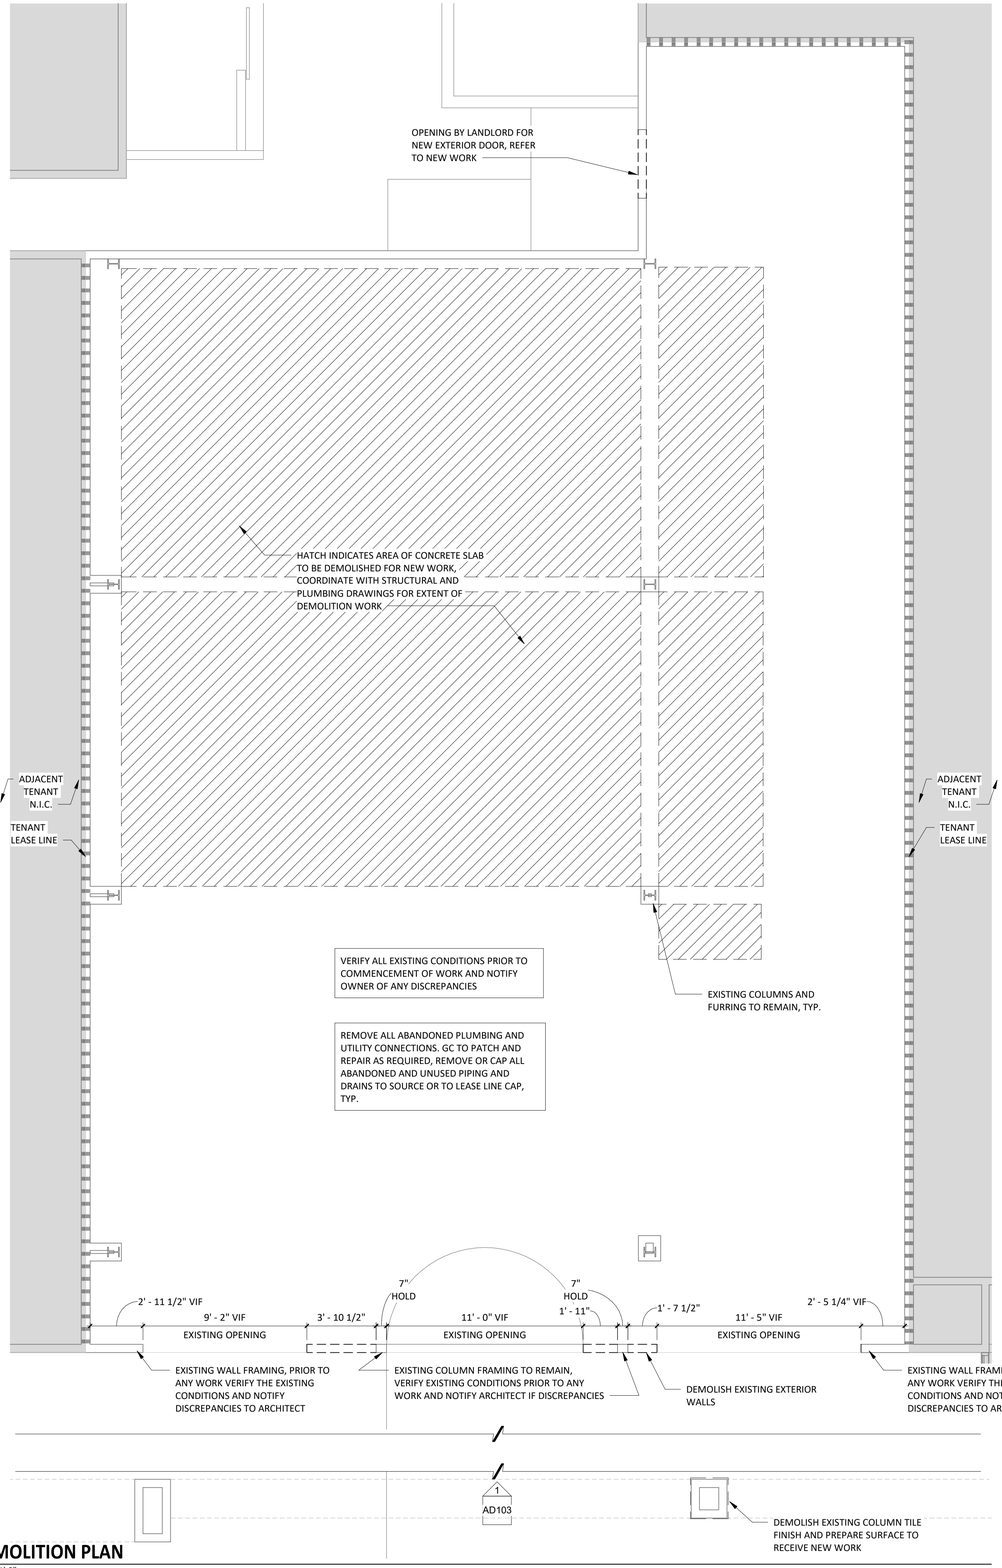

TRUE NORTH PLAN NORTH 1 AD100

DEMOLITION PLAN

1/4" = 1'-0"

GENERAL DEMOLITION NOTES

1. DEMOLISHED MATERIALS SHALL BECOME THE GENERAL CONTRACTOR'S PROPERTY AND SHALL BE REMOVED FROM THE SITE WITH FURTHER DISPOSITION AND RECYCLED BY THE GENERAL CONTRACTOR'S OPTION, UNLESS NOTED OTHERWISE.
2. REMOVE FINISH MATERIALS (INCLUDING WALLCOVERING, ETC) THROUGHOUT, UON PREPARE SURFACES FOR NEW FINISHES.
3. REMOVE DOORS, FRAMES, AND HARDWARE AS NOTED AND SAVE FOR REINSTALLATION UON.
4. REMOVE DEMOUNTABLE PARTITIONS AS NOTED AND SAVE FOR REINSTALLATION UON.
5. REMOVE AND DISCARD FLOOR FINISHES AND WALL BASE AS WELL AS FLASH PATCH, MASTIC AND ADHESIVES DOWN TO THE STRUCTURAL CONCRETE FLOOR SLAB AND PREPARE FOR NEW FINISHES UON.
6. REMOVE MATERIALS CREATING UNEVEN, OUT OF TOLERANCE SUBSTRATE INCLUDING BUT NOT LIMITED TO FASTENERS, COVER PLATES, RESILIENT FLOORING, CARPET PAD, ETC.
7. REMOVE CABINETRY, SIGNAGE, CORNER GUARDS, SHELVING, EQUIPMENT, EXPOSED BLOCKING, WALL MOUNTED ACCESSORIES UON.
8. REMOVE ALL ABANDONED EQUIPMENT AND DEVICES WITH ANY ASSOCIATED DUCTWORK, WIRING, PLUMBING LINES BACK TO SOURCE AND CAP AS REQUIRED.
9. LIFE SAFETY DEVICES SHALL REMAIN OPERATIONAL DURING DEMOLITION AND CONSTRUCTION.
10. DO NOT DEMOLISH ANY LOAD BEARING WALLS OR CONSTRUCTION THAT WILL COMPROMISE THE STRUCTURAL INTEGRITY OF THE STRUCTURE. NOTIFY OWNER AND ARCHITECT OF ANY STRUCTURAL ISSUES THAT ARISE FROM DEMOLITION.
11. PROTECT MATERIALS, FINISHES AND DEVICES TO REMAIN DURING DEMOLITION.
12. MAINTAIN CLEANLINESS OF COMMON SPACES DURING AND FOLLOWING DEMOLITION.
13. MAINTAIN ACCESSIBLE PATH OF TRAVEL AND RELOCATED ACCOMMODATIONS DURING CONSTRUCTION.
14. ANY EQUIPMENT OR DEVICES TO BE REMOVED WITH ANY ASSOCIATE WIRING OR PLUMBING REMOVED BACK TO SOURCE AND CAPPED AS REQUIRED.
15. REFER TO STRUCTURAL, PLUMBING, ELECTRICAL, AND MECHANICAL DRAWINGS FOR FULL SCOPE OF DEMOLITION WORK.
16. DRAWINGS INDICATE AN APPROXIMATION OF THE BUILDING CONSTRUCTION, CONDITIONS, AND DIMENSIONS. PLEASE NOTE NOT ALL AREAS OF THE BUILDING WERE READILY OBSERVABLE DURING DESIGN; HOWEVER BEST ATTEMPT EFFORTS WERE MADE TO SPECULATE EXISTING CONSTRUCTION ASSEMBLIES AND METHODS. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VISIT THE SITE AND VERIFY ALL EXISTING CONDITIONS, INCLUDING REQUIRED DEMOLITION OF THE BUILDING & ITS CONTENTS, ACCOMMODATION OF DEMOLITION REMOVAL, AND NEW CONSTRUCTION SCOPE OF WORK IN ACCORDANCE WITH THE REQUIREMENTS TO PERFORM THE NEW WORK. ADDITIONALLY, THESE DRAWINGS MAY NOT INCLUDE ALL EXISTING CONDITIONS WHICH MAY AFFECT THE WORK OF THIS CONTRACT. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO FIELD VERIFY ALL CONDITIONS BEFORE BEGINNING CONSTRUCTION.
17. PROVIDE INTERIOR AND EXTERIOR SHORING, BRACING, OR SUPPORT AS NECESSARY TO PREVENT MOVEMENT, SETTLEMENT, OR DAMAGE TO STRUCTURES TO BE DEMOLISHED AND ADJACENT FACILITIES TO REMAIN. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL MEANS AND METHODS OF STABILIZATION OF THE EXISTING AND ADJACENT STRUCTURES DURING AND AFTER DEMOLITION OF THE BUILDING, INCLUDING ANY ADDITIONAL BRACING NOT SPECIFICALLY INDICATED ON THE ATTACHED DRAWINGS, AS REQUIRED BY CONDITIONS IN THE FIELD.
18. WALLS AND INTERIOR CONSTRUCTION SHALL BE REMOVED IN THEIR ENTIRETY TO EXTENT INDICATED ON THE DRAWINGS AND AS REQUIRED TO ACCOMMODATE NEW CONSTRUCTION. EXISTING WALLS (OR PORTIONS OF WALLS) TO BE REMOVED SHALL BE CUT FLUSH WHERE INTERSECTED WITH WALLS TO REMAIN. REMAINING WALLS TO BE PATCHED AND FINISHED SMOOTH. NEW OPENINGS TO BE CUT IN EXISTING WALLS SHALL BE SAW-CUT AT LOCATIONS INDICATED, TO THE HEIGHT AND WIDTH INDICATED, AND SMOOTHED/PATCHED AS NECESSARY FOR INSTALLATION OF FRAMES. NEW LINTELS SHALL BE INSTALLED TO SUPPORT EXISTING WALL CONSTRUCTION ABOVE AS INDICATED ON THE DRAWINGS, OR IF NOT INDICATED, AS REQUIRED FOR NEW WALL CONSTRUCTION PER STRUCTURE DRAWINGS.
19. REMOVE MECHANICAL, ELECTRICAL, AND PLUMBING FIXTURES, EQUIPMENT, AND DISTRIBUTION SYSTEMS TO THE EXTENT INDICATED AND AS REQUIRED TO ACCOMMODATE NEW CONSTRUCTION. CAP AND/OR RECONNECT ANY UTILITIES SERVING OTHER PORTIONS OF THE BUILDING OR ADJACENT PROPERTIES ACCORDING TO THE METHODS REQUIRED BY THE APPROPRIATE UTILITY AUTHORITY AND/OR AS INDICATED ON THE DRAWINGS.
20. PATCHING IS REQUIRED WHERE DEMOLITION OF ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND STRUCTURAL SYSTEMS LEAVES HOLES, VOIDS, OR UNFINISHED CONDITIONS AT FINISHED WALLS, FLOORS, AND CEILINGS. FILL ALL FLOOR AND WALL PENETRATIONS RESULTING FROM PIPING AND CONDUIT REMOVAL WITH NON-SHRINK GROUT, READY TO RECEIVE FINAL FLOOR OR WALL FINISH.
21. REPAIR CONCRETE FLOOR SLAB AND PATCH, LEVEL AND REPAIR FLOOR SLAB AS REQUIRED FOR INSTALLATION OF NEW FLOORING.
22. CLEAN AND PATCH ALL REMAINING WALL, FLOOR AND CEILING SURFACES DAMAGED BY DEMOLITION TO A CONDITION REQUIRED TO RECEIVE NEW CONSTRUCTION, OR IF TO REMAIN EXPOSED TO A CONDITION COMPARABLE TO NEW CONSTRUCTION. THIS SHALL INCLUDE, BUT NOT BE LIMITED TO: TOOTHING IN NEW CONCRETE MASONRY TO REPLACE EXPOSED UNITS DAMAGED BEYOND REPAIR BY DEMOLITION; LEVELING (OR TAPERING) FLOOR SURFACE BETWEEN FLOOR FINISHED AT LOCATION S WALLS ARE REMOVE; AND PATCHING SMOOTH AREAS OF EXPOSED CONCRETE MASONRY STRUCTURE DAMAGED BY REMOVAL OF ADJACENT CONSTRUCTION.

DEMOLITION LEGEND

EXISTING CONSTRUCTION TO REMAIN	
EXISTING CONSTRUCTION TO BE DEMOLISHED	– – – – – – – – – – – – – –

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

DEMOLITION FLOOR PLAN

AD100

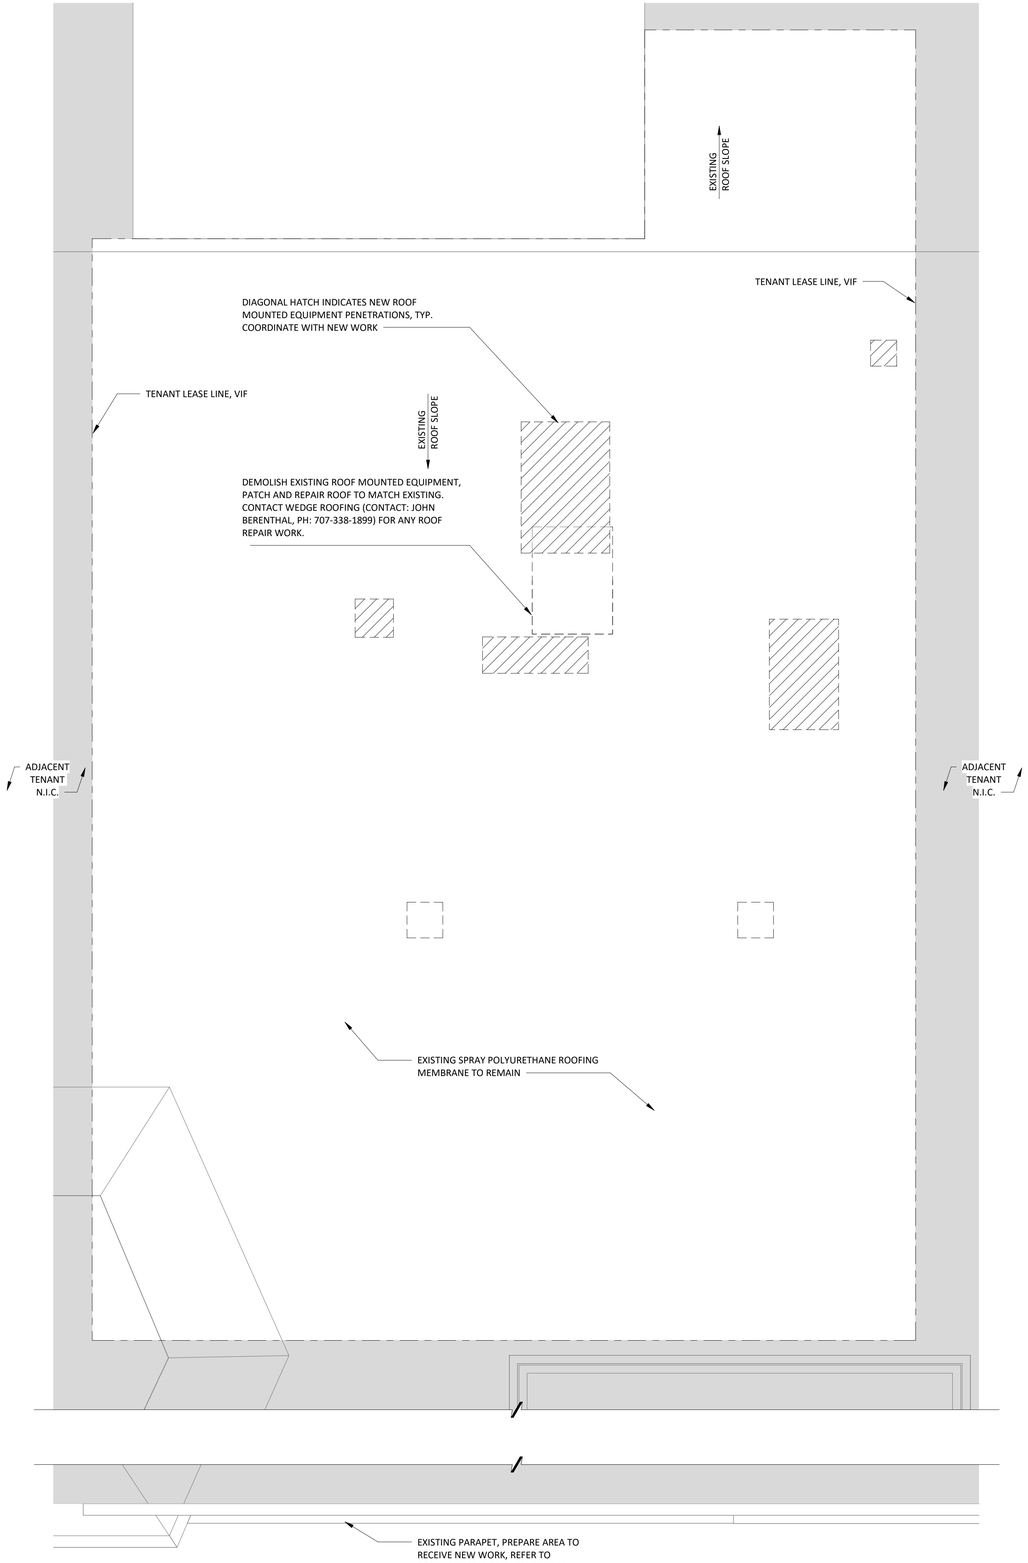

TRUE NORTH PLAN NORTH

1 AD101

DEMOLITION ROOF PLAN

1/4" = 1'-0"

GENERAL DEMOLITION NOTES

1.	DEMOLISH MATERIALS SHALL BECOME GENERAL THE GENERAL CONTRACTOR'S PROPERTY AND SHALL BE REMOVED FROM THE SITE WITH FURTHER DISPOSITION AND RECYCLED BY THE GENERAL CONTRACTOR'S OPTION, UNLESS NOTED OTHERWISE.
2.	SURVEY THE CONDITION OF THE BUILDING TO DETERMINE WHETHER REMOVING ANY ELEMENT MIGHT RESULT IN STRUCTURAL DEFIICIENCY OR UNPLANNED COLLAPSE OF ANY PORTION OF THE STRUCTURE OR ADJACENT STRUCTURES DURING SELECTIVE DEMOLITION.
3.	PERFORM SURVEYS AS THE WORK PROGRESSES TO DETECT HAZARDS RESULTING FROM SELECTIVE DEMOLITION ACTIVITIES.
4.	MAINTAIN UTILITIES TO REMAIN IN SERVICE AND PROTECT THEM AGAINST DAMAGE DURING SELECTIVE DEMOLITION OPERATIONS.
5.	CONDUCT DEMOLITION OPERATIONS AND REMOVE DEBRIS TO ENSURE MINIMAL INTERFERENCE WITH ROADS, STREETS, WALKS, AND OTHER ADJACENT OCCUPIED AND USED FACILITIES. REMOVE & TRANSPORT DEBRIS IN A MANNER THAT WILL PREVENT SPILLAGE ON ADJACENT SURFACES AND AREAS. PROMPTLY DISPOSE OF DEMOLISHED MATERIALS. PROMPTLY DISPOSE OF DEMOLISHED AMTERIALS. DO NOT ALLOW DEMOLISHED MATERIALS TO ACCUMULATE ON SITE.
6.	PROVIDE TEMPORARY WEATHER PROTECTION, DURING INTERVAL BETWEEN DEMOLITION, REMOVAL OF EXISTING EXTERIOR CONSTRUCTION AND NEW CONSTRUCTION TO ENSURE THAT NO WATER DAMAGE OCCURS TO STRUCTURE OR INTERIOR AREAS.
7.	TOTAL SCOPE OF DEMOLITION MAY NOT BE COVERED ON THIS SHEET. REVIEW ALL SHEETS IN THIS DRAWING SET TO DETERMINE TOTAL SCOPE OF DEMOLITION.
8.	REMOVE & TRANSPORT DEBRIS IN A MANNER THAT WILL PREVENT SPILLAGE ON ADJACENT SURFACES AND AREAS.
9.	TRANSPORT DEMOLISHED MATERIALS OFF OWNER'S PROPERTY AND LEGALLY DISPOSE OF THEM.
10.	CLEAN ALL HORIZONTAL SURFACES OF ACCUMULATED DUST AND DEBRIS.
11.	ALL DEMOLITION ITEMS ON THIS SHEET TO BE PERFORMED BY CHIPOTLE'S GENERAL CONTRACTOR, UNLESS NOTED OTHERWISE.
12.	COORDINATE ALL DEMOLITION ACTIVITY WITH BUILDING OWNER'S REPRESETATIVE. SOME DEMOLITION ACTIVIITES MAY BE REQUIRED TO BE PERFORMED ON PREMIUM TIME.
13.	CONTRACTOR SHALL TAKE ADEQUATE PRECAUTIONS TO PROTECT ALL ADJACENT AND REMAINING BUIDLING COMPONENTS.
14.	ALL SALVAGED ITEMS, INCLUDING BUT NOT LIMITED TO LINES, ELECTRICAL PANELS, MAIN COPPER CONDUIT, ETC. SHALL BE CAREFULLY DISASSEMBLED/DISCONNECTED AND STORED IN A SECURE LOCATION FOR POSSIBLE REUSE.
15.	IDENTIFIED SELECTIVE DEMOLITION IS FOR REFERENCE ONLY. ADDITIONAL DEMOLITION MAY BE REQUIRED TO ACCOMMODATE NEW LAYOUT; REFER TO NEW WORK PLANS AND ELEVATIONS. ALL DIMENSIONS SHOWN SHOULD BE VERIFIED IN THE FIELD.
16.	ANY FINISHED SURFACES TO REMAIN THAT ARE AFFECTED BY SELECTIVE DEMOLITION SHALL BE PATCHED TO MATCH EXISITNG ADJACENT SURFACES UNLESS CONCEALED BY NEW CONSTRUCTION.
17.	UTILITIES ABANDONED SHALL BE REMOVED AND CAPPED BEHIND FINISHED SURFACES.
18.	ALL EXTERIOR DOORS, FRAMES AND STOREFRONT TO REMAIN, UNLESS OTHERWISE NOTED.

DEMOLITION LEGEND

EXISTING CONSTRUCTION TO REMAIN	
EXISTING CONSTRUCTION TO BE DEMOLISHED	– – – – – – – – – – – – – – – –

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

DEMOLITION ROOF PLAN

AD101

GENERAL NOTES

1. REFER TO AD100 FOR GENERAL DEMOLITION NOTES AND LEGEND

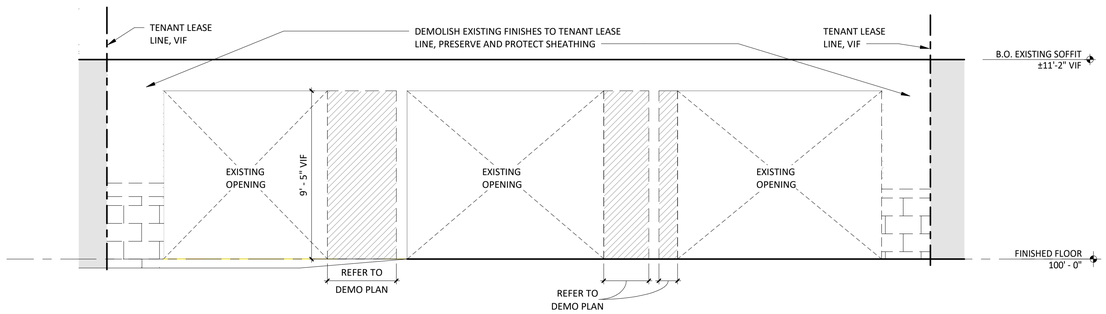

1 AD103 **DEMOLITION - EXTERIOR ELEVATION**

1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

DEMOLITION EXTERIOR ELEVATIONS

AD103

GENERAL NOTES

1. STENCILS FOR PARKING MARKINGS AVAILABLE FROM PAVEMENT STENCIL COMPANY, PHONE: (800) 250-5547, EMAIL: STENCILS@PAVEMENTSTENCIL.COM
2. NOTE: ARCHITECTURAL SITE PLAN IS FOR REFERENCE ONLY. GC TO BUILD FROM CIVIL DRAWINGS. IF THERE IS A DISCREPANCY BETWEEN ARCHITECTURE AND CIVIL, CONTACT ARCHITECT IMMEDIATELY.
3. ALL SITE WORK INCLUDING PAVING, CURBING, PARKING, PARKING LOT LIGHTING, SIDEWALKS, LANDSCAPING AND DUMPSTER ENCLOSURE ARE EXISTING U.N.O.

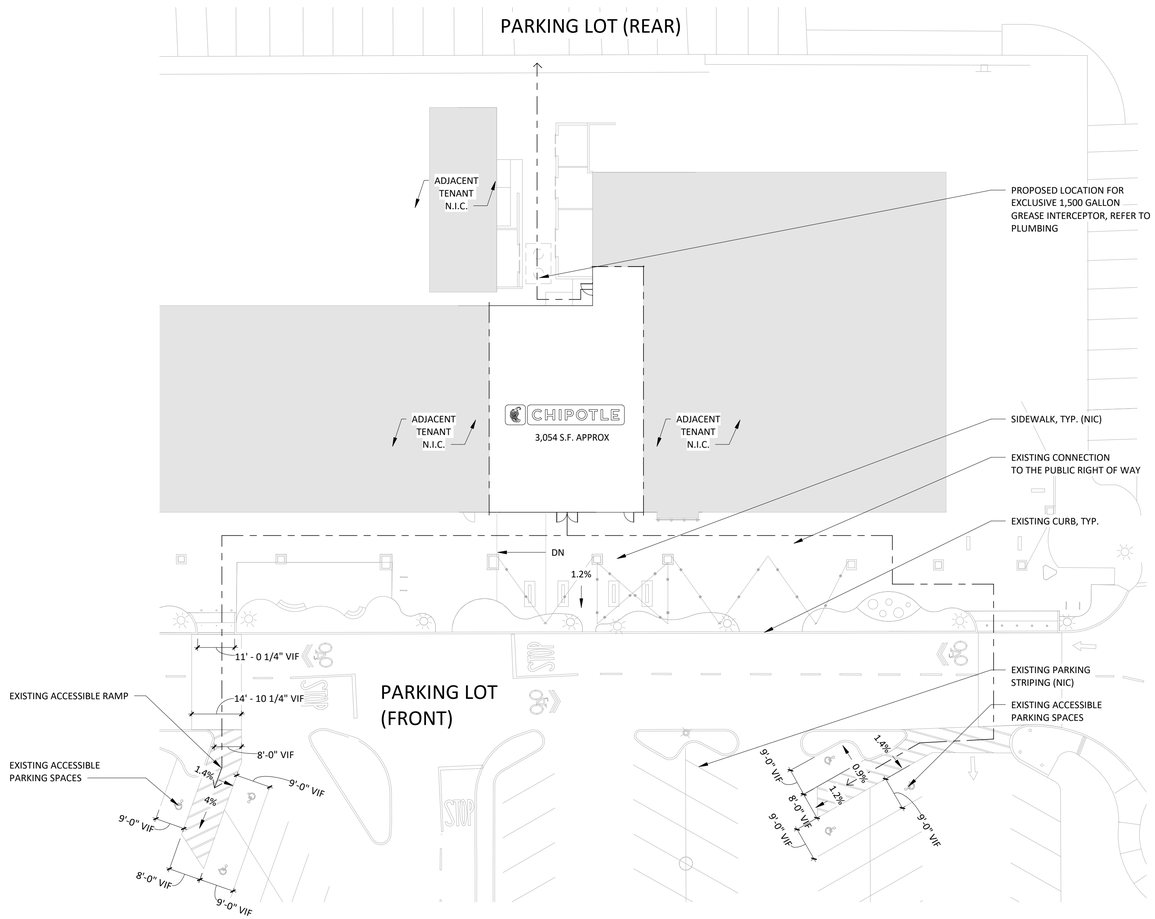

ARCHITECTURAL SITE PLAN

A001 — 3/64" = 1'-0"

TRUE NORTH PLAN NORTH

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

ARCHITECTURAL SITE PLAN

A001

NOTES:
1. THERMOPLASTIC DETECTABLE WARNINGS SHALL BE INSTALLED AS SHOWN IN PLANS AND DETAILS AND TO THE FULL WIDTH OF CURB RAMP OR FLUSH SURFACE. THE DETECTABLE WARNING SHALL BE LOCATED SO THAT THE EDGE NEAREST THE CURB LINE OR OTHER POTENTIAL HAZARD IS 6 TO 8 INCHES FROM THE CURB LINE OR OTHER POTENTIAL HAZARD.

2. THERMOPLASTIC DETECTABLE WARNING SHALL BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS.

3. PRODUCT SHALL BE YELLOW ULINE H-5635/6 OR APPROVED EQUAL.

4. TRUNCATED DOMES ARE INSTALLED THE FULL WIDTH OF THE RAMP OR WALK WAY AND 36" DEEP (PERPENDICULAR TO VEHICULAR WAY).COLOR AND CONTRAST AT DETECTABLE WARNING SURFACES: THE MATERIAL USED TO PROVIDE VISUAL CONTRAST SHALL BE AN INTEGRAL PART OF THE SURFACE. DETECTABLE WARNING SURFACES SHALL BE YELLOW AND APPROXIMATE F.S 33538 OF FEDERAL STANDARD 595C. OR DETECTABLE WARNING SURFACES SHALL PROVIDE A 70 PERCENT MINIMUM VISUAL CONTRAST WITH ADJACENT WALKING SURFACES

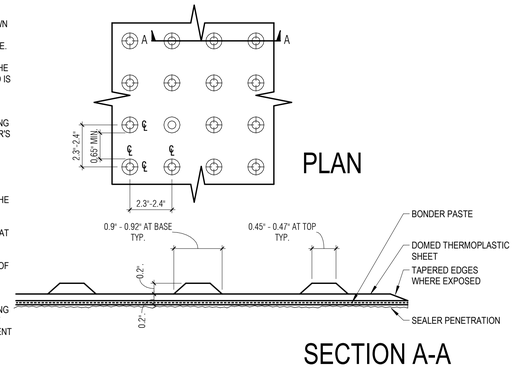

SECTION A-A

TRUNCATED DOMES PER CBC 11B-705.1.

A002 — 3" = 1'-0"

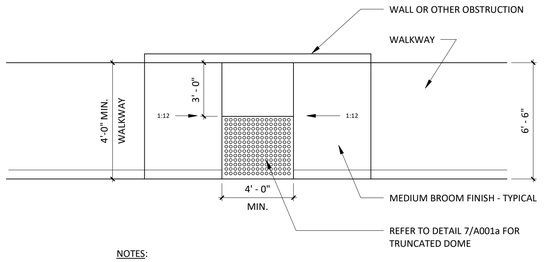

NOTES:
1. ALL PAINT ON WALKING SURFACES SHALL BE SLIP RESISTANT PER 2022 CBC 1003.4 AND 11B-302.1
2. RUNNING WALKING SURFCES: 1:20 MAX.
3. CROSS SLOPE WALKING SURFACES: 1:48 MAX.

PARALLEL CURB RAMP

5 / A002 — 1/4" = 1'-0" (FOR REFERENCE ONLY)

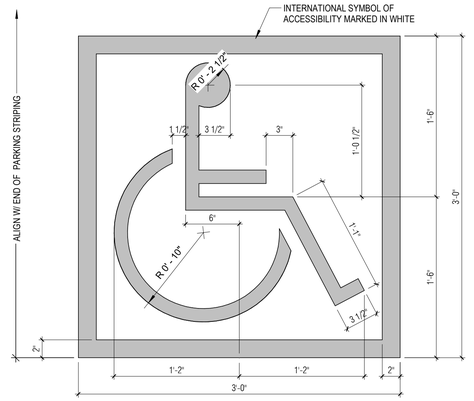

ACCESSIBILITY SYMBOL DETAIL

4 / A002 — 1 1/2" = 1'-0"

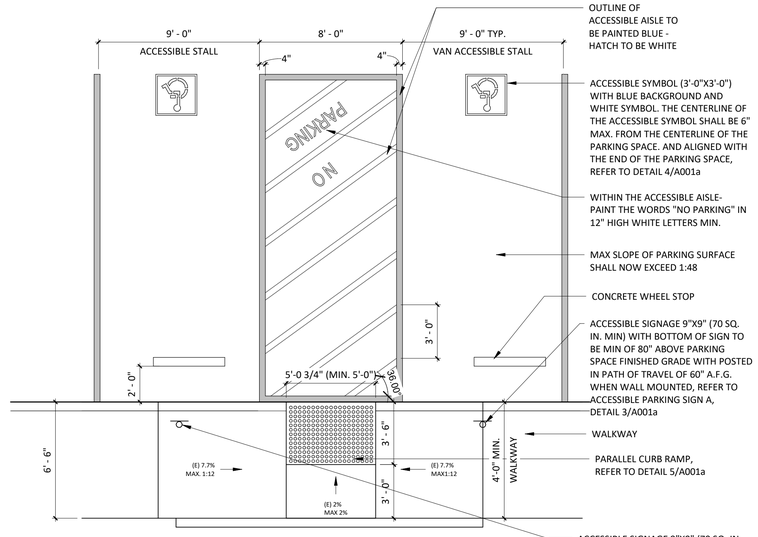

NOTES:
1. ALL PAINT ON WALKING SURFACES SHALL BE SLIP RESISTANT PER 2022 CBC 1003.4 AND 11B-302.1

TYP. ACCESSIBLE PARKING

1 / A002 — 1/4" = 1'-0" (FOR REFERENCE ONLY)

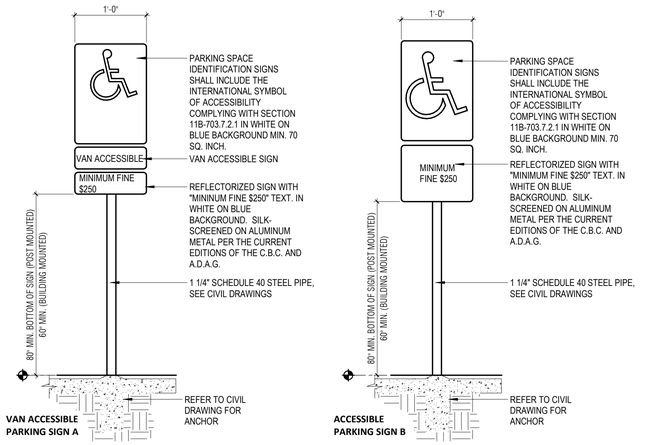

TYP. ACCESSIBLE PARKING SIGN

3 / A002 — 1" = 1'-0" (FOR REFERENCE ONLY)

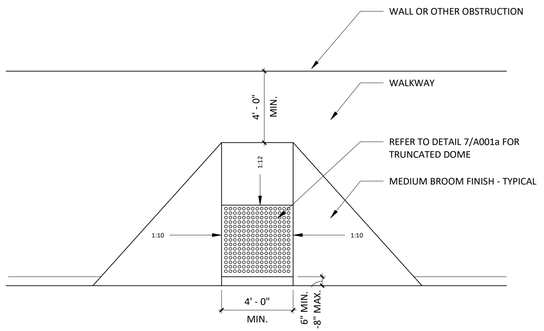

NOTES:
1. ALL PAINT ON WALKING SURFACES SHALL BE SLIP RESISTANT PER 2022 CBC 1003.4 AND 11B-302.1
2. RUNNING WALKING SURFCES: 1:20 MAX.
3. CROSS SLOPE WALKING SURFACES: 1:48 MAX.

TYP. PERPENDICULAR CURB RAMP

2 / A002 — 1/4" = 1'-0" (FOR REFERENCE ONLY)

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
TYP. ARCHITECTURAL SITE DETAILS

A002

PLUMBING LEGEND

	FLOOR SINK
⊕	FLOOR DRAIN
	TRENCH DRAIN

GENERAL NOTES

1. VERIFY OVERALL INTERIOR DIMENSIONS, INTERIOR COLUMN PLACEMENTS, AND EXTERIOR WALL PENETRATIONS IN FIELD AND NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF CONSTRUCTION.
2. ALL DIMENSIONS ARE TO THE INSIDE FACE OF EXTERIOR WALLS.
3. ALL DIMENSIONS ARE TO THE CENTERLINE OF FIXTURE UNLESS OTHERWISE NOTED.
4. GC TO REVIEW ELECTRICAL PLANS FOR LIGHTING OR POWER STUB LOCATIONS PRIOR TO POURING SLAB.
5. REFER TO "03300 - CAST-IN-PLACE CONCRETE" IN SPECIFICATIONS FOR CONCRETE PATCHING OR INSTALLATION INFORMATION.
6. VERIFY PERIMETER FOUNDATION INSULATION IS EXISTING IN FIELD AND NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF CONSTRUCTION.
7. ALL TILED FLOOR TO MAINTAIN POSITIVE SLOPE TO ALL FLOOR DRAINS OF NOT GREATER THAN 2% SLOPE FOR A 4'X4' AREA U.N.O.

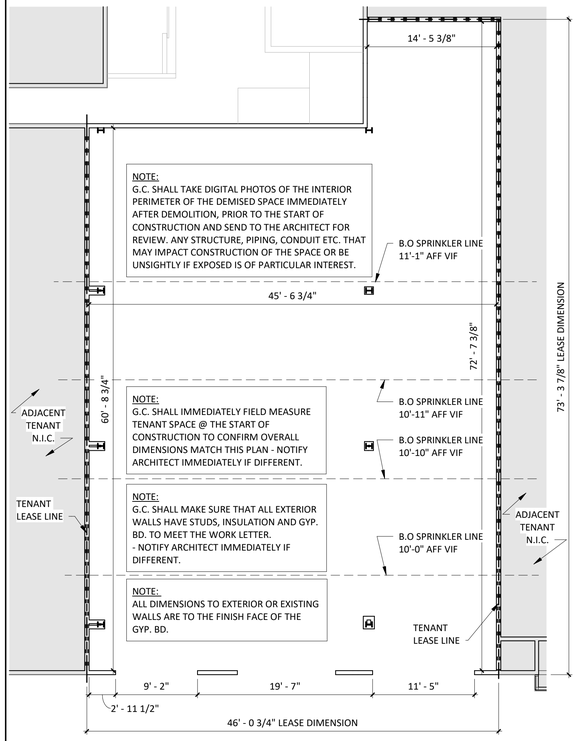

DEMISED PREMISES PLAN

TRUE NORTH / PLAN NORTH — 4 / A101

1/8" = 1'-0"

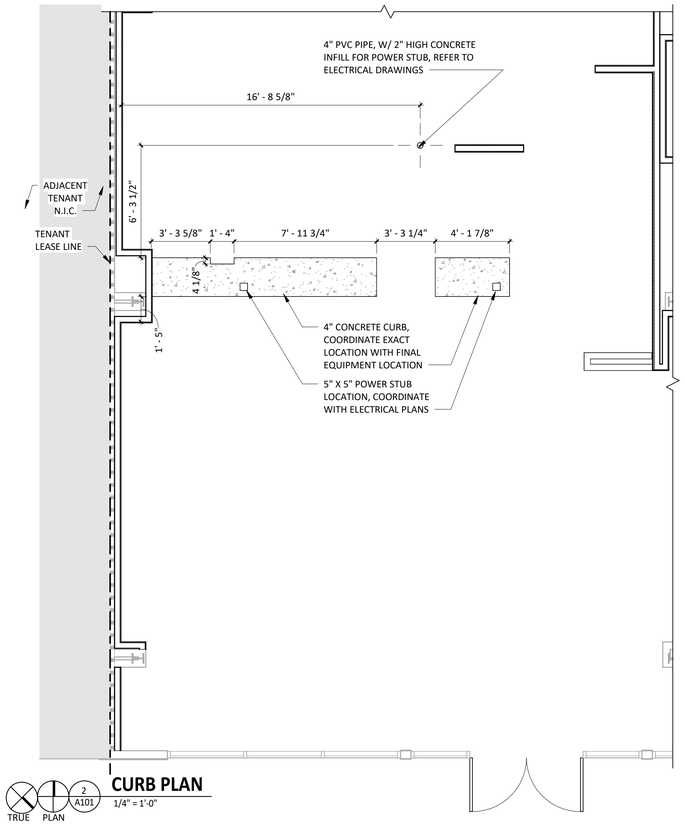

CURB PLAN

TRUE NORTH / PLAN NORTH — 2 / A101

1/4" = 1'-0"

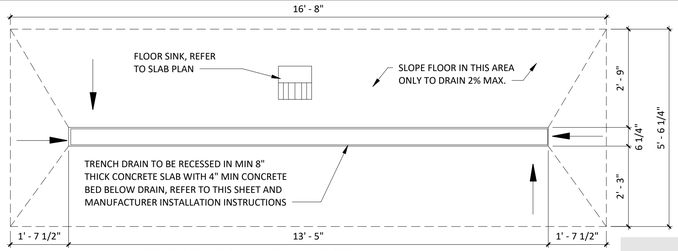

TRENCH DRAIN PLAN DETAIL

TRUE NORTH / PLAN NORTH — 5 / A101

1/2" = 1'-0"

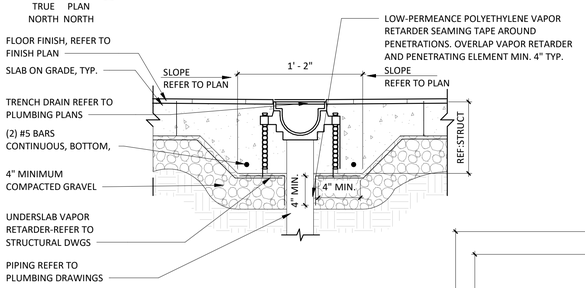

TRENCH DRAIN DETAIL

3 / A101

1 1/2" = 1'-0"

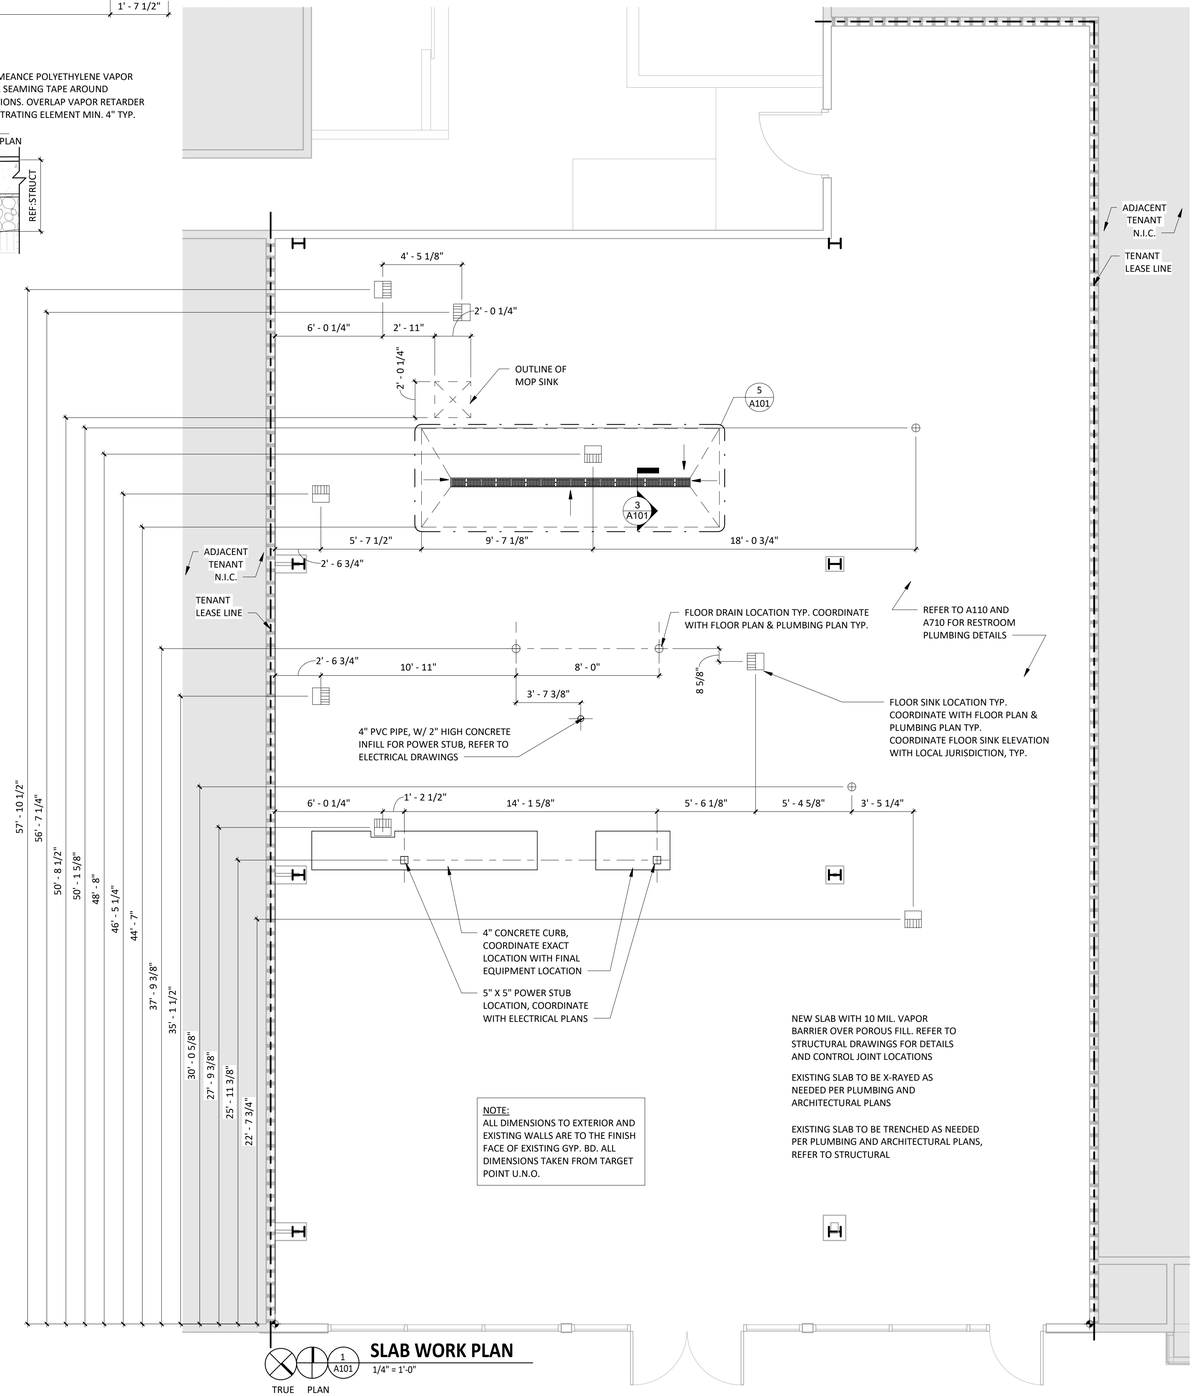

SLAB WORK PLAN

TRUE NORTH / PLAN NORTH — 1 / A101

1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

SLAB WORK PLAN

A101

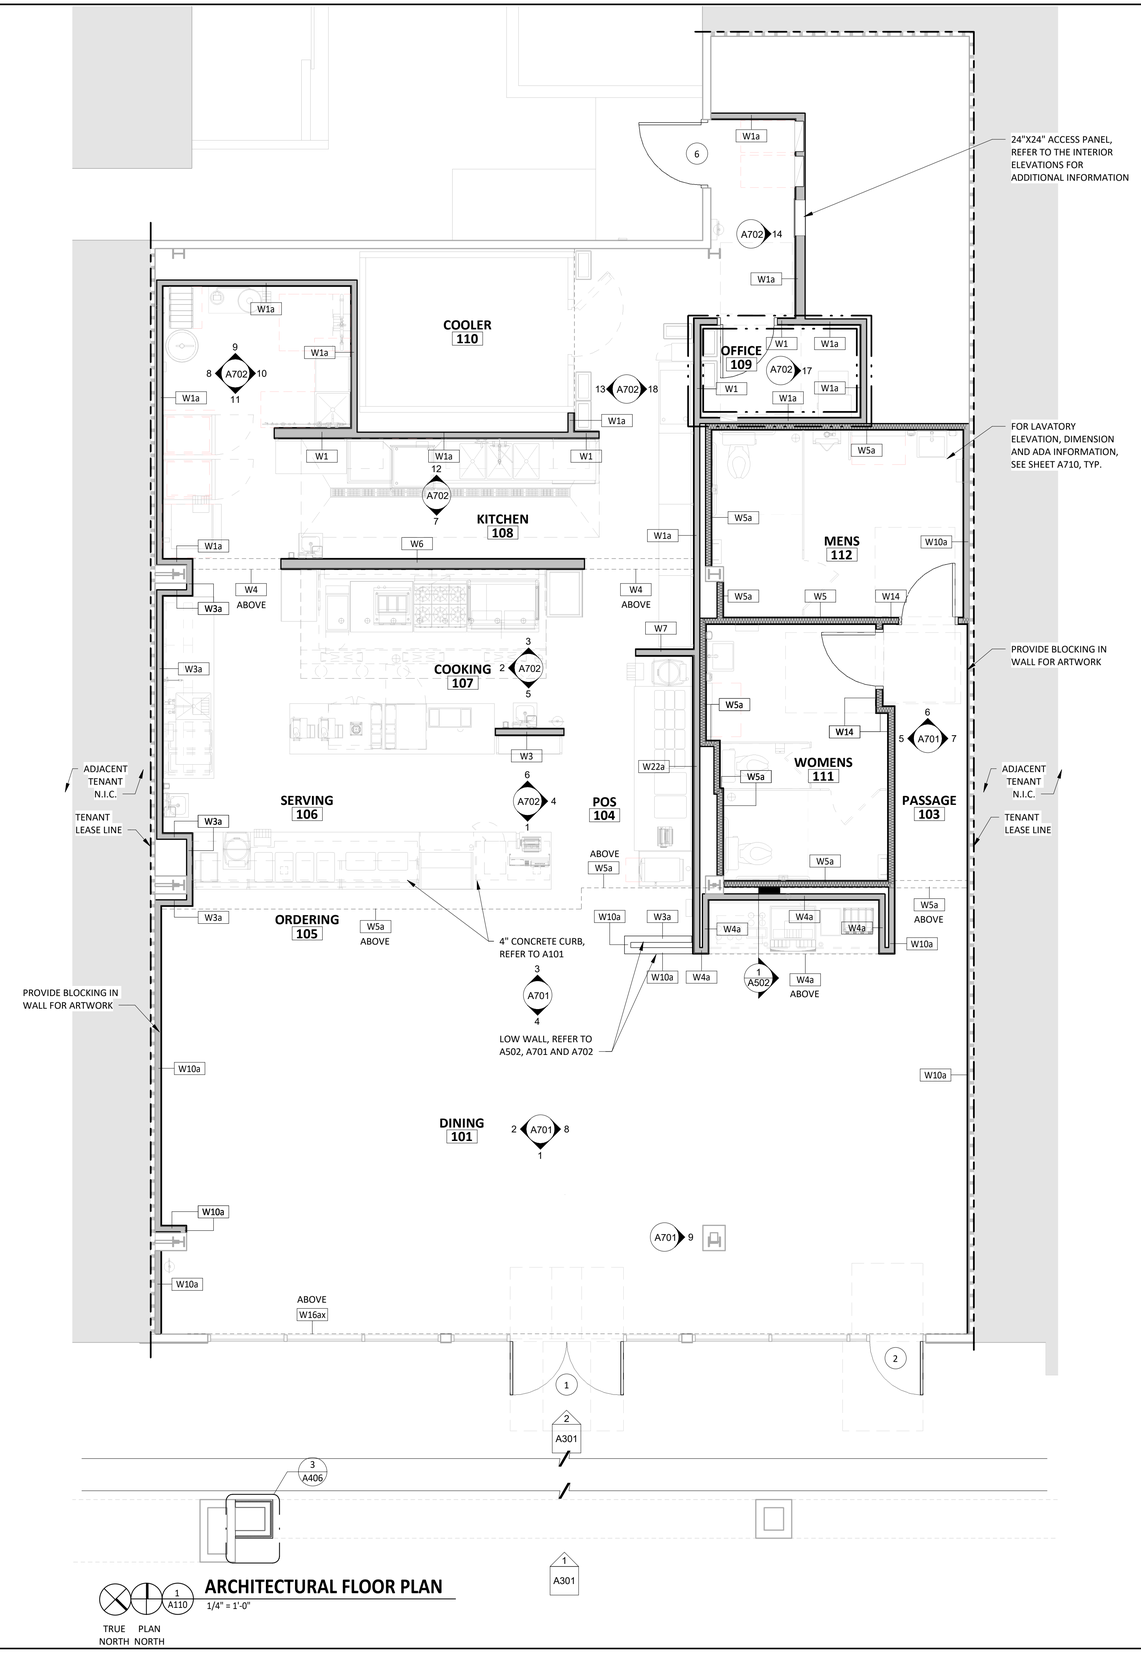

ARCHITECTURAL FLOOR PLAN

1/4" = 1'-0"

TRUE NORTH PLAN NORTH

WALL TYPE LEGEND

INTERIOR WALL CONSTRUCTION	
EXTERIOR WALL CONSTRUCTION	
INTERIOR WALL CONSTRUCTION WITH SOUND BATT INSULATION	
WALK-IN COOLER	
DESIGNATES WALLS & SHEATHING TO EXTEND TO DECK	

GENERAL NOTES

1. ALL DIMENSIONS ARE TO FACE OF FRAMING, OR CENTERLINE OF STRUCTURE UNLESS NOTED OTHERWISE.
2. DASHED CIRCLE IN RESTROOM INDICATES 5'-0" TURNING DIAMETER REQUIRED BY ADA.
3. REFER TO WALL FINISH SCHEDULE ON A120.
4. STUD SIZES AS INDICATED ON PLAN.
5. INTERIOR DOORS ARE 4" OFF OF PERPENDICULAR WALL U.N.O.
6. IN SITUATIONS WHERE TENANT'S G.C. IS TO PROVIDE TYPE 'X' GYP. BD. FOR A RATED ASSEMBLY, THE TYPE 'X' GYP. BD. IS REQUIRED TO GO BENEATH THE SHEATHING AND FINISHES.
7. SEE SHEET A801 FOR ADDITIONAL SHEATHING BEHIND CERTAIN WALL FINISHES.
8. SEE A601 FOR DOOR TYPES.
9. TENANT'S G.C. TO PERFORM LAYOUT OF ENTIRE SPACE PRIOR TO STARTING FRAMING AND REPORT ANY DESCREPANCIES IN NOTED DIMENSIONS TO ARCHITECT AND CHIPOTLE MEXICAN GRILL'S CM PRIOR TO PROCEEDING. FAILURE TO ADHERE TO THESE REQUIREMENTS RESULTING IN ANY REMEDIATION REQUIRED TO MEET DESIGN INTENT WILL BE AT CONTRACTOR'S COST.
10. SEE A501 FOR WALL TYPES.
11. PROVIDE DEFLECTION TRACKS AT WALLS WHICH GO TO THE UNDERSIDE OF THE DECKING, REFER TO DETAIL 3/A501
12. PROVIDE FULL HEIGHT BLOCKING IN WALL FOR ALL SHELVING, TYP.
13. DENSSHIELD TILE BACKER BOARD SHALL NOT BE INSTALLED OVER VAPOR BARRIERS AT EXTERIOR WALLS.
14. MOISTURE RESISTANT GYP. BD. SHALL BE USED IN RESTROOMS.

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ARCHITECTURAL FLOOR PLAN

A110

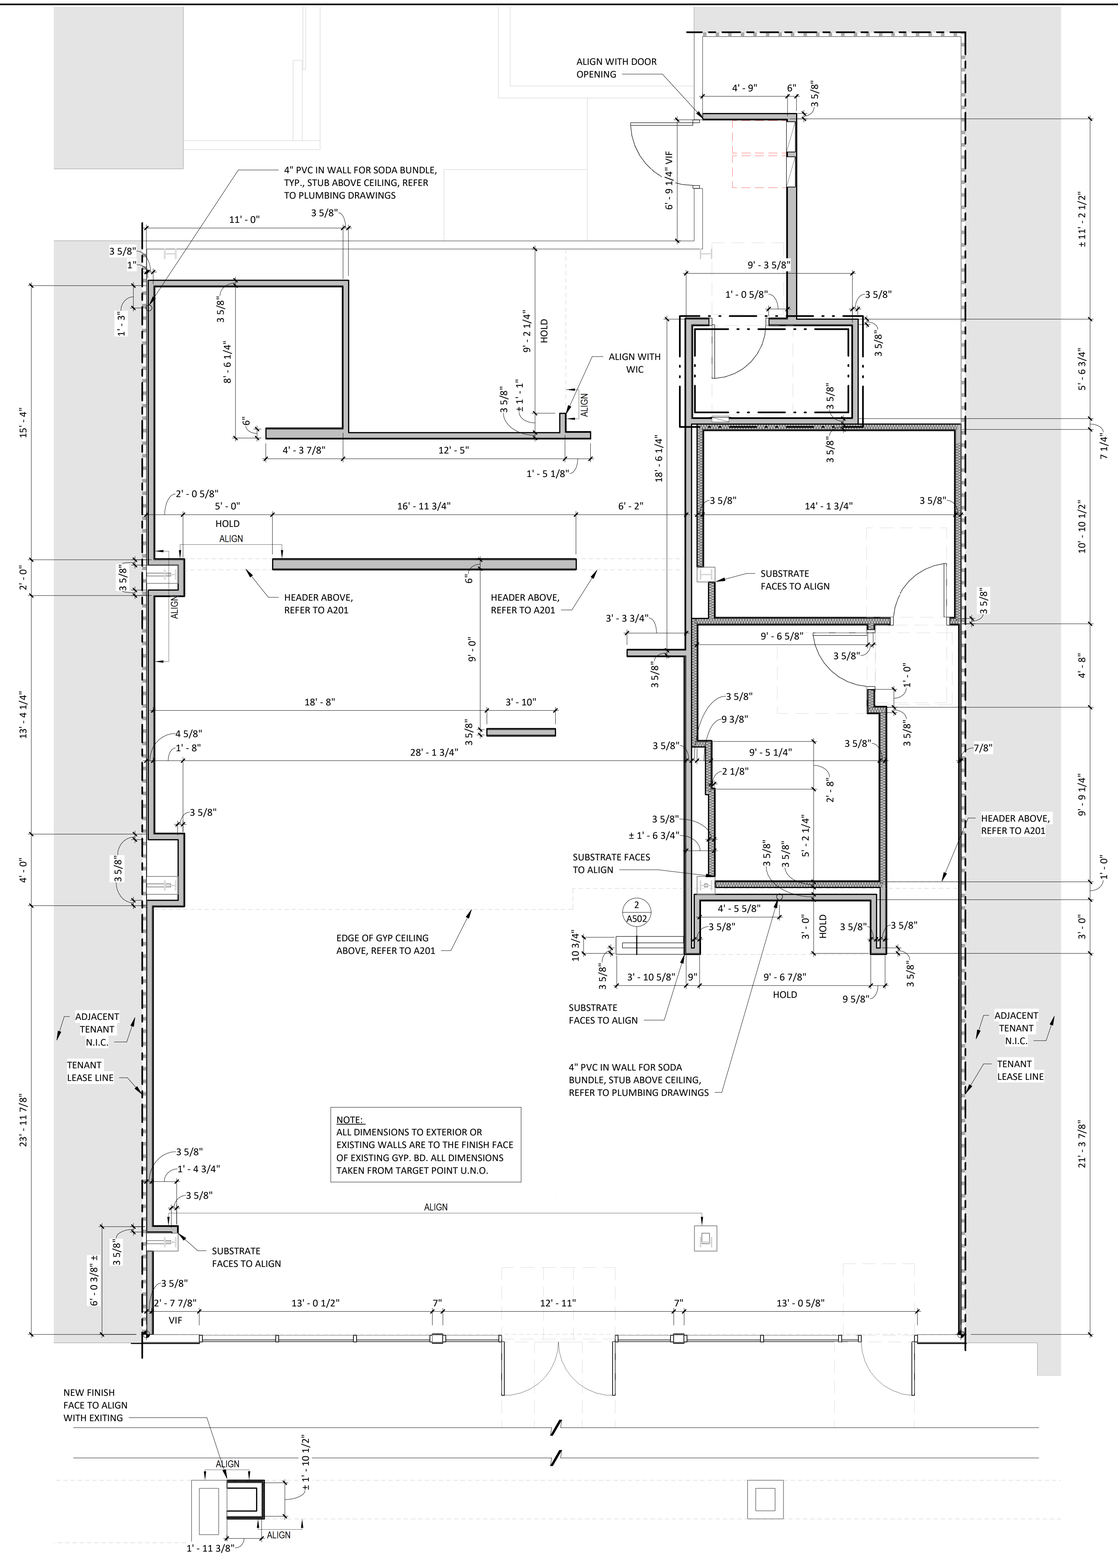

ARCHITECTURAL FLOOR PLAN - DIMENSIONED

1/4" = 1'-0"

WALL TYPE LEGEND

INTERIOR WALL CONSTRUCTION	
EXTERIOR WALL CONSTRUCTION	
INTERIOR WALL CONSTRUCTION WITH SOUND BATT INSULATION	
WALK-IN COOLER	
DESIGNATES WALLS & SHEATHING TO EXTEND TO DECK	

GENERAL NOTES

1. ALL DIMENSIONS ARE TO FACE OF FRAMING, OR CENTERLINE OF STRUCTURE UNLESS NOTED OTHERWISE.
2. DASHED CIRCLE IN RESTROOM INDICATES 5'-0" TURNING DIAMETER REQUIRED BY ADA.
3. REFER TO WALL FINISH SCHEDULE ON A120.
4. STUD SIZES AS INDICATED ON PLAN.
5. INTERIOR DOORS ARE 4" OFF OF PERPENDICULAR WALL U.N.O.
6. IN SITUATIONS WHERE TENANT'S G.C. IS TO PROVIDE TYPE 'X' GYP. BD. FOR A RATED ASSEMBLY, THE TYPE 'X' GYP. BD. IS REQUIRED TO GO BENEATH THE SHEATHING AND FINISHES.
7. SEE SHEET A801 FOR ADDITIONAL SHEATHING BEHIND CERTAIN WALL FINISHES.
8. SEE A601 FOR DOOR TYPES.
9. TENANT'S G.C. TO PERFORM LAYOUT OF ENTIRE SPACE PRIOR TO STARTING FRAMING AND REPORT ANY DESCREPANCIES IN NOTED DIMENSIONS TO ARCHITECT AND CHIPOTLE MEXICAN GRILL'S CM PRIOR TO PROCEEDING. FAILURE TO ADHERE TO THESE REQUIREMENTS RESULTING IN ANY REMEDIATION REQUIRED TO MEET DESIGN INTENT WILL BE AT CONTRACTOR'S COST.
10. SEE A501 FOR WALL TYPES.
11. PROVIDE DEFLECTION TRACKS AT WALLS WHICH GO TO THE UNDERSIDE OF THE DECKING, REFER TO DETAIL 3/A501
12. PROVIDE FULL HEIGHT BLOCKING IN WALL FOR ALL SHELVING, TYP.
13. DENSSHIELD TILE BACKER BOARD SHALL NOT BE INSTALLED OVER VAPOR BARRIERS AT EXTERIOR WALLS
14. MOISTURE RESISTANT GYP. BD. SHALL BE USED IN RESTROOMS.

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

ARCHITECTURAL FLOOR PLAN DIMENSIONED

A111

CODED NOTES

1	1-1/2" X 1-1/2" STAINLESS STEEL CORNER GUARDS TO 5'-0" AFF WITH 1-1/2" X 1-1/2" FRP CORNER TRIM ABOVE
2	SCHLUTER-QUADEC METAL CORNER, REFER TO 10&11/A802 & 11/A801.
3	ALUMINUM ENDCAPS, REFER TO 12/A802. FOR WINDOWS, REFER TO 12&13/A802
4	PROVIDE STAINLESS STEEL ON WALL TO 24" ABOVE TOP OF MOP SINK WITH FRP ABOVE. FLASH BOTTOM EDGE OVER MOP SINK RIM. BEND STAINLESS STEEL AT INSIDE CORNER SO THERE IS NO JOINT, REFER TO 17/A801.
5	NOT USED
6	COOLER WALL PANELS AS PROVIDED BY THE COOLER MANUFACTURER HAVE A 26-GAUGE COATED AND EMBOSSED STEEL FINISH.
7	G.C. TO PROVIDE 18 GAUGE STAINLESS STEEL SHROUD AROUND EXPOSED LINES AT THE ICE MAKER.
8	PROVIDE WATERPROOFING MEMBRANE, REFER TO 4&5/A802. PROVIDE ON INTERIOR OF ALL RESTROOM WALLS, REFER TO 18/A801.
9	PROVIDE QUARRY TILE ON TOP OF CURB FOR SMART SAFE. PROVIDE BULLNOSE TILE TO LAP OVER TOP CUT EDGE OF BASE TILE, REFER TO SHEET 1/A802. G.C. TO COORDINATE EXTENT OF QUARRY TILE WITH KES PRIOR TO INSTALLATION.
10	FRP CLOSURE AT COOLER AIR GAP, REFER TO 14/A801
11	NOT USED
12	OUTSIDE CORNER GUARD BY TMS, REFER TO 13/A801
13	ALIGN LOW EDGE OF RENO RAMP WITH FRONT EDGE OF EQUIPMENT CURB AND FACE OF ADJACENT WALL BASE FINISH
14	ALIGN CENTERLINE OF RENO RAMP WITH CENTERLINE OF DOOR PANEL ABOVE
15	PROVIDE TOP CORNER AT TRANSITION FROM GYP BD CEILING TO FRP WALL REFER TO 9/A210
16	4" PVC PIPE, WITH 2" HIGH CONCRETE INFILL FOR POWER STUB, TYP. OF TWO (2). REFER TO ELECTRICAL DRAWINGS
17	CONCRETE CURB FOR EQUIPMENT, WITH QUARRY TILE BASE AT EXPOSED EDGES
18	EXTENT OF QUARRY TILE FROM KITCHEN, ALIGN TILE WITH EDGE OF DOOR THRESHOLD
19	BULLNOSE TILE TRANSITION WITH POLISHED CONCRETE, REFER TO PLAN

GENERAL NOTES

1. STONEWOOD WALL PANELS AND WAINSCOT PROVIDED BY TMS, INSTALL BY GC.
2. SPALTED MAPLE PANELS PROVIDED BY TMS, INSTALLED BY GC.
3. GC IS RESPONSIBLE FOR SEQUENCING OF PREWIRING WITH COMPLETION OF INTERIOR FINISHES (GYP. BD. FINISHES).

FINISH LEGEND

FLOOR FINISHES		WALL BASE FINISHES		WALL FINISHES		CEILING/DECK FINISHES		DOOR FINISHES	
LGD. #		LGD. #		LGD. #		LGD. #		LGD. #	
F1	POLISHED CONCRETE	B1	BLACK RUBBER, COVELESS	P1	PLYWOOD, VERTICAL GRAIN	C1	NOT USED	D1	PAINT "BLACK"
F2	QUARRY TILE	B2	QUARRY TILE, COVE	P2	FIBERGLASS REINFORCED PANELS TO 4'-0" AFF (SMOOTH FINISH)	C2	STONEWOOD	D2	PAINT "KNIGHT'S ARMOR"
F3	EXTERIOR CONCRETE	B3	BLACK RUBBER, COVE	P3	GYP BD; PAINT "THIN ICE", EGGSHELL, REFER TO A701 AND A710	C3	GYP BD; PAINT "MOONLIT SNOW"		
F4	SEALED CONCRETE	B4	QUARRY TILE, COVELESS	P4	NOT USED	C4	2X4 VINYL-FACED LAY-IN		
F5	NOT USED	B5	CERAMIC TILE	P5	CERAMIC TILE - WHITE				
				P6	FIBERGLASS REINFORCED PANELS (PEBBLED FINISH)				
				P7	NOT USED				
				P8	NOT USED				
				P9	SPALTED MAPLE WALL PANEL, HORIZONTAL GRAIN				
				P10	STOREFRONT				
				P11	STONEWOOD WALL PANEL				
				P12	PREFINISHED BRAKE METAL				

ROOM FINISH SCHEDULE

100	MAIN ENTRY	F1	B1	REFER TO PLAN FOR WALL FINISHES	C3	10'-4"	SEE SHEET A701 AND SPECIFICATION SHEETS
101	DINING	F1	B1		C3	10'-4"	SEE SHEET A701 AND SPECIFICATION SHEETS
102	UTENSIL	F2	B2		C2	±8'-1 3/4" / ±9'-1 3/4"	SEE SHEET A701 AND SPECIFICATION SHEETS
103	PASSAGE	F1	B1		C3	10'-0"	SEE SHEET A701 AND SPECIFICATION SHEETS
104	POS	F2	B2/B4		C3 /C4	±9'-0" / ±9'-4"	SEE SHEET A702 AND SPECIFICATION SHEETS
105	ORDERING	F1	B1/B4/B5		C1/C3	STR / ±9-0"	SEE SHEET A701 AND SPECIFICATION SHEETS
106	SERVING	F2	B2		C3	±9'-0"	SEE SHEET A702 AND SPECIFICATION SHEETS
107	COOKING	F2	B2		C3 /C4	±9'-0" / ±9'-4"	SEE SHEET A702 AND SPECIFICATION SHEETS
108	KITCHEN	F2	B2		C4	10'-0"	SEE SHEET A702 AND SPECIFICATION SHEETS
109	OFFICE	F2	B2		C4	9'-0"	EXTEND SHEATHING TO STRUCTURE
110	COOLER	F2	B2		STR	STR	CEILING HEIGHT & FINISHES PER MANUFACTURER
111	WOMENS	F2	B2		C3	±8'-0"	SEE SHEET A710 AND SPECIFICATION SHEETS
112	MENS	F2	B2		C3	±8'-0"	SEE SHEET A710 AND SPECIFICATION SHEETS

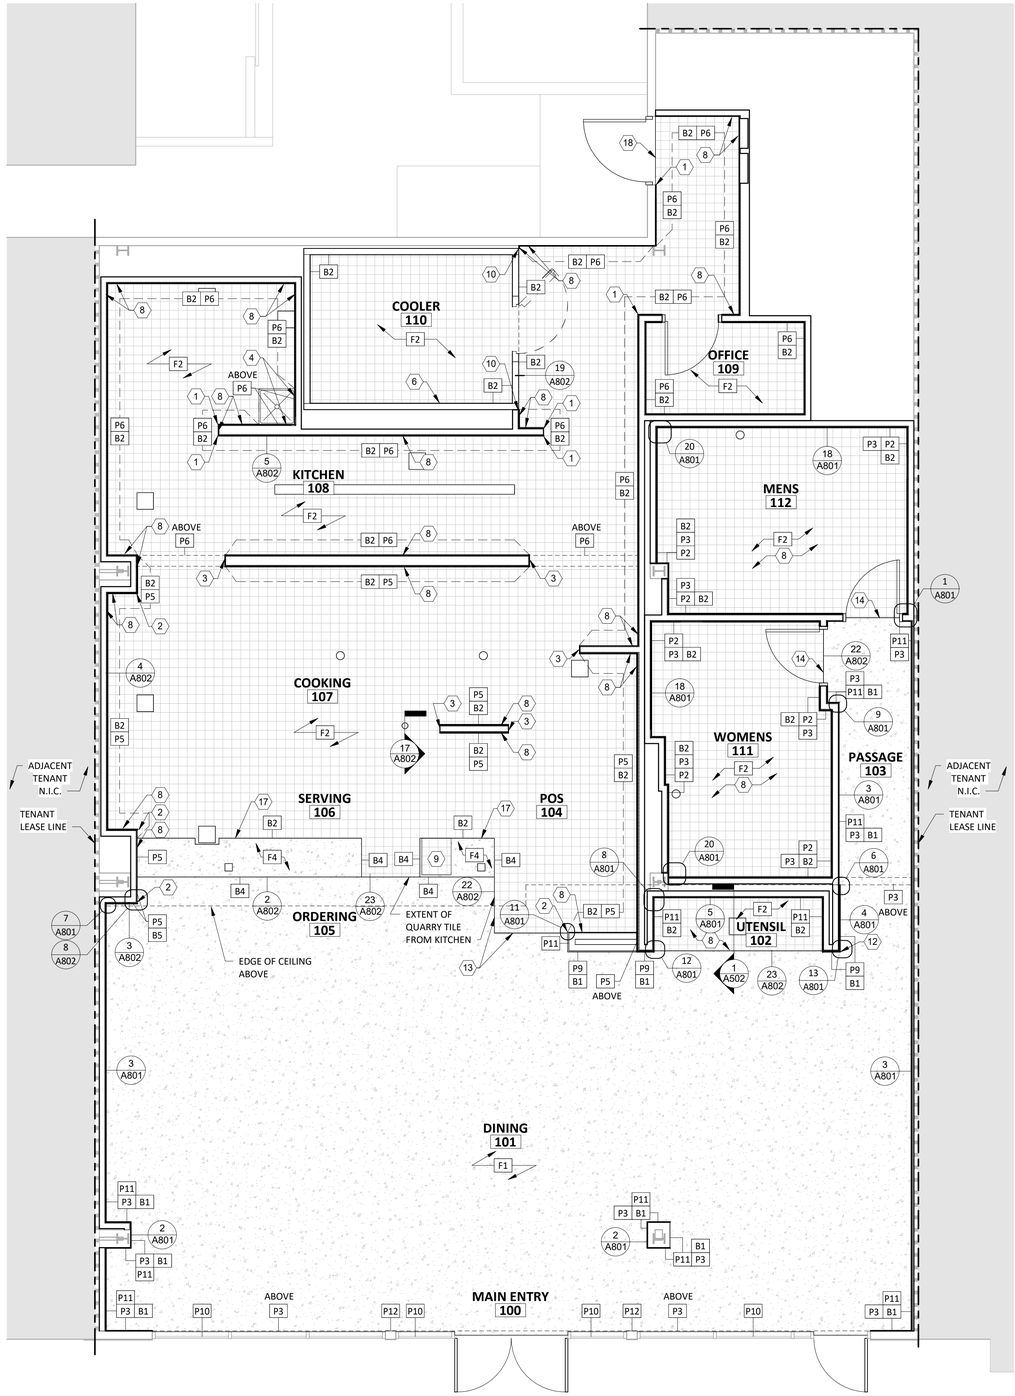

TRUE NORTH / PLAN NORTH

FINISH PLAN (1/A120)
1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
FINISH PLAN

A120

GENERAL NOTES - FF&E

1.	REFER TO SHEETS A131 AND A132 FOR EQUIPMENT LIST AND FURNITURE SCHEDULE.
2.	ALL DIMENSIONS ARE TO FACE OF FRAMING, EDGE OF EQUIPMENT OR CENTERLINE OF EQUIPMENT UNLESS NOTED OTHERWISE.
3.	ALL FURNITURE TO BE SQUARE/PARALLEL TO TENANT SPACE/WALLS AS SHOWN ON PLANS

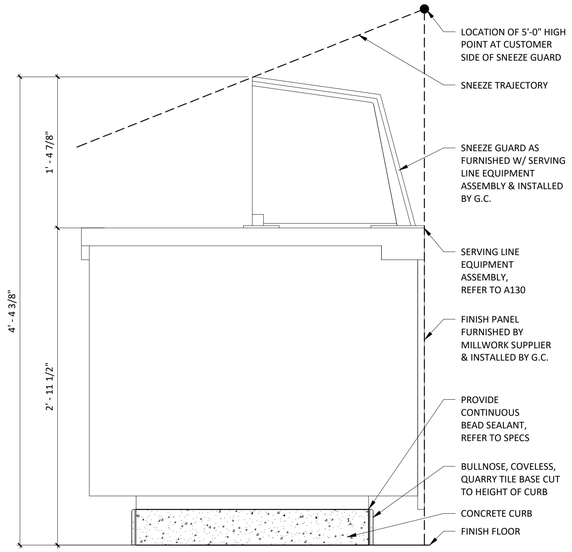

3 / A130 **DETAIL @ SERVE LINE SNEEZE GUARD**
1 1/2" = 1'-0"

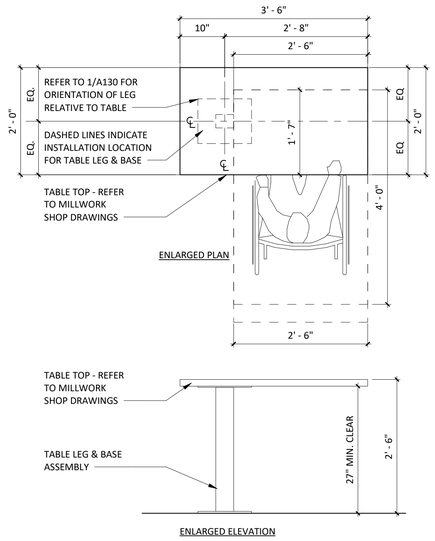

2 / A130 **DETAIL @ ACCESSIBLE TABLE**
3/4" = 1'-0"

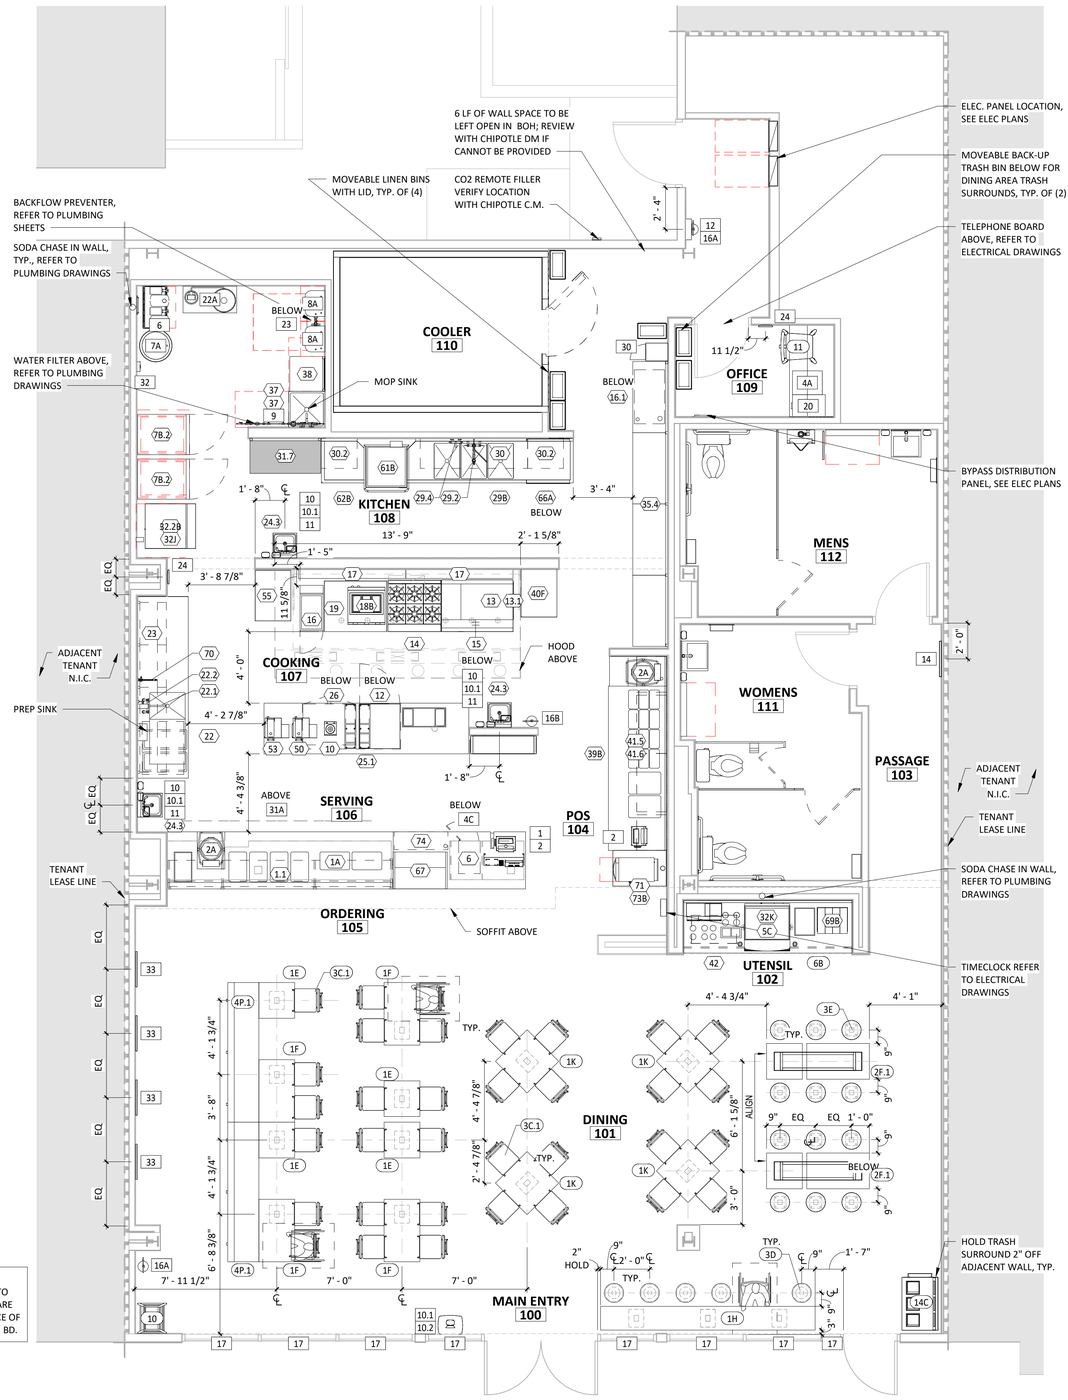

1 / A130 **FURNITURE, FIXTURE & EQUIPMENT PLAN**
1/4" = 1'-0"

TRUE NORTH PLAN NORTH

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
FF&E PLAN

A130

KITCHEN EQUIPMENT LIST

ITEM #	DESCRIPTION	MANUFACTURER	MODEL NO.	QTY	SUPPLIED BY	INSTALLED BY	UTILITY				REMARKS
							ELEC	GAS	WATER	SEWER	
1.1	Sneeze Guard Serve Line 12 Pan (Left)	BSI	Custom-L	1	TMS	TMS/GC					
1A	M4.0 - Front Serve Line - 12 Pan - RTD - POS Right	Duke	12 Pan Serve Line POS RTD_241x38.5in (Right)	1	KES	KES; GC	●			●	Installed On Concrete Curb
2A	Tortilla Warmer	Caliente Industries	A2	2	KES	KES	●				GC To Store In Walk-In Cooler Until Final Installation
6	Cup Dispenser	Dispense-Rite	CHIP-ECL-3B	1	KES	KES; GC					Installed At POS Counter
7B.2	Upright Beverage Cooler, Single Door, Hinge Right	Varies	Varies - Solid Door	2	KES	KES	●				
8.3	M4.5 Chip Shelf	Trimark	Custom	1	KES	KES					
10	Blender	Vitamix	748	1	T	T	●				GC To Store In Walk-In Cooler Until Final Installation
12	Undercounter Refrigerator	Scottsman	CRMR27-LP	1	KES	KES	●				
13	Grill Stand 48x31in - Divider Right	Varies	Varies	1	KES	KES	●	●			
13.1	Woodstone Grease Splash Guard	Varies	Varies	1	KES	KES					Verify If Required
14	Range 6 Burner - Natural Gas	Woodstone	U36-6S	1	KES	KES		●			
15	Grill Stand 48x31in - Divider Right	Varies	Varies	1	KES	KES					
16	Fryer - Gas - Standard Efficiency	Imperial	Varies	1	KES	KES	●	●			Mounted On Legs, G.C. To Pin Front Legs To Floor
16.1	Grease Caddy	Mudd Studios	Chipotle Grease Caddy - RH	1	KES	KES					
17	Cook Line Stand Off - 72x6	Nationwide Fab; Marlo Mfg	CHP-72WS-6	2	KES	KES					Mount Top of Flat Surface at 33" AFF, Install Screws at Each Stud Location, Provide Blocking To Mount To Wall
18B	Gas Rice Cooker	Woodstone	WS-GRC-60	1	KES	GC	●	●			Final Connection by GC. RE:Mechanical Drawings
19	Rice Cooker Stand - Right	Nationwide Fab; Marlo Mfg	CHP-RCS-42ES-34	1	KES	KES					
22	Prep Sink - Corner - Right	Trimark	S1-122x34-US-FF-R	1	KES	GC					
22.1	Prep Sink Faucet Big Flow Faucet	T&S	B-0293-01	1	KES	GC			●		
22.2	Prep Sink Vegetable Wash Faucet	T&S	B-0730	1	KES	GC			●		GC To Provide Connection For Chemical Dispensing Equipment
22.3	Prep Sink Drain Assembly	T&S	B-3950	1	KES	KES; GC				●	
23	4 Shelves - 120in Prep Sink	Amco	CHPPS120	1	KES	KES					Mount Bottom Of Standard At 50" AFF. Provide Plywood Blocking To Mount To Wall.
24.3	Hand Sink Wall Mounted - Splash Both	Universal Stainless	EHS-1RL-NF	3	KES	GC				●	Provided with B-0199-06-F10, 1.0 GPM Aerator, Provide Plywood Blocking To Mount To Wall
24.5	Kitchen Hand Sink Faucet Splash Mount	T&S	B-1146-04	3	KES	GC			●		
25.1	Rice Prep Table Island w/Carving Station - 137x34in - Left	Duke	Custom	1	KES	KES	●				
26	Hot Holding Cabinet - Double Door (Rice)	Food Warming Equipment (FWE)	HLC-16-CHP	1	KES	KES	●				
29.2	Dish Sink Add-A-Faucet w/ Pre-Rinse	T&S	B-1033-12CRBJSK Substitute Sprayer B-0107-J-SWV	1	KES	GC			●		
29.3	Dish Sink Drain Assembly	T&S	B-3950	3	KES	KES; GC				●	
29.4	Dish Sink Chemical Faucet	T&S	B-2345-01-XX	1	KES	GC			●		GC To Provide Connection For Chemical Dispensing Equipment
29B	3 Comp Sink - 18x24in Bowls - 111 3/4in	Nationwide Fabrication; Marlo Mfg	S3-30x111.75x36.5-FF	1	KES	GC				●	
30	Shelving System - 3 Comp Sink	Amco	WST1879S	1	KES	KES					Mount bottom of Standard At 56"AFF. Provide Plywood Blocking
30.2	Shelving System - Dish Table	Amco	WST1879S	2	KES	KES					Mount bottom of Standard At 56"AFF. Provide Plywood Blocking. Mount Tight To Dish Machine
31.7	Drying Racks 23x48x85in - With Vented Aluminum Covers	Varies	Custom	1	KES	KES					Mount Bottom Of Standard At 12" AFF. Provide Plywood Blocking To Mount To Wall
32.1D	Ice Maker - Remote Condenser	Scottsman	ERC311-32	1	KES	KES	●				Condensing Units To Be Secured To The Roof Per Code By GC
32.2B	Ice Maker - Storage Bin	Scottsman	B530S	1	KES	KES				●	
32.3	Icemaker- Filter	Cuno	Bev 190	2	KES	KES			●		
32.4	Ice Maker - Scale Inhibitor	Cuno	CFS440-HT	2	KES	KES			●		
32J	Ice Maker For B.O.H. Ice Bin	Scottsman	C1030MR	1	KES	KES	●		●		Drain Ice Maker to Floor Sink, RE: Mech. Refrigeration By Tenant.
32K	Ice Maker Mounted On Soda Machine - Air Cooled	Scottsman	C0530MA	1	KES	KES	●		●	●	Drain Ice Maker to Floor Sink, RE: Mech. Refrigeration By Tenant.
33	Walk In Cooler 9x12x9ft 6in - Standard	Everidge	CHP912SR-RS	1	WCS	GC	●			●	Refer To Plumbing and Mechanical Drawings; Refrigeration By Tenant; Remote Exterior Compressor Unit To Be Secured To Roof Per Code By GC
34	Walk-In Cooler Shelving System - 9x12x9	Cambro (Camshelving)	CHP912ER	1	KES	KES					
35.4	Dry Storage Racks 23x192x85in	Varies	Custom	1	KES	KES					Mount Bottom Of Standard At 12" AFF. Provide Plywood Blocking To Mount To Wall.
37	Mop Sink Faucet	T&S	B-0660-BSTR	1	KES	GC			●		
37.1	Mop Sink Chemical Faucet	T&S	B-2345-01-XX	1	KES	GC			●		GC To Provide Connection For Chemical Dispensing Equipment
38	6 Shelves - Chemical Storage Rack	Varies	Custom	1	KES	KES					Mount Bottom Of Standard At 12" AFF. Provide Plywood Blocking To Mount To Wall.
39B	DML 2.0 130in – Left – W/POS & Cash Drawer	Duke	DML 2.0_LT-130x39	1	KES	KES	●			●	
39B.1	DML 2.0 Wall Trim Package	Duke	DML 2.0 Trim Kit	1	KES	KES					
40F	M4.5 - Filler Stand At Range	Select Stainless	24x32x36	1	KES	KES					
41.5	DML 2.0 Shelving - 130in - Top Shelf	Duke	CH000A32	1	KES	KES					Mount Bottom Of Shelf At 74 1/2" AFF. Provide Plywood Blocking To Mount To Wall.
41.6	DML 2.0 Shelving - 130in - Bottom Shelf	Duke	CH000A34	1	KES	KES					Mount Bottom Of Lowest Portion Of Shelf At 54 1/2" AFF. Provide Plywood Blocking To Mount To Wall.
42	Shelving System Under Counter Beverage Station	ISS	WST1810CLR	1	KES	KES					Mounted on (4) casters, All casters to be swivel type, Front (2) casters to have brake, Located under utensil counter
45	Dunnage Rack - 18x36in	ISS	AAL361812	1	KES	KES					
50	Food Processor	Sammic	CA-31	1	KES	KES	●				
53	Veggie Slicer	Sammic	CA-31 CP	1	KES	KES	●				
55	Filler Table - 24x34in	Trimark	TS-24x34x36-US-C	1	KES	KES					
61B	Dish Machine (w/Pump)	Hobart	AM16SCB	1	KES	KES	●		●	●	
62B	Dish Table 30x30	Trimark	CDT-30X30X36.5-B	1	KES	GC					
65	Utility Cart (Not Shown)	Select Stainless	30SU-22-14-C4-TUBS-CUSTOM	1	KES	GC					Provided As Part Of The WIC Shelving
66A	Drop-Off Table - 29x30in	Trimark	TS-29x30x31-US-C	1	KES	KES					
67	Refrigerated Counter Case, Self-Serve	Structural Concepts	CO3324R-UC	1	KES	KES					
69B	M4.0 - Simplicity Bubbler Mini-Quad	Crathco	CS-4E-16	1	KES	GC	●			●	
70	Speed Fill Faucet	T&S	B-0432 MOD	1	KES	GC			●		
71	Quesadilla Press	Turbochef	Sota Touch	1	KES	KES	●				
73B	24" TurboChef Table	Trimark	24X36X36	1	KES	KES					
	9in	Metro	Custom	1	KES	KES					

SNF LISTED FABRICATOR

NSF International

RECOGNIZES

NATIONWIDE FABRICATION, INC.
NORTHGLENN, CO

AS COMPLYING WITH NSF/ANSI 2.
PRODUCTS APPEARING IN THE NSF OFFICIAL LISTING ARE
AUTHORIZED TO BEAR THE NSF MARK.

NSF

ANSI
Certification Program Accredited by the American National Standards Institute

Certification Program Accredited by the Standards Council of Canada

This certificate is the property of NSF International and must be returned upon request. For the most current and complete information, please access NSF's website (www.nsf.org).

January 19, 2006
Certificate# 45000 - 01

Joseph L. Phillips, General Manager
Food Equipment

GENERAL NOTE:
CONTRACTOR SHALL COORDINATE AND VERIFY ALL INFORMATION WITH CHIPOTLE PRIOR TO ORDERING MATERIAL OR ROUGH-IN RELATED SERVICES.

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
EQUIPMENT SCHEDULE

A131

MISC EQUIPMENT LIST

TAG	DESCRIPTION	QTY	SUPPLIED BY	INSTALLED BY	UTILITY				REMARKS
					ELEC	GAS	WATER	SEWER	
1	Point of Sale Display	1	TMS	GC					Installed at POS Station
2	Point-Of-Sale System	2	T	TCC					Coordinate Requirements With Tenant and Elec. Drawings
3	Cash Drop Box	2	SSS	GC					Drop Box Mounted Below POS Counter
4A	B-Rate (Standard Safe)	1	TS	GC					Installed in Office
4C	Smart Safe	1	TSS	TSS	●				To Be Installed On Curb Under Serveline, Bolt to Curb Under Serveline POS
5C	Soda Dispenser - With Air-Cooled Ice Maker	1	SPS	SPS	●			●	Drain to Floor Sink, Tenant Millwork Supplier to Provide (2) Adjustable Legs to Support Dispenser From Under The Utensil Counter
6	Soda System Syrup Rack with Carbonator on Stainless Steel Shelf	1	SPS	SPS	●		●		
7A	Bulk CO2 Tank	1	CO2	CO2	●				GC To Secure Cylinders To Wall With Grade 30 Galvanized Steel Chain At 2/3 The Height Of The Cylinder. Attach To Wall With Stainless Steel Quick Link And Screw Eye
8A	Gas Tankless Water Heater	2	GC	GC		●	●	●	Refer to MEP Drawings
9	Mop Sink, See Plumbing Drawings	1	GC	GC			●	●	See Plumbing Drawings
10	Touch-Free Soap Dispenser	3	WA	GC					
10.1	Hand Sanitizer Dispenser	4	WA	GC					
10.2	Hand Sanitizer Stand	1	WA	GC					
11	Paper Towel Dispenser, Bobrick B262	3	WA	GC					Provide Plywood Blocking to Mount to Wall
12	First Aid Kit	1	T	GC					Confirm Location With Chipotle CM Prior To Installation
14	License Frame	1	T	GC					Provide Plywood Backing In Wall At License Frame Location, Refer To Arch. Floor Plans And Elevations For License Frame Location.
16A	Fire Extinguisher Type ABC - B456	2	GC	GC					Mount in locations specified by the Fire Marshal. Provide plywood backing at specified locations.
16B	Fire Extinguisher Type K	1	GC	GC					Mount in locations specified by the Fire Marshal. Provide plywood backing at specified locations.
17	Window Shades	8	WS	WS					See Sheet A130 For Location & Size (When Used)
19	Hat & Coat Strips (Not Shown)	1	WA	GC					Provide Plywood Blocking to Mount to Wall
20	2-Drawer File Cabinet, By Tenant	1	T	T					By Tenant
22A	Water Softener On Dunnage Rack	1	KES	GC			●	●	See MEP Sheets For Details
23	Backflow Preventer	1					●	●	See MEP Sheets for Details
24	iPAD Wall Station	2	T	GC	●				Tablet By Tenant, Refer to Electrical Drawings
28	Mop Strip (Not Shown)	1	T	GC					Provide Plywood Backing To Mount To Wall, 2 Hole At Mop Basin and 6 Hole In Kitchen
30	Lockers - 1 Wide x 5 High	1	KES	KES					
31A	21inx31in Menu System	1	TMB	GC					
32	CO2 Alarm	1	CO2AS	GC	●				Refer to Electrical Drawings for Additional Details
33	Framed Photograph	4	T	GC					Provide Plywood Backing In Wall At Picture Frame Location, Refer To Arch. Floor Plans And Elevations For Picture Frame Location.
33C	M4.0 - Pick-Up Sign - Double Faced - Surface Mounted - Bottom	1	TSV	GC					

FURNITURE LIST

TAG	DESCRIPTION	QTY	SUPPLIED BY	INSTALLED BY	UTILITY				REMARKS
					ELEC	GAS	WATER	SEWER	
1E	M4.0 - Table 24x24in - Rectangular Base	4	TMS	GC					
1F	M4.0 - Table 24x42in, Rectangular Base (Accessible)	4	TMS	GC					See Detail On A130
1H	M4.0 - Community Table - Low - Window - Length Varies	1	TMS	GC					
1K	M4.0 - Table 30x30in	4	TMS	GC					
2F.1	M4.0 - Bar Height Table 6-Top, With Footrest	2	TMS	GC					One Coat Hook Per Two Seats, Confirm Mounting Location With Shop Drawings
3C.1	M4.0 - Dining Room Chair	36	TMS	GC					
3D	M4.0 - Marshmallow Stool - Fixed	5	TMS	GC					Align Seat With Seam Perpendicular To Table Edge
3E	M4.0 - Bar Stool - Fixed	12	TMS	GC					Align Seat With Seam Perpendicular To Table Edge
4P.1	Banquette Bench (Black) - Floor Mount	2	TMS	GC					
6B	M4.0 - Beverage Counter - No Trash - 4" Splash - 113"	1	TMS	GC				●	Coordinate Floor Drain Installation with Utensil Counter Installation
10	Child's High Chair	1	T	GC					
11	Office Chair, By Tenant	1	T	T					By Tenant
14C	M4.0 - 3 Bin Trash/Recycling Surround - Interior	1	TMS	GC					Bins Provided by Tundra in Smallwares Package

GENERAL NOTE:
CONTRACTOR SHALL COORDINATE AND VERIFY ALL INFORMATION WITH CHIPOTLE PRIOR TO ORDERING MATERIAL OR ROUGH-IN RELATED SERVICES.

IA INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
EQUIP. & FURNITURE SCHEDULE

A132

HVAC EQUIPMENT

NOTE: UTILITIES BY GC, REFER TO MECHANICAL DRAWINGS.

DESCRIPTION	SUPPLIED BY	INSTALLED BY	UTILITY				REMARKS
			ELEC	GAS	WATER	SEWER	
EXHAUST FANS & CURBS	HS	GC					CURB FURNISHED BY HS, INSTALLED BY GC
MAKE UP AIR UNIT & CURBS	HS	GC					CURB FURNISHED BY HS, INSTALLED BY GC
ROOF TOP UNITS & CURBS	HES	GC					CURB FURNISHED BY HS, INSTALLED BY GC
TEST & BALANCE SYSTEM	TAB	-					FURNISH HVAC TEST & BALANCE PER TENANT'S NATIONAL ACCOUNT PROGRAM.

GENERAL ROOF NOTES

1.	SEE STRUCTURAL DRAWINGS FOR LOCATIONS AND SIZE OF STRUCTURAL ROOF REINFORCEMENTS.
2.	SEE MECHANICAL PLANS FOR ROOF TOP EQUIPMENT.
3.	COORDINATE ALL ROOF PENETRATIONS, FLASHING, AND REPAIR W/ TENANT ROOF TOP EQUIPMENT PRIOR TO COMMENCEMENT OF WORK.
4.	DIMENSIONS FOR ROOF TOP EQUIPMENT WITH CURBS IS TO THE OUTSIDE FACE OF THE CURB. DIMENSIONS FOR EQUIPMENT WITHOUT CURBS ARE TO THE CENTER OF THE UNIT. ALL DIMENSIONS ARE FOR REFERENCE ONLY. ROOFING CONTRACTOR TO ADJUST AS NECESSARY IN FIELD. CONTACT ENGINEERING CONSULTANTS FOR ANY MAJOR MODIFICATIONS TO LAYOUT.
5.	VERIFY EXISTING ROOF STRUCTURE BELOW, IF LOCATION OR ORIENTATION OF A UNIT MUST CHANGE, NOTIFY ARCHITECT IMMEDIATELY.
6.	SEE M700 FOR PENETRATION DETAILS AT RTUS AND THE EXHAUST FAN.
7.	PROVIDE INSULATED CURBS FOR ALL EQUIPMENT IN EXPOSED DECK AREA ONLY.
8.	PROVIDE TAPERED INSULATION CRICKET AT ALL EQUIPMENT CURBS.
9.	LOCATE ALL UNITS SO DUCT DROPS BETWEEN TRUSS JOISTS. NOTIFY ARCHITECT IMMEDIATELY IF ANY UNITS NEED TO SHIFT FROM PLAN LOCATION SHOWN.
10.	MAINTAIN A WATERTIGHT CONDITION AT ALL TIMES AND INCLUDE ALL MEANS / METHODS REGARDING TEMPORARY ROOFING.
11.	PROPERLY ALTER EXISTING ROOFING TO ALLOW FOR INTEGRATION OF NEW WORK AND MAINTAIN EXISTING WARRANTIES.
12.	PROPERLY RE-INSTALL EXISTING ROOFING TO ALLOW FOR PROPER TIE-IN TO EXISTING AND PROVIDE FOR A COMPLETELY WATERTIGHT CONDITION.
13.	PROTECT THE EXISTING ROOFING FROM DAMAGE IN CONCERT WITH NEW WORK.
14.	PROTECT THE EXISTING DRAINS FROM DEBRIS.
15.	TEST EXISTING DRAINS ONCE ALL REMEDIAL WORK IS COMPLETE AND ENSURE THAT THEY ARE NOT CLOGGED.

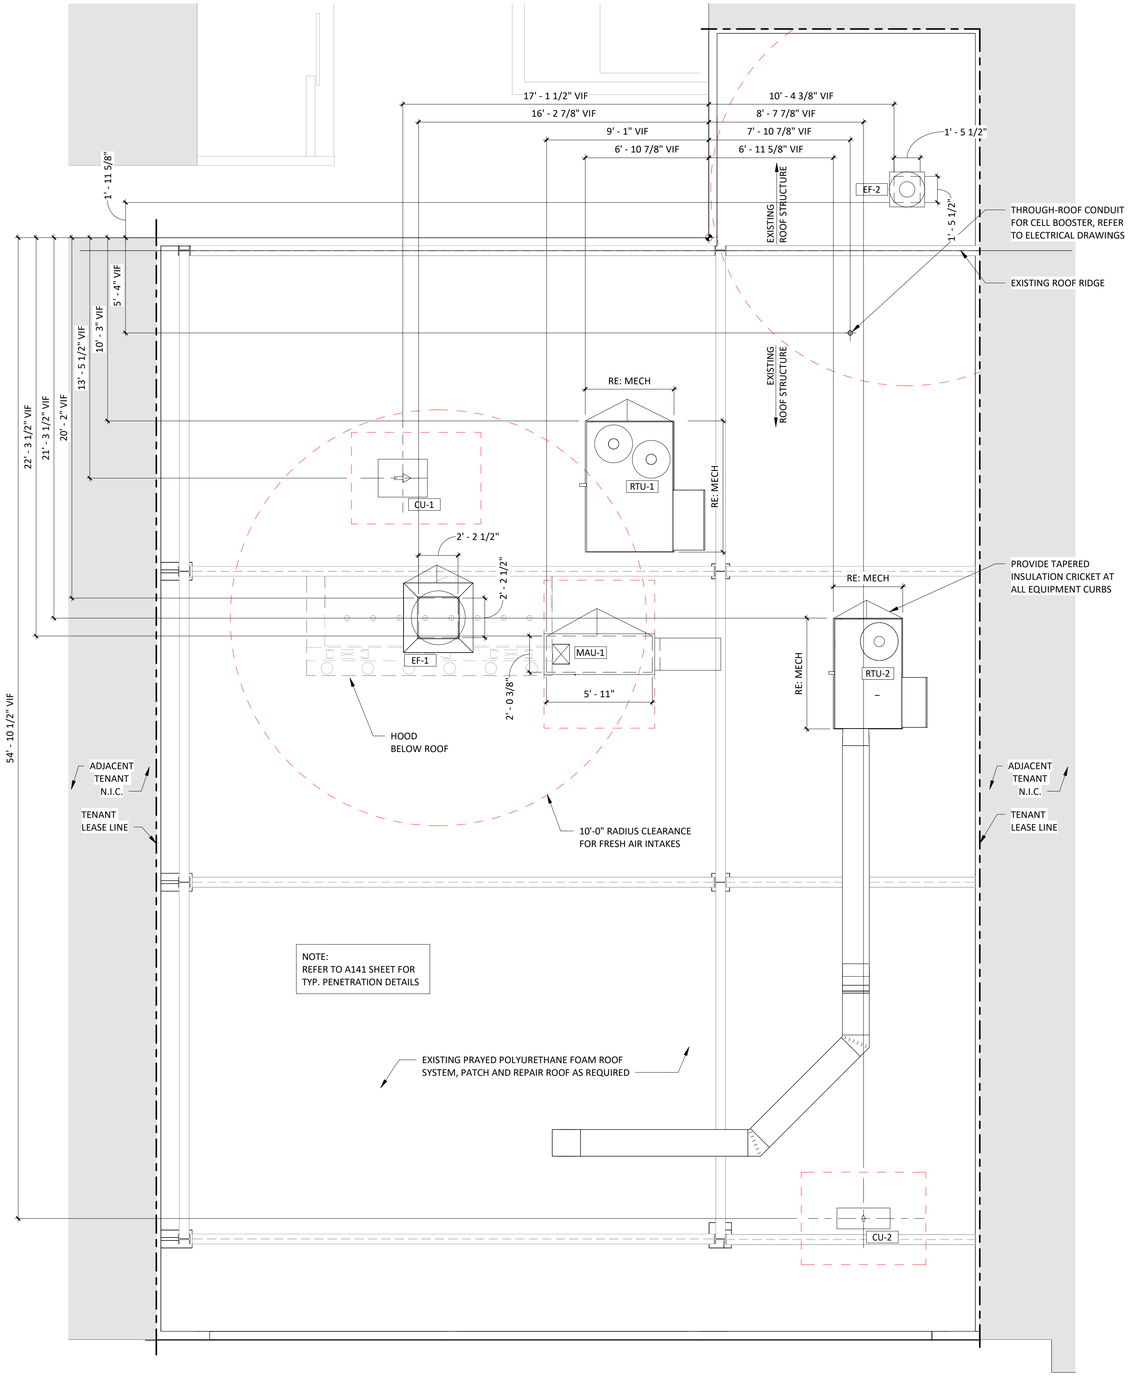

ROOF PLAN

1/4" = 1'-0"

TRUE NORTH / PLAN NORTH

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

ARCHITECTURAL ROOF PLAN

A140

NOTES:
1. THIS DETAIL IS INTENDED FOR USE AT CONDITIONS WHERE A TYPICAL PENETRATION FLASHING CANNOT BE USED OR WHERE MULTIPLE PENETRATIONS MUST BE GROUPED TOGETHER. WHEN POSSIBLE, PENETRATIONS SHOULD BE SPACED AS REQUIRED TO ALLOW EACH INDIVIDUAL PENETRATION TO BE FLASHED BY THE ROOFING SYSTEM.
2. THE SHEET METAL ENCLOSURE IS TO BE FABRICATED WATERTIGHT. SILICONE SEALANT SHOULD BE UTILIZED WHERE EXPOSED TO UV.

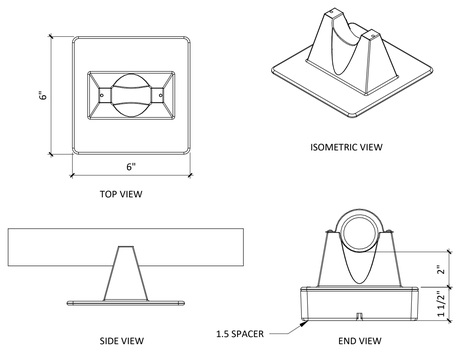

6 A141 **SMALL PIPE SUPPORTS**
6" = 1'-0"

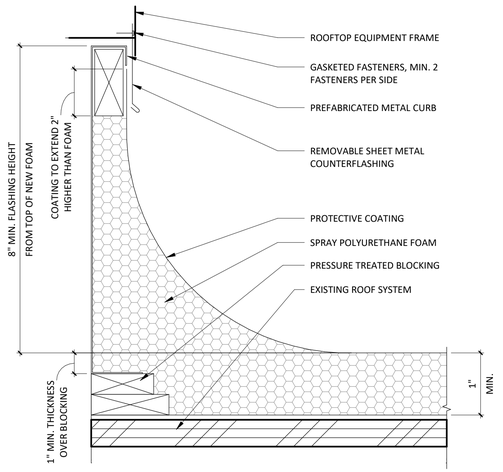

5 A141 **FLASHING AT PREFABRICATED METAL CURB**
6" = 1'-0"

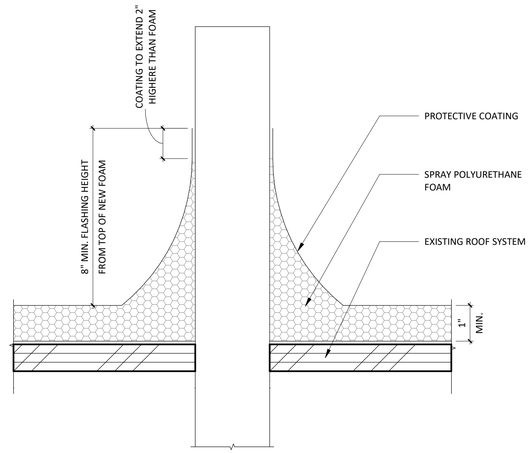

4 A141 **PIPE PENETRATION**
6" = 1'-0"

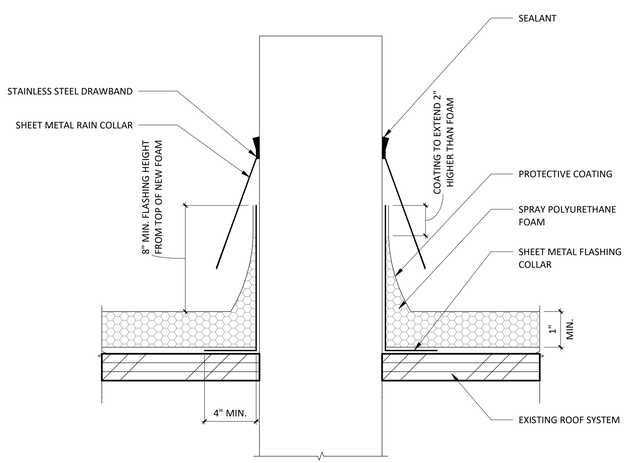

3 A141 **SHEET METAL STACK VENT**
6" = 1'-0"

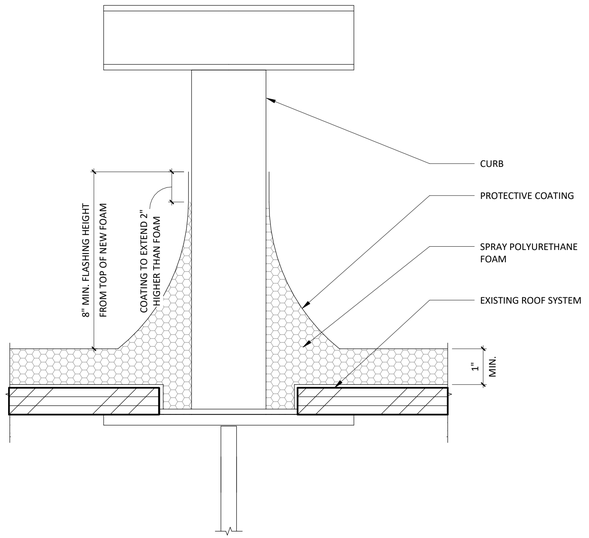

2 A141 **EQUIPMENT SUPPORT "SLEEPER" CURB**
6" = 1'-0"

NOTES:
1. THIS DETAIL IS INTENDED FOR USE AT CONDITIONS WHERE A TYPICAL PENETRATION FLASHING CANNOT BE USED OR WHERE MULTIPLE PENETRATIONS MUST BE GROUPED TOGETHER. WHEN POSSIBLE, PENETRATIONS SHOULD BE SPACED AS REQUIRED TO ALLOW EACH INDIVIDUAL PENETRATION TO BE FLASHED BY THE ROOFING SYSTEM.
2. THE SHEET METAL ENCLOSURE IS TO BE FABRICATED WATERTIGHT. SILICONE SEALANT SHOULD BE UTILIZED WHERE EXPOSED TO UV.

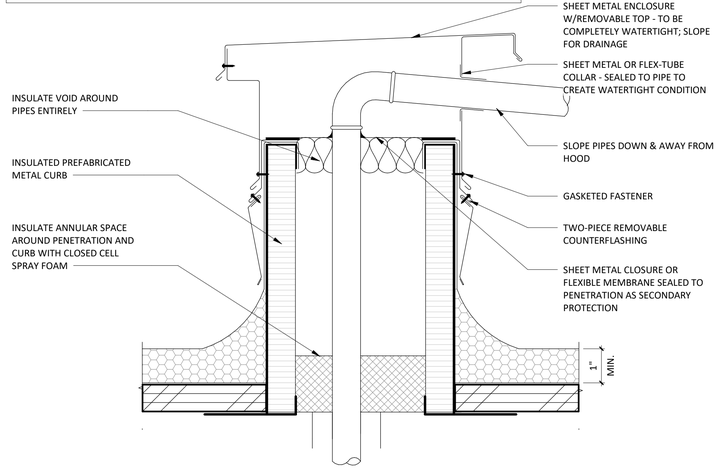

1 A141 **ENCLOSURE FOR PIPING THROUGH ROOF DECK**
6" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
TYP. ROOF PENETRATION DETAILS

A141

SECURITY SYSTEM

*REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION

SECURITY MONITOR	1	SSS	SSS	●				
SECURITY ALARM - MOTION DETECTORS	1	T.B.D.	T.B.D.	●				GC RESPONSIBLE FOR COORDINATING SEQUENCING OF PREWIRING WITH COMPLETION OF INTERIOR FINISHES (GYP. BD. FINISHES)
72 HR SECURITY DVR	1	SSS	SSS	●				
CLOSED CIRCUIT T.V. CAMERA - OUTDOOR	1	SSS	SSS	●				INSTALL AT 9'-6" U.N.O.
CLOSED CIRCUIT T.V. CAMERA - INDOOR	6	SSS	SSS	●				

CONDUIT GUIDELINES

SEE ELECTRICAL DRAWINGS FOR CONDUIT REQUIREMENTS. METAL CLAD CABLE AND FLEXIBLE METAL CONDUIT SHALL NOT BE INSTALLED IN AREAS EXPOSED TO VIEW UNLESS SPECIFICALLY NOTED OTHERWISE.

SPEAKER SCHEDULE

SP1	5	DINING ROOM SPEAKER	BLACK	SUSPENDED	REFER TO A201 & E110 FOR DETAILS

RCP GENERAL NOTES

1.	ALL INTERIOR LIGHT FIXTURES AND LAMPS PROVIDED BY TENANT'S LIGHT/LAMP SUPPLIER.
2.	ALL INTERIOR LIGHT FIXTURES AND LAMPS INSTALLED BY GC. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
3.	KITCHEN EXHAUST HOOD PROVIDED BY HS AND INSTALLED BY GC. GC TO COORDINATE PRESSURE TEST AND VIRO GUARD WITH ENVIROMATIC, INC.
4.	ANSUL BOX & FIRE SUPPRESSION SYSTEM PROVIDED BY AND INSTALLED BY HS. HOOD INTERLOCK BY GC. ELECTRICAL CONNECTION BY GC, RE: ELEC.
5.	MENU BOARD ASSEMBLY PROVIDED BY TMB, INSTALLED BY G.C.
6.	PROVIDE BLOCKING ABOVE MENU BOARD ASSEMBLY FOR INSTALLATION.
7.	REFER TO "09900 PAINTING - GENERAL" IN SPECIFICATIONS FOR FINISHES AT EXPOSED CEILING AREAS IN ADDITION TO NOTES LISTED ON THIS SHEET AND A120.
8.	UNISTRUT TO BE LEFT UNPAINTED. PROVIDE MATCHING CLOSER STRIPS AND END CAPS. CLOSER STRIP TO BE APPLIED TO THE UNDERSIDE OF THE UNISTRUT.
9.	ALL HEIGHTS ARE TO BOTTOM OF FIXTURE UNLESS NOTED OTHERWISE.
10.	LIGHT DETAILS ARE LOCATED ON SHEET A210. FIXTURE AND LAMP SPECIFICATIONS ARE LOCATED ON E100.
11.	ALL UNISTRUT SUPPORTING CEILING ELEMENTS AND/ OR DUCT WORK SHALL NOT CONTAIN ANY ELECTRICAL CONDUIT. ALL ELECTRICAL CONDUIT MUST RUN IN SEPARATE UNISTRUT.
12.	ALL UNISTRUT, CONDUIT, SPRINKLER & WATER LINES SHALL BE INSTALLED TIGHT TO THE BOTTOM OF THE DECK OR AS SHOWN IN DETAILS AND LEFT UNPAINTED
13.	ALL WATER LINES AND EXPOSED PVC SHALL BE INSTALLED IN TRUSS SPACE AND PAINTED VICTORIAN PEWTER.
14.	ALL DIMENSIONS ARE TO FACE OF FRAMING, OR CENTERLINE OF FIXTURE UNLESS NOTED OTHERWISE.
15.	SEE ELECTRICAL DRAWINGS FOR SHATTER RESISTANT LAMP LOCATIONS.
16.	ALL EMERGENCY FIXTURES, LIGHTS AND STROBES SHALL BE ALIGNED OR CENTERED ON WALLS.
17.	FULL CERAMIC TILE COURSING SHALL TAKE PRECEDENT OVER ANY CEILING/HEADER DIMENSION INDICATED IN THE PLAN, REFER TO A120.
18.	ALL CONDUIT AND PIPE PENETRATIONS OF THE SERVING LINE SOFFIT ARE TO BE HELD TIGHT TO THE DECK. PLEASE CONSULT WITH THE CHIPOTLE CM SHOULD ANY CONFLICTS ARISE.
19.	BATT INSULATION TO BE INSTALLED ABOVE THE RESTROOM CEILING.
20.	ALL LAY-IN CEILING PENETRATIONS TO BE HELD TIGHT TO WALLS. REFER TO 4/A210 AND PLUMBING DRAWINGS FOR DETAILS.
21.	REFER TO STRUCTURAL DRAWINGS FOR HOOD SUSPENSION DETAILS.
22.	ALL EXTERIOR BUILDING MOUNTED AND PATIO LIGHT FIXTURES AND LAMPS PROVIDED BY TENANT'S LIGHT/LAMP SUPPLIER, U.N.O.
23.	ALL EXTERIOR PARKING LOT LIGHT FIXTURES AND LAMPS PROVIDED BY AND INSTALLED BY G.C. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
24.	ALL EXTERIOR BUILDING MOUNTED AND PATIO LIGHT FIXTURES AND LAMPS INSTALLED BY G.C. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
25.	SECURITY CAMERA LOCATIONS ARE ONLY APPROXIMATE LOCATIONS. FOR GUIDANCE ON THE SPECIFIC LOCATION/ORIENTATION OF THESE CAMERAS, REFER TO THE ENVYSION INSTALLATION GUIDE
26.	REFER TO A120 FOR FINISH SCHEDULE

LIGHT FIXTURE SCHEDULE

A1	12	LAY-IN	2x2 LENSED TROFFER	SEE SHEET E100
B1	9	CEILING	RECESSED 6IN CAN LIGHT	SEE SHEET E100
B2	26	CEILING	RECESSED 6IN CAN LIGHT	SEE SHEET E100
B3	3	CEILING	M4.0 - RECESSED 6IN CAN LIGHT (BLACK)	SEE SHEET E100
C0	2	SURFACE	LOW PROFILE LED 1FT	SEE SHEET E100
C2	4	SURFACE	LOW PROFILE LED 3FT	SEE SHEET E100
C3	5	SURFACE	LOW PROFILE LED 4FT	SEE SHEET E100
C4	16	SURFACE	LOW PROFILE LED 5FT	SEE SHEET E100
E1	5	VARIOUS	EMERGENCY LIGHT - DUAL HEAD	SEE SHEET E100
E2	3	VARIOUS	EMERGENCY LIGHT - SINGLE HEAD	SEE SHEET E100
E4	8	VARIOUS	WHITE EXIT LIGHT - STANDARD RED LETTERS	SEE SHEET E100
E7	13	VARIOUS	EMERGENCY LIGHT - DUAL HEAD	SEE SHEET E100
H1	8	SURFACE	VAPOR PROOF HOOD LIGHT	SEE SHEET E100
J4	2	PENDANT	M4.0 - PENDANT LIGHT	SEE SHEET E100
P3	4	WALL	ACCENT LIGHT - ARTWORK LIGHT FIXTURE	SEE SHEET E100
P5	4	PENDANT	M4.0 - PENDANT LIGHT	SEE SHEET E100

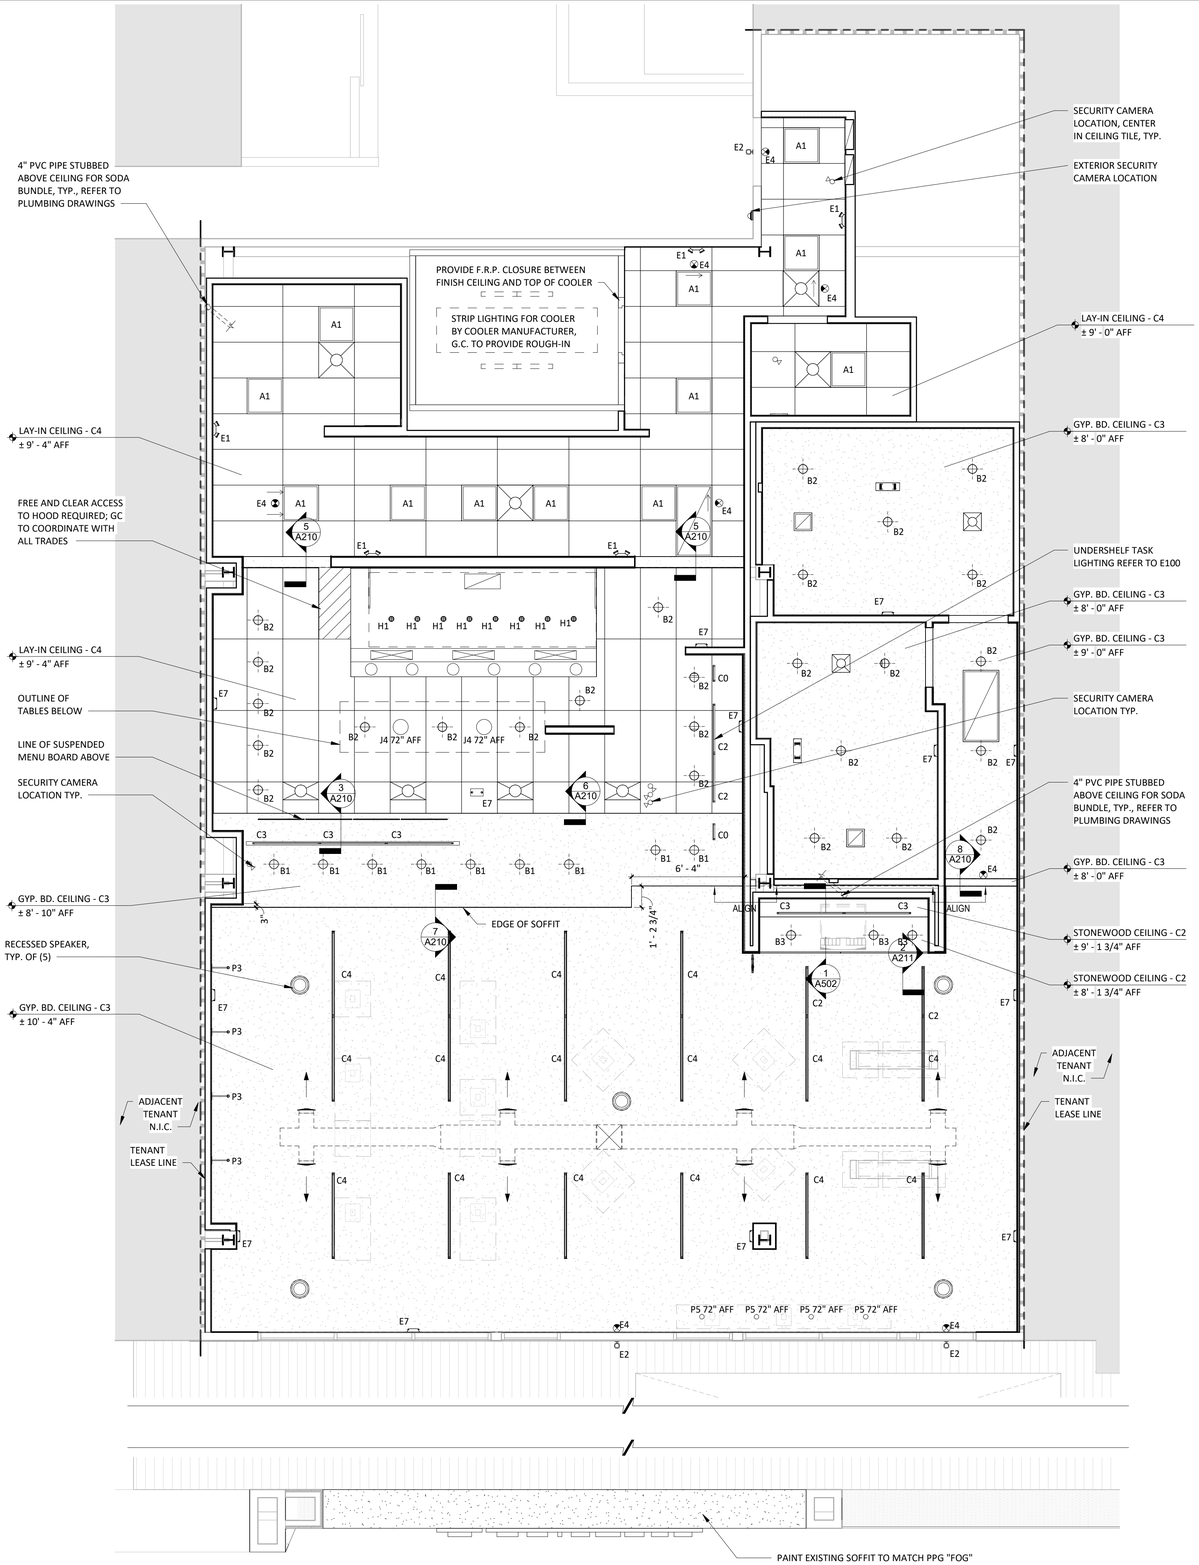

REFLECTED CEILING PLAN

1/4" = 1'-0"

TRUE NORTH PLAN NORTH

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

REFLECTED CEILING PLAN

A201

SECURITY SYSTEM

*REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION

SECURITY MONITOR	1	SSS	SSS	●				
SECURITY ALARM - MOTION DETECTORS	1	T.B.D.	T.B.D.	●				GC RESPONSIBLE FOR COORDINATING SEQUENCING OF PREWIRING WITH COMPLETION OF INTERIOR FINISHES (GYP. BD. FINISHES)
72 HR SECURITY DVR	1	SSS	SSS	●				
CLOSED CIRCUIT T.V. CAMERA - OUTDOOR	1	SSS	SSS	●				INSTALL AT 9'-6" U.N.O.
CLOSED CIRCUIT T.V. CAMERA - INDOOR	6	SSS	SSS	●				

CONDUIT GUIDELINES

SEE ELECTRICAL DRAWINGS FOR CONDUIT REQUIREMENTS. METAL CLAD CABLE AND FLEXIBLE METAL CONDUIT SHALL NOT BE INSTALLED IN AREAS EXPOSED TO VIEW UNLESS SPECIFICALLY NOTED OTHERWISE.

SPEAKER SCHEDULE

SP1	5	DINING ROOM SPEAKER	WHITE	RECESSED	REFER TO A201 & E110 FOR DETAILS

RCP GENERAL NOTES

1.	ALL INTERIOR LIGHT FIXTURES AND LAMPS PROVIDED BY TENANT'S LIGHT/LAMP SUPPLIER.
2.	ALL INTERIOR LIGHT FIXTURES AND LAMPS INSTALLED BY GC. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
3.	KITCHEN EXHAUST HOOD PROVIDED BY HS AND INSTALLED BY GC. GC TO COORDINATE PRESSURE TEST AND VIRO GUARD WITH ENVIROMATIC, INC.
4.	ANSUL BOX & FIRE SUPPRESSION SYSTEM PROVIDED BY AND INSTALLED BY HS. HOOD INTERLOCK BY GC. ELECTRICAL CONNECTION BY GC, RE: ELEC.
5.	MENU BOARD ASSEMBLY PROVIDED BY TMB, INSTALLED BY G.C.
6.	PROVIDE BLOCKING ABOVE MENU BOARD ASSEMBLY FOR INSTALLATION.
7.	REFER TO "09900 PAINTING - GENERAL" IN SPECIFICATIONS FOR FINISHES AT EXPOSED CEILING AREAS IN ADDITION TO NOTES LISTED ON THIS SHEET AND A120.
8.	UNISTRUT TO BE LEFT UNPAINTED. PROVIDE MATCHING CLOSER STRIPS AND END CAPS. CLOSER STRIP TO BE APPLIED TO THE UNDERSIDE OF THE UNISTRUT.
9.	ALL HEIGHTS ARE TO BOTTOM OF FIXTURE UNLESS NOTED OTHERWISE.
10.	LIGHT DETAILS ARE LOCATED ON SHEET A210. FIXTURE AND LAMP SPECIFICATIONS ARE LOCATED ON E100.
11.	ALL UNISTRUT SUPPORTING CEILING ELEMENTS AND/ OR DUCT WORK SHALL NOT CONTAIN ANY ELECTRICAL CONDUIT. ALL ELECTRICAL CONDUIT MUST RUN IN SEPARATE UNISTRUT.
12.	ALL UNISTRUT, CONDUIT, SPRINKLER & WATER LINES SHALL BE INSTALLED TIGHT TO THE BOTTOM OF THE DECK OR AS SHOWN IN DETAILS AND LEFT UNPAINTED
13.	ALL WATER LINES AND EXPOSED PVC SHALL BE INSTALLED IN TRUSS SPACE AND PAINTED VICTORIAN PEWTER.
14.	ALL DIMENSIONS ARE TO FACE OF FRAMING, OR CENTERLINE OF FIXTURE UNLESS NOTED OTHERWISE.
15.	SEE ELECTRICAL DRAWINGS FOR SHATTER RESISTANT LAMP LOCATIONS.
16.	ALL EMERGENCY FIXTURES, LIGHTS AND STROBES SHALL BE ALIGNED OR CENTERED ON WALLS.
17.	FULL CERAMIC TILE COURSING SHALL TAKE PRECEDENT OVER ANY CEILING/HEADER DIMENSION INDICATED IN THE PLAN, REFER TO A120.
18.	ALL CONDUIT AND PIPE PENETRATIONS OF THE SERVING LINE SOFFIT ARE TO BE HELD TIGHT TO THE DECK. PLEASE CONSULT WITH THE CHIPOTLE CM SHOULD ANY CONFLICTS ARISE.
19.	BATT INSULATION TO BE INSTALLED ABOVE THE RESTROOM CEILING.
20.	ALL LAY-IN CEILING PENETRATIONS TO BE HELD TIGHT TO WALLS. REFER TO 4/A210 AND PLUMBING DRAWINGS FOR DETAILS.
21.	REFER TO STRUCTURAL DRAWINGS FOR HOOD SUSPENSION DETAILS.
22.	ALL EXTERIOR BUILDING MOUNTED AND PATIO LIGHT FIXTURES AND LAMPS PROVIDED BY TENANT'S LIGHT/LAMP SUPPLIER, U.N.O.
23.	ALL EXTERIOR PARKING LOT LIGHT FIXTURES AND LAMPS PROVIDED BY AND INSTALLED BY G.C. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
24.	ALL EXTERIOR BUILDING MOUNTED AND PATIO LIGHT FIXTURES AND LAMPS INSTALLED BY G.C. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
25.	SECURITY CAMERA LOCATIONS ARE ONLY APPROXIMATE LOCATIONS. FOR GUIDANCE ON THE SPECIFIC LOCATION/ORIENTATION OF THESE CAMERAS, REFER TO THE ENVYSION INSTALLATION GUIDE
26.	REFER TO A120 FOR FINISH SCHEDULE

LIGHT FIXTURE SCHEDULE

A1	12	LAY-IN	2x2 LENSED TROFFER	SEE SHEET E100
B1	9	CEILING	RECESSED 6IN CAN LIGHT	SEE SHEET E100
B2	26	CEILING	RECESSED 6IN CAN LIGHT	SEE SHEET E100
B3	3	CEILING	M4.0 - RECESSED 6IN CAN LIGHT (BLACK)	SEE SHEET E100
C0	2	SURFACE	LOW PROFILE LED 1FT	SEE SHEET E100
C2	4	SURFACE	LOW PROFILE LED 3FT	SEE SHEET E100
C3	5	SURFACE	LOW PROFILE LED 4FT	SEE SHEET E100
C4	16	SURFACE	LOW PROFILE LED 5FT	SEE SHEET E100
E1	5	VARIOUS	EMERGENCY LIGHT - DUAL HEAD	SEE SHEET E100
E2	3	VARIOUS	EMERGENCY LIGHT - SINGLE HEAD	SEE SHEET E100
E4	8	VARIOUS	WHITE EXIT LIGHT - STANDARD RED LETTERS	SEE SHEET E100
E7	13	VARIOUS	EMERGENCY LIGHT - DUAL HEAD	SEE SHEET E100
H1	8	SURFACE	VAPOR PROOF HOOD LIGHT	SEE SHEET E100
J4	2	PENDANT	M4.0 - PENDANT LIGHT	SEE SHEET E100
P3	4	WALL	ACCENT LIGHT - ARTWORK LIGHT FIXTURE	SEE SHEET E100
P5	4	PENDANT	M4.0 - PENDANT LIGHT	SEE SHEET E100

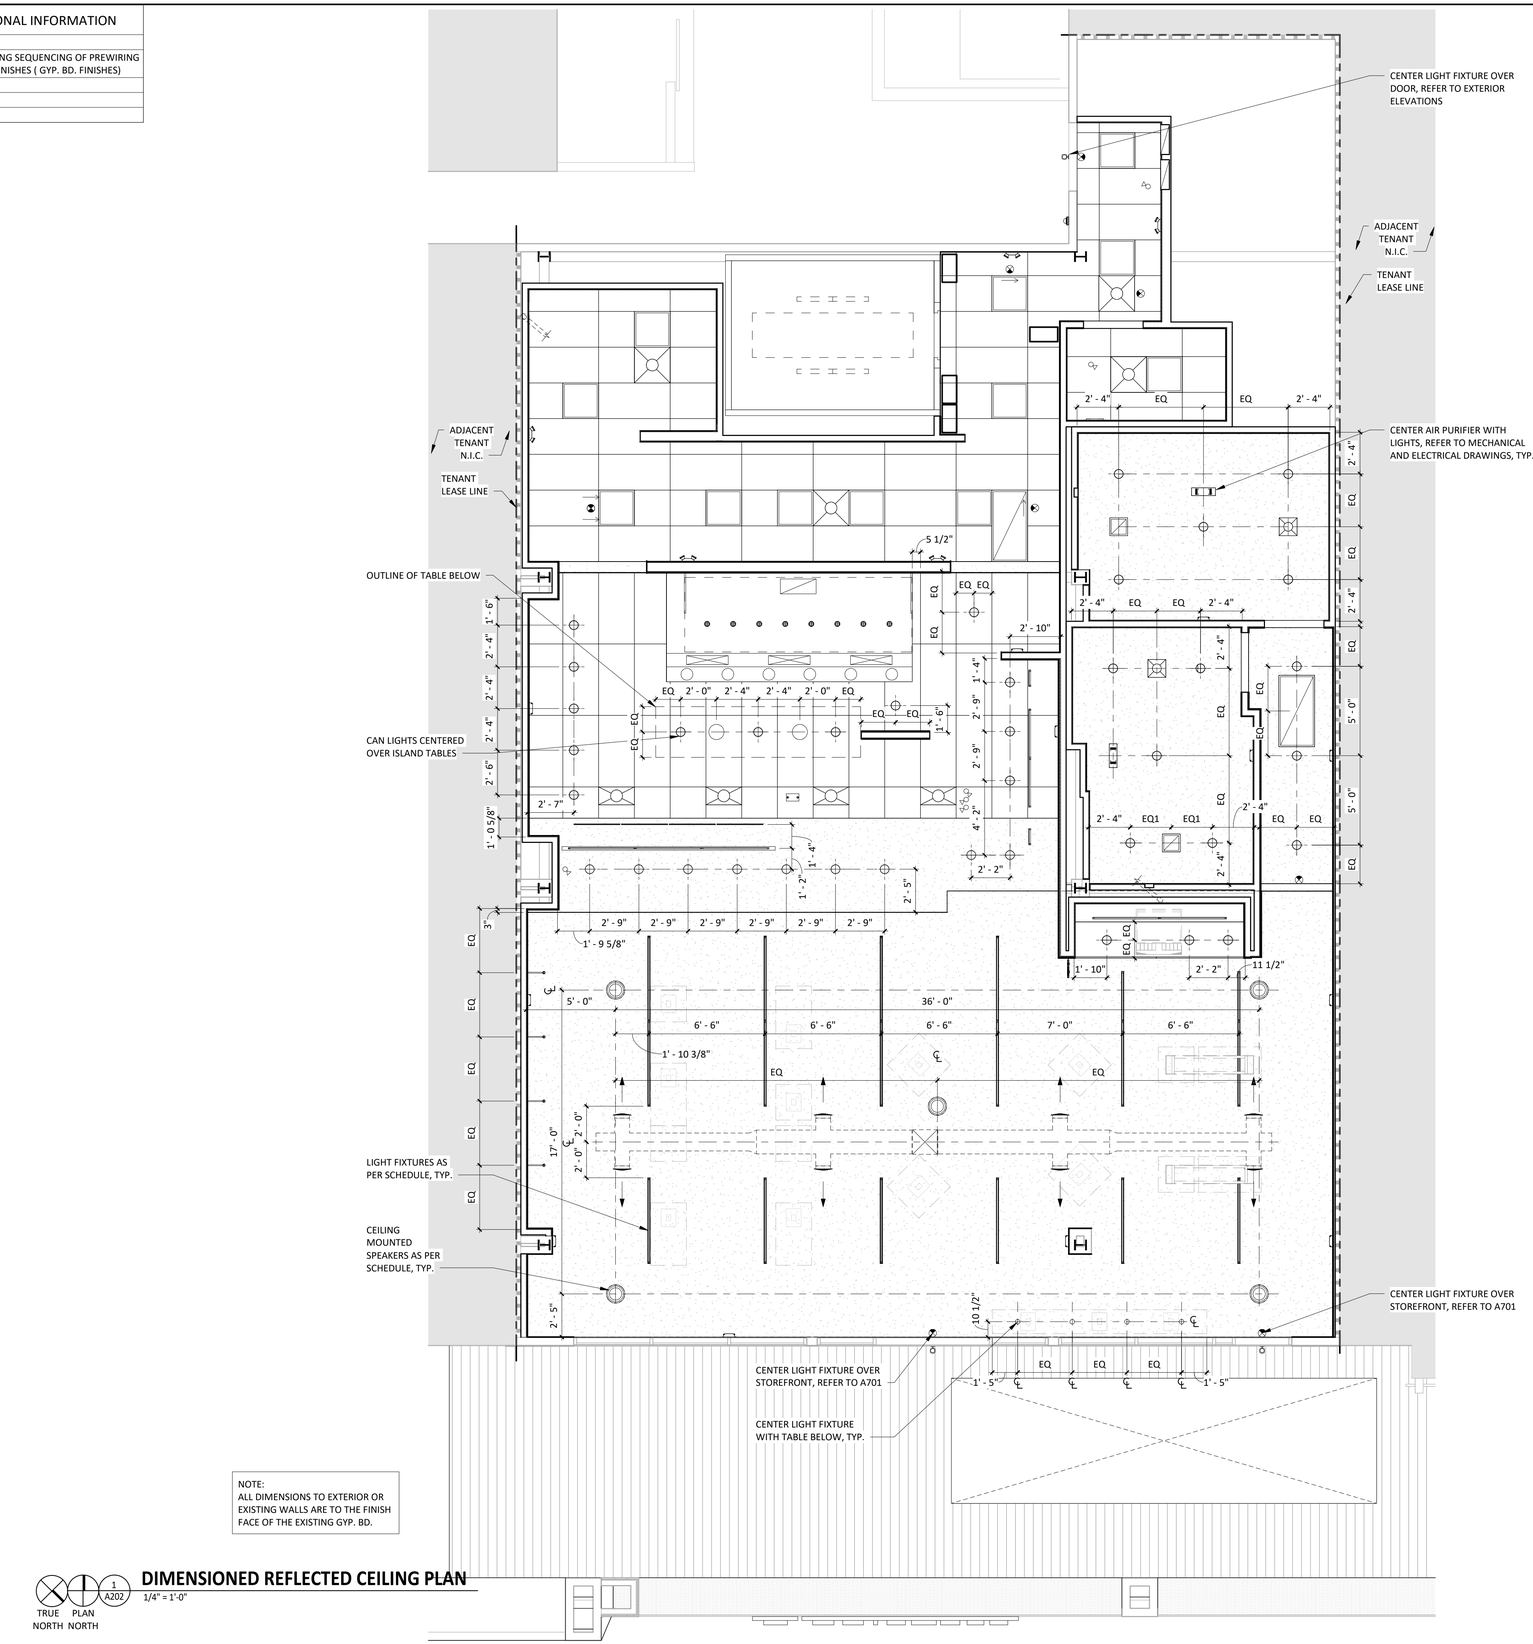

NOTE:
ALL DIMENSIONS TO EXTERIOR OR EXISTING WALLS ARE TO THE FINISH FACE OF THE EXISTING GYP. BD.

TRUE NORTH PLAN NORTH

1 / A202 **DIMENSIONED REFLECTED CEILING PLAN**

1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
DIMENSIONED REFLECTED CEILING PLAN

A202

REFER TO A201 FOR GENERAL NOTES

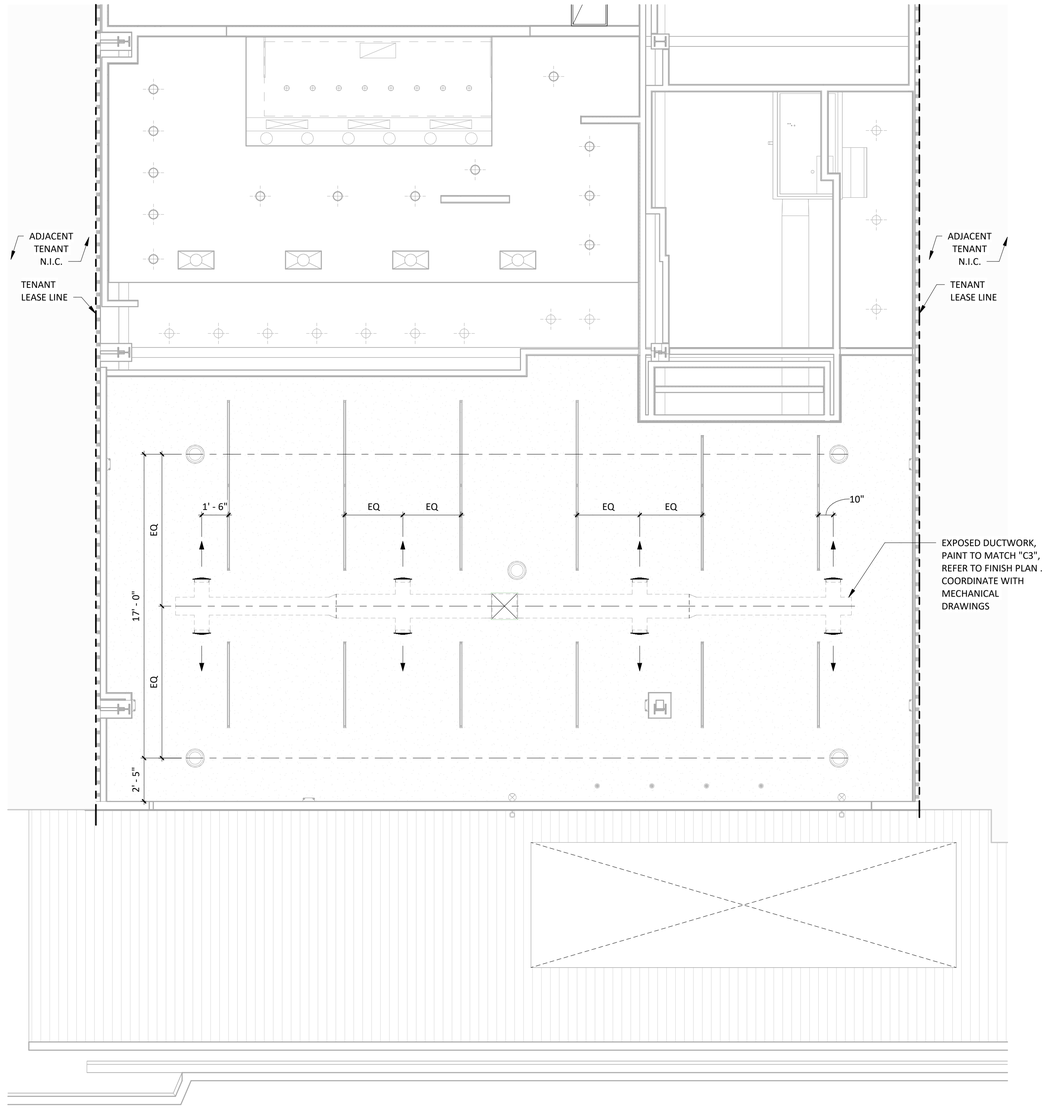

1 A203

TRUE NORTH PLAN NORTH

DUCTWORK LAYOUT

1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

REFLECTED CEILING & DUCTWORK PLAN

A203

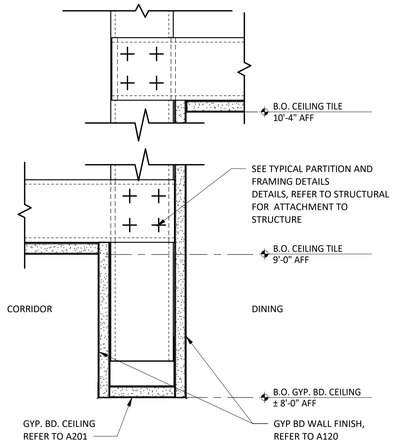

8 A210 **CORRIDOR CEILING TRANSITION**
3" = 1'-0"

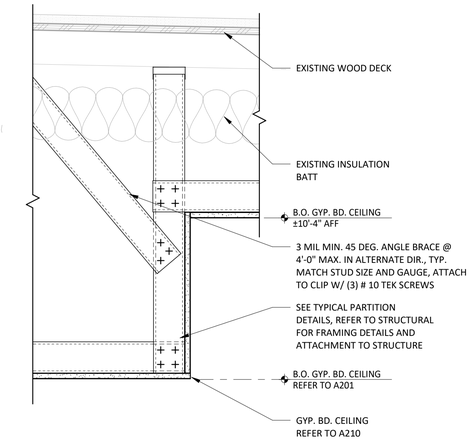

7 A210 **JOIST SHELF DETAIL**
1 1/2" = 1'-0"

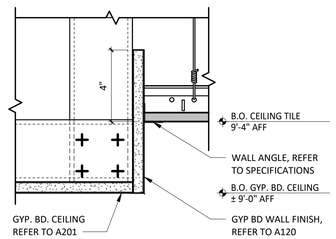

6 A210 **KITCHEN CEILING TRANSITION**
3" = 1'-0"

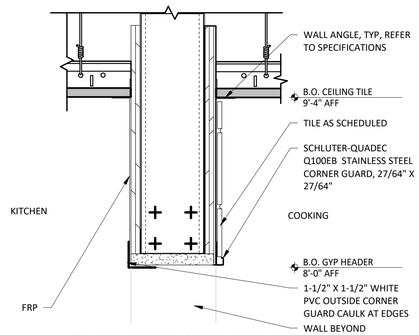

5 A210 **KITCHEN CEILING TRANSITION**
3" = 1'-0"

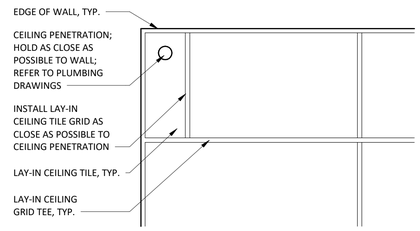

4 A210 **LAY-IN CEILING PENETRATION - PLAN DETAIL**
3/4" = 1'-0"

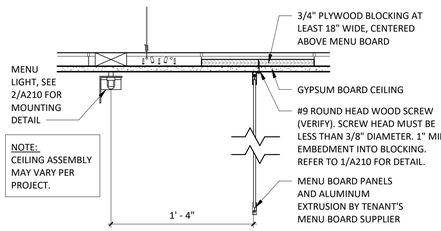

3 A210 **MENU BOARD DETAIL**
1 1/2" = 1'-0"

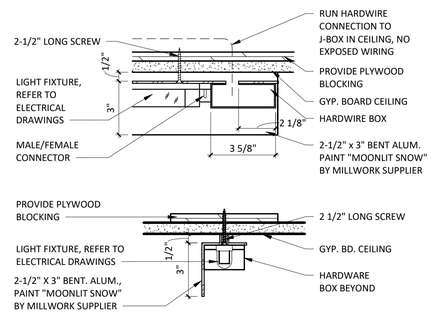

2 A210 **MENU BOARD / ACCENT LIGHT DETAILS**
3" = 1'-0"

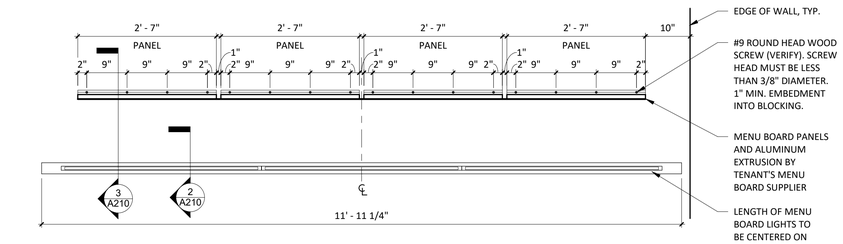

1 A210 **MENU - SCREW PATTERN PLAN**
3/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
CEILING DETAILS

A210

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

LIGHTING DETAILS

A211

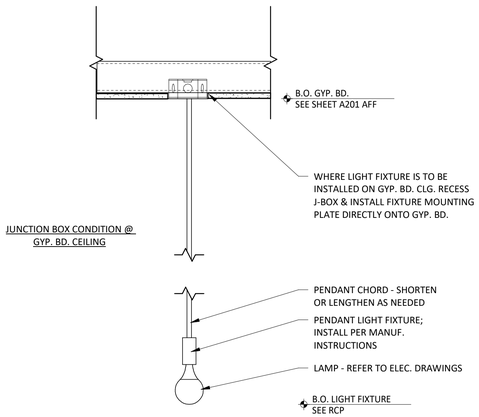

3 / A211 **PENDANT LIGHT FIXTURE**
1 1/2" = 1'-0"

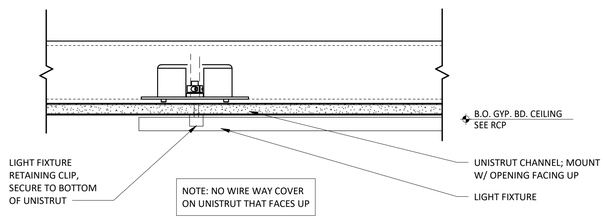

2 / A211 **SUSPENDED STRIP LIGHT CONNECTION DETAIL**
3" = 1'-0"

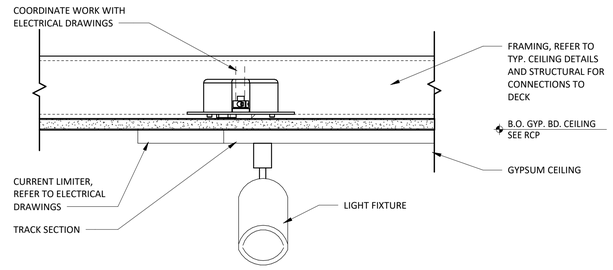

1 / A211 **SUSPENDED TRACK LIGHT CONNECTION DETAIL**
3" = 1'-0"

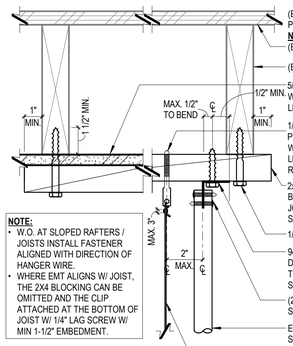

NOTE:
- W.O. AT SLOPED RAFTERS / JOISTS INSTALL FASTENER ALIGNED WITH DIRECTION OF HANGER WIRE.
- WHERE EMT ALIGNS W/ JOIST, THE 2X4 BLOCKING CAN BE OMITTED AND THE CLIP ATTACHED AT THE BOTTOM OF JOIST W/ 1/4" LAG SCREW W/ MIN 1-1/2" EMBEDMENT.

SEISMIC COMPRESSION STRUT ATTACHMENT TO WOOD STRUCTURE



12 GA. SEISMIC BRACING WIRE 45° MAX. FROM HORIZ. PLANE. INSTALL TAUNT AND WRAP WIRE LOOPS MIN. 4X TIGHTLY WITHIN 1-1/2" MAX. ATTACH TO BLOCKING W/ 1/4" DIA. CLOSED EYE SCREW W/ 1-1/2" MIN. PENETRATION

SEISMIC SPLAY WIRE ATTACHMENT TO (E) WOOD JOIST



SEISMIC SPLAY WIRE ATTACHMENT BETW. (E) WOOD JOIST @ TYPE 'X' GYP. BD.



SEISMIC SPLAY WIRE ATTACHMENT BETW. (E) WOOD JOIST

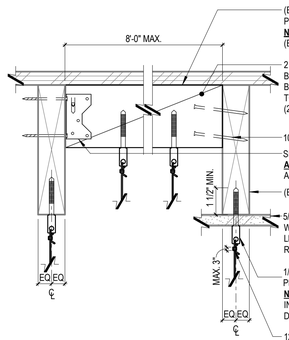

HANGER WIRE ATTACHMENT TO WOOD STRUCTURE (OPTIONS)

HANGER & SEISMIC BRACE WIRE & EMT COMPRESSION STRUT CONNECTION TO WOOD STRUCTURE AT SUSPENDED CEILING

4 A212 — 3" = 1'-0"

ALTERNATIVE:
IN LIEU OF EMT, PROVIDE MTL. C-STUD PER SCHED. ATTACH TO MAIN RUNNER W/ (2) 1/4" DIA. MACHINE THRU-BOLT AND NUT CONNECTING FLATTENED END OF STUD TO MAIN RUNNER BULB. CENTER OVER CROSS TEE. SEE DIAGRAM FOR LOCATIONS. ATTACH TO STRUCTURE ABOVE PER APPLICABLE. CONNECTION DETAIL.

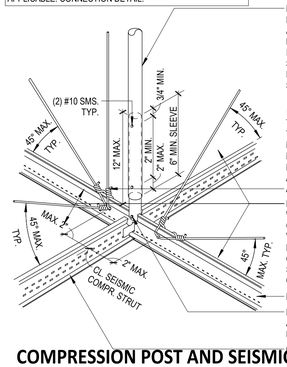

VERTICAL EMT COMPRESSION STRUT AS SCHEDULED. ATTACH TO MAIN RUNNER @ 12'-0" O.C. MAX. @ 6'-0" O.C. MAX. FROM WALLS. CENTERED O/ CROSS TEE. SEE DIAGRAM FOR LOCATIONS. ATTACH TO STRUCTURE ABOVE PER APPLICABLE. CONNECTION DETAIL. INSTALL STRUT NOT MORE THAN 1 HORIZ. IN 6 VERT. OUT OF PLUMB. SEPARATE COMPRESSION STRUTS AT LEAST 6-INCHES FROM ALL UNBRACED DUCTS, PIPES, CONDUIT, ETC. INSTALL INDEPENDENT POSITIVE BRACING SYSTEMS FOR EA. CHANGE IN CLG. PLANE ELEV. FOR LATERAL MOVEMENT AND SEISMIC LOADS.

12-GA. VERTICAL WIRE HANGER, ATTACH TO GRID. WRAP WIRE LOOPS MIN. 3X TIGHTLY TO PREVENT ANY VERTICAL MOVEMENT OR ROTATION OF THE MEMBER WITHIN THE LOOPS W/ MAX. (2" MAX. FROM SEISM. COMPRESSION STRUT) ATTACH TO STRUCTURE ABOVE PER APPLICABLE CONNECTION DETAIL.

PROVIDE (4) X 12 GA. SPLAYED BRACING WIRES ORIENTED 90 DEG. FROM EACH OTHER AND IN PLANE OF EA. RUNNER/TEE, VERTICAL ANGLE AT 45° MAX. FROM HORIZ. PLANE. (2" MAX. FROM SEISM. COMPRESSION STRUT) ATTACH TAUNT TO STRUCTURE ABOVE PER APPLICABLE SDC. CONNECTION DETAIL.

MAIN RUNNER, TYP.

PROVIDE 1/4" DIA. MACHINE THRU-BOLT AND NUT CONNECTING SLOTTED END OF EMT TO MAIN RUNNER BULB.

COMPRESSION POST AND SEISMIC BRACING AT SUSPENDED CEILING

8 A212 — 3/16" = 1'-0"

NOTES:
1. POSITIVELY ATTACH EA. RECESSED LIGHT FIXTURE, FLEX. SPRINKLER FITTING, AIR TERMINAL OR OTHER DEVICE TO SUSPENDED CEILING SYSTEM W/ MIN. (2) APPROVED MECHANICAL CLIPS/FASTENERS AT OPPOSITE CORNERS SUPPORTING 100 % OF THE FIXTURE WEIGHT ACTING IN ANY DIRECTION.
2. ATTACH EA. SURFACE-MOUNTED LIGHT FIXTURE TO SUSPENDED CEILING SYSTEM W/ A POSITIVE CLAMPING DEVICE COMPLETELY SURROUNDING THE SUPPORTING MEMBERS. PROVIDE SAFETY WIRES BETWEEN THE CLAMPING DEVICE AND THE ADJ. CEILING HANGER OR TO STRUCTURE PER APPLICABLE ATTACHMENT DETAIL.
3. ANY FIXTURE WEIGHT MAY NOT EXCEED CARRYING DESIGN LOAD OF SUPPORTING CEILING GRID MEMBERS.
4. PROVIDE 12 GA. SAFETY WIRES AT EA. LIGHT FIXTURE CONNECTING THE FIXTURE HOUSING TO THE STRUCTURE ABOVE. SAFETY WIRES DONT NEED TO BE TAUT. PROVIDE MIN. (1) SAFETY WIRE @ LIGHT FIXTURE < 10 LB. (SUPPLEMENTARY HANGER WIRES OF SUPPORTING CROSS TEES NOT REQUIRED), OR MIN. (2) SAFETY WIRES @ LIGHT FIXTURE FROM 10 LB. - 56 LB., AND MIN. (2) SAFETY WIRES AT FLEX. SPRINKLER FITTING, AIR TERMINAL OR OTHER DEVICE WEIGHING FROM 20 LB. TO 56 LB.
5. SUPPORT EA. LIGHT FIXTURE, FLEX. SPRINKLER, AIR TERMINAL OR OTHER DEVICE EXCEEDING 56 LB., AND EA. PENDANT LIGHT FIXTURE DIRECTLY FROM THE STRUCTURE ABOVE BY APPROVED HANGERS OR ALT. SUPPORT. DO NOT SUPPORT FROM CEILING GRID SUSPENSION SYSTEM.
6. RIGID CONDUIT IS NOT PERMITTED FOR ATTACHMENT OF LIGHT FIXTURES.

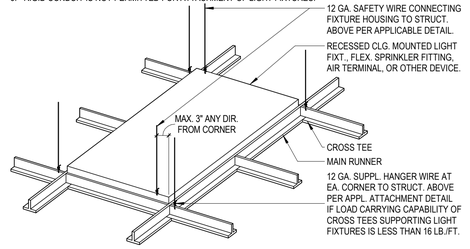

TYP. CLG. MOUNTED LIGHT FIXTURE OR DEVICE ATTACHMENT AT SUSP. CEILING

7 A212 — 1 1/2" = 1'-0"

GRID CONNECTION TO ATTACHED WALL AT SUSPENDED CEILING GRID

6 A212 — 3" = 1'-0"

NOTES:
- PROVIDE SEISMIC SEPARATION JOINT FOR CONT. CEILING AREAS > 2,500 SQ. FT.
- INSTALL PER ICC ESR-1308

SEISMIC JOINT AT CROSS TEE

SEISMIC SEPARATION JOINTS AT SUSPENDED CEILING GRID

5 A212 — 1 1/2" = 1'-0"

GRID CONNECTION TO UNATTACHED WALL AT SUSPENDED CEILING GRID

3 A212 — 3" = 1'-0"

HANGER/BRACE WIRE SPLICE
1. WIRE SPLICES SHOWN LOOSELY TIED FOR ILLUSTR. PURPOSES ONLY. DRAW TIGHT TO COMPLETE INSTALLATION WHEN CONSTRUCTED.
2. TIGHTLY WRAP WIRE LOOPS AND BEND SHARPLY TO PREVENT ANY VERT. MOVEMENT OR ROTATION WITHIN THE LOOPS.
3. EACH HANGER AND BRACE WIRE SHALL BE SPLICED NO MORE THAN ONCE ALONG ITS LENGTH.

GRID AND WIRE HANGER

ALTERNATIVE:
GRID AND COUNTER SPLAYED WIRE HANGER

TYPICAL WIRE HANGER AT SUSPENDED CEILING GRID

2 A212 — 3" = 1'-0"

TYPICAL SUSPENDED CEILING WIRING DIAGRAM - SDC D,E & F

1 A212 — 1/4" = 1'-0"

REQUIREMENTS: SUSP. CEILING SYSTEMS SEISMIC DESIGN CATEGORIES D,E & F

1. **BASELINE SUSPENDED CEILING SYSTEM IS BASED ON "ARMSTRONG" SEISMIC RESTRAINT PER ICC REPORT ESR-1308 FOR SDC 'D','E','F' COMPONENTS FOR PERMIT AND BID PURPOSES. CONFORM TO ASTM C635, C636, E580 AND ASCE-7 SECTION 13.5.6 ALTERNATIVE MANUFACTURERS ARE PERMITTED, PROVIDING PRODUCT IS COMPARABLE INCLUDING, BUT NOT LIMITED TO, FUNCTION, DIMENSION, PERFORMANCE, APPEARANCE AND OTHER CHARACTERISTICS EQUAL OR EXCEEDING SPECIFIED PRODUCT. CONTRACTOR IS RESPONSIBLE FOR CERTIFICATION OF ALL ALTERNATIVE PRODUCTS.**
2. **THE ASSEMBLIES SUPPORTED ARE LIMITED TO DISTRIBUTED CEILING SYSTEMS WHERE THE LOAD ON ANY INDIVIDUAL SUPPORT ASSEMBLY DOES NOT EXCEED 90 LBF (400N).**
3. SYSTEM COMPONENTS SHALL BE COMPLIANT WITH CODE DEFINED SEISMIC DESIGN CATEGORIES (SDC) ENFORCED BY LOCAL JURISDICTION.
4. PROVIDE 12-GA. VERT. HANGER WIRES @ 4'-0" MAX. OC. ALONG MAIN BEAMS AND NOT MORE THAN ONE-IN-SIXTH OUT-OF-PLUMB, UNLESS A COUNTER-SLOPING WIRE OR HORIZONTAL BRACE IS PROVIDED. PROVIDE PERIM. VERT. SUPPORT WIRES WITHIN 8" FROM EDGE/WALL.
5. INSTALL ALL HANGER AND BRACING WIRE ANCHOR CLOSELY IN LINE W/ DIRECTION OF WIRE PER DETAILS.
6. SEPARATE ALL CEILING HANGER AND BRACING WIRES AT LEAST 6-INCHES FROM ALL UNBRACED DUCTS, PIPES, CONDUIT, ETC.
7. DO NOT NOT ATTACH TO OR BEND HANGER AND BRACING WIRES AROUND OBSTRUCTIONS, INCLUDING BUT NOT LIMITED TO PIPING, DUCTWORK, CONDUIT AND EQUIPMENT. PROVIDE TRAPEZE OR OTHER SUPPLEMENTARY SUPPORT MEMBERS AT OBSTRUCTIONS TO ALLOW TYPICAL HANGER SPACING. BRACE ASSEMBLIES MUST BE CONFIGURED AND/OR LOCATED TO AVOID OBSTRUCTIONS WHILE MAINTAINING THE REQUIRED MAXIMUM BRACE ASSEMBLY SPACING.
8. BRACE PARTITIONS ATTACHED TO CEILING SUSPENSION SYSTEM LATERALLY TO BUILDING STRUCTURE INDEPENDENT FROM CEILING.
9. USE MAX. 4'-0" X 4'-0" GRID SYSTEM.
10. PROVIDE MIN. 7/8" PERIMETER SUPPORTING WALL ANGLE W.O. NO EXPOSED POP RIVETS.
11. ATTACH GRID SYSTEM ON TWO ADJACENT WALLS W.O. IN EACH ORTHOGONAL HORIZONTAL DIRECTION. ATTACH END OF THE CEILING GRID TO SUPPORTING WALL ANGLE AND PERIMETER SEISMIC RESTRAINT CLIP - AT THE OPPOSITE END OF THE CEILING GRID IN EACH HORIZONTAL DIRECTION PROVIDE A MIN. 3/4" CLEARANCE AT GRID END TO WALL OBSTRUCTION, AND REST UNATTACHED GRID ON AND BE FREE TO SLIDE ON THE SUPPORTING WALL ANGLE AND PERIMETER SEISMIC RESTRAINT CLIP.
12. PROVIDE SEISMIC RESTRAINT CLIPS TO MAINTAIN MAIN BEAM & CROSS TEE SPACING AT PERIMETER IN LIEU OF SPREADER BARS TO CONFORM WITH ICC REPORT.
13. SCREW OR OTHERWISE POSITIVELY ATTACH ALL WALL ANGLES TO WALL STUDS OR OTHER SUPPORTING STRUCTURES.
14. ATTACH PERIMETER SEISMIC RESTRAINT CLIPS TO THE SUPPORTING WALL ANGLE W/ MIN. (2) SCREWS PER CLIP AT EA. GRID END AROUND THE ENTIRE CEILING PERIMETER.
15. PROVIDE HEAVY-DUTY GRID SYSTEMS AS IDENTIFIED IN ICC-ESR-1308
16. PROVIDE WIRE OR RIGID BRACING FOR HORIZONTAL RESTRAINT AT CEILINGS OVER 1,000 SF.
17. PROVIDE SEISMIC SEPARATION JOINTS FOR CEILINGS OVER 2,500 SF, UNLESS SEPARATED BY FULL HT. PARTITIONS. SEISMIC JOINTS SHALL BE CONCEALED FROM BELOW CEILING.
18. PROVIDE 2" OVERSIZED TRIM RINGS FOR SPRINKLERS AND OTHER PENETRATIONS FOR CEILINGS WITHOUT RIGID BRACING UNLESS FLEX. SPRINKLER HOSE FITTINGS ARE USED.
19. PROVIDE POSITIVE BRACING AT EA. CHANGE IN CEILING PLANE.
20. SUPPORT AND BRACE CABLE TRAYS AND ELEC. CONDUITS INDEPENDENTLY.
21. PROVIDE COMPRESSION POSTS (UNLESS RIGID BRACING IS USED). SEE DETAIL FOR TYPICAL SUSPENDED CEILING BRACING FOR SDC D, E & F.
22. PROVIDE SEPARATE HANGERS, STRUTS, AND BRACE ASSEMBLIES AT ALL CEILING BREAKS, CEILING PLANE CHANGES, CEILING 'CLOUDS', SOFFITS, OR DISCONTINUOUS AREAS.
23. SAFETY WIRES REQUIRED ON ALL LIGHT FIXTURES.
24. **SUSPENDED CEILINGS BRACING ANCHORS SUBJECT TO SPECIAL INSPECTION.**

COMPRESSION STRUT SIZE TABLE

EMT SECTION MIN. SIZE OF SMALLEST MEMBER:

EMT DIAMETER:	WALL THICKNESS:	MAXIMUM LENGTH:
1/2"	0.042"	3'-11"
3/4"	0.049"	6'-4"
1"	0.057"	9'-9"
1 1/4"	0.065"	12'-9"
2"	0.065"	14'-9"

NOTE: SLEEVED EMT MAX. ONE SIZE LARGER THAN REQUIRED COMPRESSION STRUT SIZE. SEE DETAIL.

MTL. STUD SIZE ALTERNATIVE SSMA#:

SSMA NO.:	MAXIMUM LENGTH:
250S125-33	5'-10"
250S137-33	6'-10"
362S137-33	8'-0"
250S137-43	8'-10"
400S137-43	10'-10"

NOTE: NO SPLICES ALLOWED.

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
TYP. CEILING DETAILS

A212

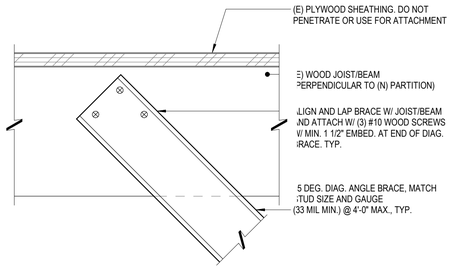

ALL SEISMIC DESIGN CATEGORIES:
BRACING ATTACHMENT AT WOOD STRUCTURE WHERE PARTITION IS PERPENDICULAR TO WD. JOISTS/BEAM

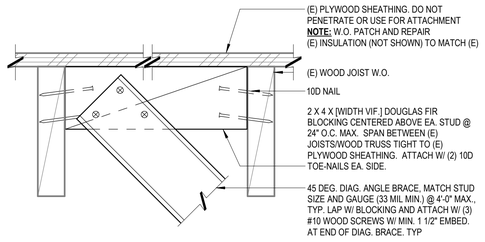

ALL SEISMIC DESIGN CATEGORIES: BRACING ATTACHMENT AT WOOD STRUCTURE WHERE PARTITION IS PARALLEL TO WOOD JOIST/BEAM

SEISMIC MTL. STUD BRACING ATTACHMENT AT WOOD STRUCTURE

3/A220 — 3" = 1'-0"

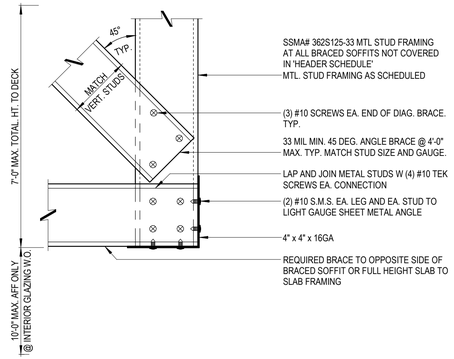

SOFFIT FRAMING AT OUTSIDE EDGE CEILING HT. OPENING OR SOFFIT - BRACED AT 48" O.C. ONE DIRECTION

DECK SUPPORTED CEILING & SOFFIT/OPENING FRAMING AT OUTSIDE EDGE

8/A220 — 3" = 1'-0"

QUALIFICATIONS & ASSUMPTIONS

REQUIREMENTS FOR (E) WOOD STRUCTURE:
VERIFY (E) STRUCTURE DOES NOT EXCEED 3/4" MAX. DEFLECTION

REQUIREMENTS FOR (N) PARTITION AND SOFFIT FRAMING:

- SEE PARTITION SCHEDULE FOR MTL. FRAMING TYPE.
- STUD SPACING: 24" O.C. MAX.
- STUD HEIGHT LIMITATION: 15'-0" MAX. AFF.
- STUD WALL WEIGHT: 10 PSF MAX.
- LATERAL LOAD: 5 PSF MAX.
- T.O. PARTIAL HEIGHT AND BRACED FRAMING TO DECK ABOVE: 8'-0" MAX.

- **DETAILS APPLICABLE FOR INTERIOR METAL STUD FRAMING AT (E) WOOD STRUCTURE W/ WOOD DECK OR WOOD ROOF ONLY.**
- **PROVIDE IN WRITING ANY AS BUILT FIELD DISCREPANCIES WITH THESE CONDITIONS, AND COORDINATE WITH ARCHITECT BEFORE START OF WORK.**
- **REFER TO OPENING FRAMING JAMB -HEADER -SILL SCHEDULES FOR MEMBER SIZING.**

***** MAX. LIMITS APPLY TO REFERENCED DETAILS ONLY. COORDINATE WITH PARTITION SCHEDULE.**

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

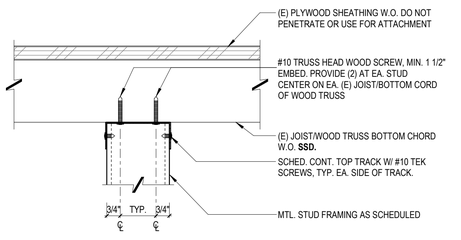

FRAMING AT WOOD DECK WHERE SOFFIT IS PERPENDICULAR TO WOOD JOISTS OR WOOD TRUSS W.O.

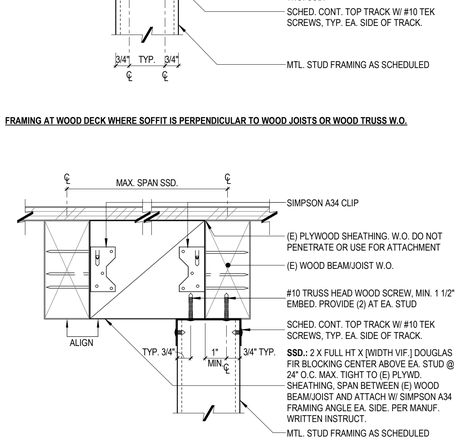

FRAMING AT WOOD DECK WHERE SOFFIT IS PARALLEL BELOW WOOD BEAM/JOISTS

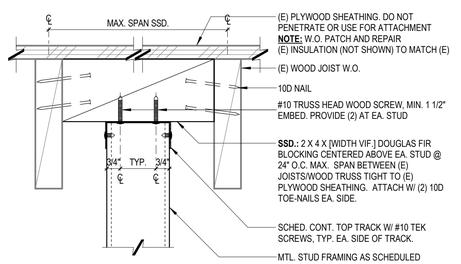

FRAMING AT WOOD DECK WHERE SOFFIT IS PARALLEL TO WOOD JOISTS

SOFFIT HEAD CONNECTION AT WOOD STRUCTURE

4/A220 — 3" = 1'-0"

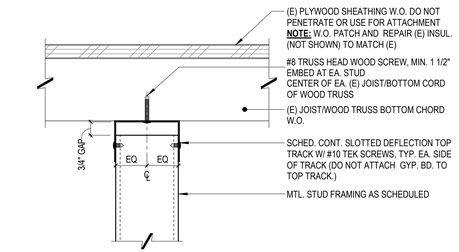

ALL SEISMIC DESIGN CATEGORIES: HEAD OF PARTITION FRAMING AT WOOD DECK WHERE PARTITION IS PERPENDICULAR TO WOOD JOISTS OR WOOD TRUSS W.O.

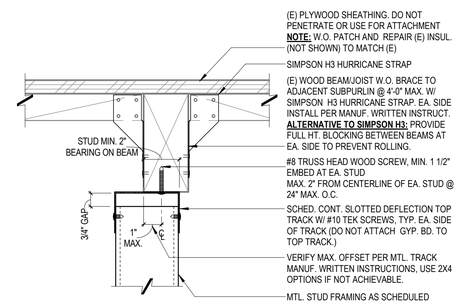

ALL SEISMIC DESIGN CATEGORIES:
HEAD OF PARTITION FRAMING AT WOOD DECK WHERE PARTITION IS PARALLEL TO WOOD BEAM/JOISTS

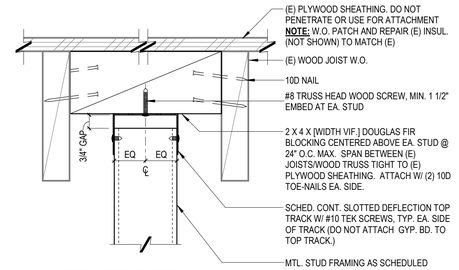

ALL SEISMIC DESIGN CATEGORIES:
HEAD OF PARTITION FRAMING AT WOOD DECK WHERE PARTITION IS PARALLEL TO WOOD JOISTS

FULL HEIGHT MTL. STUD PARTITION HEAD ATTACHMENT AT WOOD STRUCTURE

9/A220 — 3" = 1'-0"

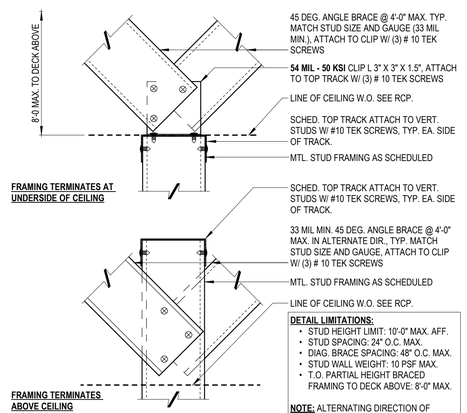

PARTIAL HEIGHT PARTITION HEAD BRACING ATTACHMENT

5/A220 — 3" = 1'-0"

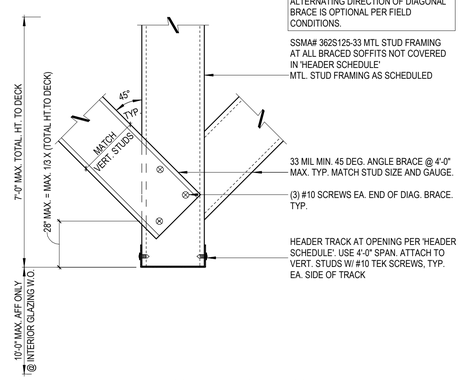

SOFFIT FRAMING AT CEILING HT. OPENING OR SOFFIT - BRACED AT 48" O.C.

DECK SUPPORTED CEILING & SOFFIT/OPENING FRAMING

6/A220 — 3" = 1'-0"

SEE SHEET "TYP. FRAMING DETAILS AND OPENING MEMBER SCHEDULES" FOR OPENING HEADER AND SILL INFO.

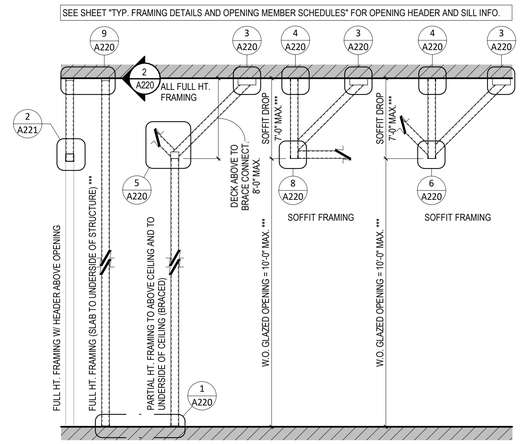

TYPICAL INTERIOR PARTITION FRAMING ATTACHMENT DIAGRAMS - WOOD STRUCTURE

7/A220 — 3/8" = 1'-0"

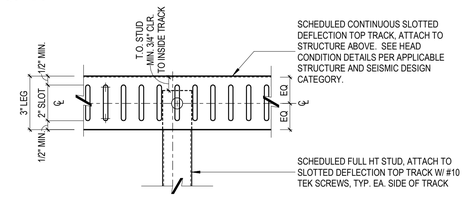

INTERIOR FRAMING - SLOTTED DEFLECTION TOP TRACK ELEVATION

2/A220 — 3" = 1'-0"

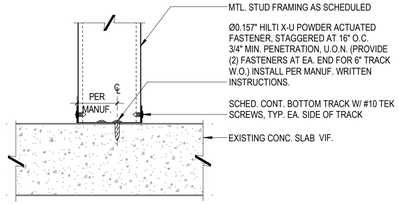

INTERIOR FRAMING - SILL AT CONC. SLAB

1/A220 — 3" = 1'-0"

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
TYP. MTL. STUD FRAMING DETAILS

A220

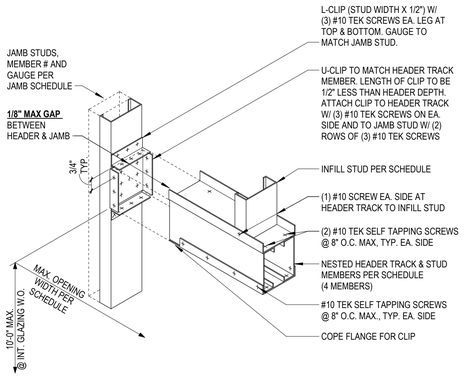

(4) MEMBER - BOX BEAM HEADER TO JAMB CONNECTION AT OPENING

12 A221 — 1" = 1'-0"

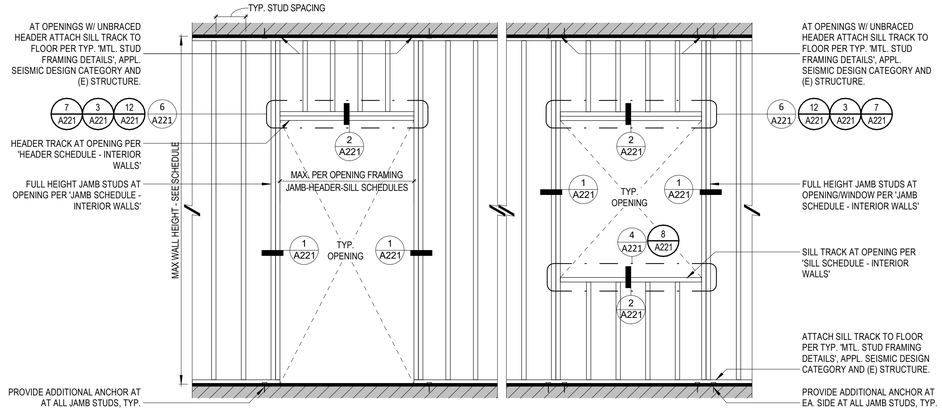

TYP. INTERIOR MTL. FRAMING OPENING DIAGRAMS

11 A221 — 3/8" = 1'-0"

JAMB SCHEDULE - INTERIOR WALLS - 3 5/8" AND 6" STUDS

MAX. OPENING WIDTH	STUD SIZE	12' MAX.WALL HEIGHT STUD/TRACK	NO. OF MEMBERS	17' MAX.WALL HEIGHT STUD/TRACK	NO. OF MEMBERS	20' MAX.WALL HEIGHT STUD/TRACK	NO. OF MEMBERS
4'-0"	3 5/8"	(1)362S162-43 (33KSI)	1	(1)362S162-43 (33KSI) (1)362T200-43 (33KSI)	2	(1)362S250-54 (50KSI) (1)362T250-54 (50KSI)	2
8'-0"	3 5/8"	(1)362S162-33 (33KSI) (1)362T150-33 (33KSI)	2	(2)362S200-43 (33KSI) (2)362T250-54 (50KSI)	3	(2)362S250-54 (50KSI) (2)362T250-54 (50KSI)	4
12'-0"	3 5/8"	(1)362S162-33 (33KSI) (1)362T125-33 (33KSI)	2	(2)362S250-54 (33KSI) (2)362T150-43 (33KSI)	4	(2)362S300-68 (50KSI) (2)362T250-68 (50KSI)	4
15'-0"	3 5/8"	(2)362S162-33 (33KSI) (1)362T200-33 (33KSI)	3	(2)362S300-54 (33KSI) (2)362T250-54 (50KSI)	4	(2)362S300-68 (50KSI) (2)362T250-97 (50KSI)	4
4'-0"	6"	(1)600S162-33 (33KSI)	1	(1)600S162-43 (33KSI)	1	(1)600S162-43 (33KSI)	1
8'-0"	6"	(1)600S162-33(33KSI)	1	(1)600S162-33 (33KSI) (1)600T125-30 (33KSI)	2	(1)600S200-43 (33KSI) (1)600T150-33 (33KSI)	2
12'-0"	6"	(1)600S162-33 (33KSI)	1	(1)600S200-33 (33KSI) (1)600T200-33 (33KSI)	2	(2)600S250-43 (33KSI) (1)600T125-33 (33KSI)	3
18'-6"	6"	(1)600S162-43 (33KSI)	1	(1)600S250-43 (33KSI) (1)600T250-43 (33KSI)	2	(2)600S250-43 (33KSI) (2)600T150-33 (33KSI)	4
21'-6"	6"	(1)600S200-43 (33KSI)	1	(2)600S200-33 (33KSI) (1)600T200-43 (33KSI)	3	(1)600S300-68 (50KSI) (1)600T250-97 (50KSI)	2

HEADER SCHEDULE - INTERIOR WALLS - 3 5/8" AND 6" STUDS

MAX. OPENING WIDTH	STUD SIZE	12' MAX.WALL HEIGHT STUD/TRACK	NO. OF MEMBERS	17' MAX.WALL HEIGHT STUD/TRACK	NO. OF MEMBERS	20' MAX.WALL HEIGHT STUD/TRACK	NO. OF MEMBERS
4'-0"	3 5/8"	(1)326T150-43 (50KSI)	1	(1)362S162-43 (33KSI) (1)362T200-33 (33KSI)	2	(1)362S200-33 (33KSI) (1)362T250-43 (33KSI)	2
8'-0"	3 5/8"	(1)362S200-33 (33KSI) (1)362T250-33 (33KSI)	2	(2)362S162-43 (33KSI) (2)362T125-43 (33KSI)	4	(2)362S162-43 (33KSI) (2)362T150-43 (33KSI)	4
12'-0"	3 5/8"	(2)362S200-43 (33KSI) (2)362T250-43 (33KSI)	4	(2)800S162-43 (33KSI) (2)362T250-54 (50KSI)	4	(2)800S162-43 (33KSI) (2)362T250-68 (50KSI)	4
15'-0"	3 5/8"	(2)362S250-97 (33KSI) (2)362T250-97 (50KSI)	4	(2)600S162-97 (33KSI) (2)362T250-97 (50KSI)	4	(2)1000S162-68 (50KSI) (2)362T250-97 (50KSI)	4
4'-0"	6"	600T200-43 (33KSI)	1	(1)600S162-33 (33KSI) (1)600T200-43 (33KSI)	2	(1)600S162-43 (33KSI) (1)600T200-43 (33KSI)	2
8'-0"	6"	(1)600S162-33 (33KSI) (1)600T250-43 (33KSI)	2	(2)600S162-33 (33KSI) (2)600T125-30 (33KSI)	4	(2)600S162-33 (33KSI) (2)600T125-33 (33KSI)	4
12'-0"	6"	(2)600S162-33 (33KSI) (2)600T125-30 (33KSI)	4	(2)600S162-33 (33KSI) (2)600T150-33 (33KSI)	4	(2)600S200-43 (33KSI) (2)600T200-33 (33KSI)	4
18'-6"	6"	(2)600S200-54 (33KSI) (2)600T200-54 (50KSI)	4	(2)1000S200-43 (33KSI) (2)600T250-68 (50KSI)	4	(2)1200S300-54 (33KSI) (2)600T250-68 (50KSI)	4
21'-6"	6"	(2)600S350-54 (33KSI) (2)600T250-68 (50KSI)	4	(2)1000S300-54 (33KSI) (2)600T250-97 (50KSI)	4	(2)1400S200-68 (50KSI) (2)600T250-97 (50KSI)	2

SILL SCHEDULE - INTERIOR WALLS - 3 5/8" AND 6" STUDS

MAX. OPENING WIDTH	STUD SIZE	STUD/TRACK	NO. OF MEMBERS	MAX. OPENING WIDTH	STUD SIZE	STUD/TRACK	NO. OF MEMBERS
4'-0"	3 5/8"	(1)362T150-33 (33KSI)	1	4'-0"	6"	(1)600T125-30 (33KSI)	1
8'-0"	3 5/8"	(1)362T150-33 (33KSI)	1	8'-0"	6"	(1)600T125-30 (33KSI)	1
12'-0"	3 5/8"	(1)362S162-43 (33KSI) (1)362T150-43 (33KSI)	2	12'-0"	6"	(1)600T125-33 (33KSI)	1
15'-0"	3 5/8"	(1)362S200-54 (33KSI) (1)362T250-54 (33KSI)	2	18'-6"	6"	(1)600S200-43 (33KSI) (1)600T250-43 (33KSI)	2
				21'-6"	6"	(1)600S300-54 (33KSI) (1)600T250-43 (33KSI)	2

NOTE: SEE AXON AND FASTENING OPTION DETAILS FOR ADDITIONAL INFO BASED ON OPENING DIMENSIONS.

OPENING FRAMING JAMB - HEADER - SILL SCHEDULES

5 A221 — 3" = 1'-0"

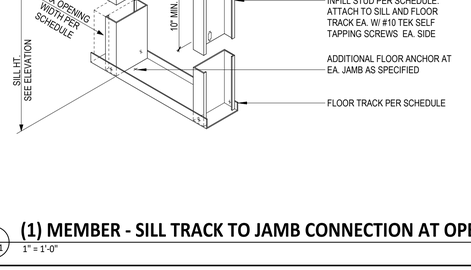

(2) MEMBER - SILL TRACK TO JAMB CONNECTION AT OPENING

8 A221 — 1" = 1'-0"

(2) MEMBER STUD & TRACK HEADER TO JAMB CONNECTION AT OPENING

7 A221 — 1" = 1'-0"

(1) MEMBER - HEADER TRACK TO JAMB CONNECTION AT OPENING

6 A221 — 1" = 1'-0"

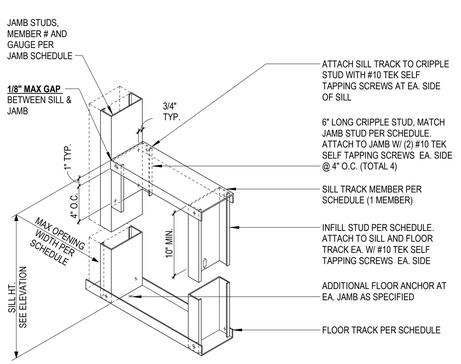

(1) MEMBER - SILL TRACK TO JAMB CONNECTION AT OPENING

4 A221 — 1" = 1'-0"

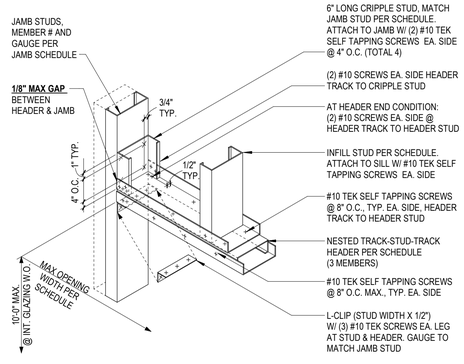

(3) MEMBER TRACK-STUD-TRACK HEADER TO JAMB CONNECTION AT OPENING

3 A221 — 1" = 1'-0"

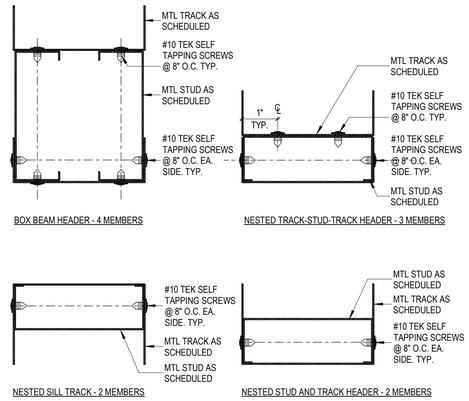

NOTE: REFER TO "OPENING FRAMING JAMB - HEADER - SILL SCHEDULES" FOR MEMBER SIZING REQUIREMENTS.

FASTENING OPTIONS FOR SILLS, AND HEADERS WITH 4, 3, OR 2 MEMBERS

2 A221 — 6" = 1'-0"

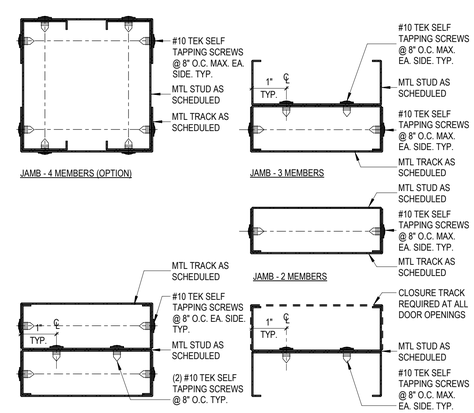

NOTE: REFER TO "OPENING FRAMING JAMB - HEADER - SILL SCHEDULES" FOR MEMBER SIZING REQUIREMENTS.

FASTENING OPTIONS FOR JAMBS WITH 4, 3, OR 2 MEMBERS

1 A221 — 6" = 1'-0"

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
TYP. MTL. STUD FRAMING DETAILS

A221

EXT ELEV GENERAL NOTES

1.	REFER TO EXTERIOR ELEVATIONS THIS SHEET FOR EXTERIOR SIGNAGE LOCATIONS, SIZES & DESCRIPTIONS.
2.	EXTERIOR SIGNAGE PROVIDED BY TSV AND INSTALLED BY TSV. GC TO MAKE FINAL CONNECTION.

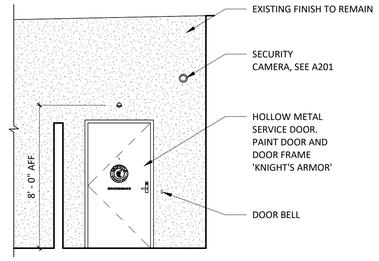

3/A301 EXT ELEV - REAR ELEVATION

1/4" = 1'-0"

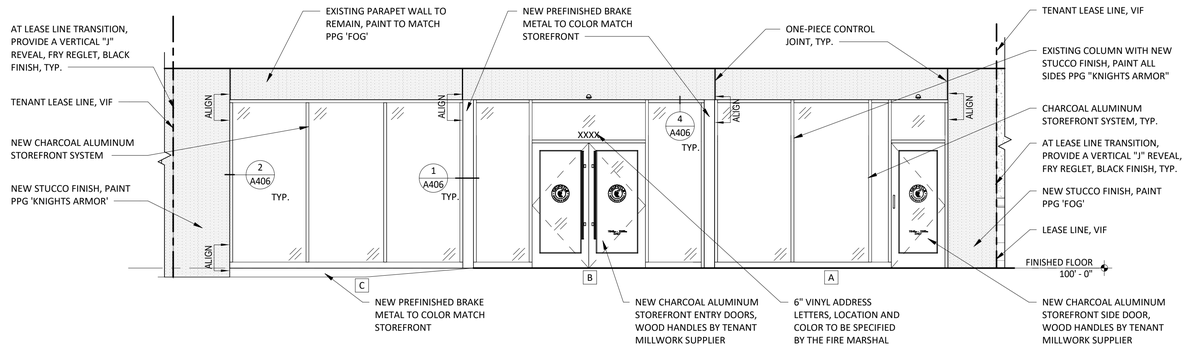

2/A301 EXT ELEV - STOREFRONT

1/4" = 1'-0"

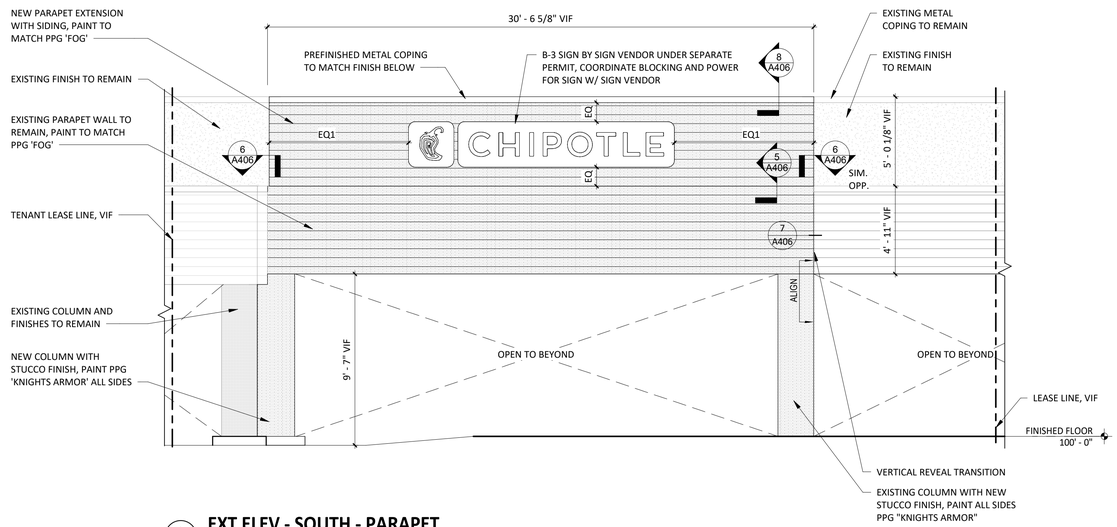

1/A301 EXT ELEV - SOUTH - PARAPET

1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
EXTERIOR ELEVATIONS

A301

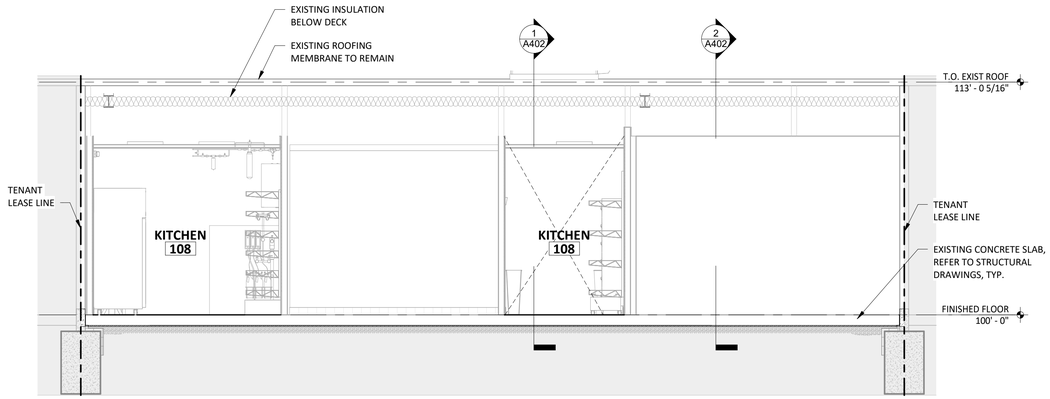

4 A401 **BUILDING SECTION**
1/4" = 1'-0"

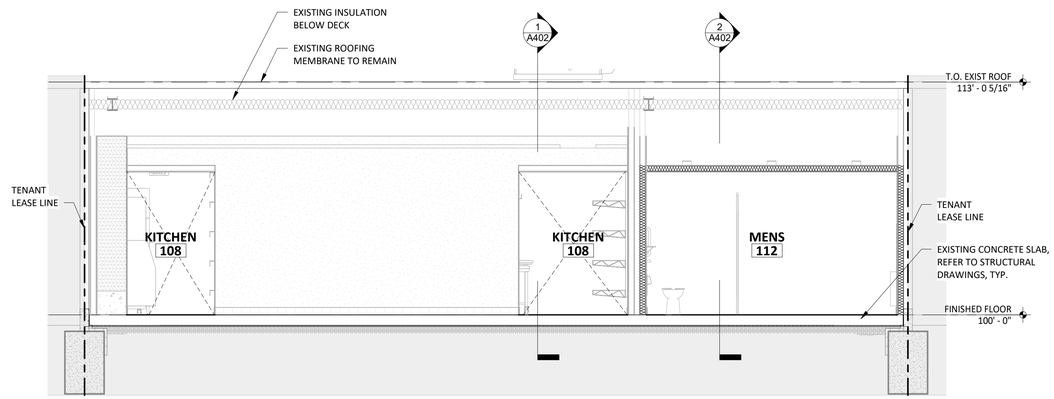

3 A401 **BUILDING SECTION**
1/4" = 1'-0"

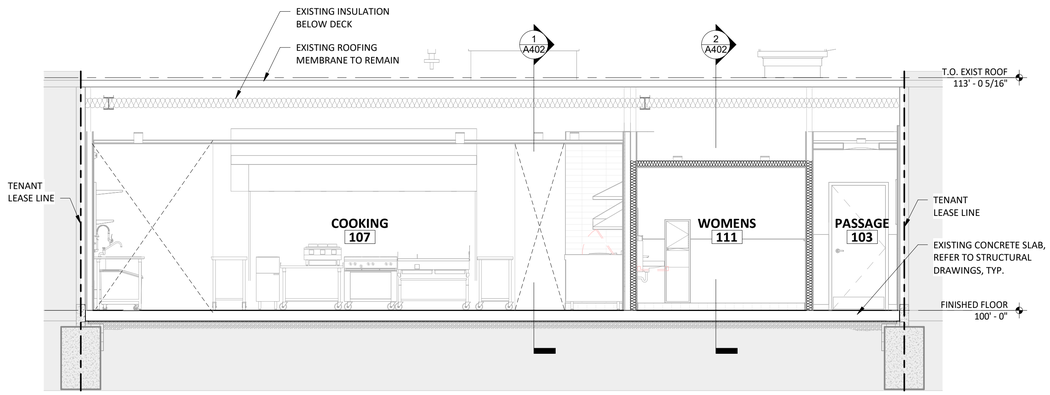

2 A401 **BUILDING SECTION**
1/4" = 1'-0"

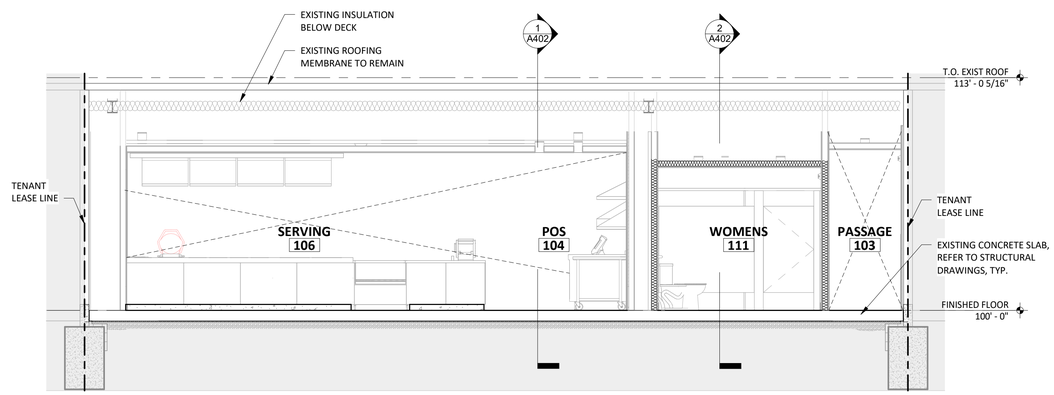

1 A401 **BUILDING SECTION**
1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
BUILDING SECTIONS

A401

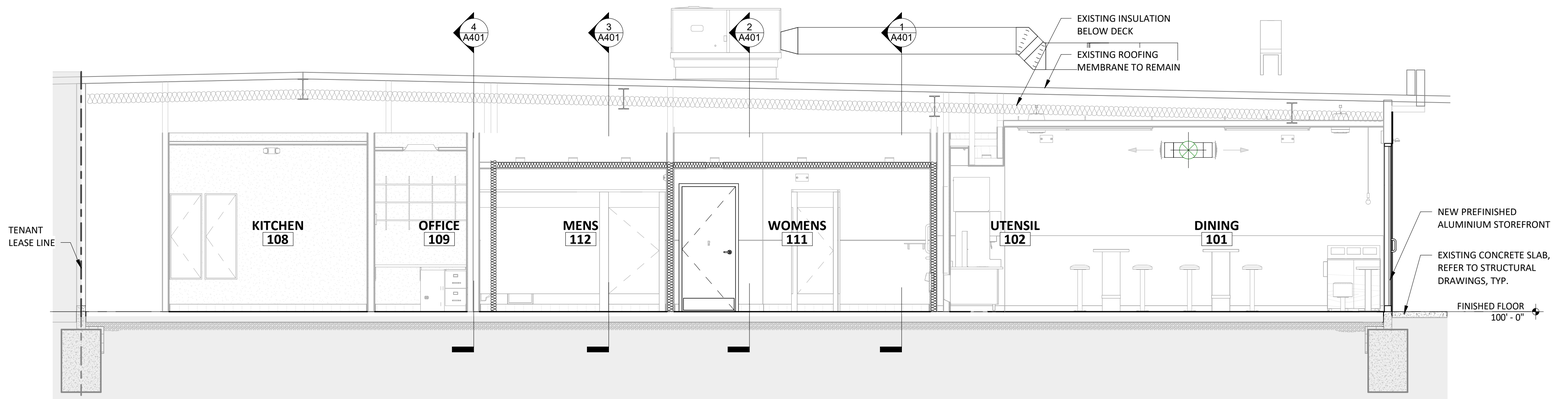

2 A402 **BUILDING SECTION**
1/4" = 1'-0"

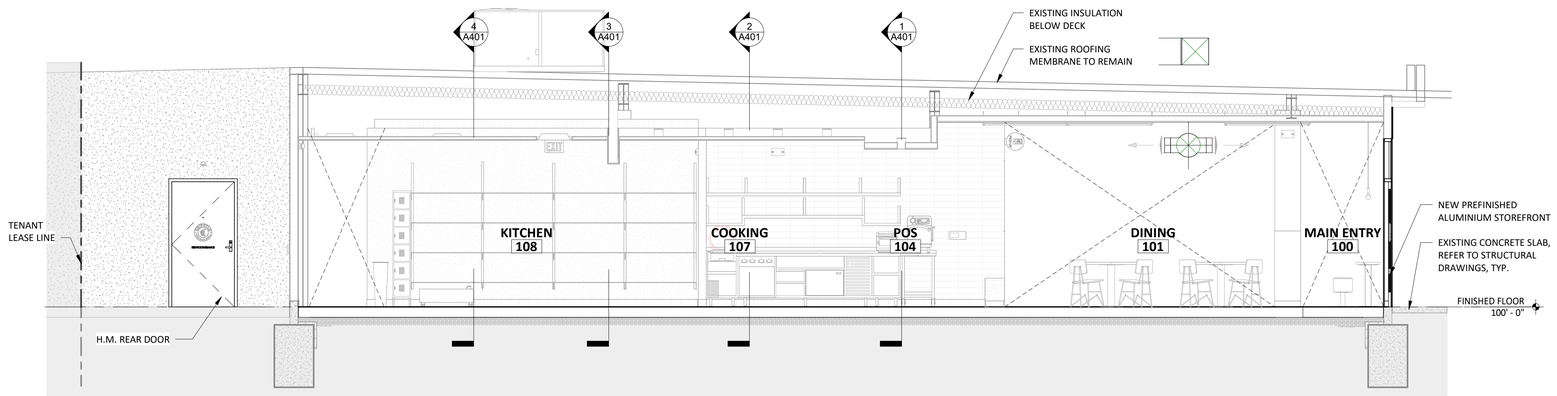

1 A402 **BUILDING SECTION**
1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
BUILDING SECTIONS

A402

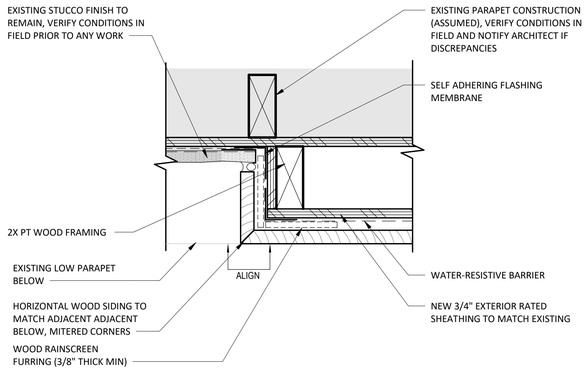

6 A406 **NEW PARAPET END TRANSITION**
3" = 1'-0"

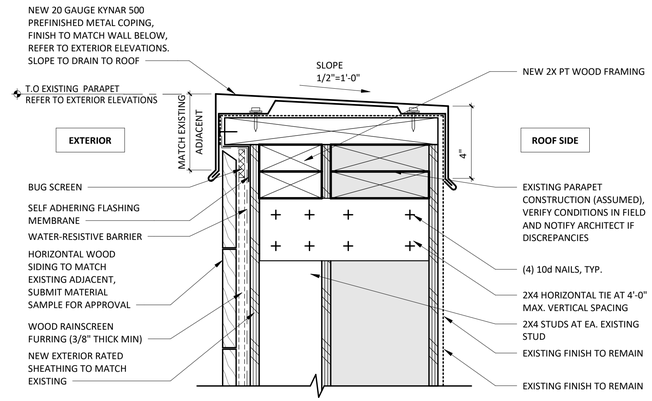

8 A406 **WOOD SIDING PARAPET DETAIL**
3" = 1'-0"

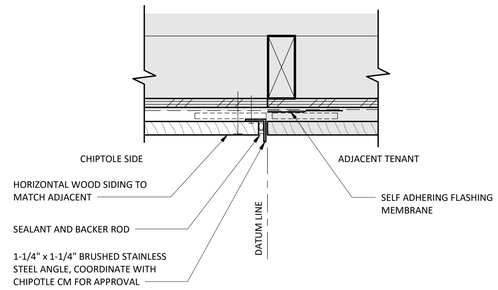

7 A406 **VERTICAL REVEAL TRANSITION**
3" = 1'-0"

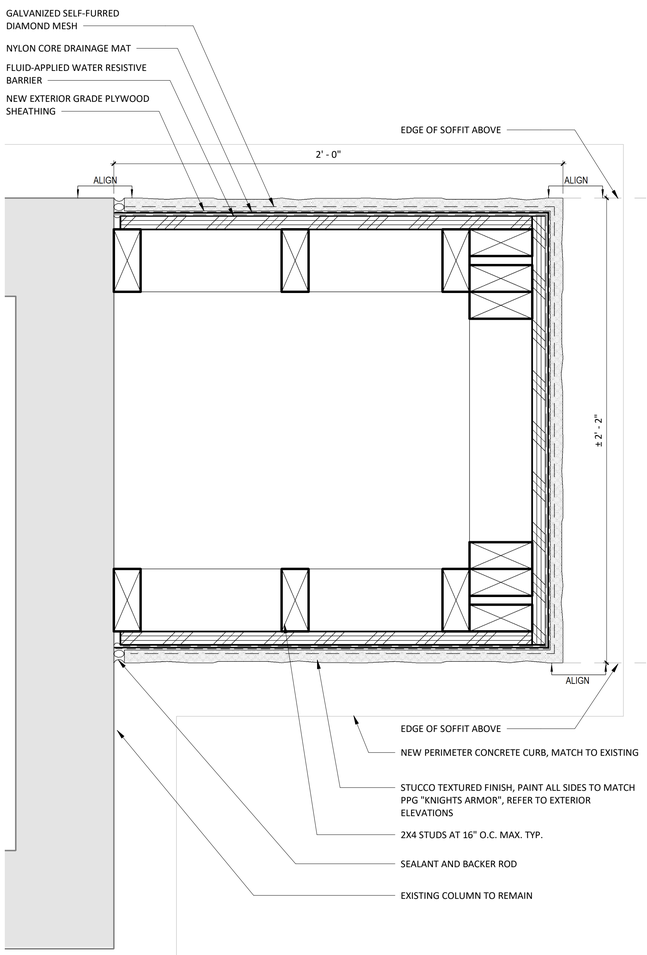

3 A406 **ENLARGED FAUX COLUMN**
3" = 1'-0"

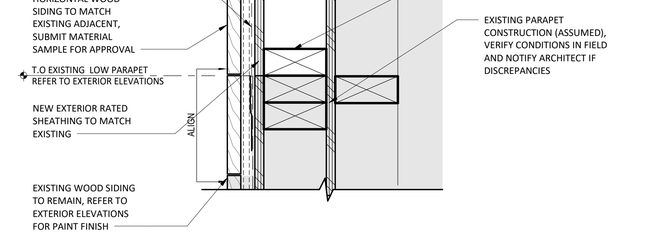

5 A406 **EXISTING WOOD PARAPET TRANSITION**
3" = 1'-0"

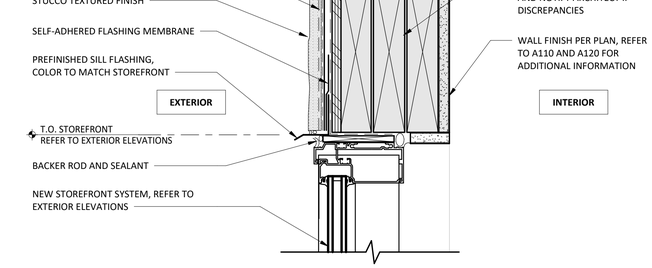

4 A406 **STOREFRONT HEAD SECTION DETAIL, TYP.**
3" = 1'-0"

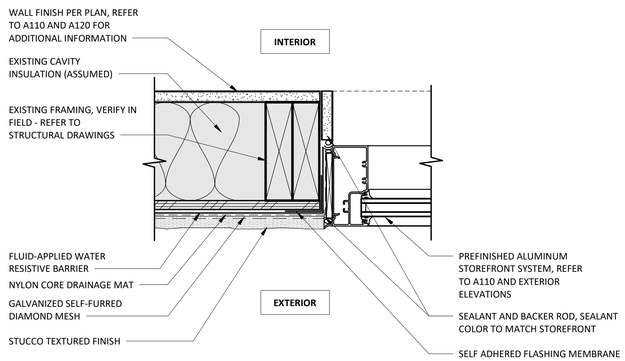

2 A406 **STOREFRONT JAMB SECTION DETAIL, TYP.**
3" = 1'-0"

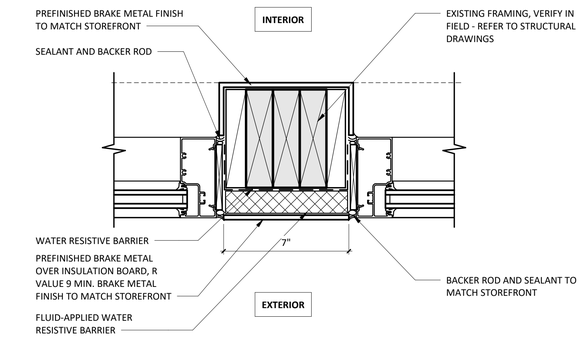

1 A406 **STOREFRONT COLUMN PLAN DETAIL**
3" = 1'-0"

INTERIOR ARCHITECTS
SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
EXTERIOR DETAILS

A406

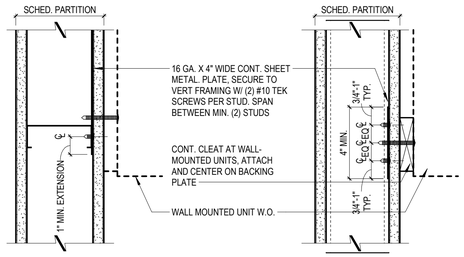

TYPICAL PARTITION BACKING FOR OBJECTS WITH MAXIMUM VERTICAL LOAD OF 25 LBS. PER LINEAR FOOT

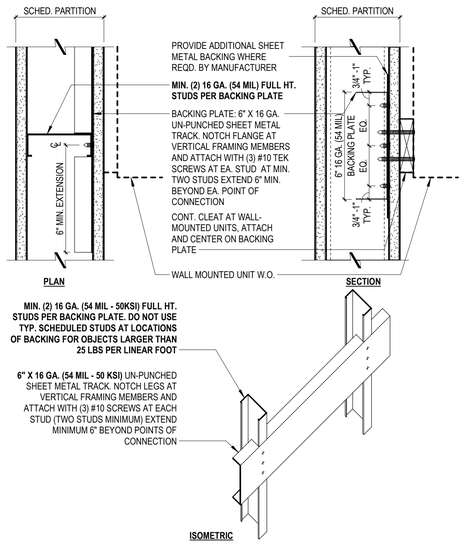

TYPICAL PARTITION BACKING FOR WALL-MOUNTED OBJECTS 100 LBS. PER LINEAR FOOT OR 250 LBS POINT LOAD

NOTE:
1. COORDINATE BACKING PLATE LOCATION WITH ACCESSORY MANUFACTURER'S MOUNTING INSTRUCTIONS.
2. COORDINATE FULL HT. STUD GAUGE FOR ALL LOCATIONS BETWEEN 25 LBS AND 100 LBS PER LINEAR FOOT.
3. SEE STRUCTURAL DRAWINGS FOR PARTITION BLOCKING AND FRAMING FOR HEAVIER LOADS.
4. PROVIDE PARTITION BACKING AT ITEMS SUCH AS SHELVING, MILLWORK, WALL-MOUNTED RESTROOM FIXTURES, HANDRAILS, GRAB BARS, SIGNAGE, TOILET ACCESSORIES, ETC. AS REQUIRED FOR PROPER ATTACHMENT AND AS REQUIRED BY THE CONTRACTOR.

1 A501 TYPICAL IN-WALL BACKING FOR WALL MOUNTED UNITS

3" = 1'-0"

WALL TYPES

1. G.C. SHALL PROVIDE SOLID BLKG. IN WALLS AS NEEDED
2. REFER TO ARCHITECTURAL FLOOR PLAN FOR ALL STUD SIZES
3. REFER TO A120 FOR ALL WALL FINISHES

NOTE: ALL CONCEALED WOOD TO BE FRT RATED



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP, OR AT OFFICE WALLS, EXTEND STUDS AND SHEATHING TO DECK ON EXPOSED SIDE(S) OF WALL
FIRE BLOCKING
5/8" PLYWOOD EACH SIDE
METAL STUDS @ 16" O.C.
5/8" CEMENTITIOUS BACKER BD. EACH SIDE TO 1'-4" AFF

W1 INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP, OR AT OFFICE WALLS, EXTEND STUDS AND SHEATHING TO DECK ON EXPOSED SIDE(S) OF WALL
KITCHEN SIDE
5/8" PLYWOOD
METAL STUDS @ 16" O.C.
5/8" CEMENTITIOUS BACKER BD. TO 1'-4" AFF

W1a INTERIOR PARTITION



5/8" PLYWOOD
EXTERIOR WALL
5/8" CEMENTITIOUS BACKER BD. TO 1'-4" AFF

W1ax INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP EXTEND STUDS AND SHEATHING TO DECK ON EXPOSED SIDE(S) OF WALL
5/8" DENSSHIELD EACH SIDE
METAL STUDS @ 16" O.C.
5/8" CEMENTITIOUS BACKER EACH SIDE TO 16" AFF

W3 INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP EXTEND STUDS AND SHEATHING TO DECK ON EXPOSED SIDE(S) OF WALL
5/8" DENSSHIELD
KITCHEN SIDE
METAL STUDS @ 16" O.C.
5/8" CEMENTITIOUS BACKER TO 16" AFF

W3a INTERIOR PARTITION



WHERE NO CLG. IS INDICATED ON RCP EXTEND STUDS AND SHEATHING TO 1/2" BELOW TOP OF BOX, REFER TO A210 FOR BOX HEIGHT
5/8" PLYWOOD
METAL STUDS @ 16" O.C.

W4 INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK (ONLY WHERE CLG IS INDICATED)
WHERE NO CLG. IS INDICATED ON RCP EXTEND STUDS AND SHEATHING TO 1/2" BELOW TOP OF BOX HEIGHT, REFER TO A701
5/8" PLYWOOD
METAL STUDS @ 16" O.C.

W4a INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP EXTEND STUDS AND SHEATHING TO DECK ON EXPOSED SIDE(S) OF WALL
PROVIDE SOUND ATTENUATION BATT INSUL. WHERE REQ'D, SEE FLOOR PLAN FOR LOCATIONS
METAL STUDS @ 16" O.C.
5/8" GYP. BD. BOTH SIDES. (PROVIDE MOISTURE RESISTANT GYP. BD. ON RESTROOM SIDE.)

W5 INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP EXTEND STUDS AND SHEATHING TO DECK ON EXPOSED SIDE OF WALL
PROVIDE SOUND ATTENUATION BATT INSUL. WHERE REQ'D, SEE FLOOR PLAN FOR LOCATIONS
METAL STUDS @ 16" O.C.
5/8" GYP. BD. (PROVIDE MOISTURE RESISTANT GYP. BD. ON RESTROOM SIDE.)

W5a INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP OR AT OFFICE WALLS EXTEND STUDS AND SHEATHING TO DECK ON EXPOSED SIDE(S) OF WALL
5/8" DENSSHIELD
5/8" PLYWOOD
KITCHEN SIDE W/ FRP
METAL STUDS @ 16" O.C.
5/8" CEMENTITIOUS BACKER EACH SIDE TO 16" AFF

W7 INTERIOR PARTITION



MTL. STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP EXTEND STUDS AND SHEATHING TO DECK ON EXPOSED SIDE(S) OF WALL
5/8" GYP. BD.
5/8" PLYWOOD TO 50 1/2" AFF
METAL STUDS @ 16" O.C.

W10a INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP OR AT OFFICE WALLS EXTEND STUDS AND SHEATHING TO DECK ON EXPOSED SIDE(S) OF WALL
5/8" GYP. BD.
PROVIDE SOUND ATTENUATION BATT INSUL. WHERE REQ'D, SEE FLOOR PLAN FOR LOCATIONS
METAL STUDS @ 16" O.C.
5/8" GYP. BD. (PROVIDE MOISTURE RESISTANT GYP. BD. ON RESTROOM SIDE.)

W14 INTERIOR PARTITION



EXISTING GYP. BD.
24 GAUGE GALVANIZED METAL TO 50 1/2" AFF
EXISTING WALL

W16ax INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP EXTEND STUDS AND SHEATHING TO DECK ON EXPOSED SIDE(S) OF WALL
5/8" DENSSHIELD
5/8" PLYWOOD
5/8" CEMENTITIOUS BACKER TO 16" AFF
METAL STUDS @ 16" O.C.

W22a INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
24 GAUGE GALVANIZED METAL, EXTEND PAST EDGE OF HOOD 18" IN ALL DIRECTIONS
METAL STUDS @ 16" O.C.
5/8" CEMENTITIOUS BACKER

W26a INTERIOR PARTITION



METAL STUD ANGLE BRACING @ 48" O.C. - EXTEND TO DECK
WHERE NO CLG. IS INDICATED ON RCP EXTEND STUDS AND SHEATHING TO 1/2" BELOW TOP OF BOX, REFER TO A210 FOR BOX HEIGHT
5/8" PLYWOOD
5/8" DENSSHIELD
METAL STUDS @ 16" O.C.
5/8" CEMENTITIOUS BACKER TO 16" AFF

W28 INTERIOR PARTITION

GENERAL NOTES

REFER TO FINISH SCHEDULE AND CERAMIC TILE WALL FINISHES KEY PLAN ON SHEET A120 FOR WALL FINISHES, REFER TO FLOOR PLAN ON A110 FOR METAL STUD SIZE.

STUD SCHEDULE & NOTES

SIZE/TYPE	MAX HEIGHT @ 5PSF, L/240	MAX HEIGHT @ 5PSF, L/360
362S125-18	UP TO 12'-0"	
362S137-33	UP TO 16'-0"	UP TO 12'-0"
600S137-33	UP TO 22'-0"	UP TO 16'-0"
600S162-43	UP TO 26'-0"	UP TO 22'-0"

1. ALL HEIGHTS REFER TO NON-COMPOSITE, FULLY BRACED PARTITIONS
2. ALL HEIGHTS BASED ON 16" O.C. SPACING U.O.N
3. BOTTOM TRACK TO BE SAME GAUGE AS STUD.
4. TOP TRACK TO BE ONE GAUGE HIGHER.

PARTITION NOTES

1. ALL METAL STUDS TO CONFORM TO LOCAL BUILDING CODES.
2. ALL STUD WALLS AND PARTITIONS REQUIRE GYP. BOARD ON BOTH SIDES FOR THE FULL HEIGHT OF THE STUDS UNLESS SPECIFICALLY DETAILED OTHERWISE.
3. ALL SUSPENDED WALLS SHALL HAVE GYP. BOARD WHICH EXTENDS 4" ABOVE THE SUSPENDED CEILING UNLESS SHOWN AND/OR NOTED OTHERWISE BY THE ARCHITECT.
4. ALL NONSTRUCTURAL INTERIOR WALLS MUST WITHSTAND A MIN. OF 5 PSF LATERAL LOAD AND AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION AND THE APPLICABLE BUILDING CODE.
5. ALL STUD WALLS AND PARTITIONS SHALL HAVE CONTINUOUS LINES OF BRIDGING SPACED AT 4'-0" MAXIMUM ON CENTER. THE BRIDGING SHALL BE SECURELY FASTENED TO THE STUDS WITH EITHER SCREWS OR WELDS. REFER TO DETAILS THIS SHEET.
6. ALL STUDS SHALL BE "CEE" STUDS WITH FLANGE STIFFENERS.
7. THE MATERIALS AND DETAILS SHOWN ARE FOR TYPICAL INSTALLATIONS. WHERE THE STUD MANUFACTURER'S RECOMMENDATIONS OR LOCAL ORDINANCES ARE MORE RESTRICTIVE, THEY SHALL APPLY.
8. FASTENERS SHALL BE AS REQUIRED BY THE LOCAL AUTHORITY HAVING JURISDICTION AND THE APPLICABLE BUILDING CODE.
9. TYPICAL DEFLECTION REQUIREMENTS: (L=LENGTH IN INCHES).

- L/360 FOR BRITTLE MATERIALS SUCH AS TILE AND STONE
- L/240 FOR ALL OTHER INTERIOR MATERIALS.

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

ARCHITECTURAL WALL TYPES

A501

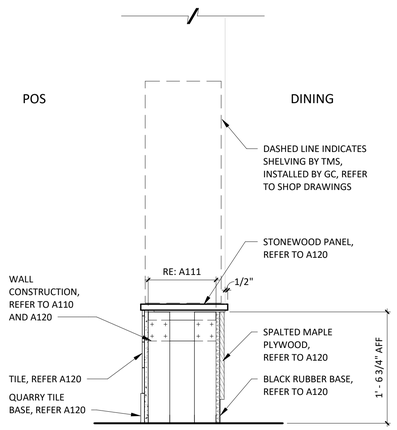

2 A502 **MOPUS SECTION - PASS THRU**
1" = 1'-0"

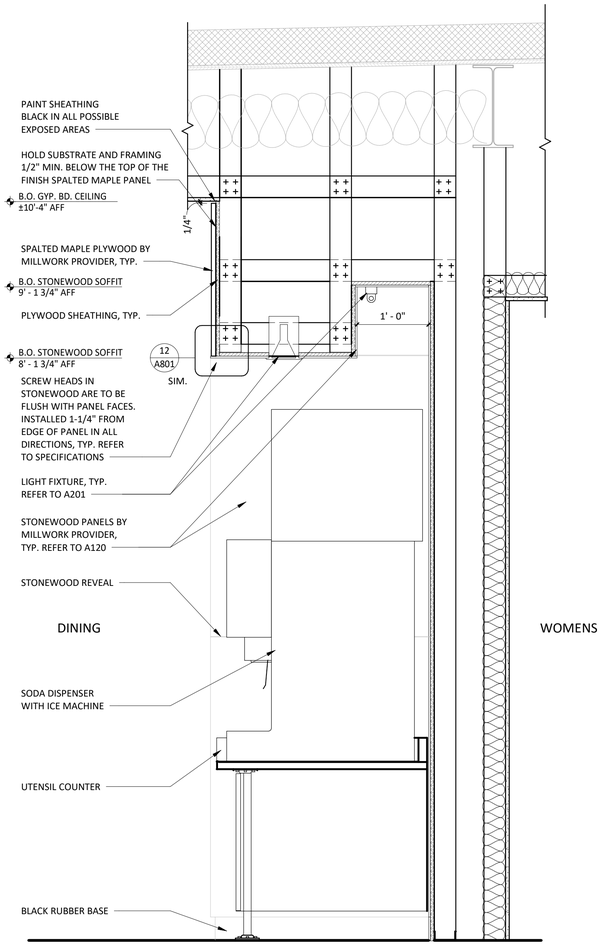

1 A502 **UTENSIL SECTION**
1" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
INTERIOR SECTIONS

A502

DOOR SCHEDULE

TAG	ROOM	DOOR STATUS *	FRAME STATUS	DOOR DESCRIPTION	DOOR WIDTH	DOOR HEIGHT	DOOR THICKNESS	DOOR TYPE	DOOR FINISH	FRAME TYPE	FRAME MATERIAL	STILE	HARDWARE SET	HARDWARE STATUS	REMARKS
1	MAIN ENTRY	NEW		DOUBLE STOREFRONT (WIDE STILE, WOOD PULL/PUSH)	6' - 4"	7' - 0"	0' - 1 3/4"	A	SEE A301	STOREFRONT	ALUM	MEDIUM STILE	1	NEW	1,2,4,5
2	DINING	NEW		SINGLE STOREFRONT (WIDE STILE, NON-OFFSET, PANIC)	3' - 0"	7' - 0"	0' - 1 3/4"	A	SEE A301	STOREFRONT	ALUM	MEDIUM STILE	2A	NEW	1,3,4,5
6	KITCHEN	NEW		HM REAR KITCHEN (STANDARD)	3' - 6"	7' - 0"	0' - 1 3/4"	D	D1/D2 (SEE A120)	1	H.M.	-	3	NEW	1,4,6
43	OFFICE	NEW		MANAGER'S OFFICE	3' - 0"	7' - 0"	0' - 1 3/4"	C	D1 (SEE A120)	1	H.M.	-	4	NEW	
44	WOMENS	NEW		MENS RESTROOM (SINGLE-OCCUPANT, STANDARD)	3' - 0"	7' - 0"	0' - 1 3/4"	D	D1 (SEE A120)	1	H.M.	-	6	NEW	
45	MENS	NEW		WOMENS RESTROOM (SINGLE-OCCUPANT, STANDARD)	3' - 0"	7' - 0"	0' - 1 3/4"	D	D1 (SEE A120)	1	H.M.	-	5	NEW	

REMARK NOTES

1. DOORS WITH REMARK #1 TO BE KEYED THE SAME
2. EXIT INDICATOR ARRIVES WITH SIGNS STATING "THIS DOOR TO REMAIN UNLOCKED DURING BUSINESS HOURS" AND "THIS DOOR TO REMAIN UNLOCKED WHEN THE BUILDING IS OCCUPIED". VERIFY REQUIRED SIGN WORDING WITH LOCAL JURISDICTION PRIOR TO INSTALLATION. ONE SIGN IS TO BE PLACED IN A VISIBLE LOCATION ABOVE THE DOORS.
3. THERE IS TO BE NO EXTERIOR HOLE OR CYLINDER
4. USE NON-SHRINK STRUCTURAL GROUT BED UNDER THRESHOLD
5. BLACK DOOR SWEEP TO BE USED WITH CHARCOAL, BLACK OR BRONZE STOREFRONT. LIGHT GRAY DOOR SWEEP TO BE USED WITH CLEAR ANODIZED ALUMINUM STOREFRONT
6. REAR KITCHEN DOOR TO BE PAINTED 'BLACK' ON INTERIOR AND 'KNIGHT'S ARMOR' ON EXTERIOR U.N.O.

TYPICAL EXTERIOR DOOR TYPES

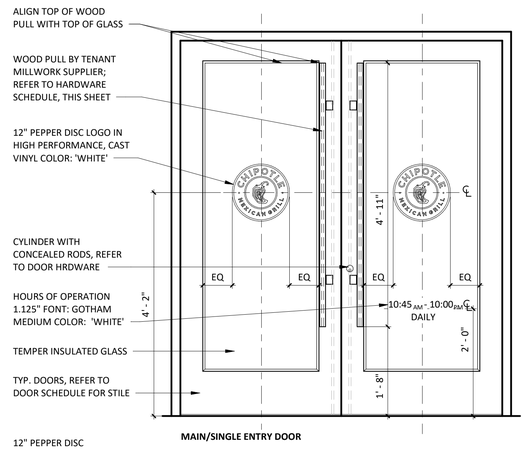

MAIN/SINGLE ENTRY DOOR

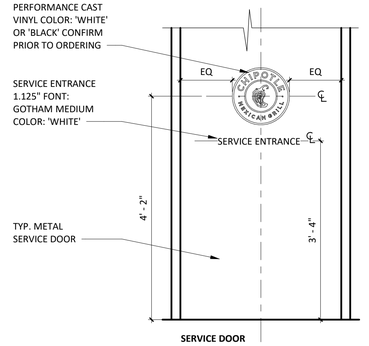

SERVICE DOOR

HARDWARE SETS

SET 1 - MAIN ENTRY - PAIR - WOOD PULL/PUSH

(2)	HINGE	HAGER, MODEL 780-224HD-83"-CLR
(2)	MORTISE CYLINDER	SCHLAGE, MODEL 80-103, BRUSHED CHROME; C.O. CYLINDER AT 34" MIN. FROM BOTTOM OF DOOR
(2)	TEMP CORE	SCHLAGE, MODEL 80-035 INTERCHANGEABLE CORE, (BRUSHED CHROME)
(2)	PUSH HARDWARE	1 1/2" DIAMETER WOOD PUSH, VARIES HIGH - PROVIDED BY MILLWORK SUPPLIER. MOUNT TOP OF PULLS FLUSH WITH TOP OF GLAZING STOP IN DOOR, RE: SHOP DRAWINGS
(2)	PULL HARDWARE	1 1/2" DIAMETER WOOD PULL, VARIES HIGH - PROVIDED BY MILLWORK SUPPLIER. MOUNT TOP OF PULLS FLUSH WITH TOP OF GLAZING STOP IN DOOR, RE: SHOP DRAWINGS
(1)	DEADBOLT	ADAMS RITE, MODEL MS1850S-310-628
(1)	EXIT INDICATOR	ADAMS RITE, MODEL 4089-00-130
(1)	HEADER BOLT	ADAMS RITE, MODEL 4016-30-01
(1)	THRESHOLD BOLT	ADAMS RITE, MODEL 4015-18-1B
(2)	CLOSER	DORMA, MODEL 8916-AF89P-689 (TOP JAMB), (ALUMINUM)
(2)	DOOR STOP	IVES, MODEL FS18S (ALUMINUM)
(2)	OVERHEAD STOP	GLYNN-JOHNSON, MODEL 454S-SP28 (ALUMINUM)
(2)	CLOSER BACK PLATE	DORMA, MODEL BP89, ALUMINUM
(1)	THRESHOLD	REESE, MODEL S424A-72 (SIZE 72")
(2)	SMOKE SEAL	REESE, MODEL 797B-21
(2)	DOOR SWEEP	PEMKO, MODEL SFSC-200-36 (36" DOOR),OWNER FURNISHED

SET 2A - ENTRY - SINGLE - NON-OFFSET - PANIC HARDWARE

(1)	HINGE	HAGER, MODEL 780-224HD-83"-CLR
(1)	PUSH HARDWARE	ADAMS RITE, MODEL 8801-36-628 (ALUMINUM FINISH, 36" DOOR); C.O. EXIT DEVICE AT 38" FROM BOTTOM OF DOOR
(1)	PULL HARDWARE	HAGER, MODEL 4G US32D (8" CTC), CENTER ON DOOR STILE
(1)	CLOSER	DORMA, MODEL 8916-AF89P-689 (TOP JAMB), (ALUMINUM)
(1)	CLOSER BACK PLATE	DORMA, MODEL BP89, ALUMINUM
(1)	OVERHEAD STOP	GLYNN-JOHNSON, MODEL 454S-US32D (ALUMINUM)
(1)	THRESHOLD	REESE, MODEL S424A-36 (SIZE 36")
(1)	SMOKE SEAL	REESE, MODEL 797B-21
(1)	DOOR SWEEP	PEMKO, MODEL SFSC-200-36 (36" DOOR), OWNER FURNISHED
(1)	DOOR STOP	IVES, MODEL FS18S (ALUMINUM)

SET 3 - REAR EXIT - SINGLE

(1)	HINGE	HAGER, MODEL 780-224HD-83"-CLR
(1)	PUSH HARDWARE	FALCON, MODEL 25-R-EO-4'-US28 (SIZE 42")
(1)	PULL HARDWARE	FALCON, MODEL 510L-DANE-LHR-US26D, ALUMINUM (EXTERIOR SIDE)
(1)	RIM CYLINDER	GLS, MODEL RCIC-7-LZ-626
(1)	TEMP CORE	SCHLAGE, MODEL 80-035 INTERCHANGEABLE CORE (FINISH: BRUSHED CHROME)
(1)	CLOSER	DORMA, MODEL 8916-AF89P-689 (TOP JAMB), ALUMINUM
(1)	CLOSER BACK PLATE	DORMA, MODEL BP89, ALUMINUM
(1)	THRESHOLD	REESE, MODEL S239A-42, (SIZE 42")
(1)	WEATHERSTRIP	REESE, MODEL DS75C-4070
(1)	DOOR SWEEP	PEMKO, MODEL SFSC-200-42 (42" DOOR) (BLACK) OWNER FURNISHED
(1)	DOOR VIEWER	IVES, MODEL U698B26D, C.O. VIEWER AT 60" FROM BOTTOM OF DOOR
(1)	DOOR SILENCERS	IVES, MODEL SR64
(1)	DOOR BUZZER	TRINE, MODEL 66B
(1)	KICKPLATE	HIAWATHA, MODEL KP834-US32D

SET 4 - MANAGER'S OFFICE

(3)	HINGE	STANLEY, MODEL FBB179-4.5-US26 (06-8438)
(1)	LOCKSET	SCHLAGE, MODEL L9453L-06A-626
(1)	TEMP CORE	SCHLAGE, MODEL 80-035 INTERCHANGEABLE CORE (FINISH: BRUSHED CHROME)
(1)	KICKPLATE	HIAWATHA, MODEL KP834-32D
(1)	DOOR STOP	DON-JO, MODEL 1407-630, STAINLESS STEEL
(3)	DOOR SILENCERS	IVES, MODEL SR64
(1)	SECURITY WINDOW	AIR LOUVERS, MODEL VSL1212TEMPPAK SLIMLINE 12" X 12" X 1/4" LITE KIT (10" X 10" GLASS VISIBLE)

SET 5 - UNISEX 1 RESTROOM - SINGLE OCCUPANT - STANDARD

(3)	HINGE	STANLEY, MODEL FBB179-4.5-US26 (06-8438)
(1)	CLOSER	FALCON, MODEL: SC61xRW/PAxALU
(1)	LOCKSET	SCHLAGE, MODEL AL40S-NEP-626
(1)	DOOR STOP	DON-JO, 1407-630
(3)	DOOR SILENCERS	IVES, MODEL SR64
(2)	KICKPLATE	HIAWATHA, MODEL KP834-32D
(1)	COAT HOOK	MILLS, MODEL FT6519, SUPPLIED BY WASHROOM ACCESSORIES VENDOR, MOUNT T.O. HOOK AT 47 1/2" AFF

SET 6 - UNISEX 2 RESTROOM - SINGLE OCCUPANT - STANDARD

(3)	HINGE	STANLEY, MODEL FBB179-4.5-US26 (06-8438)
(1)	CLOSER	FALCON, MODEL: SC61xRW/PAxALU
(1)	LOCKSET	SCHLAGE, MODEL AL40S-NEP-626
(1)	DOOR STOP	DON-JO, 1407-630
(3)	DOOR SILENCERS	IVES, MODEL SR64
(2)	KICKPLATE	HIAWATHA, MODEL KP834-32D
(1)	COAT HOOK	MILLS, MODEL FT6519, SUPPLIED BY WASHROOM ACCESSORIES VENDOR, MOUNT T.O. HOOK AT 47 1/2" AFF

DOOR NOTES

1. ALL EGRESS DOORS SHALL BE READILY OPENABLE FROM THE EGRESS SIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT.
2. LATCHES, HANDLES, PANIC BARS AND ALL DOOR HARDWARE WILL COMPLY WITH SECTION 7.2 OF NFPA 101 PER THE SPECIFICATIONS.
3. THE MANAGER HAS A KEY TO UNLOCK RESTROOM DOORS, FROM THE OUTSIDE IN CASE OF AN EMERGENCY.
4. ALL DOORS TO REMAIN UNLOCKED DURING BUSINESS HOURS.
5. SEE THIS SHEET FOR EXTERIOR DOOR SIGNAGE INFO.
6. MAXIMUM EFFORT TO OPERATE EXTERIOR OR INTERIOR DOORS WITH CLOSERS SHALL NOT EXCEED 5 POUNDS. THIS MAY BE INCREASED TO 15 POUNDS FOR FIRE-RATED DOORS.
7. ALL FRAMES, DOORS AND HARDWARE TO BE FURNISHED BY TENANT HARDWARE SUPPLIER AND INSTALLED BY TENANT G.C. CALL ANDY SNYDER WITH TWIN CITY HARDWARE AT 763-762-4860 (EMAIL: ASNYDER@TCHCO.COM) TO ARRANGE DELIVERY. STOREFRONT DOORS ARE TO BE PROVIDED BY G.C., STOREFRONT HARDWARE PROVIDED BY TENANT HARDWARE SUPPLIER.
8. THE BOTTOM 10 INCHES OF ALL DOORS SHALL HAVE A SMOOTH, UNINTERRUPTED SURFACE TO ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST WITHOUT CREATING A TRAP OR HAZARDOUS CONDITION.
9. ALL SUPPORT SIGNAGE PROVIDED BY TENANT'S SUPPORT SIGNAGE SUPPLIER.
10. ALL SUPPORT SIGNAGE INSTALLED BY G.C.
11. ALL HARDWARE SHALL MATCH STOREFRONT, VERIFY WITH ARCHITECT PRIOR TO ORDERING

DOOR FRAMES



NOTE: GC TO VERIFY THE WALL THICKNESS PRIOR TO ORDERING DOOR FRAMES.

CUSTOM WOOD PULL

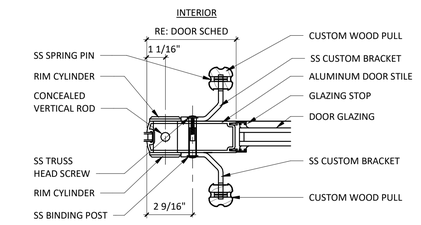

DOOR TYPES

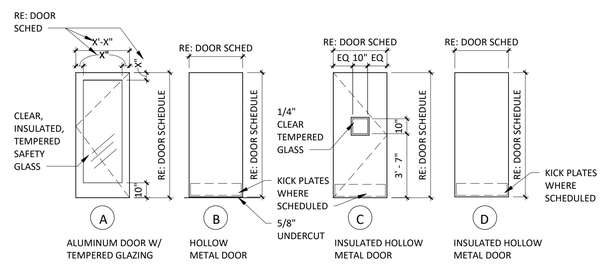

DOOR CLOSER

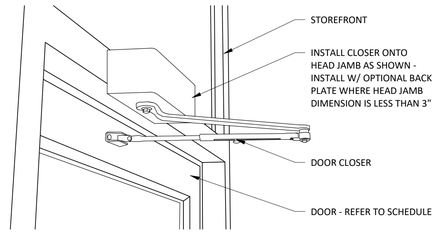

TOP JAMB MOUNT INSTALLATION. (NOTE THAT BACKPLATE IS MISSING IN THIS INSTALLATION BECAUSE HEAD JAMB IS OF ADEQUATE HEIGHT TO RECEIVE ALL MOUNTING SCREWS WITHOUT IT.) WHEN IN DOUBT ABOUT THE HEAD JAMB DIMENSION OR STABILITY, ORDER THE BACKPLATE.

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
DOOR & HARDWARE SCHEDULE

A601

STOREFRONT DETAILS

GENERAL NOTE:
REFER TO SHEET A406 FOR OPENING FLASHING AND WATERPROOFING DETAILS

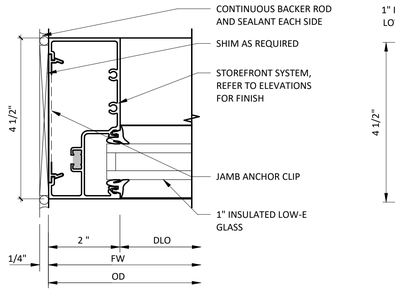

9 A602 **STOREFRONT JAMB DETAIL**
6" = 1'-0"

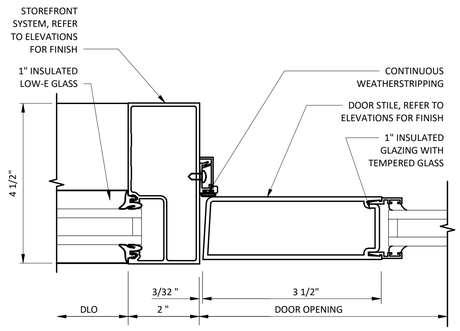

8 A602 **STOREFRONT DOOR JAMB DETAIL**
6" = 1'-0"

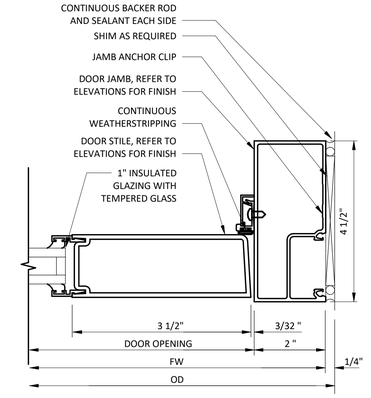

7 A602 **STOREFRONT DOOR JAMB DETAIL**
6" = 1'-0"

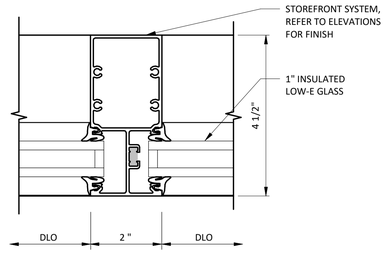

6 A602 **STOREFRONT MULLION DETAIL**
6" = 1'-0"

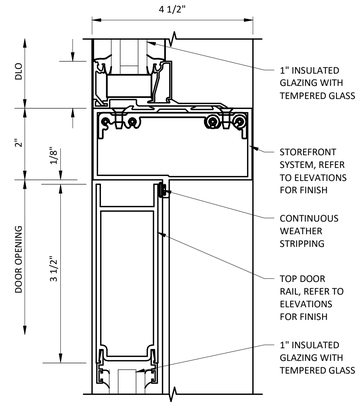

5 A602 **STOREFRONT TRANSOM BAR DETAIL**
6" = 1'-0"

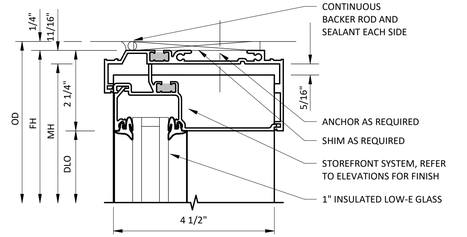

4 A602 **STOREFRONT HEAD DETAIL**
6" = 1'-0"

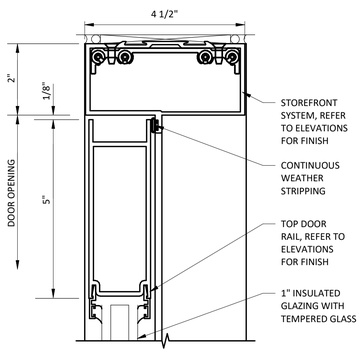

3 A602 **STOREFRONT TRANSOM BAR DETAIL**
6" = 1'-0"

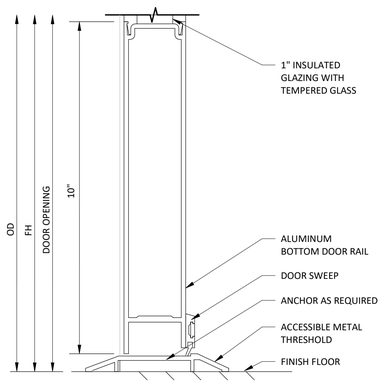

2 A602 **STOREFRONT THRESHOLD DETAIL**
6" = 1'-0"

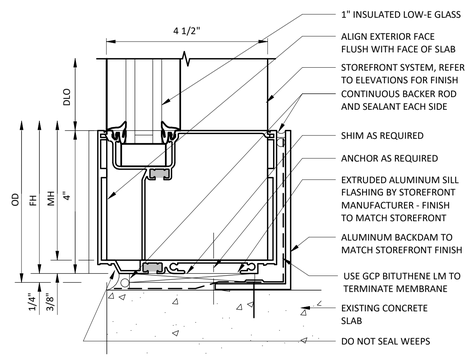

1 A602 **STOREFRONT SILL DETAIL**
6" = 1'-0"

GENERAL NOTES

1. ALL WINDOW AND DOOR GLAZING IS TO BE CLEAR / INSULATED UNLESS NOTED OTHERWISE.
2. WINDOW AND DOOR GLAZING TO BE TEMPERED AT LOCATIONS INDICATED WITH "*".
3. NEW STOREFRONT FRAMING SYSTEM TO BE SUPPLIED BY G.C. G.C. TO VERIFY FRAMING OPENING SIZES AND MATERIALS WITH ARCHITECT AND/OR CHIPOTLE CONSTRUCTION MANAGER PRIOR TO FABRICATION.
4. STOREFRONT GLAZING DESIGN IS BASED ON KAWNEER PREFINISHED ALUMINUM STOREFRONT WITH 1" INSULATED GLAZING, REFER TO SPECIFICATIONS.
5. STOREFRONT SYSTEM IS 2" x 4 1/2" NOMINAL DIMENSION; FRONT SET, U.N.O.
6. NOT USED

STOREFRONT TYPES

NOTE: ALL VIEWS FROM THE EXTERIOR

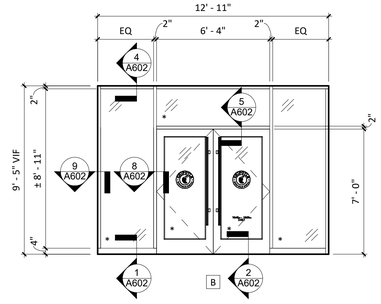

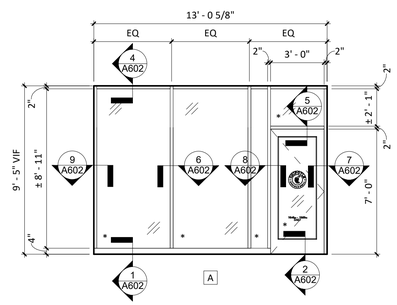

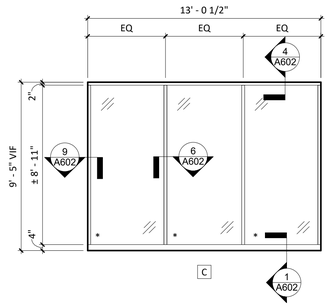

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
STOREFRONT DETAILS

A602

ELEVATION LEGEND

DENOTES WOOD BLOCKING IN WALL BEHIND WALL MOUNTED OBJECT U.N.O.

INT ELEV GENERAL NOTES

1	REFER TO SHEET A131 AND A132 FOR EQUIPMENT LIST AND FURNITURE SCHEDULE.
2	REFER TO A120 FOR FINISH SCHEDULE.
3	REFER TO A201 AND ELECTRICAL DRAWINGS FOR LIGHT FIXTURE SCHEDULE.



9 A701 **INT ELEV - DINING**
1/4" = 1'-0"

8 A701 **INT ELEV - DINING**
1/4" = 1'-0"

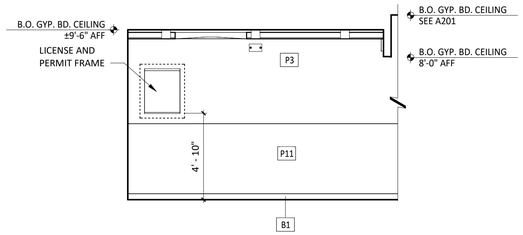

7 A701 **INT ELEV - DINING**
1/4" = 1'-0"



6 A701 **INT ELEV - DINING**
1/4" = 1'-0"

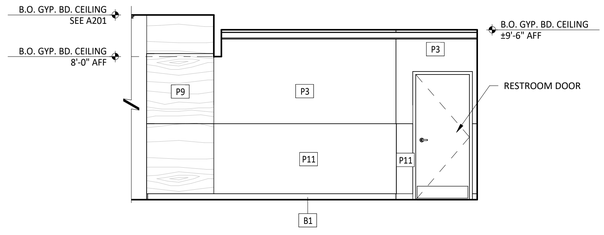

5 A701 **INT ELEV - DINING**
1/4" = 1'-0"

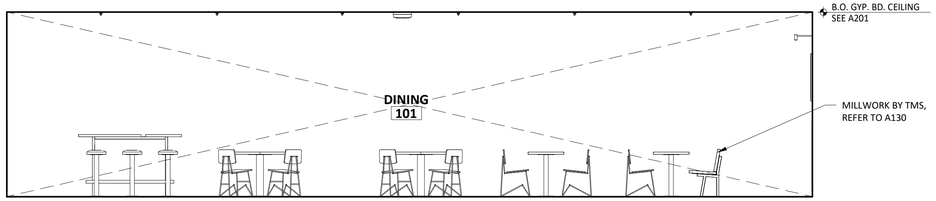

4 A701 **INT ELEV - DINING**
1/4" = 1'-0"

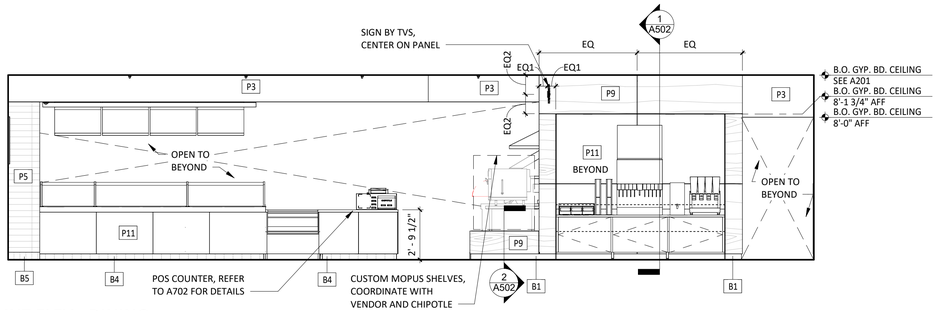

3 A701 **INT ELEV - DINING**
1/4" = 1'-0"

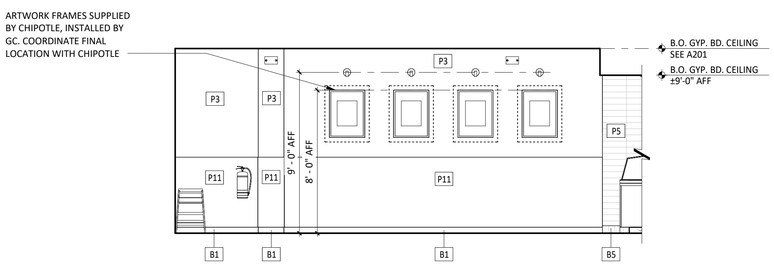

2 A701 **INT ELEV - DINING**
1/4" = 1'-0"

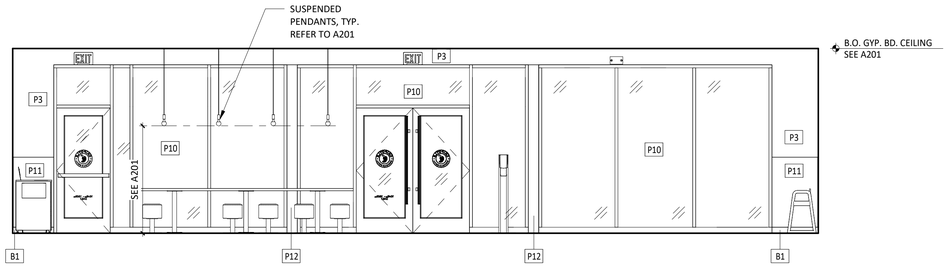

1 A701 **INT ELEV - DINING**
1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ELEVATIONS - INTERIOR
DINING

A701

ELEVATION LEGEND

DENOTES WOOD BLOCKING IN WALL BEHIND WALL MOUNTED OBJECT U.N.O.

GENERAL NOTES

1. REFER TO SHEET A131 FOR EQUIPMENT LIST AND FURNITURE SCHEDULE.
2. PROVIDE FULL HEIGHT BLOCKING IN WALL FOR ALL SHELVING, TYP.
3. REFER TO A120 FOR FINISH SCHEDULE
4. REFER TO A201 AND ELECTRICAL DRAWINGS FOR LIGHT FIXTURE SCHEDULE.

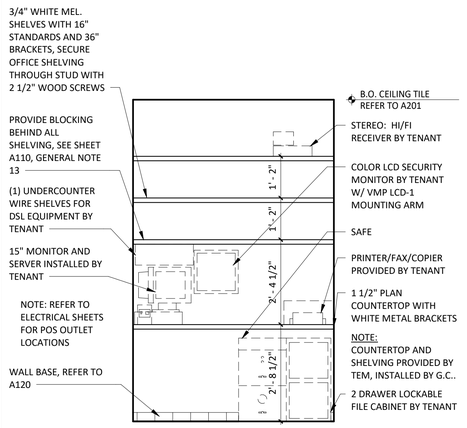

17 A702 **TYP ELEV - OFFICE SHELVING**
1/2" = 1'-0"

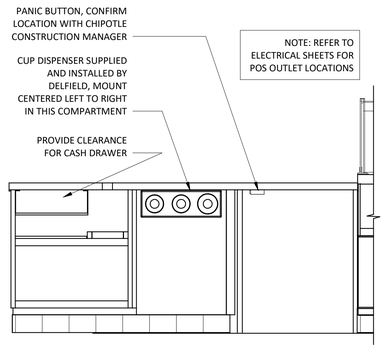

16 A702 **TYP. ELEV - POS**
3/4" = 1'-0"

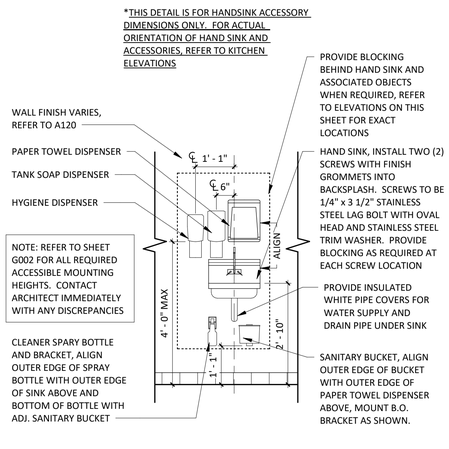

15 A702 **TYP ELEV - HAND SINK**
1/2" = 1'-0"

NOTE:
LOCKER OPERABLE PARTS SHALL BE OPERABLE WITH ONE HAND AND SHALL NOT REQUIRE TIGHT GRASPING, PINCHING, OR TWISTING. FORCE REQUIRED TO ACTIVATE OPERABLE PARTS SHALL BE 5 POUNDS MAX.

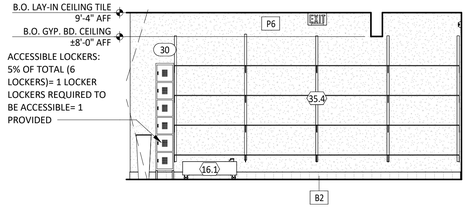

18 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

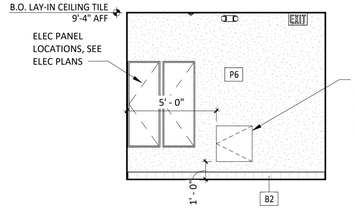

14 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

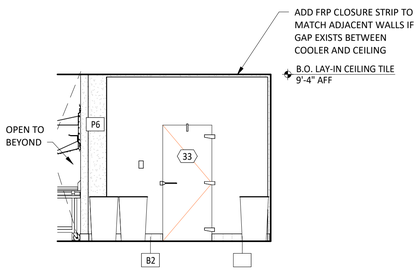

13 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

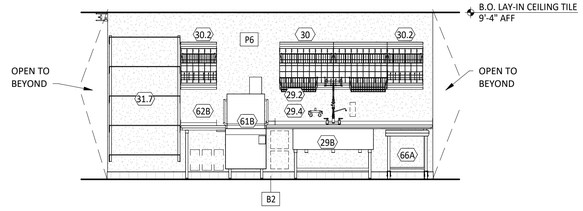

12 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"



11 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

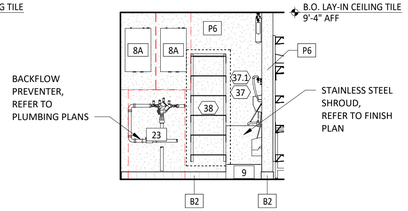

10 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

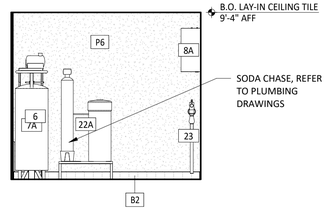

9 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

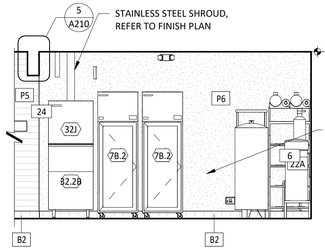

8 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

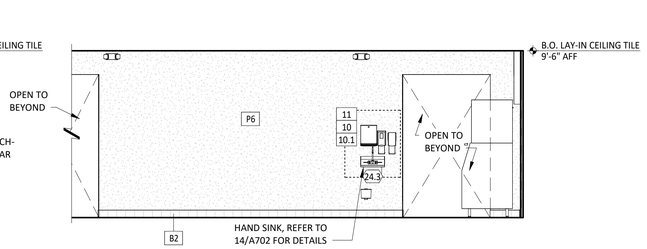

7 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

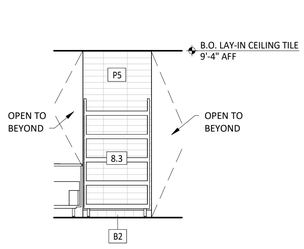

6 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"



5 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

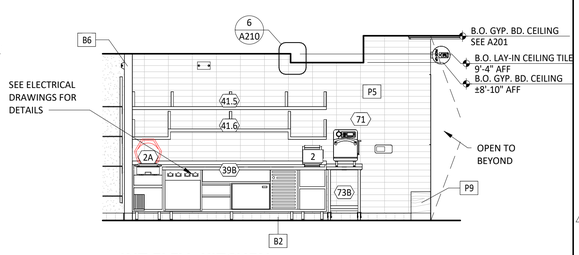

4 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

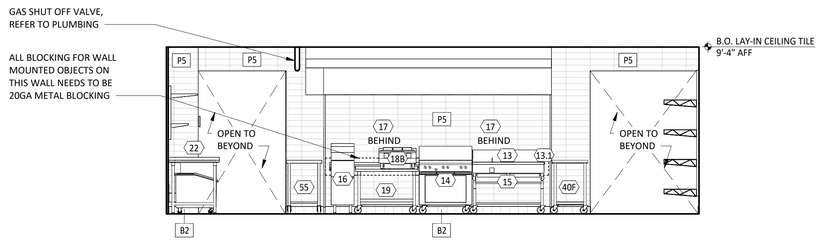

3 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

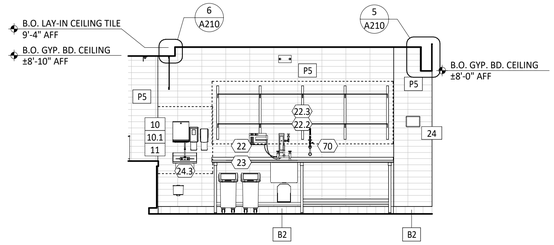

2 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

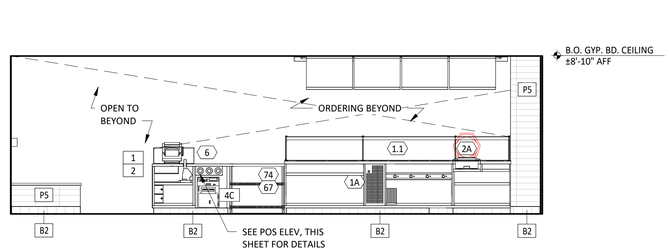

1 A702 **INT ELEV -KITCHEN**
1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
ELEVATIONS - INTERIOR KITCHEN

A702

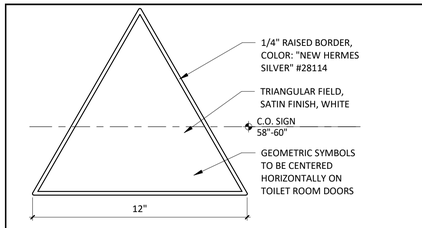

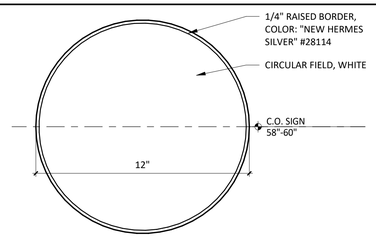

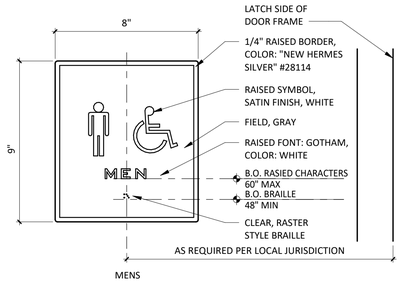

MENS

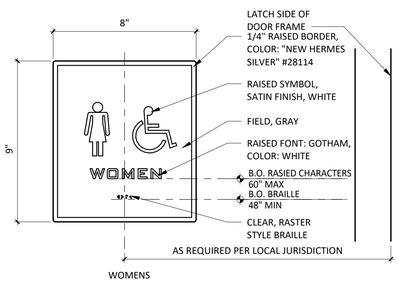

WOMENS

ELEVATION LEGEND

DENOTES WOOD BLOCKING IN WALL BEHIND WALL MOUNTED OBJECT U.N.O.

GENERAL NOTES

1. ALL DIMENSIONS ARE TO FACE OF STUD UNLESS OTHERWISE NOTES.
2. REFER TO A802 FOR TILE NOTES.
3. ALL ACCESSORIES SHALL BE AS MANUFACTURED BY AMERICAN SPECIALTIES INC OR TENANT APPROVED EQUIVALENT UNLESS DESIGNATED OTHERWISE. PROVIDE SOLID FRT WOOD BLOCKING AS NECESSARY FOR INSTALLATION PER MANUFACTURER'S RECOMMENDATIONS. SEE SHEET G002 FOR ACCESSIBILITY GUIDELINES & MOUNTING HEIGHT REQUIREMENTS.
4. REFER TO A120 FOR FINISH SCHEDULE.
5. REFER TO A201 AND ELECTRICAL DRAWINGS FOR LIGHT FIXTURE SCHEDULE.
6. FOR ADDITIONAL ASSISTANCE WITH RESTROOM ACCESSORIES PLEASE REACH OUT TO CMG@HJCINC.COM

RESTROOM ACCESSORY SCHEDULE

ITEM #	DESCRIPTION	MANUF	MODEL	QTY	PROVIDED BY	INSTALLED BY	UTILITY WATER	UTILITY SEWER	MOUNTING HEIGHT	REMARKS
1A	Grab Bar - 36in	ASI	3501-36	2	WA	GC			36" AFF to Top of Grasping Surface	Provide Plywood Blocking to Mount to Wall
1C	Grab Bar - 18in	ASI	3501-18	2	WA	GC			40" AFF to Centerline of Bottom Return	Provide Plywood Blocking to Mount to Wall
1D	Grab Bar - 48in	ASI	3501-48	2	WA	GC			36" AFF to Top of Grasping Surface	Provide Plywood Blocking to Mount to Wall
3A	Vandal Proof Mirror	Sentry Mirror	20" x 30" Vandal Proof Mirror	2	TS	GC			Bottom Edge of Reflecting Surface at 40" AFF	Provide Plywood Blocking to Mount to Wall
5	Touch-Free Soap Dispenser	Purell	CS8	2	WA	GC			47 1/2" AFF to Top of Unit	
7	Recessed Toilet Paper Dispenser	ASI	0031	2	WA	GC			29" AFF to Top of Unit	Recess Mounted in Wall - Rough Opening: 6 1/4"W X 12 1/4"H X 3 3/8"D Top of Rough Opening: 29 1/4" AFF
7.1	Surface Mounted Toilet Paper Dispenser	ASI	OO30	1	WA	GC			29" AFF to Top of Unit	If Wall Mounted, Provide Plywood Blocking to Mount to Wall
8	Utility Shelf	ASI	0692	2	WA	GC			46" AFF To Top Of Shelf	Provide Toggle Bolts to Mount to Wall
9	Recessed Convertible Paper Towel Dispenser and Waste Receptacle, Recess Mounted in Wall	Bobrick	B-3944	2	WA	GC			Bottom of Unit at Top of Base, Bottom of Dispenser to be at 40" AFF, Recess Mounting In Wall	Rough Opening: 16"W x 54 3/4"H x 4" D. Provide Plywood Blocking to Mount to Wall
12	Napkin Disposal - Recessed	ASI	0473	2	WA	GC			Top of Rough Opening @ 29" AFF	Recess Mounted in Wall - Rough Opening: 11 1/4"W X 15 3/4"H X 4"D
13	Toilet Partition	Hadrian	Color: 621 Slate	3	WA	GC			Floor Anchored w/ Overhead Brace	Run Partition From 1'-0" AFF to 7'-0" AFF
13.1	Urinal Partition	Hadrian	Color: 621 Slate	1	WA	GC			Wall Anchored	Run Partition From 1'-0" AFF to 5'-10" AFF
14	Restroom Hand Sink	SEE MEP	SEE MEP	2	GC	GC		•	Mount Bottom of Front Edge Of The Sink At Exactly 29" AFF	
14.1	Restroom Hand Sink Faucet	Chicago Faucets	3520-E2805ABCP	2	KES	GC	•			To Be Furnished With .5 GPM Aerator Installed. Thermostatic mixing valve is also included.
15	Hand Sanitizer Dispenser	Purell	ES8	2	WA	GC			Align T.O. Unit With T.O. Soap Dispenser	
16A	Surface Mounted Horizontal Baby Changing Station	Koala Care	KB300-05	2	WA	GC			Mount Bottom of Open Changing Bed at Exactly 27" AFF	GC to Provide adequate blocking to support the baby changing equipment. Blocking shall be installed in such a manner to not damage or compromise the rated assembly of the existing wall construction

TYP WASHROOM SIGN

16 / A710 — 3" = 1'-0"

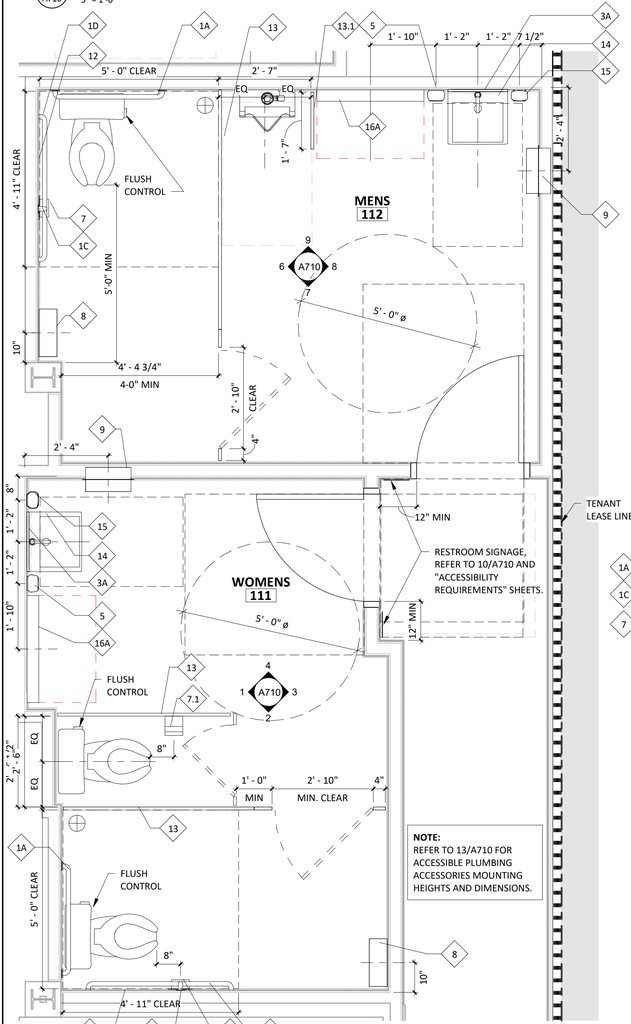

5 / A710 — ENLARGED PLAN — 1/2" = 1'-0"

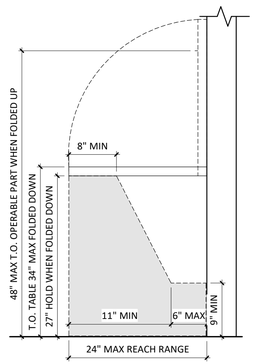

14 / A710 — TYP. BABY CHANGING STATION — 1" = 1'-0"

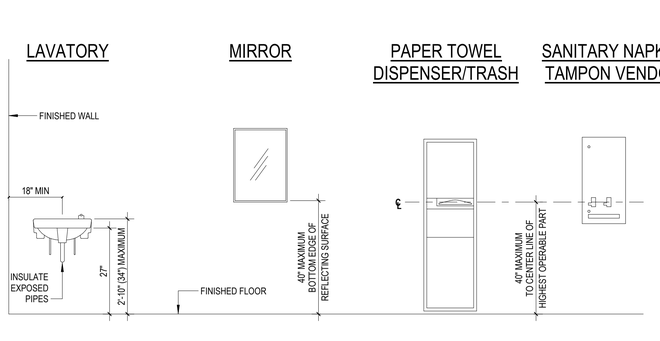

13 / A710 — TYP. RESTROOM MOUNTING DETAILS — 1/2" = 1'-0"

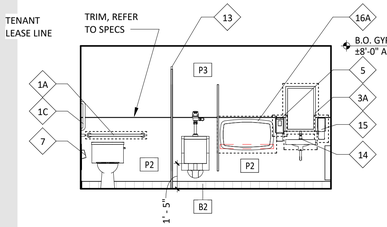

9 / A710 — WOMENS RESTROOM - ELEV — 1/4" = 1'-0"

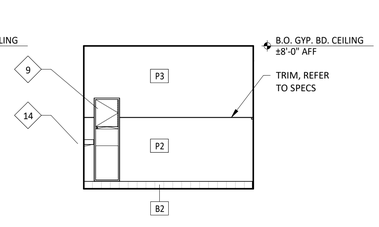

8 / A710 — WOMENS RESTROOM - ELEV — 1/4" = 1'-0"

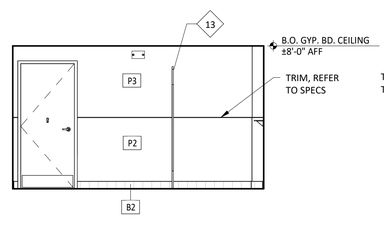

7 / A710 — WOMENS RESTROOM - ELEV — 1/4" = 1'-0"

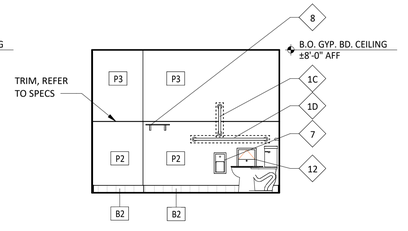

6 / A710 — WOMENS RESTROOM - ELEV — 1/4" = 1'-0"

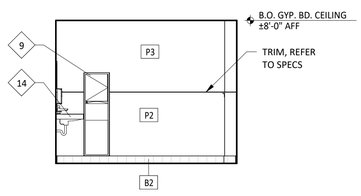

4 / A710 — MENS RESTROOM - ELEV — 1/4" = 1'-0"

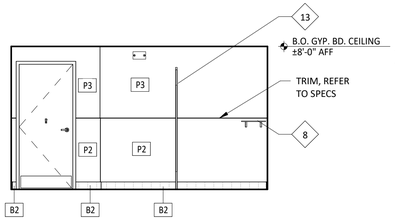

3 / A710 — MENS RESTROOM - ELEV — 1/4" = 1'-0"

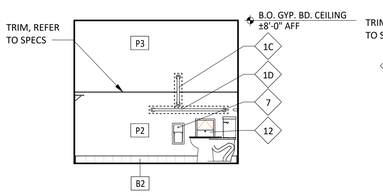

2 / A710 — MENS RESTROOM - ELEV — 1/4" = 1'-0"

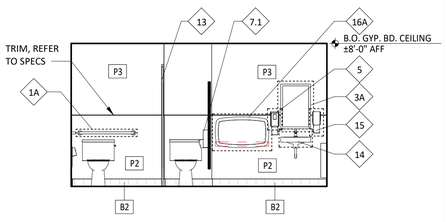

1 / A710 — MENS RESTROOM - ELEV — 1/4" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/28/25 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
RESTROOM DETAILS

A710

NOTE: ALL CONCEALED WOOD TO BE FRT RATED



20 A801 **PLAN - RR FRP INSIDE CORNER**
6" = 1'-0"

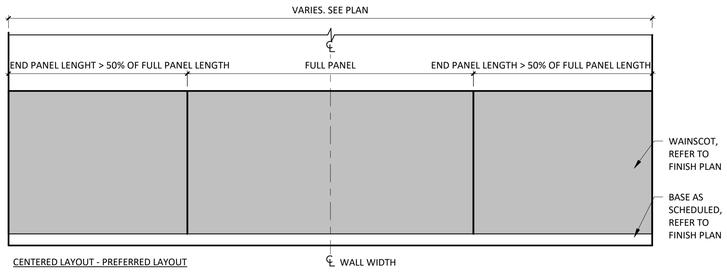

16 A801 **WAINSCOT LAYOUT**
1/2" = 1'-0"

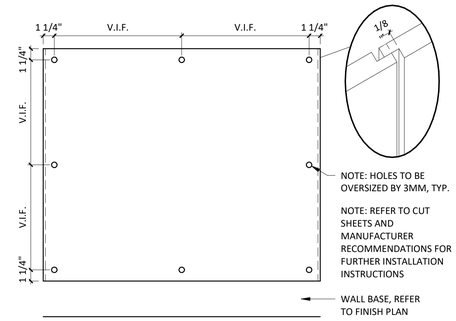

19 A801 **WAINSCOT DETAILS**
1 1/2" = 1'-0"

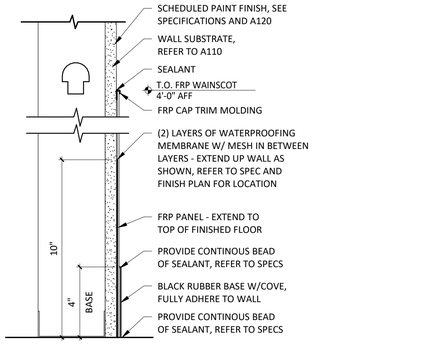

18 A801 **SECTION @ RR FRP WAINSCOT W/RUBBER BASE**
3" = 1'-0"

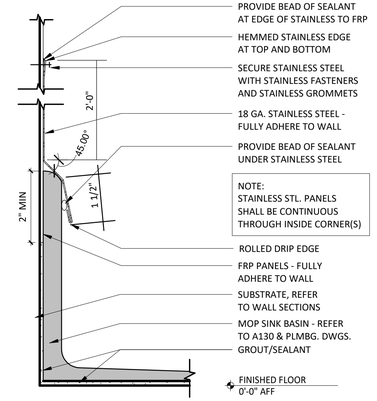

17 A801 **SECTION @ MOP SINK**
6" = 1'-0"

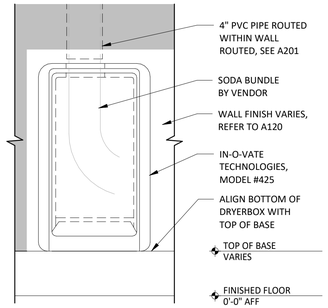

15 A801 **ELEVATION - SODA CHASE**
N.T.S.



14 A801 **PLAN - FRP CLOSER @ COOLER**
3" = 1'-0"



13 A801 **PLAN - WOOD TO WOOD CORNER**
3" = 1'-0"

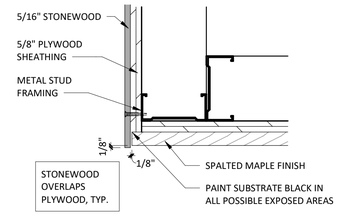

12 A801 **PLAN - WOOD TO STONEWOOD CORNER**
3" = 1'-0"



11 A801 **PLAN - STONEWOOD TO TILE CORNER**
3" = 1'-0"

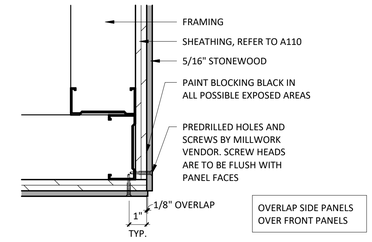

9 A801 **PLAN - STONEWOOD CORNER @ WAINSCOT**
3" = 1'-0"

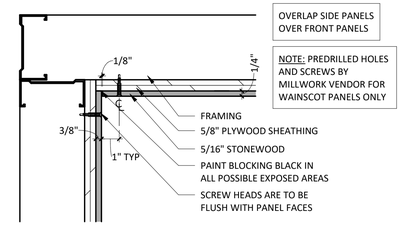

8 A801 **PLAN - STONEWOOD INSIDE CORNER**
3" = 1'-0"

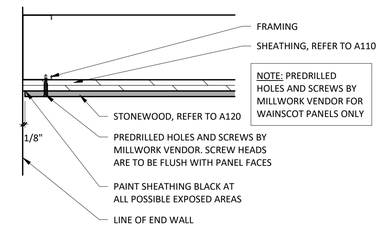

7 A801 **PLAN - STONEWOOD END CONDITION**
3" = 1'-0"

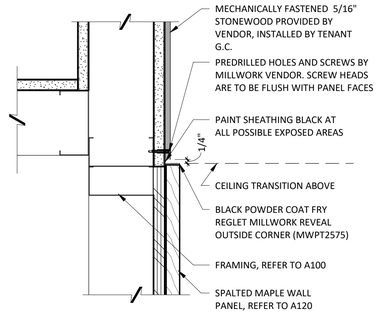

6 A801 **PLAN - WOOD END CONDITION**
3" = 1'-0"

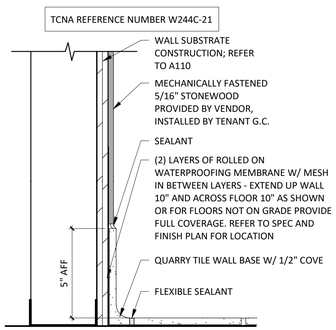

5 A801 **SECTION @ STONEWOOD**
3" = 1'-0"

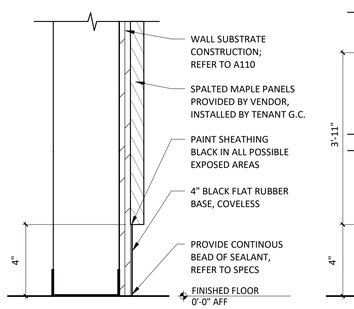

4 A801 **SECTION @ SPALTED MAPLE**
3" = 1'-0"

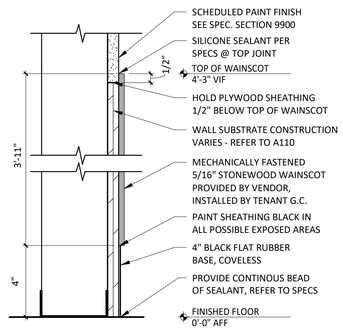

3 A801 **SECTION @ WAINSCOT**
3" = 1'-0"

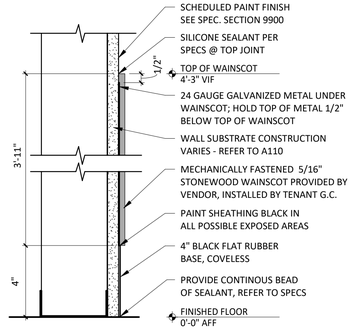

2 A801 **SECTION @ WAINSCOT**
3" = 1'-0"

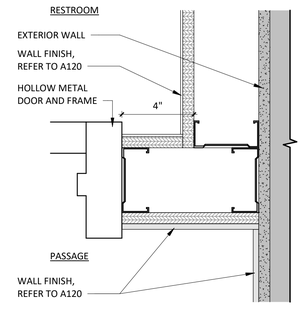

1 A801 **PLAN - DOOR JAMB**
3" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
FINISH DETAILS

A801

GENERAL NOTES

1.	TILE INSTALLER SHALL COORDINATE WITH GENERAL CONTRACTOR AND PROVIDE LAYOUT OF ALL WALL TILE PRIOR TO INSTALLATION. GENERAL CONTRACTOR SHALL PREPARE WALLS AS TO NOT HAVE ANY CUT TILES IN EITHER DIRECTION (HORIZONTALLY OR VERTICALLY) ON ANY WALLS. LAYOUT SHALL BE APPROVED BY CHIPOTLE CM PRIOR TO INSTALLATION. CONTRACTOR SHALL CONTACT ARCHITECT OF ANY DISCREPANCIES IN DIMENSIONS FOR DIRECTION PRIOR TO INSTALLATION. FAILURE TO ADHERE TO THESE REQUIREMENTS RESULTING IN ANY REMEDIATION REQUIRED TO MEET DESIGN INTENT WILL BE AT CONTRACTOR'S COST.
2.	IF REQUIRED TO CUT TILES, CONTRACTOR TO MEASURE OVERALL WALL WIDTH AND DETERMINE WHICH SOLUTION WILL ALLOW FOR THE GREATER THAN 25% TILE WIDTH AT WALL TERMINATIONS.
3.	UNLESS OTHERWISE NOTED, ALL WALL TILES SHOULD BE CENTERED ON THE WIDTH OF THE WALL PER DETAIL 1 OR 2.
4.	THERE SHOULD NEVER BE ANY CUT TILES VERTICALLY BETWEEN THE BASE AND THE CEILING. REFER TO A120 AND A201.

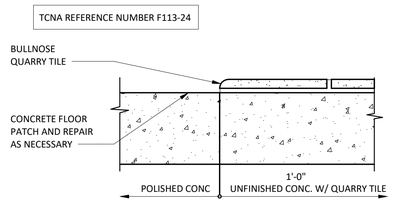

23 A802 **FLOOR TRANSITION @ READY TO DRINK**
3" = 1'-0"

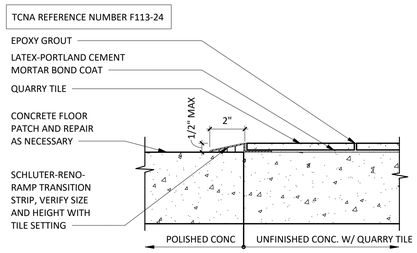

22 A802 **FLOOR TRANSITION W/ RAMP**
3" = 1'-0"

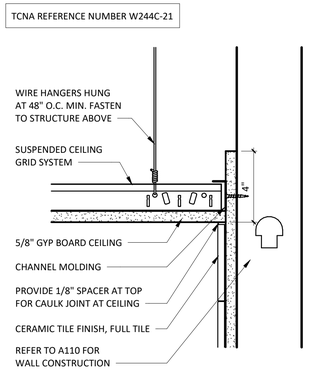

21 A802 **TILE DETAIL @ GYP BD CEILING**
3" = 1'-0"

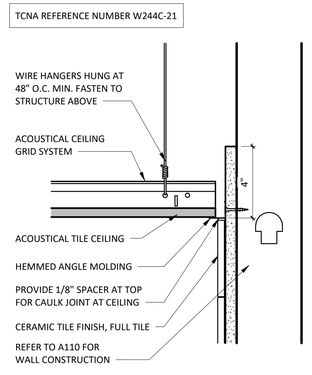

20 A802 **TILE DETAIL @ SUSPENDED CEILING**
3" = 1'-0"

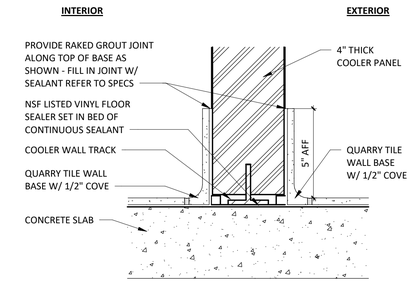

19 A802 **COOLER WALL @ QT**
3" = 1'-0"

TCNA REFERENCE NUMBER F113-24

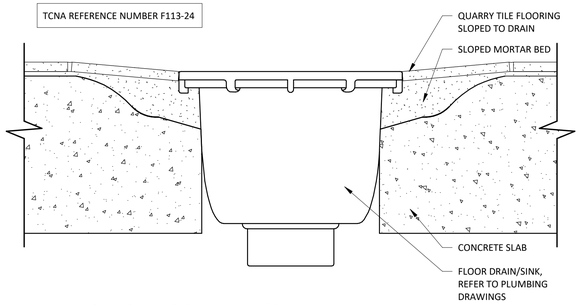

18 A802 **TYPICAL QT FLOOR DRAIN/SINK DETAIL**
3" = 1'-0"

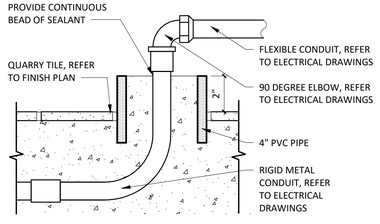

17 A802 **STUB SECTION DETAIL UNDER TABLES**
3" = 1'-0"

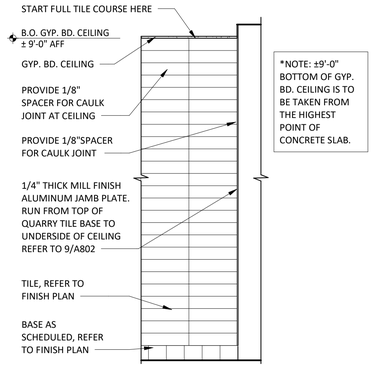

*NOTE: ±9'-0" BOTTOM OF GYP. BD. CEILING IS TO BE TAKEN FROM THE HIGHEST POINT OF CONCRETE SLAB.

16 A802 **KITCHEN WALL ENDCAP TILE LAYOUT**
1/2" = 1'-0"

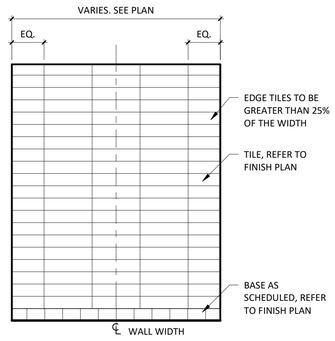

15 A802 **TILE CENTERED LAYOUT**
1/2" = 1'-0"

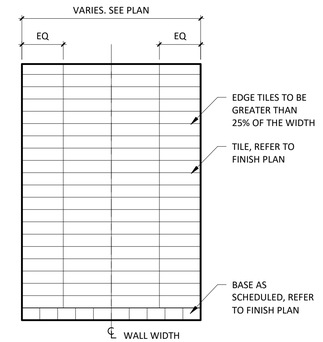

14 A802 **JOINT CENTERED LAYOUT**
1/2" = 1'-0"

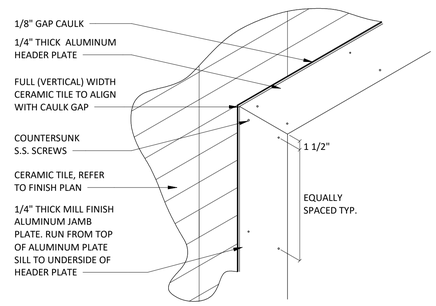

13 A802 **TILE DETAIL @ ALUMINUM PLATE HEADER**
1" = 1'-0"



12 A802 **ALUMINUM PLATE @ JAMB/HEAD/SILL**
3" = 1'-0"



11 A802 **TILE TO TILE OUTSIDE CORNER**
6" = 1'-0"



10 A802 **TILE TO FRP OUTSIDE CORNER**
6" = 1'-0"



9 A802 **TILE TO TILE INSIDE CORNER**
6" = 1'-0"

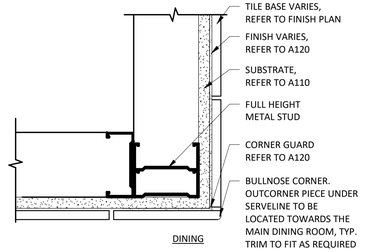

8 A802 **TILE BASE - OUTSIDE CORNER (DINING)**
3" = 1'-0"

TCNA REFERENCE NUMBER W244C-21

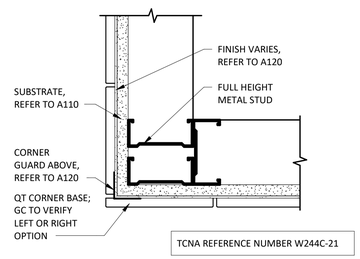

TCNA REFERENCE NUMBER W244C-21

7 A802 **QT BASE - OUTSIDE CORNER (KITCHEN)**
3" = 1'-0"



6 A802 **QT BASE - ENDCAP**
3" = 1'-0"

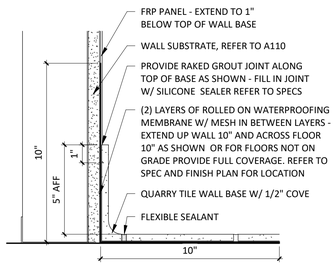

5 A802 **QT BASE @ FRP**
3" = 1'-0"

TCNA REFERENCE NUMBER W244C-21 AND F113-24

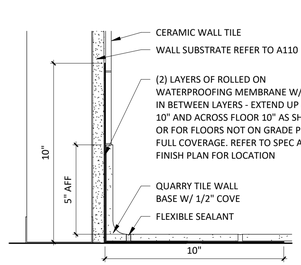

4 A802 **QT BASE @ CERAMIC TILE**
3" = 1'-0"

TCNA REFERENCE NUMBER W244C-21 AND F113-24



3 A802 **CERAMIC TILE BASE**
3" = 1'-0"

TCNA REFERENCE NUMBER W244C-21



2 A802 **QT @ CURB**
3" = 1'-0"

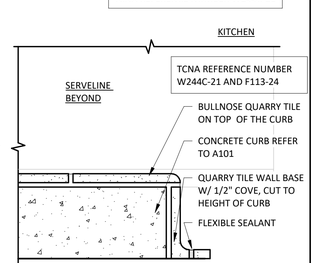

1 A802 **QT @ CURB**
3" = 1'-0"

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
TILE DETAILS

A802

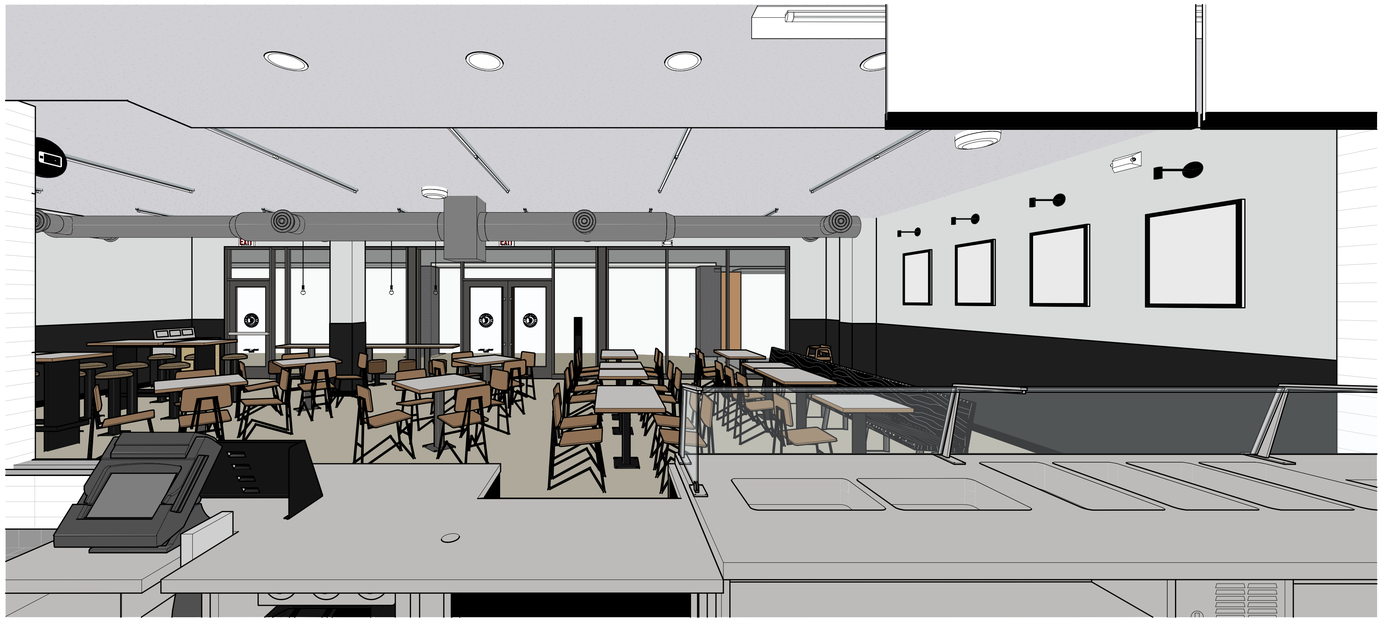

4 A900 **INTERIOR PERSPECTIVE**

3 A900 **INTERIOR PERSPECTIVE**

2 A900 **INTERIOR PERSPECTIVE**

1 A900 **INTERIOR PERSPECTIVE**

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC.

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:

INTERIOR PERSPECTIVES

A900

INTERIOR ARCHITECTS

SAN FRANCISCO
500 SANSOME STREET, 8TH FLOOR
SAN FRANCISCO, CA 94111
TEL 415-434-3305

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

2 A901 **EXTERIOR PERSPECTIVE**

1 A901 **EXTERIOR PERSPECTIVE**

Issue Record:

02/28/25	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
EXTERIOR PERSPECTIVES

A901

GENERAL

A. USE THE STRUCTURAL DRAWINGS WITH THE ARCHITECTURAL, MECHANICAL, PLUMBING, ELECTRICAL, AND SHOP DRAWINGS.
B. CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL CONTRACT DOCUMENTS AND LATEST ADDENDA, AS WELL AS SUBMITTING TO ALL SUBCONTRACTORS AND SUPPLIERS PRIOR TO SUBMITTING SHOP DRAWINGS.
C. DO NOT SCALE DRAWINGS OR AUTO-DIMENSION ELECTRONIC FILES. NOTIFY ARCHITECT AND ENGINEER OF ANY DISCREPANCIES IN WRITING PRIOR TO FABRICATION OR CONSTRUCTION.
D. COMPARE ALL CONTRACT DRAWINGS AND REPORT ANY DISCREPANCIES BETWEEN DISCIPLINES, AND WITHIN A GIVEN DISCIPLINE, TO THE ARCHITECT AND ENGINEER PRIOR TO FABRICATION AND ERECTION.
E. IF A CONFLICT EXISTS AMONG THE STRUCTURAL DRAWINGS OR GENERAL NOTES, THE STRICTEST REQUIREMENTS, AS INDICATED BY THE ENGINEER, GOVERNS.
F. COORDINATE ALL ELEVATIONS AND DIMENSIONS, INCLUDING BUT NOT LIMITED TO, OPENINGS IN WALLS AND IN ROOF AND FLOOR SYSTEMS, WITH THE ARCHITECTURAL, PLUMBING, ELECTRICAL, AND MECHANICAL PLANS.
G. VERIFY ALL DIMENSIONS, ELEVATIONS, AND ANY OTHER EXISTING CONDITIONS. NOTIFY THE ARCHITECT AND ENGINEER OF DISCREPANCIES BEFORE PROCEEDING WITH THE AFFECTED PART OF THE WORK. DURING THE CONSTRUCTION PROCESS, IT IS THE CONTRACTOR'S RESPONSIBILITY TO MAINTAIN THE INTEGRITY OF THE EXISTING STRUCTURE AND TO PROTECT FROM DAMAGE ANY PORTIONS THAT REMAIN. THE SHORING AND BRACING SHOWN (IF ANY) IS A PARTIAL AND SCHEMATIC REPRESENTATION. DETERMINE THE ERECTION PROCEDURE TO ENSURE THE STABILITY AND SAFETY OF THE BUILDING AND ITS COMPONENTS DURING CONSTRUCTION.
H. UNLESS NOTED OTHERWISE, DETAILS SHOWN ARE TYPICAL FOR ALL SIMILAR CONDITIONS.
I. THE CONTRACTOR IS SOLELY RESPONSIBLE FOR ALL CONSTRUCTION MEANS AND METHODS, AS WELL AS SAFETY PRECAUTIONS AND PROGRAMS.
J. BRITT, PETERS & ASSOCIATES, INC. IS NOT RESPONSIBLE FOR ACTS OR OMISSIONS OF THE CONTRACTOR, NOR FAILURE TO PERFORM WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
K. THE BUILDING OWNER IS RESPONSIBLE FOR PERIODIC MAINTENANCE TO ENSURE STRUCTURAL INTEGRITY. MAINTENANCE INCLUDES, BUT IS NOT LIMITED TO, STEEL/CONCRETE COATINGS, SEALANTS, CAULKED JOINTS, EXPANSION JOINTS, CONTROL JOINTS, SPALLS, AND CRACKS IN CONCRETE, AND CLEANING OF EXPOSED STRUCTURAL ELEMENTS.

DESIGN CRITERIA

A. STRUCTURAL DRAWINGS ARE BASED ON THE REQUIREMENTS OF THE 2021 INTERNATIONAL BUILDING CODE, THE 2022 CALIFORNIA BUILDING STANDARDS CODE, AND THE REFERENCED SECTIONS WITHIN.
B. DEAD LOADS:
   1. EXISTING ROOF SYSTEMS:
      a. WOOD (20 PSF TOTAL)
         1. STRUCTURE 6 PSF
         2. MEP 4 PSF
         3. INSULATION AND ROOFING 10 PSF
C. LIVE LOADS:
   1. LIVE LOADS ARE BASED ON THE MORE RESTRICTIVE OF THE UNIFORM LOAD OR THE CONCENTRATED LOAD LISTED ACTING OVER A 6.25 SQUARE FOOT AREA.

LIVE LOADS

CATEGORY	UNIFORM LOAD (PSF)	CONCENTRATED LOAD (LBS)
DINING ROOMS/RESTAURANTS	100	
KITCHEN	150	
ROOFS: ALL ROOF SURFACES SUBJECT TO WORKERS		300
ROOFS: ORDINARY ROOF	20	

D. DESIGN SNOW LOADS:
   1. GROUND SNOW LOAD: P_G 0 PSF
   2. FLAT ROOF SNOW LOAD: P_F 0 PSF
E. DESIGN WIND LOADS:
   1. BASIC WIND SPEED: V_{ULT} 92 MPH (3-SEC GUST)
   2. BASIC WIND SPEED: V_{ASD} 72 MPH (3-SEC GUST)
   3. RISK CATEGORY: II
   4. WIND EXPOSURE: C
   5. INTERNAL PRESSURE COEFF: GC_{Pi} ±0.18

Ultimate Design Wind Pressure (psf):

			Effective Wind Area (sq ft)					
Walls:			**10**	**20**	**50**	**100**	**200**	**500**
Interior	Zone 4	+	16.9	16.1	16.0	16.0	16.0	16.0
		-	-18.3	-17.5	-16.6	-16.0	-16.0	-16.0
Edge	Zone 5	+	16.9	16.1	16.0	16.0	16.0	16.0
		-	-22.5	-21.0	-19.0	-17.5	-16.0	-16.0
Roof:			**10**	**20**	**50**	**100**	**200**	**500**
Interior	Zone 1	+	16.0	16.0	16.0	16.0	16.0	16.0
		-	-29.4	-27.5	-24.9	-23.0	-21.0	-18.4
Interior	Zone 1'	+	16.0	16.0	16.0	16.0	16.0	16.0
		-	-16.9	-16.9	-16.9	-16.9	-16.0	-16.0
Edge	Zone 2	+	16.9	16.1	16.0	16.0	16.0	16.0
		-	-38.8	-36.3	-33.0	-30.5	-28.0	-24.7
Corner	Zone 3	+	16.9	16.1	16.0	16.0	16.0	16.0
		-	-38.8	-36.3	-33.0	-30.5	-28.0	-24.7

WIDTH OF ZONE, a = 11.6 FT

F. SEISMIC LOADS:
   1. RISK CATEGORY: II
   2. SEISMIC IMPORTANCE FACTOR: I_E 1.0
   3. SHORT PERIOD SPECTRAL RESPONSE ACCELERATION: S_S 1.50 g
   4. 1-SEC PERIOD SPECTRAL RESPONSE ACCELERATION: S_1 0.60 g
   5. SITE CLASS: D (ASSUMED)
   6. SHORT PERIOD DESIGN SPECTRAL RESPONSE ACCELERATION: S_{DS} 1.20 g
   7. 1-SEC PERIOD DESIGN SPECTRAL RESPONSE ACCELERATION: S_{D1} 0.68 g
   8. SEISMIC DESIGN CATEGORY: D
G. RAIN LOADS:
   1. RAIN INTENSITY (100-YEAR STORM): I 2.43 IN/HR
H. VERIFY ALL MECHANICAL EQUIPMENT WEIGHTS, LOCATIONS, AND ASSOCIATED OPENINGS WITH THE MECHANICAL CONTRACTOR, AND SUBMIT INFORMATION PRIOR TO FABRICATION OF THE SUPPORTING STRUCTURE. NOTIFY THE ENGINEER IF THE ACTUAL WEIGHT EXCEEDS THE WEIGHT INDICATED ON THE STRUCTURAL DRAWINGS.

DEMOLITION

A. REMOVE STRUCTURE FROM TOP DOWN. DO NOT ALLOW DEBRIS TO PILE UP OR FALL ON SLABS TO REMAIN. USE PLYWOOD AND/OR OTHER MEANS TO PROTECT SLABS FROM DAMAGE. REPAIR OR REPLACE DAMAGED SLABS, BEAMS, OR OTHER COMPONENTS AS DIRECTED BY OWNER.
B. THESE DRAWINGS ARE INTENDED TO DEFINE LIMITS OF STRUCTURAL ELEMENT REMOVAL, AND PRECAUTIONS FOR PREVENTING DAMAGE TO STRUCTURE TO REMAIN. REFER TO ARCHITECTURAL DEMOLITION DRAWINGS FOR ADDITIONAL INFORMATION.
C. FIELD VERIFY ALL EXISTING CONDITIONS. SUBMIT A WRITTEN REPORT IDENTIFYING DEVIATIONS FROM THE EXISTING STRUCTURE INDICATED.
D. INSTALL TEMPORARY SHORING AND BRACING OF STRUCTURE AS REQUIRED.
E. CONTACT THE ENGINEER FOR QUESTIONABLE LOCATIONS OR SPECIAL CONDITIONS NOT INDICATED.

FOUNDATIONS

A. AN ALLOWABLE BEARING CAPACITY OF 1,500 PSF HAS BEEN ASSUMED AND MUST BE CONFIRMED BY A QUALIFIED GEOTECHNICAL ENGINEER PRIOR TO PLACEMENT OF CONCRETE.
B. ALL SOILS WORK, INCLUDING BACKFILL OF UTILITY TRENCHES AND THE VERIFICATION OF BEARING CAPACITY MUST BE UNDER THE DIRECTION OF A QUALIFIED GEOTECHNICAL ENGINEER. PROXIMITY OF UTILITY TRENCHES TO BUILDING FOUNDATION SYSTEM MUST BE AS APPROVED BY THE GEOTECHNICAL ENGINEER TO ENSURE INTEGRITY OF THE BEARING SOILS.
C. BEAR FLOOR SLABS ON 4 INCH MINIMUM DRAINAGE COURSE (COMPACTED STONE) UNLESS NOTED OTHERWISE IN THE GEOTECHNICAL REPORT OR DRAWINGS. PLACE THE VAPOR RETARDER BETWEEN THE DRAINAGE COURSE AND THE SLAB. VAPOR RETARDER IS ASTM E 1745, CLASS B, 10 MIL UNLESS NOTED OTHERWISE. PLACE, PROTECT, AND REPAIR PER ASTM E 1643 AND MANUFACTURER'S INSTRUCTIONS.
D. DO NOT INSTALL FOUNDATION CONCRETE UNTIL ALL FOUNDATION WORK HAS BEEN COORDINATED WITH UNDERGROUND UTILITIES. NOTIFY THE ENGINEER OF ALL CONFLICTS BETWEEN FOUNDATIONS AND UTILITIES.
E. ALL FOUNDATIONS, OR PORTIONS THEREOF BELOW GRADE, MAY BE EARTH FORMED BY NEAT EXCAVATIONS. DO NOT PLACE FOUNDATIONS, SLABS, OR OTHER CONCRETE ON FROZEN SUBGRADE OR IN STANDING WATER.
F. DETERMINE THE EXTENT OF CONSTRUCTION DEWATERING REQUIRED FOR THE EXCAVATIONS. SUBMIT THE PROPOSED CONSTRUCTION DEWATERING PLAN TO THE GEOTECHNICAL ENGINEER FOR REVIEW PRIOR TO EXCAVATION.

CONCRETE

A. CONCRETE MUST CONFORM TO THE CONCRETE PROPERTIES SPECIFIED IN THE CONCRETE PROPERTIES TABLE.
B. CONCRETE MUST HAVE ALLOWABLE UNIT SHRINKAGE OF 0.045% AT 28 DAYS (SEE ASTM C157).
C. SLABS TO RECEIVE MOISTURE SENSITIVE FLOOR COVERINGS MUST HAVE MAXIMUM WATER/CEMENTITIOUS MATERIAL RATIO OF 0.45.
D. CONCRETE CONSTRUCTION MUST CONFORM TO THE CURRENT "ACI MANUAL OF CONCRETE PRACTICE".
E. ALL CONCRETE PLACEMENT SHALL ADHERE TO APPLICABLE SECTIONS OF ACI 305 AND ACI 306 FOR HOT WEATHER/COLD WEATHER CONCRETE PLACEMENT.
F. CONCRETE MATERIALS MUST CONFORM TO THE FOLLOWING SPECIFICATIONS:
   1. PORTLAND CEMENT: ASTM C150, TYPE I OR II
   2. AGGREGATE (NORMAL WEIGHT): ASTM C33
G. ALL REINFORCEMENT MUST CONFORM TO THE FOLLOWING SPECIFICATIONS:
   1. ALL REINFORCING, UNO: ASTM A615 GRADE 60
   2. WELDED WIRE REINFORCEMENT (WWR):
      a. SMOOTH WIRE: ASTM A1064 (65 KSI)
      b. DEFORMED WIRE: ASTM A1064 (70 KSI)
H. REINFORCEMENT DETAILING:
   1. DETAIL AND PLACE REINFORCEMENT IN ACCORDANCE WITH ACI 315.
   2. DEVELOPMENT AND SPLICE LENGTHS ARE IN TENSION UNLESS NOTED OTHERWISE.
   3. PLACE WWR 2" CLEAR FROM TOP OF SLAB UNESS NOTED OTHERWISE. LAP WWR ONE CROSSWIRE SPACING PLUS 2".
   4. INSTALL AND SECURE REINFORCEMENT TO PREVENT DISPLACEMENT DURING CONCRETE PLACEMENT. PROVIDE THE FOLLOWING CONCRETE COVER FOR REINFORCING, UNLESS SPECIFICALLY NOTED OTHERWISE:
      a. CAST AGAINST EARTH: 3"
      b. EXPOSED TO EARTH/WEATHER: #5 & SMALLER 1 1/2"
      c. SLABS, WALLS, JOISTS: #11 & SMALLER 3/4"
   5. INSTALL DOWELS TO MATCH REINFORCEMENT SIZE AND SPACING INDICATED, UNLESS NOTED OTHERWISE.
I. DO NOT USE HORIZONTAL CONSTRUCTION JOINTS IN CONCRETE POURS UNLESS SHOWN ON THE DRAWINGS. THE ENGINEER MUST APPROVE ALL DEVIATIONS OR ADDITIONAL JOINTS IN WRITING.
J. CAST SLABS MONOLITHICALLY UNLESS NOTED OTHERWISE.
K. CHAMFER ALL PERMANENTLY EXPOSED CONCRETE EDGES 3/4 INCH, UNLESS NOTED OTHERWISE.
L. REFERENCE ARCHITECTURAL AND MECHANICAL DRAWINGS FOR LOCATIONS OF OPENINGS AND SLEEVES IN CONCRETE WALLS AND SUPPORTED FLOORS. SPREAD REINFORCEMENT AT OPENINGS AND SLEEVES UNLESS OTHERWISE INDICATED. DO NOT CUT REINFORCEMENT.
M. SLOPE CONCRETE SLABS TO FLOOR DRAINS SHOWN ON MECHANICAL, PLUMBING, CIVIL, AND ARCHITECTURAL DRAWINGS.
N. BOND NEW CONCRETE TO HARDENED CONCRETE WITH A STRUCTURAL ADHESIVE BONDING AGENT PER ASTM C1059. INSTALL PER THE MANUFACTURER'S INSTRUCTIONS.
O. NO HOLES OR OPENINGS THROUGH FOUNDATION WALLS AND/OR FOOTINGS WITHOUT ENGINEER'S APPROVAL.
P. DO NOT EMBED ALUMINUM IN CONCRETE.

CONCRETE PROPERTIES

USAGE	STRENGTH (PSI)	TYPE	COMMENTS	DURABILITY CLASSIFICATION
ALL CONCRETE NOT OTHERWISE SPECIFIED	4000	NWT		F0, S0, W0, C1
ELEVATED CIP FLOOR SYSTEMS: INTERIOR	4000	NWT		F0, S0, W0, C0

CONCRETE PROPERTIES TABLE NOTES:
1. MINIMUM STRENGTH AND MAXIMUM DENSITY MEASURED AT 28 DAYS.
2. NWT = NORMAL WEIGHT CONCRETE
3. DURABILITY CLASSIFICATION INDICATES CONCRETE REQUIREMENTS BY EXPOSURE CLASS, REFER TO TABLE 19.3.2.1 OF ACI 318.

ROUGH CARPENTRY

A. GENERAL
   1. LUMBER:
      a. GRADING PER DOC PS 20 AND APPLICABLE GRADING AGENCY RULES.
         1. FACTORY MARK EACH PIECE WITH GRADING AGENCY GRADE STAMP.
      b. MAXIMUM MOISTURE CONTENT: 19%
      c. PROTECT MATERIALS FROM WEATHER.
      d. SORT AND SELECT LUMBER SO NATURAL CHARACTERISTICS DO NOT INTERFERE WITH INSTALLATION OR FASTENING.
      e. PASS PLUMBING AND CONDUIT THROUGH HOLES, NOT NOTCHES, IN STUDS, SILLS, AND PLATES. CENTER HOLES IN THE MEMBER DEPTH. USE GALVANIZED NAIL STOPPERS (16 GAGE MINIMUM) ON BOTH FACES OF BORED MEMBERS IN ACCORDING WITH THE GOVERNING PLUMBING/ELECTRICAL CODE.
B. DIMENSIONAL LUMBER:
   1. UNLESS NOTED OTHERWISE: DOUGLAS FIR NO. 1/NO. 2 OR BETTER
C. ENGINEERED LUMBER AND STRUCTURAL COMPOSITE LUMBER (SCL):
   1. INSTALL ENGINEERED WOOD PRODUCTS PER MANUFACTURER'S WRITTEN INSTRUCTIONS. FOLLOW MANUFACTURER INSTRUCTIONS FOR MULTI-PLY FASTENING AS WELL AS LIMITS ON HOLE SIZES AND LOCATIONS.
   2. SIZES INDICATED ARE NET DIMENSIONS.
   3. LAMINATED-VENEER LUMBER (LVL):
      a. STRUCTURAL CAPACITIES IN ACCORDANCE WITH ASTM D5456.
         1. ALLOWABLE UNIT STRESS IN BENDING, EDGEWISE: 2,600 PSI
         2. MODULUS OF ELASTICITY, EDGEWISE: 2,000,000 PSI
D. FASTENERS:
   1. NAILS, BRADS, AND STAPLES: ASTM F1667
   2. AS A MINIMUM, FASTEN ALL WOOD FRAMING TO COMPLY WITH THE "FASTENING SCHEDULE" OF THE REFERENCED BUILDING CODE AND THE ICC-ES EVALUATION REPORT FOR FASTENERS.
   3. USE STEEL COMMON NAILS UNLESS NOTED OTHERWISE.
   4. STAGGER FASTENERS TO PREVENT SPLITTING, INCLUDING PARALLEL TO GRAIN SPLITTING.
   5. FASTEN MULTI-PLY MEMBERS TOGETHER USING (3) ROWS OF 16d NAILS AT 12 INCHES OC, UNLESS NOTED OTHERWISE.
E. CONNECTORS:
   1. INSTALL CONNECTORS COMPLYING WITH MANUFACTURER'S WRITTEN INSTRUCTIONS. INSTALL FASTENERS THROUGH EACH FASTENER HOLE, UNLESS NOTED OTHERWISE.
   2. CONNECTORS INDICATED ARE MANUFACTURED BY SIMPSON STRONG-TIE, INC. CONNECTORS BY OTHER MANUFACTURERS MAY BE USED IF THE LOAD CAPACITY IS EQUAL TO OR GREATER THAN THE CONNECTOR SPECIFIED. USE MANUFACTURER'S RECOMMENDED FASTENERS, UNLESS NOTED OTHERWISE.
   3. CONNECTORS HAVE A MINIMUM CORROSION PROTECTION OF G90 GALVANIZATION COMPLYING WITH ASTM A653.

POST-INSTALLED ANCHORS

A. ONLY USE POST-INSTALLED ANCHORS WHERE SPECIFIED ON THE DRAWINGS.
B. OBTAIN APPROVAL FROM THE ENGINEER OF RECORD PRIOR TO USING POST-INSTALLED ANCHORS FOR MISSING OR MISPLACED CAST-IN-PLACE ANCHORS.
C. LOCATE EXISTING REBAR, REINFORCING, AND ANCHORS PRIOR TO DRILLING. DO NOT DAMAGE OR DISTURB EXISTING REBAR, REINFORCING OR ANCHORS.
D. INSTALL ANCHORS ACCORDING TO MANUFACTURER'S INSTRUCTIONS, INCLUDING, BUT NOT LIMITED TO: EXPIRATION DATE, INSTALLATION TEMPERATURE, DRILLING METHOD, HOLE SIZE, HOLE DEPTH, HOLE CLEANING, MIXING PROCEDURE, ANCHOR INSTALLATION, AND CURING.
E. FOR PROJECTS MEETING IBC 2012 OR LATER, ACI/CRSI ADHESIVE ANCHORS INSTALLER CERTIFICATION IS REQUIRED FOR ALL INSTALLERS OF ADHESIVE ANCHORS IN HORIZONTAL OR UPWARDLY INCLINED ORIENTATION. PROOF OF CERTIFICATION OR ON-SITE TRAINING FOR ALL ADHESIVE ANCHOR INSTALLERS SHALL BE PROVIDED TO THE EOR PRIOR TO INSTALLATION.
F. FOLLOW MANUFACTURER'S INSTRUCTIONS FOR MINIMUM EDGE DISTANCES AND SPACING.
G. UNLESS NOTED OTHERWISE, EMBED ANCHORS IN THE APPROPRIATE SUBSTRATE WITH A MINIMUM EMBEDMENT OF 8 TIMES THE NOMINAL ANCHOR DIAMETER OR THE EMBEDMENT REQUIRED TO SUPPORT THE INTENDED LOAD.
H. ADHESIVE ANCHOR DESIGN BOND STRENGTH IS BASED ON CRACKED CONCRETE, ACI 355.4 TEMPERATURE CATEGORY B, AND INSTALLATIONS INTO DRY HOLES DRILLED USING A HAMMER DRILL INTO CONCRETE CURED FOR AT LEAST 21 DAYS AND NOT EXPOSED TO WATER FOR THE PRECEDING 14 DAYS. ADHESIVE ANCHORS MUST BE INSTALLED BY A CERTIFIED ADHESIVE ANCHOR INSTALLER PER ACI 318.
I. INSPECT ANCHOR INSTALLATION PER APPLICABLE BUILDING CODE AND SPECIAL INSPECTION REQUIREMENTS.
J. SUBMIT SUBSTITUTION REQUESTS TO THE STRUCTURAL ENGINEER, INCLUDING CALCULATIONS PREPARED AND SEALED BY A REGISTERED PROFESSIONAL ENGINEER SHOWING THE SUBSTITUTED PRODUCT WILL ACHIEVE AN EQUIVALENT CAPACITY USING THE APPROPRIATE DESIGN PROCEDURE REQUIRED BY THE BUILDING CODE.
K. NON-ADHESIVE ANCHORS IN NEW CONCRETE SHALL NOT BE INSTALLED UNTIL CONCRETE HAS CURED A MINIMUM OF 7 DAYS AND SHALL NOT BE LOADED PRIOR TO CONCRETE CURING FOR 28 DAYS (UNLESS OTHERWISE SPECIFIED BY MANUFACTURER).
L. INSTALL ANCHORS PER THE MANUFACTURER PRINTED INSTALLATION INSTRUCTIONS (MPII), AS INCLUDED IN THE ANCHOR PACKAGING.
M. THE CONTRACTOR SHALL ARRANGE AN ANCHOR MANUFACTURER'S REPRESENTATIVE TO PROVIDE ONSITE INSTALLATION TRAINING FOR ALL OF THE ANCHORING PRODUCTS SPECIFIED. THE STRUCTURAL ENGINEER OF RECORD MUST RECEIVE DOCUMENTED CONFIRMATION THAT ALL PERSONNEL WHO INSTALL ANCHORS ARE TRAINED PRIOR TO THE COMMENCEMENT OF ANCHOR INSTALLATION.

SPECIAL INSPECTIONS AND TESTING

A. SPECIAL INSPECTIONS AND TESTING ARE PERFORMED IN ACCORDANCE WITH IBC CHAPTER 17 AND LOCAL JURISDICTION PROVISIONS, BY AN INDEPENDENT INSPECTION AND TESTING AGENCY. THE SPECIAL INSPECTOR MUST OBSERVE AND TEST THE WORK FOR CONFORMANCE TO THE CONTRACT DOCUMENTS.
B. THE SPECIAL INSPECTOR MUST FURNISH INSPECTION REPORTS TO THE BUILDING OFFICIAL, THE ENGINEER OR ARCHITECT OF RECORD, AND ALL OTHER DESIGNATED INDIVIDUALS. ALL DISCREPANCIES MUST BE BROUGHT TO THE ATTENTION OF THE CONTRACTOR FOR CORRECTION, THEN, IF NOT CORRECTED, TO THE PROPER DESIGN AUTHORITY AND THE BUILDING OFFICIAL.
C. THE SPECIAL INSPECTOR MUST SUBMIT A FINAL SIGNED REPORT STATING WHETHER THE WORK IS, TO THE BEST OF THE INSPECTOR'S KNOWLEDGE, IN CONFORMANCE WITH THE CONTRACT DOCUMENTS, SOILS REPORT, AND APPLICABLE WORKMANSHIP OF THE BUILDING CODE.

SUBMITTALS

A. CONTRACTOR MUST REVIEW AND STAMP ALL SHOP DRAWINGS BEFORE SUBMITTING FOR REVIEW. SUBMIT SHOP DRAWINGS TO THE ARCHITECT AND/OR ENGINEER FOR REVIEW. FABRICATE AND CONSTRUCT FROM THE REVIEWED SUBMITTALS. ALLOW 10 BUSINESS DAYS FOR EACH SUBMITTAL REVIEW UNLESS AN ALTERNATE REVIEW TIME IS AGREED UPON BY ALL PARTIES. IN THE EVENT MULTIPLE SUBMITTALS ARE SUBMITTED AT THE SAME TIME, THE CONTRACTOR MUST INDICATE WHICH SUBMITTALS HAVE PRIORITY.
B. MAINTAIN A RECORD SET OF APPROVED SHOP DRAWINGS IN THE FIELD.
C. SUBMIT IN WRITING ANY DEVIATION FROM, ADDITION TO, SUBSTITUTION FOR, OR MODIFICATION TO, THE STRUCTURE OR ANY PART OF THE STRUCTURE DETAILED, TO THE ENGINEER FOR REVIEW. SHOP DRAWINGS SUBMITTED FOR REVIEW DO NOT CONSTITUTE "IN-WRITING" UNLESS IT IS CLEARLY NOTED SPECIFIC CHANGES ARE BEING REQUESTED.
D. PREPARE A LIST AND SCHEDULE OF ALL STRUCTURAL SUBMITTALS PRIOR TO CONSTRUCTION.
E. SUBMIT THE FOLLOWING SHOP DRAWINGS FOR THE ENGINEER'S REVIEW:
   1. CONCRETE MIX DESIGNS
   2. REINFORCING STEEL
   3. ALL OPENINGS IN FLAT SLABS INCLUDING BUT NOT LIMITED TO MECHANICAL, ELECTRICAL, AND PLUMBING
F. SUBMIT ITEMS MARKED (1) SEALED BY A REGISTERED PROFESSIONAL ENGINEER IN THE STATE WHERE THE PROJECT IS LOCATED. SUBMIT ITEMS MARKED (2) FOR OWNER'S RECORD ONLY, AND WILL NOT HAVE THE ENGINEER'S SHOP DRAWING STAMP AFFIXED. SUBMIT ITEMS MARKED (3) WITH DESIGN CALCULATIONS SEALED BY A REGISTERED PROFESSIONAL ENGINEER IN THE STATE WHERE THE PROJECT IS LOCATED.
   1. THE OMISSION FROM THE SHOP DRAWINGS OF ANY MATERIALS REQUIRED BY THE CONTRACT DOCUMENTS DOES NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY OF FURNISHING AND INSTALLING SUCH MATERIALS, REGARDLESS OF WHETHER THE SHOP DRAWINGS HAVE BEEN REVIEWED AND APPROVED.
G. THE USE OF ELECTRONIC FILES OR REPRODUCTIONS OF CONTRACT DOCUMENTS BY ANY CONTRACTOR, SUBCONTRACTOR, ERECTOR, FABRICATOR, OR MATERIAL SUPPLIER IN LIEU OF PREPARATION OF SHOP DRAWINGS SIGNIFIES ACCEPTANCE OF ALL INFORMATION SHOWN HEREON AS CORRECT, AND OBLIGATES THEM TO ANY JOB EXPENSE, REAL OR IMPLIED, ARISING DUE TO ANY ERRORS THAT MAY OCCUR HEREON.

Consultant:

BRITT, PETERS AND ASSOCIATES INC.
consulting engineers
999 Waterside Drive
Suite 2202
Norfolk, VA 23510
(757) 965-5710
www.brittpeters.com
BPA Project # 240639

PROFESSIONAL ENGINEER · DAVID R. SCHLAFER · No. 94819 · 02/27/2025 · CIVIL · STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/2025	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
GENERAL NOTES

S000

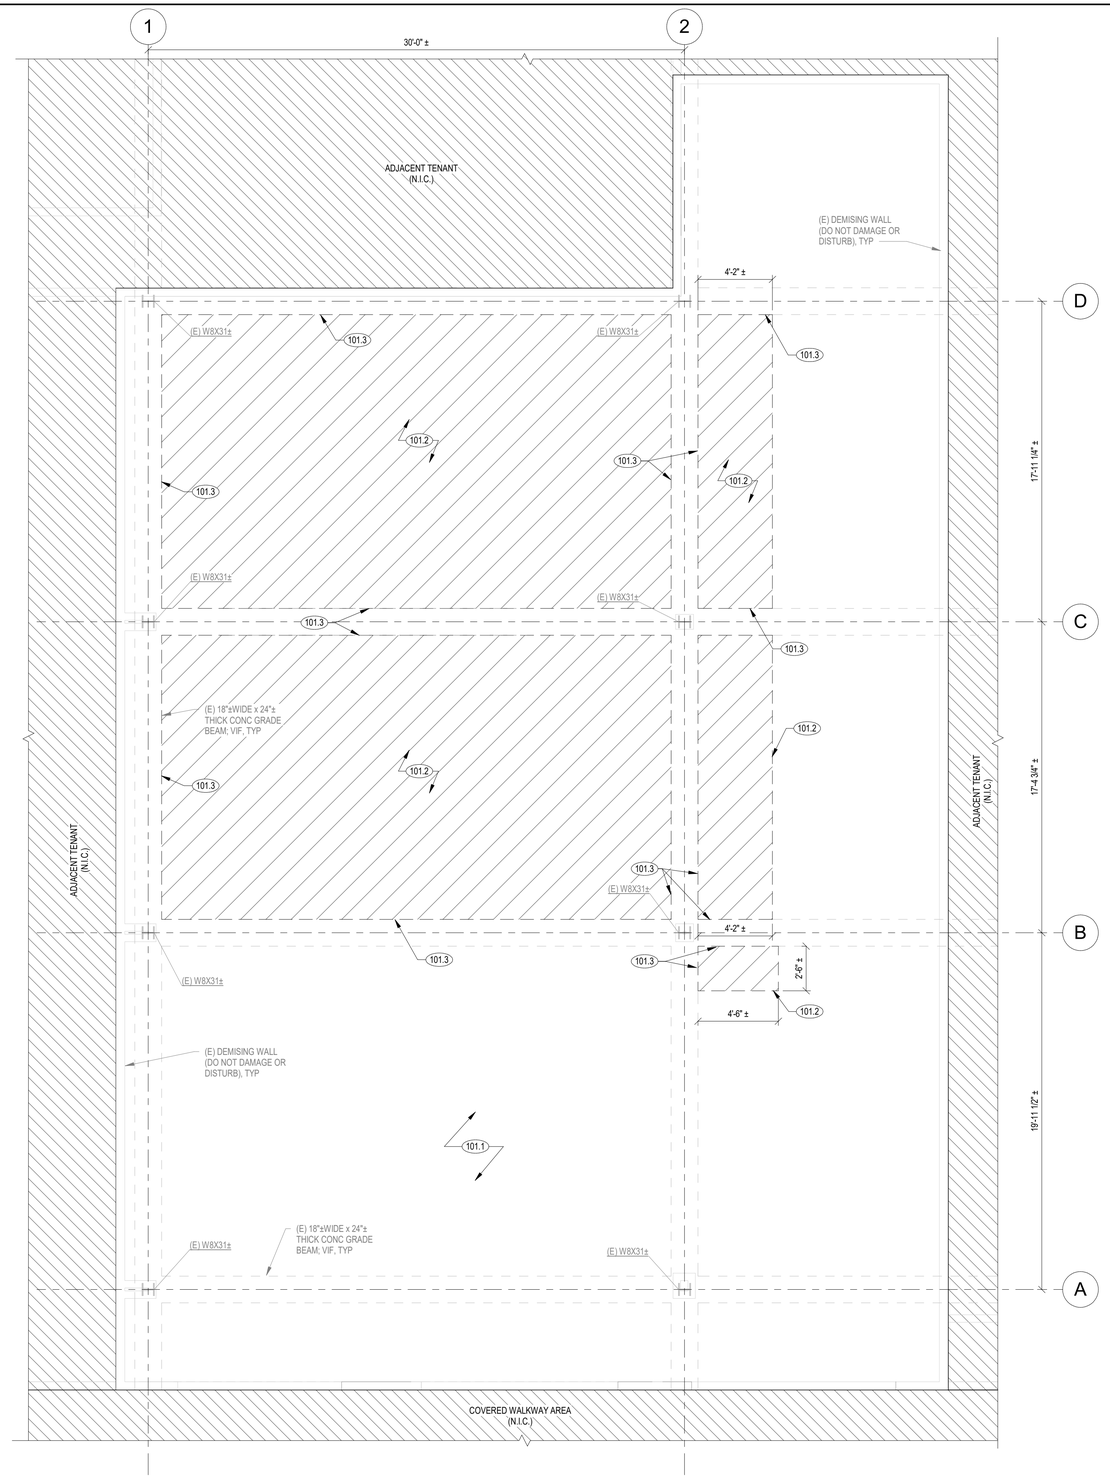

1 DEMO SLAB PLAN

1/4" = 1'-0"

PLAN LEGEND

(##)	DENOTES SHEET NOTE, REF SCHEDULE THIS SHEET
±	DENOTES APPROXIMATE DIMENSION/ELEVATION, FIELD VERIFY
(E)	DENOTES EXISTING BUILDING ELEMENT, FIELD VERIFY
VIF	DENOTES VERIFY IN FIELD
	DENOTES STRUCTURAL SLAB DEMO EXTENTS, REF SHEET NOTE 101.2

DEMOLITION PLAN NOTES

1. NO RECORD STRUCTURAL DRAWINGS ARE AVAILABLE. EXISTING STRUCTURAL INFORMATION SHOWN IS BASED UPON A FIELD VISIT BY BRITT, PETERS AND ASSOCIATES ON SEPTEMBER 18, 2024 AND FROM INFORMATION PROVIDED BY PACIFIC COAST CUTTERS INC., ON DECEMBER 10, 2024. REFERENCE THE ARCHITECTURAL DEMOLITION DRAWINGS FOR ADDITIONAL INFORMATION ON THE EXISTING STRUCTURE. FIELD VERIFY EXISTING STRUCTURE, INCLUDING DIMENSIONS, ELEVATIONS AND OTHER DETAILS, PRIOR TO DEMOLITION.
2. REFERENCE THE ARCHITECTURAL DEMOLITION DRAWINGS FOR REMOVAL OF NON-STRUCTURAL ITEMS, DIMENSIONS, ELEVATIONS AND OTHER INFORMATION NOT SHOWN.
3. REFERENCE THE GENERAL NOTES ON SHEET S000.

SHEET NOTE SCHEDULE - DEMOLITION (##)

REF PLANS AND DETAILS FOR SHEET NOTES REQUIRED, NOT ALL NOTES APPLICABLE TO THIS SHEET

MARK	DESCRIPTION
101.1	EXISTING 12"+/- THICK CONCRETE SLAB REINFORCED WITH #5 TOP BARS AT 16"+/- OC (EA WA) AND #6 BOTTOM BARS AT 12"+/- OC (EA WA). ALL EXISTING BAR SIZES ARE ASSUMED, GC TO VERIFY PRIOR TO DEMO.
101.2	PARTIALLY REMOVE EXISTING STRUCTURAL SLAB. EXTENTS OF SLAB DEMOLITION ARE APPROXIMATE AND SHALL BE FIELD VERIFIED. REF ARCHITECTURAL DEMO DRAWINGS FOR OTHER DETAILS NOT INDICATED.
101.3	DO NOT DAMAGE NOR DISTURB EXISTING CONCRETE GRADE BEAM BELOW SLAB. FIELD VERIFY EXISTING GRADE BEAM SIZE, THICKNESS, ELEVATIONS AND EXTENTS PRIOR TO SLAB DEMOLITION

EXISTING CONCRETE GRADE BEAM REINFORCING NOTE

DO NOT DAMAGE OR DISTURB EXISTING CONCRETE GRADE BEAM REINFORCING (TIES, LONG BARS, ETC.). DO NOT PENETRATE THE EXISTING CONCRETE MEMBER UNTIL REINFORCING LOCATIONS ARE ESTABLISHED AND MARKED USING RADIOGRAPHIC (X-RAY) SCANNING. ADJUST OPENINGS, ANCHORS, AND OTHER DRILLING LOCATIONS TO AVOID EXISTING CONCRETE REINFORCING. IMMEDIATELY NOTIFY THE ENGINEER OF DAMAGED REINFORCING. REMEDIATION/REPLACEMENT OF DAMAGED REINFORCING IS THE CONTRACTOR'S RESPONSIBILITY.

NOTE REGARDING EXISTING CONSTRUCTION

THE CONTRACTOR SHALL VERIFY THAT ALL STRUCTURAL COMPONENTS SHOWN ON THESE DRAWINGS ARE ACCURATE IN REPRESENTING WHAT IS CURRENTLY BUILT. THE CONTRACTOR SHALL NOTIFY THE STRUCTURAL ENGINEER OF RECORD IF ANY AS-BUILT CONDITION DIFFERS FROM WHAT IS DEPICTED ON THESE DOCUMENTS.

Consultant:

BRITT, PETERS AND ASSOCIATES INC.
consulting engineers

999 Waterside Drive
Suite 2202
Norfolk, VA 23510
(757) 965-5710
www.brittpeters.com
BPA Project # 240639

PROFESSIONAL ENGINEER
DAVID R. SCHLAFER
C 94819
02/27/2025
CIVIL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/2025	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

DEMO SLAB PLAN

SD101

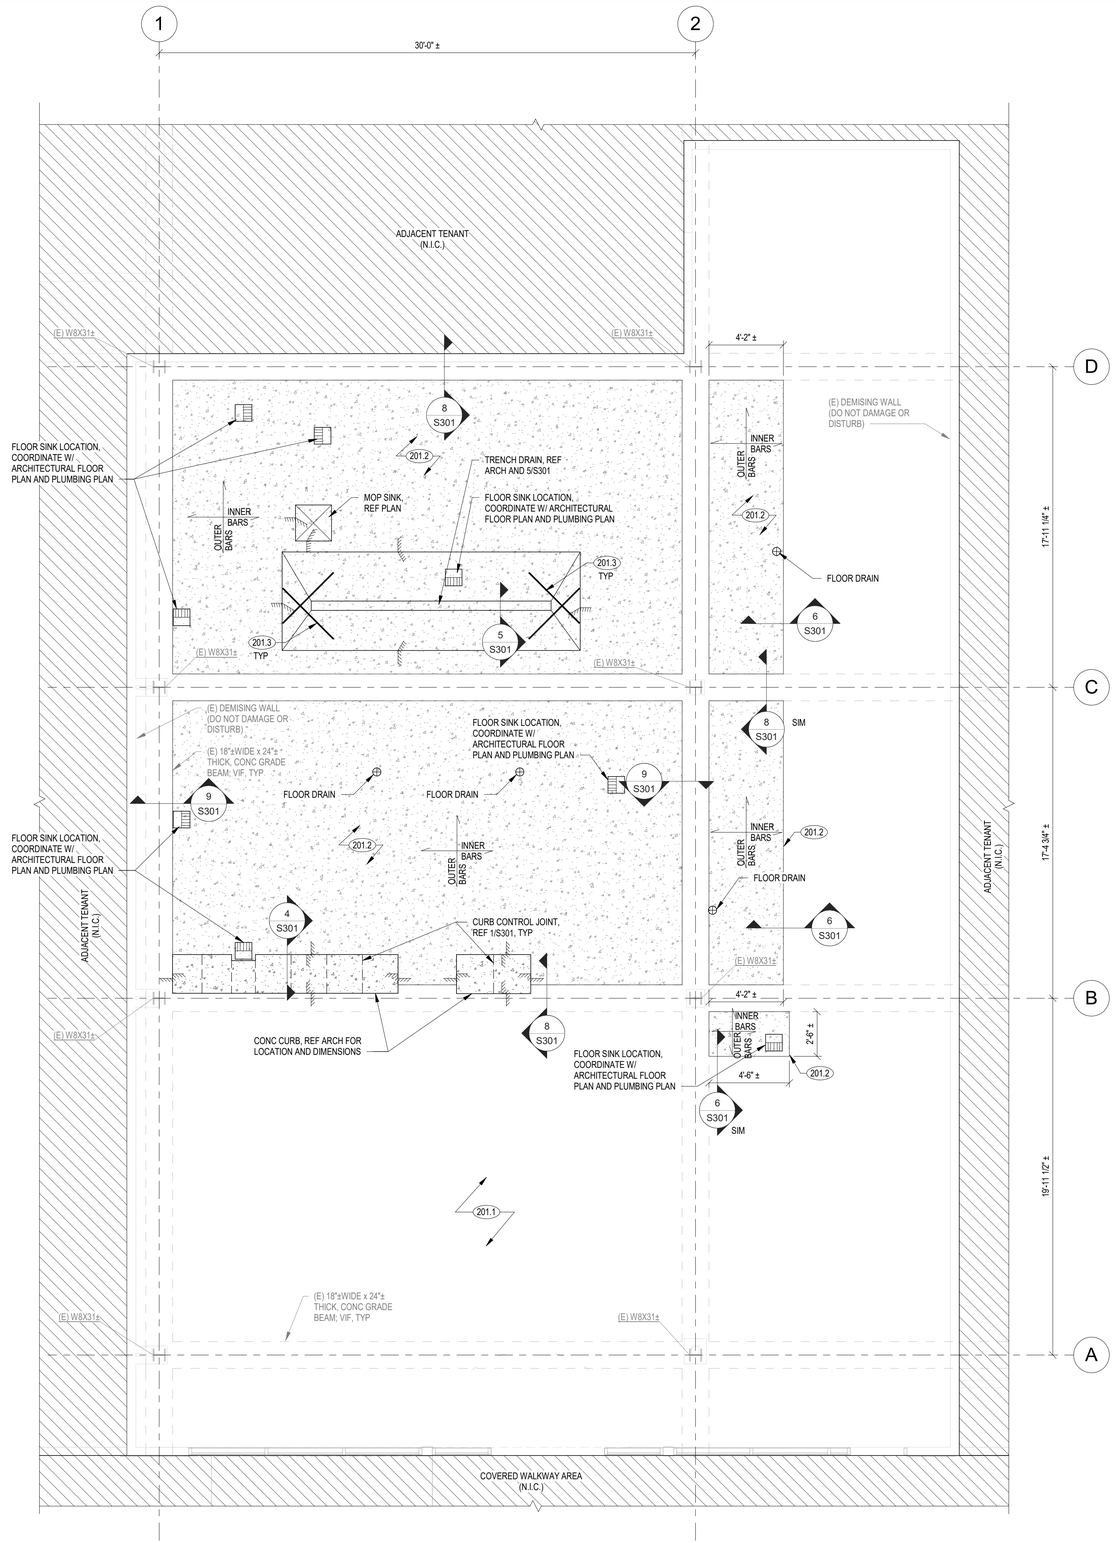

1 **SLAB PLAN**
1/4" = 1'-0"

PLAN LEGEND

#.##	DENOTES SHEET NOTE, REF SCHEDULE THIS SHEET
±	DENOTES APPROXIMATE DIMENSION/ELEVATION, FIELD VERIFY
(E)	DENOTES EXISTING BUILDING ELEMENT, FIELD VERIFY
VIF	DENOTES VERIFY IN FIELD

PLAN NOTES

1. NO RECORD STRUCTURAL DRAWINGS ARE AVAILABLE. EXISTING STRUCTURAL INFORMATION SHOWN IS BASED UPON A FIELD VISIT BY BRITT, PETERS AND ASSOCIATES ON SEPTEMBER 18, 2024 AND FROM INFORMATION PROVIDED BY PACIFIC COAST CUTTERS INC., ON DECEMBER 10, 2024. FIELD VERIFY ALL EXISTING FRAMING SIZES, CONDITIONS AND DIMENSIONS PRIOR TO FABRICATION OF NEW MATERIAL. CONTACT ENGINEER WITH DISCREPANCIES PRIOR TO FABRICATION OF NEW MATERIAL.
2. REFER TO MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR SLAB PENETRATIONS AND UNDERGROUND UTILITIES.
3. REFER TO ARCHITECTURAL DRAWINGS FOR SLAB PENETRATIONS AND UNDERGROUND UTILITIES.
4. VERIFY LOCATION, SIZE AND NUMBER OF FLOOR DEPRESSIONS AND FLOOR SLOPES WITH ARCHITECTURAL AND MEP DRAWINGS.
5. COORDINATE ABSOLUTE ELEVATION OF TOP OF SLAB WITH ARCHITECTURAL DRAWINGS,
6. REF SHEET S000 FOR GENERAL STRUCTURAL NOTES.

201.2

SHEET NOTE SCHEDULE - FOUNDATION PLAN #.##

REF PLANS AND DETAILS FOR SHEET NOTES REQUIRED, NOT ALL NOTES APPLICABLE TO THIS SHEET

MARK	DESCRIPTION
201.1	EXISTING 12"+/- THICK CONCRETE SLAB REINFORCED WITH #5 TOP BARS AT 16"+/- OC (EA WAY) AND #6 BOTTOM BARS AT 12"+/- OC (EA WAY). ALL EXISTING BAR SIZES ARE ASSUMED, GC TO VERIFY PRIOR TO DEMO
201.2	12" THICK CONCRETE SLAB REINFORCED WITH #6 OUTER BARS AND #5 INNER BARS @ 12" OC, EACH WAY, TOP AND BOTTOM. INSTALL VAPOR RETARDER PER GEOTECHNICAL ENGINEER REQUIREMENTS, REF GENERAL NOTES FOR ADDITIONAL INFORMATION.
201.3	(2) #4 x 4'-0" AT RE-ENTRANT CORNER, LOCATED 1" CLEAR FROM TOP OF SLAB

EXISTING CONCRETE GRADE BEAM REINFORCING NOTE

DO NOT DAMAGE OR DISTURB EXISTING CONCRETE GRADE BEAM REINFORCING (TIES, LONG BARS, ETC.). DO NOT PENETRATE THE EXISTING CONCRETE MEMBER UNTIL REINFORCING LOCATIONS ARE ESTABLISHED AND MARKED USING RADIOGRAPHIC (X-RAY) SCANNING. ADJUST OPENINGS, ANCHORS, AND OTHER DRILLING LOCATIONS TO AVOID EXISTING CONCRETE REINFORCING. IMMEDIATELY NOTIFY THE ENGINEER OF DAMAGED REINFORCING. REMEDIATION/REPLACEMENT OF DAMAGED REINFORCING IS THE CONTRACTOR'S RESPONSIBILITY.

NOTE REGARDING EXISTING CONSTRUCTION

THE CONTRACTOR SHALL VERIFY THAT ALL STRUCTURAL COMPONENTS SHOWN ON THESE DRAWINGS ARE ACCURATE IN REPRESENTING WHAT IS CURRENTLY BUILT. THE CONTRACTOR SHALL NOTIFY THE STRUCTURAL ENGINEER OF RECORD IF ANY AS-BUILT CONDITION DIFFERS FROM WHAT IS DEPICTED ON THESE DOCUMENTS.

Consultant:

BRITT, PETERS AND ASSOCIATES INC.
consulting engineers
999 Waterside Drive
Suite 2202
Norfolk, VA 23510
(757) 965-5710
www.brittpeters.com
BPA Project # 240639

PROFESSIONAL ENGINEER — DAVID R. SCHLATTER — C 94819 — CIVIL — STATE OF CALIFORNIA
02/27/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/2025 PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
SLAB PLAN

S201

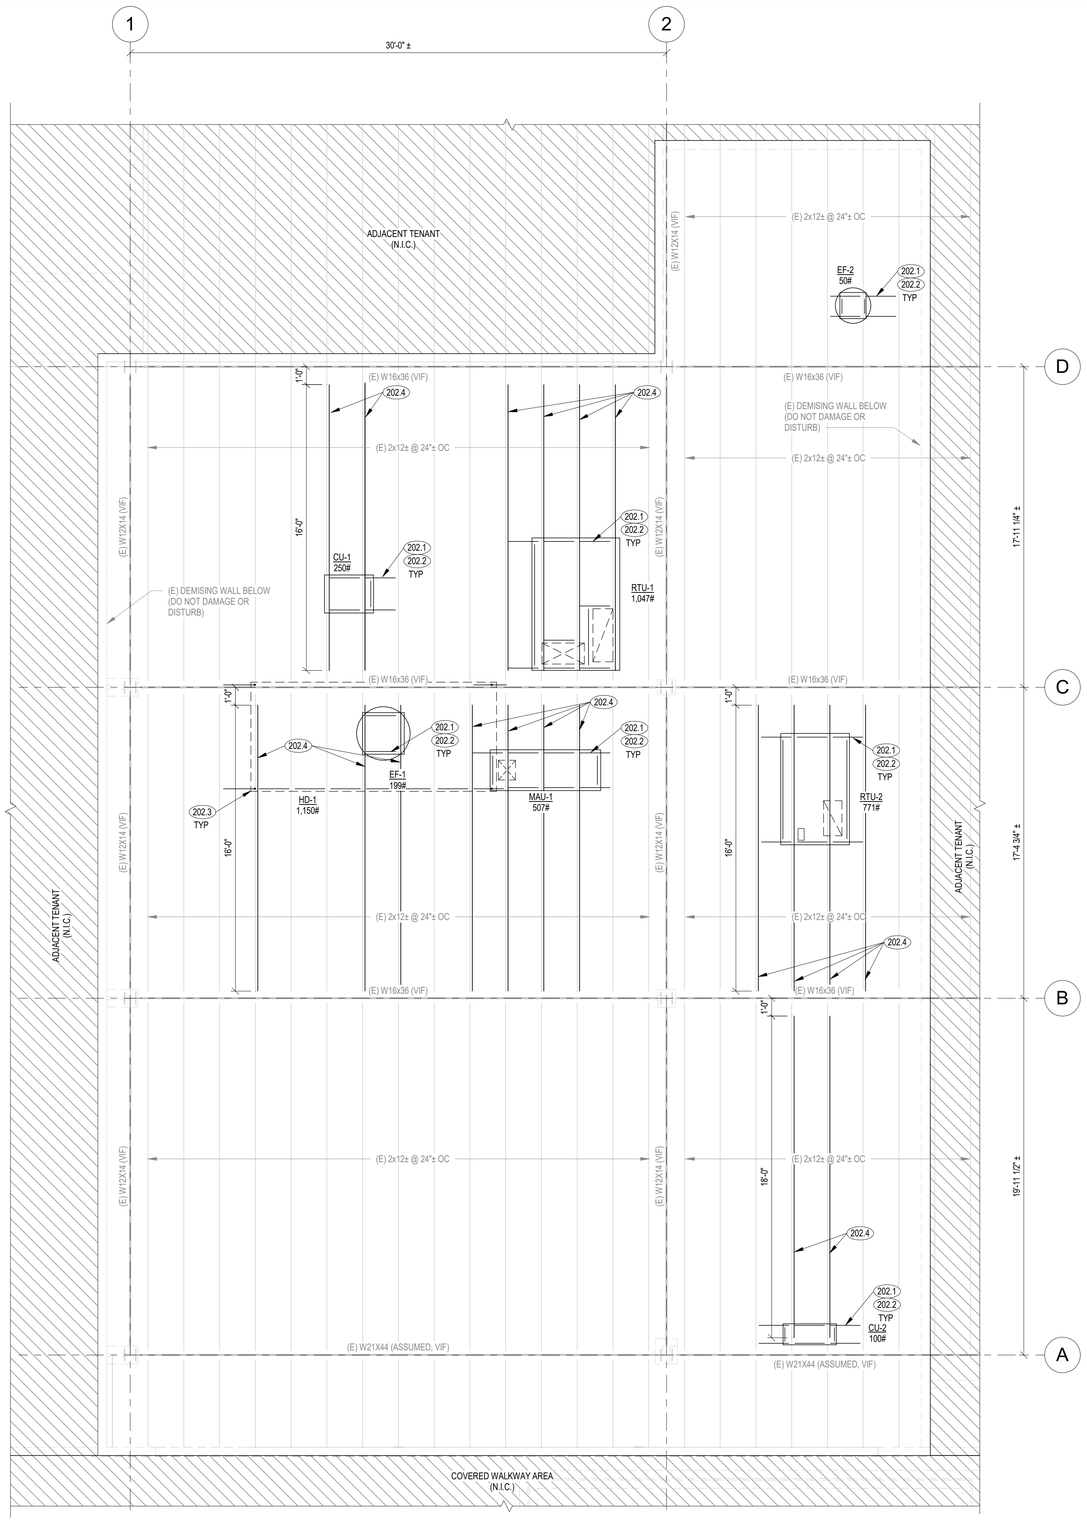

1 EXISTING ROOF FRAMING PLAN

1/4" = 1'-0"

PLAN LEGEND

#.##	DENOTES SHEET NOTE, REF SCHEDULE THIS SHEET
±	DENOTES APPROXIMATE DIMENSION/ELEVATION, FIELD VERIFY
(E)	DENOTES EXISTING BUILDING ELEMENT, FIELD VERIFY
VIF	DENOTES VERIFY IN FIELD

ROOF FRAMING PLAN NOTES

1. NO RECORD STRUCTURAL DRAWINGS ARE AVAILABLE. EXISTING STRUCTURAL INFORMATION SHOWN IS BASED UPON A FIELD VISIT BY BRITT, PETERS AND ASSOCIATES ON SEPTEMBER 18, 2024 AND FROM INFORMATION PROVIDED BY PACIFIC COAST CUTTERS INC., ON DECEMBER 10, 2024. FIELD VERIFY ALL EXISTING FRAMING SIZES, CONDITIONS AND DIMENSIONS PRIOR TO FABRICATION OF NEW MATERIAL. CONTACT ENGINEER WITH DISCREPANCIES PRIOR TO FABRICATION OF NEW MATERIAL.

SHEET NOTE SCHEDULE - ROOF FRAMING... (#.##)

REF PLANS AND DETAILS FOR SHEET NOTES REQUIRED, NOT ALL NOTES APPLICABLE TO THIS SHEET

MARK	DESCRIPTION
202.1	INSTALL BLOCKING PER DETAILS 2/S302 AND 3/S302
202.2	RTU ANCHORAGE, REF 4/S302
202.3	VENT HOOD BELOW, REF 1/S302 FOR ATTACHMENT TO EXISTING STRUCTURE. REF ARCH DRAWINGS FOR HOOD LOCATION, ELEVATION, ETC
202.4	CONT 1.75X11.25 LVL REINFORCING SISTERED TO EXISTING JOIST, REF 5/S302 FOR ADDITIONAL INFORMATION

NOTE REGARDING EXISTING CONSTRUCTION

THE CONTRACTOR SHALL VERIFY THAT ALL STRUCTURAL COMPONENTS SHOWN ON THESE DRAWINGS ARE ACCURATE IN REPRESENTING WHAT IS CURRENTLY BUILT. THE CONTRACTOR SHALL NOTIFY THE STRUCTURAL ENGINEER OF RECORD IF ANY AS-BUILT CONDITION DIFFERS FROM WHAT IS DEPICTED ON THESE DOCUMENTS.

Consultant:

BRITT, PETERS AND ASSOCIATES INC.
consulting engineers

999 Waterside Drive
Suite 2202
Norfolk, VA 23510
(757) 965-5710
www.brittpeters.com
BPA Project # 240639

PROFESSIONAL ENGINEER
DAVID R. SCHLAFER
C 94819
02/27/2025
CIVIL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/2025	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

EXISTING ROOF FRAMING PLAN

S202



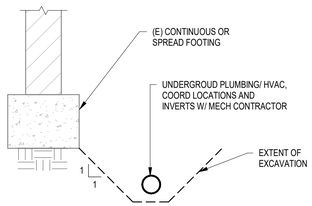

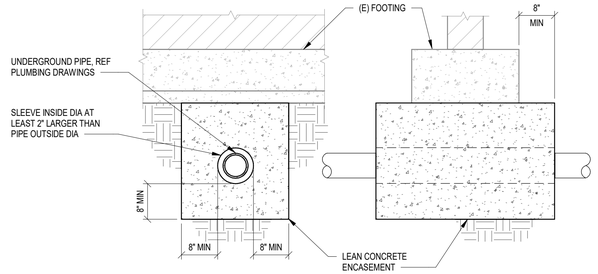

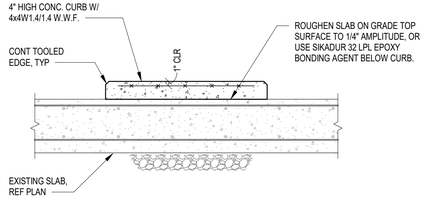

1 TYPICAL CURB CONTROL JOINT
NTS

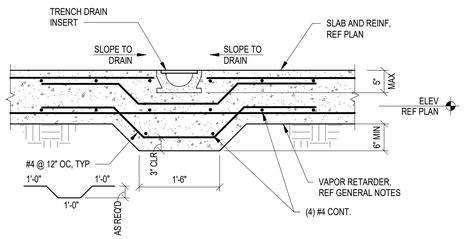

2 TYPICAL EXCAVATION CLEARANCE REQUIREMENTS
NTS

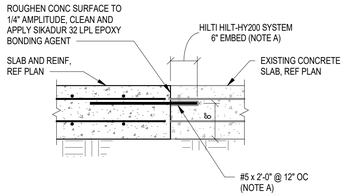

NOTE A:
DO NOT DAMAGE OR DISTURB EXISTING CONCRETE GRADE BEAM REINFORCING (TIES, LONG BARS, ETC). DO NOT PENETRATE THE EXISTING CONCRETE MEMBER UNTIL LOCATIONS OF THE REINFORCING IS ESTABLISHED USING RADIOGRAPHIC (X-RAY) SCANNING. ADJUST OPENINGS, ANCHORS, AND OTHER DRILLING LOCATIONS TO AVOID EXISTING CONCRETE REINFORCING

3 TYPICAL PLUMBING UNDER FOOTING DETAIL
NTS

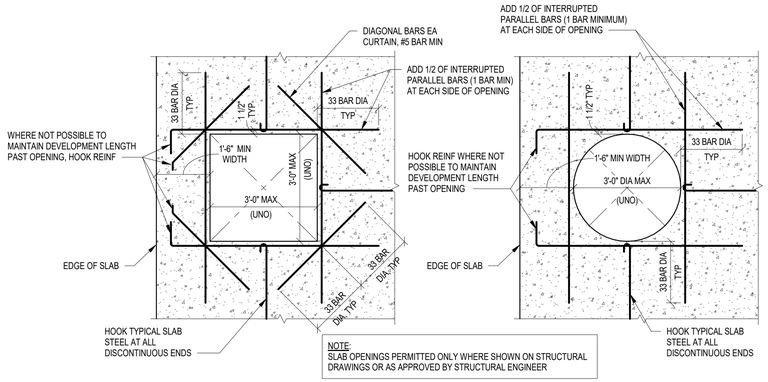

NOTE:
SLAB OPENINGS PERMITTED ONLY WHERE SHOWN ON STRUCTURAL DRAWINGS OR AS APPROVED BY STRUCTURAL ENGINEER

4 CURB DETAIL
NTS

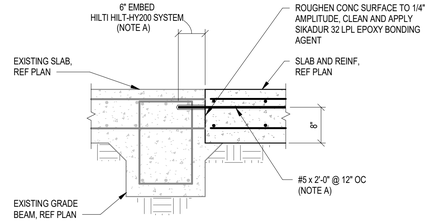

NOTE A:
DO NOT DAMAGE OR DISTURB EXISTING CONCRETE GRADE BEAM REINFORCING (TIES, LONG BARS, ETC). DO NOT PENETRATE THE EXISTING CONCRETE MEMBER UNTIL LOCATIONS OF THE REINFORCING IS ESTABLISHED USING RADIOGRAPHIC (X-RAY) SCANNING. ADJUST OPENINGS, ANCHORS, AND OTHER DRILLING LOCATIONS TO AVOID EXISTING CONCRETE REINFORCING

5 TRENCH DETAIL
NTS

6 NEW SLAB ON GRADE TO EXISTING
3/4" = 1'-0"

7 REINFORCING AROUND OPENINGS IN CONCRETE SLAB, UNO
1/2" = 1'-0"

8 TYPICAL SLAB CONNECTION TO EXISTING CONCRETE GRADE BEAM
3/4" = 1'-0"

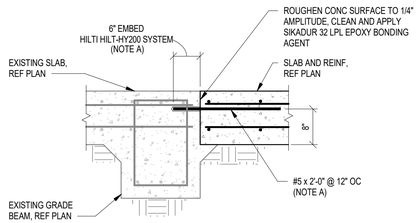

NOTE A:
DO NOT DAMAGE OR DISTURB EXISTING CONCRETE GRADE BEAM REINFORCING (TIES, LONG BARS, ETC). DO NOT PENETRATE THE EXISTING CONCRETE MEMBER UNTIL LOCATIONS OF THE REINFORCING IS ESTABLISHED USING RADIOGRAPHIC (X-RAY) SCANNING. ADJUST OPENINGS, ANCHORS, AND OTHER DRILLING LOCATIONS TO AVOID EXISTING CONCRETE REINFORCING

9 TYPICAL SLAB CONNECTION TO EXISTING CONCRETE GRADE BEAM
3/4" = 1'-0"

NOTE REGARDING REINF COVER REQUIREMENTS

ALL REINFORCING SHALL BE PLACED IN ACCORDANCE WITH THE MINIMUM COVER REQUIREMENTS PER ACI AS OUTLINED IN THE GENERAL NOTES. SPECIFIC BAR LOCATIONS SHOWN IN SECTIONS AND DETAILS MAY OVERRIDE BUT NOT VIOLATE THE MINIMUM COVER REQUIREMENTS.

Consultant:

BRITT, PETERS AND ASSOCIATES INC.
consulting engineers
999 Waterside Drive
Suite 2202
Norfolk, VA 23510
(757) 965-5710
www.brittpeters.com
BPA Project # 240639

PROFESSIONAL ENGINEER — DAVID R. SCHLAFER — C 94819 — 02/27/2025 — CIVIL — STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/2025	PERMIT SET

Revisions:

Project No.
47CMGX.0065.000

Contents:
TYPICAL DETAILS

S301

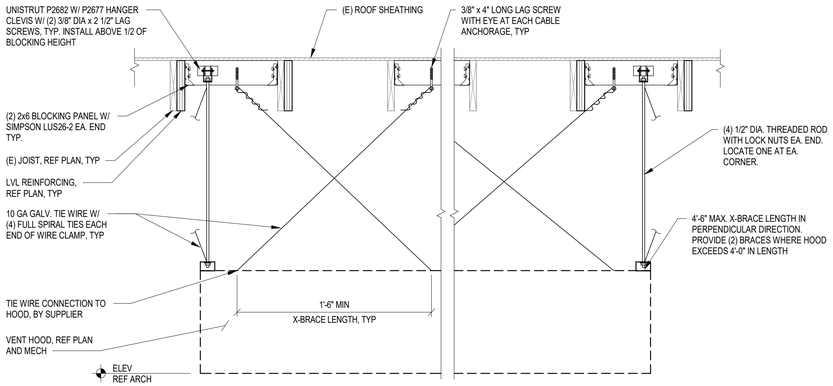

1 TYPICAL VENT HOOD SUPPORT

3/4" = 1'-0"

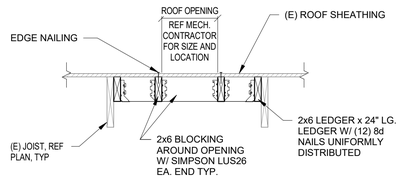

2 TYPICAL BLOCKING AT RTU OPENING

3/4" = 1'-0"

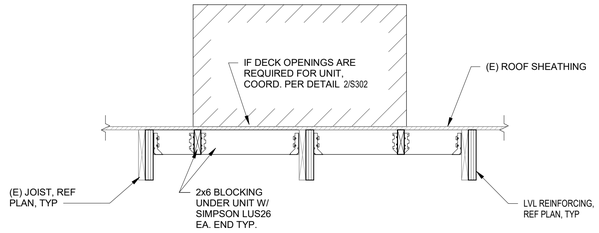

3 TYPICAL BLOCKING AT RTU

3/4" = 1'-0"

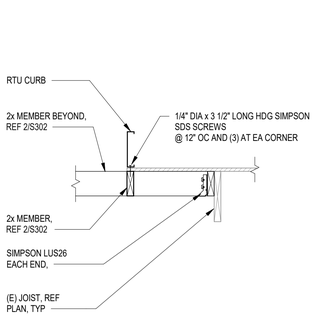

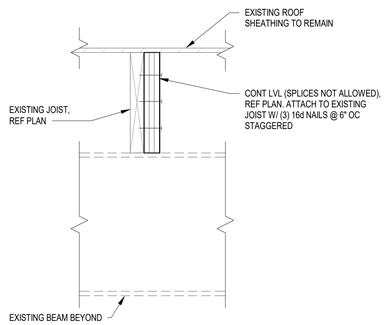

SECTION

4 TYP ANCHORAGE AT RTUS

3/4" = 1'-0"

5 EXISTING ROOF JOIST REINF DETAILS

1 1/2" = 1'-0"

Consultant:

BRITT, PETERS AND ASSOCIATES INC.
consulting engineers
999 Waterside Drive
Suite 2202
Norfolk, VA 23510
(757) 965-5710
www.brittpeters.com
BPA Project # 240639

PROFESSIONAL ENGINEER
DAVID R. SCHLATTER
C 94819
02/27/2025
CIVIL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/2025	PERMIT SET

Revisions:

Project No.

47CMGX.0065.000

Contents:

TYPICAL DETAILS

S302

SECTION 15732 - PACKAGED ROOFTOP AIR-CONDITIONING UNITS

PART 1 - GENERAL

1.1 SECTION REQUIREMENTS

A. Submittals: Product Data and Shop Drawings.
B. Comply with ASHRAE 15.
C. EER: Equal to or greater than prescribed by the energy code adopted by the Authority Having Jurisdiction.
D. Warranties: Submit a written warranty, signed by the manufacturer, agreeing to the repair or replacement of components that fail within 5 years of Substantial Completion.

PART 2 - PRODUCTS

2.1 PACKAGED UNITS, 5 TO 20 TONS

A. Factory assembled and tested, consisting of compressors, condensers, evaporator coils, condenser and evaporator fans, refrigeration and temperature controls, filters, and dampers.
   1. Refer to Rooftop Heating/Cooling Unit Schedule on drawing M600 for capacities, and manufacturers.
   2. Evaporator Fans: Belt or direct driven, forward curved centrifugal.
   3. Exhaust/Relief Fans: Direct drive, forward curved centrifugal or propeller.
   4. Condenser Fans: Direct drive propeller.
   5. Refrigerant Coils: Aluminum fins and copper coil.
   6. Compressors: Serviceable hermetic or fully hermetic, with safety controls, hot gas bypass, and timed off controls.
   7. Heat Exchangers: Gas fired, with gas controls, electronic ignition, high limit cutout, and forced draft proving switch.
   8. Economizer controls (Comparative Enthalpy, 100% capacity).
   9. Smoke Detectors: Photoelectric in supply and/or return as called for in schedule on sheet M600.
   10. Operating Controls: Two stage heating and two stage cooling on units 7-1/2 tons and over.
   11. Roof curb.
   12. Control Wiring from T-stat to rooftop unit: Shall be 18ga / 7 conductor, rated for plenum applications.
   13. Control Wiring from T-stat to remote sensor: Shall be a separate 18ga / 2 conductor shielded, rated for plenum applications.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install units level and plumb and firmly anchored.
B. Connect gas piping to burner with pipe same size as gas train inlet, and provide union with sufficient clearance for burner removal and service.
C. Install ducts to termination in roof mounting frames. Terminate ducts through roof structure.
D. Connect units to wiring systems and to ground.

END OF SECTION 15732

SECTION 15810 - DUCTS AND ACCESSORIES

PART 1 - GENERAL

1.1 SECTION REQUIREMENTS

A. Submittals: Product Data for fire and smoke dampers.
B. Comply with NFPA 90A for systems serving spaces more than 25,000 cu. ft. in volume or building Types II, IV, and V construction more than 3 stories in height.
C. Comply with NFPA 90B for systems serving spaces in 1 or 2 family dwellings or serving spaces less than 25,000 cu. ft..
D. Comply with NFPA 96, "Ventilation Control and Fire Protection of Commercial Cooking Operations," for kitchen hood ducts.
E. Comply with UL 181 and UL 181A for ducts and closures.
F. Testing, Adjusting, and Balancing Agency Qualifications: AABC certified (to be furnished by Tenant).

PART 2 - PRODUCTS

2.1 DUCTS

A. Spiral Duct: Spiral Lock Seam, without insulation, G90 galvanized finish, ASTM A-653/924
   1. Basis of Design Manufacturers: Lindab SPIROsafe, alternates to the basis of design must be submitted for review.
   2. Fittings: Factory produced standing seam construction with internal sealing. Fittings with a major axis of 36" or smaller shall be 20 gauge. Fittings with a major axis of 37"-48" shall be 18 gauge.
B. Galvanized Steel Sheet: Forming steel, ASTM A 653/653M, G90 coating designation.
C. Duct Liner: ASTM C 1071, Type II, with an airstream surface coated with a temperature resistant coating. Thickness: 1-1/2 inch. R-value : 8.
   1. Adhesive: ASTM C 916, Type I.
   2. Mechanical Fasteners: Galvanized steel pin, length as required to penetrate liner plus a 1/8 inch projection maximum into the airstream.
D. Joint and Seam Tape: Comply with UL 181A.
E. Joint and Seam Sealant: Comply with UL 181A.
F. Rectangular Metal Duct Fabrication: Comply with SMACNA's "HVAC Duct Construction Standard" for metal thickness, reinforcing types and intervals, tie rod applications, and joint types and intervals.

2.2 ACCESSORIES

A. Volume-Control Dampers: Factory fabricated volume control dampers, complete with required hardware and accessories. Single blade and multiple opposed blade, standard leakage rating, and suitable for horizontal or vertical applications.
B. Fire Dampers: Factory-fabricated fire dampers, complete with required hardware and accessories. UL labeled according to UL 555, "Fire Dampers".
C. Flexible Connectors: Flame retardant or noncombustible fabrics, coatings, and adhesives complying with UL 181, Class 1.
D. Flexible Ducts: Factory fabricated, insulated, round duct, with an outer jacket enclosing 2 inch thick, glass fiber insulation, R-value: 6.0, around a continuous inner liner.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Duct System Pressure Class: Construct and install each duct system with 2 inch positive and negative duct pressure classifications.
B. Conceal ducts from view in finished and occupied spaces. Except where noted as exposed.
C. Avoid passing through electrical equipment spaces and enclosures.
D. Support and connect metal ducts according to SMACNA's "HVAC Duct Construction Standard".
E. Install duct accessories according to applicable portions of details of construction as shown in SMACNA standards.
F. Install liner and/or insulation on ductwork per the material schedule on sheet M010.
G. Install volume control dampers in lined duct with methods to avoid damage to liner and to avoid erosion of duct liner.
H. Install fire and smoke dampers according to manufacturer's UL approved written instructions.
I. Install fusible links in fire dampers.
J. Provide saddle taps at tees for exposed ductwork.

3.2 TESTING, ADJUSTING, AND BALANCING

A. The Tenant will supply an independent balance agent to to balance and adjust the HVAC installation. The balance agent will be responsible for any pulley or belt changes required.
B. The GC is to have trained staffed available during the balancing to correct issues noted by the balance agent.
C. The balance agent is to balance airflow within distribution systems, including submains, branches, and terminals to indicated quantities +/- 10%. The hood exhaust system shall be balanced to a tolerance of -0+10% and the make-up air system to a tolerance of -10+0%.
D. The balance agent is to supply a copy of the balance report to the Tenant, engineer and general contractor for review.

END OF SECTION 15810

SECTION 15855 - DIFFUSERS, REGISTERS, AND GRILLES

PART 1 - GENERAL

1.1 SECTION REQUIREMENTS

A. Submittals: None.

PART 2 - PRODUCTS

2.1 OUTLETS AND INLETS

A. All air terminal devices:
   1. Refer to Grills, Registers, and Diffusers Schedule for equipment schedule
   2. Manufacturer: As scheduled (NO SUBSTITUTIONS)
   3. Material: As scheduled.
   4. Finish: As scheduled.
   5. Mounting: As scheduled.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Coordinate location and installation with duct installation and installation of other ceiling and wall mounted items.
B. Locate ceiling diffusers, registers, and grilles, as indicated on the architectural "reflected ceiling plans." Unless otherwise indicated, locate units in center of acoustical ceiling panels.

END OF SECTION 15855

HVAC GENERAL NOTES

A GENERAL NOTES APPLY TO HVAC SHEETS.

B WORK SHALL COMPLY WITH STATE AND LOCAL CODE REQUIREMENTS AS APPROVED AND AMENDED BY THE AUTHORITY HAVING JURISDICTION, INCLUDING APPLICABLE SECTIONS OF NFPA, THE MECHANICAL CODE, AND ANY INTERIM AMENDMENTS AT THE TIME OF THE PROPOSAL. PURCHASE PERMITS ASSOCIATED WITH THE WORK. OBTAIN INSPECTIONS REQUIRED BY CODE. SEE ARCHITECTURAL SHEETS FOR THE PREVAILING CODES.

C CONTRACTOR AND SUBCONTRACTORS SHALL REVIEW A COMPLETE SET OF THE CONSTRUCTION DOCUMENTS.

D COORDINATE WORK WITH THE WORK OF OTHER TRADES, EQUIPMENT FURNISHED BY OTHERS, REQUIREMENTS OF THE OWNER, AND OF THE EXISTING CONDITIONS AT THE PROJECT SITE.

E DRAWINGS FOR THE MECHANICAL WORK ARE DIAGRAMMATIC, SHOWING THE GENERAL LOCATION, TYPE, LAYOUT, AND EQUIPMENT REQUIRED. THE DRAWING SHALL NOT BE SCALED FOR EXACT MEASUREMENTS, REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS. REFER TO MANUFACTURER'S STANDARD INSTALLATION DRAWINGS FOR EQUIPMENT CONNECTIONS AND INSTALLATION REQUIREMENTS. PROVIDE DUCTWORK, CONNECTIONS, OFFSETS, ACCESSORIES, AND MATERIALS NECESSARY FOR A COMPLETE SYSTEM.

F DUCT DIMENSIONS ON PLANS INDICATE DIMENSIONS OF INTERNAL FREE AREA.

G PERFORATED CEILING DIFFUSERS SHALL BE 4-WAY UNLESS NOTED OTHERWISE.

H COORDINATE ROOF WORK WITH THE OWNER'S CONSTRUCTION MANAGER PRIOR TO CONSTRUCTION.

I UNLESS NOTED OTHERWISE RECTANGULAR DUCT ELBOWS GREATER THAN 45° SHALL BE MITERED ELBOWS WITH DOUBLE-THICKNESS TURNING VANES AND RECTANGULAR DUCT ELBOWS 45° OR LESS SHALL BE RADIUSED ELBOWS WITH AN INSIDE RADIUS OF AT LEAST 1/2 THE WIDTH OF THE DUCT.

J REPLACE AIR FILTERS WITH NEW, CLEAN MERV 8 AIR FILTERS AT TURNOVER.

K THE TERM "FURNISH" MEANS SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS. THE TERM "INSTALL" DESCRIBES THE OPERATIONS AT THE PROJECT SITE INCLUDING THE ACTUAL UNLOADING, UNPACKING, ASSEMBLY, ERECTING, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, AND SIMILAR OPERATIONS. THE TERM "PROVIDE" MEANS TO FURNISH AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE.

L INSTALL LABELING CALLED FOR IN THE MECHANICAL DRAWINGS USING ENGRAVED PHENOLIC PLATES (WHITE WITH BLACK LETTERING).FURNISHED BY TSV.

M PROVIDE P3000 12 GA. UNISTRUT WITH PG FINISH FOR DUCT SUPPORTS AND OTHER UNISTRUT IN AREAS EXPOSED TO VIEW. SLOTTED UNISTRUT AND OTHER UNISTRUT WITH HOLES IS NOT ACCEPTABLE.

HVAC MATERIAL SCHEDULE

	APPLICATION	ALLOWABLE MATERIAL
DUCT		
	CONCEALED, GENERAL EXHAUST	RECT. OR ROUND AS SHOWN
	CONCEALED, RETURN	RECT. OR ROUND AS SHOWN, LINED OR INSULATED
	CONCEALED, SUPPLY	RECT. OR ROUND AS SHOWN, LINED OR INSULATED
	CONCEALED, TYPE I HOOD EXHAUST	RECTANGULAR 16 GA. BLACK IRON W/ WRAP OR UL 1978 FACTORY-MANUFACTURED DUCT W/ WRAP (SUBMIT SHOP DRAWINGS FOR FACTORY-MANUFACTURED DUCT PRIOR TO ORDERING FOR APPROVAL)
	EXPOSED GENERAL EXHAUST	RECTANGULAR, NO EXPOSED DUCT-SEALING MASTIC
	EXPOSED RETURN	RECTANGULAR, NO EXPOSED DUCT-SEALING MASTIC
	EXPOSED SUPPLY	RECT. LINED OR ROUND AS SHOWN, NO EXPOSED DUCT-SEALING MASTIC

HVAC ABBREVIATIONS

(E)	EXISTING
ABV	ABOVE
ADA	AMERICANS WITH DISABILITIES ACT
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHJ	AUTHORITY HAVING JURISDICTION
BFF	BELOW FINISHED FLOOR
BFG	BELOW FINISHED GRADE
BOH	BACK OF HOUSE
CLG	CEILING
CTE	CONNECT TO EXISTING
DN	DOWN
EXT'G	EXISTING
FLR	FLOOR
FOH	FRONT OF HOUSE
GYP	GYPSUM BOARD
NTS	NOT TO SCALE
O/H	OVERHEAD
OBD	OPPOSED BLADE DAMPER
TYP	TYPICAL
U/G	UNDERGROUND
UNO	UNLESS NOTED OTHERWISE
VFD	VARIABLE FREQUENCY DRIVE
VSC	VARIABLE SPEED CONTROLLER
W/	WITH
WIC	WALK-IN COOLER
CO2AS	TENANT'S CO2 ALARM SUPPLIER
GC	GENERAL CONTRACTOR
HES	TENANT'S HVAC EQUIPMENT SUPPLIER
HS	TENANT'S HOOD SUPPLIER
KES	TENANT'S KITCHEN EQUIPMENT SUPPLIER
LL	LANDLORD
MSS	TENANT'S MUSIC SYSTEMS SUPPLIER
SPS	TENANT'S SODA POP SUPPLIER
TAB	TENANT'S TEST AND BALANCE VENDOR
TCC	TENANT'S CABLING CONTRACTOR
TDC	TENANT'S DUCT CLEANER
TEMS	TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER
TLS	TENANT'S LIGHT/LAMP SUPPLIER
TMB	TENANT'S MENU BOARD SUPPLIER
TMS	TENANT'S MILLWORK SUPPLIER
TP	TENANT'S PHONE SUPPLIER
TPS	TENANT'S PANELBOARD SUPPLIER
TRS	TENANT'S RAILING SUPPLIER
TSV	TENANT'S SIGN VENDOR
TUV	TENANT'S UV SNAITIZER SUPPLIER
WCS	TENANT'S WALK-IN COOLER SUPPLIER
WHS	TENANT'S WATER HEATER SUPPLIER

HVAC SYMBOLS

CEILING DIFFUSER

CEILING-MOUNTED RETURN OR EXHAUST REGISTER

SUPPLY REGISTER

RETURN GRILLE

FLEXIBLE DUCT

MITERED CORNER WITH TURNING VANES

W/H — DUCTWORK INTERNAL FREE DIMENSIONS (WIDTH/HEIGHT) RECTANGULAR TO ROUND DUCT TRANSITION

S — DUCT-MOUNTED SMOKE DETECTOR

M — MOTOR-OPERATED DAMPER

MANUAL VOLUME DAMPER

GREASE DUCT CLEANOUT

MITERED CORNER WITHOUT TURNING VANES

T — GRIDPOINT THERMOSTAT

S — GRIDPOINT ZONE SENSOR MODULE

S — GRIDPOINT SUPPLY PROBE

— PLAN NOTE: SEE PLAN NOTES LISTED ON THE SAME SHEET FOR NOTE MEANING

CONNECT TO EXISTING

XX-# — EQUIPMENT TAG: SEE EQUIPMENT SCHEDULE ON SHEET M600 FOR EQUIPMENT INFORMATION

A/V — AUDIO/VISUAL REMOTE SMOKE DETECTOR ANNUNCIATOR WITH REMOTE KEY OPERATED RESET

12"ØCD1 / 550 — GRILL, REGISTER, OR DIFFUSER TAG: TAG, NECK SIZE, AIRFLOW [CFM]

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER — WALTER SHOUP — M 42319 — EXP 03/31/27 — MECHANICAL — STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.

230654

Contents:

HVAC SPECIFICATIONS

M010

STATE OF CALIFORNIA
Mechanical Systems
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-MCH-E
This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.4, or 141.0(b)2 for alterations.	
Project Name: CMG Greenbrae Sir Francis Drake	**Report Page:** **(Page 1 of 11)**
Project Address:	**Date Prepared:** 2025-02-24T16:26:16-05:00

A. GENERAL INFORMATION

01	Project Location (city)	Greenbrae	04	Total Conditioned Floor Area	2680
02	Climate Zone	2	05	Total Unconditioned Floor Area	0
03	Occupancy Types Within Project:		06	# of Stories (Habitable Above Grade)	1

● Restaurant

B. PROJECT SCOPE

This table includes mechanical systems or components that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.4, 170.2(b) or 141.0(b)2 and 180.2(b)2 for alterations.

01 Air System(s)	02 Wet System Components	03 Dry System Components
☒ Heating Air System	☐ Water Economizer	☒ Air Economizer
☒ Cooling Air System	☐ Pumps	☐ Electric Resistance Heat
Mechanical Controls	☐ System Piping	☒ Fan Systems
☒ Mechanical Controls (existing to remain, altered or new)	☐ Cooling Towers	☒ Ductwork (existing to remain, altered or new)
	☐ Chillers	☒ Ventilation
	☐ Boilers	☐ Zonal Systems/ Terminal Boxes

STATE OF CALIFORNIA
Mechanical Systems
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-MCH-E
Project Name: CMG Greenbrae Sir Francis Drake	**Report Page:** **(Page 2 of 11)**
	Date Prepared: 2025-02-24T16:26:16-05:00

C. COMPLIANCE RESULTS

Table C will indicate if the project data input into the compliance document is compliant with mechanical requirements. This table is not editable by the user. If this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D., or the table indicated as not compliant for guidance.

01		02		03		04		05		06		07		08	09
System Summary 110.1, 110.2, 140.4, 170.2(c)	AND	Pumps 140.4(k), 170.2(c)4I	AND	Fans/ Economizers 140.4(c), 140.4(e), 170.2(c)	AND	System Controls 110.2, 120.2, 140.4(f), 170.2(c)	AND	Ventilation 120.1, 160.2	AND	Terminal Box Controls 140.4(d), 170.2(c)4B	AND	Distribution 120.3, 140.4(j), 160.2, 160.3	AND	Cooling Towers 110.2(e)2	Compliance Results
(See Table F)		(See Table G)		(See Table H)		(See Table I)		(See Table J)		(See Table K)		(See Table L)		(See Table M)	
Yes	AND		AND	Yes	AND	Yes	AND	Yes	AND		AND	Yes	AND		COMPLIES with Exceptional Conditions
Mandatory Measures Compliance (See Table Q for Details)												COMPLIES			

D. EXCEPTIONAL CONDITIONS

This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

The permit applicant has indicated on Table J that ventilation calculations have been attached or included elsewhere on the plans.

E. ADDITIONAL REMARKS

This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

F. HVAC SYSTEM SUMMARY (DRY & WET SYSTEMS)

Space Conditioning System Information

01 System Name	02 Quantity	03 System Serving	04 System Status	05 Space Type	06 Utilizing Recovered Heat
RTU-1	1	Single zone	New/ Addition	Retail	☐

STATE OF CALIFORNIA
Mechanical Systems
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-MCH-E
Project Name: CMG Greenbrae Sir Francis Drake	**Report Page:** **(Page 3 of 11)**
	Date Prepared: 2025-02-24T16:26:16-05:00

F. HVAC SYSTEM SUMMARY (DRY & WET SYSTEMS)

Space Conditioning System Information

01 System Name	02 Quantity	03 System Serving	04 System Status	05 Space Type	06 Utilizing Recovered Heat
RTU-2	1	Single zone	New/ Addition	Retail	☐

Dry System Equipment Sizing (includes air conditioners, condensers, heat pumps, VRF, furnaces and unit heaters and DOAS systems)

01	02	03	04	05	06	07	08	09	10	11
Name or Item Tag	Equipment Category per Tables 110.2, 140.4(a)2 and 170.2(c)3aii	Equipment Type per Tables 110.2 and Title 20	Smallest Size Available[1] 140.4(a) and 170.2(c)1	Equipment Sizing per Mechanical Schedule (kBtu/h) 140.4(a&b), 170.2(c)1 & 170.2(c)2						
				Heating Output[2,3]			Cooling Output[2,3]		Load Calculations[3,4]	
				Per Design (kBtu/h)	Rated (kBtu/h)	Supp. Heating Output (kBtu/h)	Sensible Per Design (kBtu/h)	Rated (kBtu/h)	Total Heating Load (kBtu/h)	Total Sensible Cooling Load (kBtu/h)
RTU-1	Unitary AC/ Cond. (no elec. resistance)	AC, air-cooled pkg (3 phase)	Yes				71.12	93.4		67.6
RTU-2	Unitary AC/ Cond. (no elec. resistance)	AC, air-cooled pkg (3 phase)	Yes				46.17	62.01		44.6

[1] FOOTNOTES: Equipment shall be the smallest size, within the available options of the desired equipment line, necessary to meet the design heating and cooling loads of the building per 140.4(a) and 170.2(c)1. Healthcare facilities are excepted.
[2] It is common practice to show rated output capacity on the equipment schedule. Sensible cooling output comes from specification sheet tables.
[3] If equipment is heating only, leave cooling output and load blank. If equipment is cooling only, leave heating output and load blank.
[4] Authority Having Jurisdiction may ask for load calculations used for compliance per 140.4(b) and 170.2(c).

STATE OF CALIFORNIA
Mechanical Systems
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-MCH-E
Project Name: CMG Greenbrae Sir Francis Drake	**Report Page:** **(Page 4 of 11)**
	Date Prepared: 2025-02-24T16:26:16-05:00

F. HVAC SYSTEM SUMMARY (DRY & WET SYSTEMS)

Dry System Equipment Efficiency (other than Package Terminal Air Conditioners (PTAC) and Package Terminal Heat Pumps (PTHP), DX-DOAS and Dual Fuel Heat Pumps)

01	02	03	04	05	06	07	08	09
		Heating Mode				Cooling Mode		
Name or Item Tag	Size Category (Btu/h)	Rating Condition (°F)	Efficiency Unit	Minimum Efficiency Required per Tables 110.2 / Title 20	Design Efficiency	Efficiency Unit	Minimum Efficiency Required per Tables 110.2 / Title 20	Design Efficiency
RTU-1	>=65,000 and <135,000					EER IEER	11 14.6	11.2 15
RTU-2	<65,000					SEER	13	14

G. PUMPS

This section does not apply to this project.

STATE OF CALIFORNIA
Mechanical Systems
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-MCH-E
Project Name: CMG Greenbrae Sir Francis Drake	**Report Page:** **(Page 5 of 11)**
	Date Prepared: 2025-02-24T16:26:16-05:00

H. FAN SYSTEMS & AIR ECONOMIZERS

This table is used to demonstrate compliance with prescriptive requirements found in 140.4(c), 140.4(e), 140.4(m), 170.2(c)3, and 170.2(c)4A for fan systems. Fan systems serving only process loads are exempt from these requirements and do not need to be included in Table H.

System Name	RTU-1	Quantity	1	Fan System Status	New	System Zoning	all other systems	Serving Dwelling Units	Not Serving Dwelling Units	Fan System Airflow (cfm)	3,000	Site Elevation	55	Economizer	Differential Enthalpy
01	02	03	04			05		06	07	08	09			10	11
									Allowance		Design				
Fan Name or Item Tag	Fan Type	Qty	Component			Airflow through Component (%)		Water Gauge (w.g)	Component Allowance (watt/cfm)	Fan Allowance (watt/cfm)[1]	Design Electrical Input Power Method			Motor Nameplate Horsepower	Fan Electrical Input Power (kW)
RTU-1	Supply	1	Hydronic/DX cooling coil or heat pump coil			100			0.139	0.585	Manufacturer provided				1.1
			Air Blender			100			0.046						
			Gas heat			100			0.058						
			Filtration allowance for > MERV 16 or HEPA filter			100			0.342						
Supply Fan Base Allowance (watt/cfm)		0.232	Exhaust/Return/Relief/Transfer Fan Base Allowance(watt/cfm)					0	Fan System Allowance (kW)[3]		2.45		Fan System Electrical Input Power (kW)		1.1

STATE OF CALIFORNIA
Mechanical Systems
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-MCH-E
Project Name: CMG Greenbrae Sir Francis Drake	**Report Page:** **(Page 6 of 11)**
	Date Prepared: 2025-02-24T16:26:16-05:00

H. FAN SYSTEMS & AIR ECONOMIZERS

System Name	RTU-2	Quantity	1	Fan System Status	New	System Zoning	all other systems	Serving Dwelling Units	Not Serving Dwelling Units	Fan System Airflow (cfm)	2,000	Site Elevation	55	Economizer	Differential Enthalpy
01	02	03	04			05		06	07	08	09			10	11
									Allowance		Design				
Fan Name or Item Tag	Fan Type	Qty	Component			Airflow through Component (%)		Water Gauge (w.g)	Component Allowance (watt/cfm)	Fan Allowance (watt/cfm)[1]	Design Electrical Input Power Method			Motor Nameplate Horsepower	Fan Electrical Input Power (kW)
RTU-2	Supply	1	Hydronic/DX cooling coil or heat pump coil			100			0.139	0.527	Manufacturer provided				0.79
			Air Blender			100			0.046						
			Filtration allowance for > MERV 16 or HEPA filter			100			0.342						
Supply Fan Base Allowance (watt/cfm)			Exhaust/Return/Relief/Transfer Fan Base Allowance(watt/cfm)						Fan System Allowance (kW)[3]				Fan System Electrical Input Power (kW)		0.79

[1] FOOTNOTES: Fans serving spaces with design background noise goals below NC35
[2] Low-turndown single-zone VAV fan system must be capable of and configured to reduce airflow to 50 percent of design airflow and use no more than 30 percent of the design wattage at that airflow. No more than 10 percent of the design load served by the equipment shall have fixed loads.
[3] Fan system allowance includes fan system base allowance.
[4] Filter pressure loss can only be counted once per fan system.
[5] Complex Fan System means a fan system that combines a single cabinet fan system with other supply fans, exhaust fans, or both.
[6] Computer room economizers must meet requirements of 140.9(a) and will be documented on the NRCC-PRC-E document..

H. EXHAUST AIR HEAT RECOVERY 140.4(q), 170.2(c)4O

01	02	03	04	05	06	07	08	09	10	11

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-676-1108
WWW.BOWMAN.COM



COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

Revisions:

Drawn: BH | PM: AG | CC: WN | Checked: WS

Project No.
230654

Contents:
TITLE 24 FORMS

M011

H. EXHAUST AIR HEAT RECOVERY 140.4(q), 170.2(c)4O

Fan System Name	Qty	Hours of Operation per Year	Design Supply Airflow Rate	Outdoor Airflow	% Outdoor Air at Full Design Airflow	Exemptions to Exhaust Air Heat Recovery Requirement per 140.4(q) & 170.2(c)4O	Exhaust Air Heat Recovery 140.4(q) & 170.2(c)4O	Type Of Heat Recovery Rating	Required Recovery Ratio	Energy Recovery Bypass
RTU-1	1	>= 8,000	3,000	800	27	No Exemptions Apply	Not Required			
RTU-2	1	>= 8,000	2,000	700	35	No Exemptions Apply	Not Required			

Fan Energy Index (FEI)

01	02	03
Name or Item Tag	FEI Exception	FEI
RTU-1	Embedded Fan <5HP or <4.1kW	
RTU-2	Embedded Fan <5HP or <4.1kW	

I. SYSTEM CONTROLS

This table is used to demonstrate compliance with mandatory controls in 110.2 and 120.2 and prescriptive controls in 140.4(f) and (n), 170.2(c)4D 170.2(c)4L or requirements in 141.0(b)2E 180.2(b)2 for altered space conditioning systems.

01	02	03	04	05	06	07	08	09	10
System Name	System Zoning	Conditioned Floor Area Being Served (ft²)	Thermostats 110.2(b) & (c)[1], 120.2(a) 160.3(a)2A or 141.0(b)2E & 180.2(b)2	Shut-Off Controls 120.2(e) & 160.3(a)2D	Isolation Zone Controls 120.2(g) & 160.3(a)2F	Demand Response 110.12 120.2(b) & 160.3(a)2B	Supply Air Temp. Reset 140.4(f) & 170.2(c)4D	Window Interlocks per 140.4(n) & 170.2(c)4D	Direct Digital Control (DDC) per 120.2
RTU-1/RTU-2	Single zone	<= 25,000 ft²	Setback	Auto Timer Switch	NA: Single Zone	DR Tstat per 110.12	NA: Single Zone	NA: No operable windows	NA: Single Zone

[1]*FOOTNOTES: Gravity gas wall heaters, gravity floor heaters, gravity room heaters, non-central electric heaters, fireplaces or decorative gas appliances, wood stoves are not required to have setback thermostats.*

J. VENTILATION AND INDOOR AIR QUALITY

This table is used to demonstrate compliance with mandatory ventilation requirements in 120.1 120.2(e)3B 140.4(p) and 140.4(q) for all nonresidential and hotel/motel and d:\t24refnolink/]160.2, 160.3(a)3D, 170.2(a)4N, 170.2(a)4O for high-rise residential occupancies. For alterations, only ventilation systems being altered within the scope of the permit application need to be documented in this table. In lieu of this table, the required outdoor ventilation rates and airflows may be shown on the plans or the calculations can be presented in a spreadsheet.

01	☒	Check the box if the project is showing ventilation calculations on the plans, or attaching the calculations instead of completing this table.
02	☐	Check this box if the project included Nonresidential, Hotel/Motel Spaces or Multifamily Common Use Spaces
	☐	
03	☐	Check the box if the project is using natural ventilation in any nonresidential or hotel/motel spaces to meet required ventilation rates per 120.1(c)2.

K. TERMINAL BOX CONTROLS

This section does not apply to this project.

L. DISTRIBUTION (DUCTWORK and PIPING)

This table is used to show compliance with mandatory pipe insulation requirements found in 120.3 and mandatory requirements found in 120.4(g) for duct sealing.

01	☐	Insulation shall be protected from damage, including that due to sunlight, moisture, equipment maintenance, and wind. Insulation exposed to weather shall be installed with a cover suitable for outdoor service. Insulation covering chilled water piping and refrigerant suction piping located outside the conditioned space shall have a Class I or Class II vapor retarder. All penetrations and joints of which shall be sealed.

Duct Leakage Testing

The answers to the questions below apply to the following duct systems:	RTU-1/2	**NR/ Common Use:** Duct leakage testing shall not exceed 6% per NA7.5.3 required for these systems?	No

L. DISTRIBUTION (DUCTWORK and PIPING)

		Dwelling Units: Total duct leakage of duct system shall not exceed 12% or duct system to outside shall not exceed 6% per RA3.1.4 required for systems?	---
		Duct leakage testing per CMC Section 603.9.2 required for these systems?	Yes
11	No	The scope of the project includes only duct systems serving healthcare facilities	
12	Yes	Duct system provides conditioned air to an occupiable space for a constant volume, single zone, space-conditioning system.	
13	Yes	The space conditioning system serves less than 5,000 ft² of conditioned floor area.	
14	No	The combined surface area of the ducts is more than 25% of the total surface area of the entire duct system:	
15	No	The scope of the project includes extending an existing duct system, which is constructed, insulated or sealed with asbestos.	
16	No	The scope of the project includes an existing duct system that is documented to have been previously sealed as confirmed through field verification and diagnostic testing in accordance with procedures in the Reference Nonresidential Appendix NA2.	
17	Yes	All Ductwork and plenums with pressure class ratings shall be constructed to Seal Class A	
18	No	All ductwork is an extension of an existing duct system	
19	No	Ductwork serving individual dwelling unit	
20		< 25 ft of new or replacement space conditioning ducts installed	
21	R-8	Duct Insulation R-value	
22	No	Ductwork Existing To Remain	
23	No	Duct System Connected To Altered Space Conditioning System	

M. COOLING TOWERS

This section does not apply to this project.

N. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION

Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at https://www.energy.ca.gov/programs-and-topics/programs/building-energy-efficiency-standards/2022-building-energy-efficiency-4

Form/Title
NRCI-MCH-01-E - Must be submitted for all buildings

O. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in previous tables of this document. If any selection needs to be changed, please explain why in Table E Additional Remarks. These documents must be provided to the building inspector during construction and can be found online at https://www.energy.ca.gov/programs-and-topics/programs/building-energy-efficiency-standards/2022-building-energy-efficiency-4

Form/Title	Systems/Spaces To Be Field Verified
NRCA-MCH-02-A - Outdoor Air must be submitted for all newly installed HVAC units. Note: MCH-02-A can be performed in conjunction with MCH-07-A Supply Fan VFD Acceptance (if applicable) since testing activities overlap.	
NRCA-MCH-03-A - Constant Volume Single Zone HVAC NOTE: This form does not automatically move to "Yes'. If Constant Volume Single Zone HVAC Systems are included in the scope, permit applicant should move this form to "Yes".	RTU-1/RTU-2
NRCA-MCH-05-A - Air Economizer Controls	RTU-1; RTU-2

P. DECLARATION OF REQUIRED CERTIFICATES OF VERIFICATION

There are no NRCV forms required for this project.

Q. MANDATORY MEASURES DOCUMENTATION LOCATION

This table is used to indicate where mandatory measures are documented in the plan set or construction documentation.

01		02
Compliance with Mandatory Measures documented through MCH Mandatory Measures Note Block	Yes	Plan sheet or construction document location
		M012

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Brent Hoogland	Documentation Author Signature: Brent Hoogland
Company: Bowman Consulting Group	Signature Date: 02/24/2025
Address: 1490 W 121st Ave	CEA/ HERS Certification Identification (if applicable): N/A
City/State/Zip: Denver, CO 80234	Phone: (303)-678-1108

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

1. The information provided on this Certificate of Compliance is true and correct.
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: Walter Shoup	Responsible Designer Signature: Walter Shoup
Company: Bowman Consulting Group	Date Signed: 02/24/2025
Address: 1490 W 121st Ave	License: 42319
City/State/Zip: Denver, CO 80234	Phone: (303)-678-1108

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP 09/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.
230654

Contents:
TITLE 24 FORMS

M012

HVAC PLAN NOTES

1 SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR CEILING MOUNTED EQUIPMENT LOCATION. TYPICAL.

2 PAINT DUCTWORK VISIBLE THROUGH DINING ROOM SUPPLY REGISTERS BLACK. TYPICAL. ALL EXPOSED DUCTWORK (AND SUPPORTS) SHOULD BE PAINTED WHITE TO MATCH THE CEILING FINISH.

3 PENETRATIONS THROUGH SHEAR WALL SHALL BE LIMITED TO 10" DIAMETER (OR A GROUP OF PENETRATIONS ALL CONTAINED WITHIN 10" DIAMETER). IF LARGER PENETRATIONS OR GROUPS OF PENETRATIONS ARE REQUIRED COORDINATE WITH STRUCTURAL ENGINEER FOR APPROPRIATE BRACING. SEE STRUCTURAL DRAWINGS FOR SHEAR WALL LOCATION.

4 46/22 DUCT UP FOR TRANSITION TO RTU-1 RETURN CONNECTION IN ROOF CURB. RTU-1 SHALL HAVE AN INTEGRAL SMOKE DETECTOR MOUNTED IN THE RETURN AIR STREAM. INTERLOCK SMOKE DETECTOR TO RTU-1 OPERATION.

5 22/14 DUCT UP FOR TRANSITION TO RTU-2 RETURN CONNECTION IN ROOF CURB. RTU-2 SHALL HAVE AN INTEGRAL SMOKE DETECTOR MOUNTED IN THE RETURN AIR STREAM. INTERLOCK SMOKE DETECTOR TO RTU-2 OPERATION.

6 30/14 DUCT UP FROM BUILDING SUPPLY THROUGH ROOF. TRANSITION TO RTU-1 SUPPLY CONNECTION IN ROOF CURB.

7 18/18 DUCT UP THROUGH ROOF. RUN DUCT ON ROOF TO RTU-2 SUPPLY CONNECT. SEE ROOF PLAN FOR ROUTING INFORMATION.

8 14/14 DUCT UP THROUGH ROOF. TRANSITION TO MAU-1 SUPPLY CONNECTION IN ROOF CURB.

9 24/10 DUCT UP FROM HOOD THROUGH ROOF TO EF-1 COMPLIANT WITH NFPA 96. TRANSITION TO EXHAUST DROP SIZE IN CURB. PROVIDE RADIUSED ELBOWS WITH AN INSIDE RADIUS OF 0.5W AT ELBOWS IN GREASE DUCT.

10 8/6 DUCT UP THROUGH ROOF TO EF-2.

11 28/6 DUCT DOWN TO MAKEUP AIR PSP DUCT CONNECTION. TRANSITION TO SUPPLY PLENUM OPENING SIZE. TYPICAL FOR 3.

12 8" DIA. DUCT DOWN TO AC PSP DUCT CONNECTION. TRANSITION TO SUPPLY PLENUM OPENING SIZE. TYPICAL. CAP UNUSED DUCT CONNECTIONS.

13 INSTALL SINGLE-GANG VERTICAL J-BOX FOR GRIDPOINT THERMOSTATS FURNISHED BY TEMS FOR RTU-1 AND RTU-2 AT THIS LOCATION AT 48" AFF. COORDINATE WITH ELECTRICAL SWITCHING IN THIS AREA. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.

14 INSTALL GRIDPOINT ZONE SENSOR MODULE FURNISHED BY TEMS FOR RTU-1 AT THIS LOCATION 72" AFF DIRECTLY TO WALL (NO JUNCTION BOX). COORDINATE LOCATION WITH EQUIPMENT. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.

15 INSTALL GRIDPOINT ZONE SENSOR MODULE FURNISHED BY TEMS FOR RTU-2 AT THIS LOCATION 66" AFF DIRECTLY TO WALL (NO JUNCTION BOX). COORDINATE LOCATION WITH EQUIPMENT. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.

16 INSTALL GRIDPOINT SUPPLY PROBE FURNISHED BY TEMS FOR RTU-1 IN THE SUPPLY DUCTWORK UPSTREAM FROM THE FIRST BRANCH CONNECTION. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.

17 INSTALL GRIDPOINT SUPPLY PROBE FURNISHED BY TEMS FOR RTU-2 IN THE SUPPLY DUCTWORK UPSTREAM FROM THE FIRST BRANCH CONNECTION. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.

18 INSTALL REMOTE TEMPERATURE SENSOR FOR HOOD HD-1 AT THIS LOCATION 72" AFF. COORDINATE LOCATION WITH EQUIPMENT. PROVIDE (2) #18 G. THERMISTOR CABLE FROM TEMPERATURE SENSOR TO HOOD CONTROL PANEL.

19 INSTALL KITCHEN HOOD, HD-1. SUPPORT HOOD PER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL HOOD ACCORDING TO THE REQUIREMENTS OF ITS LISTING, IN COMPLIANCE WITH NFPA 96, THE BUILDING CODE, AND AUTHORITIES HAVING JURISDICTION. HOOD SHALL HAVE AN INTEGRAL DUCT COLLAR TEMPERATURE SENSOR TO AUTOMATICALLY ENERGIZE THE EXHAUST AND MAKEUP AIR FANS IF COOKING TEMPERATURES ARE DETECTED. EXHAUST DUCT SYSTEM TO BE WELDED OR FACTORY-MANUFACTURED WATER AND AIR TIGHT. INSTALL CLEANOUTS PER CODE AND AS SHOWN. INSTALL HOOD PER DETAILS 2, 4, AND 9/M700. CHIPOTLE WILL PROVIDE AN INDEPENDENT TESTING AGENCY FOR TESTING THE INTEGRITY OF THE GREASE DUCT SYSTEM.

HVAC PLAN NOTES

20 INSTALL REMOTE CONDENSING UNIT FOR WALK-IN COOLER ON ROOF AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL REFRIGERANT LINE SET, THERMOSTATIC EXPANSION VALVE, SOLENOID VALVE, TEMPERATURE CONTROL, SIGHT GLASS, FILTER DRIER, PRESSURE CONTROL, LOW AMBIENT CONTROLS, AND WEATHERPROOF HOUSING. TRAP AND SLOPE REFRIGERANT LINES PER MANUFACTURER'S RECOMMENDATIONS. INSTALLATION SHALL COMPLY WITH ASHRAE/ANSI STANDARD 15. INSTALL THE REFRIGERANT LINE SET UNDER THE ROOF DECK TO WITHIN 3' OF THE CONDENSING UNIT. CUT 2-1/2" HOLE IN WALK-IN COOLER ROOF FOR REFRIGERANT LINE SET AND SEAL PER THE COOLER MANUFACTURER'S INSTALLATION INSTRUCTIONS AFTER LINE SET IS INSTALLED.

21 INSTALL REMOTE CONDENSER FOR ICE MACHINE ON ROOF AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL REFRIGERANT LINE SET, THERMOSTATIC EXPANSION VALVE, SOLENOID VALVE, TEMPERATURE CONTROL, SIGHT GLASS, FILTER DRIER, PRESSURE CONTROL, LOW AMBIENT CONTROLS, AND WEATHERPROOF HOUSING. TRAP AND SLOPE REFRIGERANT LINES PER MANUFACTURER'S RECOMMENDATIONS. SEAL PIPING PENETRATIONS THROUGH ROOF. INSTALLATION SHALL COMPLY WITH ASHRAE/ANSI STANDARD 15. INSTALL THE REFRIGERANT LINE SET UNDER THE ROOF DECK TO WITHIN 3' OF THE REMOTE CONDENSER. IF REFRIGERANT PIPING TO ICE MAKER IS EXPOSED TO PUBLIC VIEW CONCEAL WITHIN A STAINLESS STEEL SHROUD AS SHOWN IN THE ARCHITECTURAL DRAWINGS.

22 INSTALL ROOFTOP EQUIPMENT PER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS.

23 INSTALL EXHAUST FAN EF-1 PER DETAIL 5/M700 AND AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL GREASE VIROGUARD SYSTEM FURNISHED BY CHIPOTLE ON EXHAUST FAN, EF-1.

24 PROVIDE SUPPLY DIFFUSER CONNECTION TO SUPPLY SYSTEM PER DETAIL 1/M700. TYPICAL.

25 PROVIDE AUDIO/VISUAL REMOTE SMOKE DETECTOR ANNUNCIATOR WITH REMOTE KEY OPERATED RESET. WIRE A UNIT BACK TO EACH SMOKE DETECTOR. MOUNT UNIT 60" AFF. TYPICAL.

26 INSTALL REME HALO AIR PURIFIER FURNISHED BY TUV IN RTU PER DETAIL 6/M700. SEE ELECTRICAL DRAWINGS FOR POWER CONNECTION INFORMATION. INSTALL UV WARNING STICKERS ON FACE OF ENCLOSURE PER DETAIL AND ON ANY RTU ACCESS DOOR(S) THROUGH WHICH THE REME HALO WOULD BE VISIBLE IF OPENED.

27 MAINTAIN 10' CLEARANCE BETWEEN WATER HEATER FLUE TERMINATION AND OUTSIDE AIR INTAKES. MAINTAIN 10' CLEARANCE BETWEEN WATER HEATER COMBUSTION AIR INTAKE AND EXHAUST FAN EF-1 DISCHARGE. SEE PLUMBING DRAWINGS FOR MORE INFORMATION ON WATER HEATER FLUE AND COMBUSTION AIR TERMINATIONS.

28 ADJUST SUPPLY REGISTERS SO THAT SUPPLY AIR IS EVENLY DISTRIBUTED THROUGHOUT THE SPACE. ADJUST THE NORTH (PLAN-SOUTH) SUPPLY REGISTERS SO THAT SUPPLY AIR HITS EXTERIOR WALL AT APPROXIMATELY 7' AFF. DO NOT POSITION SUPPLY REGISTERS IN ANY MANNER THAT AN AIR DRAFT CAN BE FELT.

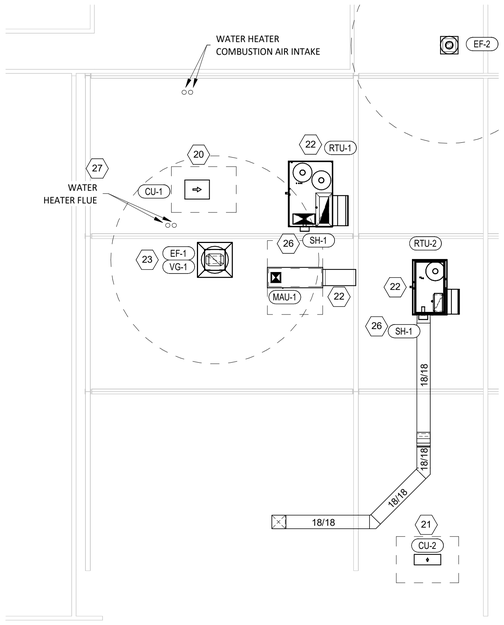

2 M100 **HVAC ROOF PLAN**
1/8" = 1'-0"

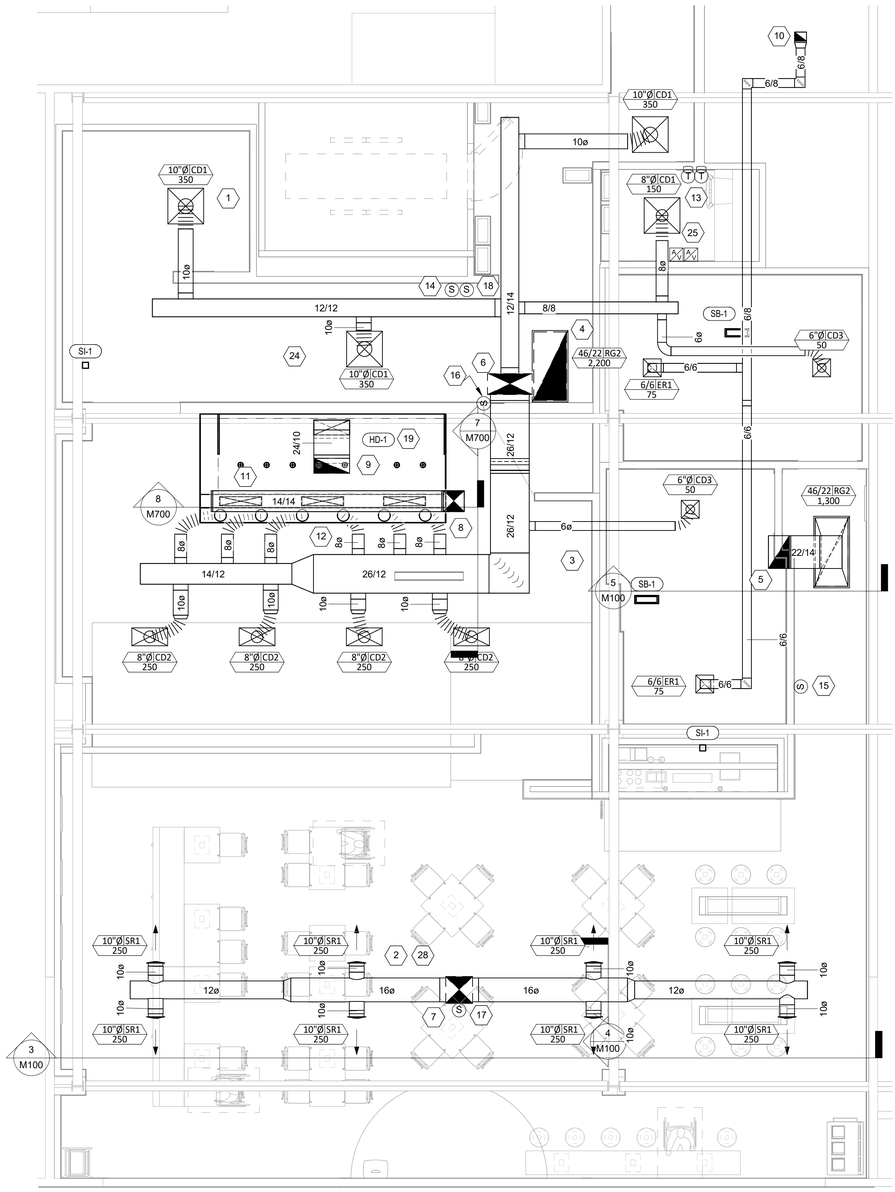

1 M100 **HVAC FLOOR PLAN**
1/4" = 1'-0"

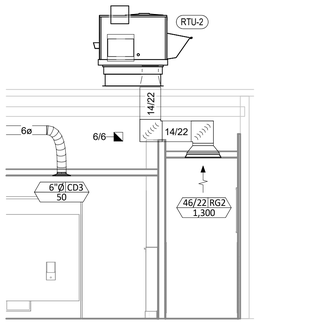

5 M100 **HVAC DINING ROOM RETURN SECTION**
1/4" = 1'-0"



4 M100 **HVAC DINING ROOM SECTION**
1/4" = 1'-0"

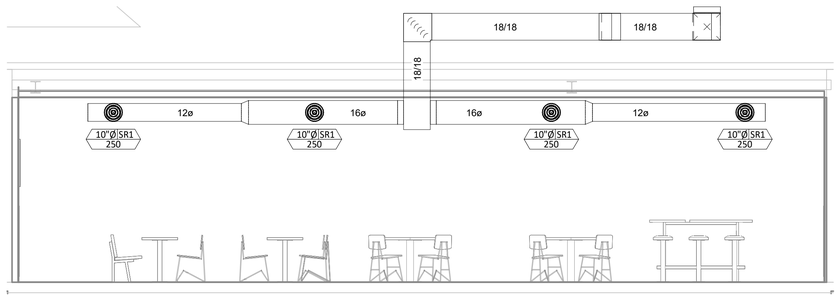

3 M100 **HVAC DINING ROOM SECTION**
1/4" = 1'-0"

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP. 03/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.
230654

Contents:
HVAC PLAN

M100

Ventilation Calculations

Ventilation Calculations Comply with: ASHRAE 62.1

Room Name	Room Area	Room Type	Number of People	CFM/Person	CFM/sqft	Total Required OA CFM	Total Provided OA CFM
RTU-1							
Dining	903	Dining rooms	64	7.5	0.18	643	**645**
Utensil	42	Dining rooms	3	7.5	0.18	31	**30**
Passage	80	Corridors	0	0	0.06	5	**5**
Total						**679**	**680**
RTU-2							
POS	135	Kitchens (cooking)b	3	7.5	0.12	39	**40**
Serving	54	Dining rooms	4	7.5	0.18	40	**40**
Cooking	466	Kitchens (cooking)b	10	7.5	0.12	131	**130**
Kitchen	228	Kitchens (cooking)b	5	7.5	0.12	65	**65**
Office	46	Office spaces	1	5	0.06	8	**10**
Total						**283**	**285**

SANITIZING EQUIPMENT SCHEDULE

TAG	COUNT	DESCRIPTION	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
					MANUFACTURER	MODEL	
SB-1	2	BATHROOM AIR PURIFICATION UNIT	TUV	GC	RGF ENVIRONMENTAL GROUP	BRU ASSEMBLY	SEE ELECTRICAL SHEETS FOR CONNECTION INFORMATION
SH-1	2	HVAC AIR PURIFICATION UNIT	TUV	GC	RGF ENVIRONMENTAL GROUP	REME-HALO	SEE DETAIL 6/M700 FOR INSTALLATION INFORMATION.
SI-1	2	ICE MACHINE TREATMENT SYSTEM	TUV	GC	RGF ENVIRONMENTAL GROUP	IMS-B-GA	SEE PLUMBING DRAWINGS FOR INSTALLATION INFORMATION.

FAN SCHEDULE

TAG	DESCRIPTION	AIRFLOW	E.S.P.	WEIGHT	ELECTRICAL		FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
					MOTOR POWER	V/P/H			MANUFACTURER	MODEL	
EF-1	UPBLAST UL762 EXHAUST FAN	2,550 CFM	1.45 in-wg	199 lb	2 hp	208/3/60	HS	GC	CAPTIVE-AIRE	DU180HFA	DIRECT DRIVE UL762 UPBLAST EXHAUST FAN FURNISHED WITH WEATHERPROOF DISCONNECT AND VENTED ROOF CURB
EF-2	DOWNBLAST RESTROOM EXHAUST FAN	150 CFM	0.60 in-wg	50 lb	0.25 hp	120/1/60	HS	GC	CAPTIVE-AIRE	DR12HFA	DIRECT DRIVE DOWNBLAST RESTROOM EXHAUST FAN FURNISHED WITH INTEGRAL DISCONNECT, SPEED CONTROL, BACKDRAFT DAMPER, AND CURB

VIROGUARD SCHEDULE

TAG	COUNT	DESCRIPTION	DUCT CONNECTION SIZE	FAN	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN MANUFACTURER
VG-1	1	VIROGUARD HOOD EXHAUST FAN ROOFTOP CONTAINMENT SYSTEM	16" X 16"	CAPTIVE-AIRE DU180HFA	TDC	GC	ENVIROMATIC

CONDENSING UNIT SCHEDULE

TAG	DESCRIPTION	NOMINAL CAPACITY	NUMBER OF		REFRIGERANT		WEIGHT	ELECTRICAL			FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
			COMPRESSORS	CIRCUITS	TYPE	CHARGE		MOCP	FLA	V/P/H			MANUFACTURER	MODEL	
CU-1	CONDENSING UNIT - WALK-IN COOLER		1	1	R-404A	10.4 lb	250 lb	15 A	9 A	208/3/60	WCS	GC	HARFORD	KPCL99MZOP-3E	FURNISHED WITH WALK-IN COOLER
CU-2	REMOTE CONDENSER - LOW CAPACITY ICE MAKER		0	1	R-404A	11.46 lb	100 lb			120/1/60	KES	GC	HOSHIZAKI	URC-9FZ	FURNISHED WITH ICE MAKER

MAKEUP AIR UNIT SCHEDULE

TAG	DESCRIPTION	AIRFLOW	E.S.P.	HEATING			WEIGHT	ELECTRICAL		FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
				INPUT	OUTPUT	EAT		MOTOR POWER	V/P/H			MANUFACTURER	MODEL	
MAU-1	DIRECT-FIRED MAKEUP AIR UNIT	1,300 CFM	0.50 in-wg	78,010 Btu/h	71,769 Btu/h	21 °F	507 lb	1 hp	208/3/60	HS	GC	CAPTIVE-AIRE	A1-D.250-15D	12.5:1 MAX TURNDOWN. FURNISHED WITH DISCONNECT, ROOF CURB, SCREEN INTAKE, AND WASHABLE ALUMINUM FILTERS

KITCHEN HOOD SCHEDULE

TAG	DESCRIPTION	MAX COOKING TEMP.	EXHAUST PLENUM						PERFORATED SUPPLY PLENUMS										NO. OF LIGHT FIXTURES	WEIGHT	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
					DUCT COLLARS						MAU PLENUM				AC PLENUM										
												DUCT COLLARS				DUCT COLLARS									
			AIRFLOW	E.S.P.	NO.	WIDTH	LENGTH	LENGTH	WIDTH	LENGTH	WIDTH	AIRFLOW	NO.	WIDTH	LENGTH	AIRFLOW	NO.	DIAMETER					MANUFACTURER	MODEL	
HD-1	TYPE I CANOPY HOOD WITH PERFORATED MAU AND AC SUPPLY PLENUMS	600 °F	2,550 CFM	0.97 in-wg	1	10"	2' - 0"	12' - 9"	4' - 3"	13' - 9"	1' - 7"	1,300 CFM	3	6"	2' - 4"	700 CFM	6	8"	8	1,150 lb	HS	GC	CAPTIVE-AIRE	5424 ND-2-ACPSP-F	MAT'L: 18 GA. TYPE 430 SS. FURNISHED WITH VERTICAL END PANELS, VAPORPROOF INCANDESCENT LIGHT FIXTURES, 16" TALL HE SS FILTERS, INTEGRAL UTILITY CABINET, ANSUL SYSTEM, DUCT COLLAR TEMPERATURE SENSOR, PREWIRE PACKAGE, SPARE FIRE SYSTEM DRY CONTACT, AND 4-POLE 20A CONTACTOR

ROOFTOP UNIT SCHEDULE

TAG	DESCRIPTION	NOMINAL CAPACITY	EER	AIRFLOW			NET COOLING CAPACITY					HEATING CAPACITY			NUMBER OF		REFRIGERANT		WEIGHT	ELECTRICAL			FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
									EAT		COND.									MOCP	FLA	V/P/H					
				TOTAL	OA	E.S.P.	TOTAL	SENSIBLE	DB	WB	EAT	INPUT	OUTPUT	EAT	COMPRESSORS	CIRCUITS	TYPE	CHARGE							MANUFACTURER	MODEL	
RTU-1	CARRIER ROOFTOP UNIT	7.5 ton	11.2	3,000 CFM	800 CFM	0.80 in-wg	93,400 Btu/h	71,120 Btu/h	80 °F	67 °F	95 °F	125,000 Btu/h	103,000 Btu/h	70 °F	2	2	R-454B	15 lb	1,047 lb	45 A	39 A	208/3/60	HES	GC	CARRIER	48FEDM08B2M5-8WAC0	RA SMOKE DETECTOR, AL/CU - AL/CU - LOUVERED HAIL GUARDS, MERV-13 HIGH EFFICIENT FILTERS, ULTRA LOW LEAK ENTY ECONOMIZERONE WITH BAROMETRIC RELIEF, SMOKE DETECTOR REMOTE TEST/RESET/ALARM INDICATOR KIT, HORN/STROBE ANNUNCIATOR WITH CLEAR COLORED LENS, ENTHALPY/DIFFERENTIAL DRY BULB SENSOR FOR POL224 CONTROLLER (ECONOMIZERONE) ONLY, 14 INCH TALL ROOF CURB
RTU-2	CARRIER ROOFTOP UNIT	5 ton	11.2	2,000 CFM	700 CFM	0.80 in-wg	62,010 Btu/h	46,170 Btu/h	80 °F	67 °F	95 °F	60,000 Btu/h	49,000 Btu/h	70 °F	1	1	R-454B	15 lb	771 lb	45 A	31 A	208/3/60	HES	GC	CARRIER	48FEGA06B2M5-8WAC0	ULTRA LOW NOX LOW HEAT, RA SMOKE DETECTOR, AL/CU - AL/CU - LOUVERED HAIL GUARDS, MERV 13 HIGH EFFICIENT FILTERS, ULTRA LOW LEAK ENTY ECONOMIZERONE WITH BAROMETRIC RELIEF, SMOKE DETECTOR REMOTE TEST/RESET/ALARM INDICATOR KIT, HORN/STROBE ANNUNCIATOR WITH CLEAR COLORED LENS, ENTHALPY/DIFFERENTIAL DRY BULB SENSOR, 14 INCH TALL ROOF CURB

AIR BALANCE SCHEDULE

TAG	SUPPLY FLOW	RETURN FLOW	EXHAUST FLOW	SUBTOTAL
EF-1	0 CFM	0 CFM	2,550 CFM	-2,550 CFM
EF-2	0 CFM	0 CFM	150 CFM	-150 CFM
MAU-1	1,300 CFM	0 CFM	0 CFM	1,300 CFM
RTU-1	3,000 CFM	2,200 CFM	0 CFM	800 CFM
RTU-2	2,000 CFM	1,300 CFM	0 CFM	700 CFM
NET PRESSURIZATION				100 CFM

AIR TERMINAL SCHEDULE

TAG	DESCRIPTION	FACE SIZE	MATERIAL	FINISH	MOUNTING	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		NOTES
								MANUFACTURER	MODEL	
CD1	PERFORATED CEILING DIFFUSER	24" X 24"	ALUMINUM	WHITE	LAY-IN CEILING	GC	GC	NAILOR	4320A TYPE L	PROVIDE WITH INTEGRAL OBD
CD2	PERFORATED CEILING DIFFUSER	24" X 12"	ALUMINUM	WHITE	LAY-IN CEILING	GC	GC	NAILOR	4320A TYPE L	PROVIDE WITH INTEGRAL OBD, REMOVE 4-WAY DEFLECTORS
CD3	PERFORATED CEILING DIFFUSER	12" X 12"	ALUMINUM	WHITE	SURFACE MOUNT	GC	GC	NAILOR	4320A TYPE S	PROVIDE WITH INTEGRAL OBD
ER1	PERFORATED CEILING EXHAUST	12" X 12"	ALUMINUM	WHITE	SURFACE MOUNT	GC	GC	NAILOR	4330R TYPE S	PROVIDE INTEGRAL OBD
RG2	PERFORATED CEILING RETURN	48" X 24"	ALUMINUM	WHITE	SURFACE MOUNT	GC	GC	NAILOR	4330R TYPE S	
SR1	ADJUSTABLE TURBO NOZZLE	SEE NECK SIZE	ALUMINUM	WHITE	WALL	GC	GC	AIR CONCEPTS	ANR-10	PROVIDE WITH CONCEALED MOUNTING AND FACE-ACCESSIBLE OBD

CONTROL FUNCTIONS

A. THE MAIN COOKING EXHAUST FAN AND MAKE-UP AIR UNIT SHALL BE INTERLOCKED TO OPERATE TOGETHER. THIS CONTROL CIRCUIT IS ACTIVATED BY A SWITCH AND INCLUDES A FIRE PROTECTION OVERRIDE.
B. THE TEMPERATURE IN EACH ZONE IS CONTROLLED BY SPACE TEMPERATURE SENSORS CONNECTED TO THE THERMOSTATS LOCATED IN THE OFFICE. ALL ZONES SHALL OPERATE WITH CONTINUOUS FAN OPERATION DURING OCCUPIED TIMES AND INTERMITTENTLY AS NEEDED TO MAINTAIN SET POINTS DURING UNOCCUPIED TIMES. OUTSIDE AIR DAMPERS SHALL BE OPEN CONTINUOUSLY WHEN EITHER IN OCCUPIED MODE OR WHEN THE HOOD SYSTEM IS ON AND SHALL BE CLOSED DURING UNOCCUPIED PERIODS.
C. THE THERMOSTATS SHALL DETERMINE OCCUPIED/UNOCCUPIED STATUS BASED ON THE SCHEDULE IN THE ENERGY MANAGEMENT SYSTEM.

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP 03/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.

230654

Contents:

HVAC SCHEDULES

M600

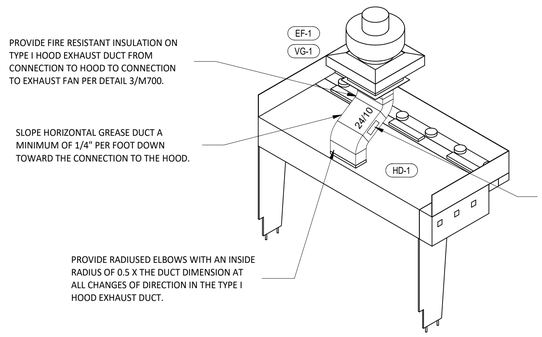

9 M700 **HOOD EXHAUST ISOMETRIC**
NOT TO SCALE

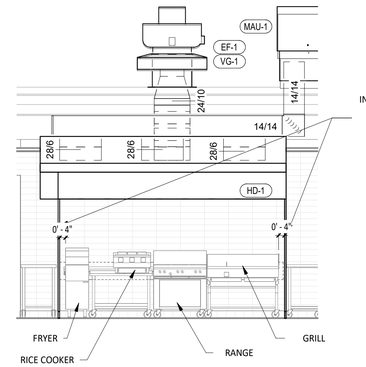

8 M700 **HOOD ELEVATION**
1/4" = 1'-0"

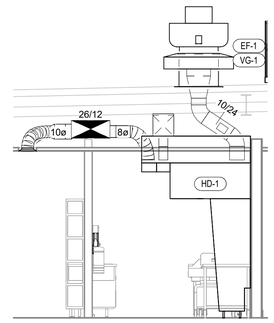

7 M700 **DUCT SECTION AT HOOD**
1/4" = 1'-0"

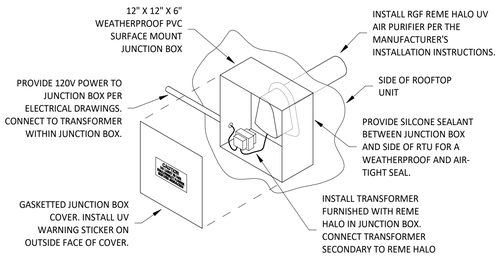

INSTALLATION LOCATION
INSTALL AIR PURIFIER WITH JUNCTION BOX ON OUTSIDE FACE OF ROOFTOP UNIT AND WITH UV LAMP TUBE EXTENDING INTO THE INTERIOR OF THE ROOFTOP UNIT. FIELD VERIFY EXACT LOCATION TO AVOID DAMAGING, TOUCHING, OR INTERFERING WITH ANY RTU INTERIOR COMPONENTS. INSTALLATION LOCATION SHALL BE AS FOLLOWS:

TRANE: INSTALL INTO THE SUPPLY AIR STREAM THROUGH THE REMOVABLE PANEL COVERING THE HORIZONTAL DISCHARGE SUPPLY AIR OPENING.

YORK: INSTALL INTO THE SUPPLY AIR PLENUM FROM THE BACK SIDE OF THE UNIT JUST ABOVE THE HEAT EXCHANGER.

6 M700 **UV AIR PURIFIER INSTALLATION**
NOT TO SCALE

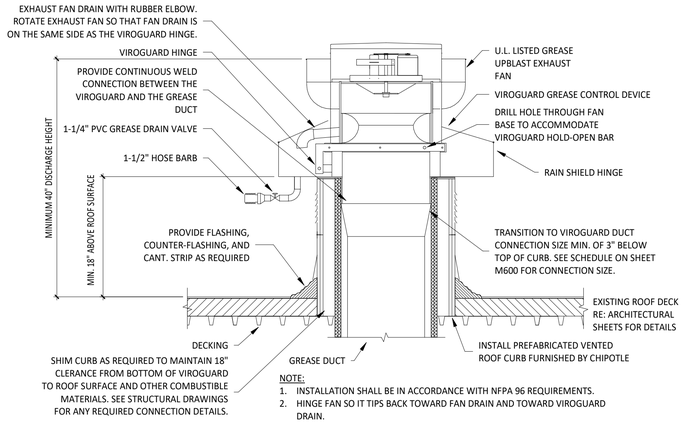

NOTE:
1. INSTALLATION SHALL BE IN ACCORDANCE WITH NFPA 96 REQUIREMENTS.
2. HINGE FAN SO IT TIPS BACK TOWARD FAN DRAIN AND TOWARD VIROGUARD DRAIN.

5 M700 **GREASE EXHAUST FAN**
NOT TO SCALE

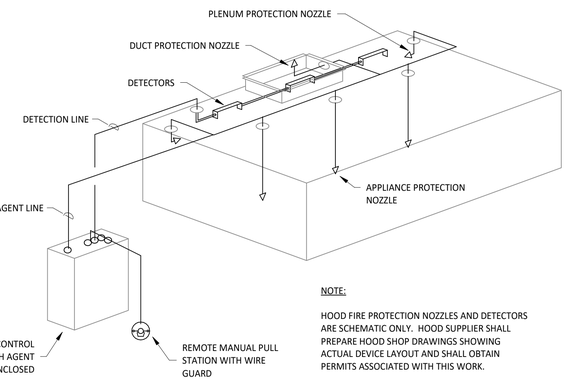

NOTE:
HOOD FIRE PROTECTION NOZZLES AND DETECTORS ARE SCHEMATIC ONLY. HOOD SUPPLIER SHALL PREPARE HOOD SHOP DRAWINGS SHOWING ACTUAL DEVICE LAYOUT AND SHALL OBTAIN PERMITS ASSOCIATED WITH THIS WORK.

4 M700 **FIRE SUPPRESSION SYSTEM SCHEMATIC**
NOT TO SCALE

FIRE RATED ENCLOSURE - GREASE DUCTS

1. THERMAL CERAMICS FIREMASTER FASTWRAP XL IS TESTED TO ASTM E2336 AND UL LISTED PER HNKT.G18 TO PROVIDE ZERO CLEARANCE TO COMBUSTIBLES AND TO PROVIDE A 1- OR 2-HOUR ENCLOSURE. THROUGH PENETRATIONS FIRESTOP SYSTEMS ARE TESTED IN ACCORDANCE WITH ASTM E 814 (UL 1479). ICC CODE EVALUATION PER REPORT UL ER 14229-01.
2. COMPLIANT TO THE FOLLOWING CODES:
   NFPA 96
   INTERNATIONAL MECHANICAL CODES
   UNIFORM MECHANICAL CODE.
   CALIFORNIA MECHANICAL CODE
3. INSULATION APPLIED IN TWO LAYERS WITH TIGHT COMPRESSION JOINT ON BOTH LAYERS AT ALL JOINTS.
4. MINIMUM 16 GAUGE CARBON STEEL (OR 18 GAGE STAINLESS STEEL) RECTANGULAR OR ROUND GREASE EXHAUST DUCT
5. INSTALL UL LISTED AND LIQUID TIGHT THERMAL CERAMICS FASTDOOR XL ACCESS DOORS, OR ALTERNATE DOOR UL LISTED PER UL1978, AT ALL CHANGES IN DIRECTION AND AT MINIMUM EVERY 20 FT ON HORIZONTAL RUNS.
6. SUPPORT HANGER SYSTEMS DO NOT NEED TO BE WRAPPED PROVIDED THE HANGER RODS ARE MINIMUM OF 3/8 IN. DIAMETER AND SUPPORTS ARE MINIMUM 2 X 2 X 1/8 IN. STEEL ANGLE OR SMACNA EQUIVALENT SUPPORT SYSTEM.
7. THERMAL CERAMICS DUCT WRAP SHALL BE INSTALLED DIRECTLY ONTO THE DUCT AND APPLIED FROM THE HOOD CONNECTION TO THE CONNECTION TO THE FAN.
8. THERMAL CERAMICS DUCT ENCLOSURE SYSTEM SHALL BE INSTALLED IN STRICT ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS AND UL LISTINGS.

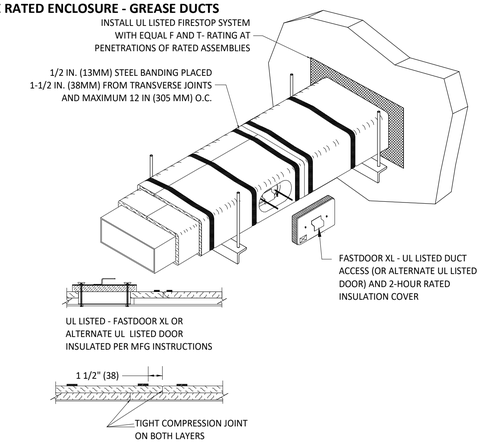

3 M700 **FIREMASTER DUCT WRAP - UL HNKT-G18**
NOT TO SCALE

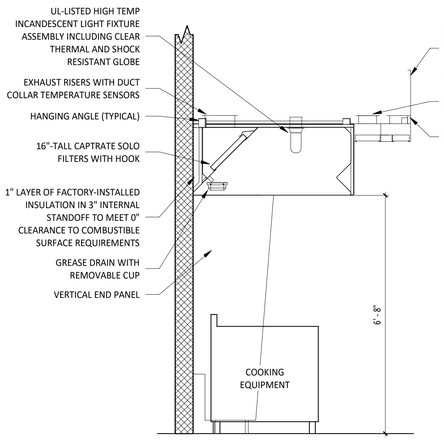

2 M700 **HOOD SECTION VIEW**
NOT TO SCALE

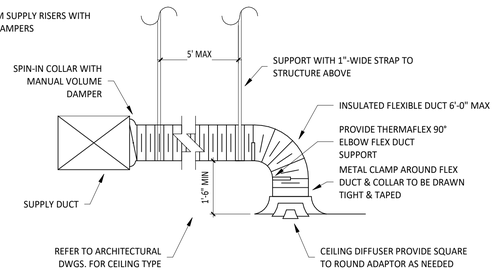

NOTE:
1. METHOD OF INSTALLATION FOR AIRTIGHT SEAL IS TYPICAL FOR ALL FLEX CONNECTIONS TO AIR DISTRIBUTION DEVICES.

1 M700 **DIFFUSER CONNECTION**
NOT TO SCALE

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP 03/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.
230654

Contents:
HVAC DETAILS

M700

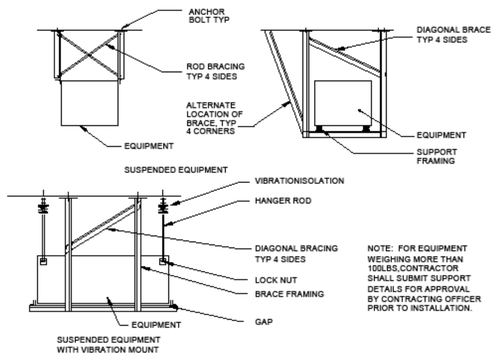

2 M701 SIESMIC RESTRAINTS AND SUPPORTS FOR EQUIPMENT

NOT TO SCALE

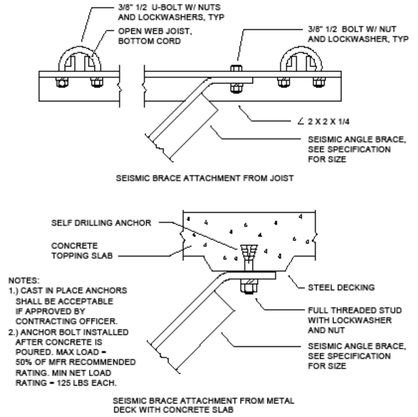

1 M701 SIESMIC ANGLE BRACE DETAIL

NOT TO SCALE

4 M701 SIESMIC SWAY BRACE DETAIL

NOT TO SCALE

3 M701 SIESMIC RESTRAINTS FOR MECHANICAL EQUIPMENT

NOT TO SCALE

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP 03/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.
230654

Contents:
HVAC SEISMIC DETAILS

M701

FOR QUESTIONS, CALL THE
Highwinds Group
REGION #5
PHONE: 707-864-7119 ~ 0420
EMAIL: mgill@captiveaire.com

PATENT NUMBERS
AC-PSP (UNITED STATES) - US PATENT 7963830 B2.
AC-PSP WALL/CANADA - CA PATENT 2505030.
AC-PSP ISLAND/CANADA - CA PATENT 2505036.

HOOD INFORMATION – JOB#7185483

HOOD NO	TAG	MODEL	MANUFACTURER	LENGTH	WALK COOKING TEMP	TYPE	APPLIANCE DUTY	DESIGN CFM/FT	TOTAL CFM	EXHAUST PLENUM SIZING				MUA CFM	AC CFM	HOOD CONSTRUCTION	HOOD CONFIG. END (1)	END (2)
										WIDTH	LENG	HEIGH	SP					
1		5424 WD-2-ACPSP-F	CAPTIVEAIRE	12' 9"	500 DEG	1	HEAVY	200	2550	10"	24"	4"	2550	1530	-0.966"	1300	696	430 SS WHERE EXPOSED	ALONE	ALONE

HOOD INFORMATION

HOOD NO	TAG	TYPE	QTY	FILTER(S) HEIGHT	LENGTH	EFFICIENCY @ 7 MICRONS	QTY	LIGHT(S)	WIRE GUARD	LOCATION	SIZE	UTILITY CABINET(S) FIRE SYSTEM TYPE	SIZE	ELECTRICAL MODEL #	SWITCHES QUANTITY	FIRE PIPING	HOOD WEIGHT
1		CAPTRATE SOLID FILTER	9	16"	16"	85% SEE FILTER SPEC	9	LSS SERIES E26	NO	LEFT	12"x54"x24"	TANK FS	4.0/4.0	SC-3101039PA	1 LIGHT 1 FAN	YES	1313 LBS

HOOD OPTIONS

HOOD NO	TAG	OPTION
1		FIELD WRAPPER 1030" HIGH FRONT, LEFT, RIGHT.
		INSULATION FOR BACK OF HOOD.
		RISER SENSOR INSTALL 4IN PLEN.
		RIGHT VERTICAL END PANEL 27" TOP WIDTH, 21" BOTTOM WIDTH, 88" HIGH INSULATED 430 SS.
		LEFT VERTICAL END PANEL 27" TOP WIDTH, 21" BOTTOM WIDTH, 88" HIGH INSULATED 430 SS.
		FULL DIMENSION HANGING BRACKET - FRONT.

PERFORATED SUPPLY PLENUM(S)

HOOD NO	TAG	POS	LENGTH	WIDTH	HEIGHT	TYPE	RISER(S) WIDTH	LENG	DIA	CFM	SP
1		Front	165"	19"	6"	RUA	6"	28"		430	0.027"
						RUA	6"	28"		430	0.027"
						RUA	6"	28"		430	0.027"
						AC		8"	106	0.043"
						AC		8"	106	0.043"
						AC		8"	106	0.043"
						AC		8"	106	0.043"
						AC		8"	106	0.043"
						AC		8"	106	0.043"

CLEARANCE TO COMBUSTIBLES

HOODS #	SURFACE	*CLEARANCE
1	TOP	18"
	FRONT	0"
	BACK	0"
	LEFT	0"
	RIGHT	18"

* 457 CLEARANCE TO COMBUSTIBLES CONFORMS TO UL710 STANDARDS

- HOOD MOUNTED UTILITY CABINETS REQUIRE 36" SERVICE CLEARANCE.

SPECIFICATION: CAPTRATE® GREASE-STOP® SOLID FILTER

THE CAPTRATE GREASE-STOP SOLID FILTER IS A SINGLE-STAGE FILTER FEATURING A UNIQUE S-BAFFLE DESIGN IN CONJUNCTION WITH A SLOTTED REAR BAFFLE DESIGN, TO DELIVER EXCEPTIONAL FILTRATION EFFICIENCY.

FILTER IS STAINLESS STEEL CONSTRUCTION, AND SIZED TO FIT INTO STANDARD FILTER RACK OPENINGS.

UNITS SHALL INCLUDE STAINLESS STEEL HANDLES AND A FASTENING DEVICE TO SECURE THE TWO COMPONENTS WHEN ASSEMBLED.

GREASE EXTRACTION EFFICIENCY PERFORMANCE SHALL REMOVE AT LEAST 75% OF GREASE PARTICLES FIVE MICRONS IN SIZE, AND 85% GREASE PARTICLES SEVEN MICRONS IN SIZE AND LARGER, WITH A CORRESPONDING PRESSURE DROP NOT TO EXCEED 1.0 INCHES OF WATER GAUGE.

THE CAPTRATE GREASE-STOP SOLID WAS TESTED TO ASTM STANDARD ASTM F2519-05, "STANDARD TEST METHOD FOR GREASE FILTERS USED IN SOLID FUEL BURNING APPLIANCES".

EFFICIENCY VS. PARTICLE DIAMETER



PRESSURE DROP VS. FLOW RATE



CAPTRATE FILTERS ARE BUILT IN COMPLIANCE WITH: NFPA #96, NSF STANDARD #2, IMC 507.2.1 & 507.2.2, IMC MECH CODE 1304.1, ULC-S649.



ASSEMBLY INSTRUCTIONS

HANGING ANGLE MUST BE SUPPORTED WITH 1/2" - 13 TPI GRADE 5 (MINIMUM) ALL-THREAD, SANDWICH HANGING ANGLES AT EACH END AND EVERY 4' (MAX.) WITH 1/2" GRADE 5 (MINIMUM) STEEL FLAT WASHERS AND 1/2" - 13 TPI GRADE 5 (MINIMUM) HEX NUTS AS SHOWN. MUST USE DOUBLED HEX NUT CONFIGURATION ABOVE CEILING ANCHORS. SINGLE HEX NUT BENEATH HANGING ANGLE IS ACCEPTABLE. USE HEX NUTS BENEATH BOTTOM HEX NUT TO MAINTAIN 1/4" OF EXPOSED THREADS BENEATH BOTTOM HEX NUT. TORQUE ALL HEX NUTS TO 57 FT-LBS.

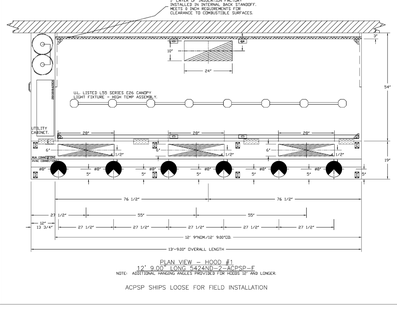
1" LAYER OF INSULATION FACTORY INSTALLED IN BOTTOM BACK OF CANOPY. CLEARANCE TO COMBUSTIBLE SURFACES.
10 - LISTED LSS SERIES E26 CANOPY LIGHT FIXTURE - HIGH TEMP ASSEMBLY
UTILITY CABINET
54"
19"
12" SPACING @ 12" SPACING @ 12" SPACING @ 12" SPACING @ 12" SPACING @ 12" SPACING @
6" 6" 6" 6" 6" 6" 6" 6" 6" 6" 6" 6" 6" 6"
24" 24" 24" 24" 24" 24" 24" 24" 24" 24" 24" 24" 24" 24"
6" 6" 6" 6" 6" 6" 6" 6" 6" 6" 6" 6" 6" 6



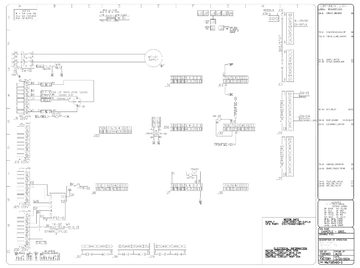



CAPTIVEAIRE
Highwoods Group
4641 Paragon Park Rd. Raleigh, NC. 27616 PHONE: (919) 875 - 0420 FAX: (919)790-0077 EMAIL: raygo@captiveaire.com
www.captiveaire.com

REVISIONS

DESCRIPTION	DATE
1	
2	
3	
4	

CHIPOTLE - GREENBRAE (Sr Francis Drake) CA
GREENBRAE, CA, 94904

DATE: 11/22/2024

DWG.#: 7185483

DRAWN BY:

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 5

ELECTRICAL PACKAGE - JOB#7185483

NO	TAG	PACKAGE #	LOCATION	SWITCHES: LOCATION	SWITCHES: QUANTITY	OPTION	FANS CONTROLLED: FAN TAG	FANS CONTROLLED: TYPE	FANS CONTROLLED: #	FANS CONTROLLED: HP	FANS CONTROLLED: VOLT/PH	FANS CONTROLLED: F.L.A
1		SC-3010MA	UTILITY CABINET LEFT	UTILITY CABINET LEFT - HOOD # 1	1 LIGHT 1 FAN	SMART CONTROLS THERMOSTATIC CONTROL W/ RELAY ON/OFF, WITH SUPPLY	EF-1	EXHAUST	3	3.000	208	7.5
							MAU-1	SUPPLY	3	3.000	208	7.5

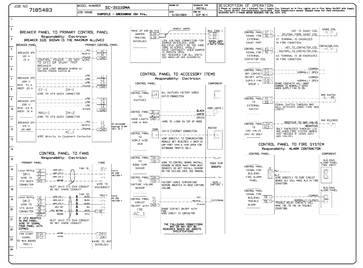

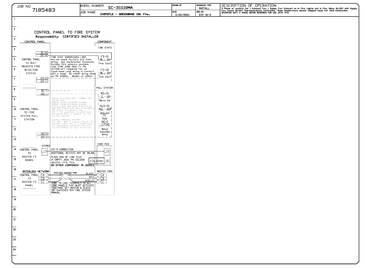

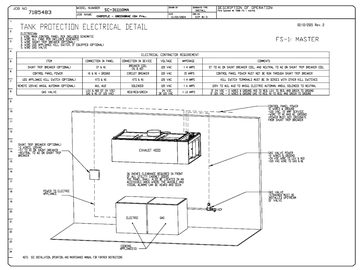

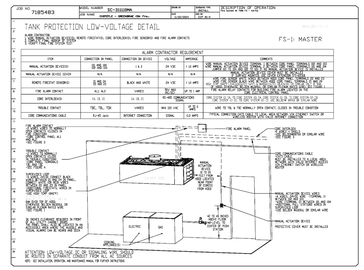

CAPTIVEAIRE
Highwoods Group
4641 Paragon Park Rd. Raleigh, NC. 27616 PHONE: (919) 875 - 0420 FAX: (919)790-0077 EMAIL: raygo@captiveaire.com
www.captiveaire.com

REVISIONS

DESCRIPTION	DATE
1	
2	
3	
4	

CHIPOTLE - GREENBRAE (Sr Francis Drake) CA
GREENBRAE, CA, 94904

DATE: 11/22/2024

DWG.#: 7185483

DRAWN BY:

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 6

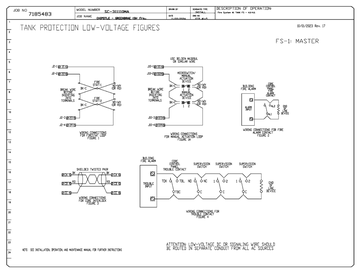

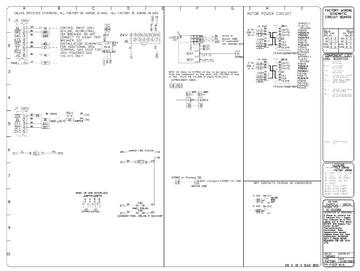

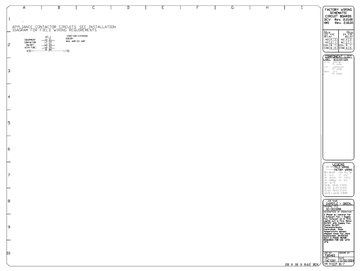

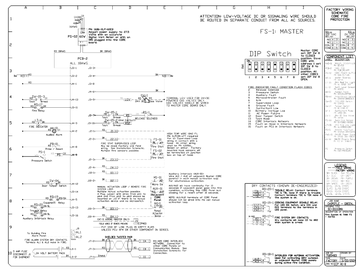

CAPTIVEAIRE
Highwoods Group
4641 Paragon Park Rd. Raleigh, NC. 27616 PHONE: (919) 875 - 0420 FAX: (919)790-0077 EMAIL: raygo@captiveaire.com
www.captiveaire.com

REVISIONS

DESCRIPTION	DATE
1	
2	
3	
4	

CHIPOTLE - GREENBRAE (Sr Francis Drake) CA
GREENBRAE, CA, 94904

DATE: 11/22/2024

DWG.#: 7185483

DRAWN BY:

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 7

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP. 03/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.

230654

Contents:

CAPTIVEAIRE SHOP DRAWINGS

M703

SECTION 15055 - COMMON PIPING REQUIREMENTS
PART 1 - GENERAL
A. SECTION REQUIREMENTS
1. Comply with the requirements of the Building Code and the local authority having jurisdiction.
PART 2 - PRODUCTS
2.1 SUPPORTING DEVICES
A. Hanger and Pipe Attachments: Factory fabricated with galvanized coatings; nonmetallic coated for hangers in direct contact with copper tubing.
B. Building Attachments: Powder actuated type, drive pin attachments with pullout and shear capacities appropriate for supported loads and building materials; UL listing and FM approval for fire protection systems.
C. Mechanical Anchor Fasteners: Insert-type attachments with pullout and shear capacities appropriate for supported loads and building materials; UL listing and FM approval for fire protection systems.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install piping free of sags and bends.
B. Install fittings for changes in direction and branch connections.
C. Install sleeves for pipes passing through concrete and masonry walls, gypsum board partitions, and concrete floor and roof slabs.
D. Exterior Wall, Pipe Penetrations: Mechanical sleeve seals installed in steel or cast iron pipes for wall sleeves.
E. Fire Barrier Penetrations: Seal pipe penetrations with through-penetration firestop systems.
F. Install unions adjacent to each valve and at final connection to each piece of equipment.
G. Install dielectric unions and flanges to connect piping materials of dissimilar metals in gas piping.
H. Install dielectric coupling and nipple fittings to connect piping materials of dissimilar metals in water piping.
I. Provide full ring escutcheons at plumbing penetrations through walls or ceilings. Tightly seal escutcheons to the adjacent surface.
3.2 HANGERS AND SUPPORTS
A. Install building attachments within concrete or to structural steel. Install additional attachments at concentrated loads, including valves, flanges, guides, strainers, expansion joints, and at changes in direction of piping.
B. Install powder actuated drive pin fasteners in concrete after concrete is cured. Do not use in lightweight concrete or in slabs less than 4 inches thick.
C. Install mechanical anchor fasteners in concrete after concrete is cured. Do not use in lightweight concrete or in slabs less than 4 inches thick.
D. Support fire protection system piping independent of other piping.
E. Load Distribution: Install hangers and supports so piping live and dead loading and stresses from movement will not be transmitted to connected equipment.
END OF SECTION 15055

SECTION 15080 - MECHANICAL INSULATION
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals: None.
B. Quality Assurance: Labeled with maximum flame-spread rating of 25 and maximum smoke developed rating of 50 according to ASTM E 84.
PART 2 - PRODUCTS
2.1 PIPE INSULATION
A. Preformed Glass Fiber Pipe Insulation: ASTM C 547, Class 1, with factory applied, all purpose, vapor retarder jacket.
B. Polyolefin Pipe Insulation: Unicellular polyethylene, preformed pipe insulation. Comply with ASTM C 534, Type I, except for density.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install vapor barriers on insulated pipes with surface operating temperatures below 60 deg F.
B. Insulate fittings, valves, and specialties.
C. Seal vapor barrier penetrations for hangers, supports, anchors, and other projections.
D. Coat glass fiber pipe insulation ends with vapor barrier coating.
E. Roof Penetrations: Apply insulation for interior applications to a point even with the top of the roof flashing.
F. Exterior Wall Penetrations: For penetrations of below grade exterior walls, terminate insulation flush with mechanical sleeve seal.
G. Interior Walls and Partitions Penetrations: Apply insulation continuously through walls and partitions, except fire rated walls and partitions.
H. Fire Rated Walls and Partitions Penetrations: Terminate insulation at penetrations through fire rated walls and partitions. Seal around penetration with through penetration firestop systems.
I. Floor Penetrations: Terminate insulation at the underside of the floor assembly and at the floor support at top of floor. Seal around penetration with through penetration firestop systems.
J. Glass Fiber Insulation Installation: Bond insulation to pipe with adhesive. Seal seams and joints with vapor barrier compound.
K. Interior Piping System Applications: Insulate the following piping systems:
1. Domestic cold, hot, and recirculation water pipes.
2. Exposed sanitary drains and water supply pipes for public hand sinks.
3. Refrigerant piping.
L. Do not apply insulation to the following systems, materials, and equipment:
1. Flexible connectors.
2. Fire protection piping systems.
3. Sanitary drainage and vent piping.
4. Chrome plated pipes and fittings, except for plumbing fixtures for the disabled.
5. Piping specialties, including air chambers, unions, strainers, check valves, plug valves, and flow regulators.
M. Pipe Insulation Thickness Application Schedule: Insulate piping with the following materials and thicknesses:
1. Domestic Hot and Recirculation water pipes: 1-inch preformed glass fiber pipe insulation.
2. Domestic Cold Water: 1/2-inch preformed glass fiber pipe insulation.
3. P-Trap and Fixture Supplies for public hand sinks: ADA-compliant pre-formed insulation.
END OF SECTION 15080

SECTION 15110 - VALVES
PART 1 - GENERAL (Not Applicable)
PART 2 - PRODUCTS
2.1 GENERAL DUTY VALVES
A. End Connections: Threads shall comply with ANSI B1.20.1. Flanges shall comply with ANSI B16.1 for cast iron valves and ANSI B16.24 for bronze valves. Solder-joint connections shall comply with ANSI B16.18.
B. Ball Valves: Rated for 150 psig saturated steam pressure, 400 psig WOG pressure; 2 piece construction; with bronze body, standard (or regular) port, chrome plated brass ball, replaceable "Teflon" or "TFE" seats and seals, blowout proof stem, and vinyl covered steel handle.
C. Plug Valves: Rated at 150 psig WOG; bronze body, with straightaway pattern, square head, and threaded ends.
D. Swing Check Valves: Class 125, cast bronze body and cap; with horizontal swing, Y-pattern, and bronze disc.
E. Valves for Copper Tube: Solder ends, except provide threaded ends for heating hot water and low pressure steam service.
F. Valves for Steel Pipe: Threaded ends.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Use gate and ball valves for shutoff duty and ball for throttling duty.
B. Locate valves for easy access and provide separate support where necessary.
C. Install accessible valves for each fixture and item of equipment.
D. Install valves in horizontal piping with stem at or above center of pipe.
E. Install valves in a position to allow full stem movement.
F. Install check valves for proper direction of flow in horizontal position with hinge pin level.
END OF SECTION 15110

SECTION 15140 - DOMESTIC WATER PIPING
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Performance Requirements: Unless otherwise indicated minimum pressure requirements for water piping are as follows:
1. Service Entrance Piping: 100 psig.
2. Domestic Water Piping: 80 psig.
B. Comply with NSF 14 "Plastic Piping Components and Materials."
C. Comply with NSF 61 "Drinking Water System Components -- Health Effects."
PART 2 - PRODUCTS
2.1 PIPES AND TUBES (See Material Schedule on sheet P010 for where these materials are to be used)
A. Hard Copper Tube: ASTM B 88, Types L and M, water tube, drawn temper.
B. PVC Plastic, Water Pipe: ASTM D 1785, Schedule 80, plain ends.
2.2 FITTINGS
A. Wrought Copper, Solder Joint Pressure Fittings: ASME B 16.22.
B. Cast Copper Alloy, Solder Joint Pressure Fittings: ASME B 16.18.
C. Bronze Flanges: ASME B 16.24, Classes 150 and 300.
D. Copper Unions: ASME B 16.18, cast copper alloy body, hexagonal stock, with ball and socket joint, metal to metal seating surfaces, and solder joint, threaded, or solder joint and threaded ends. Threads complying with ASME B 1.20.1.
E. PVC Plastic, Schedule 80, Socket Type Pipe Fittings: ASTM D 2467.
2.3 JOINING MATERIALS
A. Solder Filler Metal: ASTM B 32, lead free.
B. Brazing Filler Metals: AWS A5.8, alloys to suit system requirements.
C. Solvent Cements: As recommended by manufacturer.
D. Plastic Pipe Seals: ASTM F 477, elastomeric gasket.
PART 3 - EXECUTION
3.1 VALVE APPLICATIONS
A. Install gate valves close to main on each branch and riser serving two or more plumbing fixtures or equipment connections and where indicated.
B. Install gate or ball valves on inlet to each plumbing equipment item, on each supply to each plumbing fixture not having stops on supplies, and elsewhere as indicated.
C. Install drain valve at base of each riser, at low points of horizontal runs, and where required to drain water distribution piping system.
D. Install swing check valve on discharge side of each pump and elsewhere as indicated.
E. Install ball valves in each hot water circulating loop and discharge side of each pump.
3.2 PIPING INSTALLATIONS
A. Install hangers and supports at intervals indicated in the applicable plumbing code and as recommended by pipe manufacturer.
B. Support vertical piping at each floor.
3.3 INSPECTING AND CLEANING
A. Inspect and test piping systems following procedures of authorities having jurisdiction.
B. Clean and disinfect water distribution piping following procedures of authorities having jurisdiction.
END OF SECTION 15140

SECTION 15150 - SANITARY WASTE AND VENT PIPING
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Minimum Pressure Requirement for Soil, Waste and Vent: 10 feet head.
B. Comply with NSF 14 "Plastic Piping Components and Related Materials".
PART 2 - PRODUCTS
2.1 PIPES AND TUBES
A. PVC Plastic, DWV Pipe: ASTM D 2665, Schedule 40, plain ends.
2.2 FITTINGS
A. PVC Plastic, DWV Pipe Fittings: ASTM D 2665, made to ASTM D 3311; socket type; drain, waste, and vent pipe patterns.
PART 3 - EXECUTION
3.1 PIPING INSTALLATION
A. Install cleanout and extension to grade at connection of building sanitary drain and building sanitary sewer.
B. Locate drainage piping runouts as close as possible to bottom of floor slab supporting fixtures or drains.
3.2 INSPECTION
A. Inspect and test piping systems following procedures of authorities having jurisdiction.
END OF SECTION 15150

SECTION 15198 - NATURAL GAS PIPING
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Quality Assurance: Comply with NFPA 54 and the Plumbing Code.
PART 2 - PRODUCTS
2.1 PIPE, TUBE, AND SPECIALTIES
A. Steel Pipe: ASTM A 53, Type S (Seamless), Grade B, Schedule 40, plain ends.
B. Malleable Iron Threaded Fittings: ASME B16.3, Class 150.
C. Manual Valves: Comply with standards listed or, if appropriate, to ANSI Z21.15.
D. Gas Stops: AGA certified, bronze-body, plug type with bronze plug, for 2-psig or less natural gas. Include AGA stamp, flat or square head or lever handle, and threaded ends complying with ASME B1.20.1.
E. Gas Valves: 150-psig WOG, cast-iron or bronze body, bronze plug, straightaway pattern, square head, tapered-plug type.
F. Gas Pressure Regulators: ANSI Z21.18, single stage, steel jacketed, corrosion resistant pressure regulators. Include atmospheric vent, elevation compensator. Regulator pressure ratings, inlet and outlet pressures, and flow volume in cubic feet per hour of natural gas at specific gravity are as indicated.
G. Line Gas Pressure Regulators: Inlet pressure rating not less than system pressure.
H. Flexible Connectors: ANSI Z21.24, copper alloy.
I. Strainers: Bronze body, Y-pattern, full size of connecting piping. Include stainless-steel screens with 3/64 inch perforations and a pressure rating of 125-psig- minimum, WOG working pressure.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Close equipment shutoff valves before turning off gas to premises or section of piping. Perform leakage test as specified to determine that all equipment is turned off in affected piping section.
B. Install shutoff valve, downstream from gas meter, outside building at gas service entrance.
C. Install gas stops for shutoff to appliances with NPS 2" or smaller low pressure gas supply.
D. Drips and Sediment Traps: Install drips at points where condensate may collect. Include outlets of gas meters. Locate where readily accessible to permit cleaning and emptying. Do not install where condensate would be subject to freezing.
E. Install gas piping at uniform slope of 0.1 percent upward toward risers.
F. Connect branch piping from top or side of horizontal piping.
G. Install strainers on supply side of each control valve, gas pressure regulator, solenoid valve, and elsewhere as indicated.
H. Install valves in accessible locations, protected from damage.
I. Install gas valve upstream from each gas pressure regulator. Where two gas-pressure regulators are installed in series, valve is not required at second regulator.
J. Connect gas piping to equipment and appliances with shutoff valves and unions. Install gas valve upstream from and within 36 inches of each appliance using gas. Install union or flanged connection downstream from valve.
K. Inspect, test, and purge piping according to NFPA 54, Part 4, "Gas Piping Inspection, Testing, and Purging", and requirements of authorities having jurisdiction.
END OF SECTION 15198

SECTION 15410 - PLUMBING FIXTURES
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
Submittals: None.
A. Comply with requirements of Public Law 102-486, "Energy Policy Act", regarding water flow rate and water consumption of plumbing fixtures.
B. Comply with applicable standards below:
1. Enameled, Cast Iron Fixtures: ASME A112.19.1M.
2. National Sanitation Foundation Construction: NFS2.
3. Porcelain Enameled Fixtures: ASME A112.19.4M.
4. Slip Resistant Bathing Surfaces: ASTM F 462.
5. Stainless Steel Fixtures: ASME A112.19.3M.
6. Vitreous China Fixtures: ASME A112.19.2M.
PART 2 - PRODUCTS
2.1 Refer to the fixture schedule on drawing P600
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install fixtures with flanges and gasket seals.
B. Install flushometer valves for accessible water closets and urinals with handle mounted on wide side of compartment. Install other actuators in locations that are easy for the disabled to reach.
C. Fasten wall hanging plumbing fixtures securely to supports attached to building substrate when supports are specified, and to building wall construction where no support is indicated.
D. Fasten floor mounted fixtures to substrate. With fixtures having holes for securing fixture to wall construction, fasten to reinforcement built into walls.
E. Fasten wall mounted fittings to reinforcement built into walls.
F. Fasten counter mounted plumbing fixtures to casework.
G. Secure supplies to supports or substrate within pipe space behind fixture.
H. Set mop basins in leveling bed of cement grout.
I. Install individual supply inlets, supply stops, supply risers, and tubular brass traps with cleanouts at fixture.
J. Install water supply stop valves in accessible locations.
K. Install traps on fixture outlets. Omit traps on fixtures having integral traps. Omit traps on indirect wastes, unless otherwise indicated or required by the Authority Having Jurisdiction.
L. Install full-ring escutcheons at wall, floor, and ceiling penetrations in exposed, finished locations and within cabinets and millwork. Use deep pattern escutcheons where required to conceal protruding pipe fittings.
M. Install piping connections between plumbing fixtures and piping systems and plumbing equipment. Install insulation on supplies and drains of fixtures for the disabled.
N. Ground equipment. Tighten electrical connectors and terminals according to UL 486A and UL 486B.
END OF SECTION 15410

SECTION 15554 - FLUES AND VENTS
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals: None.
PART 2 - PRODUCTS
2.1 GAS VENTS
A. Vent/air intake for high efficiency domestic water heater. Follow manufacturer's recommendations for sizing and material.
B. Accessories: Tees, elbows, increasers, draft hood connectors, metal cap with bird barrier, adjustable roof flashing, storm collar, support assembly, thimbles, firestopping spacers, and fasteners; fabricated of similar materials and designs as vent-pipe straight sections.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install vents according to stipulated minimum clearances from combustibles.
B. Seal between sections of positive pressure vents using only sealants recommended by manufacturer.
C. Support vents at intervals to support the weight of the vent and all accessories, without exceeding loading of appliances.
END OF SECTION 15554

PLUMBING ABBREVIATIONS

(E)	EXISTING
ABV	ABOVE
ADA	AMERICANS WITH DISABILITIES ACT
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHJ	AUTHORITY HAVING JURISDICTION
BFF	BELOW FINISHED FLOOR
BFG	BELOW FINISHED GRADE
BOH	BACK OF HOUSE
CLG	CEILING
CTE	CONNECT TO EXISTING
CW	DOMESTIC COLD WATER
DN	DOWN
EXT'G	EXISTING
FCO	FLOOR CLEANOUT
FD	FLOOR DRAIN
FLR	FLOOR
FOH	FRONT OF HOUSE
FS	FLOOR SINK
FW	DOMESTIC FILTERED COLD WATER
GCO	GRADE CLEANOUT
GI	GREASE INTERCEPTOR
GT	GREASE TRAP
GW	GREASE WASTE
GYP	GYPSUM BOARD
HW	DOMESTIC HOT WATER
NTS	NOT TO SCALE
O/H	OVERHEAD
SAN	SANITARY WASTE

PLUMBING ABBREVIATIONS

ST	STORM SEWER
SW	DOMESTIC SOFTENED COLD WATER
TYP	TYPICAL
U/G	UNDERGROUND
UNO	UNLESS NOTED OTHERWISE
W/	WITH
WIC	WALK-IN COOLER
C02AS	TENANT'S CO2 ALARM SUPPLIER
GC	GENERAL CONTRACTOR
HES	TENANT'S HVAC EQUIPMENT SUPPLIER
HS	TENANT'S HOOD SUPPLIER
KES	TENANT'S KITCHEN EQUIPMENT SUPPLIER
LL	LANDLORD
MSS	TENANT'S MUSIC SYSTEMS SUPPLIER
SPS	TENANT'S SODA POP SUPPLIER
TAB	TENANT'S TEST AND BALANCE VENDOR
TCC	TENANT'S CABLING CONTRACTOR
TDC	TENANT'S DUCT CLEANER
TEMS	TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER
TLS	TENANT'S LIGHT/LAMP SUPPLIER
TMB	TENANT'S MENU BOARD SUPPLIER
TMS	TENANT'S MILLWORK SUPPLIER
TP	TENANT'S PHONE SUPPLIER
TPS	TENANT'S PANELBOARD SUPPLIER
TRS	TENANT'S RAILING SUPPLIER
TSV	TENANT'S SIGN VENDOR
TUV	TENANT'S UV SNAITIZER SUPPLIER
WCS	TENANT'S WALK-IN COOLER SUPPLIER
WHS	TENANT'S WATER HEATER SUPPLIER

PLUMBING SYMBOLS

ELBOW UP
ELBOW DOWN
DOMESTIC COLD WATER
DOMESTIC FILTERED COLD WATER
DOMESTIC SOFTENED COLD WATER
DOMESTIC HOT WATER (110 DEGREES)
DOMESTIC HOT WATER RECIRC.
GAS
GAS (ON ROOF)
SANITARY WASTE
GREASE WASTE
SANITARY VENT
CONDENSATE DRAIN
PLAN NOTE: SEE PLAN NOTES LISTED ON THE SAME SHEET FOR NOTE MEANING
CONNECT TO EXISTING
REDUCED PRESSURE ZONE BACKFLOW PREVENTER
WATER METER
GAS METER
EQUIPMENT TAG: SEE EQUIPMENT SCHEDULE ON SHEET P600 FOR EQUIPMENT INFORMATION
VALVE
SOLENOID-OPERATED VALVE
WALL HYDRANT/ROOF HYDRANT
CHECK VALVE
CIRCUIT-SETTER BALANCE VALVE RATED FOR POTABLE WATER
FLOOR DRAIN
FLOOR SINK
CLEANOUT

PLUMBING GENERAL NOTES

A GENERAL NOTES APPLY TO PLUMBING SHEETS.
B PLUMBING WORK SHALL BE DONE IN ACCORDANCE WITH THE PLUMBING CODE, LOCAL HEALTH DEPARTMENT STANDARDS, AND THE AUTHORITY HAVING JURISDICTION. SEE ARCHITECTURAL SHEETS FOR THE PREVAILING CODES.
C PIPING LAYOUTS ON DRAWINGS ARE SCHEMATIC. EXACT LOCATIONS ARE TO BE COORDINATED WITH THE EXISTING CONDITIONS AND THE WORK OF OTHER TRADES.
D CONCEAL PIPING UNLESS NOTED OTHERWISE. WATER SUPPLY PIPES SHALL BE INSTALLED LEVEL.
E PROVIDE SHUT-OFF VALVES FOR ISOLATION OF FIXTURE GROUPS AS SHOWN ON DRAWINGS IN ADDITION TO STOP VALVES AT EACH FIXTURE.
F PROVIDE STOP VALVES AT FIXTURES.
G PROVIDE TRAP PRIMERS FOR FLOOR DRAINS AS SHOWN ON SHEET P100.
H WHERE THE WATER OR GAS SUPPLY LINE SIZE SHOWN IN THE PLUMBING DIAGRAMS DIFFERS FROM THE FIXTURE OR EQUIPMENT CONNECTION SIZE, PROVIDE LINE SIZE PIPE TO WITHIN 6" OF THE FIXTURE OR EQUIPMENT BEFORE TRANSITIONING TO THE CONNECTION SIZE.
I PIPING IN EXTERIOR WALLS SHALL BE INSTALLED BETWEEN THE INSULATION AND THE INTERIOR WALL FINISHING MATERIAL.
J INSULATE THE HOT AND COLD WATER, CONDENSATE DRAINAGE, AND STORM PIPING PER THE SPECIFICATIONS AND DETAIL 8/P700.
K PROVIDE GAS SHUT-OFF VALVES AT EACH PIECE OF EQUIPMENT. PROVIDE ACCESSIBLE DIRT LEG AT THE BOTTOM OF VERTICAL SECTIONS OF GAS PIPE AND AT THE CONNECTION TO EACH PIECE OF EQUIPMENT.
L PLUMBING FIXTURES, ACCESSORIES, AND MATERIALS PROVIDED FOR DOMESTIC WATER SHALL BE LEAD FREE.
M PRIOR TO TURNOVER PERFORM A VIDEO INSPECTION OF THE SANITARY AND GREASE LINES FROM THE MAIN LINES WITHIN THE TENANT SPACE TO THE MAIN SEWER TO VERIFY THAT THE SANITARY WASTE SYSTEM IS CONNECTED, CLEAN, AND FREE OF SAGS, BELLIES, BREAKS, AND DEBRIS. DELIVER A REPORT AND COPY OF THE VIDEO TO THE TENANT'S CONSTRUCTION MANAGER PRIOR TO TURNOVER.
N THE TERM "FURNISH" MEANS SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS. THE TERM "INSTALL" DESCRIBES THE OPERATIONS AT THE PROJECT SITE INCLUDING THE ACTUAL UNLOADING, UNPACKING, ASSEMBLY, ERECTING, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, AND SIMILAR OPERATIONS. THE TERM "PROVIDE" MEANS TO FURNISH AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE.
O PRIOR TO CONNECTION TO ANY EXISTING SEWER SYSTEM PERFORM A DIE TEST TO VERIFY THE TYPE OF SYSTEM AND THE DIRECTION OF FLOW. REPORT ANY DEVIATION FROM THE CONSTRUCTION DOCUMENTS TO THE TENANT'S CONSTRUCTION MANAGER.
P PROVIDE SANITARY AND GREASE WASTE PIPES AT A MINIMUM SLOPE OF 1/4" PER FOOT UNLESS NOTED OTHERWISE.
Q INSTALL SHUTOFF AND ISOLATION VALVES SHOWN TO BE ABOVE CEILINGS IN ACCESSIBLE LOCATIONS WITHIN 12" OF LAY-IN CEILINGS.

PLUMBING MATERIAL SCHEDULE

	APPLICATION	ALLOWABLE MATERIAL
NATURAL GAS PIPE		
	CONCEALED	SCH. 40 STEEL PIPE, MALLEABLE IRON THREADED FITTINGS
	EXPOSED	SCH. 40 STEEL PIPE, MALLEABLE IRON THREADED FITTINGS, PAINTED
SANITARY WASTE & VENT PIPE		
	ABOVE GROUND HAND SINK DRAINS	BRASS WITH CHROME FINISH
	ABOVE GROUND PREP SINK AND WARE WASHING SINK DRAINS	PVC PLASTIC DWV PIPE AND FITTINGS
	ABOVE GROUND, CONCEALED	PVC PLASTIC DWV PIPE AND FITTINGS
	BELOW GROUND	PVC PLASTIC DWV PIPE AND FITTINGS
WATER SUPPLY PIPE		
	ABOVE GRADE	TYPE L COPPER TUBE

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP 03/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.
230654

Contents:
PLUMBING SPECIFICATIONS

P010

A. GENERAL INFORMATION

01	Project Location (city)	Greenbrae	02	Climate Zone	2
03	Occupancy Types Within Project (select all that apply):				
● Restaurant					

B. PROJECT SCOPE

This table includes domestic water heating systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive paths outlined in 140./ 170.2(d) and 141.0(a)/ 180.1, or 141.0(b)2N / 180.2 for additions or alterations. Solar water heating systems are documented on the NRCC-SAB compliance document. Combined hydronic water heating systems are documented on the NRCC-MCH compliance document.

01	02	03		
My project consists of (check all that apply):	System Type[1,2]	System Components		
☒ New system (DHW system being installed for the first time)	Central System (serving nonresidential spaces)	☒ Equipment	☒ Distribution	☒ Controls
☐ System Alteration (equipment, distribution or controls)		☐ Equipment	☐ Distribution	☐ Controls

[1]FOOTNOTES: Point of use water heaters, or other non-central systems used to serve nonresidential spaces, are considered individual systems.
[2] Dwelling units refers to hotel/motel guest rooms and units in a multifamily residential occupancy.
[3] DHW systems serving 2 or more dwelling units are considered "Central Systems" for multifamily occupancies

C. COMPLIANCE RESULTS

Table C will indicate if the project data input into the compliance document is compliant with water heating requirements. If this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D. or the table indicated as not compliant for guidance.

01	02	03	04
Domestic Hot Water Equipment	Distribution Systems	Controls	**Compliance Results**
Table F	Table G	Table H	
Yes	Yes	Yes	COMPLIES

D. EXCEPTIONAL CONDITIONS

This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

STATE OF CALIFORNIA
Domestic Water Heating System CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-PLB-E
Project Name: CMG Greenbrae Sir Francis Drake	**Report Page:** (Page 2 of 8)
	Date Prepared: 2025-02-21T18:26:15-05:00

E. ADDITIONAL REMARKS

This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
Generated Date/Time:
Report Version: 2022.0.000
Schema Version: rev 20220101
Documentation Software: Energy Code Ace
Compliance ID: 275812-0225-0002
Report Generated: 2025-02-21 15:26:19

STATE OF CALIFORNIA
Domestic Water Heating System CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-PLB-E
Project Name: CMG Greenbrae Sir Francis Drake	**Report Page:** (Page 3 of 8)
	Date Prepared: 2025-02-21T18:26:15-05:00

F. DOMESTIC HOT WATER EQUIPMENT

This table is used to demonstrate compliance with mandatory equipment requirements in 110.1 and 110.3. Compliance with prescriptive requirements in 140.5(c) / 170.2(d) must also be demonstrated and with 141.0 / 180.1/ 180.2 for addition and alteration scopes.

Equipment Schedule: Water Heating Efficiency and Standby Loss

03		04		05	06			
System Name	DWH-1/DWH-2	Exception to 140.5(c)/ 170.2(d)3	Exceptions Do Not Apply	☐	Gas Service Water Heating System >= 1MMBtu/h[1]	Capacity-weighted Average Efficiency %		
07	08	09	10	11	12	13	14	15
Name or Item Tag	Equipment Type	Volume (gal)	Rated Input Capacity (Btu/h)	Max GPM/ First Hour Rating (FHR)	Rated Efficiency	Minimum Efficiency Required	Efficiency Unit	Designed Standby Loss	Maximum Standby Loss
DWH-1/DWH-2	Commercial Gas Instantaneous Water Heater	0	398,000		96	0.8	TE		

[1]FOOTNOTE: In systems >= 1MMBtu/h with multiple units, gas water heaters with input capacity > 100,000 Btu/h may meet 90% Et requirements via an input capacity-weighted average.
[2]FOOTNOTE: Compliant equipment may be found in the Modernized Appliance Efficiency Database System (MAEDBS) on the Energy Commission website: https://cacertappliances.energy.ca.gov/Pages/Search/AdvancedSearch.aspx

Water Heating Equipment All Occupancies

	Yes	No	Not Applicable	Requirement
18	☐	☐	☒	Unfired storage tank insulation shall have Internal + External >=R-16 OR External >=R-3.5. Label required per 110.3(c)3
19	☐	☐	☒	New state buildings 60% of energy for service water heating from site solar energy or recovered energy per 110.3(c)5
20	☒	☐	☐	Isolation valves for instantaneous water heater with input rating >6.8 kBTUH or 2 kW has been specified per 110.3(c)6
21	☐	☐	☒	School buildings < 25,000 ft^2 and < 4 stories must install a heat pump water heating system per 140.5(a)1. Water heating systems serving an individual bathroom space may be an instantaneous electric water heater.

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
Generated Date/Time:
Report Version: 2022.0.000
Schema Version: rev 20220101
Documentation Software: Energy Code Ace
Compliance ID: 275812-0225-0002
Report Generated: 2025-02-21 15:26:19

STATE OF CALIFORNIA
Domestic Water Heating System CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-PLB-E
Project Name: CMG Greenbrae Sir Francis Drake	**Report Page:** (Page 4 of 8)
	Date Prepared: 2025-02-21T18:26:15-05:00

G. DOMESTIC HOT WATER DISTRIBUTION SYSTEM

This table is used to demonstrate compliance for nonresidential occupancies with distribution requirements in 120.3 and 140.5. For multifamily and hotel/motel occupancies, compliance is demonstrated with requirements 110.3(c), 160.4, 170.2(d).

Recirculation Loops in Central Systems Serving Dwelling Units or Nonresidential Spaces

	Yes	No	Not Applicable	Requirement
01	●	○	○	Air release valve or vertical pump installation per 110.3(c)4A
02	●	○	○	Check valve or similar located between recirculation pump and water heating equipment to prevent backflow per 110.3(c)4B
03	●	○	○	Hose bibb installed between pump and equipment and isolation valve between hose bibb and equipment per 110.3(c)4C
04	●	○	○	Isolation valves on both sides of the pump per 110.3(c)4D
05	●	○	○	Cold water and recirculation loop piping shall not be connected to the hot water storage tank drain port per 110.3(c)4E
06	●	○	○	Check valve installed on cold water supply between hot water system and next closest tee on cold water supply per 110.3(c)4F
07	○	○	●	DWELLING UNITS ONLY: For central systems serving multiple dwelling units, design includes a recirculation system serving separate dwelling units per 170.2(d) unless building has <=8 dwelling units.
08	○	○	●	DWELLING UNITS ONLY: For heat pump water heating systems, the hot water return from the recirculation loop shall connect to a recirculation loop tank and shall not directly connect to the primary heat pump water heater inlet or the primary thermal storage tanks per 170.2(d)2A.
09	○	○	●	DWELLING UNITS ONLY: For heat pump water heating systems, the fuel source for the recirculation loop tank shall be electricity if auxiliary heating is needed. The recirculation loop heater shall be capable of multi-pass water heating operation per 170.2(d)2B.

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
Generated Date/Time:
Report Version: 2022.0.000
Schema Version: rev 20220101
Documentation Software: Energy Code Ace
Compliance ID: 275812-0225-0002
Report Generated: 2025-02-21 15:26:19

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP 03/31/27
SAN RAMON
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

Revisions:

Drawn: BH | PM: AG | CC: WN | Checked: WS

Project No.
230654

Contents:
TITLE 24 FORMS

P011

G. DOMESTIC HOT WATER DISTRIBUTION SYSTEM

Mandatory Pipe Insulation All Occupancies

13	☐	For systems serving dwelling units, pipe insulation must meet the minimum insulation requirements in Table 160.4-A (see blow) except: • Piping that penetrates framing members shall not be required to have pipe insulation for the distance of the framing penetration. Piping that penetrates metal framing shall use grommets, plugs, wrapping or other insulating material to assure that no contact is made with the metal framing. Insulation shall abut securely against all framing members • Piping installed in interior or exterior walls shall not be required to have pipe insulation if all of the requirements are met for compliance with Quality Insulation Installation (QII) as specified in the Reference Residential Appendix RA3.5. • Piping surrounded with a minimum of 1 inch of wall insulation, 2 inches of crawlspace insulation, or 4 inches of attic insulation, shall not be required to have pipe insulation.
14	☒	For systems serving nonresidential spaces, pipe insulation for the following applications is specified to comply with Table 120.3-A (see below) per 120.3: • Recirculating system piping, including supply and return piping of the water heater • The first 8 ft of hot and cold outlet piping, including between storage tank and heat trap, for a nonrecirculating storage system • Pipes that are externally heated
15	☒	Insulation shall be protected from damage, including that due to sunlight, moisture, equipment maintenance, and wind. Insulation exposed to weather shall be installed with a cover suitable for outdoor service per 120.3(b) / 160.4(f). Pipe insulation buried below grade must be installed in a water proof and non-crushable casing or sleeve.

TABLE 120.3-A / 160.4-A PIPE INSULATION THICKNESS

Fluid Temperature Range (°F)	Conductivity Range (Btu-in per hour per ft² per °F)	Insulation Mean Rating Temp (°F)	Nominal Pipe Diameter (in)			
			< 1	1 to < 1.5	1.5 to < 4	1.5 to < 4 Multifamily & Hotel/Motel
			Minimum Insulation Required			
105-140	0.22 - 0.28	100	1.0 in or R-7.7	1.5 in or R-12.5	1.5 in or R-11	2.0 in or R-16

H. DOMESTIC HOT WATER CONTROLS

This table is used to demonstrate compliance with control requirements in 110.3 for all occupancies. For multifamily residential and hotel/motel occupancies, compliance is also demonstrated with requirements in 160.4(e) / 170.2(d).

	Yes	No	Not Applicable	Requirement
01	☒	☐	☐	Construction documents require manufacturer certification that service water-heating systems are equipped with automatic temperature controls capable of adjusting temperature settings per 110.3(a).
02	☒	☐	☐	Systems with capacity > 167,000 BTUH equipped with outlet temperature controls per 110.3(c)1 unless covered by California Plumbing Code 613.0.
03	☒	☐	☐	Controls for circulating pumps or electrical heat trace systems are capable of automatically turning off the system per §110.3(c)2 unless systems serves healthcare facility.
04	☐	☐	☒	For recirculation systems serving multiple dwelling units, design includes automatic pump controls per 170.2(d) or 180.1(b)3 for additions.
05	☐	☐	☒	For recirculation systems serving individual dwelling units, design includes manual on/off controls as specified in Reference Appendix RA4.4.9 per 170.2(d).
06	☐	☐	☒	Combustion air positive shut-off shall be provided per 160.4(3).on all newly installed commercial boilers as follows: • Boilers with input capacity >= 2.5 MMBtu/h, in which the boiler is designed to operate with a nonpositive vent static pressure • Boilers where one stack serves two or more boilers with a total combined input capacity per stack of 2.5 MMBtu/h.
07	☐	☐	☒	Boiler combustion air fans with motor >= 10 hp shall meet one of the following • The fan motor shall be driven by a variable speed drive OR • The fan motor shall include controls that limit the fan motor demand to <=30% of the total design wattage at 50% of the design air volume.
08	☐	☐	☒	Newly installed boilers with an input capacity {d:gte/] 5MMBtu/h and a steady state full-load combustion efficiency < 90% shall maintain excess (stack-gas) oxygen concentrations <= 5% by volume on a dry basis over firing rates of 20-100%. Combustion air volume shall be controlled with respect to firing rate or flue gas oxygen concentration. Use of a common gas and combustion air control linkage or jack shaft is prohibited.

I. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION

Selections have been made based on information provided in this document. If any selection have been changed by permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and can be found online

Form/Title
NRCI-PLB-E - Must be submitted for all buildings

J. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

There are no forms required for this project.

K. DECLARATION OF REQUIRED CERTIFICATES OF VERIFICATION

There are no forms required for this project.

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Brent Hoogland	Documentation Author Signature: Brent Hoogland
Company: Bowman Consulting Group	Signature Date: 02/24/2025
Address: 1490 W 121st Ave	CEA/ HERS Certification Identification (if applicable): N/A
City/State/Zip: Denver, CO 80234	Phone: (303)-678-1108

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

1. The information provided on this Certificate of Compliance is true and correct.
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: Walter Shoup	Responsible Designer Signature: Walter Shoup
Company: Bowman Consulting Group	Date Signed: 02/24/2025
Address: 1490 W 121st Ave	License: 42319
City/State/Zip: Denver, CO 80234	Phone: (303)-678-1108

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP 09/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.
230654

Contents:
TITLE 24 FORMS

P012

PLUMBING SUPPLY PLAN NOTES

1 SEE CIVIL UTILITY PLAN FOR CONTINUATION OF 1-1/2" DOMESTIC WATER SERVICE.
2 PROVIDE 1/2" FILTERED WATER TO THE BAG-IN-BOX SODA CARBONATOR AT 102" AFF. SODA CARBONATOR SHALL HAVE AN INTEGRAL ASSE 1022-RATED CARBONATED BEVERAGE BACKFLOW PREVENTION DEVICE.
3 PROVIDE WATER HEATERS DWH-1 AND DWH-2 PER DETAIL 1/P700.
4 PROVIDE WATER FILTERS MOUNTED TO WALL PER DETAIL 11/P700. PROVIDE 1/2" SUPPLY PIPES FROM FILTERS TO ICE MAKER AND SODA CARBONATOR AS SHOWN.
5 PROVIDE 1/2" FILTERED WATER ROUGH-IN TO THE ICE MAKER AT 56" AFF. PROVIDE 6' LONG STAINLESS STEEL FLEXIBLE BRAIDED WASHING MACHINE WATER CONNECTOR WITH MINIMUM 0.43" ID (BRASSCRAFT SL12-72WA F OR EQUAL) FOR FINAL CONNECTION TO ICE MAKER.
6 PROVIDE DOMESTIC WATER ROUGH-INS FOR THE MOP BASIN FAUCET AT 36" AFF. PROVIDE DOMESTIC WATER ROUGH-INS FOR THE CHEMICAL DISPENSER FAUCET (HB-1) AT 64" AFF DIRECTLY ABOVE THE MOP BASIN FAUCET. SEE ARCHITECTURAL ELEVATION FOR ADDITIONAL INFORMATION.
7 LANDLORD TO PROVIDE NEW DEDICATED GAS METER. SEE LANDLORD'S CIVIL UTILITY PLAN FOR ON-SITE GAS ROUTING.
8 PROVIDE GAS CONNECTIONS TO THE COOKING EQUIPMENT PER DETAIL 7/P700.
9 SUPPORT THE GAS PIPE ON THE ROOF PER DETAIL 5/P700. WOOD BLOCKING IS NOT AN ACCEPTABLE METHOD OF SUPPORTING THE GAS PIPE.
10 PROVIDE ACCESSIBLE LINE-SIZED GAS VALVE, DIRT LEG, AND UNION AT GAS CONNECTION TO THE EQUIPMENT.
11 REFER TO ARCHITECTURAL DRAWINGS FOR PAINTING OF INTERIOR AND EXTERIOR EXPOSED GAS PIPE.
12 PROVIDE DOMESTIC WATER ROUGH-INS FOR THE CHEMICAL DISPENSER FAUCET (HB-1) AT 52" AFF. SEE ARCHITECTURAL ELEVATION FOR ADDITIONAL INFORMATION.
13 PROVIDE DOMESTIC WATER ROUGH-INS FOR THE VICTORY WASH DISPENSER FAUCET (HB-2) AT 52" AFF. SEE ARCHITECTURAL ELEVATION FOR ADDITIONAL INFORMATION.
14 PROVIDE RESTROOM HAND SINK WALL CARRIER IN WALL PER PLUMBING SCHEDULE. INSTALL THERMOSTATIC MIXING VALVE FURNISHED WITH HAND SINK FAUCET SECURED TO WALL BELOW HAND SINK. ALL HAND SINK PIPING AND ACCESSORIES SHALL BE FULLY CONTAINED DIRECTLY BELOW HAND SINK.

PLUMBING SUPPLY PLAN NOTES

15 PROVIDE KITCHEN EQUIPMENT GAS SHUTOFF 6" BELOW THE CEILING PER DETAIL 4/P700.
16 CONNECT CHEMICAL DISPENSER TO HB-1. CHEMICAL DISPENSER HAS AN INTEGRAL AIR GAP AS IS SHOWN IN DETAIL 10/P700.
17 PROVIDE ASSE 1016/1070 POINT-OF-USE THERMOSTATIC MIXING VALVE, WATTS LFUSG-B, ON WATER SUPPLY TO KITCHEN HAND SINKS. PROVIDE ANGLE STOP BELOW SINK, FASTEN MIXING VALVE TO WALL, AND MAKE FINAL CONNECTION FROM ANGLE STOPS TO MIXING VALVE AND FROM MIXING VALVE TO FAUCET USING BRAIDED STAINLESS STEEL HOSE. ADJUST MIXING VALVE FOR A DISCHARGE TEMPERATURE OF APPROXIMATELY 110° F.
18 PROVIDE ACCESSIBLE VALVE IN WATER SUPPLY TO FIXTURE AS SHOWN.
19 PROVIDE GAS CONNECTION TO THE RICE COOKER PER DETAIL 6/P700.
20 PROVIDE GAS ROUGH-IN TO FRYER BEHIND RICE COOKER TABLE SO THAT VALVES AND DIRT LEG ARE ACCESSIBLE ONCE FRYER IS SECURED INTO PLACE.
21 PROVIDE 1/2" FILTERED WATER ROUGH-IN TO THE ICE MAKER AT 24" AFF. PROVIDE 6' LONG STAINLESS STEEL FLEXIBLE BRAIDED WASHING MACHINE WATER CONNECTOR WITH MINIMUM 0.43" ID (BRASSCRAFT SL12-72WA F OR EQUAL) FOR FINAL CONNECTION TO ICE MAKER.
22 INSTALL RGF IMSB ICE MAKER SANITIZER FURNISHED BY TUV PER CHIPOTLE'S INSTALLATION INSTRUCTIONS.
23 PROVIDE 3/4" DOMESTIC HOT AND COLD WATER ROUGH-INS FOR THE PREP SINK (SK-2) FAUCET AT 24" AFF TO ALLOW FOR THE VICTORY WASH CHEMICAL DOCK TO BE INSTALLED DIRECTLY BELOW THE PREP SINK BASIN. MAKE FINAL CONNECTION TO PREP SINK FAUCET USING 3/4" BRAIDED STAINLESS STEEL WATER HEATER CONNECTOR HOSE.
24 PROVIDE 3/4" HOT WATER TO THE DISH MACHINE, MAKING FINAL CONNECTION USING HOSE FURNISHED WITH DISH MACHINE. PROVIDE WATER HAMMER ARRESTOR ON HOT WATER LINE. PROVIDE AN ACCESSABLE SHUTOFF VALVE BELOW THE DISH MACHINE AND INSTALL THE STRAINER FURNISHED WITH THE DISH MACHINE IN AN ACCESSIBLE LOCATION AT THE CONNECTION TO THE UNIT.
25 PROVIDE ROOF HYDRANT RH-1 WITH BOTTOM OF NOZZLE INSTALLED 24" ABOVE THE BOTTOM OF ROOF DECK. PROVIDE ACCESSIBLE ISOLATION VALVE IN WATER SUPPLY TO ROOF HYDRANT. SUPPORT ROOF HYDRANT PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
26 PROVIDE FILTERED DOMESTIC WATER ROUGH-IN FOR THE SPEED FILL POT FILLER FAUCET (PF-1) AT 40" AFF. SEE ARCHITECTURAL ELEVATION FOR DETAIL.
27 PROVIDE WATER SERVICE ENTRY PER DETAIL 16/P700.
28 INSTALL RGF IMSB ICE MAKER SANITIZER FURNISHED BY TUV PER CHIPOTLE'S INSTALLATION INSTRUCTIONS. LOCATE IMSB BELOW UTENSIL COUNTER IN A LOCATION THAT DOES NOT INTERFERE WITH THE ROLLING RACK BELOW THE UTENSIL COUNTER.
29 PENETRATIONS THROUGH SHEAR WALL SHALL BE LIMITED TO 10" DIAMETER (OR A GROUP OF PENETRATIONS ALL CONTAINED WITHIN 10" DIAMETER). IF LARGER PENETRATIONS OR GROUPS OF PENETRATIONS ARE REQUIRED COORDINATE WITH STRUCTURAL ENGINEER FOR APPROPRIATE BRACING. SEE STRUCTURAL DRAWINGS FOR SHEAR WALL LOCATION.
30 PROVIDE ACCESSIBLE TRAP PRIMER ABOVE LAY-IN CEILING AS SHOWN. INSTALL PER MANUFACTURER'S INSTALLATION INSTRUCTIONS WITH A SERVICE VALVE AT THE TRAP PRIMER INLET. PROVIDE 1/2" DISTRIBUTION PIPE(S) TO FLOOR DRAIN TRAP PRIMER CONNECTION(S) AS SHOWN. HORIZONTAL DISTRIBUTION PIPING SHALL HAVE CONTINUOUS SLOPE TO THE FLOOR DRAIN(S)
31 REPLACE STOCK WATER CLOSET HANDLE WITH UNIVERSAL CABLE-OPERATED HANDLE (FLUSHMATE AP300503 OR AP300504 - FIELD VERIFY COMPATIBILITY WITH FLUSHMATE SYSTEM IN WATER CLOSET).

PLUMBING GAS CONNECTIONS

TAG	DESCRIPTION	CONNECTION SIZE	EQUIVALENT LENGTH	INPUT
DWH-1	WATER HEATER (GAS TANKLESS)	3/4"	115'	199,000 Btu/h
DWH-2	WATER HEATER (GAS TANKLESS)	3/4"	115'	199,000 Btu/h
FB-1	GAS FRYER	3/4"	150'	90,000 Btu/h
GR-1	GAS GRIDDLE	1"	135'	120,000 Btu/h
MAU-1	DIRECT-FIRED MAKEUP AIR UNIT	1/2"	135'	78,010 Btu/h
RC-1	RICE COOKER	3/4"	145'	33,000 Btu/h
RN-1	6 BURNER RANGE	3/4"	145'	192,000 Btu/h
RTU-1	CARRIER ROOFTOP UNIT	3/4"	115'	125,000 Btu/h
RTU-2	CARRIER ROOFTOP UNIT	3/4"	150'	60,000 Btu/h
GRAND TOTAL			MAX: 95	1,096,010 Btu/h

NOTES:
1. PRESSURE REQUIRED AFTER METER: 7" W.C.
2. DISTANCES ARE APPROXIMATE

PLUMBING FIXTURE SUPPLY CONNECTIONS

ROUGH-IN TYPE KEY	
ANGLE 3/8"	BRASS CRAFT KTR19 OR EQUAL (BRASS/CHROME 1/4 TURN ANGLED BALL STOP WITH 3/8" COMPRESSION CONNECTION)
ANGLE 1/2"	BRASS CRAFT R39X C OR EQUAL (BRASS/CHROME MULTI-TURN ANGLED STOP WITH 1/2" COMPRESSION CONNECTION)
ANGLE 3/4"	EVERFLOW 74342-NL W/ 3/4" SWEAT X MIP ADAPTER OR EQUAL (BRASS ANGLE STOP W/ 3/4" FIP INLET AND OUTLET)
DIRECT	PROVIDE COPPER PIPE IN CONNECTION SIZE SHOWN TO FIXTURE
HOSE 1/2"	ARROWHEAD BRASS WM50F OR EQUAL (BRASS/CHROME WASHING MACHINE VALVE W/ 3/4" MHT OUTLET)
MIP	PROVIDE PIPE WITH MIP THREAD STUBBED OUT OF WALL IN CONNECTION SIZE SHOWN AND LENGTH COMPATIBLE WITH FIXTURE AND WALL MATERIAL/FINISHES.

TAG	DESCRIPTION	CONNECTION SIZE CW	CONNECTION SIZE HW	ROUGH-IN TYPE	WSFU CW	WSFU HW	WSFU TOTAL	COUNT	TOTAL WSFU
BFP-1	RPZ BACKFLOW PREVENTER	1/2"		DIRECT	0	0	0	1	0
BFP-2	RPZ BACKFLOW PREVENTER	1 1/2"		DIRECT	0	0	0	1	0
DM-1	DISH SANITIZING MACHINE (PUMPED OUTLET)	0"	1/2"	HOSE 1/2"	0	3	3	1	3
ET-1	EXPANSION TANK	3/4"		DIRECT	0		0	1	0
HB-1	CHEMICAL DISPENSER HOSE BIB	1/2"	1/2"	MIP	2.25	2.25	3	2	6
HB-2	VEGETABLE WASH HOSE BIB	1/2"		MIP	1.5		1.5	1	1.5
HS-1B	RESTROOM HAND SINK FAUCET	1/2"	1/2"	ANGLE 3/8"	1.5	1.5	2	2	4
HS-2	KITCHEN HAND SINK	1/2"	1/2"		1.5	1.5	2	3	6
IM-1	ICE MAKER - BOH	1/2"		HOSE 1/2"	1		1	1	1
IM-2	ICE MAKER - SODA	1/2"		HOSE 1/2"	1		1	1	1
MB-1B	MOP SINK FAUCET	1/2"	1/2"	MIP	2.25	2.25	3	1	3
PF-1	SPEED FILL FAUCET	3/8"		MIP	1.5		1.5	1	1.5
RH-1	FREEZE PROOF ROOF HYDRANT	3/4"		DIRECT	1		1	1	1
SK-1	THREE COMPARTMENT SINK	1/2"	1/2"	ANGLE 1/2"	3	3	4	1	4
SK-2	PREP SINK	3/4"	3/4"	ANGLE 3/4"	3	3	4	1	4
TP-2	TRAP PRIMER (TWO FLOOR DRAINS)	1/2"		DIRECT	0		0	1	0
TP-3	TRAP PRIMER (THREE-FOUR FLOOR DRAINS)	1/2"		DIRECT	0		0	1	0
UR-1	URINAL	3/4"			5		5	1	5
WC-1	WATER CLOSET	1/2"			2		2	3	6
WH-1	FREEZE PROOF WALL HYDRANT	3/4"		DIRECT	1		1	1	1
GRAND TOTAL									48

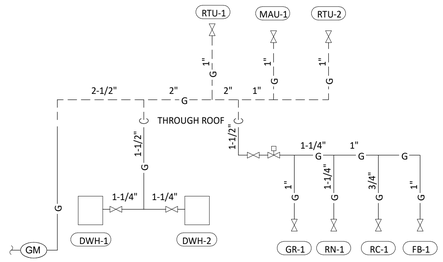

3 P100 **GAS DISTRIBUTION DIAGRAM**
NOT TO SCALE

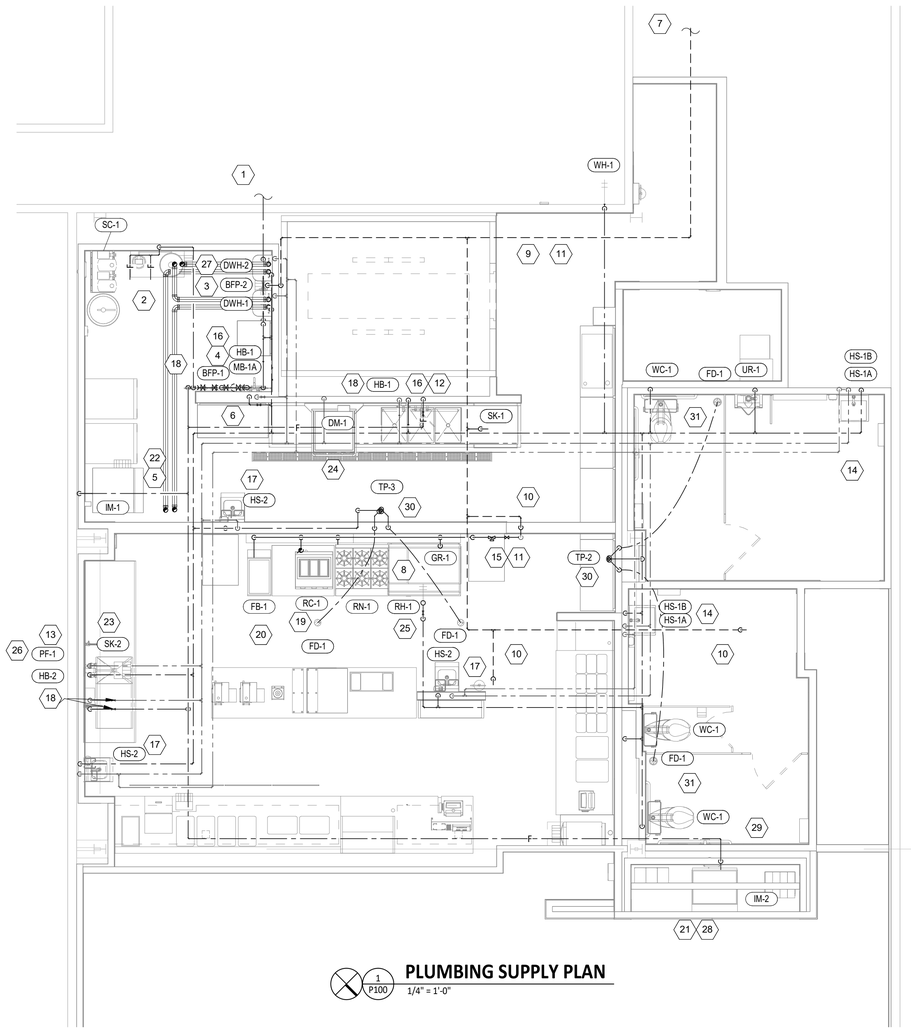

1 P100 **PLUMBING SUPPLY PLAN**
1/4" = 1'-0"

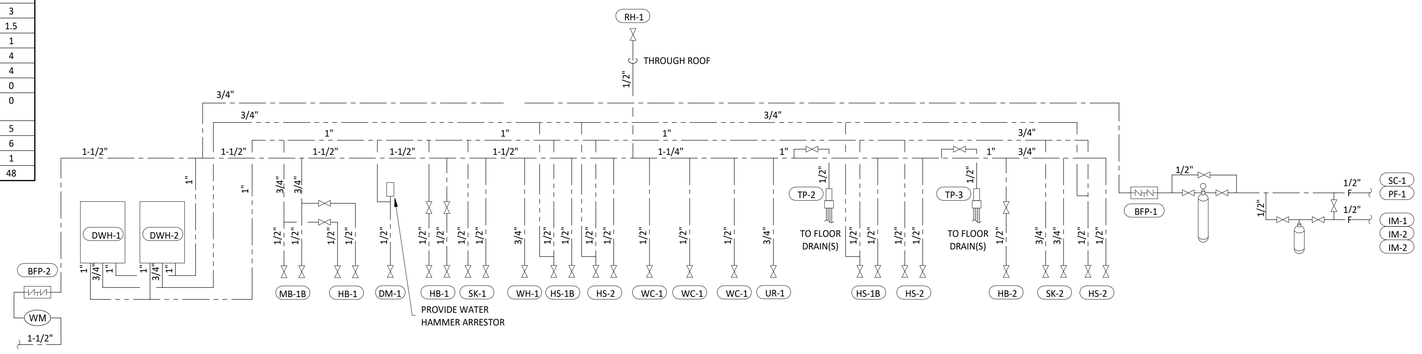

2 P100 **PLUMBING SUPPLY DIAGRAM**
NOT TO SCALE

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP 03/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

A Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.
230654

Contents:
PLUMBING PLAN
WATER & GAS

P100

PLUMBING WASTE AND VENT PLAN NOTES

1 PROVIDE 3/4" CONDENSATE DRAIN FROM THE WALK-IN COOLER EVAPORATOR TO THE FLOOR SINK BELOW AS SHOWN. SLOPE CONDENSATE DRAIN A MINIMUM OF 1" PER FOOT. HOLD EXPOSED CONDENSATE DRAIN IN WALK-IN COOLER AS HIGH AS POSSIBLE. CONCEAL DRAIN PIPING WITHIN FRAMED WALLS AS SHOWN. DISCHARGE THROUGH AN AIR GAP. MAKE FINAL CONNECTION TO EVAPORATOR INSIDE WALK-IN COOLER USING A UNION. CONDENSATE DRAIN SHOULD PENETRATE WALL AT POINT OF DISCHARGE AT 8" AFF.

2 PROVIDE DRAIN CONNECTIONS TO THE THREE COMPARTMENT SINK PER DETAIL 2/P700.

3 COORDINATE ROUTING OF SODA BUNDLES WITH COCA-COLA TECHNICIAN FROM BAG-IN-BOX AREA TO EACH SODA FOUNTAIN. OTHER THAN WITHIN THE WALLS DOWN TO THE DRYER BOX THE SODA BUNDLE SHALL BE ROUTED OVERHEAD WITHOUT CONDUIT. COORDINATE SUPPORT AND ROUTING OF THE SODA LINE BUNDLES WITH COCA-COLA TECHNICIAN DURING ROUGH IN AND PROVIDE NECESSARY SUPPORTS. SEE ARCHITECTURAL DRAWINGS FOR SODA BUNDLE TERMINATION LOCATION AND PROVIDE TERMINATION PER DETAIL 12/P700.

4 NOT USED.

5 PROVIDE DRAIN LINES FROM THE FOOD PREP SINK TO THE FLOOR SINK. PROVIDE AN AIR GAP AT THE DISCHARGE TO THE FLOOR SINK.

6 PROVIDE A 3" VENT THROUGH THE ROOF PER DETAIL 3/P700.

7 LANDLORD TO PROVIDE GREASE INTERCEPTOR GI-1. SEE CIVIL UTILITY PLAN FOR CONTINUATION OF 4" GREASE WASTE PIPE.

8 SEE CIVIL UTILITY PLAN FOR CONTINUATION OF 4" SANITARY SEWER.

9 PROVIDE 3/4" VALVED DRAIN FROM HOT FOOD TABLE TO THE FLOOR SINK. DRAIN THROUGH AN AIR GAP.

10 PROVIDE INSULATED COPPER DRAIN LINES FROM THE TEA TRAY DRAIN AND THE SODA MACHINE DRAIN TO THE FLOOR SINK. DRAIN THROUGH AN AIR GAP. HOLD TEA TRAY DRAIN AS HIGH AS POSSIBLE AND SECURE TO STRUCTURE BELOW THE UTENSIL COUNTER.

11 TRIM TRENCH DRAIN ENDS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS PRIOR TO INSTALLATION SO THAT GRATE FITS WITHOUT GAPS. INSTALL TRENCH DRAIN WITH SLIGHT POSITIVE SLOPE TOWARD THE DRAIN CONNECTION TO AVOID STANDING WATER IN TRENCH DRAIN.

12 PROVIDE 2" VENT TO GREASE INTERCEPTOR GI-1. SEE CIVIL UTILITY PLAN FOR MORE INFORMATION.

13 DO NOT PROVIDE WALL CLEANOUTS ON TILE OR PUBLICLY-VISIBLE WALLS. IF A WALL CLEANOUT IS REQUIRED ON THESE SURFACE COORDINATE THE EXACT LOCATION WITH CHIPOTLE'S CONSTRUCTION MANAGER.

14 PROVIDE INDIRECT WASTE AND CONDENSATE DRAINS FROM FIXTURES OTHER THAN KITCHEN SINKS CONCEALED IN THE WALL AS SHOWN IN DETAIL 9/P700.

15 PROVIDE DRAIN FROM WATER FILTER BFP TO FLOOR SINK CONCEALED IN THE WALL AS SHOWN IN DETAIL 9/P700.

16 PROVIDE TRENCH DRAIN AS SHOWN IN DETAIL 15/P700.

17 INSTALL DRAIN HOSE FURNISHED WITH DISH MACHINE FROM DISH MACHINE OUTLET TO FLOOR SINK. HOLD DRAIN HOSE TIGHT TO WALL AND SECURE TO 3-COMP SINK DRAIN TO MAINTAIN AN AIR GAP AT THE FLOOR SINK.

18 PROVIDE CONDENSATE TRAP ON RTU PER DETAIL 13/P700.

19 NOT USED.

20 NOT USED.

21 NOT USED.

22 NOT USED.

23 PROVIDE PVC DRAIN PIPES FROM THE ICE MACHINE TO THE FLOOR SINK PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. PROVIDE A CODE-APPROVED AIR GAP AT THE DISCHARGE TO THE FLOOR SINK. SECURE ICE MAKER DRAIN PIPES TO THE BOTTOM OF THE ICE MAKER.

PLUMBING FIXTURE WASTE CONNECTIONS

TAG	DESCRIPTION	CONNECTION SIZE - WASTE	DFU	COUNT	TOTAL DFU
DM-1	DISH SANITIZING MACHINE (PUMPED OUTLET)	5/8"	7	1	7
FCO-1	FLOOR CLEANOUT (3")	3"	0	1	0
FCO-2	FLOOR CLEANOUT (4")	4"	0	2	0
FD-1	FLOOR DRAIN	2"	2	4	8
FS-1	FLOOR SINK	3"	5	8	40
GI-1	GREASE INTERCEPTOR	4"	0	1	0
HS-1A	RESTROOM HAND SINK	2"	1	2	2
HS-2	KITCHEN HAND SINK	2"	1	3	3
MB-1A	MOP BASIN	3"	2	1	2
SK-1	THREE COMPARTMENT SINK	2"	0	1	0
SK-2	PREP SINK	2"	0	1	0
TD-1	TRENCH DRAIN	2"	2	1	2
UR-1	URINAL	2"	2	1	2
WC-1	WATER CLOSET	3"	4	3	12
GRAND TOTAL					78

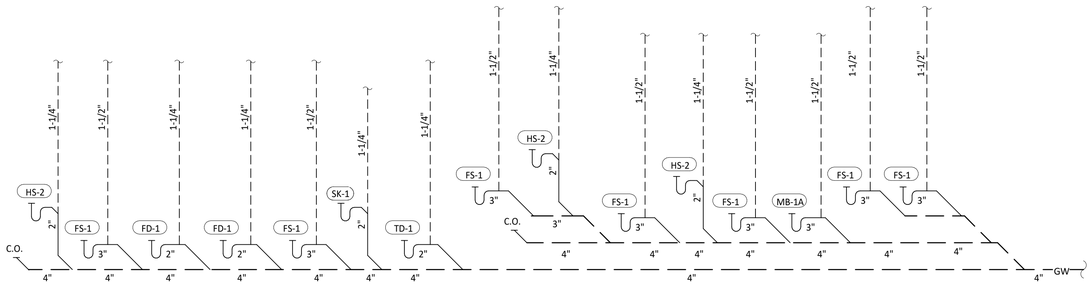

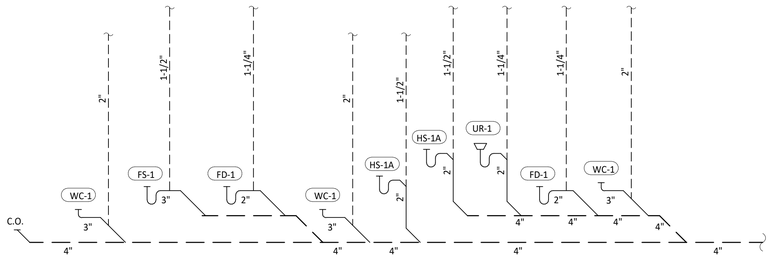

2/P110 **SANITARY WASTE & VENT DIAGRAM**
NOT TO SCALE

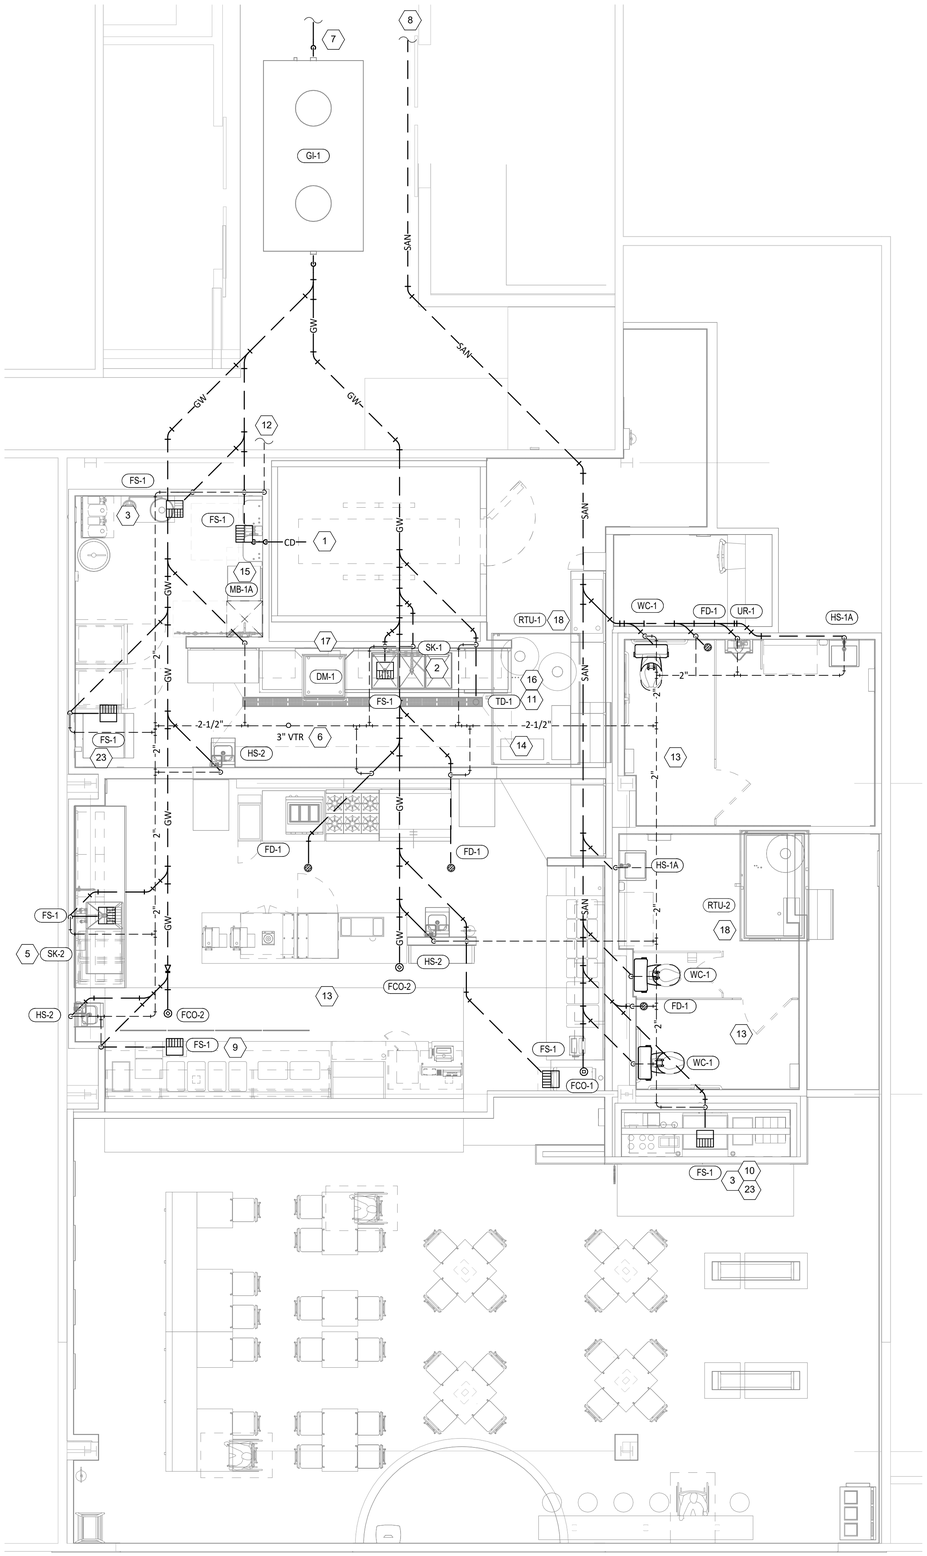

1/P110 **SANITARY WASTE & VENT PLAN**
1/4" = 1'-0"

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP 03/31/27
CIVIL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.
230654

Contents:
PLUMBING PLAN
WASTE & VENT

P110

PLUMBING FIXTURE SCHEDULE

TAG	DESCRIPTION	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS	COUNT	CONNECTION SIZE			WATER SUPPLY FIXTURE UNITS			DRAINAGE
				MANUFACTURER	MODEL			CW	HW	WASTE	CW	HW	TOTAL	FIXTURE UNITS
BFP-1	RPZ BACKFLOW PREVENTER	GC	GC	CONBRACO	4ALF-203-T2F	LEAD FREE REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTER WITH AUTOMATIC DIFFERENTIAL RELIEF VALVE	1	1/2"			0	0	0	
BFP-2	RPZ BACKFLOW PREVENTER	GC	GC	CONBRACO	4ALF-207	LEAD FREE REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTER WITH AUTOMATIC DIFFERENTIAL RELIEF VALVE AND AIR GAP FITTING	1	1 1/2"			0	0	0	
DM-1	DISH SANITIZING MACHINE (PUMPED OUTLET)	KES	GC	SEE ARCH	--	CHEMICAL SANITIZING DISH MACHINE WITH INTEGRAL ELECTRIC BOOSTER HEATER AND PUMPED OUTLET	1	0"	1/2"	5/8"	0	3	3	7
ET-1	EXPANSION TANK	GC	GC	AMTROL	ST-5	2 GALLON CAPACITY	1	3/4"			0		0	
FB-1	GAS FRYER	KES	GC	SEE ARCH	--		1							
FCO-1	FLOOR CLEANOUT (3")	GC	GC	SIOUX CHIEF	852-3PNR	ON-GRADE ADJUSTABLE CLEANOUT WITH INTERNAL THREADED CLEANOUT PLUG AND ROUND NICKEL-BRONZE RING AND COVER (OR APPROVED EQUAL WITH INTERNAL THREADED CLEANOUT PLUG)	1			3"				0
FCO-2	FLOOR CLEANOUT (4")	GC	GC	SIOUX CHIEF	852-4PNR	ON-GRADE ADJUSTABLE CLEANOUT WITH INTERNAL THREADED CLEANOUT PLUG AND ROUND NICKEL-BRONZE RING AND COVER (OR APPROVED EQUAL WITH INTERNAL THREADED CLEANOUT PLUG)	2			4"				0
FD-1	FLOOR DRAIN	GC	GC	SIOUX CHIEF	842-2-PNR	ADJUSTABLE FLOOR DRAIN WITH PVC BODY, ROUND POLISHED METAL RING AND STRAINER, AND TRAP PRIMER PORT	4	1/2"		2"				2
FS-1	FLOOR SINK	GC	GC	SIOUX CHIEF	861-3PU2	HEAVY DUTY PVC FLOOR SINK WITH ALUMINUM DOME BOTTOM STRAINER AND OPEN HALF PVC GRATE	8			3"				5
GI-1	GREASE INTERCEPTOR	GC	GC	CUSTOM	--	1,500 GALLON PRECAST GREASE INTERCEPTOR BY LANDLORD.	1			4"				0
GR-1	GAS GRIDDLE	KES	GC	SEE ARCH	--		1							
HB-1	CHEMICAL DISPENSER HOSE BIB	KES	GC	SEE ARCH	--	COMMERCIAL QUALITY HOT & COLD MIXING WALL HYDRANT. SUPPLY ARMS SHALL HAVE INTEGRAL SHUT-OFF STOP AND CHECK VALVE. FAUCET HAS FEMALE NPT INLETS.	2	1/2"	1/2"		2.25	2.25	3	
HB-2	VEGETABLE WASH HOSE BIB	KES	GC	SEE ARCH	--	SILL FAUCET WITH NPT FEMALE INLET	1	1/2"			1.5		1.5	
HS-1A	RESTROOM HAND SINK	GC	GC	AMERICAN STANDARD	9024.001EC	ADA-ACCESSIBLE, WALL-MOUNTED, PORCELAIN LAVATORY. PROVIDE ZURN Z1231 (Z1231-D FOR BACK-TO-BACK APPLICATIONS) CONCEALED ARM CARRIER IN WALL. APPROVED ALTERNATE: KOHLER K-2084	2			2"				1
HS-1B	RESTROOM HAND SINK FAUCET	KES	GC	SEE ARCH	--	METERED FAUCET WITH 0.5 GPM AERATOR AND FURNISHED WITH THERMOSTATIC MIXING VALVE. ADJUST FAUCET FOR 30 SECOND RUN TIME.	2	1/2"	1/2"		1.5	1.5	2	
HS-2	KITCHEN HAND SINK	KES	GC	SEE ARCH	--	STAINLESS STEEL SINK WITH WALL MOUNTING BRACKET AND BACKSPLASH MOUNTED FAUCET WITH SWIVEL GOOSENECK	3	1/2"	1/2"	2"	1.5	1.5	2	1
IM-1	ICE MAKER - BOH	KES	KES	SEE ARCH	--	BACK OF HOUSE ICE MAKER WITH BIN (STANDARD CAPACITY REMOTE AIR COOLED)	1	1/2"			1		1	
IM-2	ICE MAKER - SODA	KES	KES	SEE ARCH	--	SODA MACHINE-MOUNTED ICE MACHINE (INTEGRAL AIR COOLED)	1	1/2"			1		1	
MB-1A	MOP BASIN	GC	GC	FIAT	MSB2424	PROVIDE 24"x24"x10" MOLDED-STONE MOP BASIN. INSTALL MOP BASIN IN A BED OF GROUT SO THERE ARE NO VOIDS BETWEEN THE MOP BASIN AND THE SLAB.	1			3"				2
MB-1B	MOP SINK FAUCET	KES	GC	SEE ARCH	--	SERVICE SINK FAUCET WITH BUILT IN STOPS, LEVER HANDLES, WALL BRACE, AND NPT FEMALE INLETS	1	1/2"	1/2"		2.25	2.25	3	
PF-1	SPEED FILL FAUCET	KES	GC	SEE ARCH	--	WALL-MOUNTED POT FILLER W/ SELF-CLOSING FILLER VALVE AND NPT FEMALE INLET	1	3/8"			1.5		1.5	
RC-1	RICE COOKER	KES	GC	SEE ARCH	--		1							
RH-1	FREEZE PROOF ROOF HYDRANT	GC	GC	HOEPTNER	2131R	AUTOMATIC DRAINING, FREEZELESS ROOF HYDRANT WITH ANTI-SIPHON VACUUM BREAKER HOEPTNER PRODUCTS (408) 847-7615	1	3/4"			1		1	
RN-1	6 BURNER RANGE	KES	GC	SEE ARCH	--		1							
SK-1	THREE COMPARTMENT SINK	KES	GC	SEE ARCH	--	THREE-COMPARTMENT WARE-WASHING SINK FURNISHED WITH (1) PRE-RINSE UNIT WITH ADD-ON FAUCET	1	1/2"	1/2"	2"	3	3	4	0
SK-2	PREP SINK	KES	GC	SEE ARCH	--	STAINLESS STEEL PREP TABLE WITH INTEGRAL PREP SINK. FURNISHED WITH "BIG FLO" FAUCET	1	3/4"	3/4"	2"	3	3	4	0
TD-1	TRENCH DRAIN	GC	GC	ZURN	Z886 8601 8602	6" X 160" HDPE TRENCH DRAIN (SLOPED FROM 3.50" TO 4.70") WITH (2) CLOSED END CAPS, (1) 4" NO-HUB BOTTOM OUTLET, AND CLASS-A HEEL-PROOF POLYETHYLENE GRATES. SEE DETAIL ON SHEET P700 FOR REDUCTION TO 2" DRAIN CONNECTION.	1			2"				2
TP-2	TRAP PRIMER (TWO FLOOR DRAINS)	GC	GC	PRECISION PLUMBING PRODUCTS	P2-500 W/ DU-U	TRAP PRIMER WITH INTEGRAL VACUUM BREAKER AND DISTRIBUTION UNIT. CAP UNUSED DISTRIBUTION UNIT OUTLETS.	1	1/2"			0		0	
TP-3	TRAP PRIMER (THREE-FOUR FLOOR DRAINS)	GC	GC	PRECISION PLUMBING PRODUCTS	P1-500 W/ DU-U	TRAP PRIMER WITH INTEGRAL VACUUM BREAKER AND DISTRIBUTION UNIT. CAP UNUSED DISTRIBUTION UNIT OUTLETS.	1	1/2"			0		0	
UR-1	URINAL	GC	GC	KOHLER	K-4991-ET	ADA-ACCESSIBLE, WALL-MOUNTED, VITREOUS CHINA, WASHOUT URINAL WITH SLOAN ECOS 8186-0.25 0.25 GPF BATTERY-POWERED AUTOMATIC FLUSH VALVE. INSTALL WITH RIM AT 17" AFF.	1	3/4"		2"	5		5	2
WC-1	WATER CLOSET	GC	GC	KOHLER	K-3519 W/ SEAT K-4666-C	WHITE HIGHLINE 1.0 GPF, 17-1/8"-HIGH, ADA ACCESSIBLE, PRESSURE ASSIST WATER CLOSET WITH OPEN-FRONT SEAT. INSTALL TRIP LEVER ON THE TANK TO THE OPEN SIDE OF THE STALL (ADD -RA TO THE MODEL #FOR RIGHT HAND TRIP LEVER).	3	1/2"		3"	2		2	4
WH-1	FREEZE PROOF WALL HYDRANT	GC	GC	WOODFORD	MODEL 65	AUTOMATIC DRAINING, FREEZELESS WALL HYDRANT WITH ANTI-SIPHON VACUUM BREAKER. PROVIDE WITH STEM LONG ENOUGH TO REACH INSIDE THE THERMAL ENVELOPE OF THE BUILDING.	1	3/4"			1		1	

WATER HEATER SCHEDULE

TAG	DESCRIPTION	NATURAL GAS		ELECTRICAL		FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN		REMARKS
		INPUT	CONNECTION SIZE	FLA	V/P/H			MANUFACTURER	MODEL	
DWH-1	WATER HEATER (GAS TANKLESS)	199,000 Btu/h	3/4"		120/1/60	GC	GC	NAVIEN	NPE-240A2	RATED FLOW RATE: 5.6 GPM @ 67°F RISE THERMAL EFFICIENCY: 96% PROVIDE WITH LEAD FREE "PLUMB EASY VALVE SET". GC SHALL PURCHASE WATER HEATER DIRECTLY THROUGH A NAVIEN AUTHORIZED DISTRIBUTOR (1-800-519-8794 OR WWW.NAVIEN.COM TO LOCATE AUTHORIZED DISTRIBUTOR).
DWH-2	WATER HEATER (GAS TANKLESS)	199,000 Btu/h	3/4"		120/1/60	GC	GC	NAVIEN	NPE-240A2	RATED FLOW RATE: 5.6 GPM @ 67°F RISE THERMAL EFFICIENCY: 96% PROVIDE WITH LEAD FREE "PLUMB EASY VALVE SET". GC SHALL PURCHASE WATER HEATER DIRECTLY THROUGH A NAVIEN AUTHORIZED DISTRIBUTOR (1-800-519-8794 OR WWW.NAVIEN.COM TO LOCATE AUTHORIZED DISTRIBUTOR).

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP 03/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
BH	AG	WN	WS

Project No.

230654

Contents:

PLUMBING SCHEDULES

P600

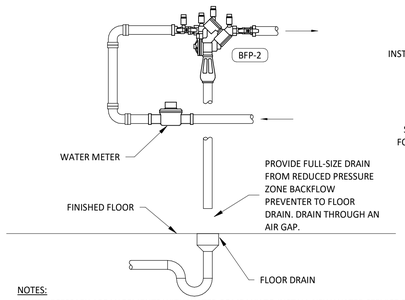

NOTES:

MAKE NECESSARY ARRANGEMENTS WITH WATER COMPANY TO INSTALL NEW WATER SERVICE PER LOCAL CODES & WATER COMPANY REGULATIONS AND PAY ALL CHARGES. SERVICE SHALL BE SIZED PER THE PLUMBING PLAN & INSTALLED IN STRICT ACCORDANCE OF WATER COMPANY REGULATIONS. ANCHOR METER, BACKFLOW PREVENTER, AND PIPING TO THE WALL OR THE FLOOR. CERTIFY THE BACKFLOW PREVENTER PER THE WATER COMPANY'S REQUIREMENTS.

16 P700 **WATER SERVICE ENTRY DETAIL**
NOT TO SCALE

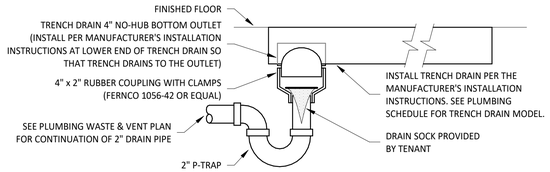

15 P700 **TRENCH DRAIN DETAIL**
NOT TO SCALE

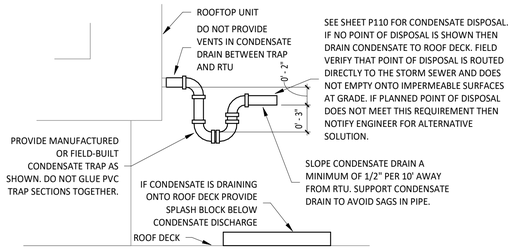

13 P700 **RTU CONDENSATE TRAP DETAIL**
NOT TO SCALE



12 P700 **SODA TERMINATION DETAIL**
NOT TO SCALE

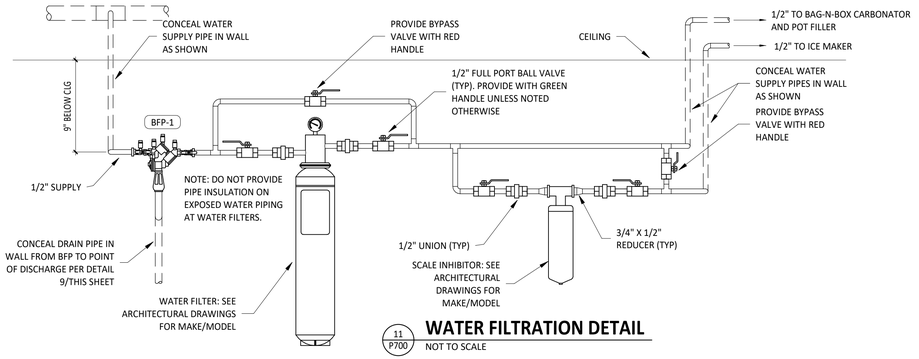

11 P700 **WATER FILTRATION DETAIL**
NOT TO SCALE

14 P700 **NOT USED**
NOT TO SCALE



10 P700 **CHEMICAL DISPENSER DETAIL**
NOT TO SCALE

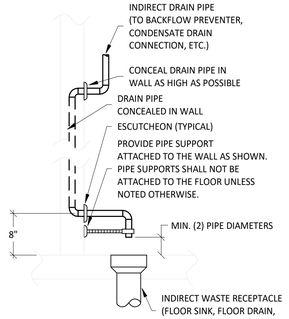

9 P700 **INDIRECT WASTE PIPING DETAIL**
NOT TO SCALE

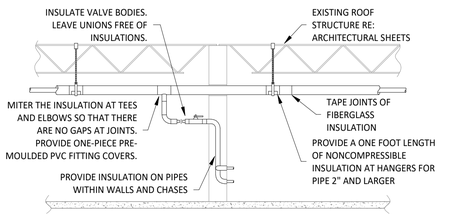

PROVIDE INSULATION ON INTERIOR COLD AND HOT WATER PIPING, CONDENSATE DRAIN PIPE, AND STORM PIPE. REFER TO SPECIFICATIONS FOR FURTHER INFORMATION REGARDING INSULATION. INSTALL ITEMS PER SPECIFICATIONS AND MANUFACTURER'S INSTRUCTIONS. MAINTAIN VAPOR BARRIER ON COLD WATER AND CONDENSATE PIPING BY MEANS OF SEALANT AND TAPE. FLAME SPREAD AND SMOKE-DEVELOPED INDEXES SHALL NOT EXCEED 25/50. SEAL EXPOSED ENDS OF FIBERGLASS INSULATION WITH ADHESIVE MASTIC. UNLESS NOTED OTHERWISE PROVIDE PREFORMED GLASS FIBER PIPE INSULATION WITH PRE-MOLDED PVC JACKETS, SLEEVES, AND FITTING COVERS ON EXPOSED WATER PIPE SO THAT EXPOSED WATER PIPE IS COVERED ENTIRELY WITH PVC INSULATION COVERS.

8 P700 **PIPE INSULATION DETAIL**
NOT TO SCALE

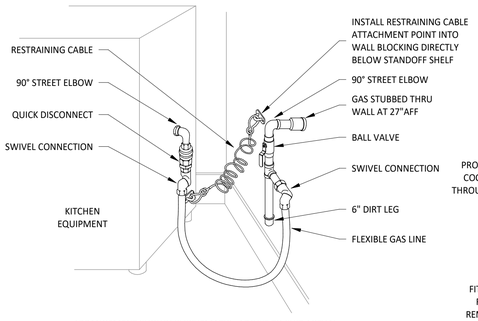

ARRANGEMENT SHOWN IS SCHEMATIC. ADJUST TO SUIT ACTUAL CONDITIONS. MAKE FINAL CONNECTION TO EQUIPMENT AS RECOMMENDED BY MANUFACTURER. PROVIDE WELDED FITTINGS/JOINTS IN ANY CONCEALED, UNSLEEVED LOCATION.

7 P700 **KITCHEN GAS EQUIPMENT DETAIL**
NOT TO SCALE

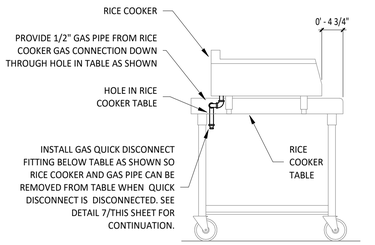

6 P700 **RICE COOKER GAS CONNECTION DETAIL**
NOT TO SCALE

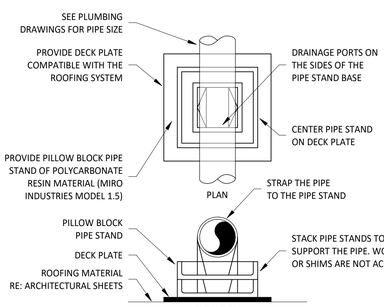

PROVIDE PIPE STANDS AS SHOWN FOR STEEL PIPE FROM 1/2" TO 1-1/2" DIAMETER. SUPPORT SPACING FOR PIPE SIZE: 1/2"=6'; 3/4"-1"=8'; 1 1/4" AND LARGER=10'; PROVIDE DECK PLATES ON ROOFING AND SET PIPE STAND FREE ON DECK PLATES. STACK PIPE STAND WHERE REQUIRED TO ELEVATE PIPING. INSTALL GAS PIPE TO ALLOW FOR EXPANSION AND CONTRACTION.

5 P700 **ROOFTOP PIPING SUPPORT**
NOT TO SCALE

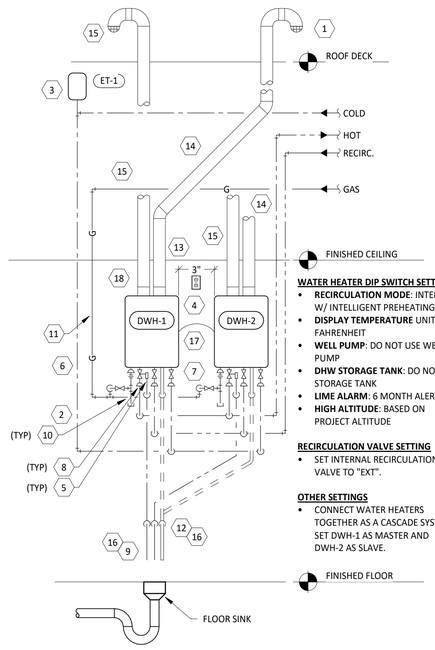

WATER HEATER DETAIL NOTES

1. PROVIDE TWO 90° ELBOWS AND A SCREEN FOR THE FLUE TERMINATION THROUGH THE ROOF PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
2. ROUGH-IN COLD, HOT, AND RECIRC PIPES AT 64" AND GAS PIPE AT 61" BELOW THE FINISHED CEILING.
3. PROVIDE EXPANSION TANK ET-1 AS SHOWN. SUPPORT TANK FROM WALL OR STRUCTURE ABOVE.
4. PROVIDE WATER HEATER RECEPTACLE WITHIN 12" OF THE FINISHED CEILING. FASTEN CORD TIGHT TO THE WALL.
5. PROVIDE PRESSURE RELIEF VALVE. PIPE PRESSURE RELIEF VALVE TO POINT OF DISCHARGE.
6. CONCEAL WATER PIPING WITHIN THE WALL AS SHOWN. INSULATE CONCEALED WATER PIPING. DO NOT PROVIDE INSULATION ON EXPOSED WATER PIPING AT WATER HEATER.
7. INTALL "PLUMB EASY VALVE SET" EXPOSED AT THE COLD AND HOT WATER CONNECTIONS TO THE WATER HEATER AS SHOWN.
8. IF THE PIPE SIZES AS SHOWN ON THE PLUMBING PLANS IS LARGER THAN THE WATER HEATER CONNECTIONS SIZES, PROVIDE REDUCERS WITHIN 6" OF THE WATER HEATER.
9. PIPE PRESSURE RELIEF VALVE DISCHARGE AND FLUE CONDENSATE DRAIN TO THE POINT OF DISCHARGE. DRAIN THROUGH AN AIR GAP.
10. PROVIDE AN EXPOSED DRIP LEG AND LINE-SIZE GAS VALVE ON THE GAS SERVICE TO THE WATER HEATER.
11. CONCEAL GAS PIPING IN THE WALL AS SHOWN.
12. PROVIDE 1/2" PVC PIPE FROM THE FLUE CONDENSATE CONNECTION TO THE POINT OF DISCHARGE. DRAIN THROUGH AN AIR GAP.
13. INSTALL THE TANKLESS WATER HEATER WITH THE TOP OF THE WATER HEATER BETWEEN 9" & 12" OF THE FINISHED CEILING.
14. PROVIDE A 2"Ø PVC PIPE FROM THE TANKLESS WATER HEATER TO THE POINT OF DISCHARGE. SLOPE HORIZONTAL SECTION OF THE FLUE 1/4" PER FOOT TOWARDS THE WATER HEATER.
15. PROVIDE A SCREENED AIR INTAKE WITH TWO 90° ELBOWS ABOVE THE ROOF PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
16. CONCEAL DRAIN LINES IN WALL PER DETAIL 9/THIS SHEET.
17. PROVIDE COMMUNICATION CABLE CONCEALED IN WALL BETWEEN WATER HEATERS.
18. IF WATER HEATERS ARE INSTALLED WITH A COMMON VENT SYSTEM THEN PROVIDE THE NAVIEN COMMON VENT COLLAR KIT WITH BACK-DRAFT DAMPER PER THE MANUFACTURER'S INSTALLATION MANUAL.

WATER HEATER DIP SWITCH SETTINGS

- **RECIRCULATION MODE**: INTERNAL W/ INTELLIGENT PREHEATING
- **DISPLAY TEMPERATURE** UNIT: FAHRENHEIT
- **WELL PUMP**: DO NOT USE WELL PUMP
- **DHW STORAGE TANK**: DO NOT USE STORAGE TANK
- **LIME ALARM**: 6 MONTH ALERT
- **HIGH ALTITUDE**: BASED ON PROJECT ALTITUDE

RECIRCULATION VALVE SETTING

- SET INTERNAL RECIRCULATION VALVE TO "EXT".

OTHER SETTINGS

- CONNECT WATER HEATERS TOGETHER AS A CASCADE SYSTEM. SET DWH-1 AS MASTER AND DWH-2 AS SLAVE.

WATER HEATER GENERAL NOTES

A. CLEAN INLET STRAINERS AFTER CONSTRUCTION HAS BEEN COMPLETED AND PRIOR TO TURNOVER OF THE BUILDING TO THE TENANT.
B. INSTALL PIPING WITH AS FEW ELBOWS AS POSSIBLE.
C. MAINTAIN REQUIRED CLEARANCE TO COMBUSTIBLE MATERIALS.
D. ADJUST WATER HEATER TO A SETPOINT OF 120° F.

1 P700 **WATER HEATER DETAIL**
NOT TO SCALE

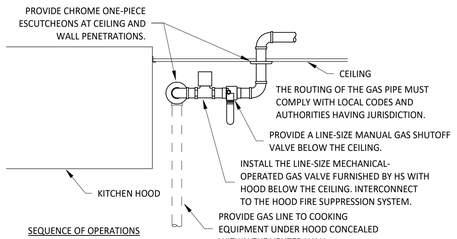

SEQUENCE OF OPERATIONS
NORMAL MODE:
- DURING NORMAL OPERATION THE GAS SHUT-OFF VALVE SHALL BE OPEN.

EMERGENCY MODE:
- UPON ACTUATION OF THE HOOD FIRE SUPPRESSION SYSTEM THE GAS SHUT-OFF VALVE SHALL CLOSE.

4 P700 **KITCHEN GAS SHUTOFF DETAIL**
NOT TO SCALE

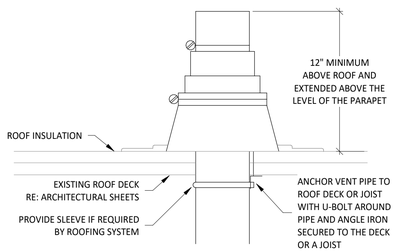

REFER TO PLANS FOR VTR PIPE SIZES AND LOCATIONS. LOCATE VTR MINIMUM TEN FEET HORIZONTAL OR THREE FEET VERTICAL ABOVE ANY BUILDING OPENING OR FRESH AIR INTAKE, AND ONE FOOT FROM ANY VERTICAL SURFACE. PROVIDE 1" FIBERGLASS INSULATION WITH ALL-SERVICE JACKET ON VENT PIPE INSIDE BUILDING WITHIN SIX FEET OF VENT THRU ROOF LOCATION. FLASHING AND COUNTER FLASHING ARE TO BE COMPATIBLE WITH THE ROOFING SYSTEM.

3 P700 **VENT THROUGH ROOF**
NOT TO SCALE

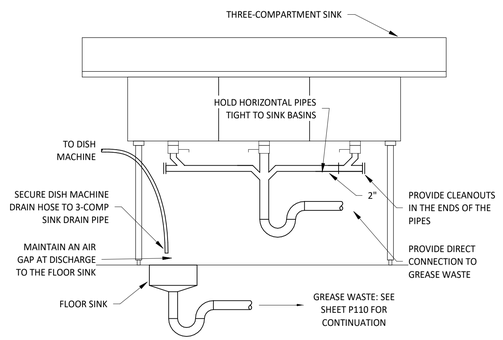

2 P700 **WARE-WASHING SINK DETAIL**
NOT TO SCALE

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

LICENSED PROFESSIONAL ENGINEER
WALTER SHOUP
M 42319
EXP. 03/31/27
MECHANICAL
STATE OF CALIFORNIA

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn: BH | PM: AG | CC: WN | Checked: WS

Project No. 230654

Contents:

PLUMBING DETAILS

P700

SECTION 16011 TEMPORARY & PERMANENT ELECTRICAL SERVICE
PART 1 GENERAL
1.1 DEFINITIONS
A. GFCI: Ground fault current interrupter.
B. RMS: Root Mean Square
C. SPDT: Single Pole, Double Throw
1.2 USE CHARGES
A. General: Cost or use charges for temporary facilities are not chargeable to Tenant, Architect, or Engineer and shall be included in the Contract Sum. Allow other entities to use temporary services and facilities without cost, including, but not limited to, the following:
1. Tenant's construction forces.
2. Occupants of Project.
3. Architect.
4. Engineer.
5. Testing agencies.
6. Personnel of authorities having jurisdiction.
B. Permanent Service: Coordinate with building Tenant and utility company to establish permanent service upon completion of the project. Contractor shall pay for all permits, aid-to-construction charges, and related fees associated with the new service.
1.3 NOTIFICATION
A. Coordinate with Tenant to provide 72 hour written notification to other tenants of any power interruptions. Notification shall state the estimated time and duration of the electrical outage.
1.4 QUALITY ASSURANCE
A. Standards: Comply with ANSI A10.6, NECA's 'Temporary Electrical Facilities," and NFPA 241.
1. Trade Jurisdictions: Assigned responsibilities for installation and operation of temporary utilities are not intended to interfere with trade regulations and union jurisdictions.
2. Electric Service: Comply with NECA, NEMA and UL standards and regulations for temporary electric service. Install service to comply with NFPA 70.
3. Comply with OSHA standards and regulations.
PART 2 PRODUCTS
2.1 MATERIALS
A. Electrical Outlets: Properly configured, NEMA-polarized outlets to prevent insertion of 110- to 120-V plugs into higher-voltage outlets; equipped with ground-fault circuit interrupters, reset button, and pilot light.
B. Power Distribution System Circuits: Where permitted and overhead and exposed for surveillance, wiring circuits, not exceeding 125-V ac, 20-A rating, and lighting circuits may be nonmetallic sheathed cable.
C. Main panelboard with disconnect.
D. Temporary lighting.
E. 120 volt receptacles with overcurrent protection.
F. Enclosures. NEMA AB 1 and NEMA KS 1 to meet environmental conditions of installed location.
1. Outdoor Locations: NEMA 250, Type 3R.
PART 3 EXECUTION
3.1 INSTALLATION
A. Electric Power Service: Provide weatherproof, grounded electric power service and distribution system of sufficient size, capacity, and power characteristics during construction period. Include meters, transformers, and overload-protected disconnecting means.
1. Install power distribution wiring overhead and rise vertically where least exposed to damage.
B. Electric Distribution: Provide receptacle outlets adequate for connection of power tools and equipment.
1. Provide waterproof connectors to connect separate lengths of electrical power cords if single lengths will not reach areas where construction activities are in progress. Do not exceed safe length-voltage ratio.
2. Provide metal conduit, tubing, or metallic cable for wiring exposed to possible damage. Provide rigid steel conduits for wiring exposed on grades, floors, decks, or other traffic areas.
3. Provide metal conduit enclosures or boxes for wiring devices.
4. Provide 4-gang outlets, spaced so 1 DO-foot (30-m) extension cord can reach each area for power hand tools and task lighting. Provide a separate 125-V ac, 20-A circuit for each outlet.
C. Lighting: Provide temporary lighting with local switching that provides adequate illumination for construction operations and traffic conditions.
1. Install and operate temporary lighting that fulfills security and protection requirements without operating entire system.
2. Provide one 100-W incandescent lamp (or equivalent) every 50 feet (15 m) in traffic areas.
3. Install exterior-yard site lighting that will provide adequate illumination for construction operations, parking and traffic conditions, and signage visibility when the Work is being performed.
END OF SECTION 16011

SECTION 16060 - GROUNDING AND BONDING
PART 1 - GENERAL
1.1 SUMMARY
A. This Section includes grounding of electrical systems and equipment. Grounding requirements specified in this Section may be supplemented by special requirements of systems described in other Sections.
1.2 QUALITY ASSURANCE
A. Testing Agency Qualifications: Testing agency as defined by OSHA in 29 CFR 1910.7 or a member company of the International Electrical Testing Association and that is acceptable to authorities having jurisdiction.
1. Testing Agency's Field Supervisor: Person currently certified by the International Electrical Testing Association to supervise on-site testing specified in Part 3.
B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
1. Comply with UL 467.
PART 2 - PRODUCTS
2.1 GROUNDING CONDUCTORS
A. For insulated conductors, comply with Division 16 Section "Wiring Methods."
B. Material: Copper.
C. Equipment Grounding Conductors: Insulated with green-colored insulation.
D. Grounding Electrode Conductors: Stranded cable.
E. Bare Copper Conductors: Comply with the following:
1. Solid Conductors: ASTM B 3.
2. Assembly of Stranded Conductors: ASTM B 8.
2.2 CONNECTOR PRODUCTS
A. Comply with IEEE 837 and UL 467; listed for use for specific types, sizes, and combinations of conductors and connected items.
PART 3 - EXECUTION
3.1 APPLICATION
A. Use only copper conductors.
B. In raceways, use insulated equipment grounding conductors.
C. Equipment Grounding Conductor Terminations: Use bolted pressure clamps.
D. Grounding Bus: Install in electrical and telephone equipment rooms, in rooms housing service equipment, and elsewhere as indicated.
1. Use insulated spacer; space 1 inch from wall and support from wall 6 inches above finished floor, unless otherwise indicated.
2. At doors, route the bus up to the top of the door frame, across the top of the doorway, and down to the specified height above the floor.
3.2 EQUIPMENT GROUNDING CONDUCTORS
A. Comply with NFPA 70, Article 250, for types, sizes, and quantities of equipment grounding conductors, unless specific types, larger sizes, or more conductors than required by NFPA 70 are indicated.
3.3 INSTALLATION
A. Grounding Conductors: Route along shortest and straightest paths possible, unless otherwise indicated. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.
3.4 CONNECTIONS
A. General: Make connections so galvanic action or electrolysis possibility is minimized. Select connectors, connection hardware, conductors, and connection methods so metals in direct contact will be galvanically compatible.
B. Equipment Grounding Conductor Terminations: For No. 8 AWG and larger, use pressure-type grounding lugs. No. 10 AWG and smaller grounding conductors may be terminated with winged pressure-type connectors.
C. Tighten screws and bolts for grounding and bonding connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A.
D. Compression-Type Connections: Use hydraulic compression tools to provide correct circumferential pressure for compression connectors. Use tools and dies recommended by connector manufacturer. Provide embossing die code or other standard method to make a visible indication that a connector has been adequately compressed on grounding conductor.
END OF SECTION 16060

SECTION 16100 - WIRING METHODS
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Summary: Building wire and cable and associated splices, connectors, and terminations for wiring systems rated 600 V and less, and twisted-pair cable; and raceways and boxes.
PART 2 - PRODUCTS
2.1 WIRES AND CABLES
A. Connectors and Splices: Wiring connectors of size, ampacity rating, material, and type and class for application and for service indicated.
2.2 RACEWAYS
A. Wireways: Screwed cover type, with manufacturers standard finish.
B. Outlet and Device Boxes: Sheet metal boxes, except use cast-metal boxes at exterior, interior exposed, and interior damp locations.
C. Pull and Junction Boxes: Sheet metal boxes, except use nonmetallic boxes with gasketed covers at exterior and interior damp locations.
2.3 ENCLOSURES
A. Hinged-Cover Enclosures: NEMA 250, steel enclosure with continuous hinge cover and flush latch. Finish inside and out with manufacturer's standard enamel.
B. Cabinets: NEMA 250, Type 1, unless otherwise indicated.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install wires and cables according to the NECA's "Standard of Installation.
B. Wiring at Outlets: Install with at least 12 inches of slack conductor at each outlet.
C. Conceal wiring, unless otherwise indicated, within finished walls, ceilings, and floors.
D. Boxes and Enclosures: In damp or wet locations use NEMA 250, Type 4, stainless steel.
E. Use raceway fittings compatible with raceway and suitable for use and location. For intermediate metal conduit, use threaded rigid steel conduit fittings, unless otherwise indicated.
F. Raceways Embedded in Slabs: Install in middle third of the slab thickness where practical, and leave at least 1 -inch concrete cover.
G. Install exposed raceways parallel to or at right angles to nearby surfaces or structural members, and follow the surface contours as much as practical.
H. Join raceways with fittings designed and approved for the purpose and make joints tight. Use bonding bushings or wedges at connections subject to vibration. Use bonding jumpers where joints cannot be made tight. Use insulating bushings to protect conductors.
I. Install pull wires in empty raceways. Use No. 14 AWG zinc-coated steel or monofilament plastic line having not less than 200-lb tensile strength. Leave not less than 18 inches of slack at each end of the pull wire.
J. Install raceway sealing fittings where required by the NEC and at wiring entrances to refrigerated spaces. Locate at suitable, approved, accessible locations and fill them with UL-listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces.
K. Stub-up Connections for Equipment: Extend conductors to equipment with rigid metal conduit; flexible metal conduit may be used 3 inches above the floor.
L. Install a separate green ground conductor in surface metal raceway from the junction box supplying the raceway to receptacle and fixture ground terminals.
3.2 IDENTIFICATION MATERIALS AND DEVICES
A. Install at locations for most convenient viewing without interference with operation and maintenance of equipment.
B. Coordinate names, abbreviations, colors, and other designations used for electrical identification with corresponding designations indicated in the Contract Documents or required by codes and standards. Use consistent designations throughout Project.
C. Identify raceways and cables with color banding as follows:
1. Bands: Pretensioned, snap-around, colored plastic sleeves or colored encircling conduit, and place adjacent bands of two-color markings in contact, side by side.
2. Band Locations: At changes in direction, at penetrations of walls and floors, at 50-foot maximum intervals in straight runs, and at 25-foot maximum intervals in congested areas.
3. Colors: As follows:
a. Telecommunication System: Green and yellow.
D. Color-code System secondary service, feeder, and branch-circuit conductors throughout the secondary electrical system as follows:

		120/208V	277/480V
1.	Phase A:	Black	Brown
2.	Phase B:	Red	Orange
3.	Phase C:	Blue	Yellow
4.	Neutral:	White	Gray
5.	Ground:	Green	Green

END OF SECTION 16100

SECTION 16140 - WIRING DEVICES
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals: None.
B. Comply with NEMA WD 1.
C. Comply with NFPA 70.
PART 2 - PRODUCTS
2.1 DEVICES
A. General: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction.
B. Color: Per Material Schedule on sheet E010.
C. Receptacles: Heavy- Duty grade, NEMA WD6, Configuration 5-20R unless otherwise indicated.
D. Ground-Fault Circuit Interrupter Receptacles: integral duplex receptacle; for installation in box without an adapter. Feed-through type, with a 2-3/4-inch- deep outlet
E. Isolated-Ground Receptacles: Equipment grounding contacts connected only to the green grounding screw terminal of the device with inherent electrical isolation from mounting strap.
F. Snap Switches: Heavy-duty, quiet type.
G. Wall Plate: Per Material Schedule on sheet E010.
H. Floor Service Fittings: Modular, above-floor, dual-service units suitable for wiring method used.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install devices and assemblies plumb and secure.
B. Mount devices flush with long dimension vertical unless otherwise indicated.
C. Protect devices and assemblies during painting.
D. Install wall plates when painting is complete and paint is cured.
END OF SECTION 16140

BUILDING CODE DATA

	CODE	
GENERAL	CALIFORNIA BUILDING CODE	2022
HVAC/MECHANICAL	CALIFORNIA MECHANICAL CODE	2022
PLUMBING	CALIFORNIA PLUMBING CODE	2022
ELECTRICAL	CALIFORNIA ELECTRICAL CODE	2022
FIRE PROTECTION	CALIFORNIA FIRE CODE	2022
	NFPA STANDARDS	CURRENT
FUEL	CALIFORNIA FUEL GAS CODE	2022
ENERGY	CALIFORNIA ENERGY CODE	2022
LOCAL AMENDMENTS	TITLE 19.04 - BUILDING REGULATIONS	2024

NOTES:
A. ALL WORK PERFORMED SHALL COMPLY WITH THE REQUIREMENTS OF THE LISTED CODES, LOCAL CODE AMENDMENTS, AND REFERENCED STANDARDS AS ENFORCED BY THE AUTHORITY HAVING JURISDICTION (AHJ).
B. ALL WORK SUBJECT TO INSPECTION BY THE AHJ AT THE PROJECT SITE FOR COMPLIANCE.

SECTION 16442 - PANELBOARDS
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals: None.
B. Comply with NFPA 70.
C. Comply with NEMA PB 1.
PART 2 - PRODUCTS
2.1 PANELBOARDS AND LOAD CENTERS
A. Manufacturers: Subject to compliance with requirement, provide products by one of the following:
1. Panelboards, Overcurrent Protective Devices, Controllers, Contactors, and Accessories:
a. Square D Co.
b. Eaton Corp.; Cutler-Hammer Products.
c. General Electric Co.; Electrical Distribution & Control Div.
d. Siemens Energy & Automation.
B. Recessed, NEMA PB 1, Type 1.
1. Load Center Capacity: as shown on drawings.
2. Front: Secured to box with concealed trim clamps.
3. Doors: With concealed hinges, flush catches, and tumbler locks, all keyed alike.
4. Bus: Hard drawn copper of 98 percent conductivity.
C. Molded-Case Circuit Breakers: NEMA AB 1, plug-in type, Single-handle for multipole circuit breakers. Appropriate for application, including Type SWD for repetitive switching lighting loads and Type HACR for heating, air-conditioning, and refrigerating equipment.
D. Contactors: NEMA ICS 2, Class A combination contactors.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install panelboards and accessory items according to NEMA PB 1.1. Provide typed, permantently-mounted English and Spanish circuit directories showing the panel schedules as installed in each panelboard.
B. Mounting Heights: Top of trim 74 inches above finished floor, unless otherwise indicated.
C. Future Circuit Provisions at Flush Panel boards: Stub four empty 3/4-inch conduits from panelboard into accessible or designated ceiling space.
D. Wiring in Panelboard Gutters: Arrange conductors into groups, bundle and wrap with wire ties according to NEC guidelines.
E. Tighten electrical connectors and terminals, including grounding connections, according to manufacturer's published torque-tightening values. Where manufacturer's torque values are not indicated, use those specified in UL 486A.
F. Perform visual and mechanical inspections and electrical tests stated in NETA ATS.
END OF SECTION 16442

SECTION 16500 - LIGHTING
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals: None.
B. Fixtures, Emergency Lighting Units, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction.
C. Coordinate ceiling-mounted luminaires with ceiling construction, mechanical work, and security and fire-prevention features mounted In ceiling space and on ceiling.
PART 2 - PRODUCTS
2.1 FIXTURES AND FIXTURE COMPONENTS, GENERAL
A. Metal Parts: Free from burrs, sharp corners, and edges. Steel, unless otherwise indicated. Form and support to prevent warping and sagging.
B. Doors, Frames, and Other Internal Access: Smooth operating, free from light leakage under operating conditions, and arranged to permit re-lamping without use of tools. Arrange doors, frames, lenses, diffusers, and other pieces to prevent accidental falling during re-lamping and when secured in operating position.
C. Lenses, Diffusers, Covers, and Globes: 100 percent virgin acrylic plastic or annealed crystal glass, unless otherwise indicated.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Set units level, plumb, and square with ceiling and walls, and secure.
B. Support for Recessed and Semirecessed Grid-Type Fluorescent Fixtures: Install ceiling support system rods or wires at a minimum of 4 rods or wires for each fixture, located not more than 6 inches from fixture corners.
C. Support for Suspended Fixtures: Support according to manufacturers' recommendations.
D. Lamping: Where specific lamp designations are not indicated, lamp units according to manufacturer's written instructions.
END OF SECTION 16500

ELECTRICAL SYMBOLS

- CONDUIT CONCEALED ABOVE THE CEILING, IN A WALL, OR IN A RACEWAY
- CONDUIT CONCEALED BELOW THE SLAB
- A-6 — HOME-RUN TO PANELBOARD AND CIRCUIT NUMBER SHOWN
- # — PLAN NOTE: SEE PLAN NOTES LISTED ON THE SAME SHEET FOR NOTE MEANING
- X/Y/Z — DISCONNECT SWITCH: X = SWITCH RATING; Y = FUSE SIZE (NF = NON-FUSED); Z = NUMBER OF POLES
- JUNCTION BOX
- ELECTRIC PANELBOARD
- $ — GENERAL PURPOSE 1-POLE SWITCH
- $M — MANUAL STARTER WITH PILOT LIGHT
- NEMA 5-20R 1-PLEX RECEPTACLE
- NEMA 5-20R DUPLEX RECEPTACLE
- NEMA 5-20R DUPLEX GFCI RECEPTACLE
- NEMA 5-20R DOUBLE-DUPLEX RECEPTACLES
- IG/GFI — NEMA 5-20R DUPLEX COMBINATION ISOLATED GROUND/GFI RECEPTACLE PASS & SEYMOUR MODEL#2095IGTRGRY (GRAY)
- OTHER RECEPTACLE - SEE PLAN FOR RATING AND TYPE
- JUNCTION BOX FOR RJ-45 DATA OUTLETS. PROVIDE 1" CONDUIT WITH PULL STRING FROM J-BOX TO ABOVE OFFICE CEILING. TERMINATE CONDUIT WITH CONDUIT BUSHING.
- DOUBLE GANG JUNCTION BOX FOR RJ-45 DATA OUTLETS. PROVIDE 1" CONDUIT WITH PULL STRING FROM J-BOX TO ABOVE OFFICE CEILING. TERMINATE CONDUIT WITH CONDUIT BUSHING.
- JUNCTION BOX FOR RJ-11 TELEPHONE OUTLETS. PROVIDE 1" CONDUIT WITH PULL STRING FROM J-BOX TO ABOVE OFFICE CEILING. TERMINATE CONDUIT WITH CONDUIT BUSHING.
- KP — SECURITY SYSTEM KEYPAD: SEE ELECTRICAL POWER PLAN FOR MORE INFORMATION.
- DC — SECURITY SYSTEM DOOR CONTACT: SEE ELECTRICAL POWER PLAN FOR MORE INFORMATION.

ELECTRICAL GENERAL NOTES

A GENERAL NOTES APPLY TO ELECTRICAL SHEETS.
B ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH THE ELECTRICAL CODE AND IN ACCORDANCE WITH THE AUTHORITY HAVING JURISDICTION. SEE ARCHITECTURAL SHEETS FOR THE PREVAILING CODES.
C WIRING SHALL BE (2)#12, #12 G IN 3/4" C UNLESS NOTED OTHERWISE.
D INDIVIDUAL CONDUIT HOME RUNS SHOWN SHALL NOT BE CONSOLIDATED.
E CIRCUIT EMERGENCY LIGHTS, ILLUMINATED EXIT SIGNS, AND NIGHT LIGHTS AHEAD OF LOCAL SWITCHING.
F INSTALL WALL SWITCHES AT 48" AFF TO CENTER OF SWITCH AND RECEPTACLES AT 18" AFF TO CENTER OF RECEPTACLE UNLESS NOTED OTHERWISE.
G INSTALL ALL CONDUIT AND LOW VOLTAGE WIRING CONCEALED ABOVE THE CEILING, IN WALLS, OR IN RACEWAYS.
H PROVIDE 1" CONDUIT WITH PULL STRING FROM EACH J-BOX FOR TELEPHONE OR DATA JACKS TO ABOVE OFFICE CEILING. SEE MATERIAL SCHEDULE FOR ALLOWABLE CONDUIT MATERIALS. PROVIDE CONDUITS WITH MINIMAL ELBOWS AND TERMINATE CONDUITS ABOVE OFFICE CEILING WITH CONDUIT BUSHING.
I THE TERM "FURNISH" MEANS SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS. THE TERM "INSTALL" DESCRIBES THE OPERATIONS AT THE PROJECT SITE INCLUDING THE ACTUAL UNLOADING, UNPACKING, ASSEMBLY, ERECTING, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, AND SIMILAR OPERATIONS. THE TERM "PROVIDE" MEANS TO FURNISH AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE.
J DIMENSIONS SHOWN IN ELECTRICAL ELEVATIONS ARE FROM THE WALL FRAMING UNLESS NOTED OTHERWISE.
K INSTALL LABELING CALLED FOR IN THE ELECTRICAL DRAWINGS USING ENGRAVED PHENOLIC PLATES FURNISHED BY TSV ON WALL IMMEDIATELY ABOVE RECEPTACLES.
L IF THERE ARE RATED ASSEMBLIES WITHIN CHIPOTLE'S SPACE COORDINATE ANY REQUIRED CONDUIT RUNS WITH SECURITY VENDOR.

ELECTRICAL MATERIAL SCHEDULE

	APPLICATION	ALLOWABLE MATERIAL
CONDUCTORS		
	#8 AWG AND LARGER	STRANDED CU, TYPE THHN/THWN OR XHHW
	#10 AWG AND SMALLER	SOLID CU, TYPE THHN/THWN OR XHHW
	FIELD-MADE CORD (EXPOSED INDOOR LOCATIONS)	TYPE SO OR SJO SERVICE CORD WITH CU CONDUCTORS
CONDUITS		
	CONNECTION TO VIBRATING EQUIPMENT (EXPOSED INDOOR DRY LOCATIONS)	FLEXIBLE METAL CONDUIT
	CONNECTION TO VIBRATING EQUIPMENT (EXPOSED WET OR DAMP LOCATIONS)	LIQUIDTIGHT FLEXIBLE METAL CONDUIT
	INDOOR, CONCEALED ABOVE GRADE	ELECTRICAL METALLIC TUBING, FLEXIBLE METAL CONDUIT, OR METAL CLAD CABLE
	INDOOR, EXPOSED	ELECTRICAL METALLIC TUBING U.N.O.
	INDOOR, WITHIN 1-1/2" OF ROOF DECK	INTERMEDIATE METAL CONDUIT
	LOW OR LINE VOLTAGE, BELOW GRADE	RIGID NONMETALLIC CONDUIT (SCHEDULE 40 PVC)
	LOW VOLTAGE, INDOOR, ABOVE GRADE	ELECTRICAL METALLIC TUBING
	OUTDOOR, ABOVE GRADE, EXPOSED OR CONCEALED	INTERMEDIATE METAL CONDUIT
WIRING DEVICES		
	IG OR IG/GFI RECEPTACLES	GRAY DEVICE WITH STAINLESS STEEL COVER PLATE
	IN KITCHEN, OFFICE, OR NON-PUBLIC SPACES	GRAY DEVICE WITH STAINLESS STEEL COVER PLATE
	IN RESTROOMS	WHITE DEVICE WITH WHITE COVER PLATE
	ON DRYWALL IN DINING ROOM	WHITE DEVICE WITH WHITE COVER PLATE
	ON HOT ROLLED STEEL, RICHLITE, OR OTHER BLACK FINISHES	BLACK DEVICE WITH BLACK COVER PLATE

ELECTRICAL ABBREVIATIONS

(E)	EXISTING
ABV	ABOVE
ADA	AMERICANS WITH DISABILITIES ACT
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHJ	AUTHORITY HAVING JURISDICTION
BFF	BELOW FINISHED FLOOR
BFG	BELOW FINISHED GRADE
BOH	BACK OF HOUSE
CLG	CEILING
CTE	CONNECT TO EXISTING
DN	DOWN
EXT'G	EXISTING
FLR	FLOOR
FOH	FRONT OF HOUSE
GFCI	GROUND FAULT CURRENT INTERRUPTER
GYP	GYPSUM BOARD
IG	ISOLATED GROUND
NF	NON-FUSED
NL	NIGHT LIGHT
NTS	NOT TO SCALE
O/H	OVERHEAD
TYP	TYPICAL
U/G	UNDERGROUND
UNO	UNLESS NOTED OTHERWISE
W/	WITH
WIC	WALK-IN COOLER
WP	WEATHERPROOF
C02AS	TENANT'S CO2 ALARM SUPPLIER
GC	GENERAL CONTRACTOR
HES	TENANT'S HVAC EQUIPMENT SUPPLIER
HS	TENANT'S HOOD SUPPLIER
KES	TENANT'S KITCHEN EQUIPMENT SUPPLIER
LL	LANDLORD
MSS	TENANT'S MUSIC SYSTEMS SUPPLIER
SPS	TENANT'S SODA POP SUPPLIER
TAB	TENANT'S TEST AND BALANCE VENDOR
TCC	TENANT'S CABLING CONTRACTOR
TDC	TENANT'S DUCT CLEANER
TEMS	TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER
TLS	TENANT'S LIGHT/LAMP SUPPLIER
TMB	TENANT'S MENU BOARD SUPPLIER
TMS	TENANT'S MILLWORK SUPPLIER
TP	TENANT'S PHONE SUPPLIER
TPS	TENANT'S PANELBOARD SUPPLIER
TRS	TENANT'S RAILING SUPPLIER
TSV	TENANT'S SIGN VENDOR
TUV	TENANT'S UV SNAITIZER SUPPLIER
WCS	TENANT'S WALK-IN COOLER SUPPLIER
WHS	TENANT'S WATER HEATER SUPPLIER

PROJECT DESCRIPTION

THIS PROJECT CONSISTS OF A RESTAURANT TENANT FINISH OF AN EXISTING BUILDING. THE NEW ELECTRICAL WORK INCLUDES, ELECTRICAL PANELBOARD(S), ROOF TOP HVAC EQUIPMENTS, POWER, GENERAL LIGHTING, GENERAL POWER FOR DINING AREA AND SPECIALTY POWER FOR THE KITCHEN AND PREPARATION AREAS. THERE IS ALSO A NEW HOOD POWER AND ANSUL SYSTEM. EXISTING ELECTRICAL SERVICE AND EXTERIOR ELECTRICAL WORK HAS BEEN FURNISHED BY LANDLORD.

BASIC LIFE-SAFETY INFRINGEMENT STATEMENT

IT IS THE DESIGN PROFESSIONAL'S JUDGEMENT, WHOSE SIGNATURE APPEARS ON THE DRAWING, THAT THE DESIGN DESCRIBED IN THIS SET OF DRAWINGS AND SPECIFICATIONS DOES NOT ADVERSELY INFRINGE ON THE BASIC LIFE-SAFETY SYSTEM OF THE BUILDING.

ENGINEER OF RECORD: _____ DATE: 02/24/2025

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

REGISTERED PROFESSIONAL ENGINEER
RAI-HUNG KUO
No. E 25775
EXP. 08/30/27
ELECTRICAL
STATE OF CALIFORNIA
02/25/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL
CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

A Revisions:

Drawn: KRG | PM: AG | CC: WN | Checked: WN

Project No.
230654

Contents:
ELECTRICAL SPECIFICATIONS

E010

STATE OF CALIFORNIA
Indoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-LTI-E
This document is used to demonstrate compliance with requirements in 110.9, 110.12(c), 130.0, 130.1, 140.6 and 141.0(b)2 for indoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e) and 180.2(b)4 for indoor lighting scopes using the prescriptive path for multifamily occupancies. Multifamily includes dormitory and senior living facilities.	
Project Name: CMG Sir Francis Drake	**Report Page:** (Page 1 of 8)
Project Address:	**Date Prepared:** 2025-02-24T12:37:40-05:00

A. GENERAL INFORMATION

01	Project Location (city)	Greenbrae	04	Total Conditioned Floor Area (ft²)	3,016
02	Climate Zone	2	05	Total Unconditioned Floor Area (ft²)	0
03	Occupancy Types Within Project (select all that apply):		06	# of Stories (Habitable Above Grade)	0
● Restaurant					

B. PROJECT SCOPE

This table includes any lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.6 / 170.2(e) or 141.0(b)2 / 180.2(b)4 for alterations.

Scope of Work	Conditioned Spaces		Unconditioned Spaces	
01	02	03	04	05
My Project Consists of (check all that apply):	Calculation Method	Area (ft²)	Calculation Method	Area (ft²)
☒ New Lighting System	Area Category Method	3016	N/A	0
☐ New Lighting System - Parking Garage	N/A	0	N/A	0
Total Area of Work (ft²)	3016			

STATE OF CALIFORNIA
Indoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-LTI-E
Project Name: CMG Sir Francis Drake	**Report Page:** (Page 8 of 8)
Project Address:	**Date Prepared:** 2025-02-24T12:37:40-05:00

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: WAI-HUNG NG	Documentation Author Signature:
Company: Bowman Consulting Group Ltd.	Signature Date: 02/24/2025
Address: 1490 W 121st Ave, Ste. 204	CEA/ HERS Certification Identification (if applicable):
City/State/Zip: Westminster, CO 80234	Phone: 303-678-1108

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

1. The information provided on this Certificate of Compliance is true and correct.
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: WAI-HUNG NG	Responsible Designer Signature:
Company: Bowman Consulting Group Ltd.	Date Signed: 02/24/2025
Address: 1490 W 121st Ave, Ste. 204	License: 25275
City/State/Zip: Westminster, CO 80234	Phone: 303-678-1108

STATE OF CALIFORNIA
Indoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-LTI-E
Project Name: CMG Sir Francis Drake	**Report Page:** (Page 3 of 8)
	Date Prepared: 2025-02-24T12:37:40-05:00

F. INDOOR LIGHTING FIXTURE SCHEDULE

This table includes all planned permanent and portable lighting other than dwelling unit/ hotel/ motel room lighting. Multifamily dwelling unit and hotel/motel room lighting is documented in Table T. If using Table T to document lighting in multifamily common use areas providing shared provisions for living, eating, cooking or sanitation, those luminaires are not included here.

Designed Wattage: Conditioned Spaces

01	02	03	04	05	06	07	08	09	10	
Name or Item Tag	Complete Luminaire Description	Modular (Track) Fixture	Small Aperture & Color Change[1]	Watts per luminaire[2]	How is Wattage determined	Total Number of Luminaires	Excluded per 140.6(a)3 / 170.2(e)2C	Design Watts	Field Inspector	
									Pass	Fail
A1	2x2 LED Lensed Troffer	No	NA	30	Mfr. Spec	12	No	360	☐	☐
B1	Recessed 6in Can Light	No	NA	17	Mfr. Spec	9	No	153	☐	☐
B2	Recessed 6in Can Light	No	NA	17	Mfr. Spec	27	No	459	☐	☐
B3	M4.0 - Recessed 6in Can Light (Black)	No	NA	12	Mfr. Spec	3	No	36	☐	☐
C0	Low Profile LED 1ft	No	NA	5	Mfr. Spec	2	No	10	☐	☐
C2	Low Profile LED 3ft	No	NA	12	Mfr. Spec	4	No	48	☐	☐
C3	Low Profile LED 4ft	No	NA	15	Mfr. Spec	5	No	75	☐	☐
C4	Low Profile LED 5ft	No	NA	18	Mfr. Spec	16	No	288	☐	☐
H1	Vapor Proof Hood Light	No	NA	15	Mfr. Spec	8	Exempt	---	☐	☐
J4	Decorative Pendant	No	NA	9	Mfr. Spec	2	No	18	☐	☐
P3	Accent Light - Artwork Light Fixture	No	NA	20	Mfr. Spec	4	No	80	☐	☐
P5	Pendant	No	NA	5	Mfr. Spec	4	No	20	☐	☐
W1	WIC LED Light	No	NA	29	Mfr. Spec	4	No	116	☐	☐
							Total Designed Watts: CONDITIONED SPACES	1,663		

[1]*FOOTNOTE: Design Watts for small aperture and color changing luminaires which qualify per 140.6(a)4B / 170.2(e)2D is adjusted to be 75% /80% of their rated wattage. Table F automatically makes this adjustment, the permit applicant should enter full rated wattage in column 05.*

[2]*Authority Having Jurisdiction may ask for Luminaire cut sheets to confirm wattage used for compliance per 130.0(c) / 160.5(b). Wattage used must be the maximum rated for the luminaire, not the lamp.*

STATE OF CALIFORNIA
Indoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-LTI-E
Project Name: CMG Sir Francis Drake	**Report Page:** (Page 4 of 8)
	Date Prepared: 2025-02-24T12:37:40-05:00

G. MODULAR LIGHTING SYSTEMS

This section does not apply to this project.

H. INDOOR LIGHTING CONTROLS (Not including PAFs)

This table includes lighting controls for conditioned and unconditioned spaces.

Building Level Controls

01	02	03	
		Field Inspector	
		Pass	Fail
Mandatory Demand Response 110.12(c)	Shut-off controls 130.1(c) / 160.5(b)4C		
NA < 4,000W subject to multilevel	See Area/Space Level Controls	☐	☐

Area Level Controls

04	05	06	07	08	09	10	11	12	
Area Description	Complete Building or Area Category Primary Function Area	Manual Area Controls 130.1(a) / 160.5(b)4A	Multi-Level Controls 130.1(b) / 160.5(b)4B	Shut-Off Controls 130.1(c) // 160.5(b)4C	Primary/Sky lit Daylighting 130.1(d) / 160.5(b)4D	Secondary Daylighting 130.1(d) / 160.5(b)4D	Interlocked Systems 140.6(a)1/ 170.2(e)2A	Field Inspector	
								Pass	Fail
KITCHEN	Kitchen/ Food Preparation	Auth. Personnel	Dimmer	Auto. Time Switch	NA: Not daylit zone	NA: Not daylit zone	No	☐	☐
Dining	Dining - Family	Auth. Personnel	Dimmer	Auto. Time Switch	Included	Included	Yes	☐	☐
					13				
					Plan Sheet Showing Daylit Zones:				
					E100				

STATE OF CALIFORNIA
Indoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-LTI-E
Project Name: CMG Sir Francis Drake	**Report Page:** (Page 5 of 8)
	Date Prepared: 2025-02-24T12:37:40-05:00

I. LIGHTING POWER ALLOWANCE: COMPLETE BUILDING OR AREA CATEGORY METHODS

Each area complying using the Complete Building or Area Category Methods per 140.6(b) are included in this table. Column 06 indicates if additional lighting power allowances per 140.6(c) or adjustments per 140.6(a) are being used .

Conditioned Spaces

01	02	03	04	05	06	
Area Description	Complete Building or Area Category Primary Function Area	Allowed Density (W/ft²)	Area (ft²)	Allowed Wattage (Watts)	Additional Allowance / Adjustment	
					Area Category	PAF
KITCHEN	Kitchen/ Food Preparation	0.95	1,340	1,273	No	No
Dining	Dining - Family	0.4	985	394	No	No
		TOTALS:	2,325	1,667	See Tables J, or P for detail	

J. ADDITIONAL ALLOWANCE: AREA CATEGORY METHOD QUALIFYING LIGHTING SYSTEM

This section does not apply to this project.

K. TAILORED METHOD GENERAL LIGHTING POWER ALLOWANCE

This section does not apply to this project.

L. ADDITIONAL LIGHTING ALLOWANCE: TAILORED WALL DISPLAY

This section does not apply to this project.

M. ADDITIONAL LIGHTING ALLOWANCE: TAILORED FLOOR AND TASK LIGHTING

This section does not apply to this project.

N. ADDITIONAL LIGHTING ALLOWANCE: TAILORED DECORATIVE /SPECIAL EFFECTS

This section does not apply to this project.

STATE OF CALIFORNIA
Indoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-LTI-E
Project Name: CMG Sir Francis Drake	**Report Page:** (Page 6 of 8)
	Date Prepared: 2025-02-24T12:37:40-05:00

O. ADDITIONAL LIGHTING ALLOWANCE: TAILORED VERY VALUABLE MERCHANDISE

This section does not apply to this project.

P. POWER ADJUSTMENT: LIGHTING CONTROL CREDIT (POWER ADJUSTMENT FACTOR (PAF))

This section does not apply to this project.

Q. RATED POWER REDUCTION COMPLIANCE FOR ONE-FOR-ONE ALTERATIONS

This section does not apply to this project.

R. 80% LIGHTING POWER FOR ALL ALTERATIONS - CONTROLS EXCEPTIONS

This section does not apply to this project.

S. DAYLIGHT DESIGN POWER ADJUSTMENT FACTOR (PAF)

This section does not apply to this project.

T. DWELLING UNIT LIGHTING

This section does not apply to this project.

U. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION

Selections have been made based on information provided in this document. If any selections have been changed by permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and can be found online

Form/Title
NRCI-LTI-E - Must be submitted for all buildings

STATE OF CALIFORNIA
Indoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-LTI-E
Project Name: CMG Sir Francis Drake	**Report Page:** (Page 7 of 8)
	Date Prepared: 2025-02-24T12:37:40-05:00

V. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in this document. If any selections have been changed by the permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and any with "-A" in the form name must be completed through an Acceptance Test Technician Certification Provider (ATTCP). For more information visit: http://www.energy.ca.gov/title24/attcp/providers.html

Form/Title	Systems/Spaces To Be Field Verified
NRCA-LTI-02-A - Must be submitted for occupancy sensors and automatic time switch controls.	KITCHEN; Dining
NRCA-LTI-03-A - Must be submitted for automatic daylight controls.	Dining
NRCA-LTI-04-A - Must be submitted for demand responsive lighting controls.	Dining

STATE OF CALIFORNIA
Indoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-LTI-E
Project Name: CMG Sir Francis Drake	**Report Page:** (Page 2 of 8)
	Date Prepared: 2025-02-24T12:37:40-05:00

C. COMPLIANCE RESULTS

If any cell on this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D. for guidance.

Lighting in conditioned and unconditioned spaces must not be combined for compliance per 140.6(b)1 / 170.2(e)	Allowed Lighting Power per 140.6(b) / 170.2(e) (Watts)						Adjusted Lighting Power per 140.6(a) / 170.2(e) (Watts)					Compliance Results
	01	02	03	04		05	06	07		08		09
	Complete Building 140.6(c)1	Area Category 140.6(c)2 / 170.2(e)4	Area Category Additional 140.6(c)2G / 170.2(e)4Av (+)	Tailored 140.6(c)3 / 170.2(e)4B (+)		**Total Allowed** (Watts)	Total Designed (Watts)	Adjustments PAF Lighting Control Credits 140.6(a)2 / 170.2(e)1B (-)		**Total Adjusted** (Watts) *Includes Adjustments		**05 must be >= 08 140.6 / 170.2(e)**
	(See Table I)	(See Table I)	(See Table J)	(See Table K)			(See Table F)	(See Table P)				
Conditioned		1,667			=	1,667	1,663		=	1663		COMPLIES
Unconditioned					=				=			
								Controls Compliance (See Table H for Details)				COMPLIES
								Rated Power Reduction Compliance (See Table Q for Details)				

D. EXCEPTIONAL CONDITIONS

This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS

This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

Indoor Lighting Mandatory Measures:

110.9 LIGHTING CONTROLS AND COMPONENTS
ALL LIGHTING CONTROL DEVICES AND SYSTEMS, AND ALL LIGHT SOURCES SHALL MEET THE APPLICABLE REQUIREMENTS OF 110.9.

NOTE: THE EXCEPTED SPACES DO NOT COUNT TOWARDS THE 10,000 FT2 THRESHOLD.

130.0 GENERAL LUMINAIRE REQUIREMENTS
ALL LUMINAIRES SHALL BE FACTORY-LABELLED PER 130.0(c).
ENERGY MANAGEMENT CONTROL SYSTEMS (EMCS) SHALL MEET REQUIREMENTS OF 130.0(e).

130.1(a) MANUAL AREA CONTROLS
EACH ROOM OR AREA WITH FLOOR-TO-CEILING WALLS IN THIS BUILDING SHALL HAVE LIGHTING CONTROLS THAT ALLOW LIGHTING TO BE MANUALLY TURNED ON AND OFF MANUAL CONTROLS SHALL:

1. BE READILY ACCESSIBLE
2. BE LOCATED IN THE SAME ENCLOSED AREA WITH THE LIGHTING IT CONTROLS.
3. PROVIDE SEPARATE CONTROL OF GENERAL, FLOOR, WALL, WINDOW CASE DISPLAY, ORNAMENTAL AND SPECIAL EFFECTS LIGHTING SO EACH TYPE CAN BE TURNED ON AND OFF SEPARATELY WITHOUT AFFECTING OTHER LIGHTING OR EQUIPMENT.

130.1(b) MULTILEVEL LIGHTING CONTROLS
GENERAL LIGHTING IN ALL ROOMS AND AREAS 100 FT2 OR GREATER AND WITH MORE THAN 0.5 WATTS PER FT2 OF LIGHTING LOAD SHALL HAVE MULTILEVEL CONTROLS THAT ALLOW LIGHT LEVELS TO BE ADJUSTED UP AND DOWN. CONTROLS SHALL PROVIDE NUMBER OF CONTROL STEPS AND UNIFORM ILLUMINANCE LIGHT LEVELS PER TABLE 130.1-A.

130.1(c): SHUTOFF CONTROLS
ALL INSTALLED INDOOR LIGHTING SHALL BE EQUIPPED WITH CONTROLS TO AUTOMATICALLY REDUCE LIGHTING POWER WHEN SPACE IS TYPICALLY UNOCCUPIED.

130.1(c)1: CONTROL REQUIREMENTS
ALL INSTALLED INDOOR LIGHTING SHALL HAVE ALL OF THE FOLLOWING:
A. CONTROL(S) CAPABLE OF AUTOMATICALLY SHUTTING OFF ALL LIGHTING IN THE SPACE WHEN TYPICALLY UNOCCUPIED (OCCUPANT SENSING CONTROL, AUTOMATIC TIME-SWITCH CONTROL, OR OTHER)
B. SEPARATE CONTROLS FOR LIGHTING ON EACH FLOOR (OTHER THAN STAIRWELLS)

C. SEPARATE CONTROLS FOR A SPACE ENCLOSED BY CEILING HEIGHT PARTITIONS NOT EXCEEDING 5,000 FT2

130.1(c)3,4 OVERRIDE FOR BUILDING LIGHTING SHUT-OFF
AREAS SERVED BY SHUT-OFF CONTROLS (OTHER THAN OCCUPANT SENSORS): SHALL:
130.1(c)3. INCLUDE MANUAL OVERRIDE CONTROL THAT COMPLIES WITH 130.1(a) AND ALLOWS LIGHTING TO REMAIN ON FOR UP TO 2 HOURS; AND
130.1(c)4. PROVIDE AUTOMATIC HOLIDAY "SHUTOFF".

130.1(c)6 PARTIAL OR FULL-OFF OCCUPANT SENSORS
PROVIDE PARTIAL OR FULL-OFF OCCUPANT SENSORS, IN ADDITION TO SHUTOFF CONTROLS PER 130.1(c)1 AND 130.1(c)2, IN THE FOLLOWING SPACES:

- AISLE WAYS AND OPEN AREAS IN WAREHOUSES
- LIBRARY BOOK STACK AISLES
- CORRIDORS AND STAIRWELLS
- OFFICES GREATER THAN 250 SQ. FT.

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

WAI-HUNG NG
REGISTERED PROFESSIONAL ENGINEER
No. E 25275
EXP. 08/30/27
ELECTRICAL
STATE OF CALIFORNIA
02/25/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
KRG	AG	WN	WN

Project No.
230654

Contents:
COMCHECK

E011

STATE OF CALIFORNIA
Indoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-LTI-E
This document is used to demonstrate compliance with requirements in 110.9, 110.12(c), 130.0, 130.1, 140.6 and 141.0(b)2 for indoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e) and 180.2(b)4 for indoor lighting scopes using the prescriptive path for multifamily occupancies. Multifamily includes dormitory and senior living facilities.	
Project Name: CMG Sir Francis Drake	**Report Page:** **(Page 1 of 8)**
Project Address:	**Date Prepared:** 2025-02-24T12:37:40-05:00

A. GENERAL INFORMATION

01	Project Location (city)	Greenbrae	04	Total Conditioned Floor Area (ft²)	3,016
02	Climate Zone	2	05	Total Unconditioned Floor Area (ft²)	0
03	Occupancy Types Within Project (select all that apply):		06	# of Stories (Habitable Above Grade)	0
● Restaurant					

B. PROJECT SCOPE

This table includes any lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.6 / 170.2(e) or 141.0(b)2 / 180.2(b)4 for alterations.

Scope of Work	Conditioned Spaces		Unconditioned Spaces	
01	02	03	04	05
My Project Consists of (check all that apply):	Calculation Method	Area (ft²)	Calculation Method	Area (ft²)
☒ New Lighting System	Area Category Method	3016	N/A	0
☐ New Lighting System - Parking Garage	N/A	0	N/A	0
Total Area of Work (ft²)	3016			

Indoor Lighting Mandatory Measures:

130.1(d) AUTOMATIC DAYLIGHTING CONTROLS
ALL GENERAL LIGHTING IN THE FOLLOWING ZONES SHALL HAVE CONTROLS THAT AUTOMATICALLY ADJUST THE INSTALLED LIGHTING POWER UP AND DOWN TO KEEP TOTAL LIGHT LEVEL STABLE AS INCOMING DAYLIGHT CHANGES:

- PRIMARY SIDELIT DAYLIT ZONES
- SECONDARY SIDELIT DAYLIT ZONES
- COMBINED PRIMARY AND SECONDARY SIDELIT DAYLIT ZONES IN PARKING GARAGES

ALL DAYLIT ZONES MUST BE SHOWN ON PLANS.

NOTE: PARKING AREAS ON THE ROOF OF A PARKING STRUCTURE ARE NOT SKYLIT DAYLIT AREAS.

IN ADDITION, AUTOMATIC DAYLIGHTING CONTROLS SHALL PROVIDE SEPARATE CONTROL FOR LUMINAIRES IN EACH TYPE OF DAYLIT ZONE. LUMINAIRES THAT FALL IN BOTH SKYLIT AND SIDELIT DAYLIT ZONE SHALL BE CONTROLLED AS PART OF THE SKYLIT ZONE.

130.1(d)3 THE AUTOMATIC DAYLIGHTING CONTROLS SHALL ACHIEVE ALL OF THE FOLLOWING:
A. ADJUST LIGHTING VIA CONTINUOUS DIMMING OR THE NUMBER OF CONTROL STEPS PROVIDED BY THE MULTILEVEL CONTROLS (FOR SPACES REQUIRED TO INSTALL MULTILEVEL CONTROLS UNDER SECTION 130.1(b)).

B. FOR EACH SPACE, ENSURE COMBINED ILLUMINANCE FROM CONTROLLED LIGHTING AND DAYLIGHT IS NOT LESS THAN ILLUMINANCE FROM CONTROLLED LIGHTING WHEN NO DAYLIGHT IS AVAILABLE.

C. ENSURE THAT THE GENERAL LIGHTING POWER IN A DAYLIT ZONE SHALL BE REDUCED BY AT LEAST 90% WHEN DAYLIGHT ILLUMINANCE IN THAT ZONE IS GREATER THAN 150% OF DESIGN ILLUMINANCE RECEIVED FROM THE GENERAL LIGHTING SYSTEM AT FULL POWER (NOT APPLICABLE TO PARKING GARAGES).

D. (FOR PARKING GARAGES ONLY) ENSURE THAT WHEN ILLUMINANCE LEVELS MEASURED AT THE FARTHEST EDGE OF THE SECONDARY SIDELIT ZONE AWAY FROM GLAZING OR OPENING ARE GREATER THAN 150% OF THE ILLUMINANCE PROVIDED BY THE CONTROLLED LIGHTING WHEN NO DAYLIGHT IS AVAILABLE, THE CONTROLLED LIGHTING POWER IN THE COMBINED PRIMARY AND SECONDARY SIDELIT DAYLIT ZONES SHALL BE REDUCED BY 100%.

130.1(d)4 WHEN PHOTOSENSORS ARE LOCATED WITHIN THE DAYLIT ZONE, AT LEAST ONE PHOTOSENSOR SHALL BE LOCATED SO THAT IT IS NOT READILY ACCESSIBLE TO UNAUTHORIZED PERSONNEL.

130.1(d)5 THE LOCATION WHERE CALIBRATION ADJUSTMENTS ARE MADE TO AUTOMATIC DAYLIGHTING CONTROLS SHALL BE READILY ACCESSIBLE TO AUTHORIZED PERSONNEL BUT MAY BE INSIDE A LOCKED CASE OR UNDER A COVER THAT REQUIRES A TOOL FOR ACCESS.

Indoor Lighting Mandatory Measures:

130.1(f) CONTROL INTERACTIONS
EACH LIGHTING CONTROL INSTALLED TO MEET 130.1 REQUIREMENTS SHALL INCORPORATE THE FUNCTIONS OF OTHER LIGHTING CONTROLS REQUIRED BY THIS SECTION.

1. FOR GENERAL LIGHTING, MANUAL AREA CONTROL SHALL PERMIT THE LEVEL OF LIGHT PROVIDED WHILE LIGHTING IS ON TO BE SET OR ADJUSTED BY CONTROLS SPECIFIED IN 130.1(b), (c), (d) and (e).

2. MANUAL AREA CONTROL SHALL PERMIT SHUTOFF CONTROL TO TURN THE LIGHTING DOWN OR OFF.

3. MULTILEVEL CONTROL SHALL PERMIT THE AUTOMATIC DAYLIGHTING CONTROL TO ADJUST ELECTRIC LIGHTING IN RESPONSE TO DAYLIGHT.

4. MULTILEVEL CONTROL SHALL PERMIT THE DEMAND RESPONSIVE (DR) CONTROL TO ADJUST LIGHTING DURING A DR EVENT THEN RETURN IT TO THE LEVEL SET BY THE CONTROL AFTER THE EVENT.

5 SHUTOFF CONTROL SHALL PERMIT THE MANUAL AREA CONTROL TO TURN THE LIGHTING ON.

6. AUTOMATIC DAYLIGHTING CONTROL SHALL PERMIT MULTILEVEL LIGHTING CONTROL TO ADJUST THE LIGHTING LEVEL.

7. FOR LIGHTING CONTROLLED BY MULTILEVEL LIGHTING CONTROLS AND OCCUPANT SENSING CONTROLS THAT PROVIDE AUTOMATIC-ON FUNCTION, CONTROLS SHALL PROVIDE A PARTIAL-ON FUNCTION THAT IS CAPABLE OF AUTOMATICALLY ACTIVATING BETWEEN 50-70% OF CONTROLLED LIGHTING POWER.

8. RESERVED

9. FOR SPACE CONDITIONING SYSTEM ZONES SERVING ONLY SPACES THAT ARE REQUIRED TO HAVE OCCUPANT SENSING CONTROLS SHALL BE CONTROLLED BY OCCUPANCY SENSING CONTROLS.

STATE OF CALIFORNIA
Electrical Power Distribution
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-ELC-E
This document is used to demonstrate compliance with mandatory requirements in 130.5, for electrical systems in newly constructed nonresidential and hotel/motel occupancies and 160.6 and 160.9 for electrical systems in newly constructed multifamily occupancies. Additions and alterations to electrical service systems in nonresidential and hotel/motel occupancies will also use this document to demonstrate compliance per 141.0(a) or 141.0(b)2P for alterations. For multifamily addition or alterations compliance will be documented per 180.1(a) or 180.2 (b)4Bvii	
Project Name: CMG Sir Francis Drake	**Report Page:** **(Page 1 of 4)**
Project Address:	**Date Prepared:** 2025-02-24T12:20:05-05:00

A. GENERAL INFORMATION

01	Project Location (city)	Greenbrae	02	Climate Zone	2
			03	Occupancy Types Within Project:	Restaurant

B. PROJECT SCOPE

This table includes electrical systems that are within the scope of the permit application.

01	02	03	04	05	06	07
Electrical Service Designation/ Description	Scope of Work[1]	Rating[2] (kVA)	Utility Provided Metering System Exception to 130.5(a)/ 160.6(a)[3]	System subject to CA Elec Code Article 517 Exception to 130.5(a)and (b)	Demand Response Controls	Provides power to dwelling units/common living areas only in multifamily occupancy
E-110, E-600	Add/Alt to feeders and branch circuits only	---	☐	☐	Where required, demand response controls must be specified which are capable of receiving and automatically responding to at least one standards based messaging protocol which enables demand response after receiving a demand response signal. Sections 120.2/ 160.3, 130.1/ 160.5, and 130.3/ 160.5, and mechanical, indoor lighting, and sign lighting Certificate of Compliance documents will indicate when demand response controls are required.	☐

[1] *FOOTNOTES: Adding only new feeders and branch circuits triggers Voltage Drop 130.5(c)/160.6(c), no other requirements from 130.5/160.6 are required.*
[2] *If common use areas in a multifamily are submetered, rating is for submeter size serving common use areas.*
[3] *Applicable if the utility company is providing a metering system that indicates instantaneous kW demand and kWh for a utility-defined period.*

STATE OF CALIFORNIA
Electrical Power Distribution
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-ELC-E
Project Name: CMG Sir Francis Drake	**Report Page:** **(Page 2 of 4)**
	Date Prepared: 2025-02-24T12:20:05-05:00

C. COMPLIANCE RESULTS

Results in this table are automatically calculated from data input and calculations in Tables F through J. Note: If any cell on this table says "COMPLIES with Exceptional Conditions" refer to Table D. Exceptional Conditions for guidance or see applicable Table referenced below.

01		02		03		04	05	06
Service Electrical Metering 130.5(a)/ 160.6(a) (See Table F)	AND	Separation for Monitoring 130.5(b)/ 160.6(b) (See Table G)	AND	Voltage Drop 130.5(c)/ 160.6(c) (See Table H)	AND	Controlled Receptacles 130.5(d)/ 160.6(d) (See Table I)	Electric Ready 160.9 (See Table J)	**Compliance Results**
	AND		AND	Yes	AND			COMPLIES

D. EXCEPTIONAL CONDITIONS

This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS

This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

H. VOLTAGE DROP

This table includes entirely new or complete replacement electrical power distribution systems, or alterations that add, modify or replace both feeders and branch circuits to demonstrate compliance with 130.5(c)/ 160.6(c). For alterations, only the altered circuits must demonstrate compliance per 141.0(b)2Piii/ 180.2(b)4Bviic.

01	02				03	04	05	
Electrical Service Designation/Description	Combined Voltage Drop on Installed Feeder/Branch Circuit Conductors Compliance Method				Location of Voltage Drop Calculations[1]	Sheet Number for Voltage Drop Calculations in Construction Documents	Field Inspector	
							Pass	Fail
E-110, E-600	☒	Voltage drop less than 5%	☐	Permitted by CA Elec Code (Exception to 130.5(c))*	In construction documents	E-600	☐	☐

** NOTES: If "Permitted by CA Elec Code *" is selected under Compliance Method above, please indicate where the exception applies in the space provided below.*

[1] *FOOTNOTES: Voltage drop calculations may be attached to the permit application outside the construction documents if allowed by the Authority Having Jurisdiction. Select "attached" if applicable. If calculations will be the responsibility of the installing contractor, select "Contractor Responsible".*

Electrical Power Distribution Mandatory Measures:

110.12(a) DEMAND RESPONSIVE (DR) CONTROLS
ALL DEMAND RESPONSIVE CONTROLS SHALL:

1. BE EITHER A. CERTIFIED OPENADR 2.0a OR OPENADR 2.0b VIRTUAL END NODE (VEN); OR B. CERTIFIED BY THE MANUFACTURER AS BEING CAPABLE OF RESPONDING TO A DR SIGNAL FROM A CERTIFIED OPENADR 2.0b VEN AUTOMATICALLY IMPLEMENTING THE CONTROL FUNCTIONS REQUESTED BY THE VEN FOR THE EQUIPMENT IT CONTROLS.
2. BE CAPABLE OF COMMUNICATING USING ONE OR MORE OF THE FOLLOWING: WI-FI, ZIGBEE, BACNET, ETHERNET, OR HARD-WIRING.
3. CONTINUE TO PERFORM ALL OTHER CONTROL FUNCTIONS PROVIDED BY THE CONTROL WHEN COMMUNICATIONS ARE DISABLED OR UNAVAILABLE.
4. DR CONTROL THERMOSTATS SHALL COMPLY WITH REFERENCE JOINT APPENDIX 5 (JA5), TECHNICAL SPECIFICATIONS FOR OCCUPANT CONTROLLED SMART THERMOSTATS.

110.12(d) DEMAND RESPONSIVE ELECTRONIC MESSAGE CENTER CONTROL
CONTROLS FOR ELECTRONIC MESSAGE CENTERS GREATER THAN 15KW SHALL BE CAPABLE OF REDUCING THE LIGHTING POWER BY A MINIMUM OF 30% WHEN RECEIVING A DR SIGNAL.

130.5(c) VOLTAGE DROP
THE MAXIMUM COMBINED VOLTAGE DROP ON BOTH INSTALLED FEEDER AND BRANCH CIRCUIT CONDUCTORS TO THE FARTHEST CONNECTED LOAD OR OUTLET SHALL NOT EXCEED 5%.

STATE OF CALIFORNIA
Electrical Power Distribution
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-ELC-E
Project Name: CMG Sir Francis Drake	**Report Page:** **(Page 3 of 4)**
	Date Prepared: 2025-02-24T12:20:05-05:00

K. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION

Selections have been made based on information provided in this document. If any selection have been changed by permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and can be found online

Form/Title
NRCI-ELC-E - Must be submitted for all buildings

L. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

There are no NRCA forms required for this project.

STATE OF CALIFORNIA
Electrical Power Distribution
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE	NRCC-ELC-E
Project Name: CMG Sir Francis Drake	**Report Page:** **(Page 4 of 4)**
Project Address:	**Date Prepared:** 2025-02-24T12:20:05-05:00

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: WAI-HUNG NG	Documentation Author Signature:
Company: Bowman Consulting Group Ltd.	Signature Date: 02/24/2025
Address: 1490 W 121st Ave, Ste. 204	CEA/ HERS Certification Identification (if applicable):
City/State/Zip: Westminster, CO 80234	Phone: 303-678-1108

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

1. The information provided on this Certificate of Compliance is true and correct.
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provided to the building owner at occupancy.

Responsible Designer Name: WAI-HUNG NG	Responsible Designer Signature:
Company: Bowman Consulting Group Ltd.	Date Signed: 02/24/2025
Address: 1490 W 121st Ave, Ste. 204	License: 25275
City/State/Zip: Westminster, CO 80234	Phone: 303-678-1108

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

REGISTERED PROFESSIONAL ENGINEER
WAI-HUNG NG
No. 25275
EXP. 08/30/27
ELECTRICAL
STATE OF CALIFORNIA
02/25/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

Revisions:
A

Drawn: KRG | PM: AG | CC: WN | Checked: WN

Project No.
230654

Contents:
COMCHECK

E012

LIGHTING CONTROL PANEL SCHEDULE: LCP

RELAY	PANEL	CIRCUIT	AREA SERVED	CONTROL	TIME ON	TIME OFF	DIMMER CONTROL	NOTES
R1	A	32	KITCHEN A	TIMECLOCK	7:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R2	A	32	KITCHEN B	TIMECLOCK	7:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R3			SPARE					SINGLE POLE (NC)
R4	A	30	DINING ROOM A	TIMECLOCK	10:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R5	A	30	DINING ROOM B	TIMECLOCK	10:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R6	A	30	DINING ROOM DL	TIMECLOCK	10:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R7	A	28	RESTROOM EXHAUST FAN	TIMECLOCK	7:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R8	A	36/38/40	EXT. LIGHTING/SIGNAGE	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	N/A	SINGLE POLE (NC)

LIGHTING CONTROL PANEL SCHEDULE NOTES

A. DUPLICATE PANEL SCHEDULE AND PERMENANTLY INSTALL WITHIN THE LIGHTING CONTROL PANEL.

LIGHTING CONTROL COMPONENTS SCHEDULE

	DESCRIPTION	QUANTITY	FURNISHED BY	INSTALLED BY	MANUFACTURER	MODEL	REMARKS
LCP	nLIGHT LIGHTING CONTROL PANEL	1	TLS	GC	ACUITY	ARP INTENC08 NLT 8FCR MVOLT HLK FM DTC CPTLE1	8 RELAY PANEL FOR DIMMING CONTROL WITH FLUSH MOUNT ENCLOSURE, AND DIGITAL TIME CLOCK
$C	WALL-MOUNTED OVERRIDE SWITCH	1	TLS	GC	ACUITY	nPODMA 4P	SEE LIGHTING CONTROL DIAGRAM FOR SWITCH CONFIGURATION
$D	WALL-MOUNTED DIMMER SWITCH	2	TLS	GC	COOPER	SAL06P-W	SLIDE DIMMER COMPATIBLE WITH UP TO 300W LED LIGHTING. SET AT 50%. IF DINING ROOM LIGHTS FLICKER AT THIS DIMMER SETTING THEN GC SHALL PROVIDE LUTRON DVCL-253P DIMMER AS REPLACEMENT.
$OC	WALL-MOUNTED LINE VOLTAGE OCCUPANCY SENSOR	3	TLS	GC	HUBBELL	LHMTS 1-N-WH	WHITE DUAL TECHNOLOGY SINGLE RELAY WITH 1 BUTTON AND NEUTRAL WIRING

LIGHTING FIXTURE SCHEDULE

TAG	COUNT	DESCRIPTION	MOUNTING	VOLTAGE	WATTS	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN			REMARKS
								MANUFACTURER	MODEL	LAMP	
A1	12	2x2 LED LENSED TROFFER	LAY-IN	120 V	30 W	TLS	GC	NORA LIGHTING	NPDBL-E22/334 W	INTEGRAL 3000K LED	COMPATIBLE WITH 0-10V DIMMING, FACTORY LOCKED TO 3000K
B1	9	RECESSED 6IN CAN LIGHT	CEILING	120 V	17 W	TLS	GC	NORA LIGHTING	NHIC-6G24ATFL W/ NTM-57W/M1 TRIM	(1) 17W ECOSTORY ECO-PAR38C-17-GU24-27 K-25D LED (25°-2700K) W/ GU 24 BASE	
B2	27	RECESSED 6IN CAN LIGHT W/ LED TRIM	CEILING	120 V	17 W	TLS	GC	NORA LIGHTING	NHIC-6G24ATFL WITH NLCBC-65130WW LED TRIM	INTEGRAL 3000K LED	LED TRIM FURNISHED WITH GU24 SOCKET ADAPTER
B3	3	RECESSED 6IN CAN LIGHT W/ BLACK LED TRIM	CEILING	120 V	12 W	TLS	GC	NORA LIGHTING	NHIC-6G24ATFL WITH NLCBC2-65127BB LED TRIM	INTEGRAL 3000K LED	BLACK LED TRIM FURNISHED WITH GU24 SOCKET ADAPTER
C0	2	LOW PROFILE LED - 1 FT	SURFACE	120 V	5 W	TLS	GC	HERA LIGHTING	EL/LED/12/WW	INTEGRAL 3000K LED	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
C2	4	LOW PROFILE LED - 3 FT	SURFACE	120 V	12 W	TLS	GC	HERA LIGHTING	EL/LED/34/WW	INTEGRAL 3000K LED	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
C3	5	LOW PROFILE LED - 4 FT	SURFACE	120 V	15 W	TLS	GC	HERA LIGHTING	EL/LED/46/WW	INTEGRAL 3000K LED	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
C4	16	LOW PROFILE LED - 5 FT	SURFACE	120 V	18 W	TLS	GC	HERA LIGHTING	EL/LED/59/WW	INTEGRAL 3000K LED	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
E1	5	EMERGENCY LIGHT - DUAL HEAD	VARIOUS	120 V	2 W	TLS	GC	EXITRONIX	LED-90	INTEGRAL LED	90 MINUTE BATTERY BACKUP
E2	3	EXTERIOR REMOTE EMERGENCY LIGHT	VARIOUS	4 V	1 W	TLS	GC	EXITRONIX	MLED1-B-WP	INTEGRAL LED	LOW VOLTAGE REMOTE EMERGENCY LIGHT POWERED BY REMOTE-CAPABLE EXIT SIGN WITH MOUNTING PLATE
E4	8	WHITE EXIT SIGN WITH EMERGENCY LIGHT -STANDARD RED LETTERS	VARIOUS	120 V	2 W	TLS	GC	EXITRONIX	CLED-U-WH	INTEGRAL LED	90 MINUTE BATTERY BACKUP WITH INTEGRAL EMERGENCY LIGHT, REMOTE HEAD CAPABLE
E7	12	EMERGENCY LIGHT	VARIOUS	120 V	2 W	TLS	GC	EXITRONIX	EV2	INTEGRAL LED	90 MINUTE BATTERY BACKUP
H1	8	VAPOR PROOF HOOD LIGHT	SURFACE	120 V	15 W	HS/TLS	HS	FURNISHED W/ HOOD	FURNISHED W/ HOOD	(1) TCP L16A19N1527K	INSTALL LAMP FURNISHED SEPARATELY BY LIGHTING SUPPLIER
J4	2	DECORATIVE PENDANT	PENDANT	120 V	9 W	TLS	GC	BARNLIGHT	BLE-C-BRN-100-ASH-SB K-100-NA-GU24	GREEN CREATIVE 9A19DIM/927/GU24/R	WITH BLACK LAMPSHADE, BLACK CORD, AND OAK LAMPHOLDER
P3	4	ACCENT ARTWORK LIGHT	WALL	120 V	20 W	TLS	GC	HI-LITE MFG	H-CW2700-B	1 MEDIUM BASE	
P5	4	PENDANT	PENDANT	120 V	5 W	TLS	GC	HI-LITE MFG	H-LC-91/CB12-91/20W LBL	TCP FG25D4027CCQ	ADJUST CORD LENGTH FOR MOUNTING HEIGHT CALLED FOR IN ARCHITECTURAL DRAWINGS
W1	4	WIC LED LIGHT	SURFACE	120 V	29 W	WCS	GC	FURNISHED W/ WIC	FURNISHED W/ WIC	INTEGRAL LED	WET-RATED COOLER FIXTURE

LIGHTING FIXTURE SCHEDULE NOTES

A. SEE THE ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LIGHT LOCATIONS.

B. SEE THE ARCHITECTURAL LIGHTING DETAILS FOR FIXTURE CONSTRUCTION DETAILS.

ELECTRICAL LIGHTING PLAN NOTES

1 INSTALL WALL-MOUNTED LIGHTING OVERRIDE SWITCH AND CONNECT TO LCP AS SHOWN IN DETAIL 6/E710

2 FOR UNCIRCUITED LIGHT FIXTURES, CONNECT TO RELAY CIRCUIT INDICATED NEXT TO THE FIXTURE TAG THROUGH THE LIGHTING CONTROL PANEL (LCP) UNLESS NOTED OTHERWISE.

3 WALL MOUNT THE EMERGENCY LIGHT FIXTURE AT 6" BELOW THE CEILING UNLESS NOTED OTHERWISE

4 VERIFY MOUNTING HEIGHT OF EXIT SIGN PRIOR TO ROUGH IN. EXIT SIGN MUST BE VISIBLE FROM AREA SERVED AFTER BUILDING SYSTEMS HAVE BEEN INSTALLED. SEE ARCHITECTURAL ELEVATIONS FOR FURTHER INFORMATION.

5 NOT USED.

6 INSTALL LIGHT FIXTURES FURNISHED WITH THE WALK-IN COOLER. PROVIDE UNSWITCHED CONDUCTOR FROM LIGHTING CIRCUIT TO WALK-IN COOLER LIGHTING J-BOX AND FROM J-BOX TO LIGHT FIXTURES AS SHOWN. CONDUIT BETWEEN LIGHT FIXTURES SHALL BE ROUTED ON THE INTERIOR OF THE WALK-IN COOLER. SEAL INTERIOR AND EXTERIOR OF CONDUITS WHERE THEY PASS THROUGH THE WALK-IN COOLER ENVELOPE PER THE NEC.

7 NOT USED.

8 <varies>

9 NOT USED.

10 INSTALL WALL-MOUNTED OCCUPANCY SENSOR FURNISHED BY LIGHTING SUPPLIER AT 42" AFF. ADJUST OCCUPANCY SENSOR TO PROVIDE AUTOMATIC ON/AUTOMATIC OFF OPERATION WITH A FIXED TIMER OF 30 MINUTES AND WITH BOTH THE PASSIVE INFRARED AND ULTRASONIC SENSORS ENABLED.

11 NOT USED.

12 INSTALL WALL-MOUNTED DIMMERS ABOVE PANELBOARDS 6" ABOVE LAY-IN CEILING FOR CONTROL OF DINING ROOM OVERHEAD STRIP LED AND PENDANT LIGHTS. CONNECT DIMMERS TO RELAYS SHOWN THROUGH THE LIGHTING CONTROL PANEL. SET DIMMERS AT 50%.

ELECTRICAL LIGHTING PLAN NOTES

13 CONNECT DINING ROOM (RELAY CIRCUITS R4, R5, R6) OVERHEAD STRIP LED LIGHTS TO THE RELAY INDICATED THROUGH THE CORRESPONDING WALL-MOUNTED DIMMER INSTALLED ABOVE THE PANELBOARDS.

14 INSTALL LIGHTING CONTROL SYSTEM PER DETAIL 6/E710.

15 NOT USED.

16 PENATRATIONS THROUGH SHEAR WALL SHALL BE LIMITED TO 10" DIAMETER (OR A GROUP OF PENETRATIONS ALL CONTAINED WITHIN 10" DIAMETER). IF LARGER PENETRATIONS OR GROUPS OF PENETRATIONS ARE REQUIRED COORDINATE WITH STRUCTURAL ENGINEER FOR APPROPRIATE BRACING. SEE STRUCTURAL DRAWINGS FOR SHEAR WALL LOCATION.

17 NOT USED.

18 INSTALL E2 REMOTE EMERGENCY LIGHT TO BOTTOM OF CANOPY. CONCEAL LOW VOLTAGE WIRING FROM EXIT SIGN TO REMOTE EMERGENCY LIGHT.

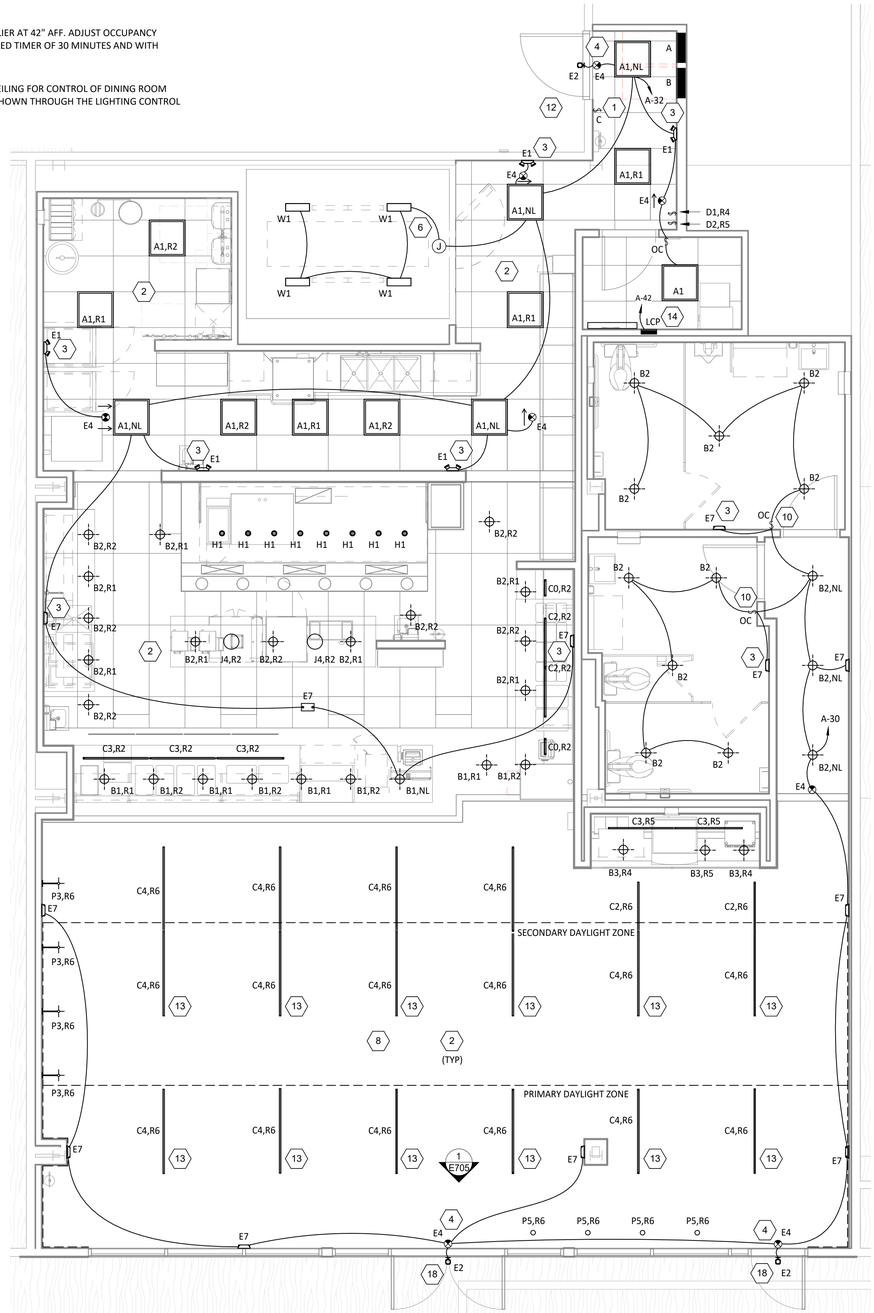

1 E100 **LIGHTING FLOOR PLAN**

1/4" = 1'-0"

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

REGISTERED PROFESSIONAL ENGINEER
NAI-HUNG KO
No. E 25775
EXP. 08/30/27
ELECTRICAL
STATE OF CALIFORNIA

02/25/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE · MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
KRG	AG	WN	WN

Project No.

230654

Contents:

ELECTRICAL LIGHTING PLAN

E100

ELECTRICAL POWER PLAN NOTES

1 SHOW ROOM WINDOW RECEPTACLE. COORDINATE EXACT RECEPTACLE MOUNTING HEIGHT IN THE FIELD. LOCATION SHALL BE IN THE DRYWALL IMMEDIATELY ABOVE THE MAIN STORE-FRONT WINDOW AND AS SHOWN IN THE DINING ROOM ELECTRICAL ELEVATIONS ON SHEET E705.

2 ICE MACHINE ELECTRICAL TIE-IN. COORDINATE EXACT LOCATION WITH EQUIPMENT INSTALLER PRIOR TO ROUGH-IN. PROVIDE L5-20P FLANGED INLET WIRED TO THE REMOTE CONDENSER. PROVIDE 48" CORDS, ONE WITH 5-20P END AND ONE WITH L5-20R END, FROM ICE MAKER TO RECEPTACLE AND FLANGED INLET.

3 CONNECT RECEPTACLES SERVING EQUIPMENT BELOW THE KITCHEN HOOD TO THE CIRCUITS SHOWN THROUGH THE CONTACTOR INTEGRAL TO THE HOOD CONTROL PANEL. INTEGRAL CONTACTOR SHALL BE INTERLOCKED TO HOOD FIRE PROTECTION SYSTEM SO THAT RECEPTACLES ARE DE-ENERGIZED UPON ACTIVATION OF HOOD FIRE PROTECTION SYSTEM.

4 JUNCTION BOX FOR EXTERIOR SIGN LIGHTING. COORDINATE EXACT LOCATION WITH CHIPOTLE'S CONSTRUCTION MANAGER AND THE SIGN INSTALLER PRIOR TO ROUGH-IN. CONNECT TO CIRCUIT SHOWN THROUGH THE EXTERIOR LIGHTING CONTACTOR PANEL AS SHOWN IN DETAIL 6/E710.

5 PROVIDE A SINGLE GANG VERTICAL JUNCTION BOX FOR THE KITCHEN EXHAUST SUPPRESSION SYSTEM PULL STATION. PROVIDE A 1/2" CONDUIT FROM THE J-BOX TO 6" ABOVE THE CEILING AND TERMINATE WITH A CONDUIT BUSHING. COORDINATE EXACT LOCATION WITH THE KITCHEN EXHAUST SUPPRESSION SYSTEM INSTALLER AND THE FIRE MARSHALL PRIOR TO ROUGH-IN.

6 HOOD CONTROL PANEL AND KITCHEN EXHAUST SUPPRESSION SYSTEM CABINET SHALL BE LOCATED WITHIN THE INTEGRAL HOOD UTILITY CABINET. PROVIDE FINAL ELECTRICAL CONNECTIONS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS NECESSARY FOR A COMPLETE AND OPERATIONAL SYSTEM.

7 PROVIDE A DUPLEX GFCI RECEPTACLE WITH WEATHERPROOF WHILE IN USE OUTLET COVER FOR IRRIGATION CONTROLLER.

8 PROVIDE AN EMPTY SINGLE GANG J-BOX FOR VOLUME CONTROLS. INSTALL 16/2 SPEAKER WIRE FURNISHED BY MSS FROM THE J-BOX TO THE AMPLIFIER IN THE OFFICE WITH 3 FEET OF SLACK AT EACH END.

9 COORDINATE DATA/POWER RECEPTACLE MOUNTING REQUIREMENTS WITH THE CASE WORK INSTALLER PRIOR TO ROUGH-IN.

10 PROVIDE ROUGH-IN FOR LAUNCHPORT AS NOTED. LAUNCHPORT WILL BE FURNISHED AND INSTALLED BY CHIPOTLE WITH THE WALLSTATION AT 62" AFF. PROVIDE A 4" X 2-1/8" DEEP OCTAGON J-BOX WITH 1-1/2" EXTENSION RING AT 62" AFF FOR THE WALLSTATION INSTALLATION WITH A 1" CONDUIT WITH PULL STRING FROM THE J-BOX TO ABOVE THE OFFICE CEILING.

11 PROVIDE (2) EMPTY 2" CONDUITS WITH PULL STRINGS FROM THE BASE BUILDING'S TELEPHONE AND DATA SERVICE ENTRANCE LOCATIONS TO THE SPACE ABOVE THE OFFICE CEILING. TERMINATE WITH CONDUIT BUSHING.

12 PROVIDE A SUITABLE LENGTH OF LIQUID-TIGHT CONDUIT TO THE EXHAUST FAN EF-1 TO ALLOW THE EXHAUST FAN TO HINGE COMPLETELY OPEN WHEN THE VIROGUARD SYSTEM IS INSTALLED.

13 AFTER THE FAX LINE, POS, AND OFFICE EQUIPMENT IS INSTALLED PROVIDE CHILDPROOF RECEPTACLE COVERS ON UNUSED IG RECEPTACLES AT THE FAX LINE, POS, AND OFFICE.

14 PROVIDE ONE PHASE, ONE NEUTRAL, AND ONE GROUND CONDUCTOR FROM THE ICE MAKER TO THE REMOTE CONDENSING UNIT.

15 PROVIDE A NEMA 3R FUSED DISCONNECT SWITCH SIZED PER MECHANICAL AND PLUMBING SCHEDULE IN SHEET E600.

16 PROVIDE 3" CONDUIT (EMT, IMC, OR RMC) THROUGH ROOF. TERMINATE WITH WEATHERHEAD EVEN WITH TOP OF PARAPET FOR FUTURE CELL BOOSTER. SECURE CONDUIT TO STRUCTURE TO SUPPORT FUTURE ANTENNA INSTALLATION. PROVIDE 1/4" X 2" X 10" 16-HOLE GROUNDING BUSBAR (BURNDY BBB14210A OR EQUAL) MOUNTED TO CONDUIT ABOVE ROOF FOR FUTURE CONNECTION OF LIGHTNING ARRESTORS. PROVIDE #2 CU GROUND FROM BUSBAR TO MAIN ELECTRODE GROUNDING CONDUCTOR.

17 INSTALL THE BYPASS DISTRIBUTION PANEL (BDP) CONSISTING OF THE NXT POWER-HUB AND UPS FURNISHED BY THE TENANT ON WALL 12" BELOW CEILING. INSTALL POWER-HUB AND UPS AND CONNECT POWER-HUB TO INPUT AND OUTPUT J-BOXES PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

18 ROUGH-INS TO SERVE LINE AND POS EQUIPMENT ARE UNDERGROUND. COORDINATE ROUGH-IN REQUIREMENTS AND LOCATIONS WITH EQUIPMENT MANUFACTURER PRIOR TO ROUGH-IN.

19 ROOFTOP UNIT SHALL HAVE AN INTEGRAL UNIT-MOUNTED WEATHERPROOF GFCI RECEPTACLE. PROVIDE CONNECTION TO CIRCUIT SHOWN.

20 ICE MAKER RECEPTACLES SHALL BE CONCEALED BEHIND THE ICE MAKER. COORDINATE LOCATION WITH ACTUAL WIDTH OF ICE MAKER.

21 PROVIDE VERTICAL METAL DIE CAST WEATHERPROOF WHILE IN USE OUTLET COVER ON RECEPTACLES AT COOK LINE. COVER SHALL BE INTERMATIC WP1010MXD FOR SINGLE GANG BOXES AND WP1030MXD FOR DOUBLE GANG BOXES. NO SUBSTITUTIONS SHALL BE ACCEPTED.

22 LABEL BATTERY-PROTECTED RECEPTACLES "BATTERY-PROTECTED: DISCONNECT AT PANEL BDP".

23 LABEL MAIN DISCONNECT SWITCH AND PANEL A "WARNING: BATTERY-PROTECTED RECEPTACLES IN USE. DISCONNECT AT PANEL BDP."

24 PROVIDE TWO J-BOXES ALIGNED VERTICALLY ON WALL AS SHOWN FOR CONNECTION TO NXT POWER-HUB. CONNECT UPPER J-BOX TO CIRCUIT SHOWN FOR CONNECTION TO POWER-HUB. TERMINATE WIRING FOR DEVICES SHOWN TO BE CIRCUITED TO "BDP-1" WITHIN LOWER J-BOX FOR CONNECTION TO POWER-HUB.

25 CONNECT RESTROOM EXHAUST FAN TO CIRCUIT SHOWN THROUGH THE LIGHTING CONTROL PANEL (LCP).

26 INSTALL 16/2 SPEAKER WIRE FURNISHED BY MSS. INSTALL SPEAKER WIRE BETWEEN SPEAKERS IN THE DINING ROOM AS SHOWN TO THE VOLUME CONTROL IN THE KITCHEN WITH 3 FEET OF SLACK AT EACH END. SEE ARCHITECTURAL PLANS FOR SPEAKER LOCATIONS. ADJUST EACH SPEAKER 70V TAP SETTING TO BE 15 WATTS.

27 PROVIDE POWER CONNECTIONS TO ISLAND PREP TABLE PER DETAIL 2/E710. PROVIDE GFCI DUPLEX RECEPTACLES IN TWO J-BOXES INTEGRAL TO PREP TABLE FOR HOT HOLDING CABINET AND GENERAL RECEPTACLE.

28 PROVIDE GFCI RECEPTACLE AND J-BOX AND INSTALL CO2 ALARM FURNISHED BY CO2AS AS SHOWN IN DETAIL 4/E710.

29 PROVIDE J-BOX AND INSTALL CO2 ALARM REMOTE DISPLAY UNIT FURNISHED BY CO2AS AS SHOWN IN DETAIL 4/E710.

30 INSTALL WALK-IN-COOLER EXTERNAL READOUT THERMOMETER REMOTE PROBE ON WALL OPPOSITE FROM DOOR AS SHOWN. ROUTE TEMPERATURE PROBE WIRE ABOVE WALK-IN COOLER CEILING PANELS, SEAL PENETRATIONS THROUGH THE CEILING PANELS, AND SECURE VERTICAL PROBE WIRE TIGHT TO WALLS. NO EXCESS PROBE WIRE SHALL BE WITHIN THE WALK-IN COOLER.

ELECTRICAL POWER PLAN NOTES

31 PROVIDE A J-BOX 6" BELOW THE LAY-IN CEILING WITH A 1/2" CONDUIT ROUTED TO THE HCP. PROVIDE 16 GA 3 CONDUCTOR LOW VOLTAGE WIRE FROM THE HOOD SUPPRESSION SYSTEM GAS VALVE BACK TO THE HCP WITH FINAL CONNECTION IN THE HCP BY THE FS INSTALLER. LOW VOLTAGE WIRING FROM THE J-BOX TO THE GAS VALVE SHALL BE CONCEALED WITHIN FLEXIBLE METAL CONDUIT OR LIQUIDTIGHT FLEXIBLE METAL CONDUIT. COORDINATE J-BOX LOCATION WITH GAS VALVE SO THAT CONDUIT IS 12" OR LESS.

32 PROVIDE 4" SQUARE J-BOX ON EXTERIOR WALL FOR MOUNTING OF EXTERIOR CAMERA. SEE ARCHITECTURAL ELEVATION FOR EXACT HEIGHT AND LOCATION. PROVIDE 3/4" CONDUIT WITH PULLSTRING FROM J-BOX TO ABOVE LAY-IN CEILING AREA IN KITCHEN. J-BOX SHALL NOT BE SURFACE MOUNTED. BASE OF CAMERA SHALL BE MOUNTED FLUSH TO EXTERIOR WALL FINISH.

33 PROVIDE 1" CONDUITS FROM LOW-VOLTAGE J-BOXES AT POS COUNTER CONCEALED WITHIN THE SERVE LINE WIRING CHASE TO THE WALL, THEN CONCEALED WITHIN THE WALL AND ABOVE THE CEILING TO ABOVE THE OFFICE CEILING.

34 NOT USED.

35 NOT USED.

36 SEAL INTERIOR AND EXTERIOR OF CONDUITS THAT PASS THROUGH THE WALK-IN COOLER ENVELOPE PER THE NEC.

37 PROVIDE ISLAND PREP TABLE FOOD WARMER RECEPTACLE WITH GROUND PIN TOWARDS THE BOTTOM OF THE RECEPTACLE.

38 INSTALL TRANSFORMER FURNISHED BY TUV WITH THE REME HALO AIR PURIFIER IN THE JUNCTION BOX ON THE EXTERIOR OF THE RTU PER DETAIL 6/M700. CONNECT LINE SIDE OF THE TRANSFORMER TO THE RTU SERVICE RECEPTACLE CIRCUIT SO THAT REME HALO RUNS CONTINUOUSLY. CONNECT THE LOW VOLTAGE SIDE OF THE TRANSFORMER TO THE REME HALO USING THE INCLUDED BARREL PLUG.

39 PROVIDE (2) 10"X10"X4" JUNCTION BOXES (J-BOX #1/J-BOX #2) ON THE WALL ABOVE PANELBOARDS 6" BELOW THE LAY-IN CEILING AND MOUNTED ADJACENT TO EACH. PROVIDE CONDUITS AND WIRING SHOWN IN DETAIL 8/E710. TEMS SHALL PROVIDE GRIDPOINT 3 PHASE METER AND TRANSFORMER WITHIN J-BOX #1 AND GRIDPOINT IOM/HUB WITHIN J-BOX #2. SEE GRIDPOINT INSTALLATION SHEET FOR DETAILS.

40 PROVIDE HORIZONTAL SINGLE-GANG J-BOX BELOW FUTURE GRIDPOINT CONTROLLER LOCATION. PROVIDE CONDUITS AND WIRING AS SHOWN IN DETAIL 8/E710.

41 INSTALL WIRED DOOR BUZZER AT 96" AFF. SEE ARCHITECTURAL DOOR EQUIPMENT FOR EQUIPMENT INFORMATION. CONNECT TO CIRCUIT SHOWN THROUGH THE TRANSFORMER FURNISHED WITH THE DOOR BUZZER. PROVIDE WIRING TO A BUTTON ADJACENT TO THE SERVICE DOOR AND CONNECT PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

42 CONNECT BATHROOM SANITIZER TO CIRCUIT SHOWN SO THAT IT IS ENERGIZED AT ALL TIMES.

43 PROVIDE POWER AND LOW VOLTAGE CONNECTIONS TO DISH SANITIZING MACHINE PER DETAIL 7/E710. CONNECT THE DETERGENT DISPENSER TO THE DISH MACHINE USING THE INCLUDED WIRING HARNESS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

44 PROVIDE RECEPTACLE FOR 2-DOOR AND 1-DOOR REFRIGERATORS WITH GROUND PINS TOWARDS THE BOTTOM OF THE RECEPTACLE.

45 PROVIDE CORD AND NEMA 5-20P PLUG FROM UTENSIL COUNTER ICE MAKER, THROUGH UTENSIL COUNTER, TO ICE MAKER RECEPTACLE.

46 LABEL UTENSIL COUNTER RECEPTACLES "TRACTOR BEVERAGE", "ICE MAKER/IMSB", AND "SODA FOUNTAIN".

47 LABEL RECEPTACLE "UV INSECT TRAP".

48 PROVIDE POWER CONNECTIONS TO ISLAND PREP TABLE PER DETAIL 2/E710. PROVIDE GFCI DUPLEX RECEPTACLE IN THE J-BOX INTEGRAL TO PREP TABLE FOR UNDERCOUNTER REFRIGERATOR. PROVIDE FINAL CONNECTION TO CARVING STATION HEATER.

49 IF NEUTRAL CONDUCTOR IS NOT NEEDED FOR SERVE LINE HOT FOOD SERVER TERMINATE NEUTRAL IN JUNCTION BOX.

50 PROVIDE A TWO-CONDUCTOR LOW VOLTAGE WIRE IN 3/4" C. AND (4) #12, #12 N., #12 G. IN 1" C. FROM MAU-1 TO THE HOOD CONTROL PANEL PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

51 PROVIDE HORIZONTAL SINGLE-GANG J-BOX FOR DATA JACK AS SHOWN FOR KRONOS TIME CLOCK.

52 PROVIDE A RECESSED J-BOX AT 56" AFF FOR THE INSTALLATION OF THE SECURITY SYSTEM KEYPAD WITH A 1/2" CONDUIT TO ABOVE THE LAY-IN CEILING. TERMINATE CONDUIT WITH A CONDUIT BUSHING.

53 PROVIDE A RECESSED SINGLE-GANG J-BOX ABOVE DOOR AND 3" IN FROM LATCH SIDE OF DOOR FOR THE INSTALLATION OF THE SECURITY SYSTEM DOOR CONTACT WITH A 1/2" CONDUIT TO ABOVE THE LAY-IN CEILING. TERMINATE CONDUIT WITH A CONDUIT BUSHING.

54 50% OF ALL 15/20 AMP RECEPTACLES IN THE OFFICE SHALL BE AUTOMATICALLY CONTROLLED PER IECC C405.11.1.

55 REFER TO POWER SITE PLAN ON SHEET E115.

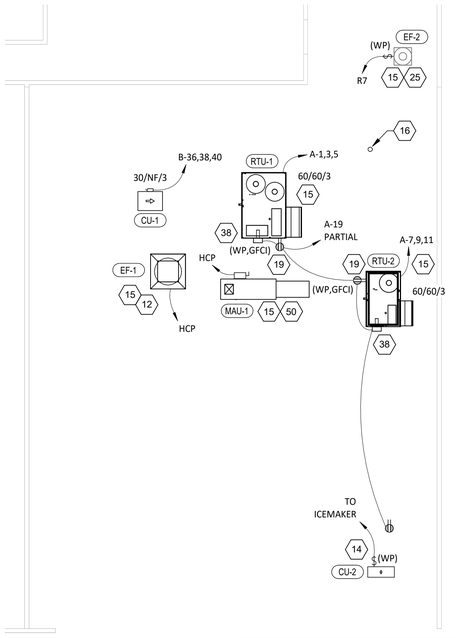

2 E110 **POWER ROOF PLAN**
1/8" = 1'-0"

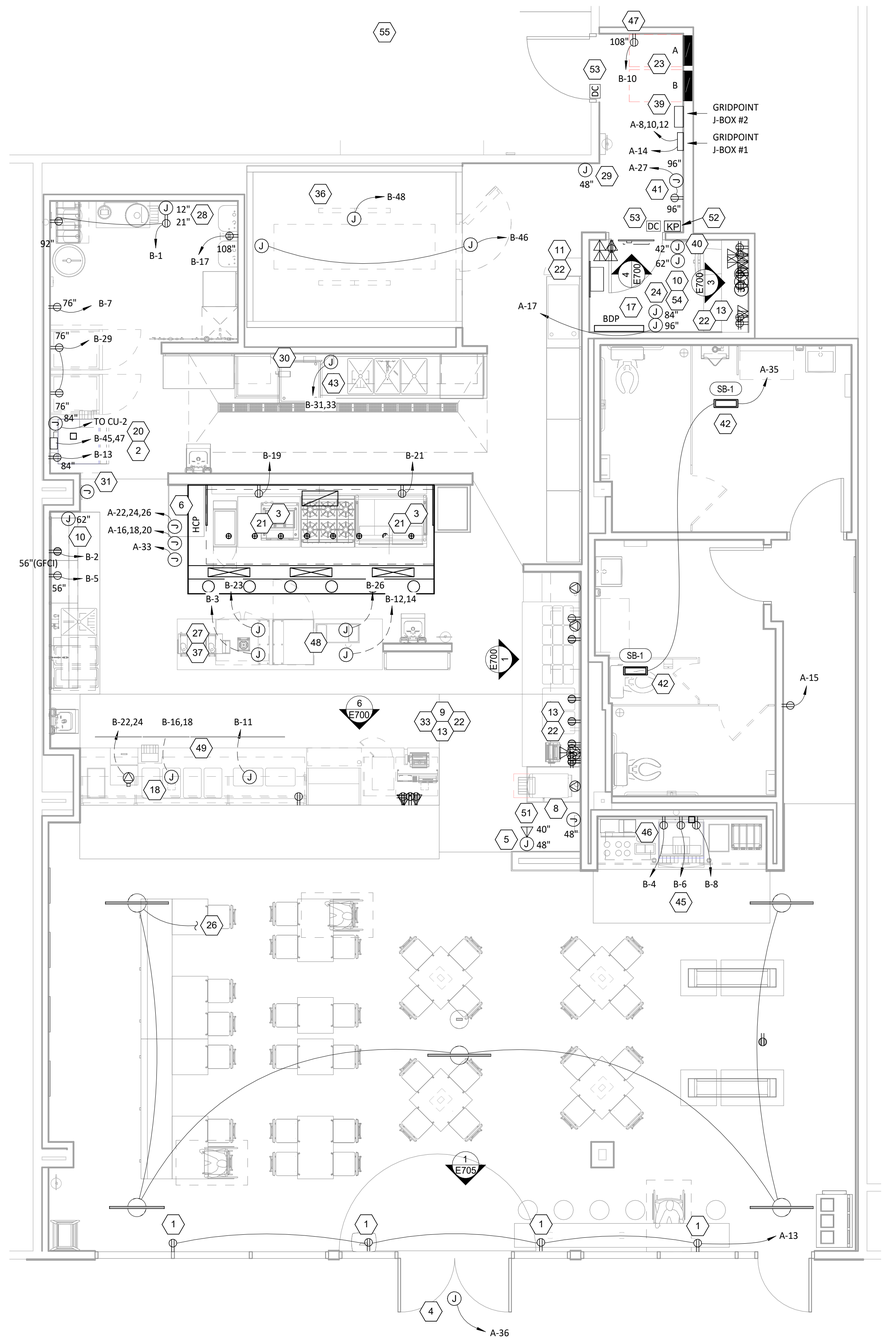

1 E110 **POWER FLOOR PLAN**
1/4" = 1'-0"

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

REGISTERED PROFESSIONAL ENGINEER
WAI-HUNG WONG
No. E 25775
ELECTRICAL
STATE OF CALIFORNIA
EXP. 08/30/27

02/25/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
KRG	AG	WN	WN

Project No.
230654

Contents:
ELECTRICAL POWER PLAN

E110

TAG	DESCRIPTION	RESPONSIBILITY	
		DEVICE OR CONDUIT	CONNECTION OR CONDUCTORS
1	LINE VOLTAGE WEATHERPROOF J-BOX - MINIMUM 6"X6"X4" J-BOX ON INTERIOR WALL OF BUILDING AT 11'-0" AFF. SEE SITE PLAN FOR LOCATION.	GC	GC
2	LOW VOLTAGE WEATHERPROOF J-BOX - MINIMUM 6"X6"X4" J-BOX ON INTERIOR WALL OF BUILDING AT 11'-0" AFF. SEE SITE PLAN FOR LOCATION.	GC	GC

GENERAL NOTES

A. WORK AND MATERIALS SHALL BE COMPLIANT WITH THE NEC AND REQUIREMENTS OF THE AHJ.
B. CONDUCTORS AND CONNECTIONS BELOW GRADE, EVEN WHERE WITHIN CONDUITS OR ENCLOSURES, SHALL BE SUITABLE FOR WET LOCATIONS.
C. PROVIDE PULL STRING IN EMPTY CONDUITS.
D. SEAL ENDS OF CONDUITS STUBBED UP ABOVE GRADE TO PROTECT FROM THE ELEMENTS.

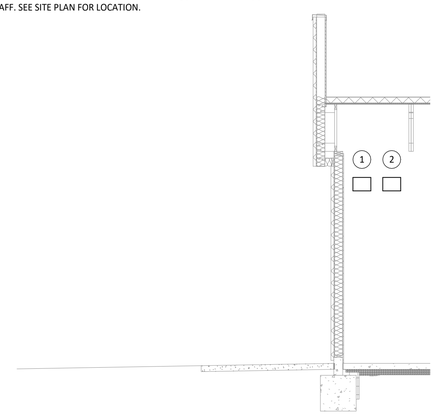

2 E115 **SITE CONDUIT DETAIL**
NOT TO SCALE

ELECTRICAL POWER PLAN NOTES

1 NOT USED.
2 NOT USED.
3 NOT USED.
4 NOT USED.
5 NOT USED.
6 NOT USED.
7 EXISTING 1" SPARE LOW VOLTAGE CONDUIT. SEE DETAIL 2/THIS SHEET FOR MORE INFORMATION.
8 EXISTING 1" SPARE LINE VOLTAGE CONDUIT. SEE DETAIL 2/THIS SHEET FOR MORE INFORMATION.
9 NOT USED.

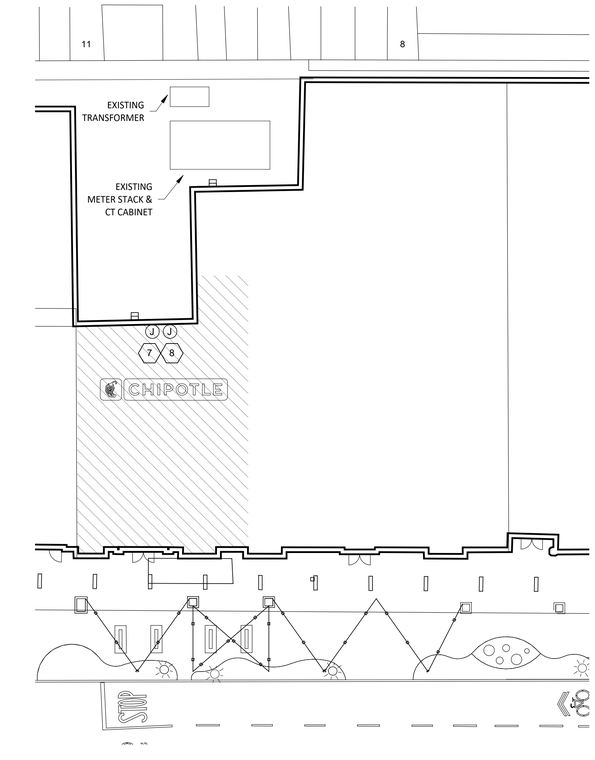

1 E115 **POWER SITE PLAN**
1" = 20'-0"

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

REGISTERED PROFESSIONAL ENGINEER
NAI-HUNG WU
No. E 25775
EXP. 08/30/27
ELECTRICAL
STATE OF CALIFORNIA

02/25/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
KRG	AG	WN	WN

Project No.
230654

Contents:
ELECTRICAL SITE POWER PLAN

E115

MECHANICAL AND PLUMBING EQUIPMENT SCHEDULE

ITEM	DESCRIPTION	AREA/ EQUIPMENT SERVED	QTY	AMPS	VOLTS	PHASE	WATTS OR VA	MOP (A)	DISC./FUSE TYPE	FEEDER	NOTES
RTU-1	ROOF TOP UNIT	KITCHEN	1	38.0	208	3	-	60	INTEGRAL	#8, #10 GND	
RTU-2	ROOF TOP UNIT	DINING ROOM	1	26.0	208	3	-	60	INTEGRAL	#8, #10 GND	
EF-1	EXHAUST FAN	KITCHEN	1	8.3	208	3	-	20	FRN-R-20	#12, #12 GND	
EF-2	EXHAUST FAN	RESTROOM	1	2.9	120	1	-	20	TO SWITCH	#12, #12 GND	
CU-1	CONDENSING UNIT	WALK-IN COOLER	1	9.0	208	3	-	15	FRN-R-15	#12, #12 GND	
CU-2	CONDENSING UNIT	ICE MAKER	1	9.0	120	1	-	15	FRN-R-15	#12, #12 GND	2
CU-3	CONDENSING UNIT	ICE MAKER	1	9.0	120	1	-	15	FRN-R-15	#12, #12 GND	2
MAU-1	MAKE-UP AIR UNIT	HD-1	1	3.1	208	3	-	15	FRN-R-15	#12, #12 GND	
HD-1	KITCHEN HOOD CONTROL PANEL	KITCHEN	1	12.0	120	1	-	20	J-BOX	#12, #12 GND	
HS-1B	HAND SINK FAUCET	RESTROOM	2	-	120	1	20	20	NEMA 5-20R	#12, #12 GND	
DWH-1	WATER HEATER	BUILDING	1	4.0	120	1	-	20	TO SWITCH	#12, #12 GND	
DWH-2	WATER HEATER	BUILDING	1	4.0	120	1	-	20	TO SWITCH	#12, #12 GND	
KITCHEN (POWER ONLY) EQUIPMENT SCHEDULE											
E-1A.1	FRONT SERVE LINE (RIGHT) - POS SYSTEM	KITCHEN	1	1.5	120	1	-	20	NEMA 5-20R	#12, #12 GND	
E-1A.2	FRONT SERVE LINE (RIGHT) - HOT FOOD WELLS	KITCHEN	1	20.0	208	1	-	30	NEMA 6-30R	#10, #10 GND	1
E-1A.3	FRONT SERVE LINE (RIGHT) - COLD TOP	KITCHEN	1	3.7	120	1	-	20	NEMA 5-20R	#12, #12 GND	1
E-2A	TORTILLA WARMER	KITCHEN	2	-	208	1	1800	20	NEMA 15-20R	#12, #12 GND	1
E-7B.1	UPRIGHT BEVERAGE COOLER	KITCHEN	1	5.0	120	1	-	20	NEMA 5-20R	#12, #12 GND	
E-7B.2	UPRIGHT BEVERAGE COOLER	KITCHEN	2	5.0	120	1	-	20	NEMA 5-20R	#12, #12 GND	
E-10	BLENDER	KITCHEN	1	11.5	120	1	-	20	NEMA 5-20R	#12, #12 GND	
E-11	CARVING STATION	KITCHEN	1	9.6	208	1	-	20	NEMA 5-20R	#12, #12 GND	1
E-12	UNDERCOUNTER REFRIGERATOR	KITCHEN	1	2.6	120	1	-	20	NEMA 5-20R	#12, #12 GND	
E-13	GRILL - NATURAL GAS	KITCHEN	1	-	120	1	200	20	NEMA 5-20R	#12, #12 GND	1
E-16	FRYER - GAS	KITCHEN	1	-	120	1	200	20	NEMA 5-20R	#12, #12 GND	1
E-18B	RICE COOKER - GAS	KITCHEN	1	0.5	120	1	-	20	NEMA 5-20R	#12, #12 GND	
E-26	HOT HOLDING CABINET	KITCHEN	1	-	120	1	1000	20	NEMA 5-20R	#10, #12 GND	
E-32.5	ICE MAKER - SANITIZER	KITCHEN	3	-	120	1	50	20	NEMA 5-20R	#12, #12 GND	1
E-32A	ICE MAKER FOR B.O.H. ICE BIN (SHORTER)	KITCHEN	1	10.5	120	1	-	20	NEMA 5-20R	#12, #12 GND	
E-32C	ICE MAKER (SODA MACHINE) AIR COOLED	KITCHEN	1	12.0	120	1	-	20	NEMA 5-20R	#12, #12 GND	
E-32D	ICE MAKER (SODA MACHINE) REMOTE COOLED	KITCHEN	1	12.5	120	1	-	20	NEMA 5-20R	#12, #12 GND	
E-33B	WALK-IN COOLER - EVAP.	KITCHEN	1	1.7	120	1	-	20	TO SWITCH	#12, #12 GND	1
E-39B.1	DML 2.0 - POS SYSTEM	KITCHEN	1	1.5	120	1	-	15	NEMA 5-15R	#12, #12 GND	1
E-39B.2	DML 2.0 - HOT FOOD WELLS	KITCHEN	1	20.0	208	1	-	30	NEMA 6-30R	#10, #10 GND	1
E-39B.3	DML 2.0 - FOOD WARMER	KITCHEN	1	11.7	120	1	-	20	NEMA 5-20R	#12, #12 GND	1
E-39B.4	DML 2.0 - COLD TOP	KITCHEN	1	3.7	120	1	-	20	NEMA 5-20R	#12, #12 GND	1
E-43	BEVERAGE COOLER BACKBAR 36IN	KITCHEN	1	3.0	120	1	-	20	NEMA 5-20R	#12, #12 GND	1
E-50	FOOD PROCESSOR	KITCHEN	1	15.0	120	1	-	20	NEMA 5-20R	#12, #12 GND	1
E-61B	DISH MACHINE (W/ PUMP)	KITCHEN	1	25.6	208	1	-	35	JJN-35	#8, #10 GND	
E-67	REFRIGERATED COUNTER CASE, SELF-SERVE	KITCHEN	1	8.8	120	1	-	20	NEMA 5-20R	#12, #12 GND	1
E-69B	M4.0 - SIMPLICITY BUBBLER MINI-QUAD	KITCHEN	1	8.5	120	1	-	20	NEMA 5-20R	#12, #12 GND	
MISC (POWER ONLY) EQUIPMENT SCHEDULE											
4C	SMART SAFE	BUILDING	1	-	120	1	200	20	NEMA 5-20R	#12, #12 GND	1
5B	SODA DISPENSER - W/ AIR-COOLED ICE MAKER	BUILDING	1	9.3	120	1	-	20	NEMA 5-20R	#12, #12 GND	1
5C	SODA DISPENSER - W/ REMOTE AIR-COOLED I.M.	BUILDING	1	9.2	120	1	-	20	NEMA 5-20R	#12, #12 GND	1
6	CARBONATOR FOR SODA SYSTEM	KITCHEN	1	10.8	120	1	-	20	NEMA 5-20R	#12, #12 GND	1
24	LAUNCHPORT WALL STATION	BUILDING	1	-	120	1	700	20	NEMA 5-20R	#12, #12 GND	1
32	CO2 ALARM	BUILDING	1	-	120	1	1	20	NEMA 5-20R	#12, #12 GND	

GENERAL NOTES

A. REFER TO VENDOR SHOP DRAWINGS FOR MORE DETAILS, CONFIRM FINAL POWER REQUIREMENTS AND LAYOUT PRIOR TO ANY NEW WORK.
B. REFER TO SHEET A702 FOR EQUIPMENT MANUFACTURER, MODEL, LOCATION AND APPROXIMATE MOUNTING HEIGHTS.
C. ALL SINGLE-PHASE RECEPTACLES RATED 150 VOLTS TO GROUND OR LESS, 50 AMPERES OR LESS AND THREE-PHASE RECEPTACLES RATED 150 VOLTS TO GROUND OR LESS, 100 AMPERES OR LESS INSTALLED IN THE KITCHEN AREA SHALL BE GFCI PROTECTED.
D. ALL EXTERIOR ELECTRICAL EQUIPMENT AND DEVICES SHALL BE RATED NEMA 3R.

NOTES

1. CONFIRM FINAL POWER REQUIREMENTS WITH VENDOR PRIOR TO ANY NEW WORK.
2. COORDINATE WITH VENDOR FOR WIRING DIAGRAM/DRAWINGS AND FINAL DETAILS PRIOR TO ANY RELATED WORK.
3. PROVIDED WITH INTEGRAL DISCONNECTING MEANS.

ELECTRICAL PANEL B

Location : REAR ENTRY
Supply From : PANEL A
Mounting : SURFACE NEMA: 1
Voltage Line-Line : 208 Phase: 3
Voltage Line-Ground : 120 Wires: 4
A.I.C Rating (A) : 22,000 Main Rating (A): 400
Main Type : MLO MCB Rating (A): -

NOTES:
1. REQUIRES GFCI PROTECTION.
2. CONFIRM FINAL POWER REQUIREMENTS.
3. PROVIDE A LOCKABLE BREAKER.
4. SHUNT TRIP PROTECTION BY ANSUL SYSTEM.
5.
6.

Notes	LOAD DESCRIPTION	SIZE (A)	POLES	CKT No	VOLT-AMPS PER PHASE A		B		C		CKT No	SIZE (A)	POLES	LOAD DESCRIPTION	Notes
1	6-CARBON/32-CO2 AL.	20	1	1	1296	1356					2	20	1	RCPT - PREP. TABLE	1
1	50-FOOD PROCESSOR	20	1	3			1800	1116			4	20	1	5B-SODA DISPENSER	1
	SPARE	20	1	5					0	1440	6	20	1	32C-ICE MAKER (UTEN.)	1
1	7B.2-BEV. COOLER	20	1	7	600	1020					8	20	1	69B-BUBBLER	1
1	67-REF. COUNTER CASE	20	1	9			1056	180			10	20	1	UV LIGHT TRAP	1
1	1A.3-COLD TOP	20	1	11					444	1000	12	20	2	11-CARVING STATION	1
1	32.5-ICE SANITIZER	20	1	13	150	1000					14	--	--	--	1
1	32A-ICE MAKER	20	1	15			1260	2080			16	30	2	1A.2-HOT FOOD WELLS	1
2	GAS WATER HEATER	20	1	17					960	2080	18	--	--	--	1
1,2,4	13-GRILL-NATURAL GAS	20	1	19	200	0					20	20	1	SPARE	
1,2,4	16-FRYER/18B-RICE	20	1	21			260	900			22	20	2	2A-TORTILLA WARMER	1
1	26-HOLDING CABINET	15	1	23					1000	900	24	--	--	--	1
1	2A-TORTILLA WARMER	20	2	25	900	312					26	20	1	12-U/C REFRIGERATOR	1
1	--	--	--	27			900	2080			28	30	2	39B.2-HOT FOOD WELLS	1
1	7B.1/7B.2-BEV. COOLER	20	1	29					1200	2080	30	--	--	--	1
1,3	61B-DISH MACHINE	35	2	31	2662	1404					32	20	1	39B.3-FOODWARMER	1
1,3	--	--	--	33			2662	444			34	20	1	39B.4-COLD TOP	1
	SPARE	30	2	35					0	1128	36	15	3	CU-1 (WALK-IN COND.)	
	--	--	--	37	0	1128					38	--	--	--	
1	43-BEV. COOLER 36IN.	20	1	39			360	1128			40	--	--	--	
	SPARE	20	1	41					0	0	42	20	1	SPARE	
	SPARE	20	1	43	0	0					44	20	1	SPARE	
	SPARE	20	1	45			0	180			46	20	1	WIC - DOOR SECTION	
	SPARE	20	1	47					0	200	48	20	1	33B-WIC-EVAPORATOR	
	SPARE	20	1	49	0	0					50	20	1	SPARE	
	SPARE	20	1	51			0	0			52	20	1	SPARE	
	SPARE	20	1	53					0	0	54	20	1	SPARE	
	Connected load per phase				12,029		16,406		12,432						

LOAD TYPE	FACTOR	CONNECTED (KVA) A	B	C	DEMAND (KVA) A	B	C	ADD'L DEMAND A	B	C	TOTAL DEMAND (KVA)
LIGHTING LOAD	1.25	0.0	0.0	0.0	0.0	0.0	0.0				0.0
REC. LOAD (10 KVA OR LESS)	1.00	0.2	0.2	0.0	0.2	0.2	0.0				0.3
REC. LOAD OVER 10 KVA	0.50	0.0	0.0	0.0	0.0	0.0	0.0				0.0
LARGEST MOTOR	1.25	0.0	0.0	0.0	0.0	0.0	0.0				0.0
OTHER MOTORS	1.00	0.0	0.0	0.0	0.2	0.0	0.0				0.2
MISCELLANEOUS	1.00	2.3	1.3	0.0	2.3	1.3	0.0				3.6
KITCHEN EQUIPMENT	0.65	9.6	14.9	12.2	6.2	9.7	8.0				23.9
	TOTAL KVA	12.0	16.4	12.4	8.7	11.2	8.2				28.0
	TOTAL KVA PER PHASE (KVA)				8.7	11.2	8.2				
	TOTAL AMPS PER PHASE (A)				72	93	68				

MINIMUM PANEL AMPACITY 94 Amps

ELECTRICAL PANEL A

Location : REAR ENTRY
Supply From : 400A MAIN
Mounting : SURFACE NEMA: 1
Voltage Line-Line : 208 Phase: 3
Voltage Line-Ground : 120 Wires: 4
A.I.C Rating (A) : 22,000 Main Rating (A): 400
Main Type : MLO MCB Rating (A): -

NOTES:
1. CONTAINS NO LOAD.
2. REQUIRES GFCI PROTECTION.
3. NOT USED.
4. RELOCATE EXISTING CIRCUIT FROM C&S WORK.
5.
6.

Notes	LOAD DESCRIPTION	SIZE (A)	POLES	CKT No	VOLT-AMPS PER PHASE A		B		C		CKT No	SIZE (A)	POLES	LOAD DESCRIPTION	Notes
	RTU-1	60	3	1	4560	0					2	60	3	TVSS	1
	--	--	--	3			4560	0			4	--	--	--	1
	--	--	--	5					4560	0	6	--	--	--	1
	RTU-2	60	3	7	3120	0					8	20	3	GRIDPOINT 3P METER	1
	--	--	--	9			3120	0			10	--	--	--	1
	--	--	--	11					3120	0	12	--	--	--	1
	RCPT - STOREFRONT	20	1	13	1200	180					14	20	1	GRIDPOINT XMFR	
	RCPT - DINING	20	1	15			180	996			16	20	3	EF-1	
	PANEL 'BDP'	20	1	17					1300	996	18	--	--	--	
	RCPTS - ROOFTOP	20	1	19	720	996					20	--	--	--	
	RCPTS - POS GENERAL	20	1	21			720	372			22	15	3	MAU-1	
	SECURITY/AUDIO	20	1	23					360	372	24	--	--	--	
	--	--	--	25	0	372					26	--	--	--	
2	RCPT - OFFICE	20	1	27			1080	348			28	20	1	EF-2	
2	RCPT - DML	20	1	29					1260	700	30	20	1	LTG - DINING + EM	
2	RCPT - RESTROOMS	20	1	31	360	1200					32	20	1	LTG - KITCHEN + EM	
	BATHROOM SANITIZER	20	1	33			100	300			34	20	1	EXISTING EXT. LIGHTS	4
	HD-1 (CTRL AND LTS)	20	1	35					1440	500	36	20	1	SIGN LIGHTING	2
	SPARE	20	1	37	0	1200					38	20	1	LIGHTING - EXTERIOR	2
4	EXISTING RECEPTACLE	20	1	39			180	500			40	20	1	SITE SIGNAGE	2
	--	--	--	41					0	1263	42	20	1	LIGHTING CTRL PANEL	
	SPARE	20	1	43	0	0					44			SPACE	
	SPARE	20	1	45			0	0			46			SPACE	
	SPARE	20	1	47					0	0	48			SPACE	
	SPARE	20	1	49	0	0					50			SPACE	
	SPARE	20	1	51			0	0			52			SPACE	
	SPARE	20	1	53					0	0	54			SPACE	
	FEED-THRU PANEL B	--	--		8682	0									
	--	--	--				11181	0							
	--	--	--						8151	0					
	Connected load per phase				22,590		23,637		24,022						

LOAD TYPE	FACTOR	CONNECTED (KVA) A	B	C	DEMAND (KVA) A	B	C	PANEL B + BDP A	B	C	TOTAL DEMAND (KVA)
LIGHTING LOAD	1.25	3.5	0.8	2.5	4.5	1.0	3.1	0.0	0.0	0.0	8.6
REC. LOAD (10 KVA OR LESS)	1.00	1.3	2.3	3.1	1.3	2.3	3.1	0.2	0.2	2.1	9.1
REC. LOAD OVER 10 KVA	0.50	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
LARGEST MOTOR	1.25	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
OTHER MOTORS	1.00	9.0	9.4	9.0	9.0	9.4	9.0	0.0	0.0	0.2	27.7
MISCELLANEOUS	1.00	0.0	0.0	0.0	0.0	0.0	0.0	2.3	1.3	0.0	3.6
KITCHEN EQUIPMENT	0.65	0.0	0.0	0.0	0.0	0.0	0.0	6.2	9.7	8.0	23.9
	TOTAL KVA	13.9	12.5	14.6	14.8	12.7	15.2	8.7	11.2	10.3	72.8
	TOTAL KVA PER PHASE (KVA)				23.5	23.8	25.5				
	TOTAL AMPS PER PHASE (A)				196	199	212				

MINIMUM PANEL AMPACITY 213 Amps

FEEDER SCHEDULE

COPPER (CU) ALUMINUM (AL)	FEEDER ID	NOMINAL AMPACITY [AMPS AT 75C]	SETS	CONDUCTORS QUANTITY	CONDUCTORS SIZE [AWG]	GROUND WIRE SIZE [AWG] COPPER ONLY	MIN CONDUIT SIZE [IN] EMT	MIN CONDUIT SIZE [IN] SCHED 40 PVC	NOTES
CU	400/4	400	1	4	600 KCMIL	#3	4	4	1

GENERAL NOTES
1. CONDUCTORS SHALL BE PROVIDED WITH 90C THHN, THWN, XHHW INSULATION INDICATED BY CODE. MAXIMUM AMPACITY SHALL BE BASED ON NEC 75C RATINGS.

NOTES
1. CONTRACTOR SHALL CALCULATE CONDUIT SIZE IF USING ALTERNATE CONDUCTORS.

FAULT CURRENT CALCULATIONS

MAXIMUM AVAILABLE FAULT CURRENT (Iaic)
Isc = (Iaic x M) ; M = 1 / (1 + F)
F (3Ø) = (1.73 x L x Iaic) / (C x N x Vp)
F (1Ø) = (2 x L x Iaic) / (C x N x Vp)

FAULT POINT	FAULT LOCATION	DISTANCE IN FEET (L)	PHASE	AL / CU	SIZE	# OF RUNS (N)	CONDUIT: MAG+1 NON-MAG+2	PRIMARY VOLT. (Vp)	SECONDARY VOLT (Vs)	WIRE FACTOR (C)	XFMR SIZE (KVA)	XFMR IMPEDANCE (%Z)	UPSTREAM FAULT (Iaic)	FAULT VALUE (Ika)
1	(E) UTILITY TRANSFORMER											1.3		**44000**
2	(E) 1200A MDP	30	3	CU	600	4	2	480		112132			44000	**42207**
3	NEW PANEL A	100	3	CU	600	1	1	208		22965			42207	**16680**
4	NEW PANEL B	5	3	CU	600	1	1	208		22965			16680	**16190**

GENERAL NOTES:

1. UNLESS NOTED, ALL DEVICES AND TERMINATIONS 100 AMPS AND LESS TO BE RATED FOR 60°C WIRE, OVER 100 AMPS, 75°C WIRE.
2. ALL WIRE #8 AND SMALLER TO BE THWN/THHN CU.; #6 AND LARGER TO BE XHHW AL.
3. THE DESIGN PROFESSIONAL HAS PERFORMED ALL REQUIRED LOAD CALCULATIONS AND VERIFIES THAT ALL UPSTREAM PANELS AND EQUIPMENT ARE NOT OVERLOADED. REFER TO DEMAND LOAD SUMMARY ON THIS SHEET FOR MORE DETAILS.
4. CONFIRM UTILITY TRANSFORMER LOCATION, SIZE, IMPEDENCE, AND AVAILABLE FAULT WHEN INFORMATION BECOMES AVAILABLE FOR EOR TO UPDATE CALCULATIONS AS NEEDED.
5. CONFIRM SERVICE EQUIPMENT INSTALLATION MEETS LOCAL UTILITY REQUIREMENTS.

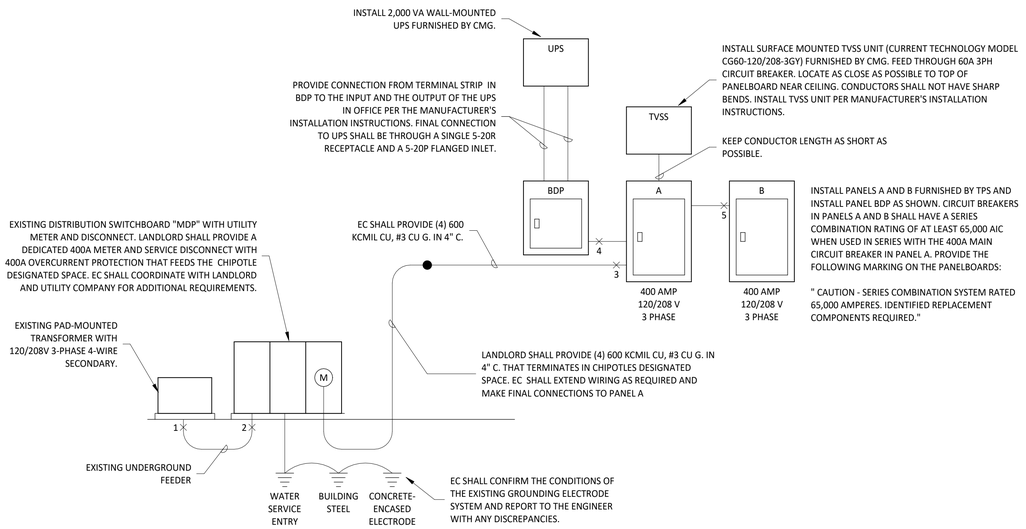

1 E600 **MAIN DISTRIBUTION DIAGRAM**
NOT TO SCALE

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

COLORADO PROFESSIONAL ENGINEER — ANTHONY GARCIA — 25775 — 08/30/21 — ELECTRICAL — STATE OF CALIFORNIA
02/25/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
KRG	AG	WN	WN

Project No.
230654

Contents:
ELECTRICAL SCHEDULES

E600

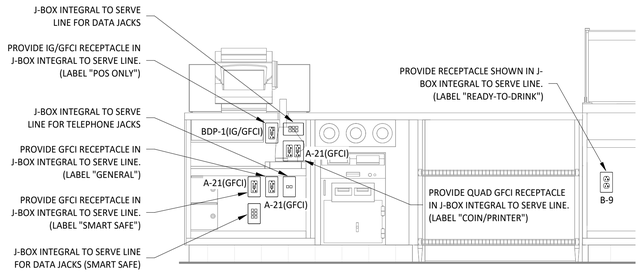

6 E700 **POS COUNTER ELECTRICAL ELEVATION**
3/4" = 1'-0"

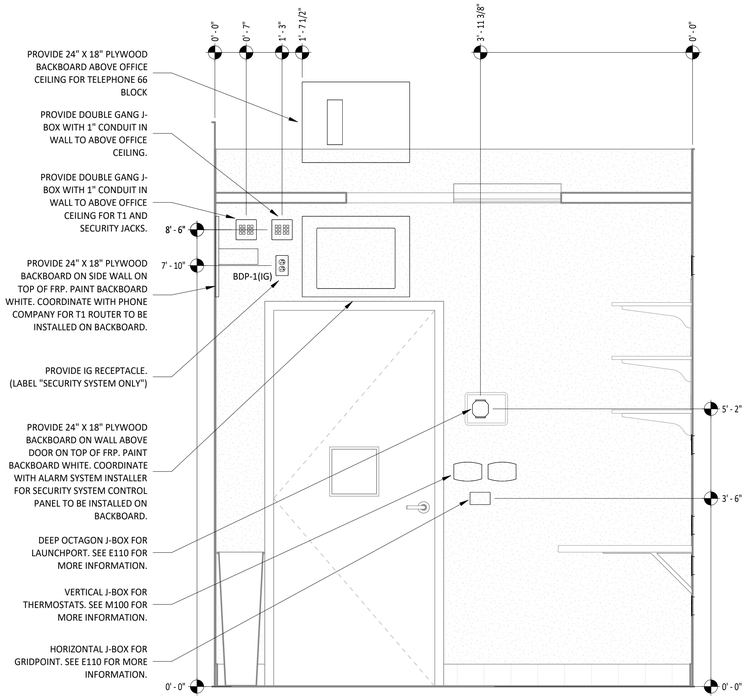

4 E700 **OFFICE DOOR ELECTRICAL ELEVATION**
3/4" = 1'-0"

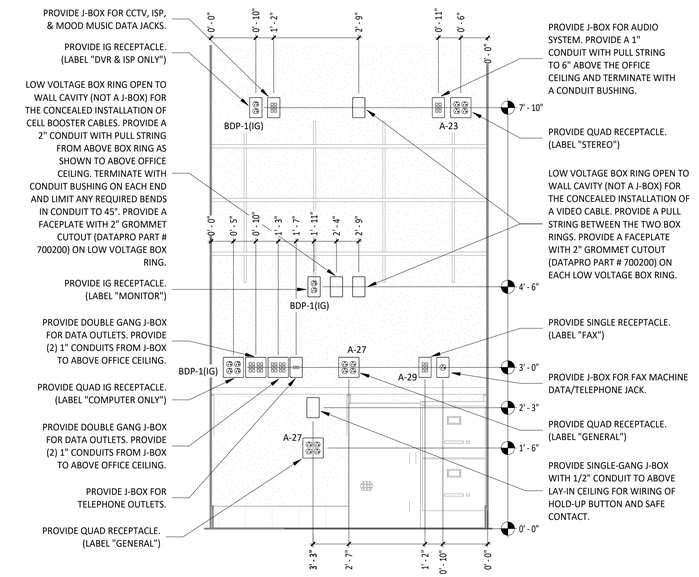

3 E700 **OFFICE DESK ELECTRICAL ELEVATION**
3/4" = 1'-0"

5 E700 **NOT USED**
NOT TO SCALE

2 E700 **NOT USED**
NOT TO SCALE

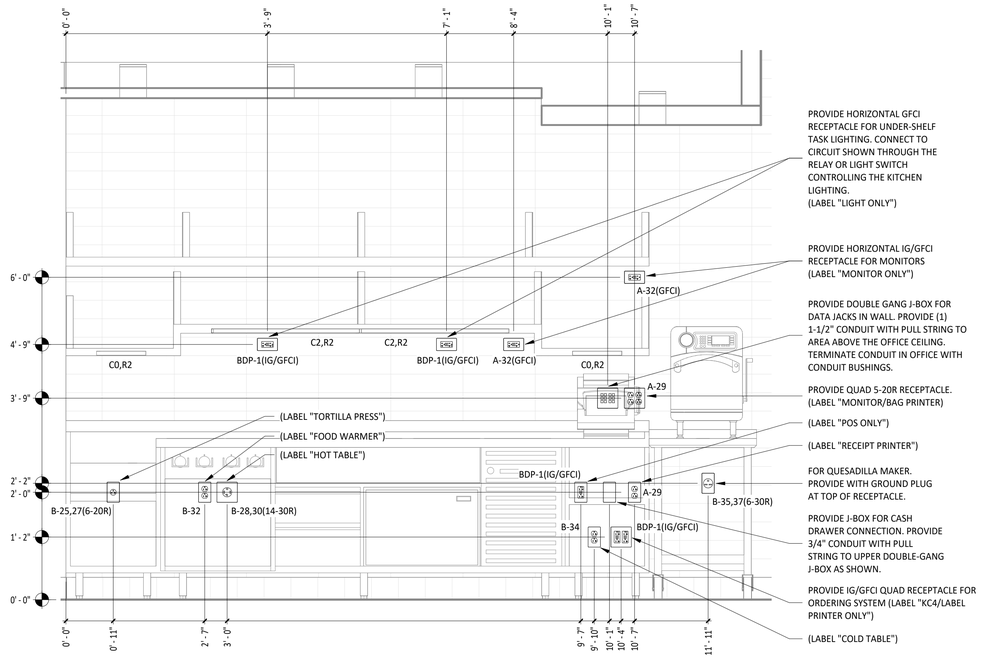

1 E700 **DML ELECTRICAL ELEVATION**
3/4" = 1'-0"

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

REGISTERED PROFESSIONAL ENGINEER
NAI-HUNG YU
No. E 25775
EXP. 08/30/27
ELECTRICAL
STATE OF CALIFORNIA

02/25/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
KRG	AG	WN	WN

Project No.
230654

Contents:
ELECTRICAL INTERIOR ELEVATIONS

E700

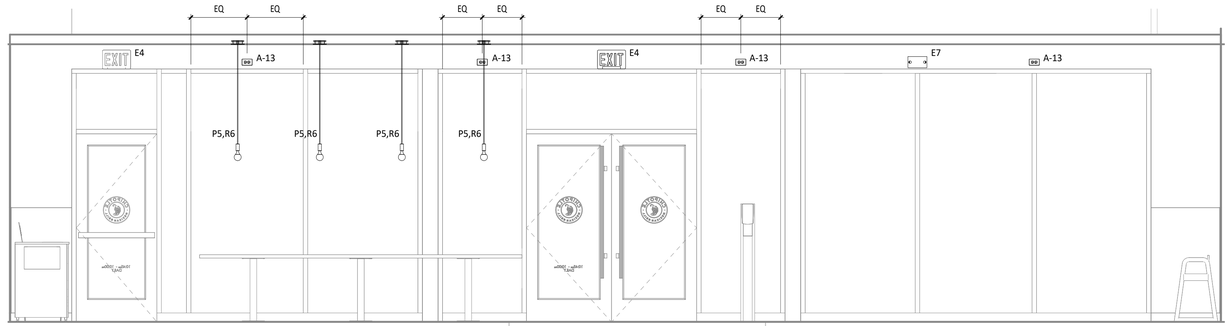

1 E705 **DINING ROOM ELECTRICAL ELEVATION**

3/8" = 1'-0"

Consultant:

Bowman

1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234

TEL 303-678-1108
WWW.BOWMAN.COM

02/25/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647

SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:

02/24/25	PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
KRG	AG	WN	WN

Project No.

230654

Contents:

ELECTRICAL INTERIOR ELEVATIONS

E705

GRIDPOINT DIAGRAM NOTES

1. INSTALL GRIDPOINT THERMOSTATS FURNISHED BY TEMS FOR RTU-1 AND RTU-2. PROVIDE THERMOSTAT WIRING FROM EACH THERMOSTAT TO THE CORRESPONDING ROOFTOP UNIT.
2. PROVIDE CAT5E CABLE FROM RTU-1 THERMOSTAT TO J-BOX #2 ABOVE ELECTRICAL PANELS (LEAVE 16" OF CABLE COILED UP INSIDE OF J-BOX #2 AND 16" BEHIND WALL OF THERMOSTAT FOR FINAL CONNECTION TO THE EMS SYSTEM BY THE TEMS) AND LABEL BOTH ENDS OF CABLE "TSTATS".
3. PROVIDE CAT5E CABLE(S) BETWEEN THERMOSTATS (LEAVE 16" OF CABLE BEHIND WALL OF EACH THERMOSTAT FOR FINAL CONNECTION BY THE TEMS) AND LABEL BOTH ENDS OF CABLE "TSTAT JUMPER". SEE GRIDPOINT INSTALLATION INSTRUCTIONS FOR TERMINATION INSTRUCTIONS.
4. INSTALL GRIDPOINT ZONE SENSOR MODULES FURNISHED BY TEMS AS SHOWN ON HVAC FLOOR PLAN. PROVIDE 18G-24G SHIELDED TWISTED PAIR FROM ZSM TO CORRESPONDING THERMOSTAT T1 TERMINALS. SEE GRIDPOINT INSTALLATION INSTRUCTIONS FOR TERMINATION INSTRUCTIONS.
5. INSTALL GRIDPOINT SUPPLY PROBE FURNISHED BY TEMS AS SHOWN ON HVAC FLOOR PLAN. PROVIDE 18G-24G SHIELDED TWISTED PAIR FROM SUPPLY PROBE TO CORRESPONDING THERMOSTAT T2 TERMINALS. SEE GRIDPOINT INSTALLATION INSTRUCTIONS FOR TERMINATION INSTRUCTIONS.
6. PROVIDE 3/4" LIQUIDTIGHT CONDUIT FROM DISH SANITIZING MACHINE TO LOW-VOLTAGE JUNCTION BOX OR TRIM RING FLUSH MOUNTED TO WALL. PROVIDE CONTINUOUS (NOT SPLICED) CAT5E CABLE FROM DISH SANITIZING MACHINE TO OFFICE (ABOVE LAY-IN CEILING) WITH 54" SLACK WITHIN THE DISH MACHINE AND 10' SLACK ABOVE THE LAY-IN CEILING. PROVIDE RJ-12 PLUG ON CABLE AT DISH MACHINE END WITH BLUE WIRE CONNECTED TO PIN 3 AND BLUE/WHITE WIRE CONNECTED TO PIN 4. LABEL CABLE ON BOTH ENDS WITH "DISHWASHER".
7. PROVIDE CAT5 CABLE FROM J-BOX #2 TO OFFICE ABOVE LAY-IN CEILING AND LABEL "RS-485 COMMS" ON BOTH ENDS OF THE CABLE. LEAVE 10' OF SLACK CABLE ABOVE OFFICE CEILING AND 16" OF SLACK CABLE INSIDE OF J-BOX #2.
8. PROVIDE CABLE (18-24AWG SHIELDED TWISTED PAIR) FROM J-BOX #2 TO OFFICE ABOVE LAY-IN CEILING AND LABEL "EMS POWER" ON BOTH ENDS OF THE CABLE. LEAVE 10' OF SLACK CABLE ABOVE OFFICE CEILING AND 16" OF SLACK CABLE INSIDE OF J-BOX #2.
9. PROVIDE SURFACE MOUNT 10" X 10" X 4" NEMA 1 ENCLOSURES ABOVE PANELBOARDS AND 6" BELOW CEILING.
10. PROVIDE 3/4" CONDUIT WITH INSULATING BUSHING ON END CONCEALED IN WALL FROM J-BOX #2 TO 6" ABOVE LAY-IN CEILING.
11. PROVIDE 3/4" CONDUIT(S) FROM J-BOX #1 TO J-BOX #2.
12. PROVIDE EMPTY 1" CONDUIT(S) FROM PANELBOARD(S) TO J-BOX #1 FOR FUTURE CT WIRING BY TEMS.
13. FIRST PANELBOARD FED FROM ELECTRICAL SERVICE. PROVIDE WITH (1) 20A/3-POLE CIRCUIT BREAKER (FOR GRIDPOINT 3 PHASE METER). IF PANELBOARD HAS 120V CIRCUITS AVAILABLE THEN ALSO PROVIDE (1) 20/1-POLE CIRCUIT BREAKER (FOR GRIDPOINT TRANSFORMER).
14. IF SPACE HAS MULTIPLE ELECTRICAL SERVICES THEN PROVIDE A "J-BOX #1" AND ASSOCIATED BREAKERS, CONDUITS, AND CONDUCTORS ON THE FIRST PANELBOARD FED FROM EACH ELECTRICAL SERVICE.
15. FOR EACH ELECTRICAL SERVICE PROVIDE (1) SET OF [(4) #12, #12 G.] FROM 3-POLE GRIDPOINT CIRCUIT BREAKER AND, IF THE PANELBOARD HAS 120V CIRCUITS AVAILABLE, (1) SET OF [(2) #12, #12 G.] FROM 1-POLE GRIDPOINT CIRCUIT BREAKER IN 3/4" CONDUIT CONCEALED IN WALL TO J-BOX #1. TERMINATE IN J-BOX #1 WITH 16" SLACK FOR FINAL CONNECTION BY TEMS.
16. IF THE PANELBOARD DOES NOT HAVE 120V CIRCUITS AVAILABLE PROVIDE A 1-POLE 120V 20A CIRCUIT BREAKER IN A PANEL WITH A 120V CIRCUIT AVAILABLE. PROVIDE (1) SET OF [(2) #12, #12 G.] FROM THE GRIDPOINT CIRCUIT BREAKER IN 3/4" CONDUIT CONCEALED IN WALL TO J-BOX #1. TERMINATE IN J-BOX # 1 WITH 16" SLACK FOR FINAL CONNECTION BY TEMS.
17. GRIDPOINT CONTROLLER PROVIDED BY TEMS
18. PROVIDE HORIZONTAL SINGLE-GANG J-BOX BELOW FUTURE GRIDPOINT CONTROLLER LOCATION AS SHOWN. PROVIDE 3/4" CONDUIT WITH PULL STRING AND INSULATING BUSHING FROM J-BOX TO 6" ABOVE OFFICE LAY-IN CEILING.

NOTE:
ARRANGEMENT SHOWN IS DIAGRAMMATIC - SEE PLANS FOR ACTUAL DEVICE LOCATIONS.

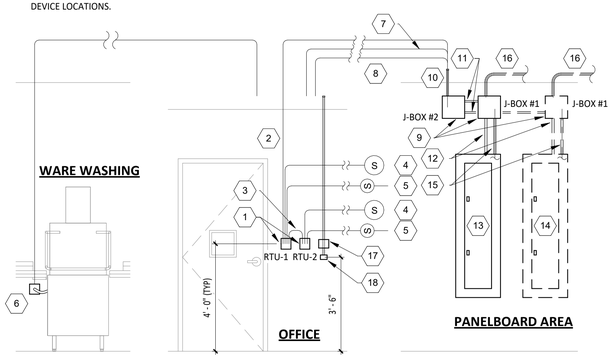

8 / E710 **GRIDPOINT WIRING DIAGRAM**
NOT TO SCALE

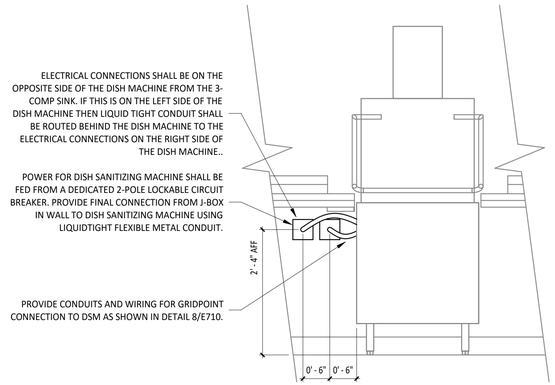

7 / E710 **DISH SANITIZING MACHINE ELECTRICAL DETAIL**
NOT TO SCALE

SEQUENCE OF OPERATIONS

A. EMERGENCY LIGHT FIXTURES, EXIT SIGNS, LOCALLY-SWITCHED FIXTURES, AND FIXTURES DESIGNATED AS NIGHT LIGHTS ARE NOT CONTROLLED THROUGH THE RELAY PANEL.
B. ALL TIMES NOTED SHALL BE LOCAL TIME AND SHALL AUTOMATICALLY ADJUST FOR DAYLIGHT SAVINGS TIME, IF APPLICABLE.
C. ALL KITCHEN LIGHTING CIRCUITS AND RESTROOM EXHAUST FAN CIRCUIT (R1, R2, R7) SHALL BE ENERGIZED AT FULL POWER FROM 7:00AM UNTIL MIDNIGHT AND SHALL BE DE-ENERGIZED AT OTHER TIMES.
D. ALL DINING ROOM LIGHTING CIRCUITS (R4, R5, R6) SHALL BE ENERGIZED FROM 10:00AM UNTIL MIDNIGHT AND SHALL BE DE-ENERGIZED AT OTHER TIMES.
E. EXTERIOR LIGHTING/SIGNAGE RELAY (R8) SHALL BE ENERGIZED FROM ONE HOUR BEFORE SUNSET UNTIL ONE HOUR AFTER CLOSING AND SHALL BE DE-ENERGIZED AT OTHER TIMES.
F. OVERRIDES: WHEN ONE OF THE OVERRIDE BUTTONS IS PRESSED THE SYSTEM WILL GO INTO OVERRIDE MODE FOR THE DURATION NOTED BELOW OR UNTIL THE NEXT SCHEDULED EVENT. FOLLOWING THIS PERIOD THE RELAYS WILL RETURN TO THE CURRENT SCHEDULED CONDITION. DURING THIS OVERRIDE TIME THE CORRESPONDING LAMP WILL ILLUMINATE ON THE OVERRIDE BUTTON.
G. INTERIOR (CHANNEL 1): WHEN THE INTERIOR OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 1) RELAYS R1, R2, R4, R5, R6, AND R7 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
H. KITCHEN DIMMING (CHANNEL 2): WHEN THE KITCHEN NORMAL/DIM OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 2) RELAY R2 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
I. DINING DIMMING (CHANNEL 3): WHEN THE DINING NORMAL/DIM OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 3) RELAYS R5 AND R6 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
J. EXTERIOR (CHANNEL 4): WHEN THE EXTERIOR OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 4) RELAY R8 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
K. VERIFY THAT TIME, TIME ZONE, AND LONGITUDE/LATITUDE ARE SET CORRECTLY ON LCP. VERIFY WITH STORE OPERATIONS THAT THE ON/OFF TIMES ARE COMPATIBLE WITH THE STORE OPERATING HOURS PRIOR TO TURNOVER.

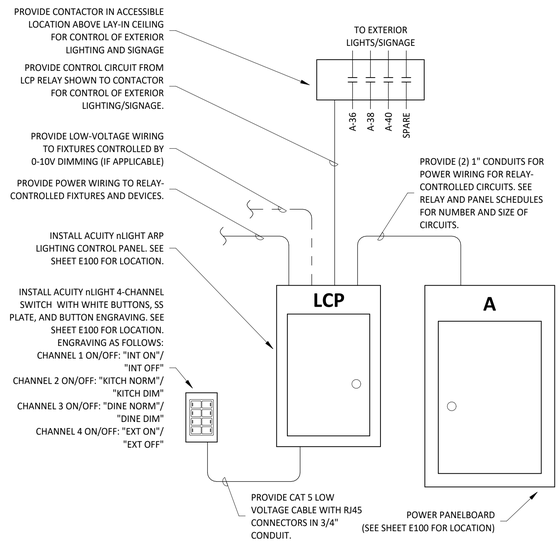

6 / E710 **LIGHTING CONTROL DIAGRAM**
NOT TO SCALE

5 / E710 **NOT USED**
NOT TO SCALE

CO2 ALARM OPTIONS	
CO2 DETECTOR	X
CO2 REMOTE DISPLAY UNIT	X
REMOTE STROBE	
RELAY	

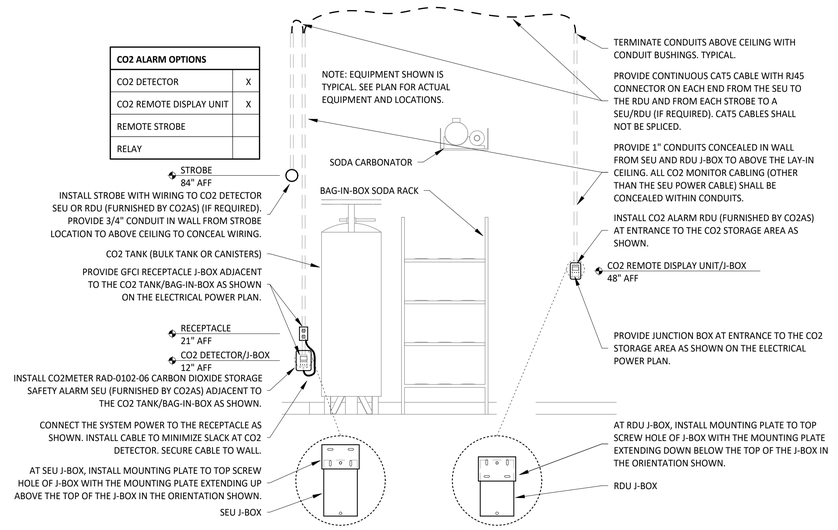

4 / E710 **CO2 ALARM DETAIL**
NOT TO SCALE

3 / E710 **NOT USED**
NOT TO SCALE

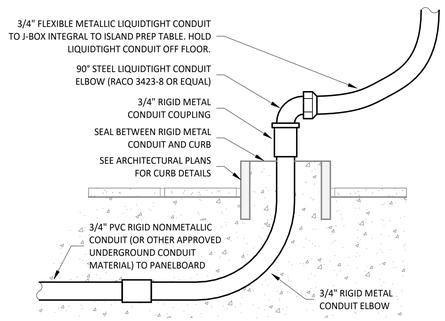

2 / E710 **PEDESTAL OUTLET DETAIL**
NOT TO SCALE

Consultant:
Bowman
1490 W 121ST AVE, STE 204
WESTMINSTER, CO 80234
TEL 303-678-1108
WWW.BOWMAN.COM

CONSULTING PROFESSIONAL ENGINEER
NAI-HUNG WANG
No. E-25775
EXP. 08/30/27
ELECTRICAL
STATE OF CALIFORNIA
02/25/2025

COPYRIGHT 2025
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: 614.318.2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 04-5647
SIR FRANCIS DRAKE,
150 BON AIR CENTER,
GREENBRAE, CA 94904

Issue Record:
02/24/25 PERMIT SET

Revisions:

Drawn:	PM:	CC:	Checked:
KRG	AG	WN	WN

Project No.
230654

Contents:
ELECTRICAL DETAILS

E710