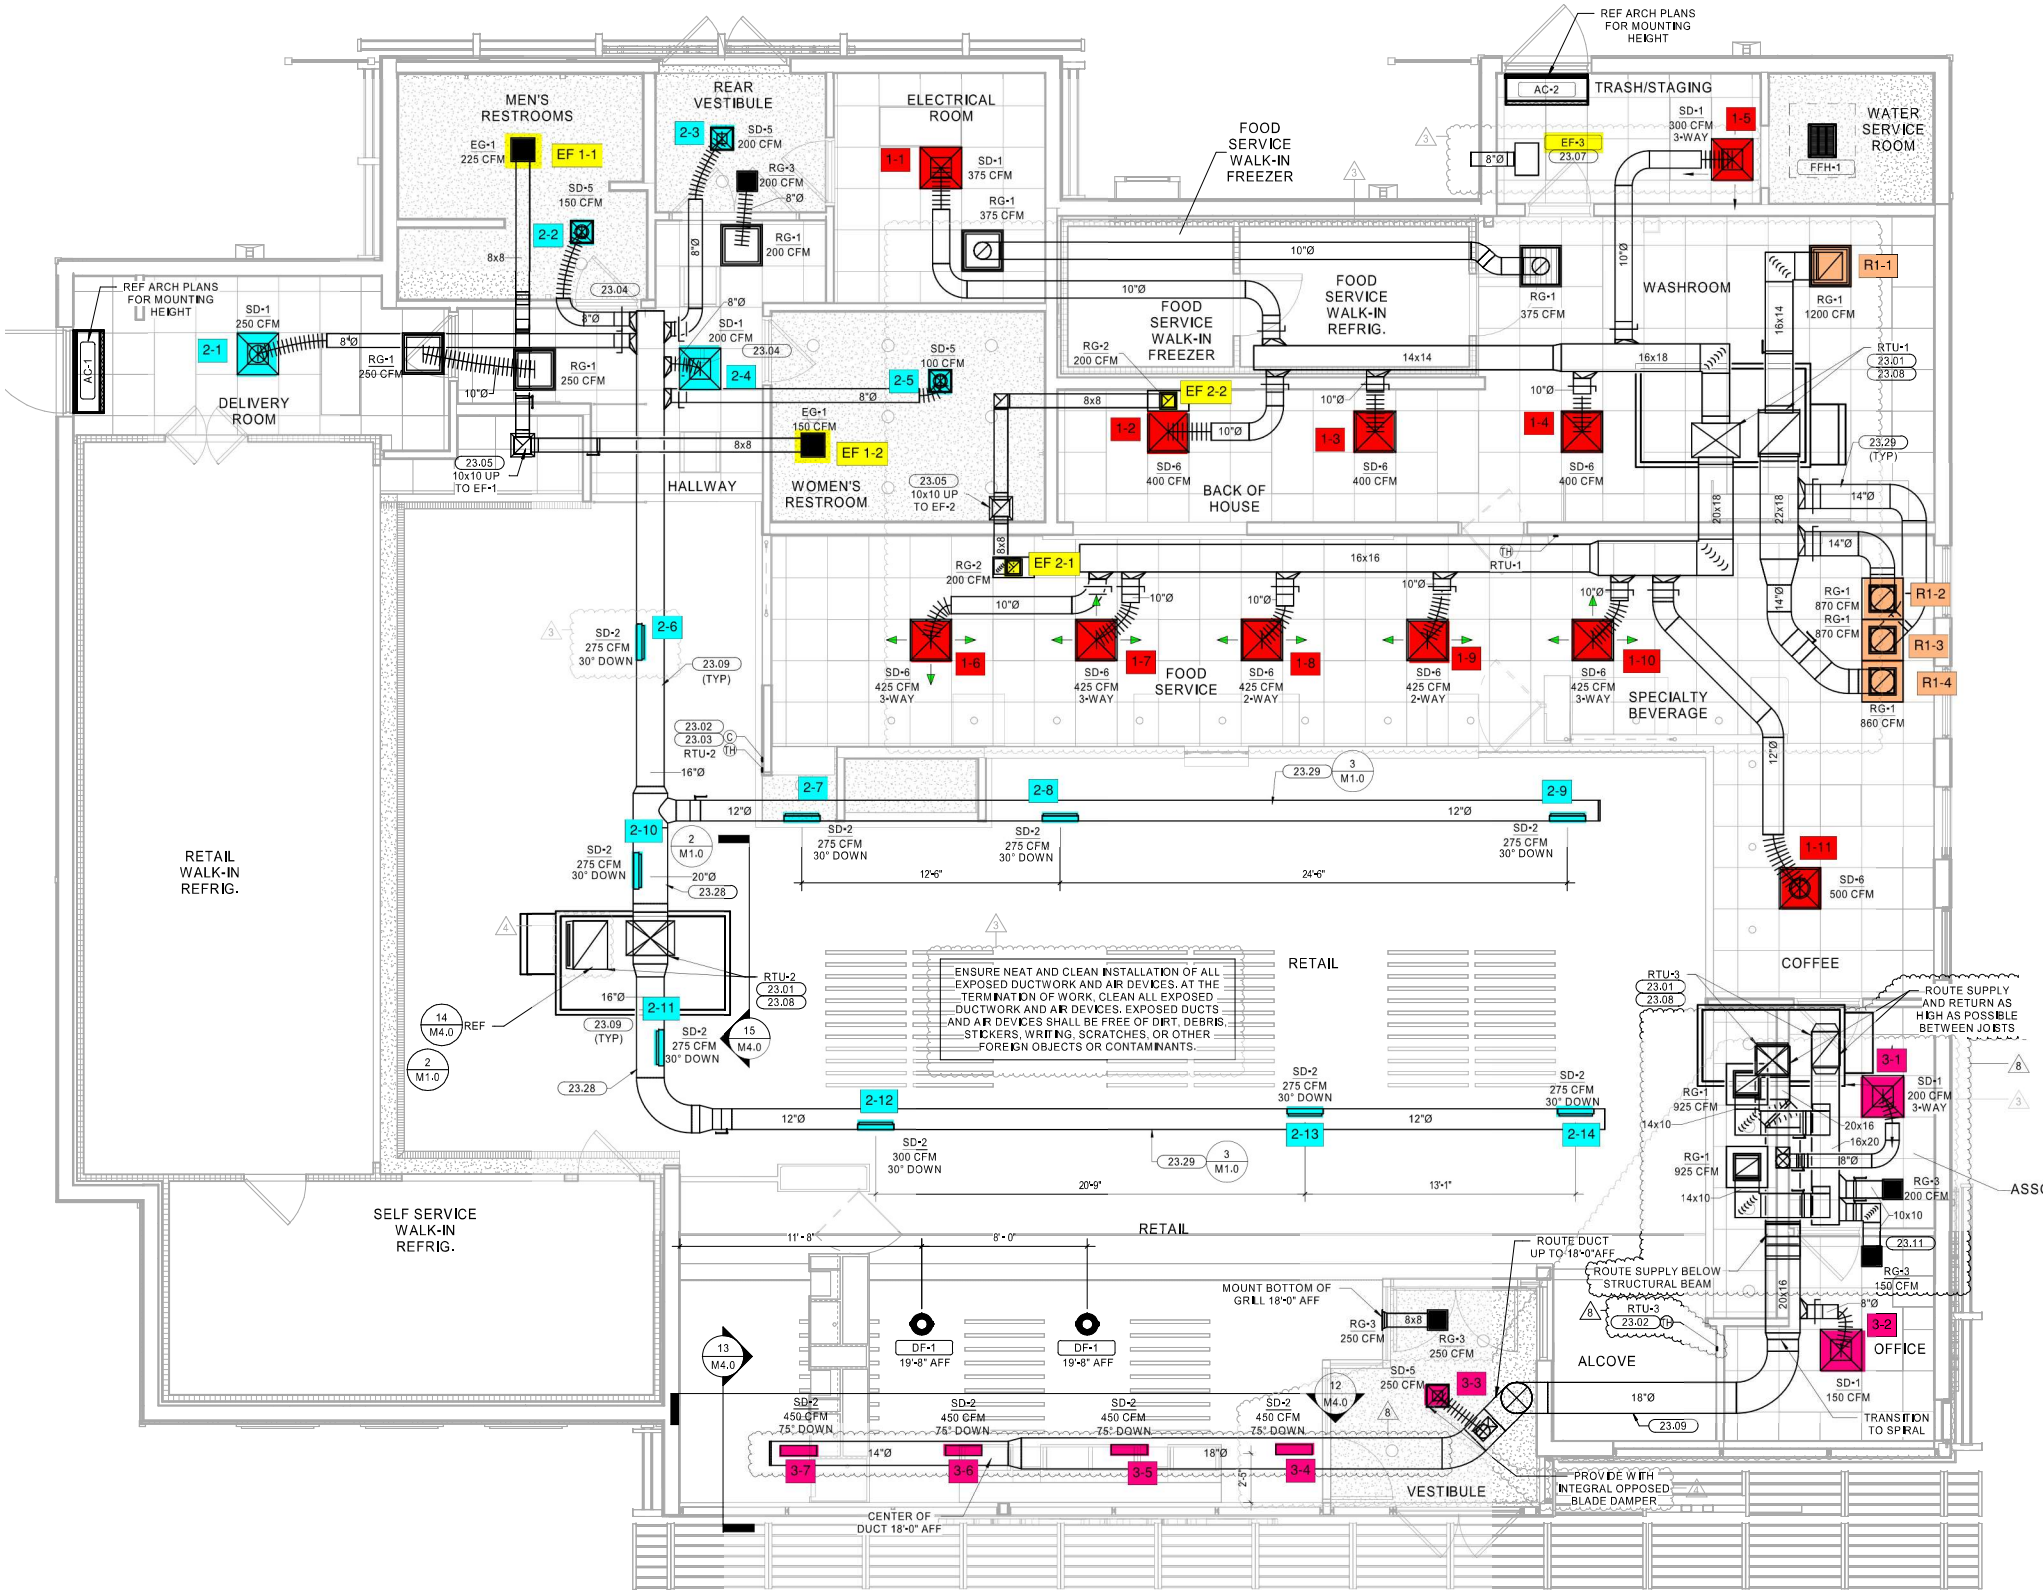
MEN'S RESTROOMS
REAR VESTIBULE
ELECTRICAL ROOM
FOOD SERVICE WALK-IN FREEZER
TRASH/STAGING
WATER SERVICE ROOM
REF ARCH PLANS FOR MOUNTING HEIGHT
DELIVERY ROOM
HALLWAY
WOMEN'S RESTROOM
BACK OF HOUSE
FOOD SERVICE WALK-IN REFRIG.
WASHROOM
FOOD SERVICE
SPECIALTY BEVERAGE
COFFEE
RETAIL WALK-IN REFRIG.
RETAIL
ENSURE NEAT AND CLEAN INSTALLATION OF ALL EXPOSED DUCTWORK AND AIR DEVICES. AT THE TERMINATION OF WORK, CLEAN ALL EXPOSED DUCTWORK AND AIR DEVICES. EXPOSED DUCTS AND AIR DEVICES SHALL BE FREE OF DIRT, DEBRIS, STICKERS, WRITING, SCRATCHES, OR OTHER FOREIGN OBJECTS OR CONTAMINANTS.
ROUTE SUPPLY AND RETURN AS HIGH AS POSSIBLE BETWEEN JOISTS
ASSOC.
SELF SERVICE WALK-IN REFRIG.
ROUTE DUCT UP TO 18'-0" AFF
ROUTE SUPPLY BELOW STRUCTURAL BEAM
MOUNT BOTTOM OF GRILL 18'-0" AFF
ALCOVE
OFFICE
TRANSITION TO SPIRAL
VESTIBULE
PROVIDE WITH INTEGRAL OPPOSED BLADE DAMPER
CENTER OF DUCT 18'-0" AFF