

SHOP DRAWING AND SUBMITTAL REVIEW

July 23, 2024

CH-1,CH-2 PAGE 8

Project Name: **Cabarrus County Behavioral Health**

Project Number: **D22-2545**

Submittal description: **025 236423.13-1 Air-Cooled Scroll Water Chiller**

Reviewed By: RD

Engineer's review is only for checking conformance with the design concept and contract documents. Review comments or lack thereof shall not be considered as relieving the contractor from meeting the requirements of the construction documents, including plans and specifications. The contractor is responsible for dimensions to be confirmed and correlated at the job site, for information that pertains solely to the fabrication process or to techniques of construction, for and the safety and coordination of the work of all trades.

Reviewed

Revise and Resubmit

Furnish as Corrected

Rejected

Roy Dayan 07/23/2024

Reviewers Signature and Date

Comments:

1. Warranty/Labor shall be updated per Messer's comments.

Built-in cover page

288-1: AIR COOLED WATER CHILLER



Status	Open Submitted
Spec section	23 64 23 AIR COOLED SCROLL WATER CHILLER
Manager	Alec Carnes (Messer Construction)
Responsible contractor	bob gianfagna (Johnson Controls, Inc.)
Reviewers step 01	Alec Carnes (Messer Construction)
Reviewers step 02	Alec Carnes (Messer Construction)

Reviewed

COMMENTS NOTED.

Reviewed by: Alec Carnes Date: 06/28/2024

Messer Construction

EQUIPMENT SUBMITTAL FOR APPROVAL

PROJECT: Messer - CCBH Cabarrus

LOCATION:



Air-Cooled Chiller

EQUIPMENT	YLAA Chiller
UNIT TAGS	CH-1, CH-2
QUANTITY	2

DATE:
Tuesday, 07 May 2024

REVISION:
0



Equipment Sales Office: 9685 Cincinnati Dayton Rd, West Chester Township, OH 45069

Clarifications

- Evaporator return/entering glycol is 57.3 deg F vs. 54 deg F with scheduled 261gpm flow and 42 deg F leaving set point.
- MCA 388A vs scheduled 381A, MOCP remains the same at 400A
- Total rated tons will be 159.3TR vs scheduled 160TR
- Actual weight is 8516lbs with pump kit at 80ft h20 per RFI vs scheduled 8070lbs. Actual flow is 261gpm per chiller schedule, not 247gpm on pump scheduled.
- Per schedule note 11, Fused disconnect will be provided by Div 26



TABLE OF CONTENTS

(YLAA - Air-Cooled Chiller)

BOM Data

Performance Ratings

Unit Drawings

Wiring Diagrams

Unit Specifications Text

Warranties

Submittal Approval Page



BID DATE: 05/07/2024
PROJECT: Messer - CCBH Cabarrus
TO: Interested Bidders

LAST ADDED NUM: None
NOTE(S)

BILL OF MATERIAL

ITEM	QTY	TAGS	DESCRIPTION
I	2	(2)CH-1, CH-2	DIRECT EXPANSION - AIR COOLED SCROLL CHILLER

EQUIPMENT DESCRIPTIONS EQUIPMENT PROPOSAL

Items Included

- Provide Model YLAA0175HJ46XFB Qty: 2
- Refrigerant Type: R454B
- Brine Application
- Power: 460/3/60 Application
- Control Transformer
- Power Connection: SP NF Disconnect Switch
- Starter Type: Across the line starter
- TEAO Fan Motors
- Low Sound Fans with VSD
- Standard Insulation
- Aluminum MCHX Coils
- Both Low/High Ambient Kit
- Louvered/Wire Encl Panels (factory)
- Hot Gas Bypass required - 1 circuit
- Compressor Parts Only Warranty: 66 Month (2-5 Year) from date of Shipment or from date of Start Up, whichever comes first.
- Entire Unit Parts Only Warranty: 42 Month (2-3 Year) (Months are from date of shipment/Years are from date of start up, whichever expires first)
- First Year Labor Warranty
- Pump Kit G required, Dual VSD Full Feature
- SC-Equip Board
- Electronic Expansion Valves

CONFIRM LOW AMBIENT KIT TO -10F OAT

PER 236423.13 2.8.B: CONFIRMED LOW AMBIENT KIT.

MESSER, ARC

WARRANTY SHALL BE PARTS AND LABOR

PER THE RFP.

MESSER, ARC.

Items NOT Included

- Hauling or Rigging Equipment Into Place.
- External Disconnect Switches or Circuit Breakers

Project Name: **Messer - CCBH Cabarrus**

Unit Tag: **CH-1, CH-2**

Qty.: 2

Model: **YLAA0175HJ46XF**

Full Load - Design

PIN

YLAA0175HJ	46XFBSDTXA	SXBLXCXX42	XE1XXXHXXX	XAXGXXX5XB	XVGSXXXXG6			
...5...10	...5...20	...5...30	...5...40	...5...50	...5...60	...5...70	...5...80	...5...90

Unit

Model No.	YLAA0175HJ46XFB
Number of Compressors	6
Compressor Type	Scroll - Hermetic
Number of Compressor Circuits	2
Refrigerant	R454B

Performance Data

Cooling Capacity [tons.R]	159.3
Total Power Input [kW]	215.3
EER [Btu/W.h]	8.876
NPLV.IP [Btu/W.h]	17.20
A-Weighted Sound Power [dB(A)]	98.0
Sound Pressure (Hemispherical Method) [dB(A)]	68.0
Sound Pressure Measured at [ft]	30.0

Electrical Data

Nominal Voltage / Voltage Limits	460/3/60 / 414-506
Compressor RLA (each circuit) [A]	53.1 / 53.1 / 53.1 / 53.1 / 53.1 / 53.1
High LRA Current (each circuit) [A]	316.0 / 316.0 / 316.0 / 316.0 / 316.0 / 316.0
Fan QTY (each circuit)	5 / 5
Fan FLA (each circuit) [A]	4.0 / 4.0
Min. Circuit Ampacity [A]	388.0
Recommended Fuse / CB Rating [A]	400.0
Max. Inverse Time CB Rating [A]	400.0
Max. Dual Element Fuse Size [A]	400.0
Unit Short Circuit Withstand [kA]	5 kA
Wires Per Phase	2 + 3
Wire Range (Lug Size)	250 - 500 kcmil + #2/0 AWG - 400 kcmil
Compressor kW	198.5
Total kW w/ Hydrokit Power	222.8

Hydrokit

Pump Type	VSD Dual Pump, Full Feature
Pump Name	Hydrokit G
Required External Static Pressure [ft H2O]	80.0
Available External Static Pressure [ft H2O]	98.2
Pump Nominal Current [A]	1.0
Fluid Connection Diameter [in]	3



DESIGN CALLS FOR 2 SETS OF #3/0 AWG PER PHASE. ACCEPTABLE, NO CHANGE REQUIRED. MESSER. ARC

Performance Impacting Options

Starter Type	Across the line starter
Power Factor Correction Capacitor	No Power Capacitor required
Remote Evaporator	Standard Cooler required
Sound Kit	No Acoustic Blanket required
Fan	Low Sound Fans with VSD

Weight & Dimensional Data

Shipping Weight [lbs]	8397
Operating Weight [lbs]	8516
Refrigerant Charge [lbs]	156
Length [in]	232.7
Width [in]	88.3
Height [in]	94.2

Project Name: **Messer - CCBH Cabarrus**

Unit Tag: **CH-1, CH-2**


Qty.: **2**

Model: **YLAA0175HJ46XF**

Heat Exchanger Performance			
Evaporator		Condenser (Air Cooled)	
Heat Exchanger Type	Plate Heat Exchanger	Ambient Air Temperature* [°F]	100.0
Entering Fluid Temperature [°F]	57.30	Altitude* [ft]	0.00
Leaving Fluid Temperature [°F]	42.00	Condensing Temperature [°F]	125.69 / 125.69
Flow Rate* [USGPM]	261.0	Number of Fans	5 / 5
Fouling Factor* [h ft ² F/Btu]	0.000100	Total Air Flow [cfm]	150000
Fluid Type* / Concentration* [%]	Propylene Glycol / 25.0	Total Fan Power [kW]	16.80
Fluid Volume [USGAL]	14.3		
Evaporating Temperature [°F]	37.27		
Evaporator Pressure Drop [ft H ₂ O]	7.27		
Strainer Pressure Drop [ft H ₂ O]	1.82		
Extension Kit Pressure Drop [ft H ₂ O]	4.23		
Total Pressure Drop [ft H₂O]	16.6		
Fluid Connection Diameter [in]	4		
Minimum Flow Rate [USGPM]	150.0		
Maximum Flow Rate [USGPM]	625.0		

* Designates user specified input

Certified in accordance with the AHRI Air-Cooled Water-Chilling Packages Certification Program, which is based on AHRI Standard 550/590 (I-P) and AHRI Standard 551/591 (SI). Certified units may be found in the AHRI Directory at www.ahridirectory.org. Unit contains freeze protection fluids in the evaporator with a leaving chilled fluid temperature above 32 DEG F [0 DEG C] and is certified when rated per the Standard with water.



Air-Cooled Water Chilling Packages
AHRI Standards 550/590 and 551/591

Part Load Performance (Based on Standard AHRI Unloading)				
Percent Load	Ambient [°F]	Capacity [tons.R]	Power Input [kW]	Unit Efficiency [Btu/W.h]
100.0	100.0	159.3	215.3	8.876
78.4	83.2	124.8	111.9	13.39
59.4	83.2	94.67	80.75	14.07
65.1	66.4	103.8	68.46	18.19
44.2	66.4	70.42	42.64	19.82
46.8	55.0	74.51	38.64	23.14
22.2	55.0	35.37	18.69	22.71

Project Name: **Messer - CCBH Cabarrus**

Unit Tag: **CH-1, CH-2**

Qty.: **2**

Model: **YLAA0175HJ46XF**

Sound Power Levels (In Accordance with AHRI 370)

Percent Load	Ambient [°F]	Octave Band Center Frequency [Hz]								LWA
		63	125	250	500	1000	2000	4000	8000	
100.0	100.0	100.0	99.0	95.0	96.0	93.0	89.0	86.0	83.0	98.0
78.4	83.2	96.0	95.0	91.0	92.0	89.0	86.0	83.0	80.0	94.0
59.4	83.2	94.0	93.0	89.0	90.0	88.0	84.0	81.0	79.0	92.0
65.1	66.4	94.0	93.0	89.0	90.0	88.0	84.0	81.0	79.0	92.0
44.2	66.4	89.0	87.0	84.0	86.0	84.0	81.0	78.0	76.0	89.0
46.8	55.0	89.0	87.0	84.0	86.0	84.0	81.0	78.0	76.0	89.0
22.2	55.0	86.0	84.0	81.0	83.0	81.0	78.0	75.0	73.0	86.0

Note: Unit is equipped with Low Sound Fans with VSD.

Measurement of sound pressure used to obtain the sound power data presented is based on AHRI-370.

Air-cooled chillers are rated in terms of sound power not sound pressure. Johnson Controls provides estimates of sound pressure, but this is not the rating metric.

For an air-cooled chiller, sound pressure calculated from sound power varies depending on how the chiller is assumed to behave, i.e. the radiation model. In other words, determining sound pressure from sound power requires making assumptions that result in different answers at a given distance from the chiller. The environment also influences sound pressure in the field installation. Sound pressure estimation radiation models pertaining to air-cooled chillers include the 'traditional' hemispherical model, parallelepiped model and equivalent hemispherical model.

Regarding sound power, Johnson Controls references tolerance limits based on ASHRAE guidelines. These are +/- 6dB in the 63Hz octave band, +/- 4dB in all other octave bands and +/- 3dB for the overall dBA.

Tolerance limits are based on uncertainties associated with:

1. Measurement Test Procedure
2. Repeatability
3. Production / Manufacturing Variability

Standard deviation associated with air-cooled chiller sound data is a measure of spread i.e. it indicates the range of probability of sound levels. Note that for operating conditions other than AHRI's Standard Rating Condition, higher levels of uncertainty can be expected.

Lead times for factory performance testing depend on test laboratory availability. Please confirm with Johnson Controls Customer Service.

Estimated Sound Pressure Levels at 30.0 ft (Derived from AHRI 370 Sound Power using Hemispherical Method)

Percent Load	Ambient [°F]	Octave Band Center Frequency [Hz]								LpA
		63	125	250	500	1000	2000	4000	8000	
100.0	100.0	70.0	69.0	65.0	66.0	63.0	59.0	56.0	54.0	68.0
78.4	83.2	66.0	65.0	61.0	62.0	60.0	56.0	53.0	51.0	65.0
59.4	83.2	64.0	63.0	59.0	60.0	58.0	54.0	51.0	49.0	63.0
65.1	66.4	64.0	63.0	59.0	60.0	58.0	54.0	51.0	49.0	63.0
44.2	66.4	59.0	58.0	54.0	56.0	55.0	51.0	48.0	46.0	59.0
46.8	55.0	59.0	58.0	54.0	56.0	55.0	51.0	48.0	46.0	59.0
22.2	55.0	56.0	54.0	51.0	53.0	52.0	48.0	45.0	43.0	56.0

Project Name: **Messer - CCBH Cabarrus**

Unit Tag: **CH-1, CH-2**

Qty.: **2**

Model: **YLAA0175HJ46XF**

Performance at AHRI Conditions			
Evaporator		Condenser	
EFT [°F]	54.00	Ambient Temp. [°F]	95.0
LFT [°F]	44.00	Altitude [ft]	0.00
Flow Rate [USGPM]	412.2	Performance	
Pressure Drop [ft H2O]	15.9	EER [Btu/W.h]	10.02
Fluid Type	Water	IPLV.IP [Btu/W.h]	17.44
Fouling Factor [h ft ² F/Btu]	0.000100	Net Cooling Capacity [tons.R]	172.7
Fluid Volume [USGAL]	14.3		

Note: Unit rated at design condition capacity.

Part Load Performance (Based on AHRI 550/590 - 2018 (IP))				
Percent Load	Ambient [°F]	Capacity [tons.R]	Power Input [kW]	Unit Efficiency [Btu/W.h]
100.0	95.0	172.7	206.8	10.02
75.1	80.0	129.6	108.6	14.32
55.4	80.0	95.69	77.92	14.74
60.4	65.0	104.3	67.55	18.53
39.8	65.0	68.77	41.74	19.77
41.9	55.0	72.38	38.38	22.63
20.2	55.0	34.91	18.63	22.49

Notes:

Country of Origin: Mexico

Min flow rate is for chillers using water. For glycol chillers please contact the application engineering team.

This unit does not have a coil coating selected.

Compliant with ASHRAE 90.1 - 2010, 2013, 2016, 2019, 2022.

Compliant with IECC - 2012, 2015, 2018.

Compliant with the requirements of the LEED Energy and Atmosphere Enhanced Refrigerant Management Credit (EAc4).

The product image shown is for illustrative purposes only and is not representative of selected options.

Pump Curve Report

Project Name: Messer - CCBH Cabarrus

Unit Tag: CH-1, CH-2

Qty.: 2

Model: YLAA0175HJ46XF


PIN

YLAA0175HJ	46XFBSDTXA	SXBLXCXX42	XE1XXXHXXX	XAXGXXX3XB	XVGSXXXXG6			
....5...105...205...305...405...505...605...705...805...90

Hydrokit Performance Data

Pump		Flow Rate [GPM]	261.0
Quantity	2	NPSHR [ft H2O]	9.70
Type	VSD Dual Pump, Full Feature	Pressure Drop	
Motor Speed [RPM]	3600	Total [ft H2O]	96.7
Impeller Diameter [in]	5.6	Chiller Internal [ft H2O]	16.6
Motor Power [hp]	10	External [ft H2O]	80.1
Efficiency [%]	69%	Safety Factor [ft H2O]	1.61






CONFIRM PUMP SELECTION IS FOR 25%PG AND NOT CLEAR WATER. CONFIRMED MESSER, ARC

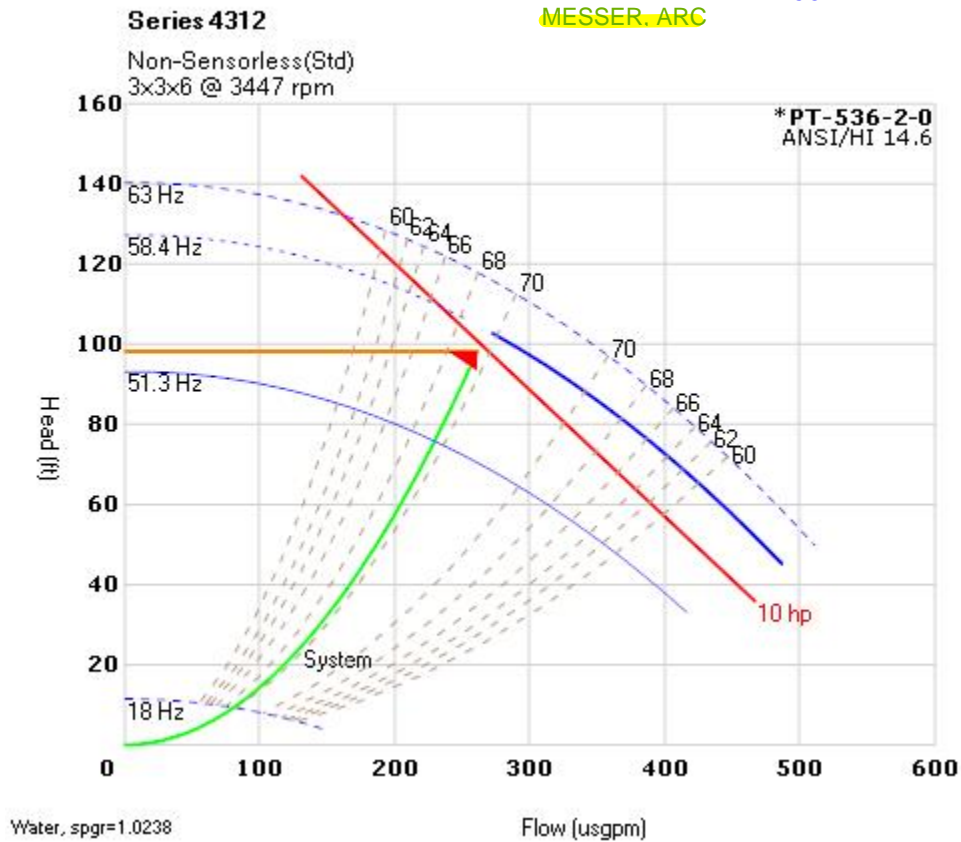

16 15 14 13 12 11 10 9 8 7 6 5 4 3 2 1

NOTE:
 1. PLACEMENT ON A LEVEL SURFACE FREE OF OBSTRUCTIONS (INCLUDING SNOW, FOR WINTER OPERATION) OR AIR-CIRCULATION ENSURES RATE PERFORMANCE, RELIABLE OPERATION AND EASE OF MAINTENANCE. SITE RESTRICTIONS MAY COMPROMISE MINIMUM CLEARANCES INDICATED BELOW, RESULTING IN UNPREDICTABLE AIR FLOW PATTERNS AND POSSIBLE DIMINISHED PERFORMANCE. JOHNSON CONTROLS UNIT CONTROLS WILL OPTIMIZE OPERATION WITHOUT NUISANCE HIGH PRESSURE SAFETY CUTOFF. HOWEVER, THE SYSTEM DESIGNER MUST CONSIDER POTENTIAL PERFORMANCE DEGRADATION.

- 1.1. RECOMMENDED MINIMUM CLEARANCES:
 1.1.1. SIDE TO WALL - 1828.8mm [72.00]
 1.1.2. REAR TO WALL - 1828.8mm [72.00]
 1.1.3. CONTROL PANEL TO WALL - 1219.2mm [48.00]
 1.1.4. TOP - NO OBSTRUCTIONS ALLOWED.
 1.1.5. DISTANCE BETWEEN ADJACENT UNITS - 3048mm [120.00]
 1.1.6. NO MORE THAN ONE ADJACENT WALL MAY BE HIGHER THAN UNIT.
2. WEIGHT AND CENTRE OF GRAVITY- REF TO AVM REPORT
3. INSTALLING CONTRACTOR MUST INCLUDE VENT AND DRAIN ACCOMMODATIONS IN CHILLED WATER PIPING NEAR EVAPORATOR.
4. NUMBER OF COMPRESSORS MAY VARY FROM DRAWING.
 4.1. REFER TO YORKWORKS REPORTS
5. FOR MONTERREY, MEXICO AND SAN ANTONIO, TEXAS BUILDS ONLY

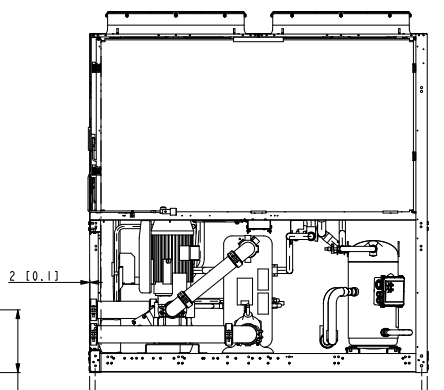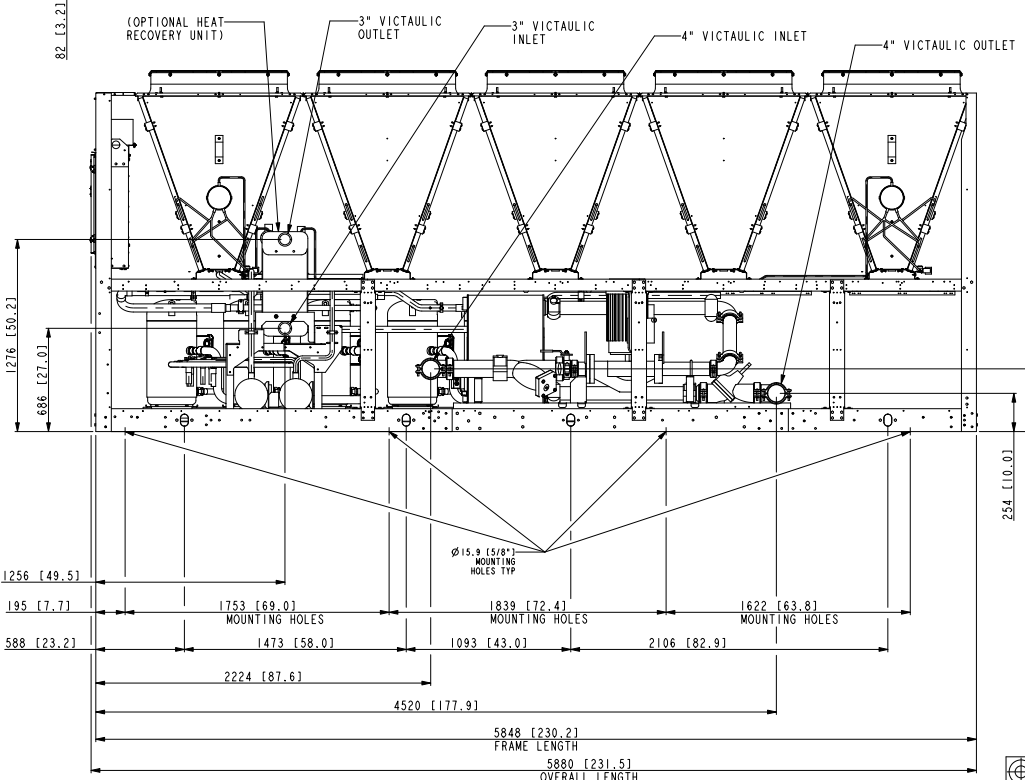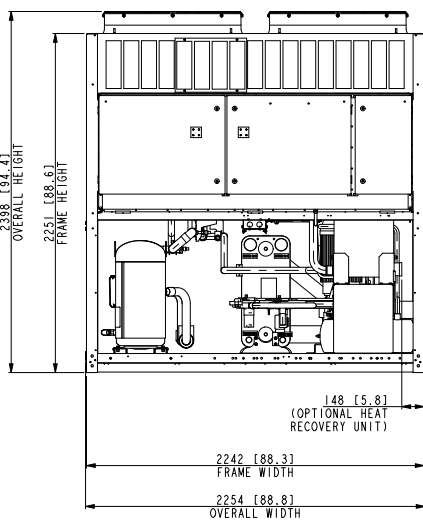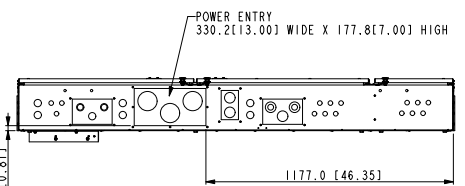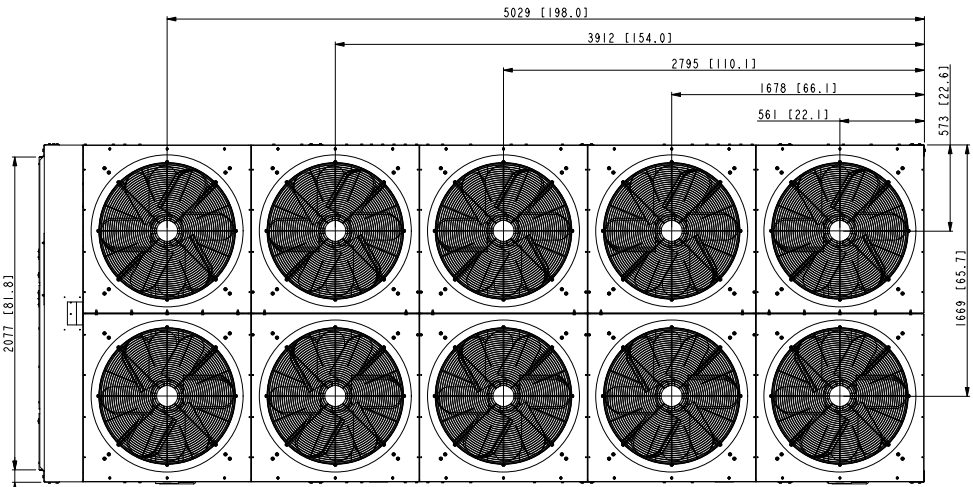

NOTE: LEFT CORNER POST REMOVED FOR CLARITY.

THIS DRAWING PERTAINS TO THE FOLLOWING MODELS:	
YLAA 0156 HE	YLAA 0156 HJ
YLAA 0170 SE	YLAA 0170 SJ
YLAA 0175 HE	YLAA 0175 HJ

REV.	DATE	EC. NO.	DR.	CHK.	ENG.
F	08-MAY-2023	ECR23-0279	RWA	DBN	AR
UPDATE TABLE TO INCLUDE YLAA 0156 HJ, 0170 SJ, AND 0175 HJ MODELS					

CONTINUED

ALL PROPRIETARY RIGHTS IN THE SUBJECT MATTER HEREOF ARE RESERVED AND NO PERMISSION IS GRANTED TO REPRODUCE THIS POST, IN WHOLE OR IN ANY PART, OR DISCLOSE ANY OF THE INFORMATION UPON IT TO OTHERS WITHOUT WRITTEN RELEASE BY JOHNSON CONTROLS INCORPORATED

Johnson Controls JOHNSON CONTROLS - BUILDING EFFICIENCY
 507 EAST MICHIGAN STREET, MILWAUKEE, WI, 53202 USA

DO NOT SCALE

YLAA 10-FAN 50 & 60HZ WITH HYDRO PUMP AND HEAT RECOVERY
 DISHIE, D175SE, D175HE

MATERIAL N/A
 ENG. STD. N/A
 PART NO.
 COT SIZE N/A

DRAWN M. LUPTON 04-DEC-2013
 MODELER M. LUPTON 04-DEC-2013
 CHKD A. SATCH 04-DEC-2013
 ENG

CAGE NUMBER
A1 66935


DRAWING NUMBER
 035-24059-013

REVISION
 VERSION


SCALE: 0.000 MASS (kg): 0.000 ORIG. NO.: SHEET 1 OF 1
 Eng Ckg

16 15 14 13 12 11 10 9 8 7 6 5 4 3 2 1

Wiring diagram

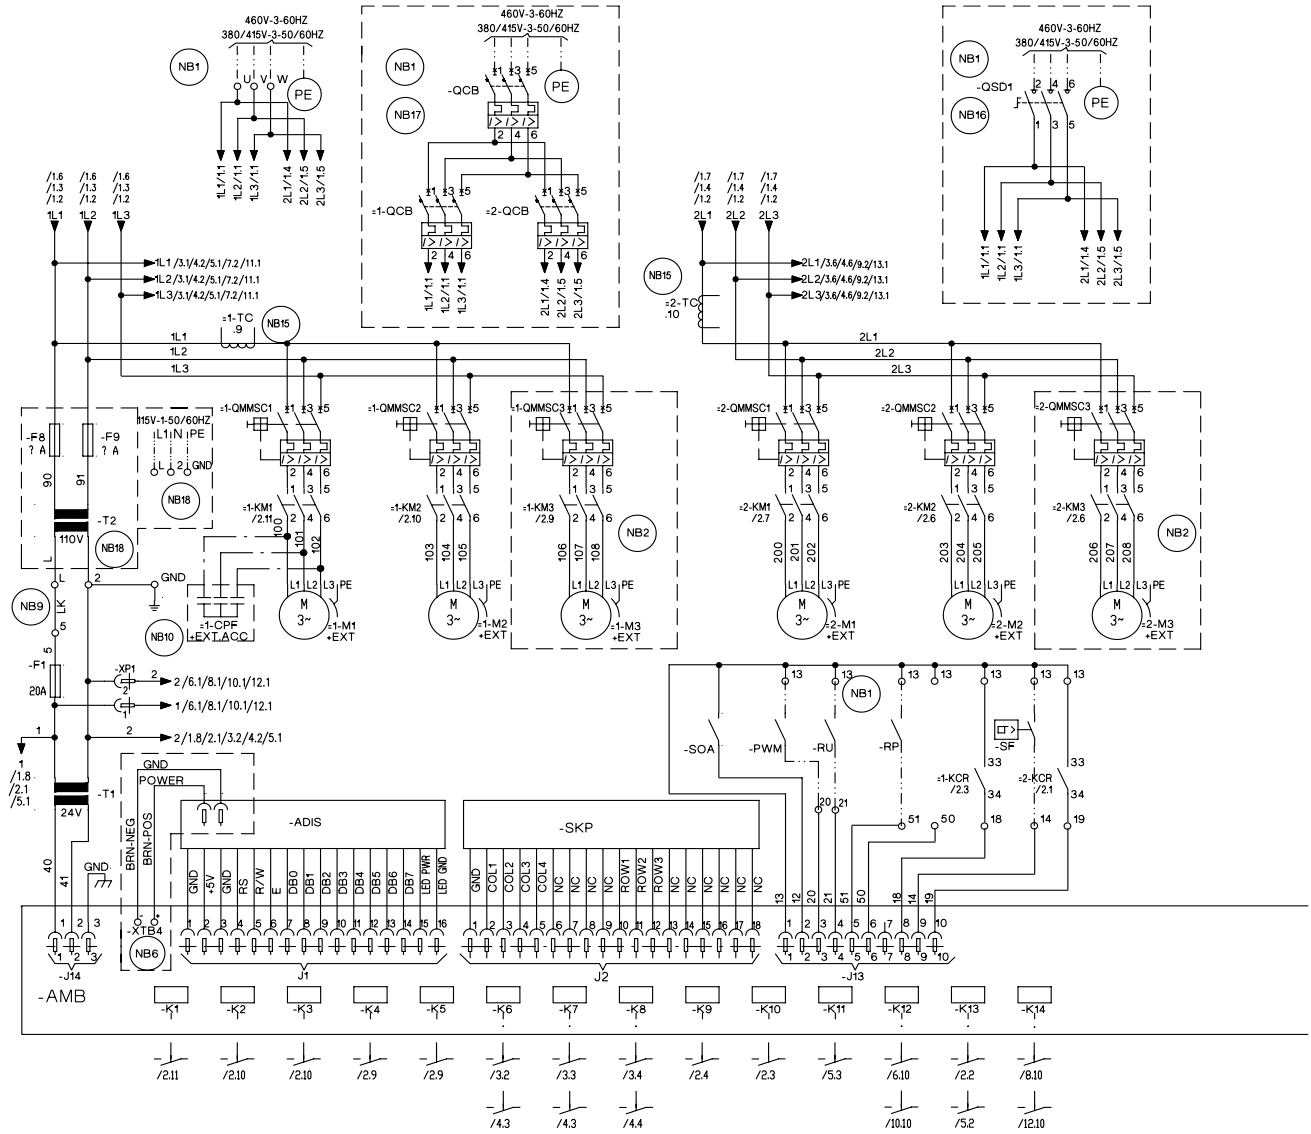

Wiring diagram (Cont'd)

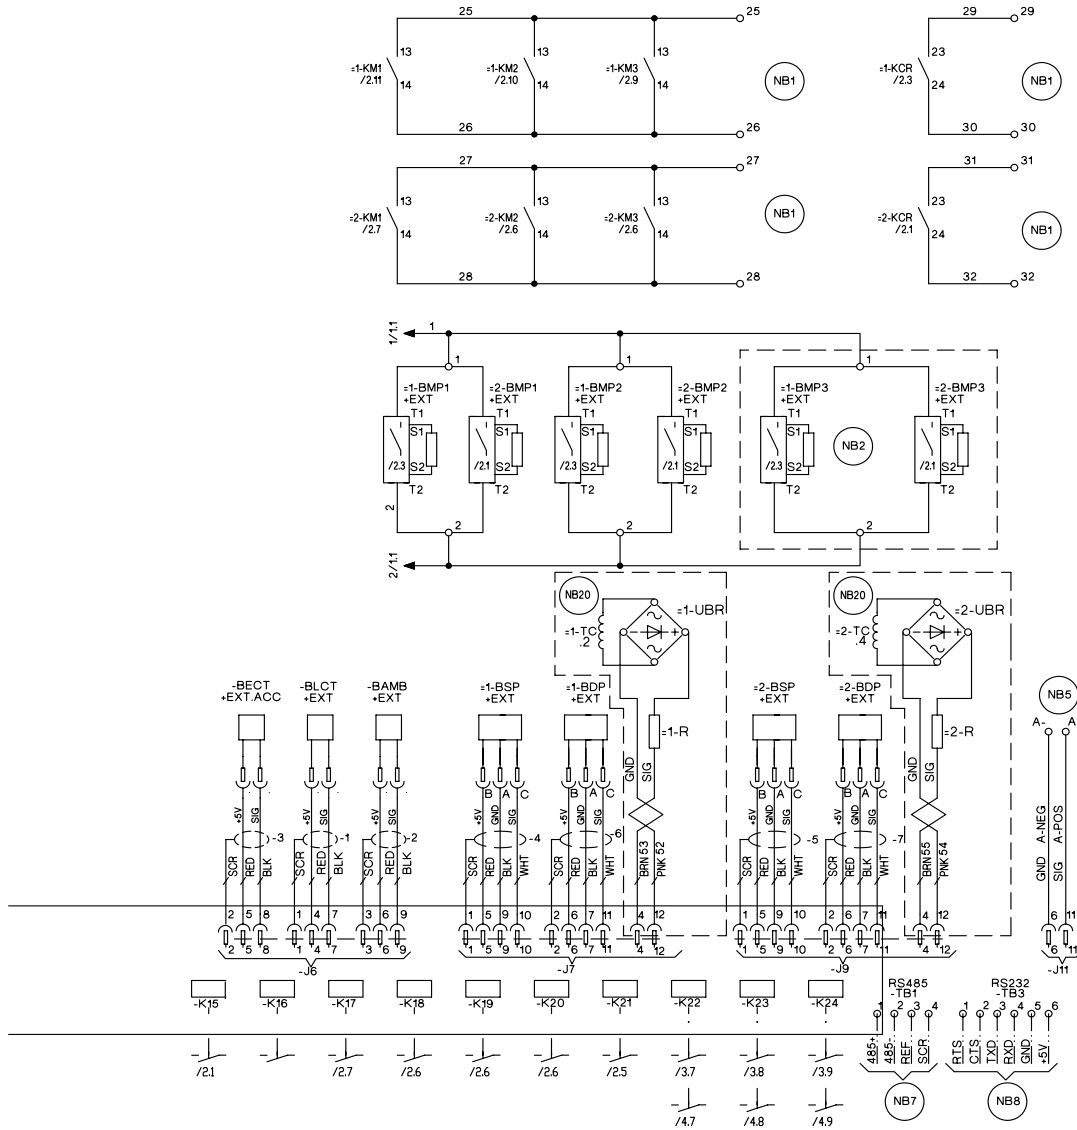

LD18444

Wiring diagram (Cont'd)

Designation	DESCRIPTION
ACC	ACCESSORY
- ADIS	DISPLAY BOARD
- AMB	MICRO BOARD

- BAMB	AMBIENT
- BDP	DISCHARGE PRESSURE
- BECT	ENTERING CHILLED TEMP
- BLCT	LEAVING CHILLED TEMPERATURE
NOT FITTED ON REMOTE EVAP UNITS	

-BMP	MOTOR PROTECTOR COMP
- BSP	SUCTION PRESSURE

-CPF	CAPACITOR POWER FACTOR
------	------------------------

- ECH	CRANKCASE HEATER
-EEH	EVAPORATOR HEATER
-EPH	PUMP HEATER
-EXT	EXTERNAL TO CONTROL PANEL

- F	FUSE
- FHP	HIGH PRESSURE CUTOUT
-FSI	FAN SPEED INHIBIT TWO SPEED FAN OPTION ONLY

GND	GROUND
G/Y	GREEN / YELLOW

J	PLUG BOARD CONNECTOR
---	----------------------

-K	CIRCUIT BOARD RELAY
-KF	FAN CONTACTOR LINE
-KFH	FAN CONTACTOR HIGH SPEED (INCLUDING COIL SUPPRESSOR)
-KFL	FAN CONTACTOR LOW SPEED (INCLUDING COIL SUPPRESSOR)
-KFOL	FAN OVERLOAD
-KFS	RELAY FAN SPEED
-KM	COMPRESSOR CONTACTOR (INCLUDING COIL SUPPRESSOR)
-KCR	CONTROL RELAY
-KP	PUMP CONTACTOR PART (INCLUDING COIL SUPPRESSOR)

- M	COMPRESSOR MOTOR
-MF	MOTOR FAN
-MP	MOTOR PUMP

NU	NOT USED
----	----------

PE	PROTECTIVE EARTH
PWM	PULSE WIDTH MODULATION TEMP RESET or REMOTE UNLOAD 2nd STEP

Designation	DESCRIPTION
-QCB	CIRCUIT BREAKER
-QMMS	MANUAL MOTOR STARTER COMP
-QMMS	MANUAL MOTOR STARTER PUMP
-QSD	SWITCH DISCONNECT

R	RESISTOR
RED	RED
RP	RUN PERMISSIVE
RU	REMOTE UNLOAD 1st STEP

CR	SCREEN
- SF	FLOW SWITCH
- SKP	KEYPAD
- SOA	SWITCH OFF AUTO

- T	TRANSFORMER
-TC	TRANSFORMER CURRENT

-UBR	BRIDGE RECTIFIER
------	------------------

WHT	WHITE
-----	-------

- XTBC	TERMINAL BLOCK CUSTOMER
- XTBF	TERMINAL BLOCK FACTORY

-YHGSV	HOT GAS SOLENOID VALVE (INCLUDING COIL SUPPRESSOR)
- YLLSV	LIQUID LINE SOLENOID VALVE (INCLUDING COIL SUPPRESSOR)
FIELD MOUNTED AND WIRED ON REMOTE EVAP UNITS	

- ZCPR	COMPRESSOR
--------	------------

(NB)	NOTE WELL (SEE NOTE)
------	----------------------

-----	WIRING AND ITEMS SHOWN THUS ARE STANDARD YORK ACCESSORIES
-------	--

-----	WIRING AND ITEMS SHOWN THUS ARE NOT SUPPLIED BY JOHNSON CONTROLS
-------	---


— — —	ITEMS THUS ENCLOSED FORM A COMPONENTS OR SETS OF COMPONENTS
-------	--

Wiring diagram (Cont'd)

- A. This drawing is based on IEC symbols.
 - B. Field wiring to be in accordance with the relevant electrical code as well as all other applicable codes and specifications.
 - C. All sources of supply shown on this diagram to be taken from one main isolator, not shown or supplied by the chiller manufacturer.
 - D. Green and yellow wire is used for earth, multicolored cable used for low voltage. Red wire used for AC control, blue wire for neutral, black wire for AC and DC power. Orange wire should be used for interlock control wiring supplied by external source.
 - E. Legend designation depicts component abbreviations. Number prefix located, if applicable, on schematic circuit, refers to system thereon, e.g.= 1-FHP2 refers to high pressure cutout no 2 on system no 1.
 - F. All wiring to control section voltage free contacts requires a supply provided by the customer maximum voltage 240 volts. The customer must take particular care when deriving the supplies for the voltage free terminals with regard to a common point of isolation. Thus, these circuits when used must be fed via the common point of isolation the voltage to these circuits is removed when the common point of isolation to the unit is opened. This common point of isolation is not supplied. The voltage free contacts are rated at 100 VA. All inductive devices {relays} switch by the voltage free contacts must have their coil suppressed using standard r/c suppressors.
 - G. Customer voltage free contacts connected to terminal 13 must be rated at 30 V 5 mA.
 - H. No controls {relays etc.} Should be mounted in any section of the control panel. Additionally, control wiring not connected to the control panel should not be run through the panel. If these precautions are not followed, electrical noise could cause malfunctions or damage to the unit and its controls.
1. Refer to installation commissioning operation and maintenance manual for customer connections and customer connection notes, non compliance to these instructions will invalidate unit warranty.
 2. Wiring and components for compressor 3 only fitted when unit has 3 compressors on the system. 1-BMP3 is replaced by a link across terminals 134 and 135. 2-BMP3 is replaced by a link across terminals 234 and 235.
 3. FHP2 is only fitted on 0089 and above. When not fitted 1-FHP2 is replaced by a link across terminals 132 and 139. 2-FHP2 is replaced by a link across terminals 232 and 239.
 4. Fitted on units with hot gas bypass option.
 5. EMS option is wired as shown.
 6. This wiring must be used for old display 031-0110-000.
 7. Network connection point.
 8. Printer port.
 9. Remote emergency stop can be wired between terminal 1 and 5 after removing link.
 10. Power factor correction accessory. Power factor correction fitted to each compressor contactor.
 11. Not fitted on compressors with internal motor protection. For system 1 terminals 132 and 133, 133 and 134 And 134 and 135 are linked. For system 2 terminals 232 and 233, 233 and 234 and 234 and 235 are linked.
 12. Only fitted on systems with 3 or 4 fans.
 13. Only fitted on systems with 4 fans.
 14. Only fitted on systems with 5 fans.
 15. Only fitted on systems with 6 fans.
 16. Input switch disconnect or circuit breaker option replaces input terminal block.
 17. Input switch disconnect and system circuit breaker option replaces input terminal block.
 18. 115 V control circuit requires a 115 V supply unless control circuit transformer -T2 and -F3 are fitted.
 19. For optional hydro kit. Heater -EPH is fitted and wired as shown. On single pump -KP1, -QMMSP1 and -MP1 are fitted and wired as shown. On two pump hydro kits -KP2, -QMMSP2 and -MP2 are also fitted and wired as shown.
 20. Current measurement option wired as shown.
 21. Only fitted on systems with single speed fans.
 22. Only fitted on systems with two speed fans.
 23. Optional compressor manual motors starters.
 24. See sheet 3 of connection diagram for power input options.


User control wiring

User control wiring inputs

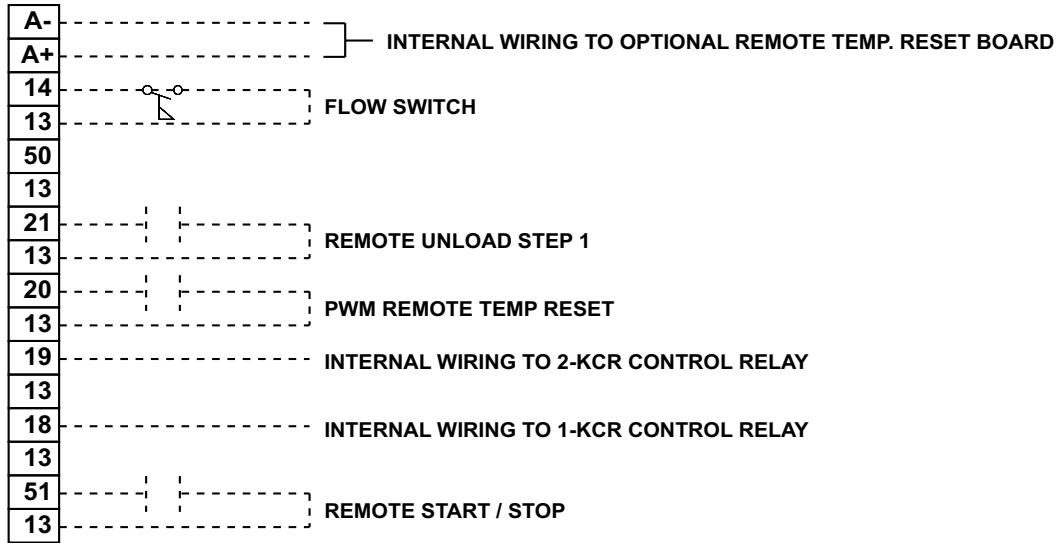

XTBC1

User control wiring outputs

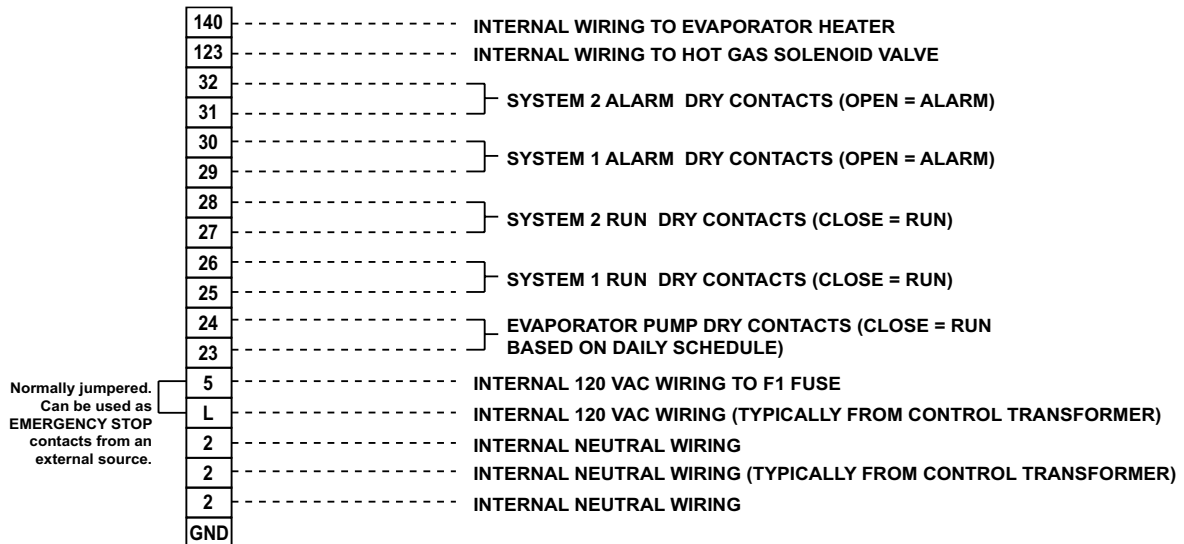

Normally jumpered.
Can be used as
EMERGENCY STOP
contacts from an
external source.

XTBC2

Air Cooled Scroll Liquid Chiller - YORK YLAA R454B 50Hz & 60Hz

I. GENERAL

a. GENERAL REQUIREMENTS

- i. The requirements of this Section shall conform to the general provisions of the Contract, including General and Supplementary Conditions, Conditions of the Contract, and Contract Drawings.

b. SCOPE

- i. Provide Microprocessor controlled, multiple scroll compressor, air-cooled, liquid chillers of the scheduled capacities as shown and indicated on the Drawings, including but not limited to:
 1. Chiller package
 2. Charge of refrigerant and oil
 3. Electrical power and control connections
 4. Chilled liquid connections
 5. Manufacturer start-up

c. QUALITY ASSURANCE

- i. Products shall be Designed, Tested, Rated and Certified in accordance with, and Installed in compliance with applicable sections of the following Standards and Codes:
 1. AHRI 550/590 – Water Chilling Packages Using the Vapor Compression Cycle
 2. AHRI 370 – Sound Rating of Large Outdoor Refrigerating and Air-Conditioning Equipment
 3. ANSI/ASHRAE 15 – Safety Code for Mechanical Refrigeration
 4. ANSI/ASHRAE 34 – Number Designation and Safety Classification of Refrigerants
 5. ASHRAE 90.1 – Energy Standard for Buildings Except Low-Rise Residential Buildings
 6. ANSI/NFPA 70 – National Electrical Code (N.E.C.)
 7. ASME Boiler and Pressure Vessel Code, Section VIII, Division 1
 8. OSHA – Occupational Safety and Health Act
 9. Manufactured in facility registered to ISO 9001
 10. Conform to Intertek Testing Services for construction of chillers and provide ETL/cETL Listed Mark
 - ii. Factory Run Test: Chiller shall be pressure-tested, evacuated and fully charged with refrigerant and oil, and shall be factory operational run tested with water flowing through the vessel.
 - iii. Chiller manufacturer shall have a factory trained and supported service organization.
 - iv. Warranty: Manufacturer shall Warrant all equipment and material of its manufacture against defects in workmanship and material for a period of eighteen (18) months from date of shipment or twelve (12) months from date of start-up, whichever occurs first.
- ### d. DELIVERY AND HANDLING
- i. Unit shall be delivered to job site fully assembled with all interconnecting refrigerant piping and internal wiring ready for field installation and charged with refrigerant and oil by the Manufacturer.
 - ii. Provide protective covering over vulnerable components for unit protection during shipment. Fit nozzles and open ends with plastic or fabric enclosures.
 - iii. Unit shall be stored and handled per Manufacturer' s instructions.

II. PRODUCTS

a. CHILLER MATERIALS AND COMPONENTS

- i. General: Install and commission, as shown on the schedules and plans, factory assembled, charged, and tested air cooled scroll compressor chiller(s) as specified herein. Chiller shall be designed, selected, and constructed using a refrigerant with Flammability rating of "1", as defined by ANSI/ASHRAE STANDARD 34 Number Designation and Safety Classification of Refrigerants. Chiller shall include not less than two refrigerant circuits above 50 tons (200kW), scroll compressors, direct-expansion type evaporator, air-cooled condenser, refrigerant, lubrication system, interconnecting wiring, safety and operating controls including capacity controller, control center, motor starting components and special features as specified herein or required for safe, automatic operation.
- ii. Cabinet: External structural members shall be constructed of heavy gauge, galvanized steel coated with baked on powder paint which, when subject to ASTM B117, 1000 hour, 5% salt spray test, yields minimum ASTM 1654 rating of "6".
- iii. Operating Characteristics: Provide low and high ambient temperature control options as required to ensure unit is capable of operation from 30°F to 115°F (-1°C to 46°C) ambient temperature. [Optional: -10°F to 125°F (-23°C to 52°C) ambient.]
- iv. Service Isolation valves: Discharge (ball type) isolation valves factory installed per refrigerant circuit. Includes a system high-pressure relief valve in compliance with ASHRAE15.
- v. Pressure Transducers and Readeout Capability
 - 1. Discharge Pressure Transducers: Permits unit to sense and display discharge pressure.
 - 2. Suction Pressure Transducers: Permits unit to sense and display suction pressure.
 - 3. High Ambient Control: Allows units to operate when the ambient temperature is above 115°F (46°C). Includes discharge pressure transducers

b. COMPRESSORS

- i. Compressors: Shall be hermetic, scroll-type, including:
 - 1. Compliant design for axial and radial sealing.
 - 2. Refrigerant flow through the compressor with 100% suction cooled motor.
 - 3. Large suction side free volume and oil sump to provide liquid handling capability.
 - 4. Compressor crankcase heaters to provide extra liquid migration protection.
 - 5. Annular discharge check valve and reverse vent assembly to provide low-pressure drop, silent shutdown and reverse rotation protection.
 - 6. Initial oil charge.
 - 7. Oil level sight glass.
 - 8. Vibration isolator mounts for compressors.
 - 9. Brazed-type connections for fully hermetic refrigerant circuits.
 - 10. Compressor Motor overloads capable of monitoring compressor motor current. Provides extra protection against compressor reverse rotation, phase-loss and phase-imbalance.

c. REFRIGERANT CIRCUIT COMPONENTS

- i. Each refrigerant circuit shall include: a discharge service ball type isolation valve, high side pressure relief, liquid line shutoff valve with charging port, low side pressure relief device, filter-drier, solenoid valve, sight glass with moisture indicator, thermostatic expansion valves, and flexible, closed-cell foam insulated suction line and suction pressure transducer.

d. HEAT EXCHANGERS

- i. Evaporator:
 - 1. Evaporator shall be brazed-plate stainless steel construction capable of refrigerant working pressure of 650 psig (3103 kPa) and liquid side pressure of 150 psig (1034 kPa) [Option for 300 psig (2068 kPa) available].
 - 2. Brazed plate heat exchangers shall be UL listed.
 - 3. Exterior surfaces shall be covered with 3/4" (19mm), flexible, closed cell insulation, thermal conductivity of 0.26k ((BTU/HR-Ft² - °F)/in.) maximum.

4. Water nozzles shall be provided with grooves for field provided ANSI/AWWA C-606 mechanical couplings.
 5. Evaporator shall include vent and drain fittings and thermostatically controlled heaters to protect to -20°F (-29°C) ambient in off-cycle.
 6. A serviceable wye-strainer and mechanical couplings shall be provided for field installation on evaporator inlet prior to startup.
- ii. Air-cooled Condenser:
1. Coils: Condenser coils shall be constructed of a single material to avoid galvanic corrosion due to dissimilar metals. Coils and headers are brazed as one piece. Integral sub cooling is included. Coils shall be designed for a design working pressure of 650 PSIG (45 bar). Condenser coil shall be washable with potable water under 100 psi (7 bar) pressure.
 2. Low Sound Fans: Shall be dynamically and statically balanced, direct drive, corrosion resistant glass fiber reinforced composite blades molded into a low noise, full-airfoil cross section, providing vertical air discharge and low sound. Each fan shall be provided in an individual compartment to prevent crossflow during fan cycling. Guards of heavy gauge, PVC (poly- vinylchloride) coated or galvanized steel shall be factory installed.
 3. Fan Motors: High efficiency, direct drive, 6 pole, 3 phase, insulation class "F" , current protected, Totally Enclosed Air-Over (TEAO) , rigid mounted, with double sealed, permanently lubricated, ball bearings.
 4. Low Sound Fans with Variable Speed Drives. All fans shall be powered by VSDs. Fans shall provide vertical air discharge from extended orifices. Fans shall be composed of corrosion resistant aluminum hub and glass-fiber-reinforced polypropylene composite blades molded into a low-noise airfoil section. Fan impeller shall be dynamically balanced for vibration-free operation. Fan guards of heavy gauge, PVC (polyvinyl chloride) coated or galvanized steel.
- e. CONTROLS
- i. General: Automatic start, stop, operating, and protection sequences across the range of scheduled conditions and transients.
 - ii. Power/Control Enclosure: Rain and dust tight NEMA 3R powder painted steel cabinet with hinged, latched, and gasket sealed door.
 - iii. Microprocessor Control Center:
 1. Automatic control of compressor start/stop, anti-coincidence and anti-recycle timers, automatic pumpdown at system shutdown, condenser fans, evaporator pump, evaporator heater, unit alarm contacts, and chiller operation from -10°F to 125°F (-23°C to 52°C) ambient. Automatic reset to normal chiller operation after power failure.
 2. Software stored in non-volatile memory, with programmed setpoints retained in lithium battery backed real-time-clock (RTC) memory for minimum 5 years.
 3. Forty character liquid crystal display, descriptions in English (or Spanish, French, Italian, or German), numeric data in English (or Metric) units. Sealed keypad with sections for Setpoints, Display/Print, Entry, Unit Options & clock, and On/Off Switch.
 4. Programmable Setpoints (within Manufacturer limits): display language; chilled liquid temperature setpoint and range, remote reset temperature range, daily schedule/holiday for start/stop, manual override for servicing, low and high ambient cutouts, low liquid temperature cutout, low suction pressure cutout, high discharge pressure cutout, anti-recycle timer (compressor start cycle time), and anti-coincident timer (delay compressor starts).
 5. Display Data: Return and leaving liquid temperatures, low leaving liquid temperature cutout setting, low ambient temperature cutout setting, outdoor air temperature, English or metric data, suction pressure cutout setting, each system suction pressure, liquid temperature reset via a 4-20milliamp or 0-10 VDC input, anti-recycle timer status for each compressor, anti-coincident system start timer condition, compressor run status, no cooling load condition, day, date and time, daily start/stop times, holiday status, automatic or manual system lead/lag control, lead system definition, compressor starts/operating hours (each), status of hot gas valves, evaporator heater and fan operation, run permissive status, number of compressors running, liquid solenoid valve status, load & unload timer status, water pump status.
 6. System Safeties: Shall cause individual compressor systems to perform auto shut down; manual reset required after the third trip in 90 minutes. System Safeties include: high discharge pressure, low suction pressure, high pressure switch, and motor protector. Compressor motor protector shall protect against damage due to high input current or thermal overload of windings.
 7. Unit Safeties: Shall be automatic reset and cause compressors to shut down if low ambient, low leaving chilled liquid temperature, under voltage, and flow switch operation.
 8. Alarm Contacts: Low ambient, low leaving chilled liquid temperature, low voltage, low battery, and (per compressor circuit): high discharge pressure, and low suction pressure.
 9. BAS Communications: YORKTalk 2, BACnet MS/TP, Modbus and N2 communication capabilities are standard.
 - iv. Manufacturer shall provide any controls not listed above, necessary for automatic chiller operation. Mechanical Contractor shall provide field control wiring necessary to interface sensors to the chiller control system.

f. POWER CONNECTION AND DISTRIBUTION

i. Power Panels:

1. NEMA 3R/12 rain/dust tight, powder painted steel cabinets with hinged, latched, and gasket sealed outer doors. Provide main power connection(s), control power connections, compressor and fan motor start contactors, current overloads, and factory wiring.
2. Power supply shall enter unit at a single location, be 3 phase of scheduled voltage, and connect to individual terminal blocks per compressor. Separate disconnecting means and/or external branch circuit protection (by Contractor) required per applicable local or national codes.

ii. Compressor, control and fan motor power wiring shall be located in an enclosed panel or routed through liquid tight conduit.

g. ACCESSORIES AND OPTIONS

i. Some accessories and options supersede standard product features. Your Johnson Controls representative will be pleased to provide assistance.

ii. Microprocessor controlled, Factory installed Across-the-Line type compressor motor starters as standard.

iii. Low Ambient Control: Permits unit operation to -10°F ambient. Standard unit controls to 30°F ambient.

1. High Ambient Control: Permits unit operation above 115°F ambient.

iv. Power Supply Connections:

1. Single Point or Multiple Point Disconnect: Single or Dual point Non-Fused Disconnect(s) and lockable external handle (in compliance with Article 440-14 of N.E.C.) can be supplied to isolate the unit power voltage for servicing. Separate external fusing must be supplied, by others, in the incoming power wiring, which must comply with the National Electric Code and/or local codes.

v. Control Power Transformer: Converts unit power voltage to 120-1-60 (500 VA capacity). Factory-mounting includes primary and secondary wiring between the transformer and the control panel.

vi. Protective Chiller Panels (Factory or Field Mounted)

1. Louvered Panels (condenser coils only): Painted steel as per remainder of unit cabinet, over external condenser coil faces.

vii. Hot Gas By-Pass: Permits continuous, stable operation at capacities below the minimum step of unloading to as low as 5% capacity (depending on both the unit & operating conditions) by introducing an artificial load on the evaporator. Hot gas by-pass is installed on only one refrigerant circuit.

viii. Low Temperature Process Glycol: Leaving chilled liquid setpoint range 10°F to 50°F (-12°C to 10°C)

ix. Vibration Isolation (Field installed):

1. 2" Deflection Restrained Spring Isolators: Level adjustable, restrained mounts in rugged welded steel housing with vertical and horizontal limit stops. Housings shall be designed to withstand a minimum 1.0g accelerated force in all directions to 2 inches (50.8 mm)

x. Hydronic Kit

1. Hydronic kit shall be factory installed within the framework of the chiller, lowering additional installation costs and decreasing floor space occupied by mechanical equipment.
2. The hydronic kit shall include features such as:
 - a. Factory-installed Y strainer with a drain port.
 - b. Factory-installed butterfly shut off valve for servicing pumps.
 - c. Factory-installed Armstrong 4392 pump with two drain ports on the lower side of the casing.
 - d. ¼" NPT fitting for field provided venting device.
 - e. ¼" NPT fitting for factory-installed thermal dispersion flow switch.
 - f. Flow Trex Combination Valve, including shut off valve, check valve and balancing capability.

3. The unit with the hydronic kit shall have single point power, reducing installation time and cost.
4. The hydronic kit shall have remote on/off control through the chiller micropanel.
5. Hydronic kit piping and components shall be heated and insulated for freeze protection.
6. Hydronic kit shall use variable speed drive (VSD), which:
 - a. Reduces commissioning time needed to balance the system.
 - b. Saves energy when used in variable primary flow arrangements.

III. EXECUTION

a. INSTALLATION

- i. General: Rig and Install in full accordance with Manufacturer' s requirements, Project drawings, and Contract documents.
- ii. Location: Locate chiller as indicated on drawings, including cleaning and service maintenance clearance per Manufacturer instructions. Adjust and level chiller on support structure.
- iii. Components: Installing Contractor shall provide and install all auxiliary devices and accessories for fully operational chiller.
- iv. Electrical: Coordinate electrical requirements and connections for all power feeds with Electrical Contractor (Division 16).
- v. Controls: Coordinate all control requirements and connections with Controls Contractor.
- vi. Finish: Installing Contractor shall paint damaged and abraded factory finish with touch-up paint matching factory finish.

CERTIFICATE OF LIMITED WARRANTY

JOHNSON CONTROLS EQUIPMENT

Contract Number:
Ship Date:

Model No.: YLAA0175HJ46XF
Start Date:

Serial Number:

POLICY STATEMENT

Johnson Controls (JCI) warrants all equipment and associated factory supplied materials or start-up services performed by Johnson Controls in connection therewith, against defects in workmanship and material. **The warranty period begins at start up, or six (6) months from the ship date, whichever occurs first.** Subject to the exclusions listed below, Johnson Controls, at its option, will repair or replace, FOB point of shipment, such products or components as it finds defective.

Except for reciprocating replacement compressors, which Johnson Controls warrants for a period of twelve (12) months from date of shipment, Johnson Controls warrants Johnson Controls reconditioned or replacement materials, or installation or start-up services performed by Johnson Controls in connection therewith, against defects in workmanship and material for a period of (90) days from date of shipment.

The above represents the minimum warranty policy Johnson Controls will extend to customers. Additional product specific coverage is provided as outlined herein or in separate related warranty policies. No warranty repairs or replacements will be made until payment for all equipment, materials, components, or services has been received by Johnson Controls.

Warranty Type	Warranty Duration	Expiration Date
Standard - Entire Unit - Parts only	1 Year	Not provided
Extended - Entire Unit - Parts only	3 Years	Not provided
Extended - Compressor - Parts only	5 Years	Not provided

EXCLUSIONS:

Unless specifically agreed to in the contract documents, or associated with additional warranty options listed above, this warranty does not include the following costs and expenses:

- I. Labor to repair, remove, or reinstall any equipment, materials or components.
- II. Special shipping, handling or transportation charges, including cranes, safety walks or other safety requirements specific to jobsites.
- III. Cost of refrigerant.
- IV. Freight damage.
- V. Field applied coatings added to any surface or heat exchanger.
- VI. Rental chillers.
- VII. Normal wear and tear or corrosion.

ALL WARRANTIES ARE VOID IF:

- A. Equipment is used with refrigerants, oil, additives, or antifreeze agents other than those authorized by supplying factory.
- B. Equipment is used with any material or any equipment such as evaporators, tubing, other low side equipment or refrigerant controls not approved by supplying factory.
- C. Equipment has been damaged by freezing because it was not properly protected during cold weather or damaged by fire or any other conditions not ordinarily encountered.
- D. Equipment is not applied, installed, operated, maintained and serviced in accordance with instructions issued by Johnson Controls.
- E. Equipment is damaged due to dirt, air, moisture, or other foreign matter entering the refrigerant system.

- F. Equipment is not properly stored, protected, or inspected by customer during the period from date of shipment to date of initial start-up.
- G. Field coating of coil has occurred.
- H. Equipment is damaged due to acts of God, abuse, including shipping damage, neglect, sabotage, or acts of terrorists.
- I. Equipment has modifications carried out that have an effect on the original design of the product without such work being authorized by the factory. Any on site design changes or unit modification/replacement shall be authorized in advance by the factory.
- J. Equipment is moved from the location where it is originally placed in service, unless performed by certified Johnson Controls employees who have followed Johnson Controls' then-current installation and operations procedures as evidenced by signed start-up documentation.

THIS WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES AND LIABILITIES, EXPRESS OR IMPLIED IN LAW OR IN FACT, INCLUDING THE WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE. THE WARRANTIES CONTAINED HEREIN SET FORTH BUYER' S SOLE AND EXCLUSIVE REMEDY IN THE EVENT OF A DEFECT IN WORKMANSHIP OR MATERIALS. IN NO EVENT SHALL JOHNSON CONTROLS' LIABILITY FOR DIRECT OR COMPENSATORY DAMAGES EXCEED THE PAYMENTS RECEIVED BY JOHNSON CONTROLS FROM BUYER FOR THE MATERIAL OR EQUIPMENT INVOLVED, NOR SHALL JOHNSON CONTROLS BE LIABLE FOR ANY SPECIAL, INCIDENTAL, OR CONSEQUENTIAL DAMAGES. THESE LIMITATIONS ON LIABILITY AND DAMAGES SHALL APPLY UNDER ALL THEORIES OF LIABILITY OR CAUSES OF ACTION, INCLUDING BUT NOT LIMITED TO, CONTRACT, WARRANTY, TORT, (INCLUDING NEGLIGENCE) OR STRICT LIABILITY. THE ABOVE LIMITATIONS SHALL INURE TO THE BENEFIT OF JOHNSON CONTROLS SUPPLIERS AND SUBCONTRACTORS.

Products furnished, but not manufactured, by Johnson Controls are not covered by this warranty. Products furnished but not manufactured by Johnson Controls may be covered by the manufacturer of such products and Buyer's sole and exclusive remedy for such products is limited to any warranty given by said manufacturer.

To qualify for warranty consideration under this Johnson Controls warranty, Buyer must immediately notify Johnson Controls at the earlier of the Buyer's discovery of the defect or the time at which the Buyer should have discovered the defect with the exercise of due diligence. Buyer must also promptly thereafter return to Johnson Controls (freight pre-paid by Buyer) all defective parts. Nothing herein is intended to provide warranty coverage to lessees or anyone other than Buyer and no third-parties are intended to be beneficiaries of this Limited Warranty.

If you are interested in adding additional coverage, contact your local JCI branch for more information about extended warranty.

The extended warranty is in accordance with BE Global Intercompany Equipment Warranty Policy 17-16.101.BEQ.

Customer Signature: _____

Johnson Controls Representative: _____

Date: _____



STANDARD LIMITED WARRANTY ENGINEERED SYSTEMS EQUIPMENT

SERVICE POLICY

Su persed es: 50.05-NM2 (812)

Form 50.05-NM2 (1212)

POLICY STATEMENT

Johnson Controls (JCI) warrants all equipment and associated factory supplied materials or start-up services performed by Johnson Controls in connection therewith, against defects in workmanship and material for a period of eighteen (18) months from date of shipment, or twelve (12) months from date of start up, whichever occurs first. Subject to the exclusions listed below, Johnson Controls, at its option, will repair or replace, FOB point of shipment, such products or components as it finds defective.

Except for reciprocating replacement compressors, which Johnson Controls warrants for a period of twelve (12) months from date of shipment, Johnson Controls warrants Johnson Controls reconditioned or replacement materials, or installation or start-up services performed by Johnson Controls in connection therewith, against defects in workmanship and material for a period of (90) days from date of shipment.

The above represents the minimum warranty policy Johnson Controls will extend to customers. Additional product specific coverage is provided as outlined in related warranty policies. No warranty repairs or replacements will be made until payment for all equipment, materials, or components has been received by Johnson Controls.

EXCLUSIONS:

Unless specifically agreed to in the contract documents, this warranty does not include the following costs and expenses:

1. Labor to remove or reinstall any equipment, materials or components.
2. Shipping, handling or transportation charges, including cranes, safety walks or other safety requirements specific to jobsites.
3. Cost of refrigerant.
4. Freight damage.
5. Field applied coatings added to any surface or heat exchanger
6. Rental Chillers.

ALL WARRANTIES ARE VOID IF:

1. Equipment is used with refrigerants, oil, additives, or antifreeze agents other than those authorized by supplying factory.
2. Equipment is used with any material or any equipment such as evaporators, tubing, other low side equipment or refrigerant controls not approved by supplying factory
3. Equipment has been damaged by freezing because it was not properly protected during cold weather or damaged by fire or any other conditions not ordinarily encountered.
4. Equipment is not installed, operated, maintained and serviced in accordance with instructions issued by Johnson Controls.
5. Equipment is damaged due to dirt, air, moisture, or other foreign matter entering the refrigerant system.
6. Equipment is not properly stored, protected, or inspected by the customer during the period from date of shipment to date of initial start-up.
7. Field coating of coil has occurred.
8. Equipment is damaged due to acts of god, abuse, including shipping damage, neglect, sabotage, or acts of terrorists.
9. Equipment has modifications carried out that have an effect on the original design of the product without such work being authorized by the factory. Any on site design changes or unit modification/replacement shall be authorized in advance by the factory.

THIS WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES AND LIABILITIES, EXPRESS OR IMPLIED IN LAW OR IN FACT, INCLUDING THE WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE. THE WARRANTIES CONTAINED HEREIN SET FORTH BUYER'S SOLE AND EXCLUSIVE REMEDY IN THE EVENT OF A DEFECT IN WORKMANSHIP OR MATERIALS. IN NO EVENT SHALL JOHNSON CONTROLS' LIABILITY FOR DIRECT OR COMPENSATORY DAMAGES EXCEED THE PAYMENTS RECEIVED BY JOHNSON CONTROLS FROM BUYER FOR THE MATERIAL OR EQUIPMENT INVOLVED, NOR SHALL JOHNSON CONTROLS BE LIABLE FOR ANY SPECIAL, INCIDENTAL, OR CONSEQUENTIAL DAMAGES. THESE LIMITATIONS ON LIABILITY AND DAMAGES SHALL APPLY UNDER ALL THEORIES OF LIABILITY OR CAUSES OF ACTION, INCLUDING BUT NOT LIMITED TO, CONTRACT, WARRANTY, TORT, (INCLUDING NEGLIGENCE) OR STRICT LIABILITY. THE ABOVE LIMITATIONS SHALL INURE TO THE BENEFIT OF JOHNSON CONTROLS SUPPLIERS AND SUBCONTRACTORS.





Equipment Release Approval Form

SUBMITTAL NOTES

Product Type:YLAA - Air-Cooled Chiller

Unit Tags:CH-1, CH-2

The following table must be completed prior to releasing the equipment for fabrication. Please initial the column indicating the information contained in this submittal has been verified, or indicate to refer to a marked-up page.

SUBMITTAL VERIFICATION	
	Purchaser Initials
Electrical voltage and electrical connections are compatible with jobsite requirements.	
Piping / Ductwork connections shown in this submittal are correct .	
Unit tag designations are correct.	
Equipment dimensions (length, width, and height) and weights have been verified to comply with jobsite conditions and rigging requirements. Please indicate approval by your initials on all included drawings.	
Verify "Unit Hand" of any Air Handling Equipment per the definition provided on the " Equipment Release / Configuration Process " form.	



SUBMITTAL VERIFICATION	
	Purchaser Initials
Indicate equipment configuration choices on the Equipment Release /Configuration Process form (if included on this Submittal package), and sign the form.	

Important Notes:

- 1) Actual fabrication release cannot commence until this form is signed by the customer and returned to JCI along with a release notification want date and ship to address.
- 2) Equipment "lead-time" does not start until confirmed release documentation is received, and the order is actually released to the factory.
- 3) Modifications to equipment configurations after fabrication release may impact cost and lead-time
- 4) Attached configurations are as shown in the approved equipment submittals or as defined in superseding customer correspondence.
- 5) AHU "Side" / "Hand" orientation is relative to a person standing inside an AHU with air hitting the back of the head.
- 6) Note that once this document is confirmed, the equipment configurations defined by this document take precedence over all other documents.
- 7) "Want date" and/or "ship to address" changes made after this document is confirmed may impact cost and lead-time.
- 8) Air handler drawings also include shipping split explosions with corresponding weights and dimensions. If additional splits are required, there will be additional costs and the unit length will increase.



Please fill out the following table and refer to the receiving/rigging instructions in this submittal to help ensure a smooth delivery and installation of the equipment.

DELIVERY INFORMATION	
	Please fill out information below
Contact name for coordinating delivery of equipment with transportation company	
Contact phone number	
Advance notice required from transportation company prior to delivering equipment (typically 48 hours)	
Ship to address:	
Other special shipping instructions or requirements	



CUSTOMER APPROVAL:

Customer
Name: _____

Signature (*) _____

Date: _____