

## CheckList List

- WALGREENS SURVEY - RTU # 4



**Comment:**




**Right side of cabinet.**

**Comment:**



**Front side of cabinet.**

**Comment:**

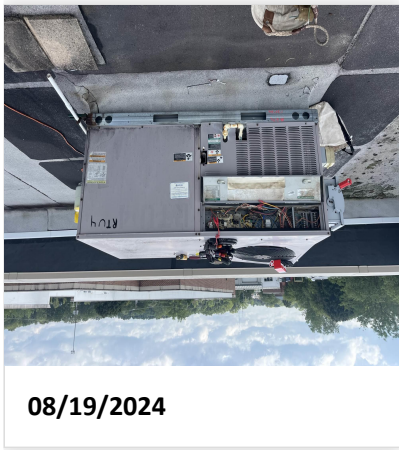

**Back side of cabinet.**

**Comment:**



**Inside of electrical cabinet.**

**Comment:**



---

**Electrical schematic.**


**Comment:**



---

**Close up picture of condensing coil.**

**Comment:**

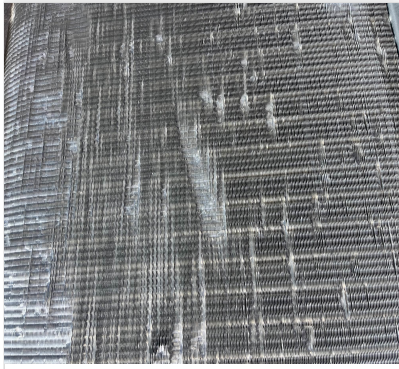

08/19/2024

---

**Blower compartment.**

**Comment:**



08/19/2024

---

**Mixed air compartment.**


**Comment:**



08/19/2024

Close up of evaporative coil.

Comment:

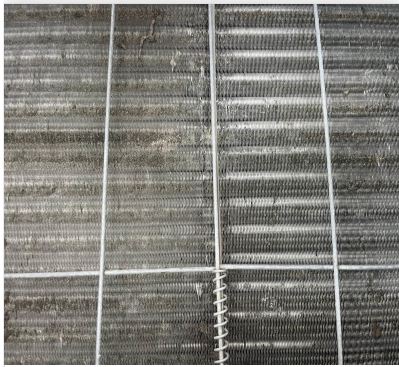

08/19/2024

Return drop looking down from unit if possible.

Comment:




08/19/2024

---

Supply drop looking down from unit if possible.

Comment:

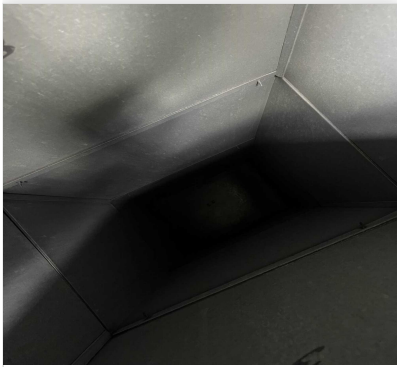

08/19/2024

---

List any visual damage and take additional pictures if needed.

Comment: