

MOUNT AC#1 MAIN TRUNK LINE AS TIGHT TO STRUCTURE AS POSSIBLE. MEAL DELIVERY CANOPY. SEE ARCHITECTURAL.

FROM OUTSIDE FACE OF EXTERIOR WALL FRAMING


ELECTRIC HEATER, MC TO MOUNT ON WALL PER MANUFACTURERS RECOMMENDATIONS.

MOUNT AIR DOOR IN CEILING, CENTERED ON DRIVE THRU DOOR OPENING AND 4" OFF THE WALL FOR INSTALLATION AND MAINTENANCE ACCESS.

REFER TO WIRING DIAGRAM ON SHEET M-901 FOR MORE INFORMATION.

DOWN WITH DAMPER, TYP.

COORD. EXACT LOCATION OF SENSORS WITH SIGNAGE.

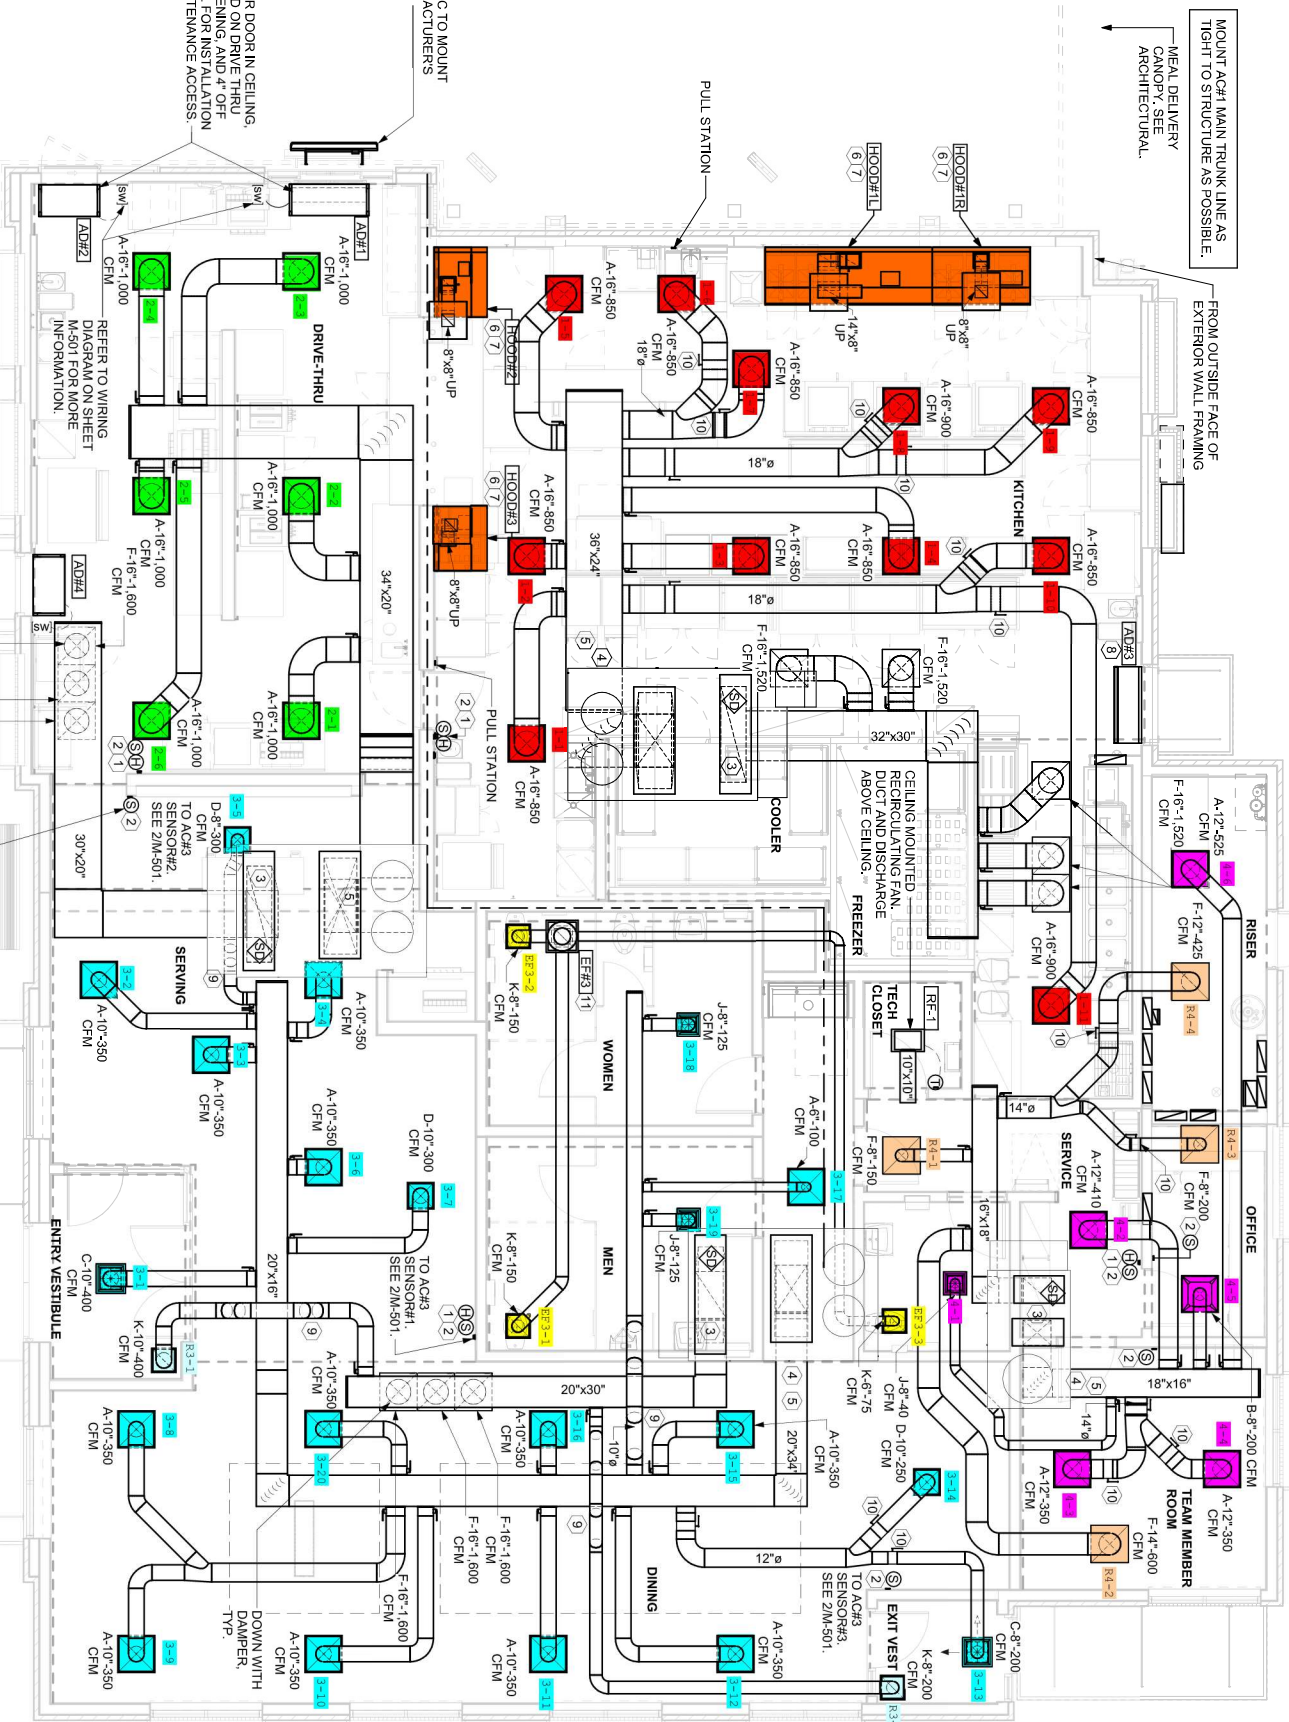

1 MECHANICAL FLOOR PLAN

1/4" = 1'-0"