

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR THE PROJECT AND SITE SPECIFIC TO THE PROJECT. IT IS NOT TO BE REUSED FOR ANY OTHER PROJECT WITHOUT THE WRITTEN CONSENT OF HFA. ANY REUSE OF THIS DRAWING FOR ANY OTHER PROJECT WITHOUT THE WRITTEN CONSENT OF HFA SHALL BE AT THE USER'S SOLE RISK. HFA ASSUMES NO LIABILITY FOR ANY DAMAGE, LOSS, OR INJURY, INCLUDING REASONABLE ATTORNEY'S FEES AND COSTS, ARISING FROM ANY REUSE OF THIS DRAWING FOR ANY OTHER PROJECT WITHOUT THE WRITTEN CONSENT OF HFA.

WAWA
STORE NUMBER: 7222
10000 W. STATE ROAD
SILVERTON, OH 45238
JOB NUMBER: 42-24-30089

ISSUE BLOCK

3	REV 3	04/29/25
5	REV 5	10/07/25

CHECKED BY: MJS
DRAWN BY: SGB
DOCUMENT DATE: 04/29/25
PROTO: U63FB-R FLY THRU
CYCLE: 2024.04.G5
PLAN ISSUE: CNST SET

STATE OF OHIO
JOHN KENNETH RALEY
E-91204
Professional Engineer
2025.10.07 08:37:45-0500'

HVAC FLOOR PLAN



SHEET: M1.0

KEYNOTES

- # NOTE
- 23.01 SUPPLY AND RETURN DUCT UP TO RTU ON ROOF, TRANSITION AS REQUIRED. FIELD VERIFY DUCT ROUTING PRIOR TO FABRICATION. PROVIDE FLEX CONNECTION FOR VIBRATION ISOLATION.
- 23.02 MOUNT REMOTE TEMPERATURE/HUMIDITY SENSOR IN AREA SHOWN AT 54" AFF. COORDINATE EXACT LOCATION WITH TENANT CONSTRUCTION MANAGER. THE ENTIRE CONTROL SYSTEM SHALL BE PROVIDED COMPLETE IN EVERY RESPECT BY THE MECHANICAL CONTRACTOR.
- 23.03 WALL MOUNTED CO2 SENSOR TO RTU-2. SENSOR TO MONITOR CO2 LEVELS THROUGH REMOTE BAS. SENSOR BY WAWA BAS VENDOR.
- 23.04 UNDERCUT DOOR 1" FOR AIR PASSAGE.
- 23.05 EXHAUST DUCT ROUTED TO FAN ON ROOF. COORDINATE ROUTING OF DUCT WITH ALL DISCIPLINES. PROVIDE TRANSITIONS AND FITTINGS AS REQUIRED.
- 23.07 EXHAUST DUCT SHALL BE GALVANIZED STEEL. PROVIDE SIDEWALL VENT WITH SCREEN AND FLAPPER DAMPER. CROWN MODEL 349 OR EQUAL. EXHAUST FAN SHALL MAINTAIN 10" CLEARANCE FOR ANY OUTSIDE AIR INTAKE. MUST MEET LOCAL CODE REQUIREMENTS. FIELD VERIFY ALL ROUTING AND REQUIREMENTS PRIOR TO BID. SEAL ALL PENETRATION WEATHER TIGHT. PRE-PAINT VENT COVER TO MATCH SIDING.
- 23.08 HVAC UNIT MANUFACTURER TO PROVIDE 120V SMOKE DETECTORS FOR SUPPLY AND RETURN WITH AUXILIARY CONTACTS AS SHOWN. UPON ACTIVATION, THE SMOKE DETECTORS SHALL SHUT DOWN THE AIR DISTRIBUTION SYSTEM TO WHICH IT IS CONNECTED AND ACTIVATE A VISIBLE AND AUDIBLE SUPERVISORY SIGNAL AT A CONSTANTLY ATTENDED LOCATION VIA THE SPRINKLER/FIRE ALARM PANEL. SMOKE DETECTORS SHALL ALSO BE FURNISHED WITH WALL MOUNTED REMOTE TEST STATION WITH KEYS RESET. REMOTE SD TEST SUPERVISORY SIGNAL SHALL BE LED TYPE WITH AUDIBLE BEEPING ALERT.
- 23.09 PROVIDE MCCOILL AIRFLOW'S DOUBLE-WALL INSULATED SPIRAL DUCT OR EQUAL (MCCOILL 614/259/1200). REFERENCE DRAWINGS FOR MOUNTING HEIGHT. PROVIDE DUCT AND FITTINGS WITH SLIP JOINT CONNECTION TYPE. FLANGE-TO-FLANGE CONNECTION TYPES ARE NOT ALLOWED.
- 23.11 PROVIDE REMOTE TEST STATION FOR SMOKE DETECTORS WITH AUDIBLE AND VISUAL ALARM WITH KEYS RESET. MOUNT TEST STATION 48 INCHES AFF. MOUNT AUDIBLE AND VISUAL ALARM IN CONSTANTLY ATTENDED LOCATION. CONSTANTLY ATTENDED LOCATION IS NOT REQUIRED WHERE DUCT SMOKE DETECTOR ACTIVATES THE BUILDING'S ALARM SYSTEM.
- 23.28 ROUTE DUCTWORK AS HIGH AS POSSIBLE PARALLEL TO STRUCTURE. REF 2-M1.0 TYP.
- 23.29 ROUTE DUCTWORK WITHIN THE JOIST SPACE. COORDINATE THRU WEBBING. REF 3-M1.0 TYP.
- 23.40 PAINT RETURN GRILLE TO MATCH FINISH OF WALL.
- 23.41 FAN CONTROLLER WIRED TO SWITCH IN OFFICE. REF ELECTRICAL PLANS.


HVAC LEGEND

SYMBOL	DESCRIPTION
	NEW RECTANGULAR OR ROUND DUCT
	FLEXIBLE DUCT
	SUPPLY AIR DUCTWORK UP THROUGH PLAN
	RETURN AIR DUCTWORK UP THROUGH PLAN
	EXHAUST AIR DUCTWORK UP THROUGH PLAN
	90° ELBOW WITH TURNING VANES
	MANUAL AIR VOLUME CONTROL DAMPER
	4 WAY SUPPLY DIFFUSER
	3 WAY SUPPLY DIFFUSER
	2 WAY OPPOSED SUPPLY DIFFUSER
	2 WAY CORNER SUPPLY DIFFUSER
	RETURN AIR DEVICE
	EXHAUST AIR DEVICE
	AIR CURTAIN
	LINEAR SLOT DIFFUSER WITH PLENUM
	COMBINATION TEMPERATURE/HUMIDITY SENSOR
	TEMPERATURE SENSOR
	CO2 SENSOR
	TYPE MARK XXX CFM
	MECHANICAL EQUIPMENT TAG
	CONDENSATE PIPING
	ROOF MOUNTED EXHAUST FAN
	INLINE EXHAUST FAN
	PACKAGED ROOFTOP AIR CONDITIONER

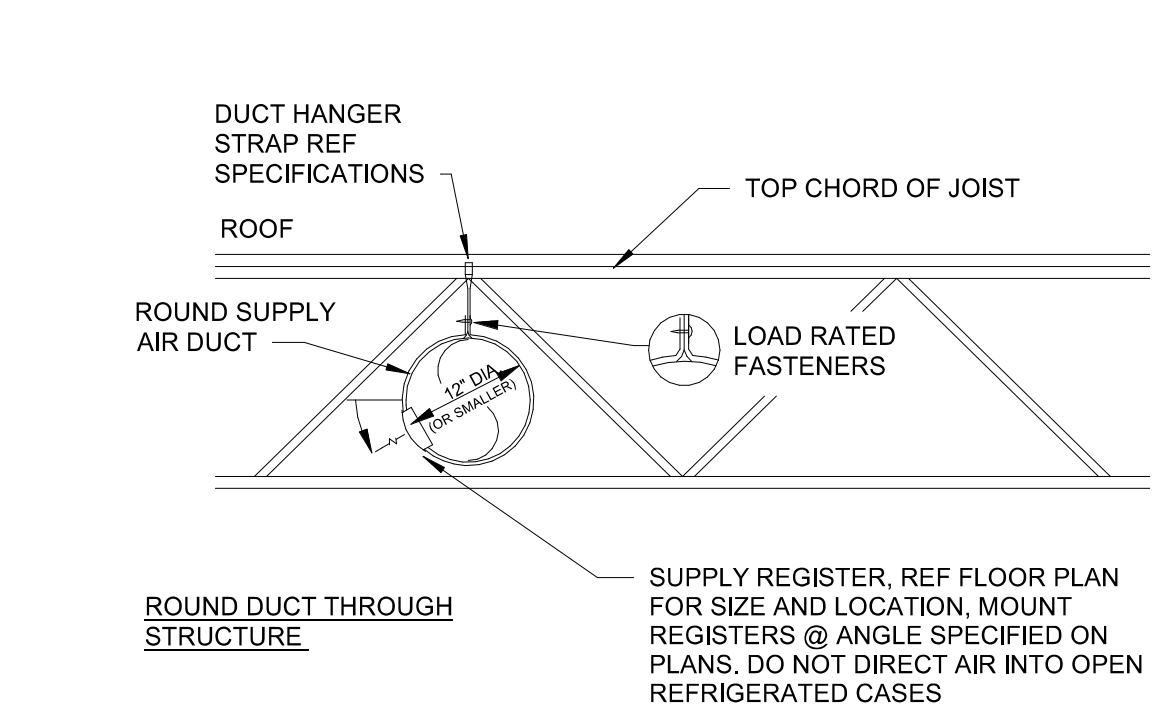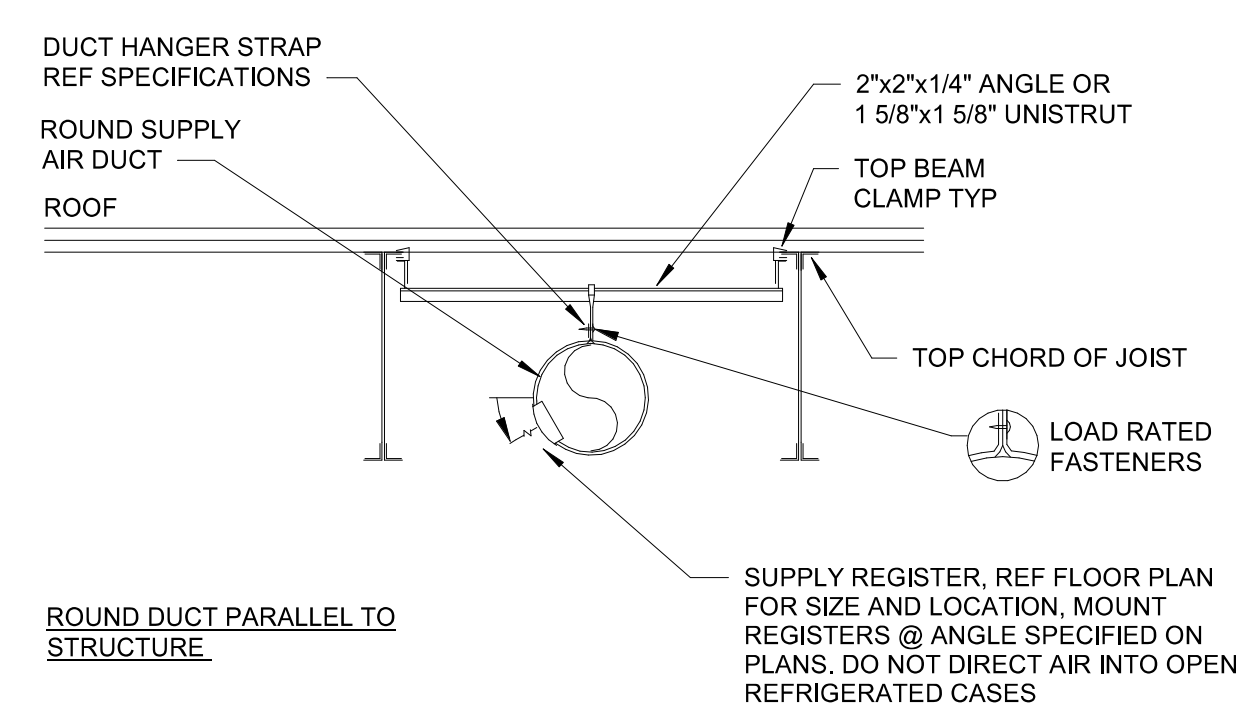


2 EXPOSED DUCT SUPPORT AND GRILLE
M1.0 NTS

3 EXPOSED DUCT SUPPORT AND GRILLE
M1.0 NTS

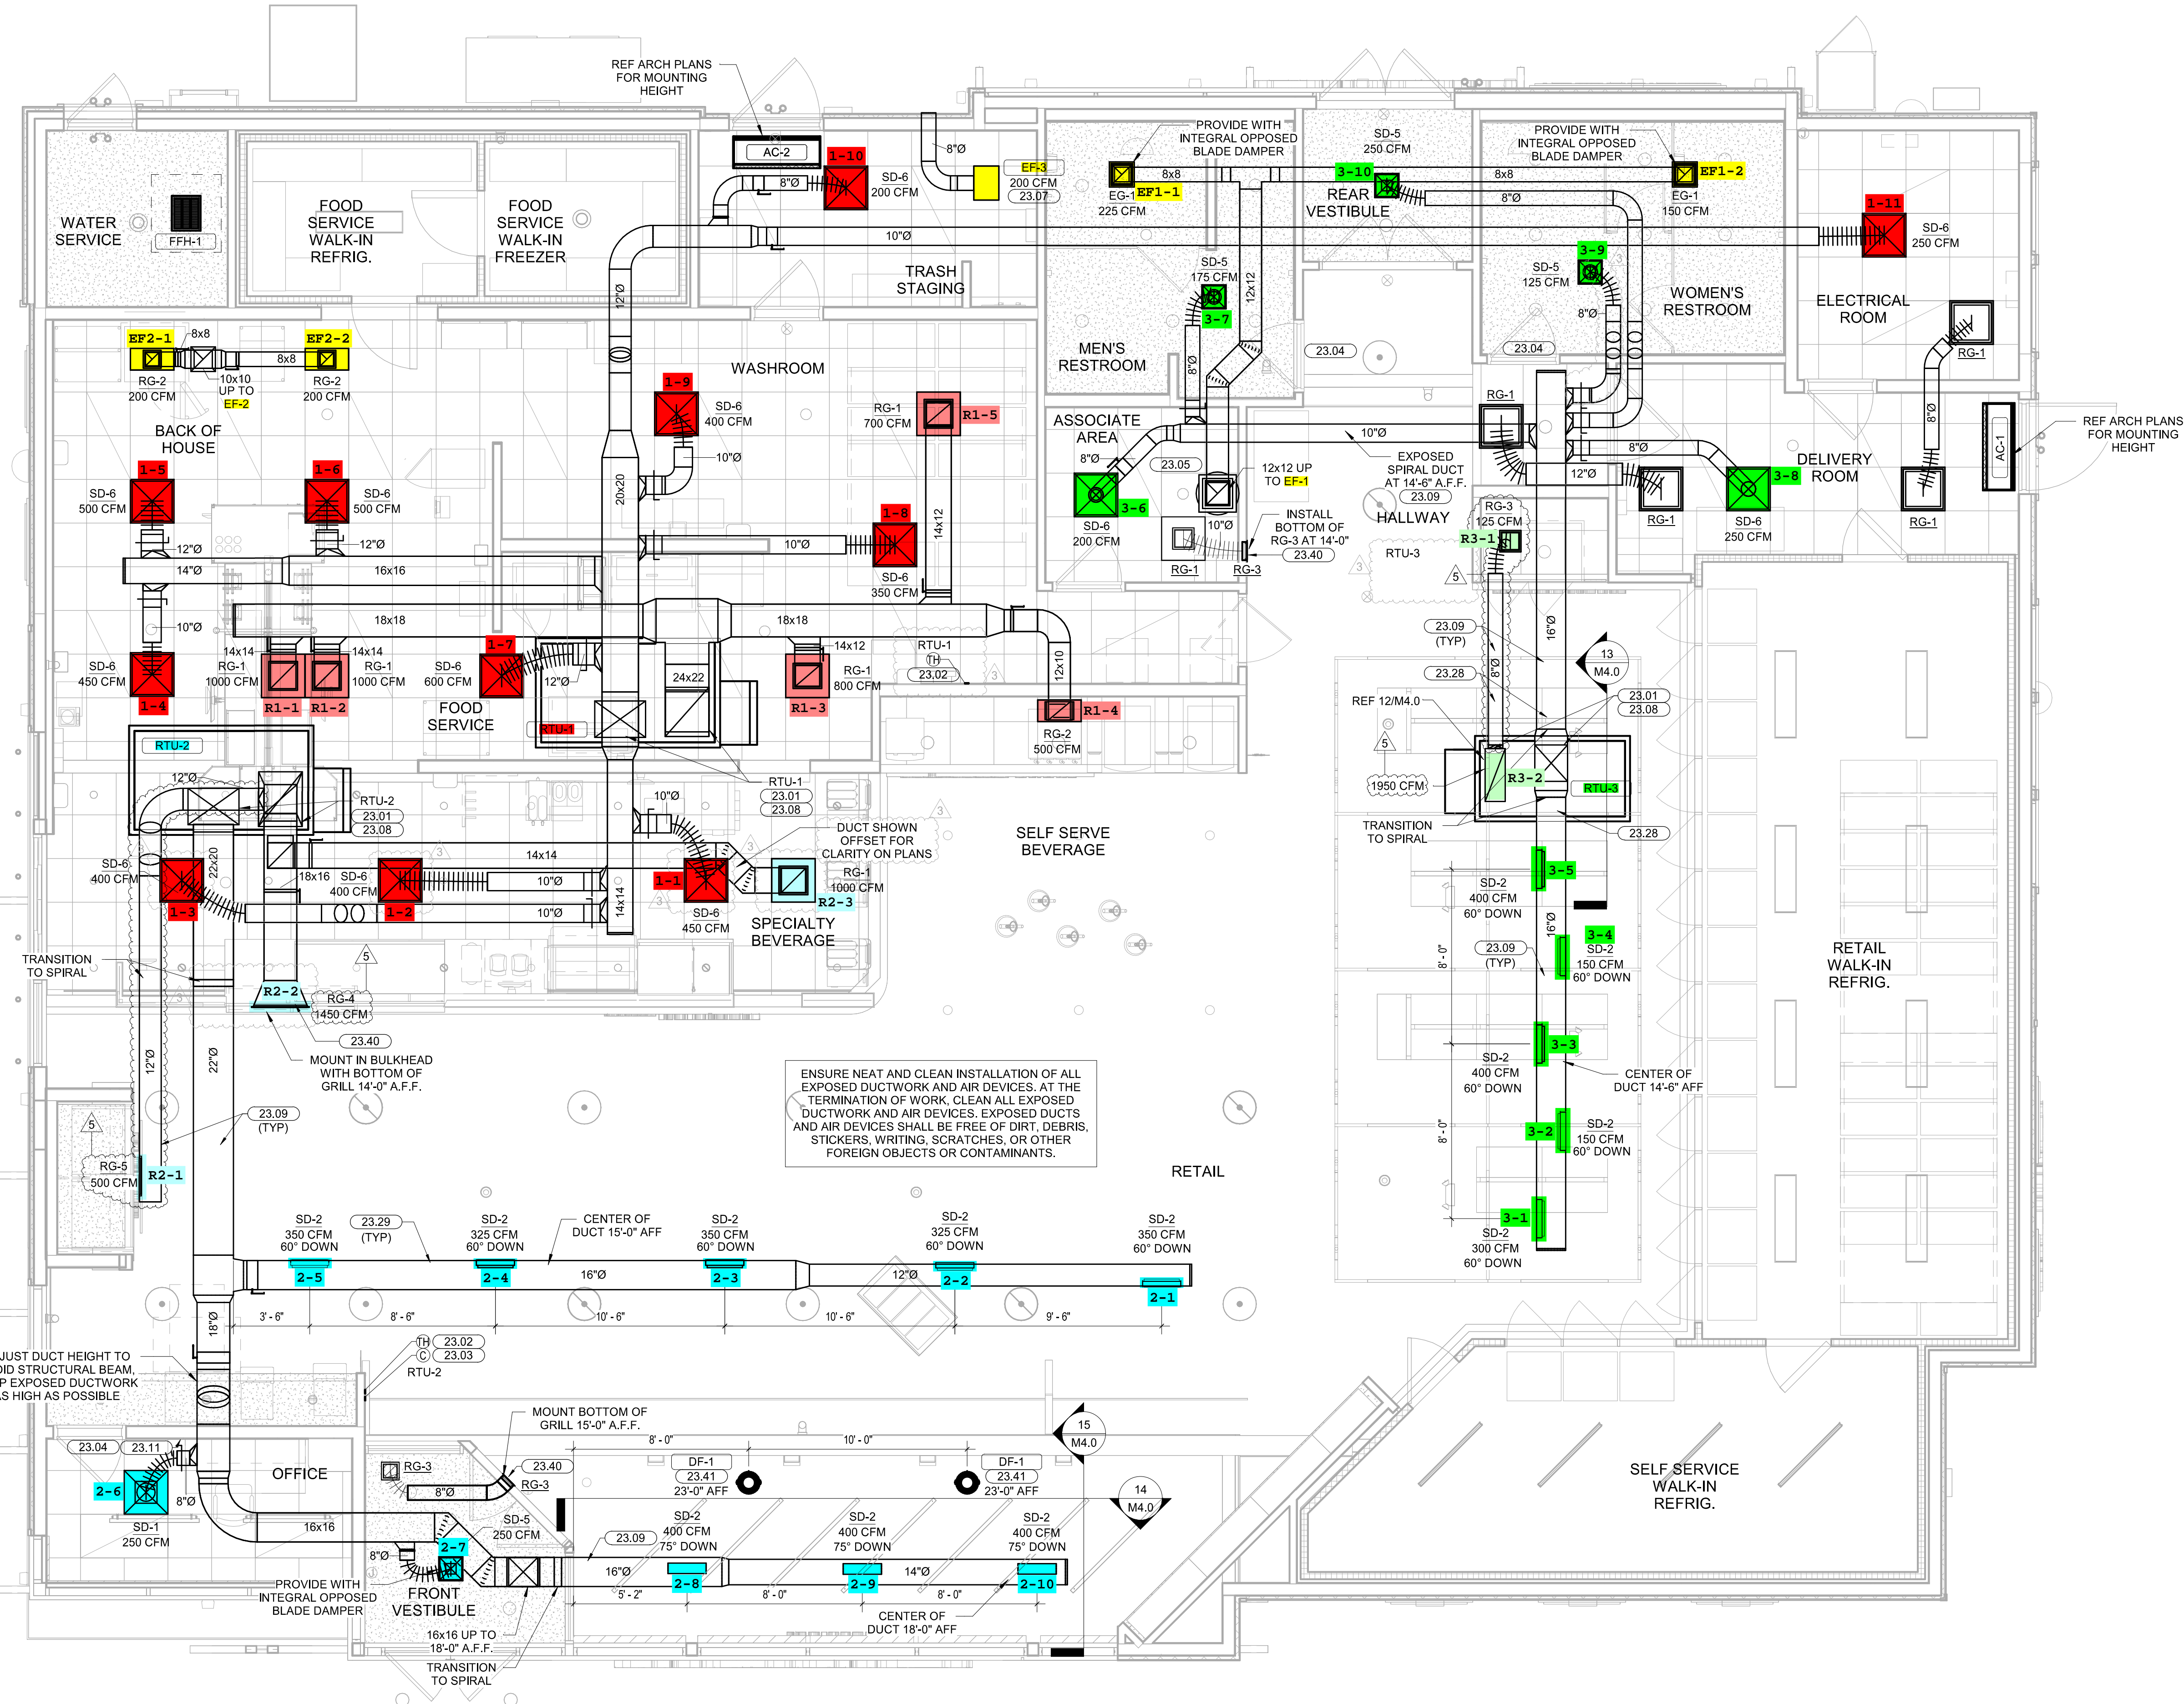


1 HVAC FLOOR PLAN
1/4" = 1'-0"


04/29/25 10:21:24 AM
C:\Users\mjs\OneDrive\Documents\2025 Rev 5\Wawa\7222\Wawa\HVAC\250424\Wawa_HVAC_FLOOR_PLAN.MXD
M1.0-HVAC_FLOOR_PLAN.MXD

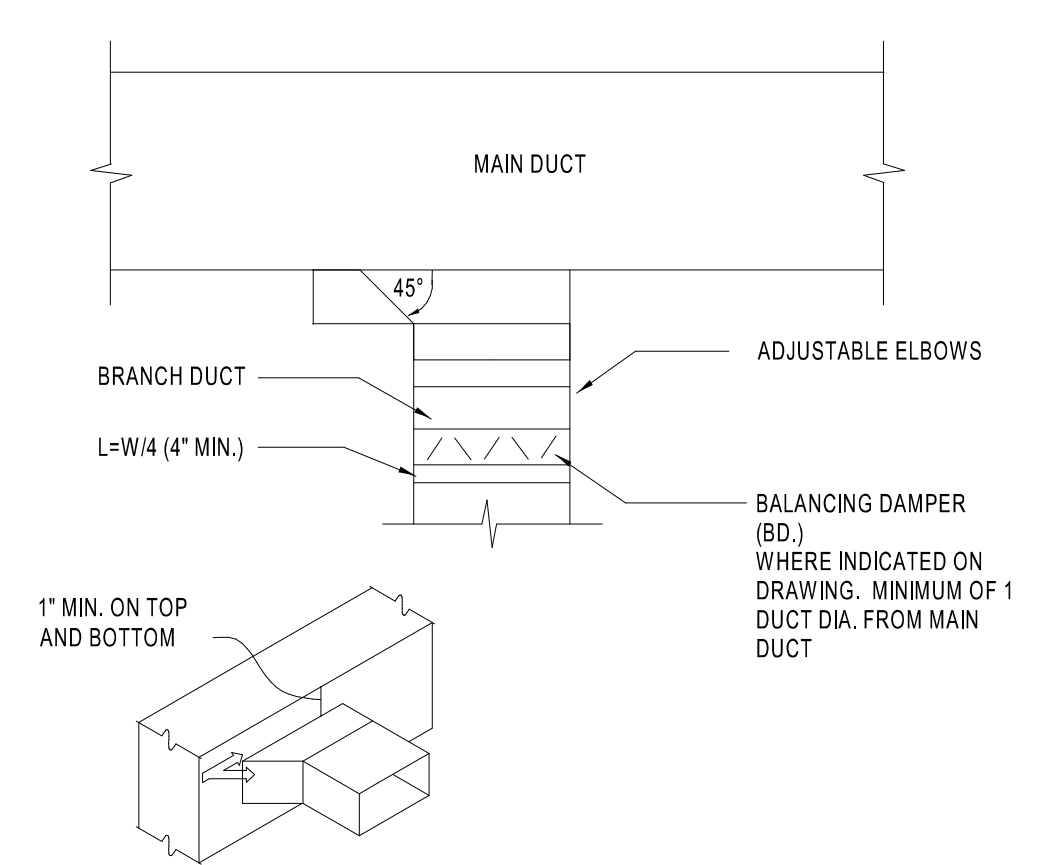

1 RECTANGULAR BRANCH CONNECTION
M4.0 NTS

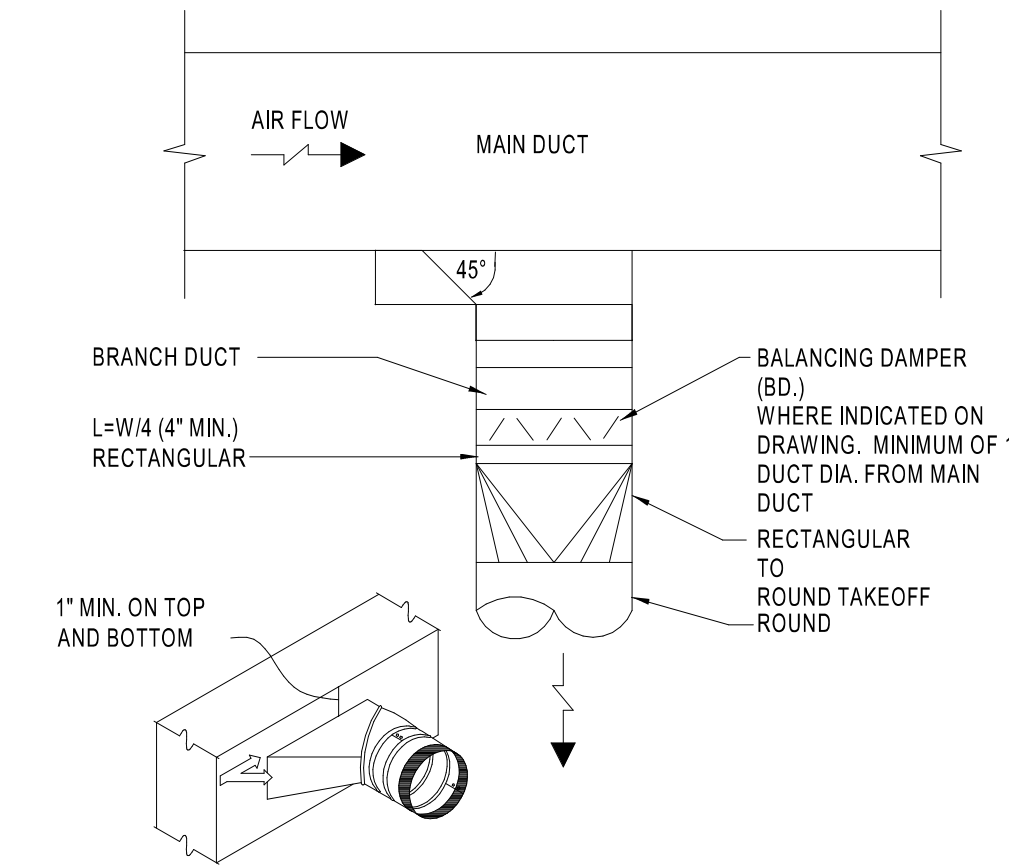

2 ROUND BRANCH CONNECTION
M4.0 NTS

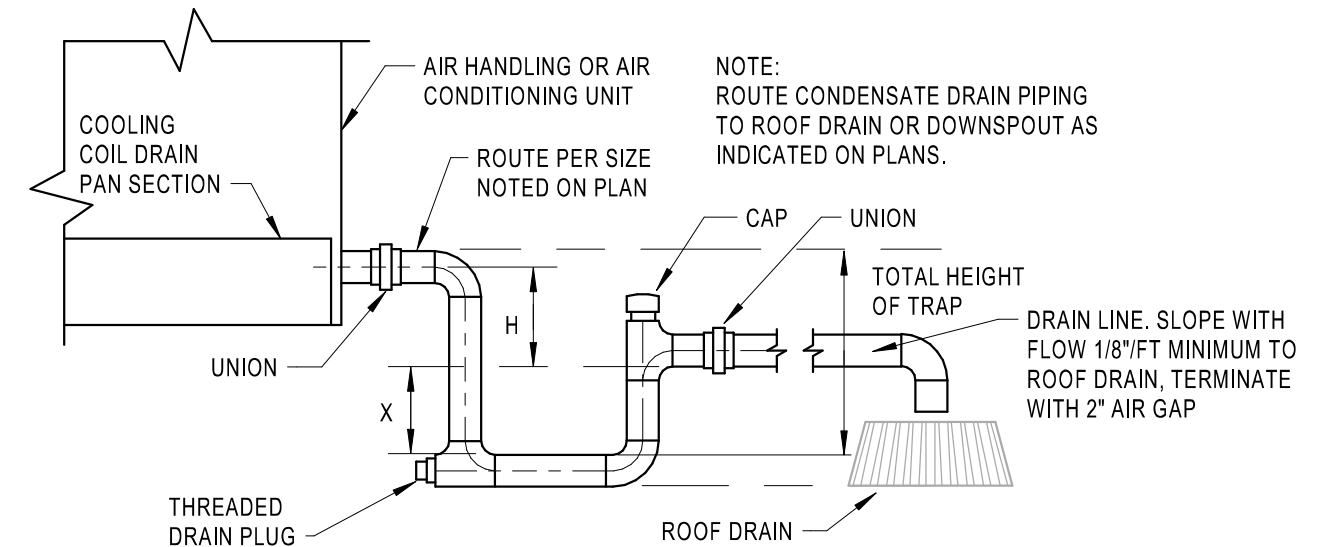


DRAIN TRAPPING HEIGHT		
FAN ARRANGEMENT	H	X
BLOW-THRU (POSITIVE STATIC PRESSURE)	A	B
DRAW-THRU (NEGATIVE STATIC PRESSURE)	D	C

A = MINIMUM 1"
 B = AT LEAST 1" PLUS CASING STATIC PRESSURE
 C = 1/2"D
 D = AT LEAST 1" PLUS CASING STATIC PRESSURE

TOTAL HEIGHT OF TRAP = X + H + (1.5 x PIPE DIAMETER) (WITHOUT INSULATION)

3 HVAC CONDENSATE DRAIN DETAIL
M4.0 NOT TO SCALE

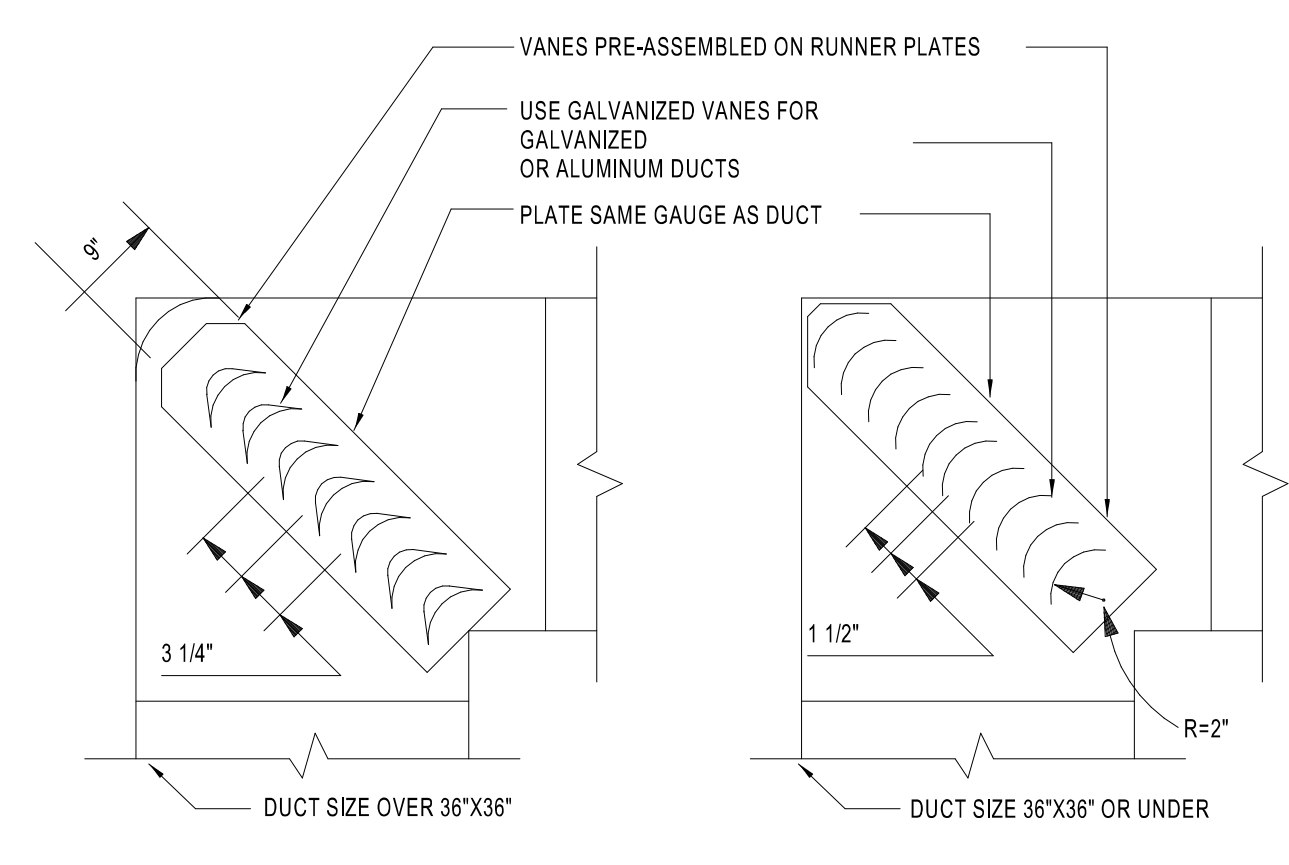

DUCT SHALL BE SECURELY FASTENED TO RUNNERS.

ALL VANES SHALL BE SECURE AND STABLE IN INSTALLED OPERATION POSITION. IF NECESSARY AT CERTAIN VELOCITIES OR PRESSURES WELD VANES TO RUNNERS ON APPROPRIATE INTERVALS ALONG RUNNERS.

TO PREVENT LINER DAMAGE CARE MUST BE EXERCISED WHEN INSTALLING VANES IN LINED OR FIBROUS GLASS DUCT.


SINGLE VANE SCHEDULE			
	R	SP	GA
SMALL	2"	1 1/2"	24
LARGE	4 1/2"	3 1/4"	22

* MAXIMUM UNSUPPORTED VANE LENGTH


SMALL SINGLE VANE 36"
 LARGE SINGLE VANE 38"
 SMALL DOUBLE VANE 60"
 LARGE DOUBLE VANE 72"

NOTE: FOLLOW PER SMACNA STANDARDS.


4 TURNING VANE DETAIL
M4.0 NTS

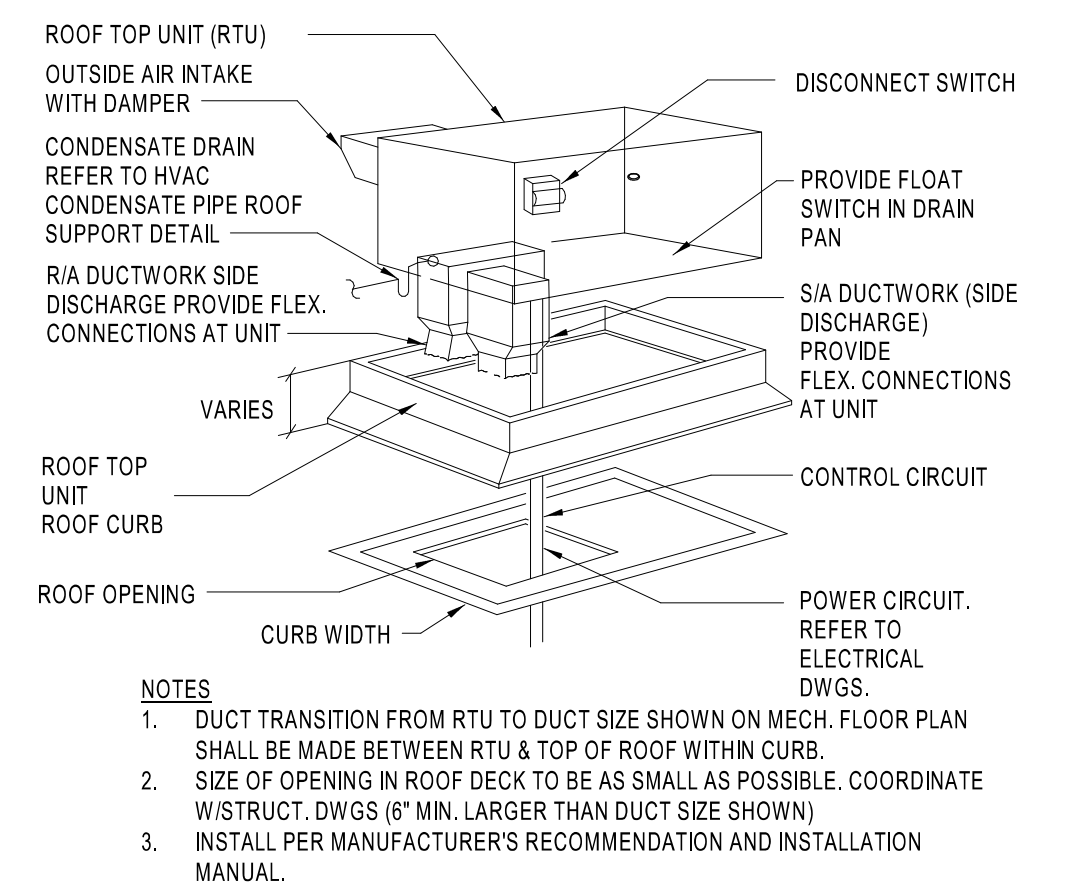


5 ROOF TOP UNIT MOUNTING DETAIL
M4.0 NTS

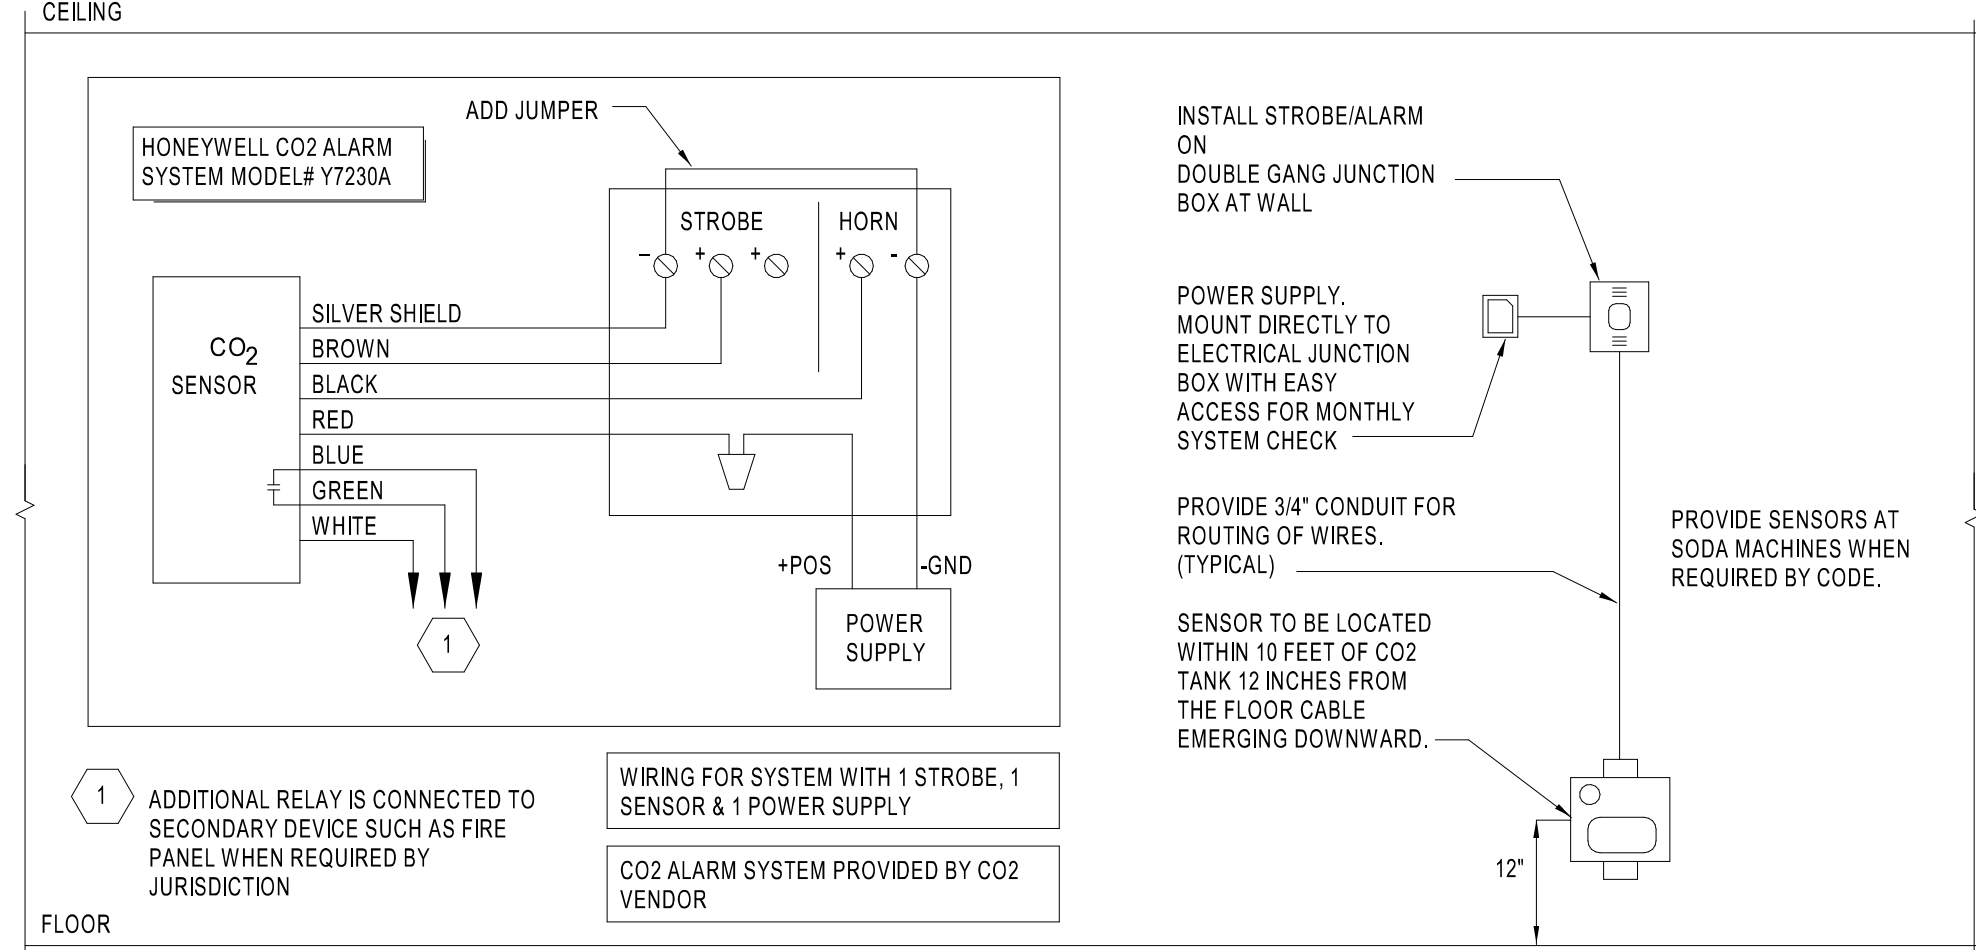

6 CO2 ALARM SYSTEM DETAIL
M4.0 NTS

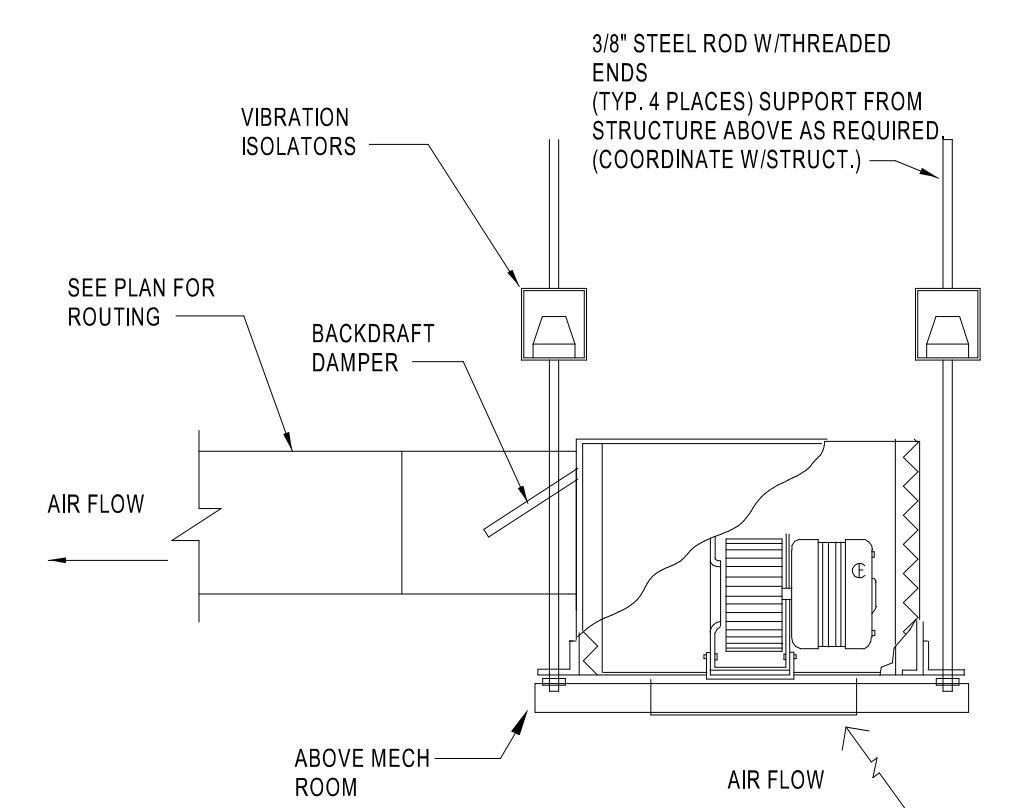

7 CEILING EXHAUST FAN DETAIL
M4.0 NTS

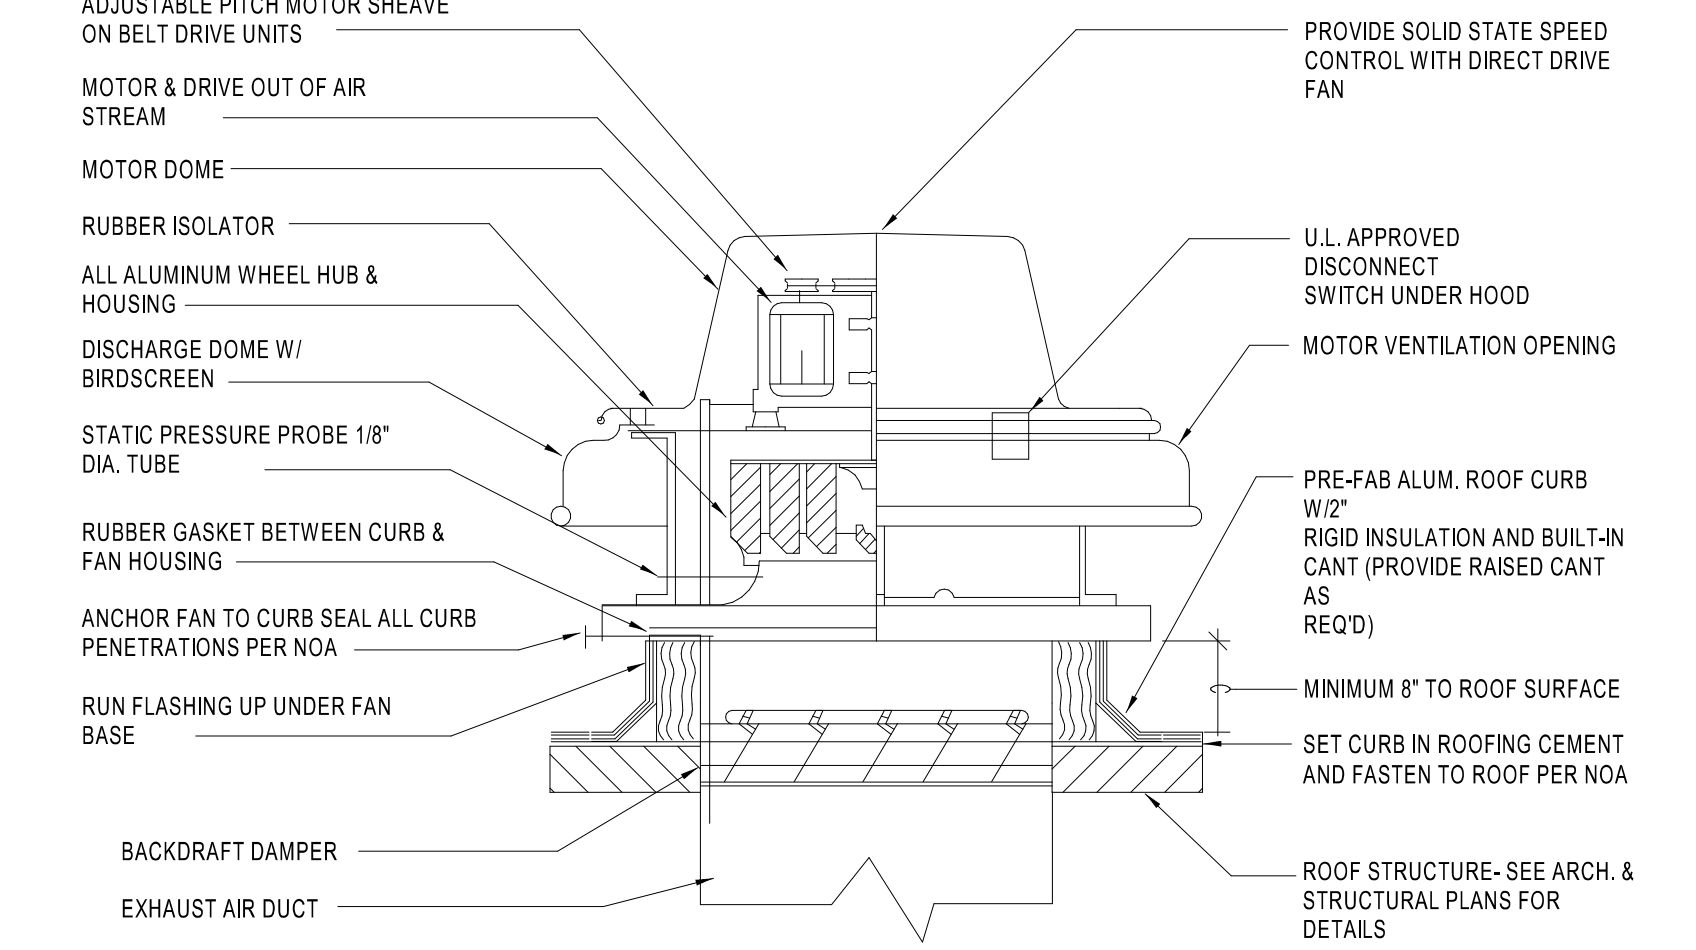


8 TYPICAL EXHAUST FAN DETAIL
M4.0 NTS

PIPE SIZE	STEEL PIPE HANGER SPACING	COPPER PIPE HANGER SPACING
1/2"	6'	6'
3/4"	6'	6'
1"	6'	8'
1-1/4"	6'	10'
1-1/2"	6'	10'
2"	10'	10'
2-1/2"	10'	10'
3"	10'	10'
4"	10'	10'


NOTES:

- COORDINATE EXACT HANGING REQUIREMENTS WITH TRUSS MANUFACTURER.
- INSTALL HANGER INSIDE INSULATION OR OTHERWISE PENETRATE VAPOR BARRIER. DO NOT HANG ONE PIPE FROM ANOTHER EXCEPT IN CHASES. SLOPE ALL WATER PIPING SLIGHTLY TOWARD DRAINABLE LOCATIONS. HANGER SPACING FOR PIPE SIZES AS INDICATED IN TABLE AND IN ACCORDANCE WITH AHJ REQUIREMENTS.
- LOCATE HANGERS WITHIN 1'-0" OF ALL VALVES, FITTINGS, AND EQUIPMENT CONNECTIONS. ANCHOR WATER PIPE AGAINST SWAYING DUE TO CHANGES IN WATER VELOCITY. CHAINS AND PERFORATED STRAP IRON AND STEEL ARE NOT ACCEPTABLE. DO NOT SUSPEND PIPE FROM JOIST BRACING MEMBERS.
- PROVIDE SEISMIC BRACING IF AS REQUIRED BY LOCAL AUTHORITIES.
- REFER TO LOCAL CODES AND SPECIFICATIONS FOR FURTHER INFORMATION.
- LOCATE HANGERS WITHIN 3 INCHES OF JOIST PANEL POINTS U.N.O.
- INDIVIDUAL PIPES 3 INCH AND SMALLER NOT REQUIRED TO BE WITHIN 3 INCHES OF PANEL POINT.
- FOR PIPE RUNNING PARALLEL TO JOISTS, ATTACH TRAPEZOID BEAM CLAMPS TO JOISTS ON EACH SIDE OF PIPE TYP.
- TRAPEZOID HANGERS AND ALL THREAD RODS ARE SIZED TO CARRY (MAX) 6 - 3 INCH DIAMETER COPPER PIPES FULL OF WATER (37.62 LBS/FT) OR EQUIVALENT. IF LOAD EXCEEDS MAXIMUM, CONTACT THE EOR FOR PROPER SIZING.


9 PIPE HANGER FOR JOIST DETAIL
M4.0 NTS

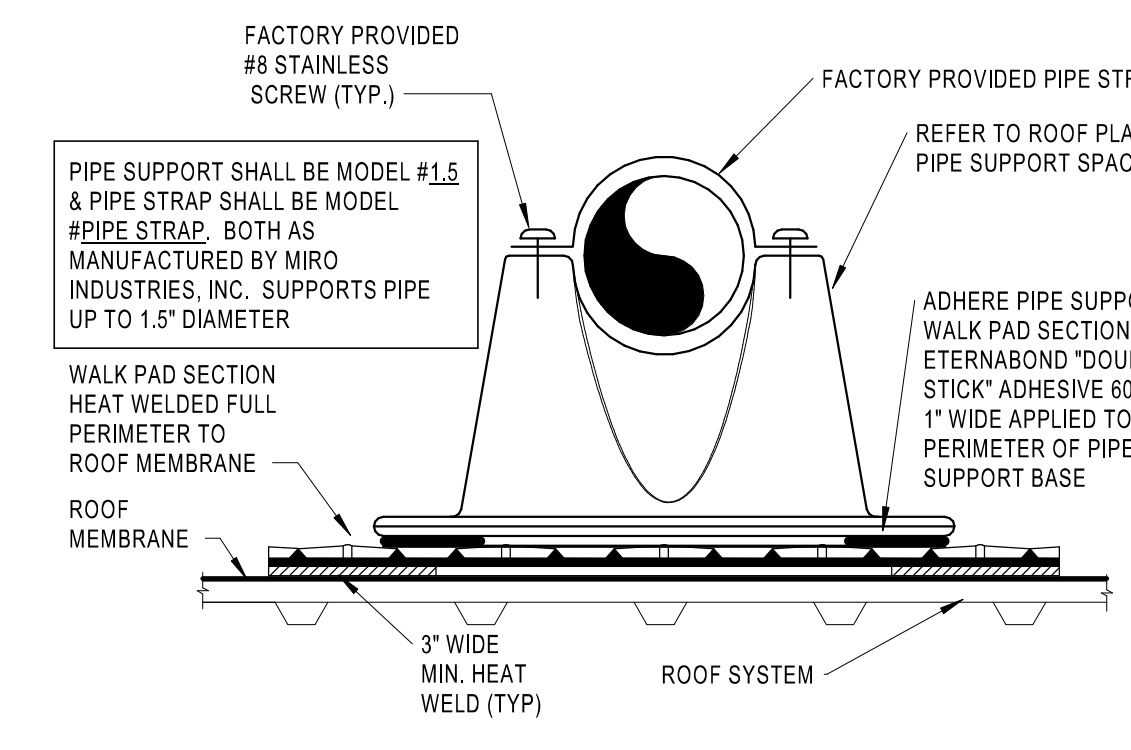


10 HVAC CONDENSATE PIPE ROOF SUPPORT DETAIL
M4.0 NTS

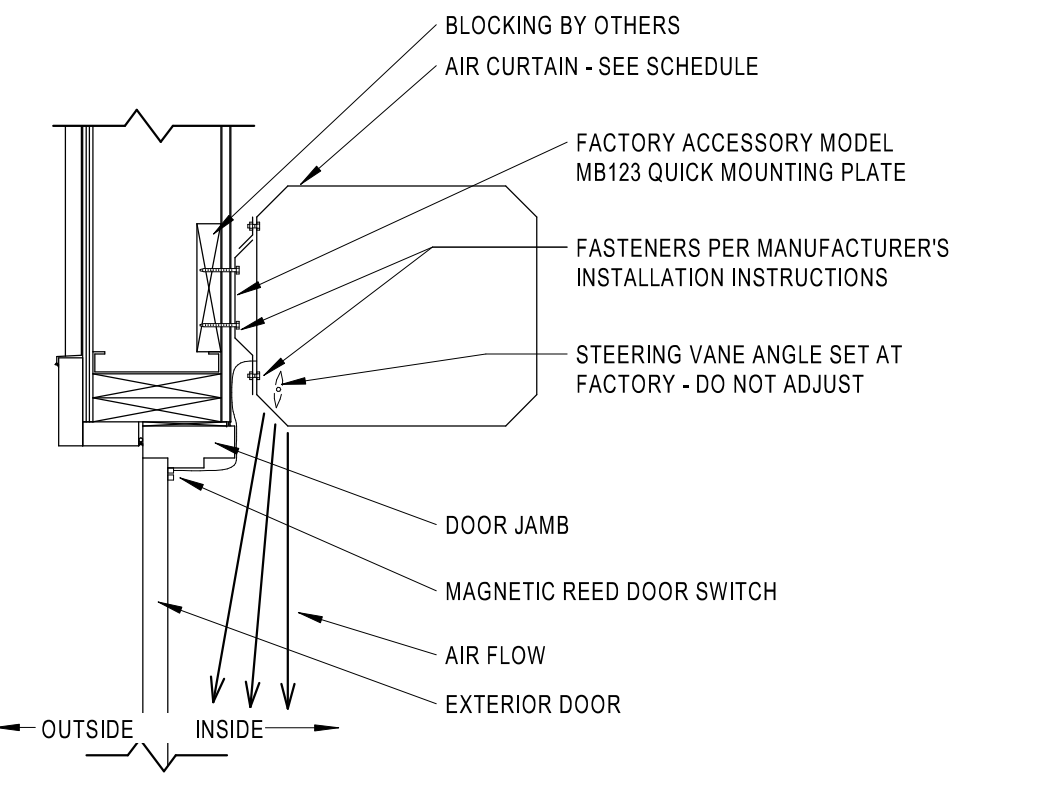


11 HVAC AIR CURTAIN INSTALLATION DETAIL
M4.0 NTS

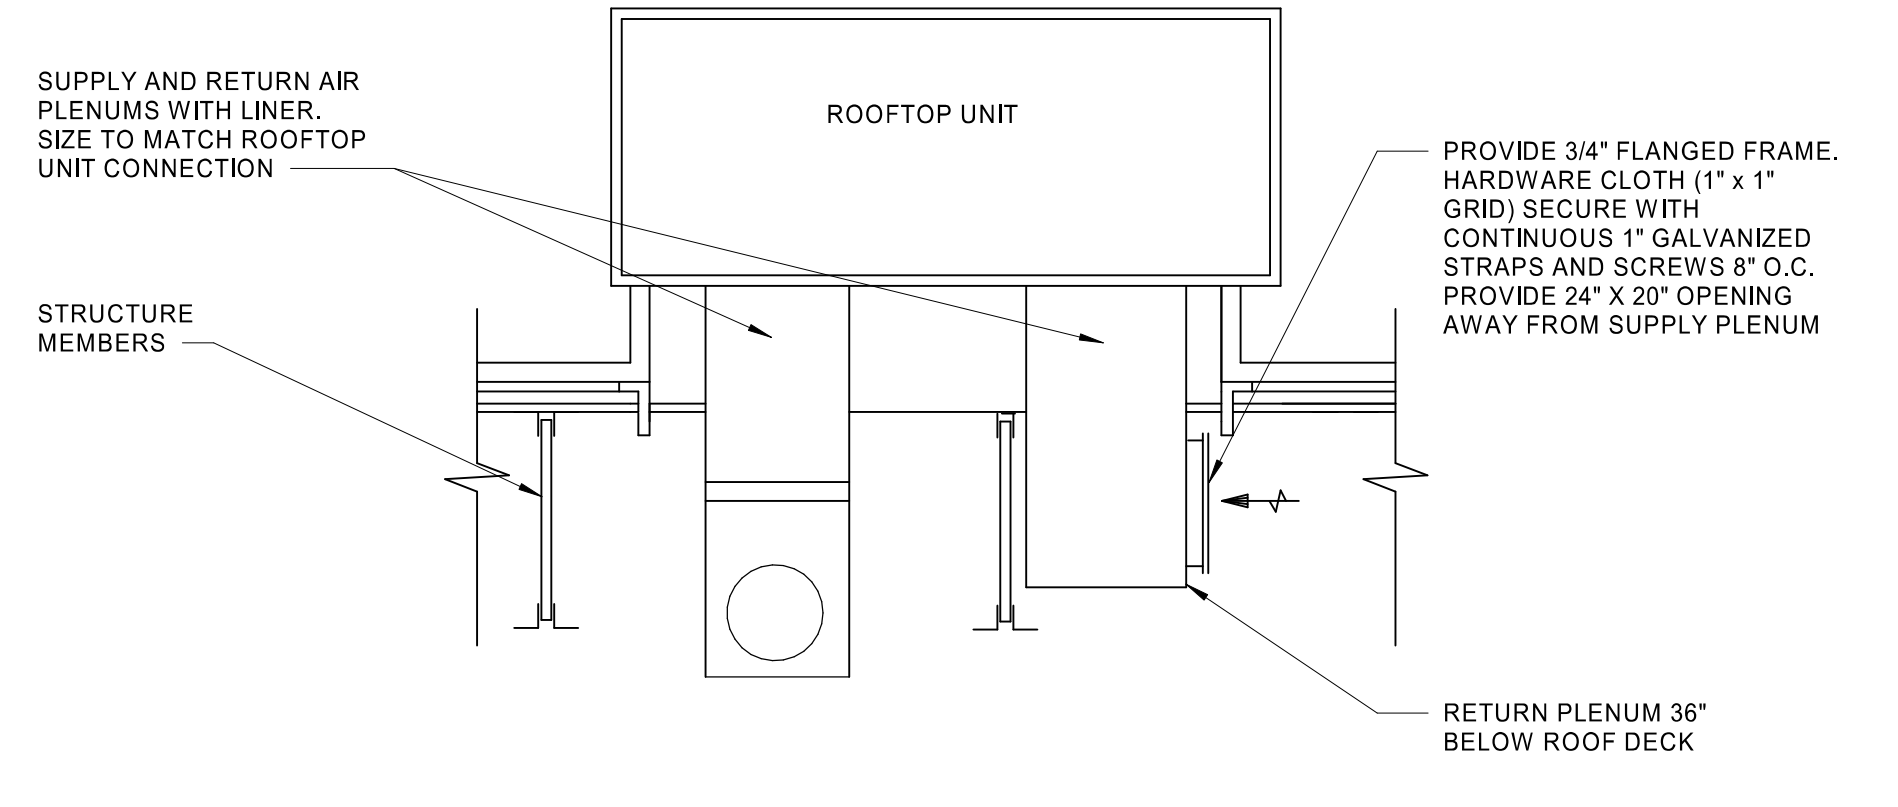


12 RTU DUCTWORK DROP DETAIL
M4.0 NTS

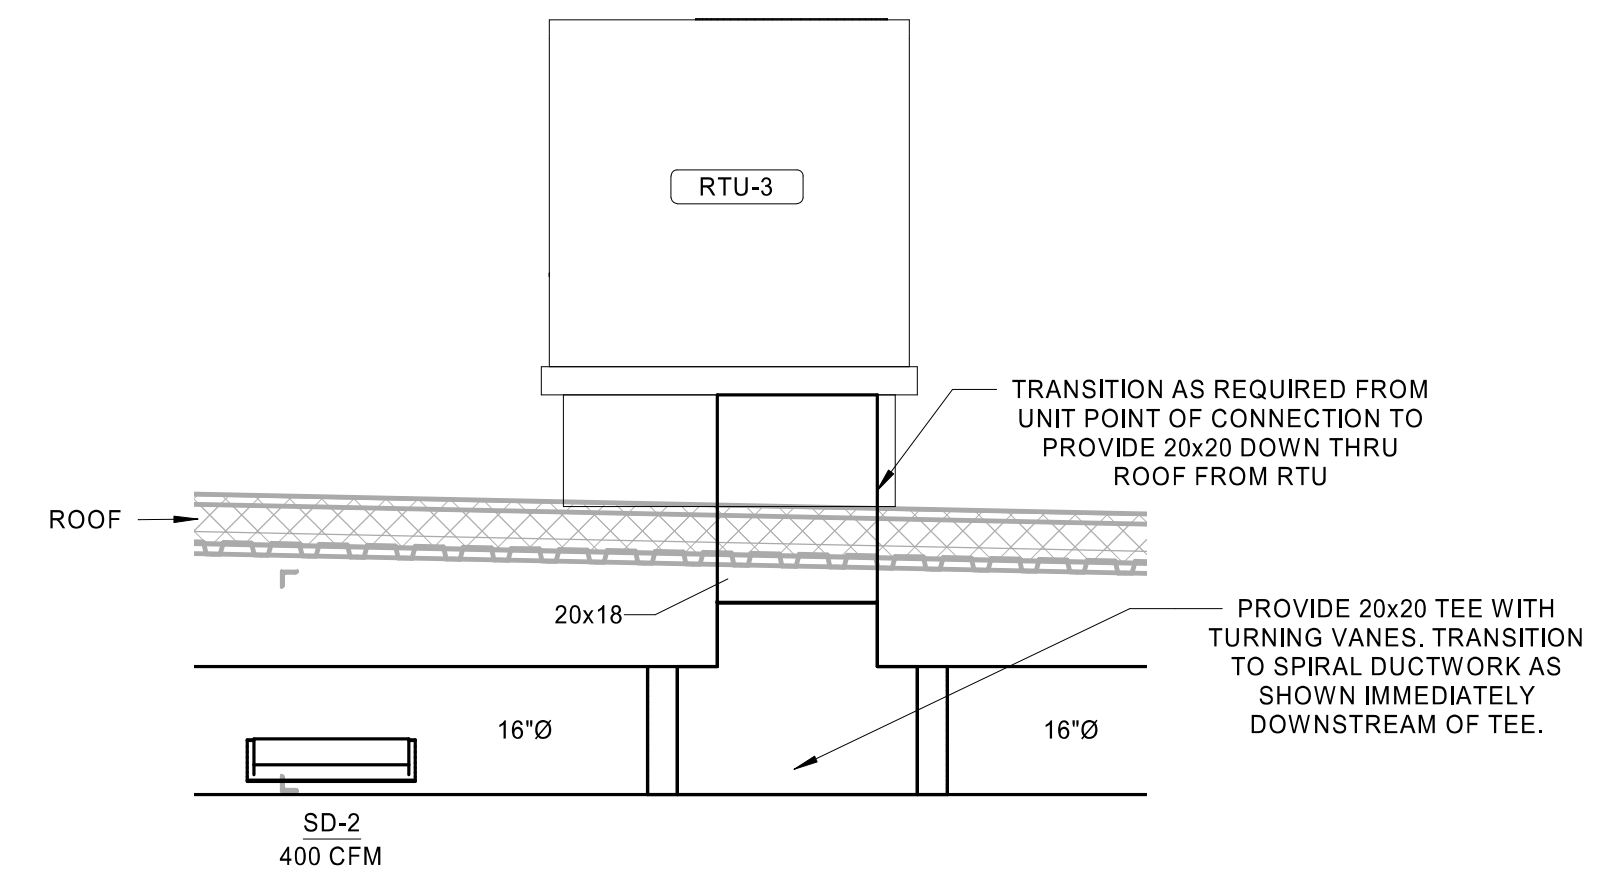

13 RTU-3 SUPPLY DUCTWORK DROP
M4.0 1/2" = 1'-0"

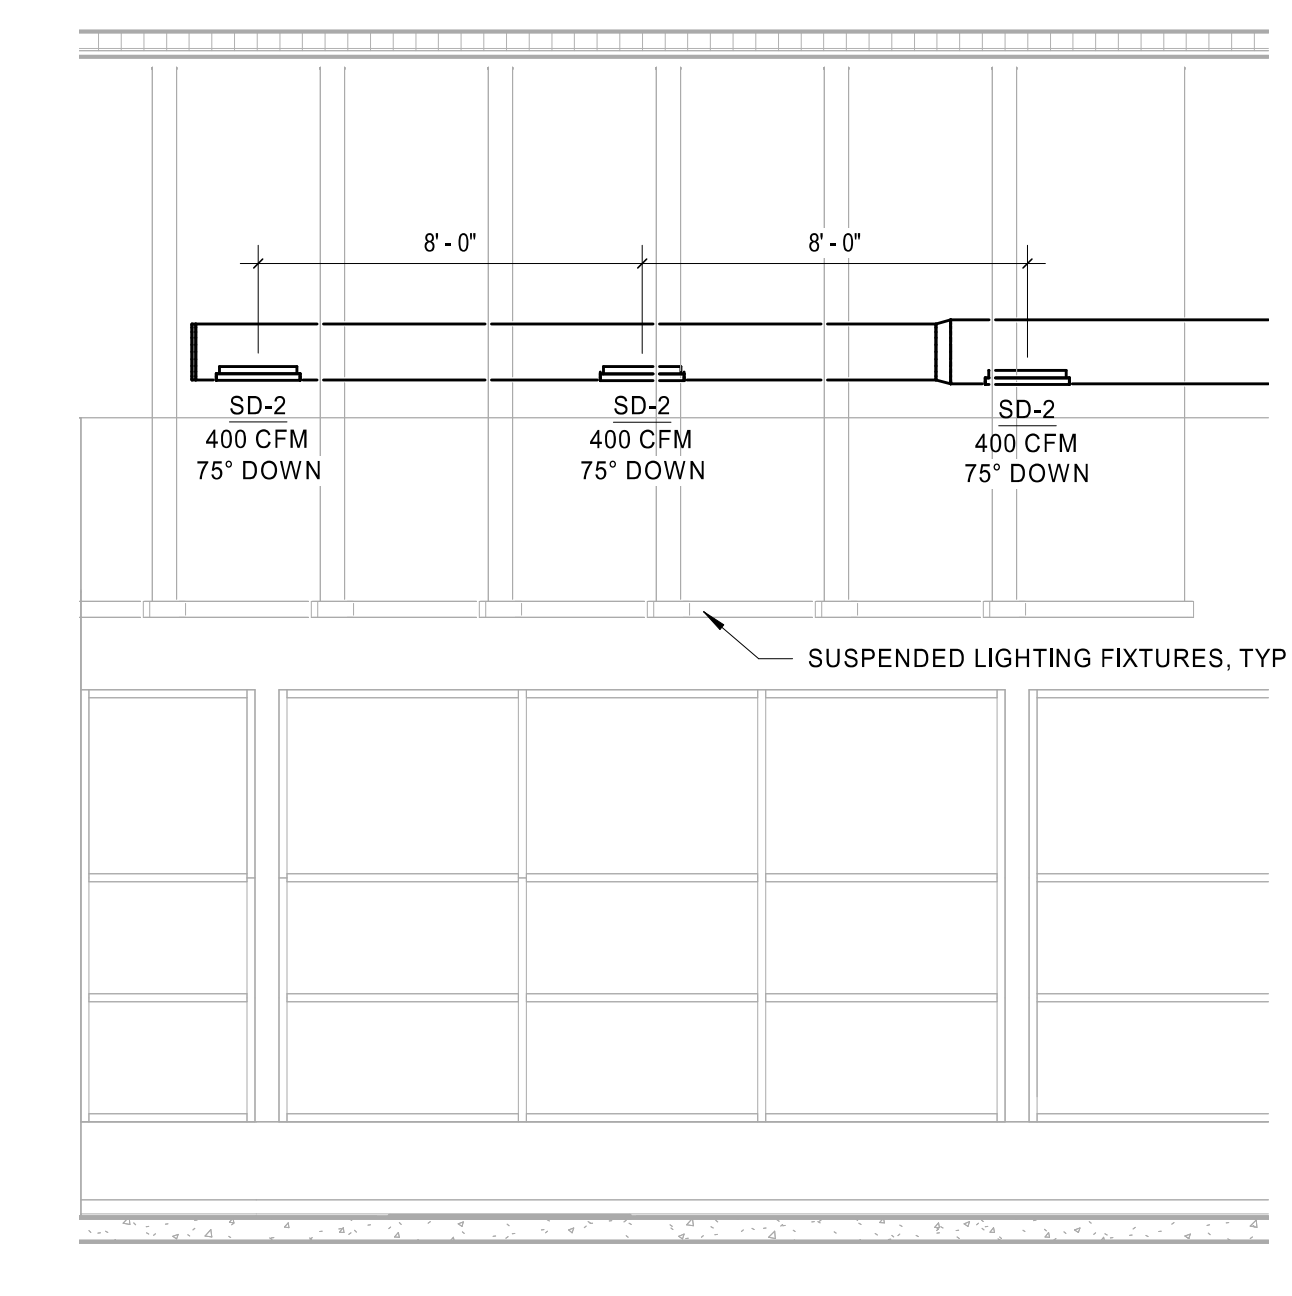

14 FRONT RETAIL DIFFUSER LAYOUT
M4.0 1/4" = 1'-0"

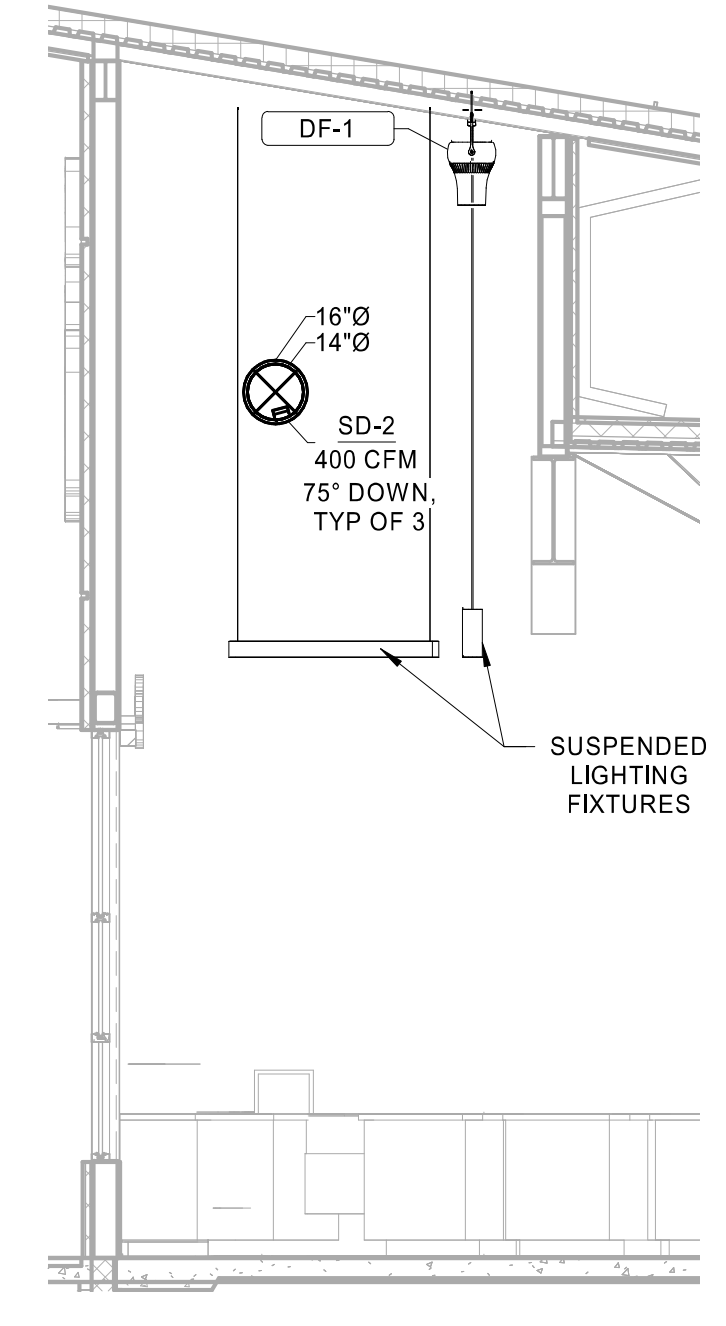

15 FRONT RETAIL DIFFUSER ANGLE DETAIL
M4.0 1/4" = 1'-0"

STIPULATION FOR REUSE: THIS DRAWING WAS PREPARED FOR THE PROJECT DESCRIBED HEREIN. IT IS NOT TO BE REUSED FOR ANY OTHER PROJECT WITHOUT THE WRITTEN CONSENT OF HFA. THE USER ASSUMES ALL LIABILITY FOR ANY AND ALL DAMAGES, INCLUDING REASONABLE ATTORNEY'S FEES AND COSTS, ARISING FROM ANY REUSE OF THIS DRAWING.

WAWA
STORE NUMBER: 7222
11100 WOODBURN ROAD
SILVERTON, OH 45238
JOB NUMBER: 42-24-0009

ISSUE BLOCK

NO.	DATE	DESCRIPTION

CHECKED BY: MJS
 DRAWN BY: SGB
 DOCUMENT DATE: 04/29/25
 PROTO: U63FB-R FLY THRU
 CYCLE: 2024.Q4.G5
 PLAN ISSUE: PERMIT SET

STATE OF OHIO
 JOHN KENNETH RALEY
 E-91124
 MECHANICAL ENGINEER
 2025.05.08 13:27:47-05'00'