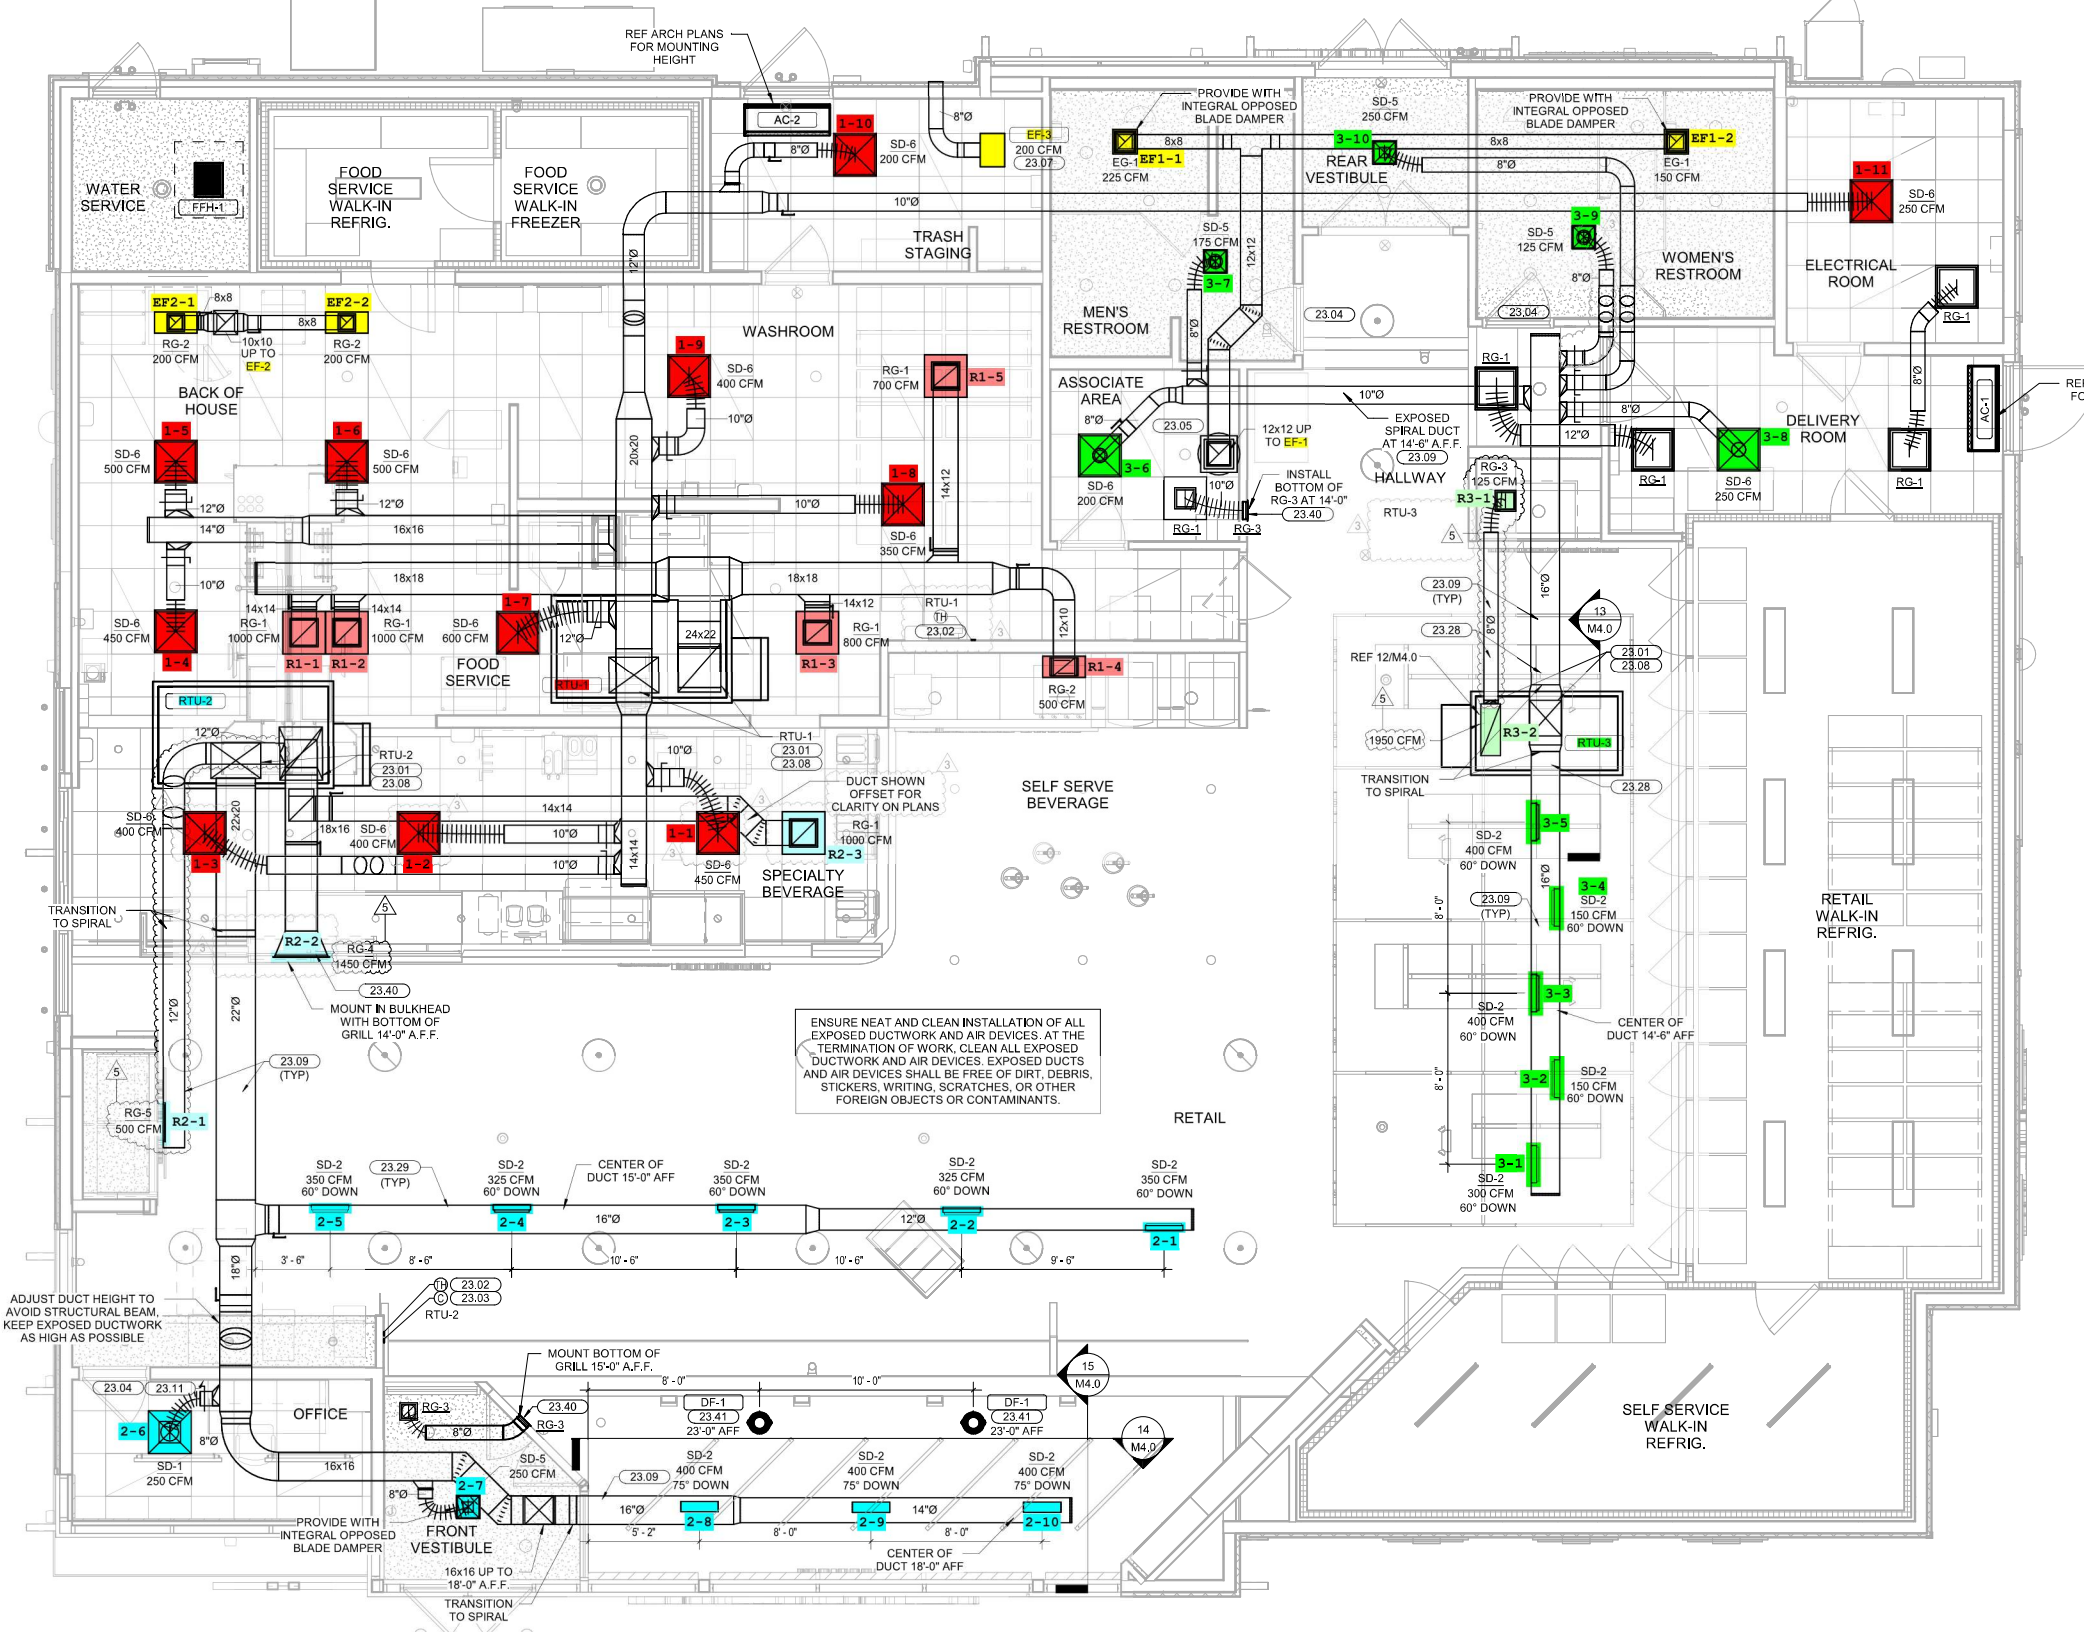
REF ARCH PLANS FOR MOUNTING HEIGHT
WATER SERVICE
FFH-1
FOOD SERVICE WALK-IN REFRIG.
FOOD SERVICE WALK-IN FREEZER
TRASH STAGING
WASHROOM
MEN'S RESTROOM
REAR VESTIBULE
WOMEN'S RESTROOM
ELECTRICAL ROOM
BACK OF HOUSE
ASSOCIATE AREA
HALLWAY
DELIVERY ROOM
FOOD SERVICE
SELF SERVE BEVERAGE
SPECIALTY BEVERAGE
RETAIL
RETAIL WALK-IN REFRIG.
SELF SERVICE WALK-IN REFRIG.
OFFICE
FRONT VESTIBULE
PROVIDE WITH INTEGRAL OPPOSED BLADE DAMPER
EXPOSED SPIRAL DUCT AT 14'-6" A.F.F.
INSTALL BOTTOM OF RG-3 AT 14'-0"
12x12 UP TO EF-1
10x10 UP TO EF-2
DUCT SHOWN OFFSET FOR CLARITY ON PLANS
TRANSITION TO SPIRAL
MOUNT IN BULKHEAD WITH BOTTOM OF GRILL 14'-0" A.F.F.
ENSURE NEAT AND CLEAN INSTALLATION OF ALL EXPOSED DUCTWORK AND AIR DEVICES. AT THE TERMINATION OF WORK, CLEAN ALL EXPOSED DUCTWORK AND AIR DEVICES. EXPOSED DUCTS AND AIR DEVICES SHALL BE FREE OF DIRT, DEBRIS, STICKERS, WRITING, SCRATCHES, OR OTHER FOREIGN OBJECTS OR CONTAMINANTS.
CENTER OF DUCT 15'-0" AFF
CENTER OF DUCT 14'-6" AFF
CENTER OF DUCT 18'-0" AFF
ADJUST DUCT HEIGHT TO AVOID STRUCTURAL BEAM, KEEP EXPOSED DUCTWORK AS HIGH AS POSSIBLE
MOUNT BOTTOM OF GRILL 15'-0" A.F.F.
16x16 UP TO 18'-0" A.F.F.
TRANSITION TO SPIRAL