

CheckList List

- WALGREENS SURVEY - RTU # 2
- WALGREENS SURVEY - RTU # 3



08-26-24 WALGREENS #17587 BALTIMORE, MD (SURVEY)

CheckList Information

Name : WALGREENS SURVEY - RTU # 2 **Status :** Completed
Assigned Organization : National TAB **Asset :**
Requesting Organization : National TAB
Created Date : 08/22/2024 - Brianna Biggs - National TAB
Completed Date : 08/28/2024 - David Annan - National TAB

CheckList Item Details

List unit label or tag nomenclature (if exists).

Comment:



08/28/2024

Close up picture of unit tag.

Comment:



08/28/2024

List model serial number & manufacturer.

Comment:

York Model: DH120N20P2AAC1A Serial: NLKM120097

Left side of cabinet.

Comment:



08/28/2024

Right side of cabinet.

Comment:



08/28/2024

Front side of cabinet.

Comment:



08/28/2024

Back side of cabinet.


Comment:



08/28/2024

Inside of electrical cabinet.

Comment:

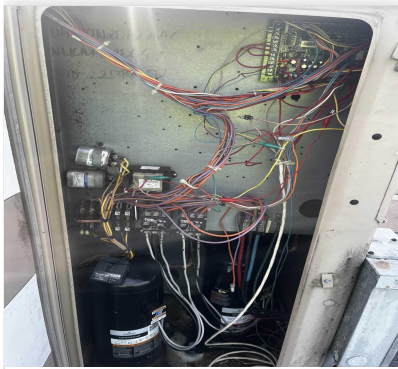

08/28/2024

Electrical schematic.

Comment:


Schematic is faded



08/28/2024

Close up picture of condensing coil.

Comment:

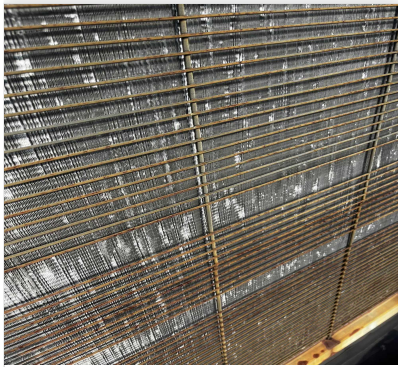

08/28/2024

Blower compartment.

Comment:



08/28/2024

Mixed air compartment.


Comment:



08/28/2024

Close up of evaporative coil.

Comment:

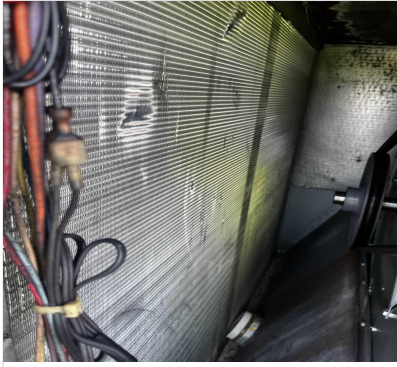

08/28/2024

Return drop looking down from unit if possible.

Comment:



08/28/2024

Supply drop looking down from unit if possible.

Comment:



08/28/2024

List any visual damage and take additional pictures if needed.

Comment:

Condenser coils are about 30% deteriorated



08-26-24 WALGREENS #17587 BALTIMORE, MD (SURVEY)

CheckList Information

Name : WALGREENS SURVEY - RTU # 3 **Status :** Completed
Assigned Organization : National TAB **Asset :**
Requesting Organization : National TAB
Created Date : 08/22/2024 - Brianna Biggs - National TAB
Completed Date : 08/28/2024 - David Annan - National TAB

CheckList Item Details

List unit label or tag nomenclature (if exists).

Comment:



08/28/2024

Close up picture of unit tag.

Comment:



08/28/2024

List model serial number & manufacturer.

Comment:

York Model: ZE060H12B2A1BAA1A1 Serial: N1D8694138

Left side of cabinet.

Comment:



08/28/2024

Right side of cabinet.

Comment:



08/28/2024

Front side of cabinet.

Comment:



08/28/2024

Back side of cabinet.


Comment:




08/28/2024

Inside of electrical cabinet.

Comment:

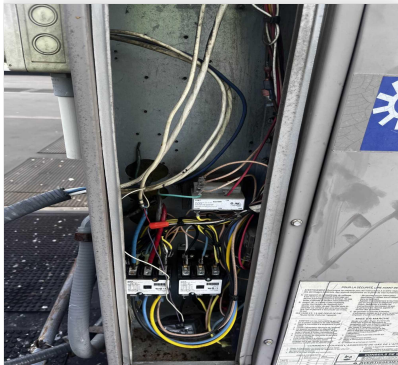


08/28/2024

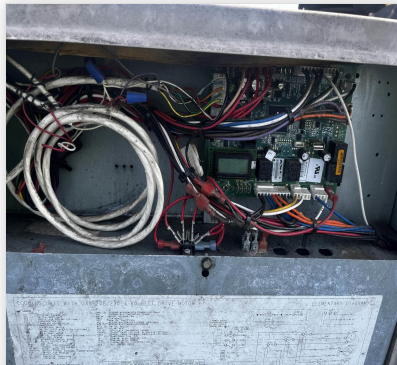


08/28/2024

Electrical schematic.

Comment:

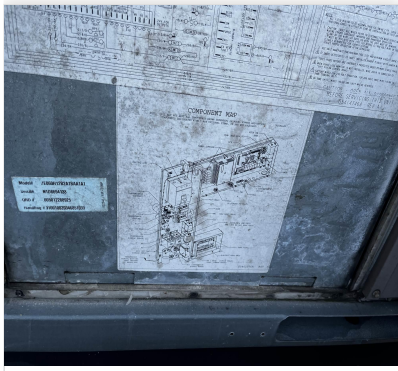

08/28/2024

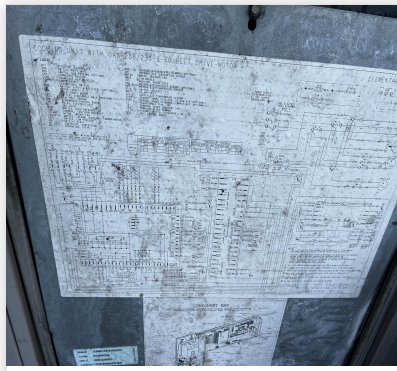

08/28/2024

Close up picture of condensing coil.

Comment:



08/28/2024

Blower compartment.

Comment:



08/28/2024

Mixed air compartment.


Comment:



08/28/2024

Close up of evaporative coil.


Comment:

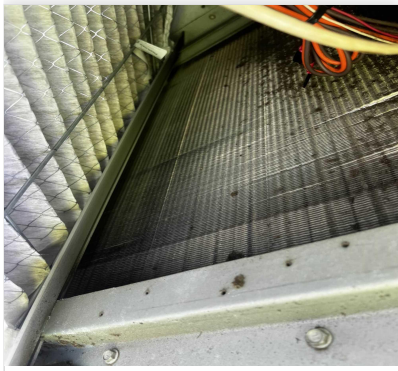

08/28/2024

Return drop looking down from unit if possible.

Comment:

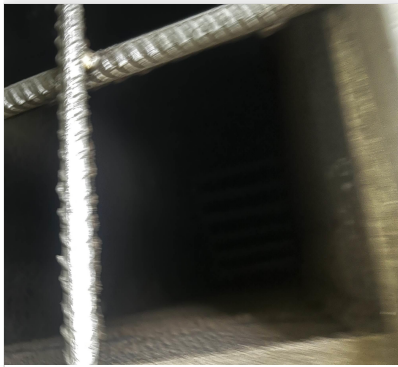

08/28/2024

Supply drop looking down from unit if possible.

Comment:



08/28/2024

List any visual damage and take additional pictures if needed.

Comment:
