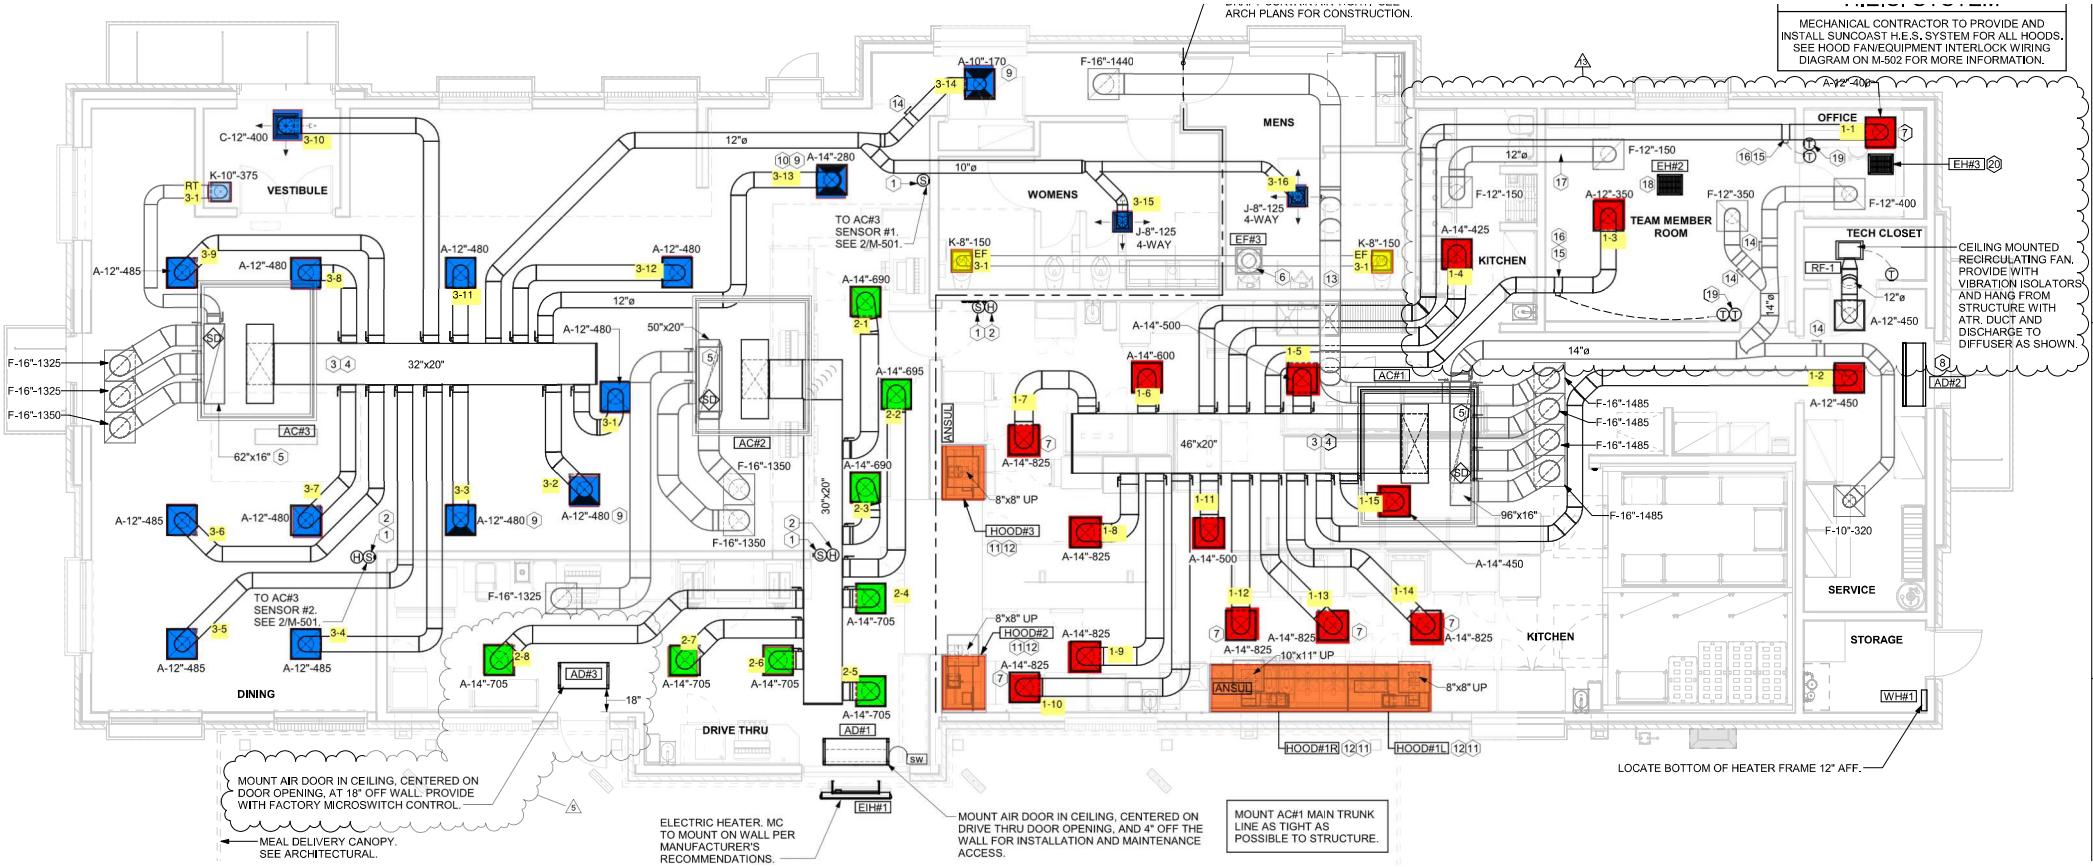
ARCH PLANS FOR CONSTRUCTION.
MECHANICAL CONTRACTOR TO PROVIDE AND INSTALL SUNCOAST H.E.S. SYSTEM FOR ALL HOODS. SEE HOOD FAN/EQUIPMENT INTERLOCK WIRING DIAGRAM ON M-502 FOR MORE INFORMATION.
VESTIBULE
DINING
DRIVE THRU
MENS
WOMENS
KITCHEN
OFFICE
TEAM MEMBER ROOM
TECH CLOSET
SERVICE
STORAGE
KITCHEN
AC#1
AC#2
AC#3
AD#1
AD#2
AD#3
EF#3
EH#1
EH#2
EH#3
HOOD#1L
HOOD#1R
HOOD#2
HOOD#3
RF-1
WH#1
TO AC#3 SENSOR #1. SEE 2/M-501.
TO AC#3 SENSOR #2. SEE 2/M-501.
CEILING MOUNTED RECIRCULATING FAN. PROVIDE WITH VIBRATION ISOLATORS AND HANG FROM STRUCTURE WITH ATR. DUCT AND DISCHARGE TO DIFFUSER AS SHOWN.
LOCATE BOTTOM OF HEATER FRAME 12" AFF.
MOUNT AIR DOOR IN CEILING, CENTERED ON DOOR OPENING, AT 18" OFF WALL. PROVIDE WITH FACTORY MICROSWITCH CONTROL.
MEAL DELIVERY CANOPY. SEE ARCHITECTURAL.
ELECTRIC HEATER. MC TO MOUNT ON WALL PER MANUFACTURER'S RECOMMENDATIONS.
MOUNT AIR DOOR IN CEILING, CENTERED ON DRIVE THRU DOOR OPENING, AND 4" OFF THE WALL FOR INSTALLATION AND MAINTENANCE ACCESS.
MOUNT AC#1 MAIN TRUNK LINE AS TIGHT AS POSSIBLE TO STRUCTURE.