

...IONS THROUGH ROOF.
 ...D 15. INSTALL THE REFRIGERANT LINE
 ...NDENSER. IF REFRIGERANT PIPING TO
 ...STAINLESS STEEL SHROUD AS SHOWN

...LLATION INSTRUCTIONS AND AS
 ...GS.


...ILED IN THE ARCHITECTURAL AND
 ...M FURNISHED BY CHIPOTLE ON

...PER DETAIL 1/M700. TYPICAL.
 ...CIATOR WITH REMOTE KEY OPERATED
 ...NT UNIT 60" AFF. TYPICAL.

...PER DETAIL 6/M700. SEE ELECTRICAL
 ...L UV WARNING STICKERS ON FACE OF
 ...THROUGH WHICH THE REME HALO

...D EXHAUST FAN DISCHARGE. SEE
 ...HEATER FLUE AND COMBUSTION AIR

...N OPPOSITE SIDE OF ROOM AT
 ...ROOM.

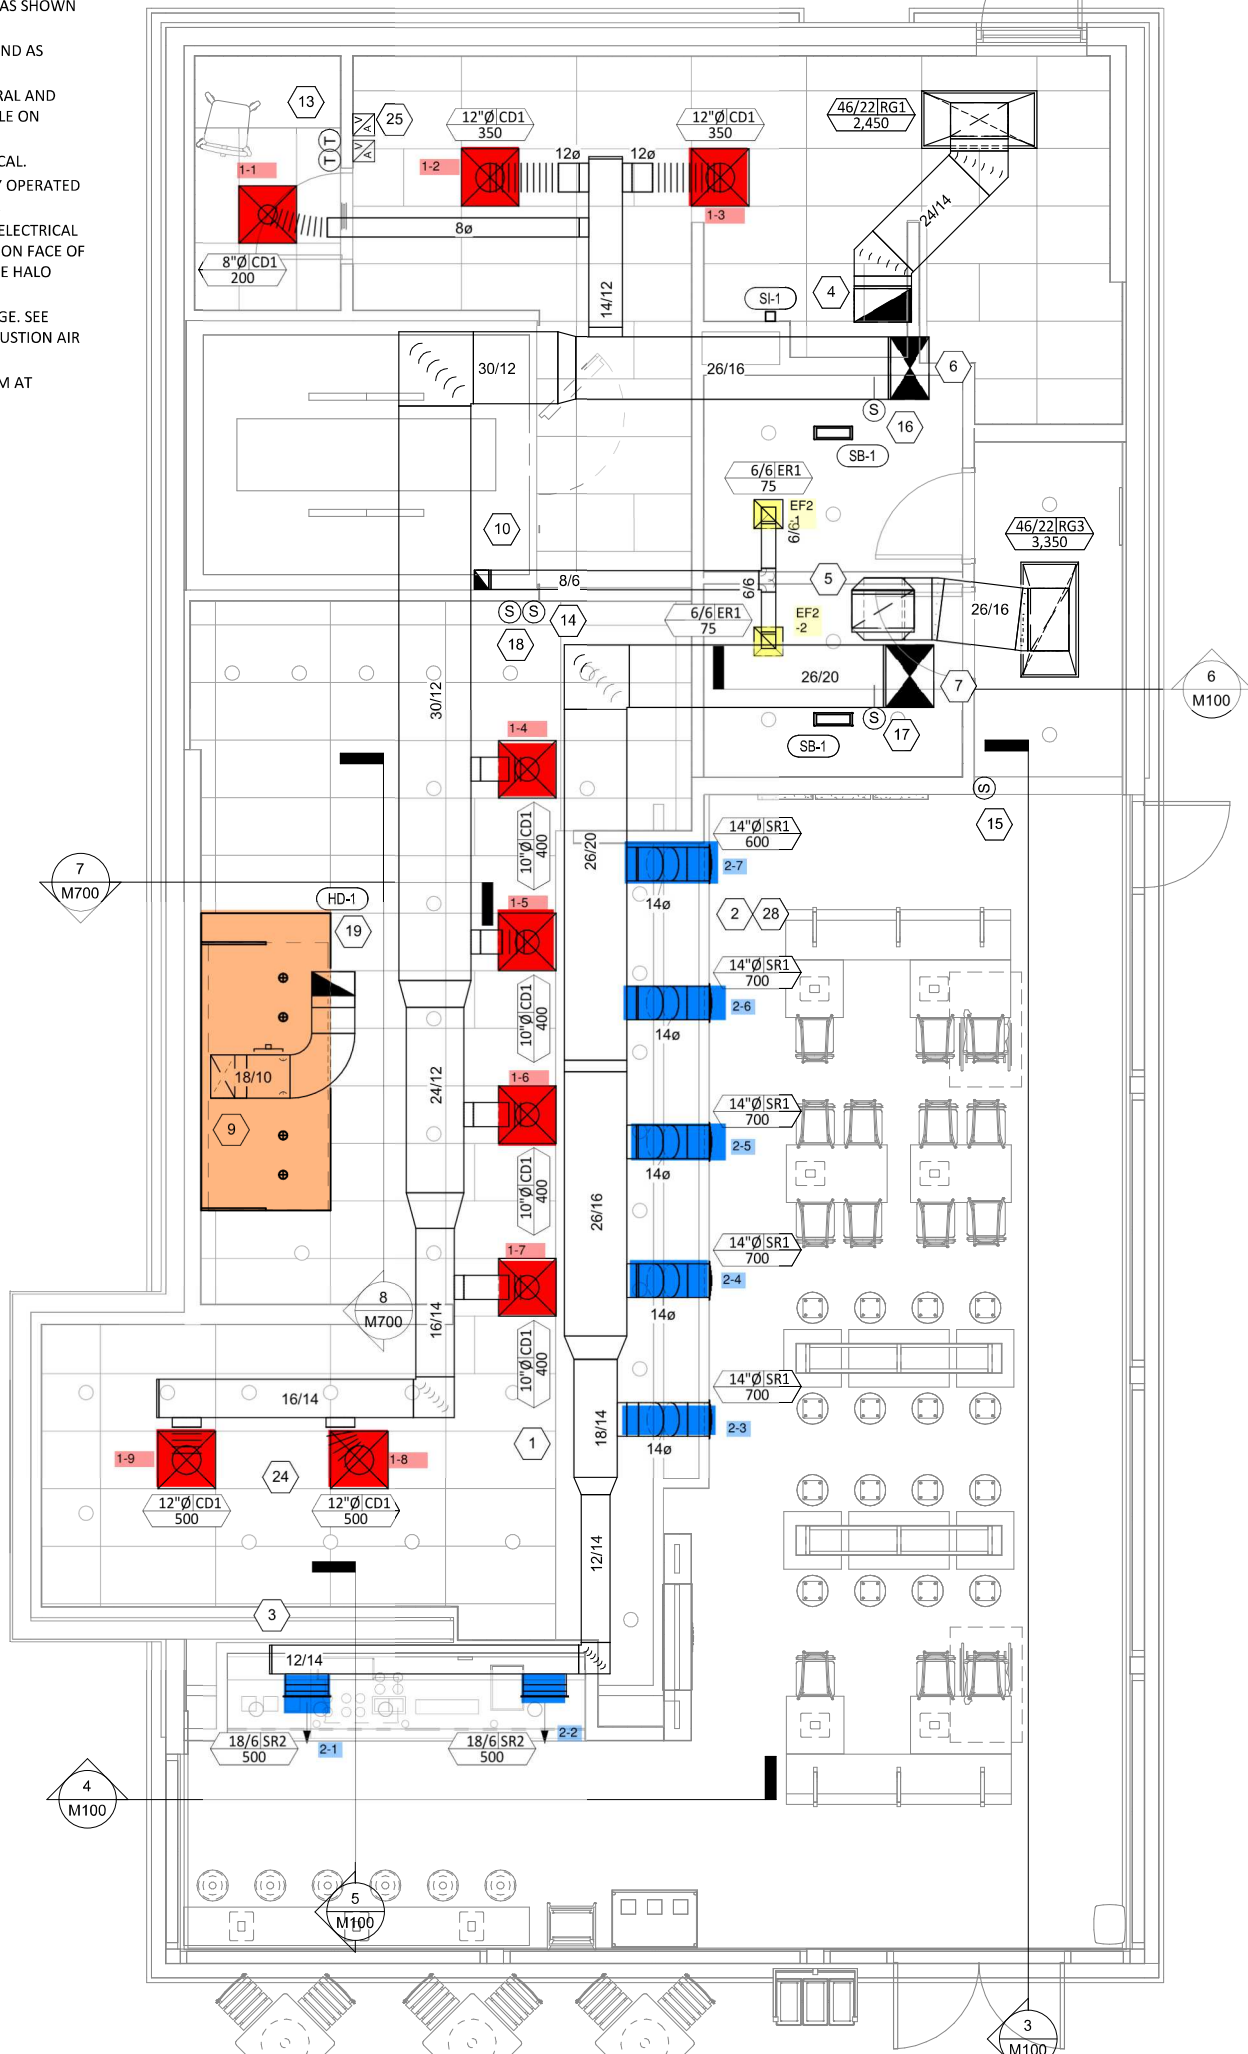

COPYRIGHT 2023
 THIS DRAWING IS AN
 AND AS SUCH REMAINS
 CHIPOTLE MEXICAN GR
 USE OF THIS DOCUMENT
 EXTENDED ONLY BY W
 CHIPOTLE MEXICAN GR



CHIPOTLE
 PO
 COLUMBIA, MO
 TELEPHONE
 INTERNET:

STORE NO.: 4989

Issue Record:

12/01/2023	PER

Revisions:

Drawn:
 IID
 Project No.
 231075

Contents:
 HVAC PL