

EXISTING CONDITIONS SHOWN ARE FROM PREVIOUS DRAWINGS.
MECHANICAL CONTRACTOR SHALL FIELD VERIFY EXACT
LOCATIONS OF ALL DUCT AND DIFFUSERS. IF MAJOR DIFFERENCES
OCCUR IN FIELD, CONTACT CHECK-IT-A CONSTRUCTION MANAGER.

LEGEND	
A1-2-400	TYPE - NECK SIZE - CHIL
+	SPRINK FITTINGS, MTD, NO SCOOP
⑨	REMOTE TEMPERATURE SENSOR
④	REMOTE HUMIDITY SENSOR
ASH	SHAVE PREFERRED

SHEET NOTES
① DUCT SIZES, SERVING DIFFERSERS AND GRILLS ARE SAME
AS SHOWN ON PREVIOUS SHEETS.


KEY NOTES (THIS SHEET ONLY)
①

MECHANICAL FLOOR PLAN
SCALE: 1/4" = 1'-0"

HES. SYSTEM
MECHANICAL CONTRACTOR TO PROVIDE
ALL NEW HOODS SEE HOOD FAN/EQUIPMENT
INTERLOCK WIRING DIAGRAM ON SHEET 1411
FOR MORE INFORMATION.

SC. TO HVE VENTILATION
CLEANING CONTRACTOR
GET IT DONE BEFORE
DUCTWORK IS INSTALLED
MUST CLEAN ALL EXISTING
DUCTWORK THAT IS TO REMAIN.

HOLD DUCT AT 40" AS HIGH AS
CLEARANCE ABOVE CEILING.

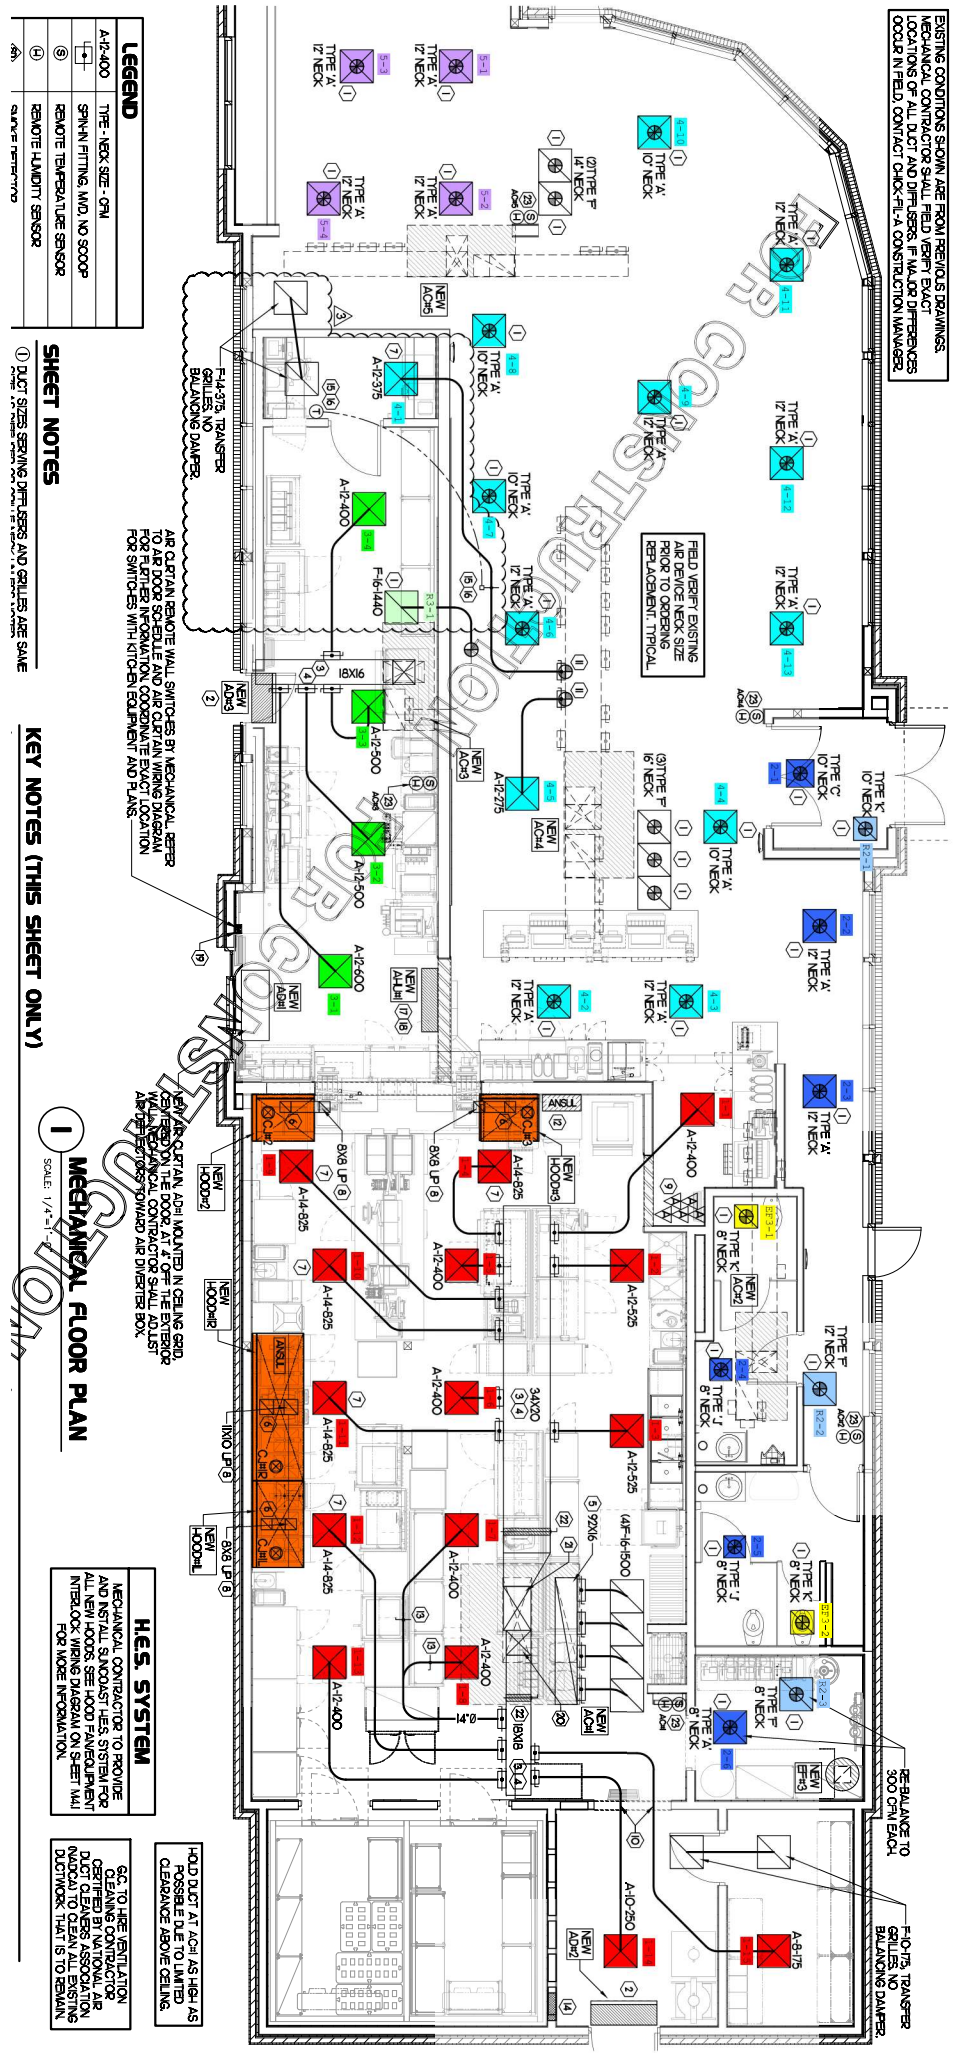

FIELD VERIFY EXISTING
AIR DEVICE NECK SIZE
PRIOR TO OCCUPANCY
REPLACEMENT TYPICAL.

AIR CURTAIN REMOVE WALL SWITCHES BY MECHANICAL REFER
TO AIR DOOR SCHEDULE AND AIR CURTAIN WIRING DIAGRAM
FOR FURTHER INFORMATION. COORDINATE EXACT LOCATION
FOR SWITCHES WITH OTHER EQUIPMENT AND PLANS.

REMOVE AIR CURTAIN AIR MOUNTED IN CEILING GRID
DOWNWARD THE DOOR AT 4" OFF THE EXTERIOR
WALL. MECHANICAL CONTRACTOR SHALL ADJUST
AIR DIVERTER TOWARD AIR DIVERTER BOX.

RE-BALANCE TO
300 CFM EACH
F-10-175, TRANSFER
GRILLS, NO
BALANCING DAMPER