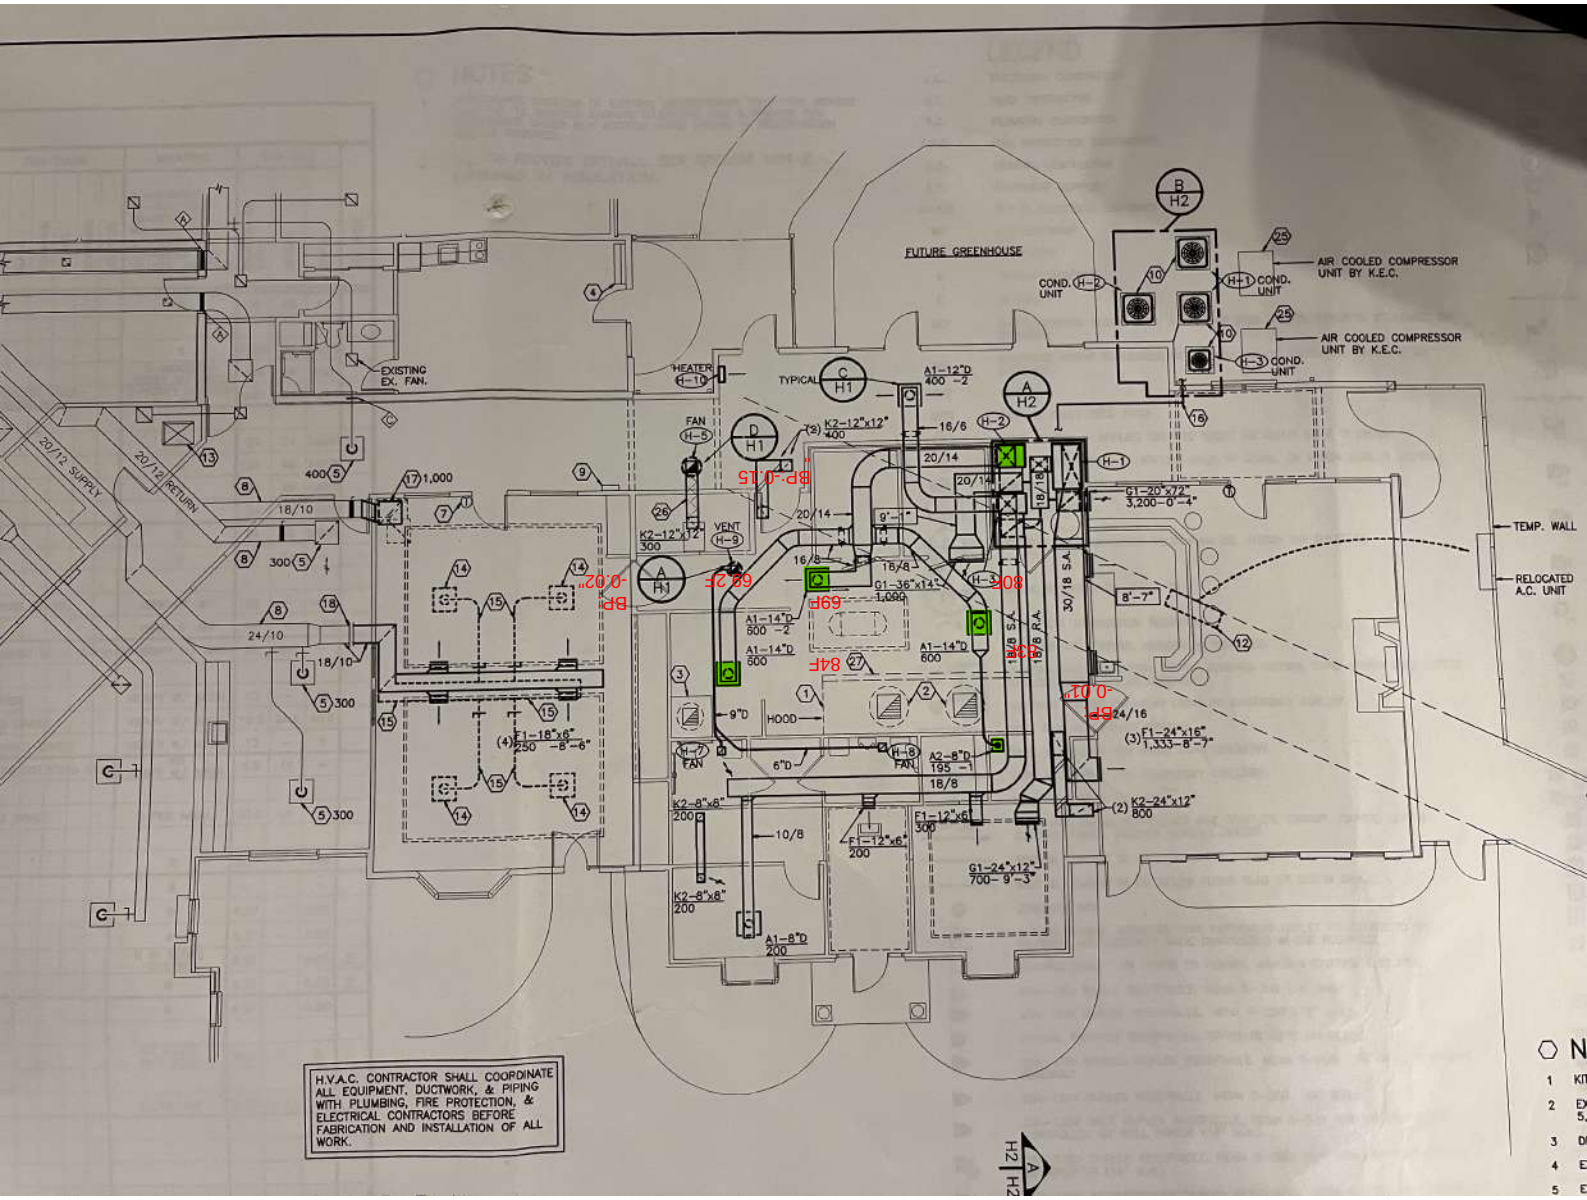
FUTURE GREENHOUSE
AIR COOLED COMPRESSOR UNIT BY K.E.C.
COND. UNIT
AIR COOLED COMPRESSOR UNIT BY K.E.C.
COND. UNIT
EXISTING EX. FAN.
HEATER
TYPICAL
FAN
VENT
HOOD
TEMP. WALL
RELOCATED A.C. UNIT
20/12 SUPPLY
20/12 RETURN
H.V.A.C. CONTRACTOR SHALL COORDINATE ALL EQUIPMENT, DUCTWORK, & PIPING WITH PLUMBING, FIRE PROTECTION, & ELECTRICAL CONTRACTORS BEFORE FABRICATION AND INSTALLATION OF ALL WORK.