


MECHANICAL FLOOR PLAN

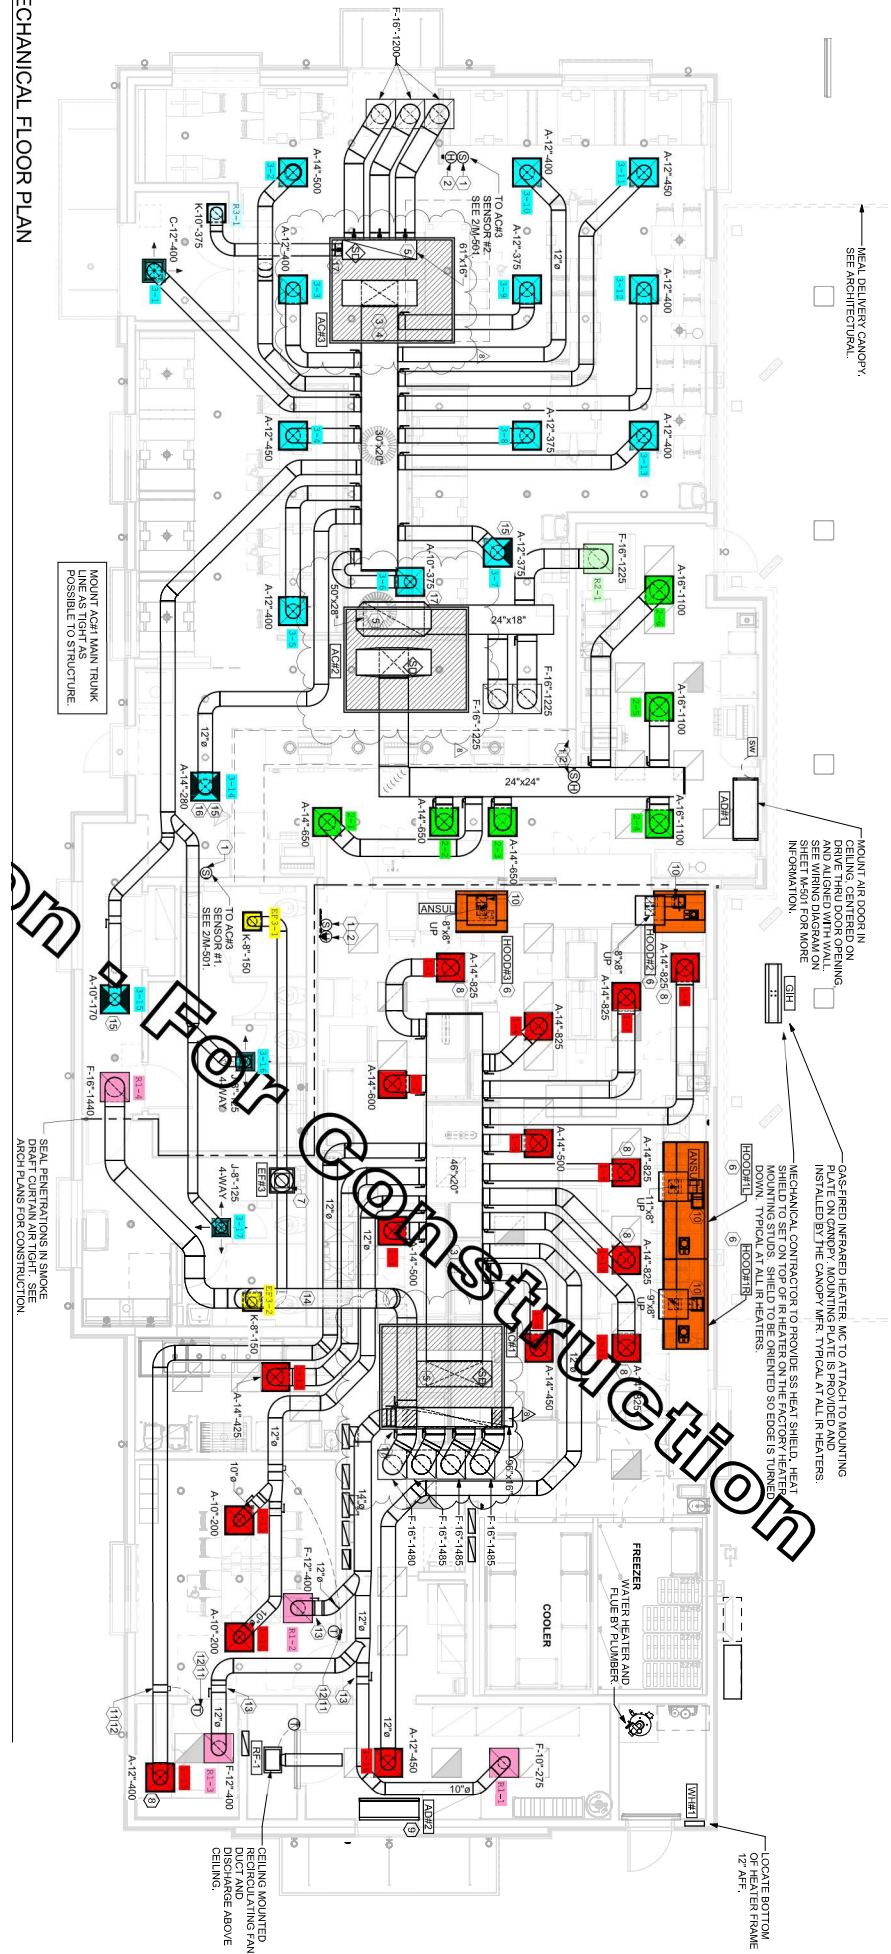

MEAL DELIVERY CANOPY.
SEE ARCHITECTURAL.

MOUNT AIR DOOR IN
DRIVE THRU DOOR OPENING.
AND ALIGNED WITH WALL.
SEE WIRING DIAGRAM
FOR INFORMATION ON WIRE

GAS-FIRED INFRARED HEATER, MC TO ATTACH TO MOUNTING
PLATE ON CANOPY. MOUNTING PLATE IS PROVIDED AND
INSTALLED BY THE CANOPY MFR. TYPICAL AT ALL HEATERS.
MECHANICAL CONTRACTOR TO PROVIDE SS HEAT SHIELD, HEAT
SHIELD TO SET ON TOP OF HEATER ON THE FACTORY HEATER
DOWN. TYPICAL AT ALL IR HEATERS.

MOUNT ACH# MAIN TRUNK
POSSIBLE TO STRUCTURE

SEAL PENETRATIONS IN SMOKE
DRIFT CURTAIN AIR TIGHT SEALS
AND FITTERS FOR SUBSTITUTION.

LOCATE BOTTOM
12" A/F.

CEILING MOUNTED
DUCT AND
RECIRCULATING FAN.
SEE ABOVE
CEILING.

For Construction