



GENERAL DEMOLITION NOTES:

- A. ALL WORK SHALL COMPLY WITH APPLICABLE NATIONAL, STATE AND LOCAL CODES, RULES, REGULATIONS AND REQUIREMENTS.
- B. ALL WORK SHALL COMPLY WITH THE BUILDING TENANT CONSTRUCTION GUIDE. COORDINATE WITH BUILDING MANAGEMENT/OWNER FOR ACCESS TO ANY TENANT LEASE SPACES THAT MIGHT BE REQUIRED FOR THE INSTALLATION, UNLESS DIRECTED BY LANDLORD ALL EQUIPMENT AND WORKMANSHIP SHALL BE GUARANTEED FOR 1 YEAR.
- C. EXISTING CONDITIONS ARE BASED ON INFORMATION PROVIDED BY SITE SURVEY AND PREVIOUS RECORD DRAWINGS. HOWEVER, IT IS NOT INTENDED TO BE A TRUE REPRESENTATION OF ACTUAL CONDITIONS. CONTRACTOR SHALL VISIT JOB SITE PRIOR TO BIDDING TO ASCERTAIN EXISTING CONDITIONS AND SHALL NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO BID.
- D. REMOVAL OF EXISTING FIXTURES AND EQUIPMENT WILL REQUIRE ISOLATING THE PIPING RISERS OR MAINS VIA SHUT-OFF VALVES. INSTALL NEW ISOLATION VALVES WHERE REQUIRED FOR COMPLETION OF WORK.
- E. REMOVAL OF EXISTING PLUMBING FIXTURES AND EQUIPMENT, ETC. WILL REQUIRE CAPPING AND SEALING EXISTING MAINS OR BRANCHES AS NECESSARY AND REQUIRED TO ALLOW THE REMAINING SYSTEMS TO FULLY OPERATE WITHOUT DEGRADATION.
- F. CONTRACTOR SHALL PROVIDE PROTECTIVE PLASTIC DROP CLOTHS TO PROTECT THE EXISTING OCCUPIED AREAS AND EQUIPMENT FROM DUST AND DEBRIS DURING THE CONSTRUCTION WORK, AND SHALL CLEAN THE AREAS OF ALL CONSTRUCTION DIRT DAILY, AND UPON COMPLETION OF THE WORK.
- G. ALL DRAINED PIPING RISERS AND MAINS SHALL BE FILLED WITH PROPER FLUID AND PROPERLY VENTED BY THIS CONTRACTOR, ONCE NEW WORK HAS BEEN INSTALLED.
- H. COORDINATE WITH GENERAL CONTRACTOR THE REMOVAL AND REPLACEMENT OF ALL EXISTING CEILING, WALLS, ETC. AS REQUIRED FOR MECHANICAL DEMOLITION WORK.
- I. EXISTING PIPING AND EQUIPMENT ETC. NOT TO BE UTILIZED IN THE COMPLETED BUILDING SHALL BE DISCONTINUED OR REMOVED AS REQUIRED. ALL ENDS OF DISCONTINUED PIPING SHALL BE CAPPED IN THE NEAREST WALL, CEILING OR FLOOR SO THAT THEY ARE COMPLETELY CONCEALED. OPENINGS LEFT IN WALLS, CEILING, ETC. WHERE EQUIPMENT AND PIPE, ETC. ARE REMOVED AND NOT REPLACED, SHALL BE PATCHED NEATLY WITH SIMILAR MATERIAL TO ADJACENT CONSTRUCTION. REFER TO DRAWINGS DELINEATING NEW WORK FOR ADDITIONAL INFORMATION REGARDING SYSTEMS OR PORTIONS OF SYSTEMS WHERE USE IS TO BE DISCONTINUED.
- J. EXISTING PIPING, FIXTURES AND EQUIPMENT THAT ARE NOT TO BE REUSED SHALL BE REMOVED AND SHALL REMAIN THE PROPERTY OF THE OWNER IF THEY WANT TO RETAIN OWNERSHIP OF SAME. IF NOT, EQUIPMENT SHALL BECOME THE PROPERTY OF THIS CONTRACTOR AND SHALL BE REMOVED FROM THE SITE AS SOON AS PRACTICAL AND DISPOSED OF IN ACCORDANCE WITH APPLICABLE LAWS AND REGULATIONS.
- K. ALL CUTTING AND CHANNELING OF EXISTING BUILDING SHALL BE ACCOMPLISHED IN A NEAT AND WORKMANLIKE MANNER WITHOUT REMOVAL OF EXCESS MATERIALS. THIS CONTRACTOR SHALL PATCH AND REPLACE WITH MATERIAL SIMILAR TO ADJACENT CONSTRUCTION.
- L. WHERE EXISTING PIPING AND EQUIPMENT, ETC., THAT ARE TO BE UTILIZED IN THE COMPLETED PROGRAM CONFLICT WITH NEW CONSTRUCTION AND THE REQUIRED DEMOLITION, THEY SHALL BE RELOCATED AND RECONNECTED TO MAINTAIN THE DESIRED SERVICE.
- M. PORTIONS OF EXISTING SYSTEMS MAY BE SHOWN FOR CLARITY EVEN THOUGH IT MAY NOT BE NECESSARY TO MODIFY OR REVISE THEM. ALL EXISTING SYSTEMS ARE SHOWN BASED ON ORIGINAL OR REMODEL BUILDING DRAWINGS. CONTRACTOR TO VERIFY ALL EXISTING CONDITIONS.
- N. ALL WORK MUST BE COORDINATED AND SCHEDULED WITH THE OWNER AND OCCUPANTS OF THIS BUILDING SO AS TO PROVIDE THE LEAST AMOUNT OF DISRUPTION OF THE NORMAL BUILDING ACTIVITIES AS POSSIBLE. MAINTAIN CONDITIONED SPACE FOR ALL OWNER OCCUPIED AREAS DURING CONSTRUCTION.
- O. ALL ACCESSIBLE ABANDONED PIPING AND DUCTWORK SHALL BE REMOVED AND PROPERLY DISPOSED OF.

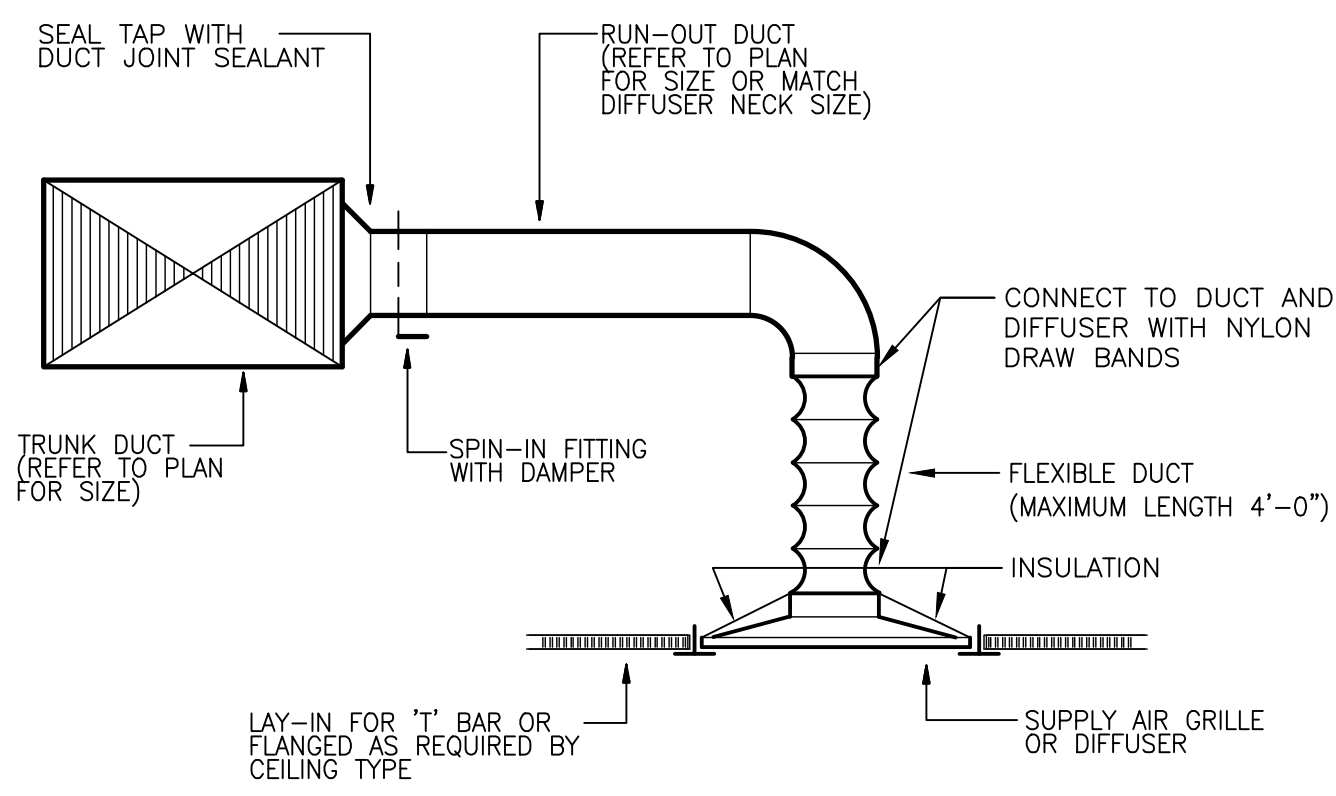

1) DIFFUSER CONNECTION DETAIL
SCALE: NOT TO SCALE

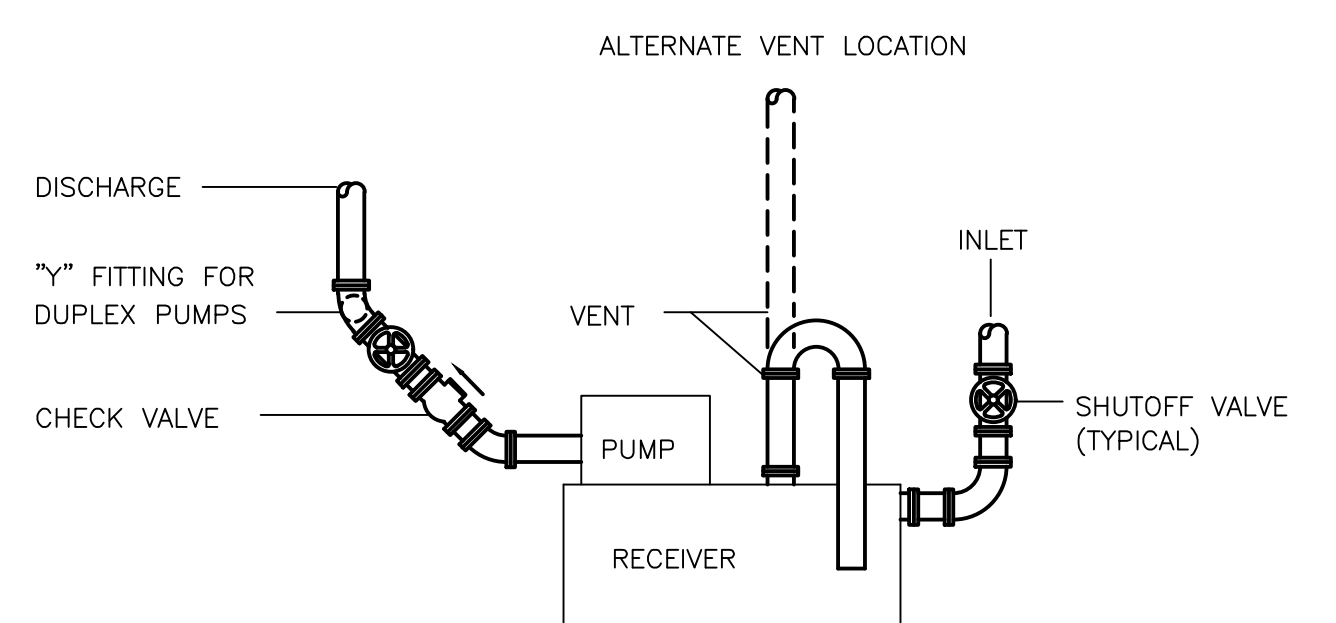

2) CONDENSATE PUMP DETAIL
SCALE: NOT TO SCALE

FAN POWERED BOXES

DESIG.	SERVES	DESIGN COOLING CFM	MIN COOLING CFM	HEATING CFM	FAN HP	ELEC KW	VOLTPH	INLET SIZE (IN)	EQUAL TO MANUF & MODEL NO
FPB1-17A	OFFICES	710	178	497	14	5.0	277/480/3	10	TITUS DTOP

NOTES: (APPLICABLE TO ALL BOXES)
 1) REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
 2) PROVIDE FIBER FREE LINER EQUAL TO PLYMER FOAM INSULATION.
 3) REFER TO SCHEDULE FOR MINIMUM SETPOINTS.
 4) BOXES SHALL BE COMPLETE WITH BUILDING STANDARD DDC CONTROLS AND CONNECTED TO BMS VIA BUILDING STANDARD SEQUENCE OF OPERATION.
 5) APPROVED MANUFACTURERS: ENVIRO-TEC, PRICE, NALOR, TITUS, JCI, GREENHECK, & TRANE.
 6) ALL SUBSTITUTIONS SHALL BE APPROVED IN WRITING, PRIOR TO BID.
 7) PROVIDE SINGLE POINT CONNECTION AND FUSED DISCONNECT FOR EACH UNIT.
 8) BOXES SHALL BE PROVIDED WITH MAGNETIC CONTACTORS, SCR, AIR FLOR SWITCHES AND DOOR INTERLOCK.
 9) FILTER RESISTANCE IS NOT INCLUDED IN THE SCHEDULED EXTERNAL STATIC PRESSURE.
 10) BOXES SHALL BE PRESSURE INDEPENDENT.
 11) PROVIDE ALL FAN POWERED BOXES OVER 2,000 CFM WITH A DEDICATED SMOKE DETECTOR IN THE RETURN AIR PATH OF THAT SPECIFIC TERMINAL.

GRILLES - REGISTERS - DIFFUSERS

DESIG.	DUTY	TYPE	MOUNTING LOCATION	MATERIAL	VOLUME CONTROL	FINISH	AIR PATTERN CONTROL	METHOD OF SUPPORT	EQUAL TO MANUFACTURER AND MODEL NO.	REMARKS
A	SUPPLY	LOUVERED	LAY-IN CLG	STEEL	NO	OFF WHITE	YES	T-BAR	TITUS TMS 2424 FACE	SEE NOTE 1,2
A	SUPPLY	LOUVERED	LAY-IN CLG	STEEL	NO	OFF WHITE	YES	T-BAR	TITUS CMN 2424 FACE	SEE NOTE 1,2,10
B	RETURN	PERFORATED	LAY-IN CLG	STEEL	NO	OFF WHITE	NO	T-BAR	TITUS PAR 2424 FACE	SEE NOTE 2
B1	RETURN	PERFORATED	LAY-IN CLG	STEEL	NO	OFF WHITE	NO	T-BAR	TITUS PAR 2424 FACE	SEE NOTE 2
C	SUPPLY	SLOT	LAY-IN CLG	STEEL	NO	BLACK	YES	T-BAR	TITUS TB080 (11-1/2" SLOT)	SEE NOTE 1,2,3,3
D	SUPPLY	AER-BLADE	LAY-IN CLG	ALUMINUM	QBD	OFF WHITE	YES	T-BAR	TITUS 272RS	SEE NOTE 6
E	RETURN	FIXED	SIDEWALL	STEEL	NO	OFF WHITE	YES	SURFACE	TITUS 25FL	SEE NOTE 4
F	SUPPLY	LINEAR SLOT	GYP BD CLG	ALUMINUM	NO	OFF WHITE	YES	SURFACE	TITUS MLT-39 (2-1" SLOTS)	SEE NOTE 1,7
G	RETURN	LINEAR SLOT	GYP BD CLG	ALUMINUM	NO	OFF WHITE	NO	SURFACE	TITUS MLTR39 (1" SLOT)	SEE NOTE 9
H	SUPPLY	LINEAR SLOT	GYP BD CLG	ALUMINUM	NO	OFF WHITE	YES	SURFACE	TITUS FL-15HT	SEE NOTE 8
I	RETURN	LINEAR SLOT	GYP BD CLG	ALUMINUM	NO	OFF WHITE	YES	SURFACE	TITUS FL-15HT	SEE NOTE 9


- NOTES:
- 1) NECK SIZES AS FOLLOWS:

DESIGNATION "A"	NECK SIZE	DESIGNATION "A" (ALTERNATE)	NECK SIZE	DESIGNATION "C"	NECK SIZE	LENGTH
000-250	8"RD	000-300	8"RD	000-150	8"RD	2'-0"
255-400	10"RD	305-435	10"RD	135-260	10"RD	4'-0"
405-550	12"RD	440-600	12"RD			
555-700	14"RD	600-745	14"RD			
 - 2) NOTIFY ENGINEER OF ANY DISCREPANCIES BETWEEN NEW MODEL NUMBER AND EXISTING NUMBER PRIOR TO PURCHASE.
 - 3) COORDINATE NEW INACTIVE SECTIONS NEXT TO SLOT DIFFUSER WITH ARCHITECT PRIOR TO BIDDING.
 - 4) REFER TO DRAWINGS FOR GRILLE/NECK SIZES.
 - 5) INACTIVE SECTIONS OF SLOT DIFFUSERS SHALL HAVE SHEET METAL LIGHTPROOF SIGHT GUARDS AND SHALL BE USED FOR RETURN AIR.
 - 6) PROVIDE WITH 2424 PANEL BORDER TYPE 3 AND TRANSITION FROM SQUARE TO ROUND DUCT. REFER TO DRAWINGS FOR GRILLE/NECK SIZES.
 - 7) CONTINUOUS GRILLE: PROVIDE REQUIRED MP-39 PLENUMS AS NEEDED.
 - 8) PROVIDE NUMBER OF SUPPLY AIR PLENUMS AS SHOWN. COORDINATE EXACT LENGTH OF SLOT WITH ARCHITECT. SUPPLY AIR PLENUMS TO BE FABRICATED BY TITUS. CONFIRM BORDER TYPE 22 WITH ARCHITECT.
 - 9) LEAVE OPEN FOR RETURN AIR AND PROVIDE A LIGHT SHIELD. COORDINATE EXACT LENGTH OF SLOT WITH ARCHITECT. COORDINATE BORDER TYPE WITH ARCHITECT.
 - 10) ALTERNATE GRILLE: REFER TO DRAWINGS FOR ADDITIONAL INFORMATION.
 - 11) APPROVED MANUFACTURERS: PRICE, TITUS, NALOR, GREENHECK, & KRUEGER.


DX COMPUTER ROOM AIR CONDITIONING

DESIG.	CFM	HP	ESP (IN)	INDOOR EVAPORATOR UNIT				OUTDOOR CONDENSING UNIT @ 105 DEF F AMBIENT										
				COOLING		ELECTRIC		ELECTRICAL		EQUAL TO								
				TOTAL	SENS	HEATING	HUMID.	FLA	OPD	VOLTPH	MANUF & MODEL NUMBER	DESIG.	MCA	OPD	VOLTPH	MANUF & MODEL NUMBER		
CRAC1-1	880	0.5	0.3	21.2	17.8	MBH	MBH	MBHWK	LBSHR	2.8	15	208/1	308/1	15.5	30	208/1	308/1	LIEBERT PPH27A


NOTES:
 1) PROVIDE LIEBERT ROOM OMS CONTROLLER, NON-LOCKING DISCONNECT SWITCH, CONDENSATE PUMP CAPABLE OF 10' OF HEAD PRESSURE FOR PRIMARY AND SECONDARY CONDENSATE DRAINS, AND LEAK DETECTION KIT

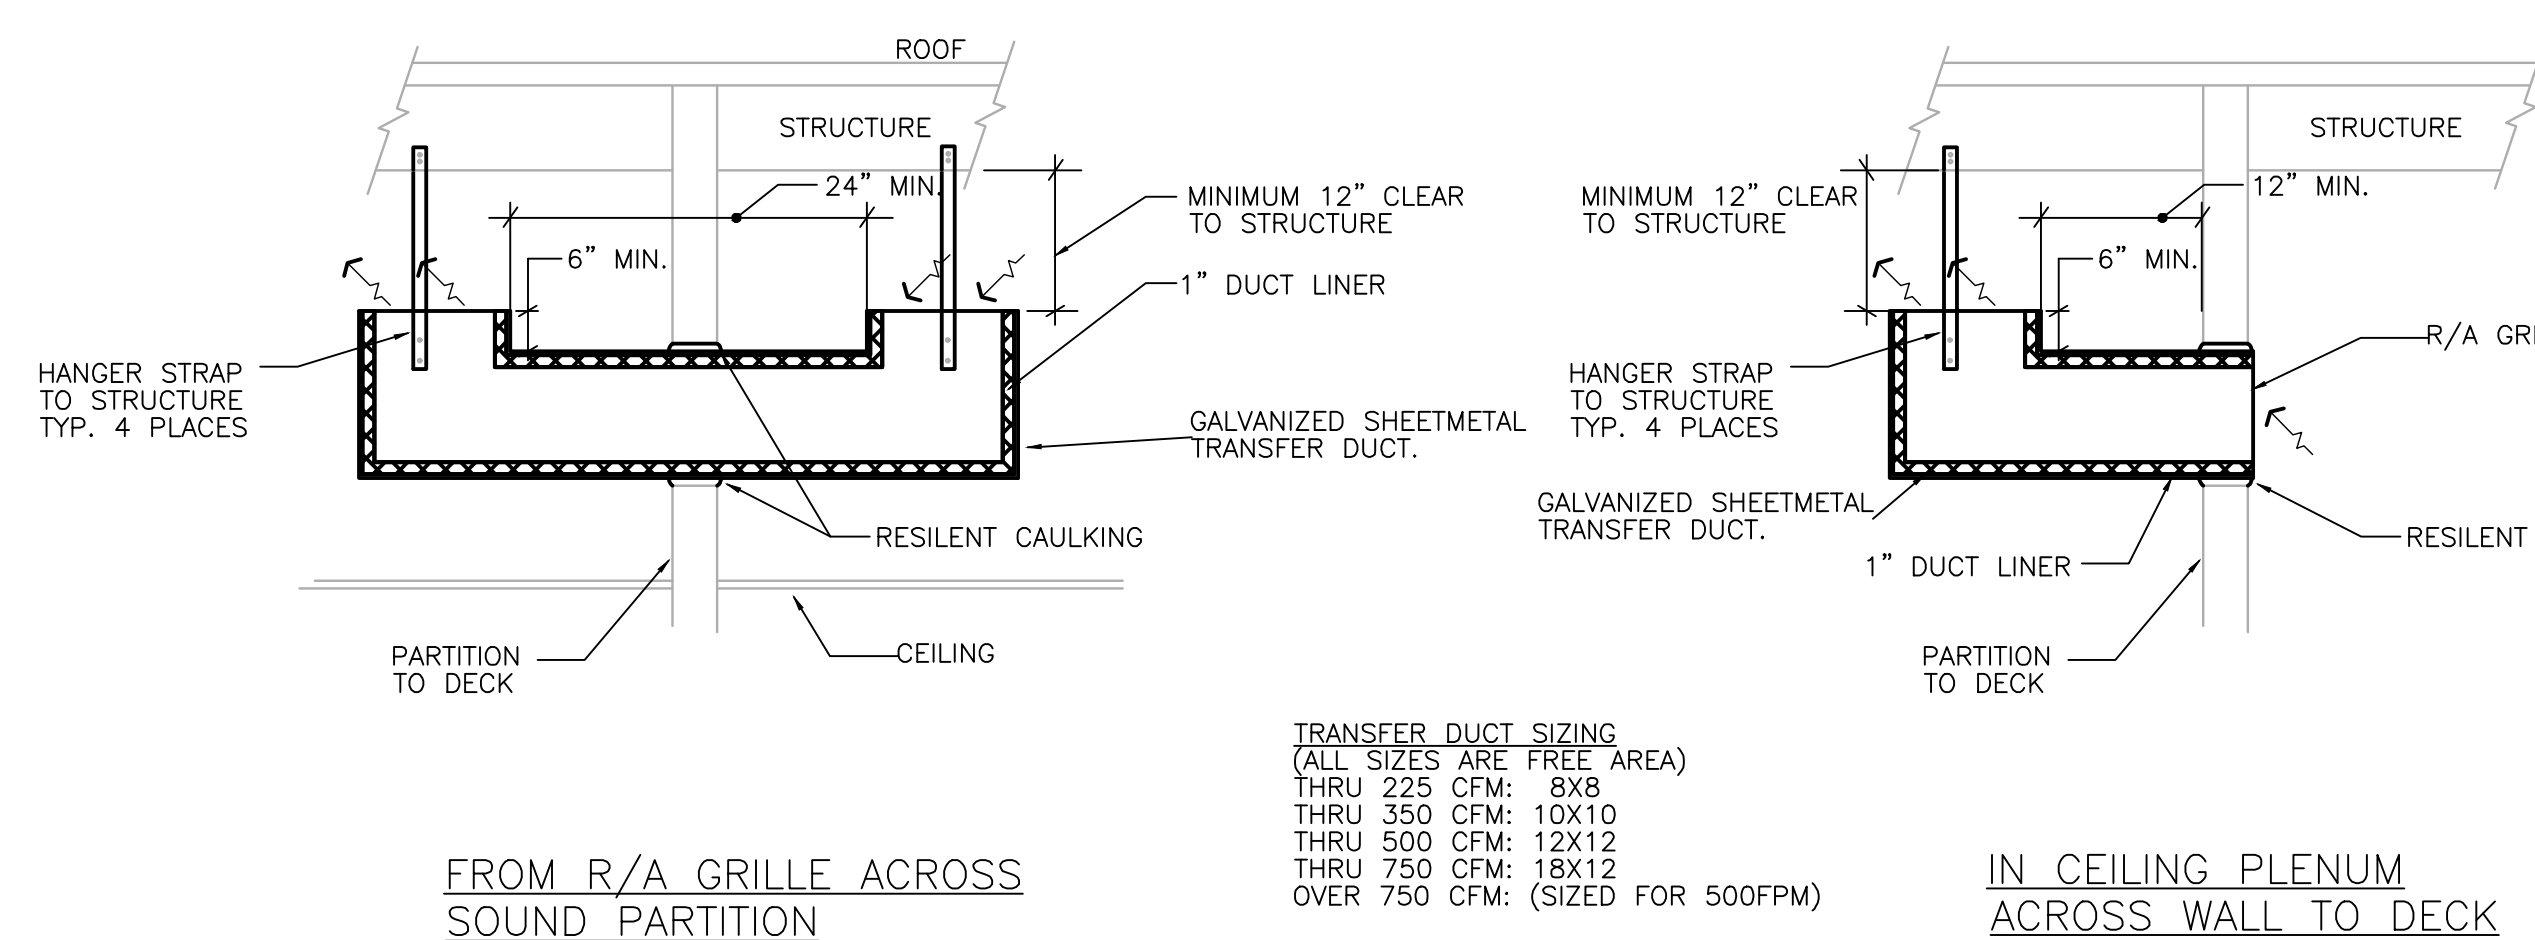


3) RA TRANSFER BOOT DETAIL
SCALE: NOT TO SCALE

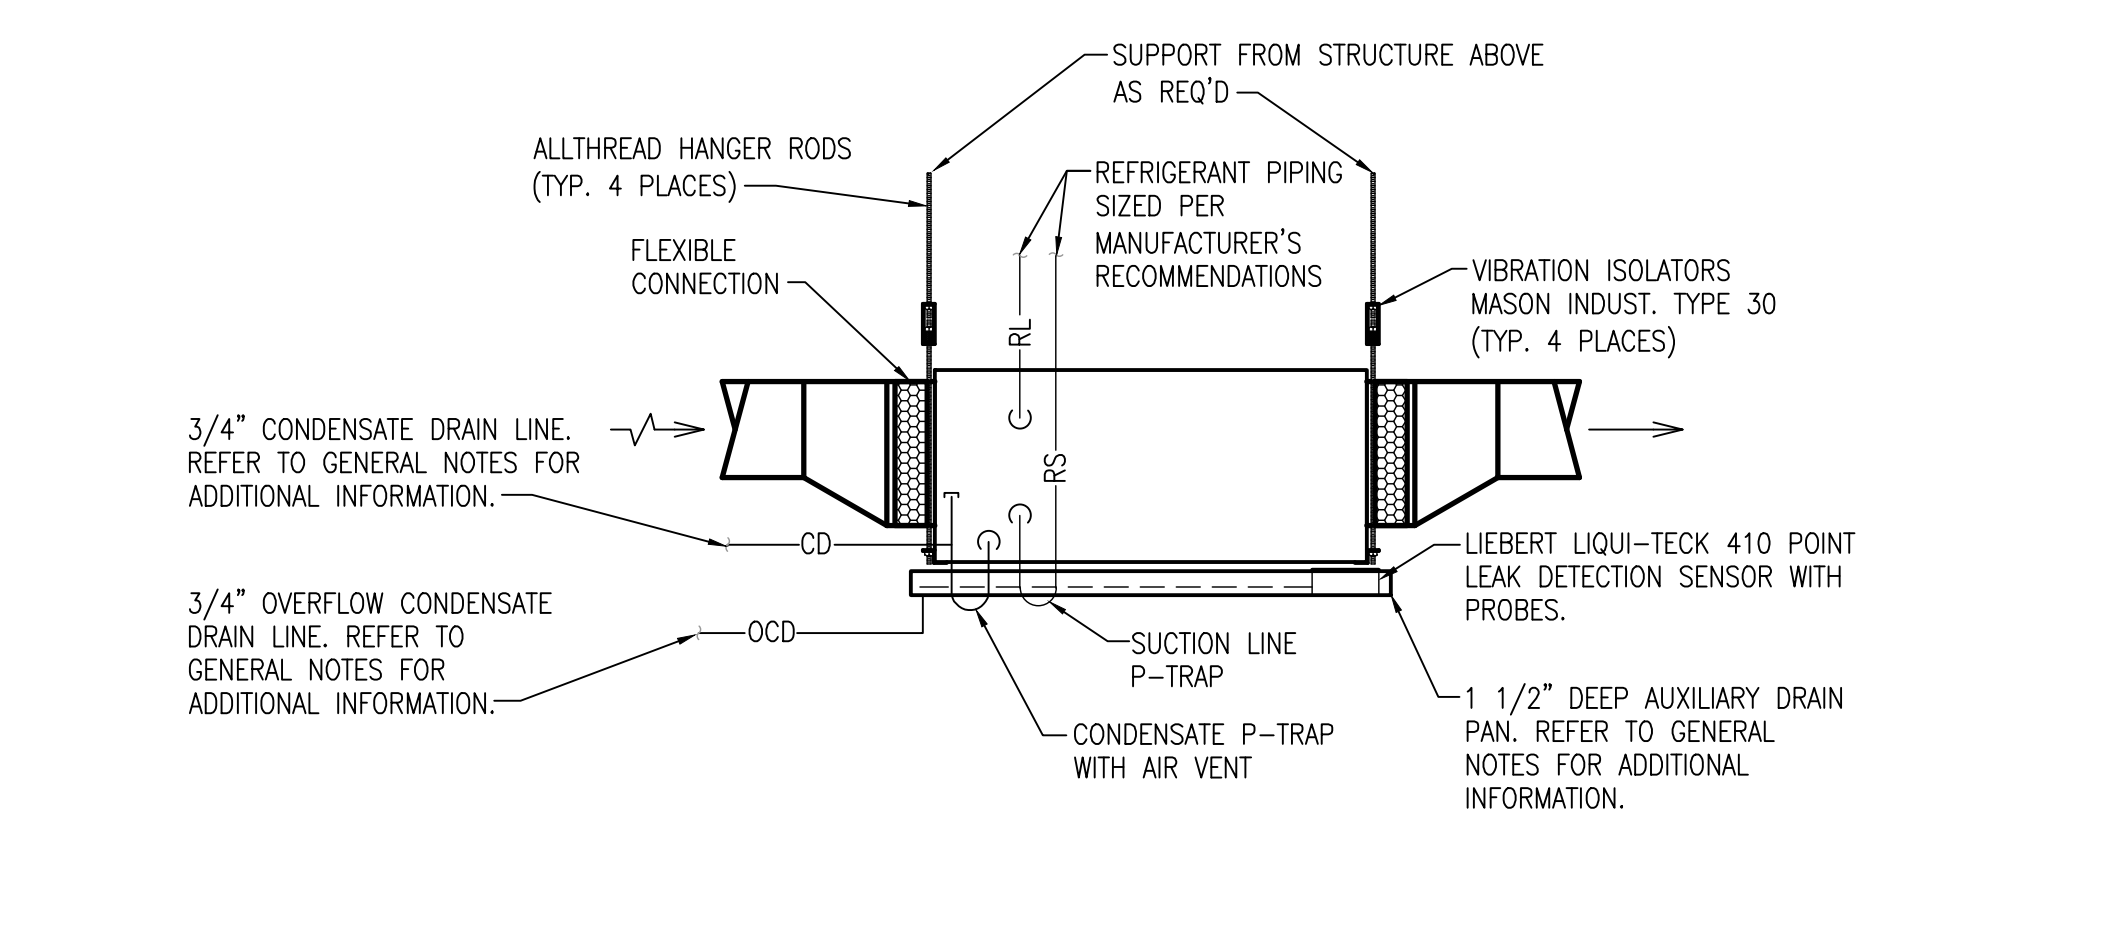


4) SUSPENDED DX CRAC UNIT INSTALLATION DETAIL
SCALE: NO SCALE

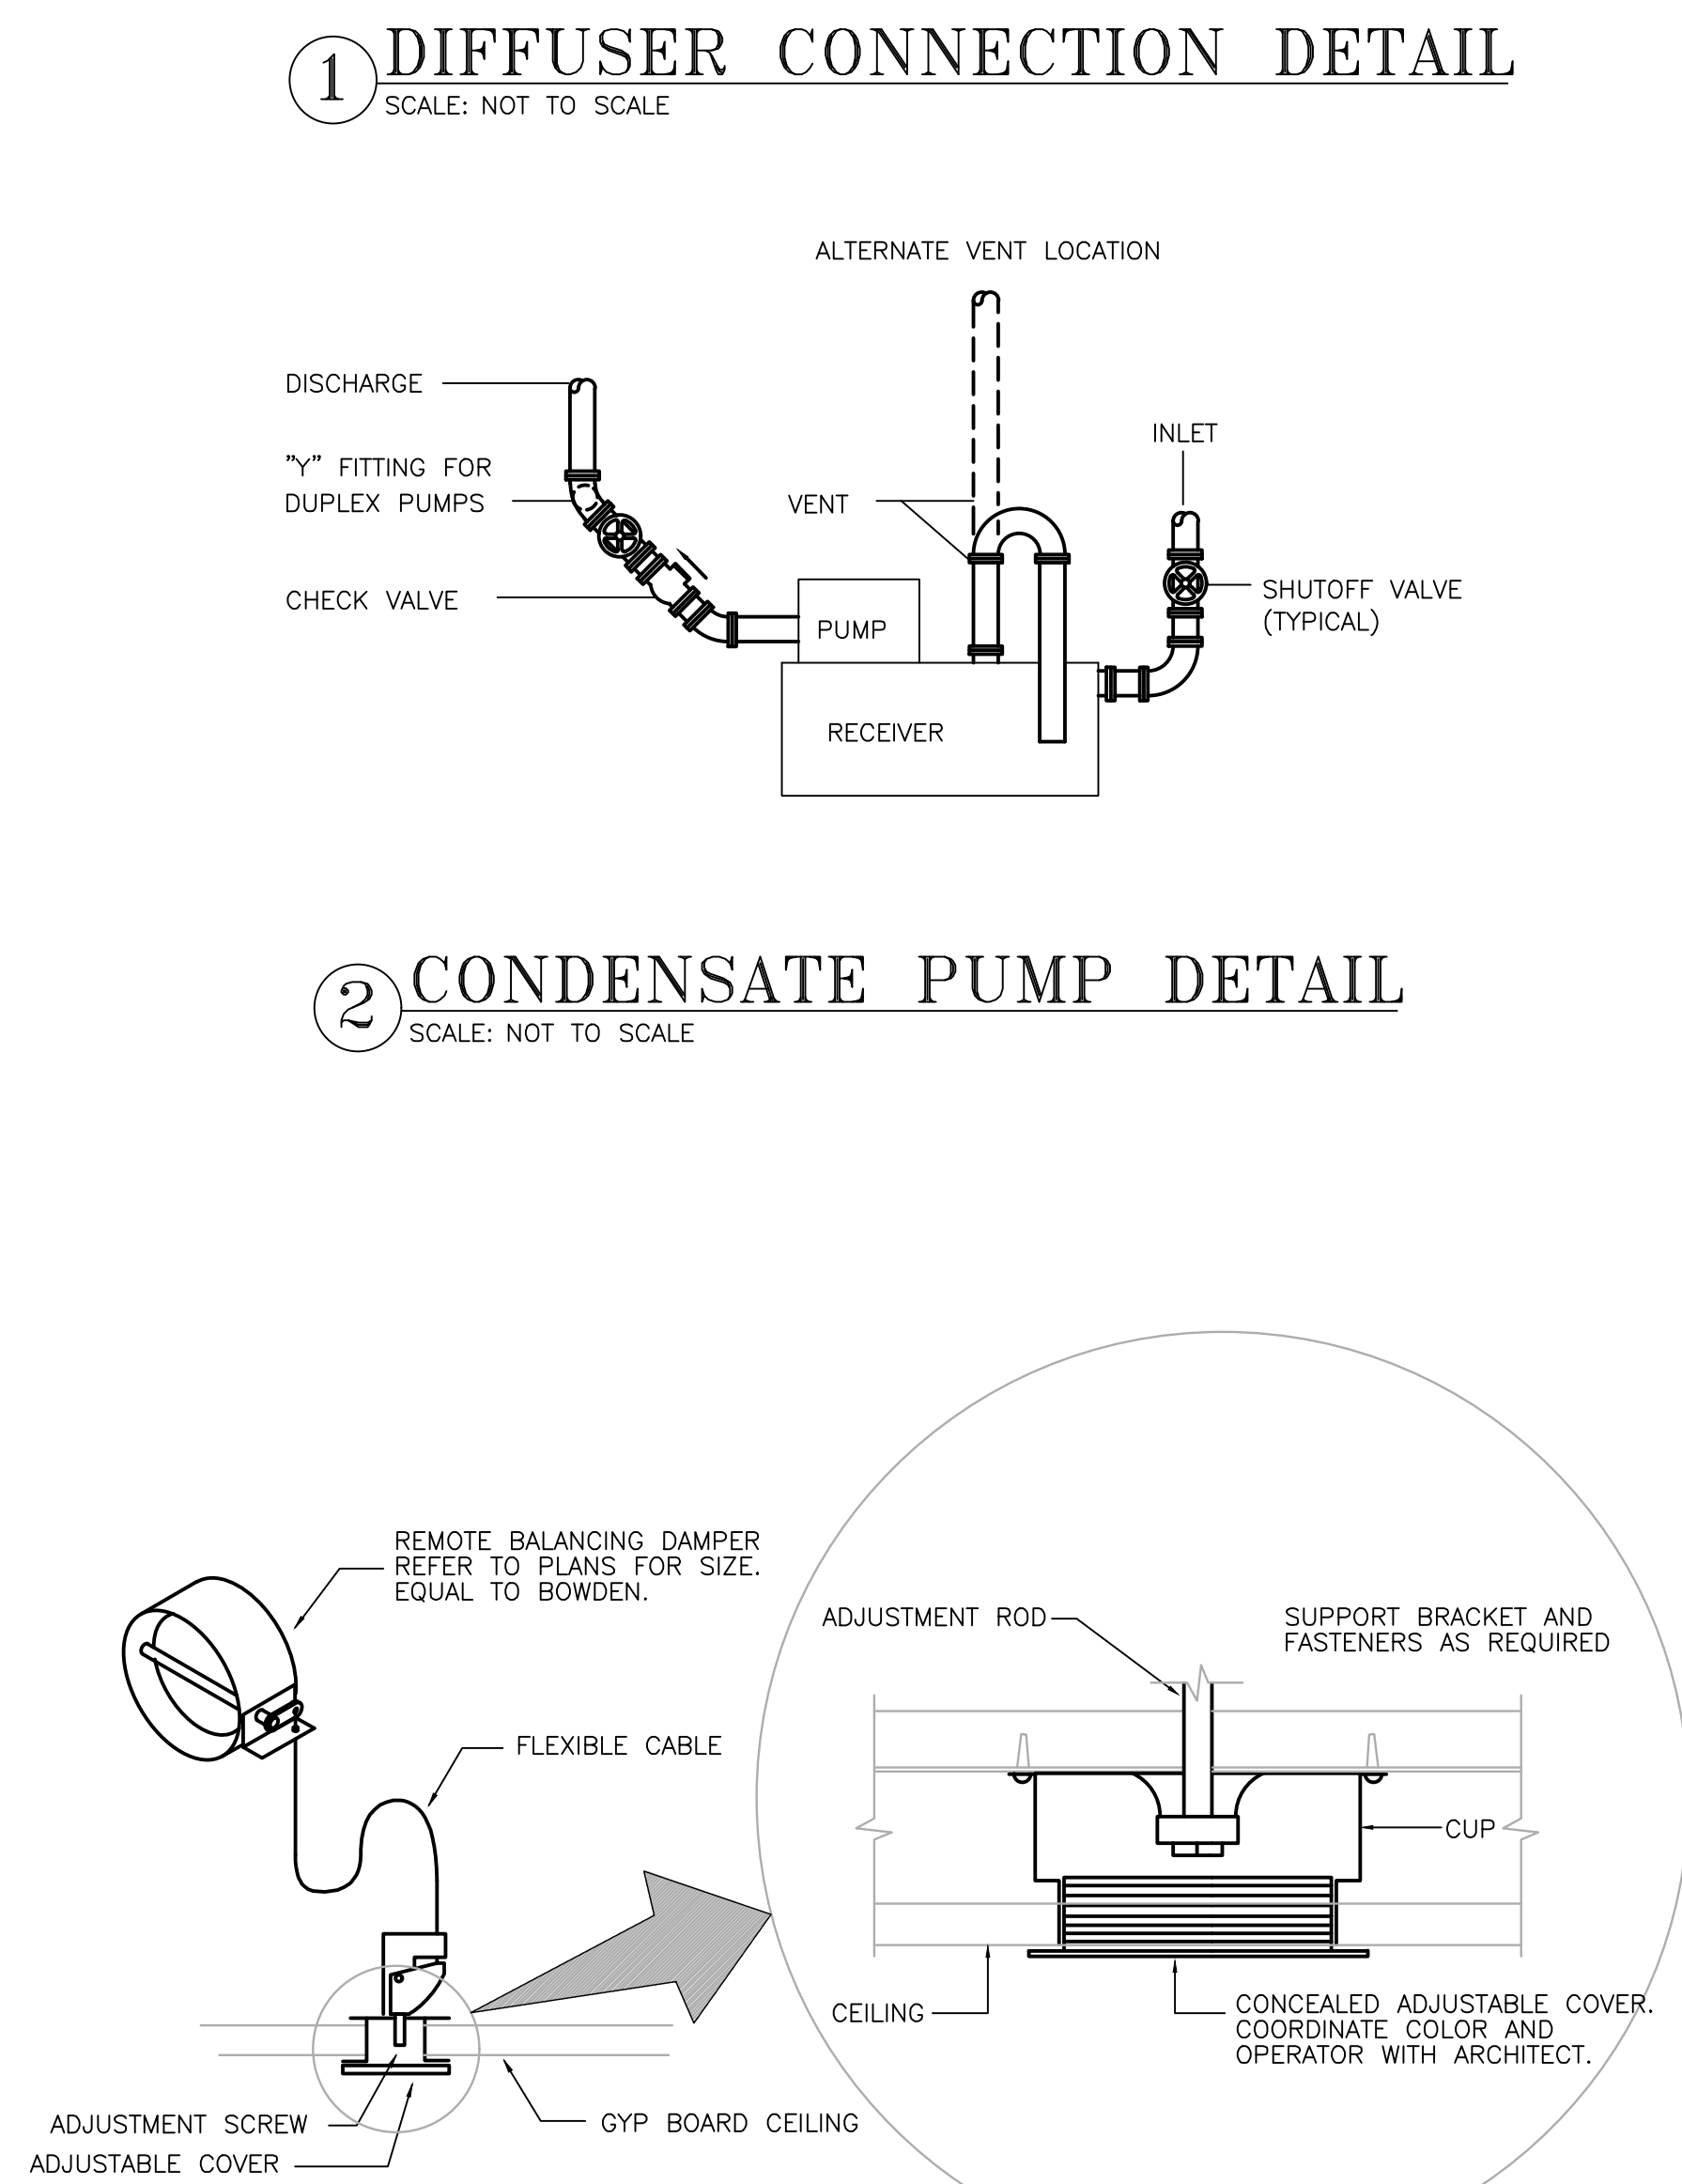

5) CONCEALED DAMPER OPERATOR DETAIL
SCALE: NO SCALE

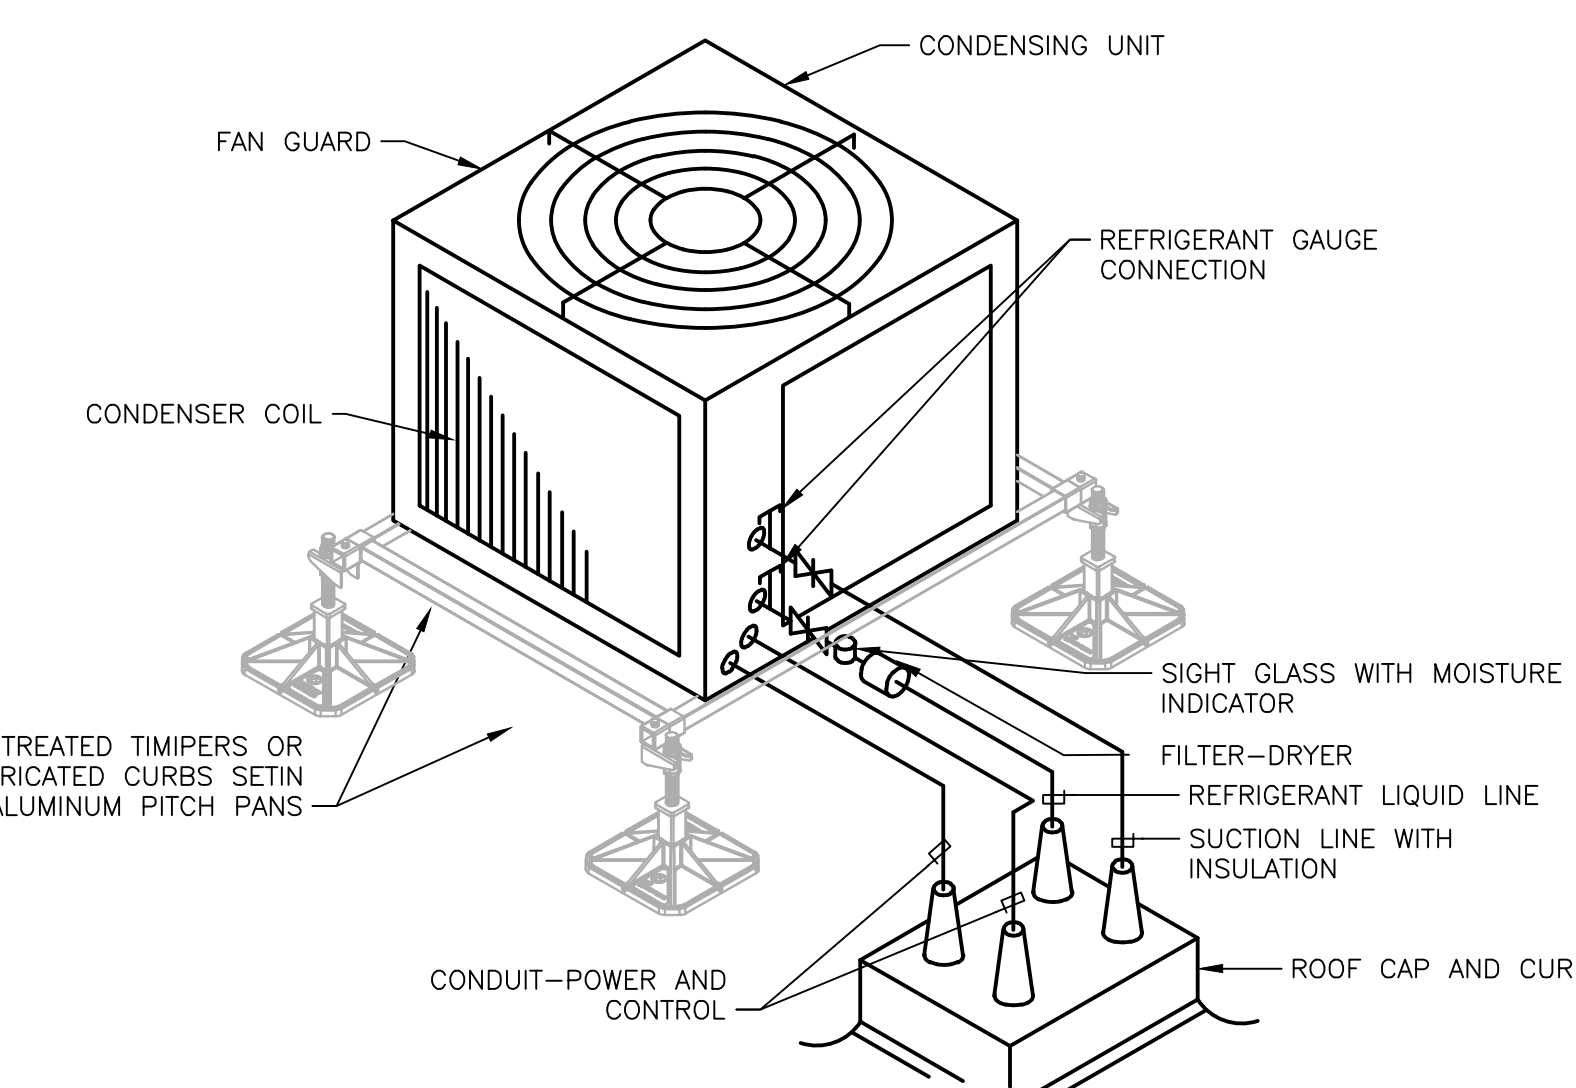

6) CONDENSING UNIT ON ROOF
SCALE: NOT TO SCALE

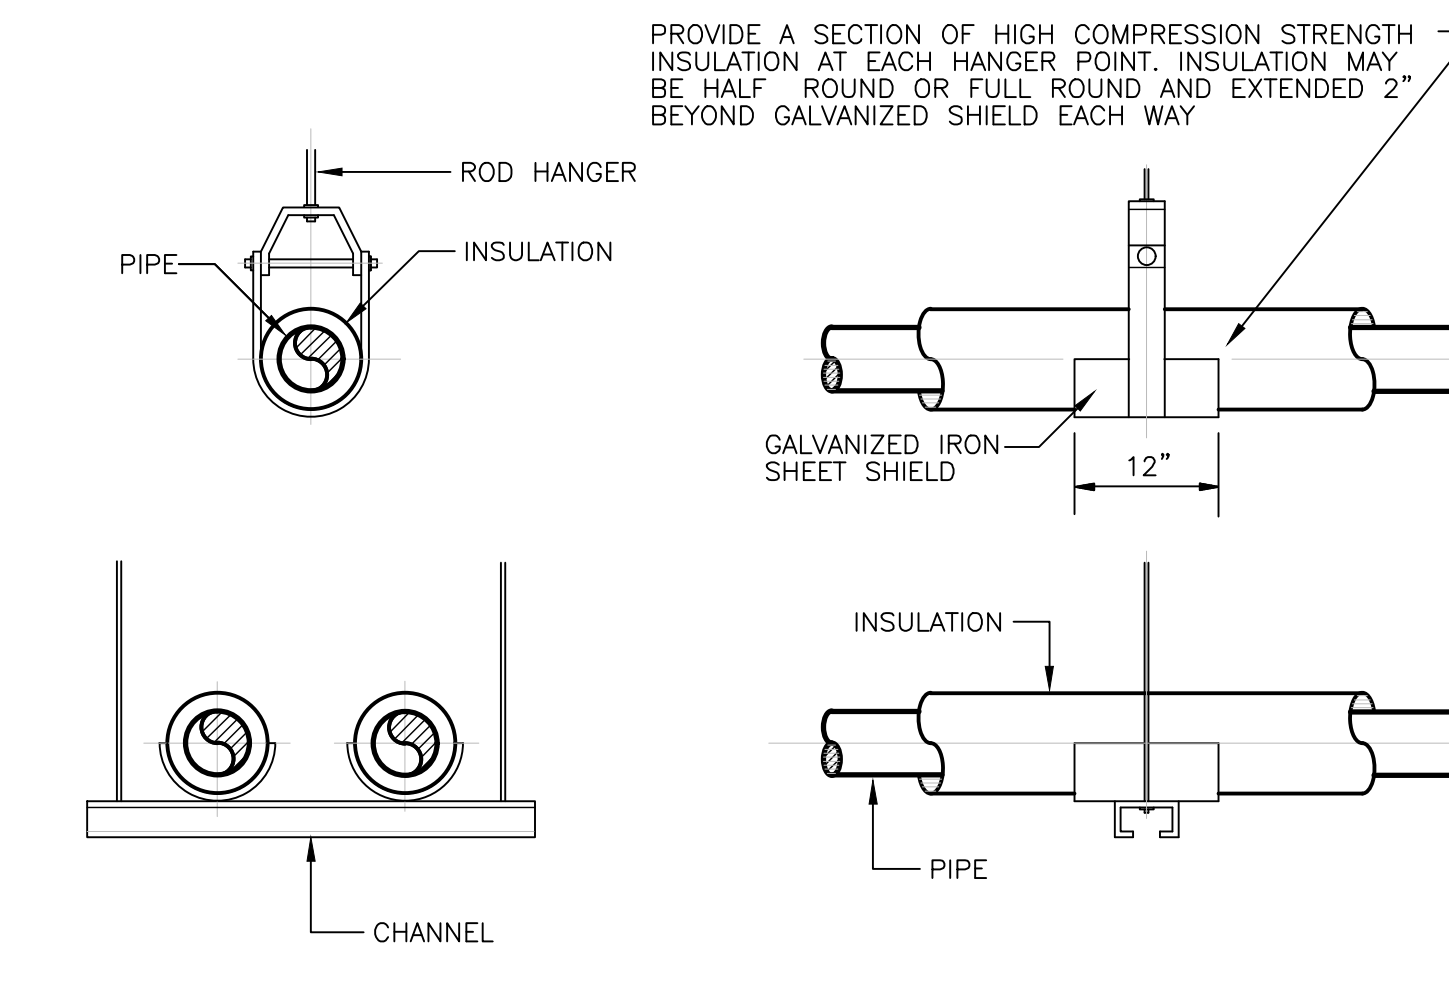

7) PIPE HANGING SUPPORT DETAILS
SCALE: NOT TO SCALE

HVAC SYMBOLS

SYMBOL	DESCRIPTION
	ARROW INDICATES EXISTING TO BE RELOCATED AS INDICATED ON PLAN
	REDISTRIBUTE AIR TO EXISTING DIFFUSER AS INDICATED ON PLAN
	INDICATES SIZE, CFM, AND DIFFUSER TYPE
	NEW CEILING SUPPLY DIFFUSER
	NEW RETURN AIR/EXHAUST GRILLE
	EXISTING RETURN AIR/EXHAUST GRILLE
	NEW SLOT DIFFUSER
	EXISTING SLOT DIFFUSER
	POINT OF CONNECTION BETWEEN NEW AND EXISTING WORK
	EXISTING TO REMAIN
	REMOVE EXISTING AS INDICATED
	CAP EXISTING DUCT
	MANUAL VOLUME CONTROL DAMPER
	DUCT TRANSITION
	FIRE (SMOKE) DAMPER (24V ACTUATOR)
	NEW OR RELOCATED THERMOSTAT
	EXISTING THERMOSTAT
	FLEXIBLE DUCT CONNECTION
	INDICATES A WALL TO DECK (FOR COORDINATION PURPOSE ONLY-REFER TO ARCHITECTS PLANS FOR REQUIREMENTS)

GENERAL NOTES:

- A. ALL WORK SHALL COMPLY WITH APPLICABLE NATIONAL, STATE AND LOCAL CODES, RULES, REGULATIONS AND REQUIREMENTS.
- B. ALL WORK SHALL COMPLY WITH THE BUILDING TENANT CONSTRUCTION GUIDE. COORDINATE WITH BUILDING MANAGEMENT/OWNER FOR ACCESS TO ANY TENANT LEASE SPACES THAT MIGHT BE REQUIRED FOR THE INSTALLATION. UNLESS DIRECTED BY LANDLORD ALL EQUIPMENT AND WORKMANSHIP SHALL BE GUARANTEED FOR 1 YEAR.
- C. EXISTING CONDITIONS ARE BASED ON INFORMATION PROVIDED BY SITE SURVEY AND PREVIOUS RECORD DRAWINGS. HOWEVER, IT IS NOT INTENDED TO BE A TRUE REPRESENTATION OF ACTUAL CONDITIONS. CONTRACTOR SHALL VISIT JOB SITE PRIOR TO BIDDING TO ASCERTAIN EXISTING CONDITIONS AND SHALL NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO BID.
- D. CONTRACTOR SHALL ENGAGE AN INDEPENDENT AIR BALANCING COMPANY TO COORDINATE WITH BUILDING MANAGEMENT/OWNER AT COMPLETION OF ANY BALANCE. BALANCING DAMPER SHALL BE TIGHTENED AND PROPERLY SEALED WITH FOIL TAPE.
- E. ALL DUCTWORK SHALL BE GALVANIZED SHEET METAL, FABRICATED, INSTALL AND SEAL. DUCTWORK FOR 1" W.G. IN ACCORDANCE WITH SMACNA STANDARDS. DUCTWORK SHALL BE INSULATED WITH 2" FIBERGLASS BLANKET WITH FOIL FACED VAPOR BARRIER TO MEET IECC REQUIREMENT (MIN RS VALUE).
- F. ALL SUPPLY AND RETURN DUCT SIZES ARE FREE AREAS.
- G. INDIVIDUAL DUCT RUN-OUTS TO EACH DIFFUSER SHALL BE SIZED IN ACCORDANCE TO THE DIFFUSER NECK SIZE FOUND IN THE GRILLES-REGISTERS-DIFFUSERS SCHEDULE UNLESS NOTED OTHERWISE.
- H. OFFSET DUCTS INTO JOIST SPACE FOR CLEARANCE WHERE SPACE ABOVE CEILING IS NOT SUFFICIENT FOR DUCTS TO CROSS OTHER DUCTS OR WORK OF OTHER TRADES.
- I. INSULATED FLEX DUCT IN THE SHALL BE UTILIZED AT INLET TO VAV BOX OR FAN POWERED BOX ONLY. LENGTH SHALL BE LIMITED TO AN OVERALL LENGTH OF TWO (2) FEET AND BE STRAIGHT RUN. INSULATED FLEX DUCT CONNECTING TO SUPPLY GRILLES SHALL BE LIMITED TO AN OVERALL LENGTH OF SIX (6) FEET WITH A MAXIMUM OF A 90 DEGREE CHANGE IN DIRECTION. SUPPORTS SHALL BE SADDLE BANDS TO STRUCTURE. SUPPORTING FROM FIRE PROTECTION PIPING, ELECTRICAL CONDUIT OR CEILING SUPPORT WIRES IS NOT ACCEPTABLE.
- J. VAV BOXES AND FAN POWERED BOXES SHALL HAVE 24" MINIMUM CLEARANCE ON ALL SIDES OF BOX.
- K. ALL ENCLOSED ROOMS (INTERIOR AND PERIMETER) SHALL HAVE RETURN AIR PATH. ROOMS WITH ALL WALLS WITH DECK SHALL HAVE LINED SHEET METAL RETURN AIR BOOTHS LOCATED IN WALL ABOVE FLOOR DRAIN IN MECHANICAL ROOM OR MOP SINK. GALVANIZED SHEET METAL SECONDARY DRAIN PANS SHALL HAVE LEAK DETECTION TAPE IN PAN AND ROUTE THE PAN'S INSULATED CONDENSATE DRAIN LINE SLOPED 1/8"/FT NEXT TO BUT INDEPENDENT OF PRIMARY DRAIN LINES.
- L. PIPES AND DUCTS TO BE COORDINATED ON JOB WITH BUILDING STRUCTURE AND WORK OF OTHER CONTRACTORS. ROUTE AS HIGH AS PHYSICALLY POSSIBLE.
- M. COORDINATE CEILING DIFFUSERS AND GRILLES WITH LIGHTING FIXTURES. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN.
- N. THERMOSTATS TO BE MOUNTED 48" ABOVE FINISHED FLOOR LEVEL UNLESS NOTED OTHERWISE ON THE PLANS. CONTRACTOR SHALL COORDINATE LOCATION OF THERMOSTATS WITH ARCHITECT IN FIELD.
- O. REPAIR AND PATCH CONSTRUCTION DAMAGED DUE TO THE DEMOLITION OF THIS PROJECT, USING SAME METHODS AND MATERIALS TO MATCH EXISTING.
- P. EVAPORATORS SHALL HAVE A PRIMARY INSULATED CONDENSATE DRAIN LINE SLOPED 1/8"/FT, EXTENDED TO NEAREST FLOOR DRAIN IN MECHANICAL ROOM OR MOP SINK. GALVANIZED SHEET METAL SECONDARY DRAIN PANS SHALL HAVE LEAK DETECTION TAPE IN PAN AND ROUTE THE PAN'S INSULATED CONDENSATE DRAIN LINE SLOPED 1/8"/FT NEXT TO BUT INDEPENDENT OF PRIMARY DRAIN LINES.
- Q. COMPUTER GRADE AC UNITS AND WATER SOURCE HEAT PUMPS SHALL HAVE TWO (2) SETS OF 2" PLEATED FILTERS. FIRST SET FOR DURING CONSTRUCTION, SECOND SET AT MOVE-IN.
- R. PROVIDE TEMPORARY HIGH EFFICIENCY FILTER MEDIA ON MAIN RETURN AIR AND EXHAUST FROM FLOOR AT BEGINNING OF PROJECT AND REPLACED AT TWO (2) WEEK INTERVALS UNTIL PROJECT COMPLETION AT WHICH TIME THE FILTER MEDIA SHALL BE REMOVED.
- S. FLEXIBLE DUCTS SHALL BE SIMILAR AND EQUAL TO THERMOFLEX. TYPE M-KE. FLEXIBLE DUCTS SHALL COMPLY WITH APPLICABLE REQUIREMENTS OF UL-181, NFPA 90-A AND OTHER COVERING AUTHORITIES.
- T. FLEXIBLE DUCT BETWEEN DUCT AND AC UNITS AND EXHAUST FANS SHALL BE EQUAL TO VENTFABRICS "VENTGLAS".
- U. AIR CONDITIONING COOLING CONDENSATE PIPING TO BE ONE-HALF INCH THICK ARMAFLEX. FITTINGS SHALL BE PRE-MOLDED OF THE SAME MATERIAL. INSTALLATION SHALL BE IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.
- V. DUCTLINER SHALL BE 1-INCH ACOUSTICAL DUCT LINING IN ACCORDANCE WITH SMACNA STANDARDS. DUCT LINING SHALL BE OWENS-CORNING FIBERGLAS "AEROFLEX" NO. 200 OR EQUAL.
- W. ALL EXISTING DUCTWORK SHALL BE FIELD VERIFIED TO BE INSULATED AND IN GOOD CONDITION, ANY TORN, DAMAGED OR MISSING INSULATION WILL BE REPLACED. EXISTING CONTROLS SHALL BE CONFIRMED TO BE IN WORKING CONDITION.
- X. CONTROL CONTRACTOR SHALL PROVIDE 24V TRANSFORMER FOR UP TO 5 VAV BOXES SERVED FROM 120V J-BOX. PROVIDE CONTROL WIRE TO EACH VAV BOX.



2641 IRVING BLVD.
DALLAS, TEXAS 75207
TEL: 214-538-4600

ARCHITECT/ENGINEER

© 2023 Purdy - McGuire
Mechanical, Electrical Engineers
11200 Dallas Parkway
Suite 3000
Dallas, Texas 75248-1147
Firm Registration # F-1511
Tel: 972-239-5357
Fax: 972-239-5231
www.purdy-mcguire.com

PM/JOB NO. 24079.001
PROJECT MGR. TODD JOHNSON

THIS DRAWING SHALL NOT BE REPRODUCED FOR ANY PROJECT OTHER THAN THE PROJECT NOTED IN THE TITLE BLOCK WITHOUT THE WRITTEN CONSENT OF PURDY-MCGUIRE, INC., DALLAS, TX

SEALED

STATE OF TEXAS
TODD JOHNSON
Professional Engineer
No. 88955
Mechanical
9/23/24

PROJECT NUMBER: 51-018
DRAWN BY: MBRR
CHECKED BY: KS
R.S.P. 14.88

BILLINGSLEY COMPANY

INTERNATIONAL BUSINESS PARK
6111 W. PLANO PARKWAY PLANO, TX 75093

HPA

INTERNATIONAL BUSINESS PARK
6111 W. PLANO PARKWAY PLANO, TX 75093

6111 W. PLANO PARKWAY
SUITE #1XXX
PLANO, TX 75093

NO.	REVISIONS	DATE

CLIENT/LANDLORD ISSUE DATE: 09/26/2024
 BID ISSUE DATE: 09/26/2024
 PERMIT ISSUE DATE: 09/26/2024
 CONSTRUCTION ISSUE DATE: 09/26/2024


DRAWING TITLE:
MECHANICAL NOTES & SYMBOLS

DRAWING NUMBER:

M0.01



ARCHITECT/ENGINEER

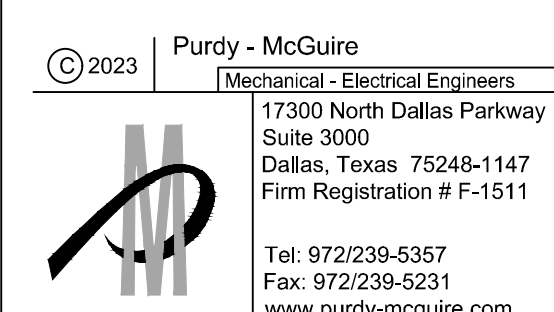

PM/JOB NO.: 24079.001
PROJECT MGR.: TODD JOHNSON
THIS DRAWING SHALL NOT BE REPRODUCED FOR ANY PROJECT OTHER THAN THE PROJECT NOTED IN THE TITLE BLOCK, WITHOUT THE WRITTEN CONSENT OF PURDY/MCGUIRE, INC., DALLAS, TX.

SEAL



PROJECT NUMBER: 51-018
DRAWN BY: MBWR
CHECKED BY: KS
P.L.P.: 14.88



INTERNATIONAL BUSINESS PARK
6111 W. PLANO PARKWAY PLANO, TX 75093
HPA

6111 W. PLANO PARKWAY
SUITE #1XXX
PLANO, TX 75093

NO.	REVISIONS	DATE

CLIENT/LANDLORD ISSUE DATE: 09/28/2024
RD ISSUE DATE: 09/29/2024
PERMIT ISSUE DATE: 09/29/2024
CONSTRUCTION ISSUE DATE: 09/29/2024

DRAWING TITLE:
MECHANICAL SPECIFICATIONS

DRAWING NUMBER:

M1.01

DIVISION 23 - HEATING VENTILATING AND AIR CONDITIONING

SECTION 230900 - COMMON WORK RESULTS

PART 1 - GENERAL

- 1.1 GENERAL NOTES AND SCOPE OF WORK
A. REFER TO SECTION 230500 FOR INFORMATION RELATED TO HVAC GENERAL CONDITIONS, MISCELLANEOUS EQUIPMENT AND MATERIALS, AND CONSTRUCTION REQUIREMENTS.
1.2 RELATED SECTIONS
A. SECTIONS 230521, 230528, 230533 AND 230700 ARE APPLICABLE BUT THEY DO NOT APPEAR IN THESE DIVISION 23 SPECIFICATIONS. REFER TO GENERAL NOTES.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION (NOT USED)

END OF SECTION

SECTION 230448 - VIBRATION CONTROLS

PART 1 - GENERAL

- 1.1 SCOPE OF WORK
A. REFER TO SECTION 230500.
PART 2 - PRODUCTS
2.1 GENERAL
A. CONCEALED DUCTWORK SHALL BE CONSTRUCTED OF NEW, PRIME GRADE, CONTINUOUS HOT-DIP MILL GALVANIZED, LOCK-FORMING, QUALITY STEEL. REFER TO SMACNA HVAC DUCT CONSTRUCTION STANDARDS.
B. WHERE DUCTS EXPOSED TO VIEW PASS THROUGH WALLS, FLOORS OR CEILINGS, PROVIDE SHEET METAL COLLARS TO COVER VOIDS AROUND THE DUCTS.
C. SQUARE AND ROUND ELBOWS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE SMACNA STANDARDS. ELBOWS NOT CONSTRUCTED WITH A CENTERLINE RADIUS OF AT LEAST 50 PERCENT OF THE DUCT WIDTH OR DIAMETER SHALL BE PROVIDED WITH TURNING VANES IN ACCORDANCE WITH SMACNA STANDARDS.
D. "FIBERBOARD" DUCTWORK WILL NOT BE ACCEPTED ON THIS PROJECT.
2.2 MEDIUM PRESSURE DUCT CONSTRUCTION
A. UNLESS NOTED OTHERWISE, MEDIUM PRESSURE DUCTS SHALL BE CONSTRUCTED TO A PRESSURIZATION CLASSIFICATION OF THREE (3) INCHES WG POSITIVE.
B. ALL ROUND MEDIUM PRESSURE DUCTS SHALL BE SPIRAL TYPE.
2.3 LOW PRESSURE DUCT CONSTRUCTION
A. LOW PRESSURE DUCTS CONNECTING SMALL AIR HANDLING EQUIPMENT, SHALL BE CONSTRUCTED TO A PRESSURIZATION CLASSIFICATION OF TWO (2) INCHES WG, POSITIVE OR NEGATIVE AS APPROPRIATE. THESE LOW PRESSURE ROUND DUCTS SHALL BE SPIRAL TYPE.
B. DUCTWORK DOWN STREAM OF AIR TERMINAL UNITS SHALL BE CONSTRUCTED TO A PRESSURE CLASSIFICATION OF ONE (1) INCHES WG POSITIVE. THESE LOW PRESSURE ROUND DUCTS MAY BE SPIRAL OR SNAP-LOCK TYPE.
C. SHOP FABRICATED DUCTS SHALL BE CONSTRUCTED, BRACED AND REINFORCED IN ACCORDANCE WITH SMACNA STANDARDS.
2.4 DUCT SEALING
A. SEAL ALL DUCTWORK ON THE PROJECT TO SMACNA CLASSIFICATION A.
2.5 FLEXIBLE DUCTS
A. FLEXIBLE DUCTS SHALL BE SIMILAR AND EQUAL TO THERMOFLEX TYPE M-KE AND SHALL COMPLY WITH APPLICABLE REQUIREMENTS OF UL-181, NFPA 98A AND OTHER GOVERNING AUTHORITIES.
B. FLEXIBLE DUCTS SHALL BE FACTORY INSULATED WITH A NOMINAL 1 INCH THICKNESS OF FIBERGLASS INSULATION, PRODUCING A THERMAL CONDUCTANCE (C") OF 0.23. DUCTS SHALL HAVE A POSITIVE INTERIOR AIR SEAL.
PERMANENTLY BONDED TO A COATED HIGH CARBON SPRING STEEL BELT, ALL SITUATED IN AN OUTER VAPOR BARRIER OF FIBERGLASS REINFORCED FILM LAMINATE.
C. FLEXIBLE DUCTS SHALL BE RATED FOR OPERATING PRESSURE OF PLUS 6 INCHES WG THROUGH 10 INCH DIAMETER, PLUS 4 INCHES WG THROUGH 16 INCH DIAMETER AND - 2 INCHES WG FOR ALL SIZES.
A. FLEXIBLE DUCTS TO DIFFUSERS AND GRILLES SHALL BE LIMITED TO 6 FOOT LENGTHS AND A MAXIMUM OF ONE (1) 90 DEGREE CHANGE IN DIRECTION. MEDIUM PRESSURE DUCTS SERVING TERMINAL UNITS SHALL BE LIMITED TO 2 FOOT LENGTHS WITH NO ELBOWS.
2.6 FLEXIBLE DUCT FABRIC
A. PROVIDE VENT FABRICS "VENTGLAS," OR EQUAL, 30 OZ PER SQ YD, BETWEEN SHEET METAL DUCTS AND AIR HANDLING EQUIPMENT, INCLUDING ALL FANS, AND POWER TYPE VENTILATORS.
2.7 DAMPERS
A. DAMPER AND SPLITTER HARDWARE FOR LOW PRESSURE DUCTS SHALL BE:
END BEARINGS - VENTLOK #607
REGULATOR FINISHED AREAS - VENTLOK #606, PLAIN COVER
REGULATOR UNFINISHED AREAS - VENTLOK #608, 3/8 INCH
B. VOLUME DAMPERS SHALL BE LOCATED AT BRANCH TAKE-OFFS AT MAIN TRUNK DUCT. NO DAMPERS (SPLITTER DAMPERS) SHALL BE LOCATED IN THE CENTER OF DUCTS.

PART 3 - EXECUTION

- 3.1 SCHEDULE
A. EQUIPMENT PADS - SMALL FLOOR MOUNTED EQUIPMENT OR PACKAGED EQUIPMENT WITH INTERNAL ISOLATION.
B. ELASTOMERIC HANGERS - SUSPENDED AIR HANDLING UNITS, EXHAUST FANS, TERMINAL UNITS, HEAT PUMPS, PUMPS, ETC.
C. RESTRAINED SPRING ISOLATORS - FLOOR MOUNTED FANS GREATER THAN 1/2 HP.
D. ROOF CURB ISOLATORS - FACTORY FABRICATED ROOFTOP UNITS.
E. INERTIA BASES - FLOOR MOUNTED PUMPS GREATER THAN 1/2 HP.
3.2 INSTALLATION
A. INSTALL VIBRATION CONTROLS PER THE MANUFACTURER'S INSTRUCTIONS.

END OF SECTION

SECTION 230553 - IDENTIFICATION

PART 1 - GENERAL

- 1.1 SCOPE OF WORK
A. REFER TO SECTION 230500.
B. LABEL ALL NEW EQUIPMENT AND PIPING SYSTEMS.
PART 2 - PRODUCTS
2.1 PIPE LABELS
A. PRETENSION PIPE LABELS OF SEMI-RIGID PLASTIC FORMED TO COVER THE FULL CIRCUMFERENCE OF PIPE.
B. IDENTIFY THE SERVICE AND DIRECTION OF FLOW. LABELS SHALL CONTAIN AT LEAST 1/2 INCH HIGH LETTERING AND BE PLACED SO THEY ARE EASY TO READ.
2.2 EQUIPMENT LABELS
A. MULTILAYER, MULTICOLOR OR PLASTIC LABELS WITH MECHANICAL ENGRAVING AND HOLES FOR ATTACHMENT TO EQUIPMENT.

PART 3 - EXECUTION

- 3.1 PIPE LABELS
A. INSTALL PIPE LABELS WHERE PIPING IS EXPOSED OR ABOVE AN ACCESSIBLE CEILING AT MAXIMUM 20 FT. CENTERS.
3.2 VALVE TAGS
A. ATTACH TAGS TO VALVES USING CHAIN. PROVIDE A VALVE SCHEDULE FOR MOUNTING IN THE MECHANICAL ROOM.
3.3 EQUIPMENT LABELS
A. PERMANENTLY ATTACH LABELS TO EQUIPMENT. LOCATE WHERE LABEL CAN BE EASILY SEEN AND READ.

END OF SECTION

SECTION 230593 - TESTING ADJUSTING AND BALANCING

PART 1 - GENERAL

- 1.1 SCOPE OF WORK
A. THE WORK INCLUDED IN THIS SECTION CONSISTS OF FURNISHING ALL LABOR, MATERIALS, INSTRUMENTS, TOOLS, AND SERVICES REQUIRED IN CONNECTION WITH THE TESTING, ADJUSTING AND BALANCING (TAB) OF THE HEATING, VENTILATING AND AIR CONDITIONING (HVAC) SYSTEMS AS DESCRIBED IN THE MECHANICAL SPECIFICATIONS AND/OR SHOWN ON THE MECHANICAL PLANS, OR REASONABLY IMPLIED THEREFROM.
B. THE TAB FIRM SHALL HAVE A LICENSED PROFESSIONAL ENGINEER SUPERVISING ALL WORK AND THE FIRM SHALL HOLD A CURRENT AABC OR NEBB CERTIFICATION.
C. REFER TO SECTION 230500.
1.2 START-UP, TEST AND ADJUST
A. PROVIDE ALL TESTS OF EQUIPMENT AND SYSTEMS REQUIRED TO PROVE COMPLIANCE WITH THE DRAWINGS AND SPECIFICATIONS. OWNER SHALL BE MADE COMPLETELY FAMILIAR WITH THE COMPLETE WORKING OF ALL THE MECHANICAL SYSTEMS.
B. THE TESTS SHALL DEMONSTRATE THE SPECIFIED CAPACITIES AND OPERATION OF ALL EQUIPMENT AND MATERIALS COMPRISING THE SYSTEMS. ALL DATA REQUIRED BY THESE SPECIFICATIONS SHALL BE PREPARED ON TYPED FORMS AND SUBMITTED TO THE ENGINEER FOR APPROVAL. COMPLETE APPROVAL WILL BE NECESSARY BEFORE FINAL PAYMENT CAN BE MADE. THE CONTRACTOR SHALL THEN MAKE AVAILABLE SUCH INSTRUMENTS NECESSARY FOR SPOT CHECKS ON THE SYSTEM.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

- 3.1 HVAC SYSTEM
A. THE HVAC CONTRACTOR SHALL WORK IN CONJUNCTION WITH THE TAB CONTRACTOR TO START-UP AND OPERATE ALL EQUIPMENT NECESSARY TO PROVIDE A COMPLETE AIR AND WATER TEST AND BALANCE REPORT.
B. TAB CONTRACTOR SHALL MEASURE CFM AT ALL DIFFUSERS, REGISTERS AND GRILLES, AND HVAC UNITS, AS WELL AS WATER FLOWS AT COILS AND PUMPS, TO ASSURE THAT THEY MATCH THE QUANTITIES SHOWN ON THE PLANS (PLUS OR MINUS 5 PERCENT). CONFIRM ALL SEQUENCES OF OPERATION ARE PERFORMING CORRECTLY.
C. TAB CONTRACTOR SHALL CALIBRATE ALL EQUIPMENT, AND SENSORS TO WORK PROPERLY, AND GIVE CORRECT INFORMATION TO THE BMS SYSTEM.

END OF SECTION

SECTION 230900 - CONTROLS

PART 1 - GENERAL

- 1.1 SCOPE OF WORK
A. REFER TO SECTION 230500.
PART 2 - PRODUCTS
2.1 CONTROLS SYSTEM
A. PROVIDE NEW, MODIFY OR EXTEND AUTOMATIC TEMPERATURE CONTROLS TO ALL NEW EQUIPMENT SHOWN ON THE DRAWINGS.
B. REFER TO THE DRAWINGS FOR ANY SPECIAL SEQUENCES OF CONTROL AND LOCATION OF EQUIPMENT.
C. REMODEL PROJECTS SHALL UTILIZE EQUIPMENT BY THE SAME MANUFACTURER AS CURRENTLY EXISTS.

PART - EXECUTION

- 3.1 DESIGN AND LAYOUT
A. THE CONTROL SYSTEM DESIGN AND LAYOUT SHALL BE PERFORMED BY A FACTORY AUTHORIZED AGENT OF THE MANUFACTURER USED.
1.2 SYSTEM OPERATION
A. AT THE CONCLUSION OF WORK, ALL EQUIPMENT AND SYSTEMS SHALL BE PROVEN TO THE ENGINEER TO OPERATE IN ACCORDANCE WITH THE NEW OR EXISTING MAIN CONTROL PANEL AND NEW EXISTING SEQUENCES OF OPERATION ON THE DRAWINGS.
B. PROVIDE ALL WIRING REQUIRED TO CONNECT INPUT/OUTPUT DEVICES TO CONTROL PANELS.
C. TEST AND ADJUST ALL DEVICES AND DOCUMENT CALIBRATION.
D. PROVIDE NECESSARY INSTRUCTION TO THE OWNER'S PERSONNEL.

END OF SECTION

SECTION 232900 - REFRIGERANT PIPING

PART 1 - GENERAL

- 1.1 SCOPE OF WORK
A. REFER TO SECTION 230500.
PART 2 - PRODUCTS
2.1 COPPER PIPE
A. PIPING SHALL BE COPPER TYPE ACR WITH WROUGHT COPPER FITTINGS AND BRAZED JOINTS.

PART 3 - EXECUTION

- 3.1 INSTALLATION
A. REFER TO SECTION 230529 FOR METHODS OF SUPPORTING ALL PIPING.

END OF SECTION

SECTION 231111 - DUCTWORK

PART 1 - GENERAL

- 1.1 SCOPE OF WORK
A. REFER TO SECTION 230500.
PART 2 - PRODUCTS
2.1 GENERAL
A. CONCEALED DUCTWORK SHALL BE CONSTRUCTED OF NEW, PRIME GRADE, CONTINUOUS HOT-DIP MILL GALVANIZED, LOCK-FORMING, QUALITY STEEL. REFER TO SMACNA HVAC DUCT CONSTRUCTION STANDARDS.
B. WHERE DUCTS EXPOSED TO VIEW PASS THROUGH WALLS, FLOORS OR CEILINGS, PROVIDE SHEET METAL COLLARS TO COVER VOIDS AROUND THE DUCTS.
C. SQUARE AND ROUND ELBOWS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE SMACNA STANDARDS. ELBOWS NOT CONSTRUCTED WITH A CENTERLINE RADIUS OF AT LEAST 50 PERCENT OF THE DUCT WIDTH OR DIAMETER SHALL BE PROVIDED WITH TURNING VANES IN ACCORDANCE WITH SMACNA STANDARDS.
D. "FIBERBOARD" DUCTWORK WILL NOT BE ACCEPTED ON THIS PROJECT.
2.2 MEDIUM PRESSURE DUCT CONSTRUCTION
A. UNLESS NOTED OTHERWISE, MEDIUM PRESSURE DUCTS SHALL BE CONSTRUCTED TO A PRESSURIZATION CLASSIFICATION OF THREE (3) INCHES WG POSITIVE.
B. ALL ROUND MEDIUM PRESSURE DUCTS SHALL BE SPIRAL TYPE.
2.3 LOW PRESSURE DUCT CONSTRUCTION
A. LOW PRESSURE DUCTS CONNECTING SMALL AIR HANDLING EQUIPMENT, SHALL BE CONSTRUCTED TO A PRESSURIZATION CLASSIFICATION OF TWO (2) INCHES WG, POSITIVE OR NEGATIVE AS APPROPRIATE. THESE LOW PRESSURE ROUND DUCTS SHALL BE SPIRAL TYPE.
B. DUCTWORK DOWN STREAM OF AIR TERMINAL UNITS SHALL BE CONSTRUCTED TO A PRESSURE CLASSIFICATION OF ONE (1) INCHES WG POSITIVE. THESE LOW PRESSURE ROUND DUCTS MAY BE SPIRAL OR SNAP-LOCK TYPE.
C. SHOP FABRICATED DUCTS SHALL BE CONSTRUCTED, BRACED AND REINFORCED IN ACCORDANCE WITH SMACNA STANDARDS.
2.4 DUCT SEALING
A. SEAL ALL DUCTWORK ON THE PROJECT TO SMACNA CLASSIFICATION A.
2.5 FLEXIBLE DUCTS
A. FLEXIBLE DUCTS SHALL BE SIMILAR AND EQUAL TO THERMOFLEX TYPE M-KE AND SHALL COMPLY WITH APPLICABLE REQUIREMENTS OF UL-181, NFPA 98A AND OTHER GOVERNING AUTHORITIES.
B. FLEXIBLE DUCTS SHALL BE FACTORY INSULATED WITH A NOMINAL 1 INCH THICKNESS OF FIBERGLASS INSULATION, PRODUCING A THERMAL CONDUCTANCE (C") OF 0.23. DUCTS SHALL HAVE A POSITIVE INTERIOR AIR SEAL.
PERMANENTLY BONDED TO A COATED HIGH CARBON SPRING STEEL BELT, ALL SITUATED IN AN OUTER VAPOR BARRIER OF FIBERGLASS REINFORCED FILM LAMINATE.
C. FLEXIBLE DUCTS SHALL BE RATED FOR OPERATING PRESSURE OF PLUS 6 INCHES WG THROUGH 10 INCH DIAMETER, PLUS 4 INCHES WG THROUGH 16 INCH DIAMETER AND - 2 INCHES WG FOR ALL SIZES.
A. FLEXIBLE DUCTS TO DIFFUSERS AND GRILLES SHALL BE LIMITED TO 6 FOOT LENGTHS AND A MAXIMUM OF ONE (1) 90 DEGREE CHANGE IN DIRECTION. MEDIUM PRESSURE DUCTS SERVING TERMINAL UNITS SHALL BE LIMITED TO 2 FOOT LENGTHS WITH NO ELBOWS.
2.6 FLEXIBLE DUCT FABRIC
A. PROVIDE VENT FABRICS "VENTGLAS," OR EQUAL, 30 OZ PER SQ YD, BETWEEN SHEET METAL DUCTS AND AIR HANDLING EQUIPMENT, INCLUDING ALL FANS, AND POWER TYPE VENTILATORS.
2.7 DAMPERS
A. DAMPER AND SPLITTER HARDWARE FOR LOW PRESSURE DUCTS SHALL BE:
END BEARINGS - VENTLOK #607
REGULATOR FINISHED AREAS - VENTLOK #606, PLAIN COVER
REGULATOR UNFINISHED AREAS - VENTLOK #608, 3/8 INCH
B. VOLUME DAMPERS SHALL BE LOCATED AT BRANCH TAKE-OFFS AT MAIN TRUNK DUCT. NO DAMPERS (SPLITTER DAMPERS) SHALL BE LOCATED IN THE CENTER OF DUCTS.

PART 3 - EXECUTION

- 3.1 FABRICATION
A. DUCTWORK SHOWN ON THE DRAWINGS, SPECIFIED, OR REQUIRED FOR HEATING, VENTILATING AND AIR CONDITIONING SYSTEMS SHALL BE CONSTRUCTED AND ERECTED IN A FIRST CLASS MANNER.
B. DUCTS SHALL BE REINFORCED IN ACCORDANCE WITH THE APPROPRIATE SMACNA STANDARDS TO PREVENT BUCKLING, BREATHING, VIBRATION AND UNNECESSARY NOISE.
C. PROVIDE MANUALLY OPERATED VOLUME CONTROL DAMPERS IN DUCT BRANCHES, FOR PROPER BALANCING OF AIR DISTRIBUTION. DAMPERS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE APPROPRIATE SMACNA STANDARDS.
D. PROVIDE HINGED ACCESS DOORS IN DUCTWORK FOR ACCESS TO ALL SMOKE DETECTORS, SENSORS, AND OTHER CONTROL DEVICES, MANUAL DAMPERS, AND FOR CLEANING OPERATIONS. FACTORY FABRICATED DOORS SIMILAR AND EQUAL TO MILCOR AND MEETING THESE SPECIFICATIONS SHALL BE ACCEPTABLE.
E. WHERE DUCTS CONNECT TO FANS, INCLUDING ROOF EXHAUSTERS PROVIDE FLEXIBLE DUCT FABRIC CONNECTIONS, PROVIDE A MINIMUM OF 1/2 INCH SLACK IN THE CONNECTIONS, AND A MINIMUM OF 2-1/2 INCH DISTANCE BETWEEN THE EDGES OF THE DUCTS, PLUS AN ADDITIONAL MINIMUM 1/2 INCH OF SLACK FOR EACH INCH OF STATIC PRESSURE ON THE FAN SYSTEM.
F. PROVIDE SCREENS ON DUCTS, FANS AND OPENINGS WHICH LEAD TO, OR ARE OUTDOORS. SCREENS SHALL BE 1/4 GAUGE, 1/2 INCH MESH, IN REMOVABLE GALVANIZED STEEL FRAMES.
G. FURNISH TEST OPENINGS WITH COVERS IN EACH DUCT FOR TAKING READINGS OF AIR VELOCITIES AND PRESSURES IN DUCTS. REFER TO THE APPROPRIATE SMACNA STANDARD FOR COVER CONSTRUCTION.

3.2 DUCT SUPPORTS

- A. HORIZONTAL AND VERTICAL SHEET METAL DUCTWORK SHALL BE SUPPORTED IN ACCORDANCE WITH THE APPROPRIATE SMACNA STANDARDS.
B. HANGER DESIGN AND METHODS OF HANGING AND SUPPORTING SHALL BE COMPATIBLE WITH THE STRUCTURE.

END OF SECTION

SECTION 231111 - DIFFUSERS, REGISTERS AND GRILLES

PART 1 - GENERAL

- 1.1 GENERAL NOTES
A. REFER TO SECTION 230500.


PART 2 - PRODUCTS

- 2.1 AIR INLETS AND OUTLETS
A. GRILLES, REGISTERS, CEILING OUTLETS, AND CEILING INLETS SHALL BE AS INDICATED ON THE DRAWING, AND SHALL BE PROVIDED WITH HEAVY DUTY SPONGE, OR SOFT FELT GASKETS. THE THROW SHALL BE SUCH THAT THE VELOCITY AT THE END OF THE THROW IN THE FIVE (5) FOOT OCCUPANCY ZONE WILL NOT BE MORE THAN 50 FPM NOT LESS THAN 25 FPM. NOISE LEVELS (NC CURVE) SHALL NOT EXCEED 40.
B. IF PRODUCTS OF A MANUFACTURER OTHER THAN THE ONES INDICATED ON THE DRAWINGS ARE USED, THE SIZES SHOWN ON THE DRAWING SHALL BE CHECKED FOR PERFORMANCE, NOISE LEVEL, FACE VELOCITY, THROW AND PRESSURE DROP BEFORE THE SUBMITTAL IS MADE. SELECTIONS SHALL MEET THE MANUFACTURER'S OWN PUBLISHED DATA FOR THE ABOVE PERFORMANCE CRITERIA. SHOULD DEVICES OTHER THAN THOSE SCHEDULED BY NAME BE FURNISHED, THE MANUFACTURER SHALL DEMONSTRATE COMPLIANCE WITH NOISE CRITERIA ON REQUEST, TO THE ARCHITECT'S SATISFACTION.
C. WHERE CALLED FOR IN SCHEDULES, THE GRILLES, REGISTERS, CEILING OUTLETS, AND CEILING INLETS SHALL BE PROVIDED WITH DEFLECTING DEVICES AND MANUAL DAMPERS. THESE SHALL BE STANDARD PRODUCTS OF THE MANUFACTURER, SUBJECT TO REVIEW BY THE ARCHITECT, AND SHALL BE SIMILAR AND EQUAL TO THOSE SCHEDULED.

PART 3 - EXECUTION

- 3.1 INSTALLATION
A. LOCATIONS OF OUTLETS SHOWN ON THE DRAWINGS ARE APPROXIMATE. COORDINATE THE EXACT LOCATION WITH REFLECTED CEILING PLAN AND OTHER TRADES.
B. VERIFY THE TYPE OF CEILING SYSTEM AND MATERIAL INTO EACH OF THE AIR INLETS AND OUTLETS IS TO BE INSTALLED, AND PROVIDE EQUIPMENT, WHICH PROPERLY "FITS" WHETHER SPECIFICALLY, SO INDICATED OR NOT ON THE DRAWINGS.

END OF SECTION




NO.	REVISIONS	DATE

CLIENT/LANDLORD ISSUE DATE:	08/20/24
BID ISSUE DATE:	09/23/24
PERMIT ISSUE DATE:	09/23/24
CONSTRUCTION ISSUE DATE:	09/23/24

RETURN AIR NOTES:

- EXISTING RETURN AIR CONDITIONS ARE BASED ON INFORMATION PROVIDED BY SITE SURVEY AND PREVIOUS RECORD DRAWINGS. HOWEVER, IT IS NOT INTENDED TO BE A TRUE REPRESENTATION OF ACTUAL RETURN AIR CONDITIONS. CONTRACTOR SHALL ENSURE A CLEAR UNOBSTRUCTED PATH BACK TO MAIN RETURN AIR IN MECHANICAL ROOM AND MAKE ALL REQUIRED MODIFICATIONS AS NEEDED TO ENSURE CLEAR RETURN AIR PATH.
- WALLS TO DECK INDICATED ON THESE DRAWINGS ARE BASED ON OUR UNDERSTANDING OF ARCHITECTURAL PLANS. COORDINATE ALL WALLS TO DECK WITH ARCHITECT AND INFORM THE ARCHITECT OF ANY DIFFERENCES WITH THIS PLAN PRIOR TO BIDDING. ANY ADDITIONAL BOOTS REQUIRED SHALL BE SIZED AT 500 FPM.
- ALL CUTTING AND CHANNELING OF EXISTING BUILDING SHALL BE ACCOMPLISHED IN A NEAT AND WORKMANLIKE MANNER WITHOUT REMOVAL OF EXCESS MATERIALS. THIS CONTRACTOR SHALL PATCH AND REPLACE WITH MATERIAL SIMILAR TO ADJACENT CONSTRUCTION. ALL BOOTS SHALL BE SEALED AT THE WALL PENETRATION.
- ALL WORK MUST BE COORDINATED AND SCHEDULED WITH THE OWNER AND OCCUPANTS OF THIS BUILDING SO AS TO PROVIDE THE LEAST AMOUNT OF DISRUPTION OF THE NORMAL BUILDING ACTIVITIES AS POSSIBLE. MAINTAIN CONDITIONED SPACE FOR ALL OWNER OCCUPIED AREAS DURING CONSTRUCTION.
- RETURN AIR BOOTS SHOWN ON DRAWINGS SHALL BE 1" INSULATED SHEET METAL BOOTS. CONTRACTOR SHALL PROVIDE PRICING FOR DUCT BOARD IN LIEU OF SHEET METAL BOOTS.

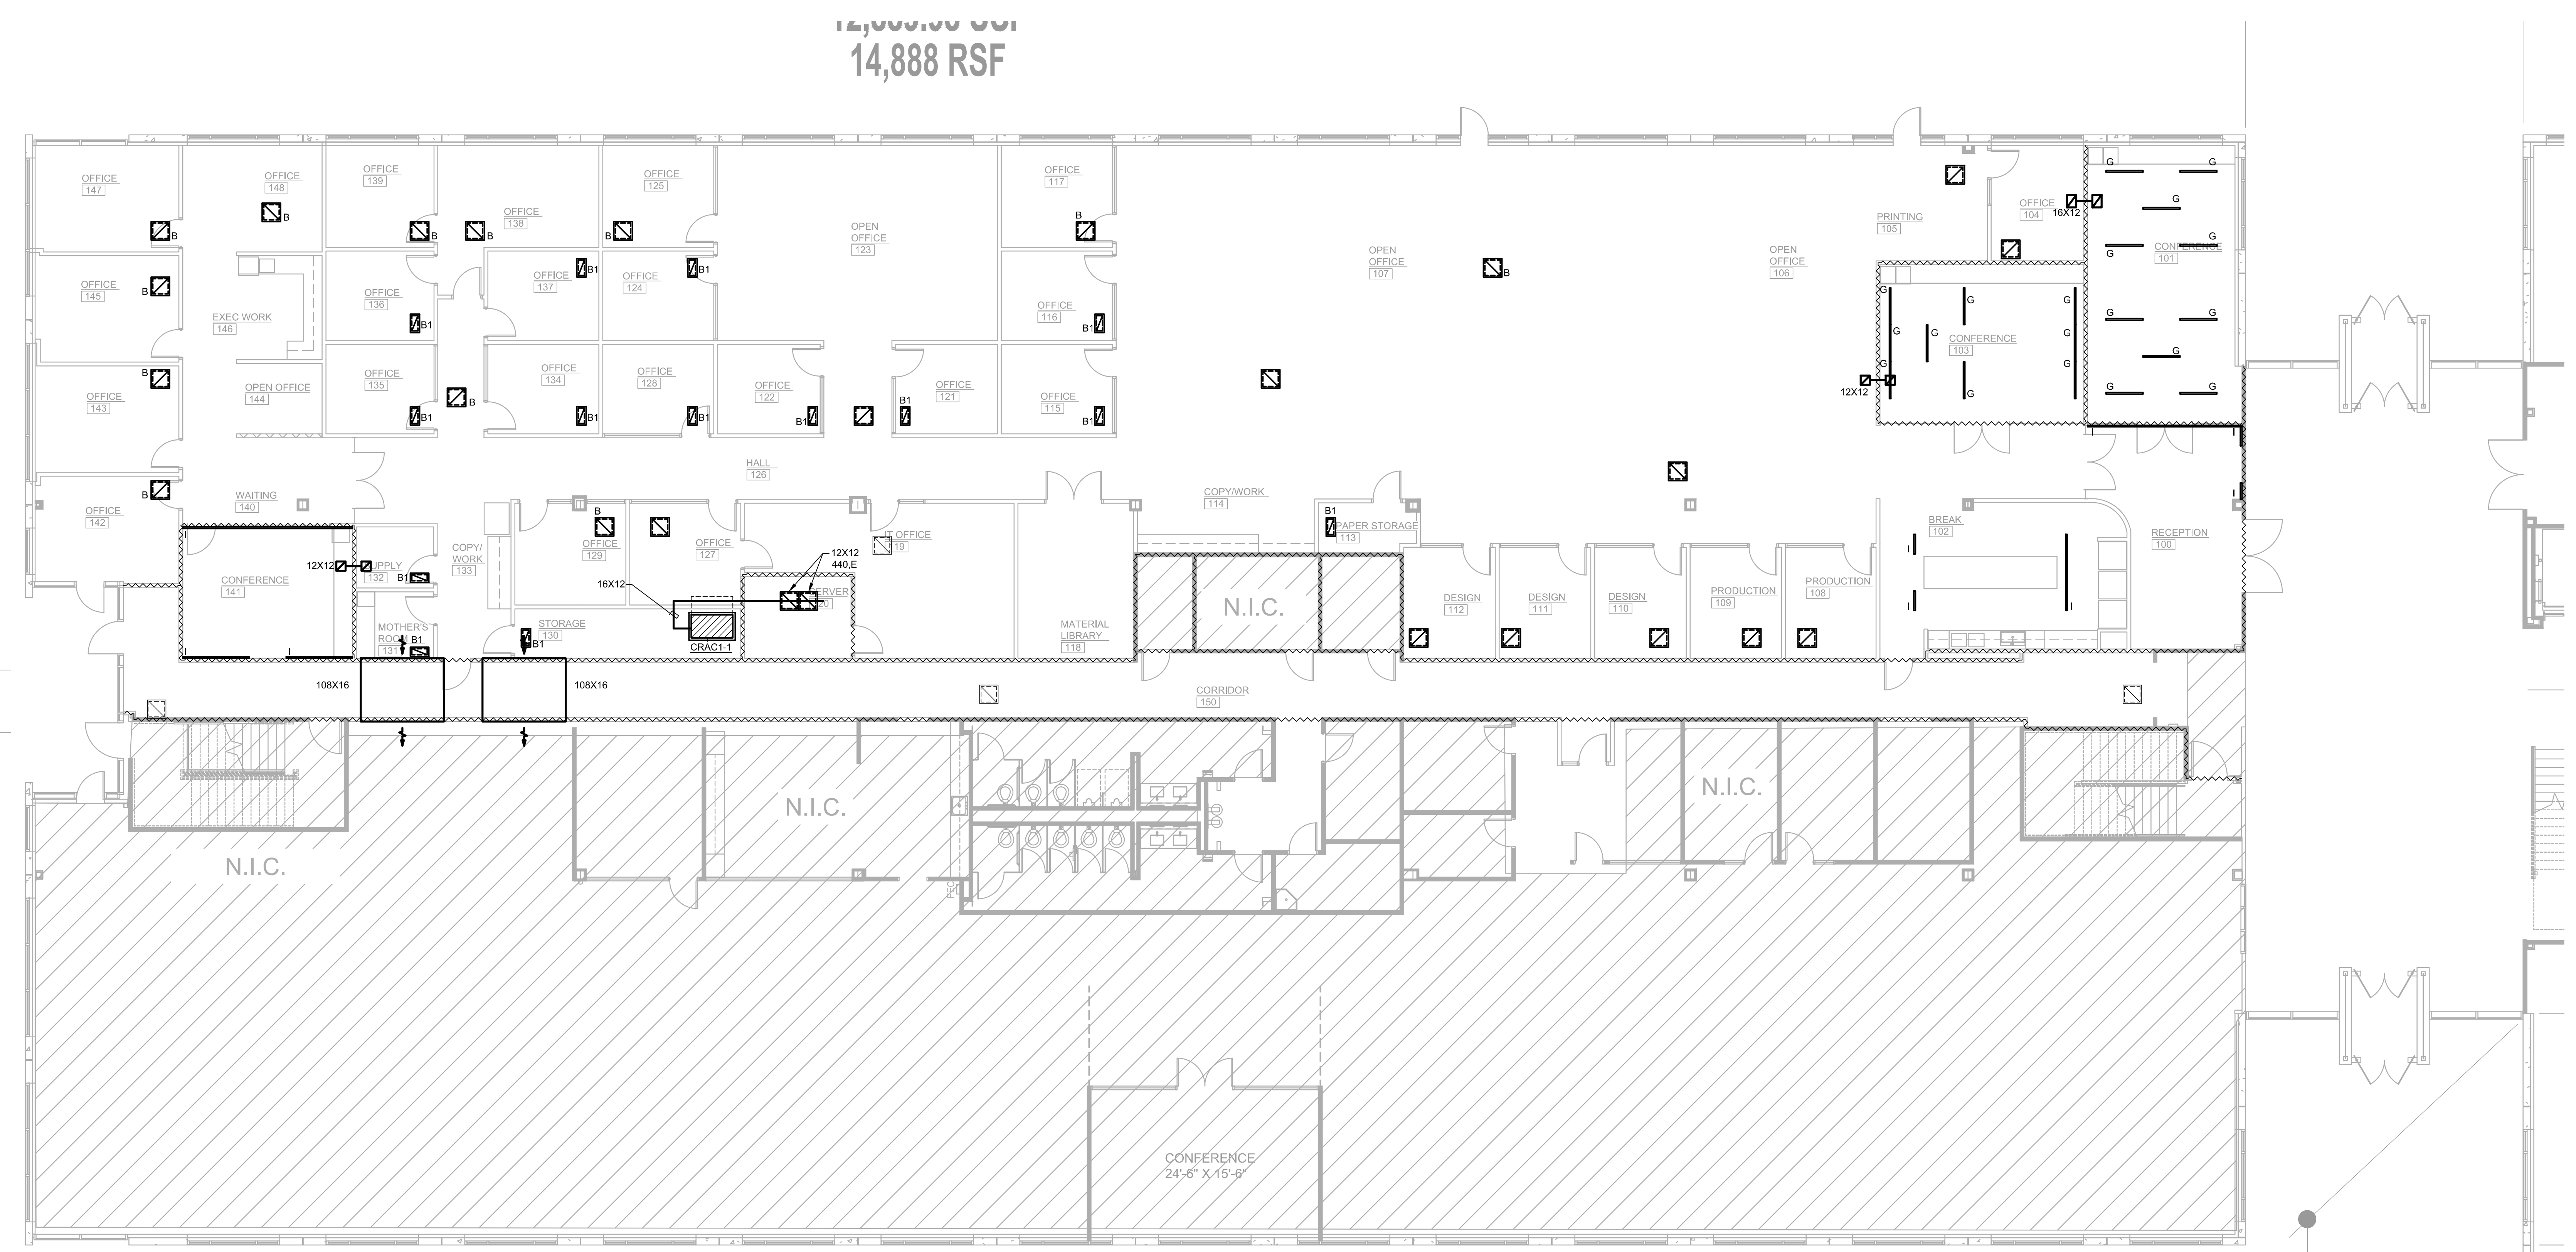

1 LEVEL 1 MECHANICAL RETURN AIR PLAN
SCALE: 1/8"=1'-0"

